



TECHNICAL MANUAL FOR CANADA



Models

■ Lossnay Unit

LGH-50RX₃-CAN

LGH-100RX₃-CAN

LGH-200RX₃-CAN

■ Lossnay Remote Controller

PZ-41SLB-E

PZ-52SF-E

CONTENTS

— Lossnay Unit —

CHAPTER 1 Ventilation for Healthy Living

1. Necessity of Ventilation	2
2. Ventilation Standards	4
3. Ventilation Method	5
4. Ventilation Performance	8
5. Outdoor Air (ventilation) Load	10

CHAPTER 2 Lossnay Construction and Principle

1. Construction and Features of Lossnay	16
2. Construction and Principle of Core	16
3. Calculation of the Total Heat Recovery Efficiency	18
4. What is a Psychrometric Chart?	19
5. Calculation of Lossnay Heat Recovery	20

CHAPTER 3 General Technical Considerations

1. Lossnay Heat Recovery Effect	22
2. Example Heat Recovery Calculation	24
3. Calculation of Lossnay Economical Effects	26
4. Psychrometric Chart	28
5. The Result of No Bacterial Cross Contamination for the Lossnay Core and Determining Resistance of the Lossnay Core to Molds	29
6. Flame-proofing Properties of Lossnay Core	31
7. Lossnay Core's Soundproofing Properties Test	33
8. Change in Lossnay Core Over Time	34
9. Comparison of Heat Recovery Techniques	36

CHAPTER 4 Characteristics

1. How to Read the Characteristic Curves	40
2. Calculating the Static Pressure Loss	40
3. How to Obtain Efficiency from Characteristic Curves	44
4. Sound	45
5. NC Curves	51
6. List of Models	52

CHAPTER 5 System Design Recommendations

1. Lossnay Usage Conditions	58
2. Noise Value of Lossnay with Built-in Fans	59
3. Attachment of Air Filter	59
4. Duct Construction	59
5. By-pass Ventilation	59
6. Transmission Rate of Various Gases and Related Maximum Workplace Concentration	60
7. Solubility of Odors and Toxic Gases, etc., in Water and Effect on Lossnay Core	61
8. Automatic Ventilation Switching	62
9. Vertical Installation	63
10. Installation of Supplementary Fan Devices After Lossnay Unit	64

CHAPTER 6 Examples of Lossnay Applications

1. Large Office Building	66
2. Medium Size Office Building	69
3. Urban Small-Scale Building	73
4. Hospitals	74
5. Schools	76
6. Public Halls (combination facilities such as day-care centres)	78

CHAPTER 7 Installation Considerations 82

CHAPTER 8 Filtering for Freshness

1. Necessity of Filters	86
2. Data Regarding Dust	86
3. Calculation Table for Dust Collection Efficiency of Each Lossnay Filter	87
4. Comparison of Dust Collection Efficiency Measurement Methods	89
5. Calculation of Dust Concentration	91

CHAPTER 9 Service Life and Maintenance

1. Service Life	94
2. Cleaning the Lossnay Core and Pre-filter	94

CHAPTER 10 Ventilation Standards in Each Country

1. Ventilation Standards in Each Country	96
2. U.S.	97
3. U.K.	97

CHAPTER 11 Lossnay Q and A 100

— Lossnay Remote Controller —

1. Summary	107
2. Applicable Models	107
3. Terminology	108
4. System Features and Examples	109
5. Examples of Applications Using External Control Input Terminals, Operation Monitor Output Terminals and Malfunction Monitor Output Terminals	127
6. Precautions When Designing Systems of M-NET	134
7. Cable Installation of the M-NET	137
8. System Designs of M-NET	140
9. Automatic Ventilation Switching	142
10. Cold Weather Area Operation Specifications	143
11. Troubleshooting	145
12. Installation method	159
13. Lossnay Remote Controller (PZ-41SLB-E)	170
14. Lossnay M-NET Remote Controller (PZ-52SF-E)	176
15. Appendix	181
*Centralised Controller (MJ-103MTRA)	181
*Remote Controllers for Mr. Slim indoor unit	188
*Network Remote Controller (PAR-F27MEA)	191

— Lossnay Unit —

CHAPTER 1

Ventilation for Healthy Living

CHAPTER 1 ● Ventilation for Healthy Living

Fresh outdoor air must be introduced constantly at a set ratio in an air conditioning system. This fresh air is introduced to be mixed with the return air from the room, to adjust the temperature and humidity, supply oxygen, reduce body and other odors, remove tobacco smoke and to increase the cleanliness of the air.

The standard ventilation (outdoor air intake) volume is determined according to the type of application, estimated number of persons in the room, room area, and relevant regulations. Systems which accurately facilitate these requirements are increasingly being required to be installed in buildings.

1. Necessity of Ventilation

The purpose of ventilation is basically divided into "oxygen supply", "cleaning of air", "temperature control" and "humidity control". Cleaning of the air includes the elimination of "odors", "gases", "dust" and "bacteria". The needs of ventilation are divided into "personal comfort", "assurance of environment for animals and plants", and "assurance of environments for machinery and constructed materials".

In Japan legal regulations regarding ventilation are set in the Building Standard Law Enforcement Ordinance and the "Building Management Law" for securing a sanitary environment in buildings. These are in general agreeance with similar regulations in other countries.

1.1 Room air environment in buildings

In Japan, the Building Management Law, a law concerning the sanitary environment of buildings, designates eleven applications including offices, shops, and schools with a total floor area of 3,000 m² or more, as buildings. According to this law maintenance and management of the ventilation and water supply and discharge according to the Environmental Sanitation Management Standards is obligatory.

The following table gives a specific account of buildings in Tokyo.
(Tokyo Food and Environment Guidance Center Report)

Specific Account of Buildings in Tokyo (March, 2003)


	Number of buildings	%
Offices	1,467	56.7
Shops	309	22.0
Department Stores	63	2.4
Schools	418	16.2
Inns	123	4.8
Theaters	86	3.3
Libraries	12	0.5
Museums	11	0.4
Assembly Halls	63	2.4
Art Museums	8	0.3
Amusement Centers	27	1.0
Total	2,587	100.0

Note: Excludes buildings with an expanded floor space of 3,000 to 5,000 m² in particular areas.

The ratio of results of the air quality measurement public inspection and the standard values that were not met (percentage of unsuitability) for the approximately 500 buildings examined in 1980 is shown in the chart at the right.

There was a large decrease in unsuitable percentages of floating particles, but there was almost no change in temperature and carbon dioxide. Values for temperature, ventilation, and carbon monoxide almost entirely cleared the standard values, and are excluded. The study from 1989 shows the item with the highest percentage of unsuitability as temperature with 37%, followed by carbon dioxide at 15%.

Percentage of unsuitability of air quality by year

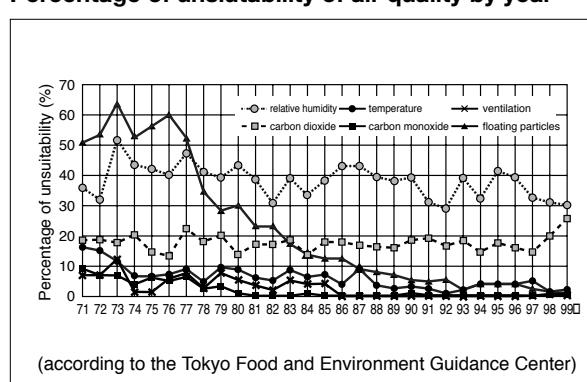

In the case of Japan, an Instruction Guideline based on these regulations has been issued, and unified guidance is carried out. Part of the Instruction Guideline regarding ventilation is shown below.

- The fresh outdoor air intake must be 10 m or higher from ground level, and be distanced appropriately from the exhaust air outlet. (Neighbouring buildings must also be considered.)
- The fresh outdoor air intake volume must be 25 to 30 m³/h·person in design.
- An air volume measurement hole must be installed at an effective position to measure the treated air volume of the ventilating device.
- The position and shape of the supply diffuser and return grille must be selected so the air environment in the room is distributed evenly.

1.2 Effect of air contamination on human bodies

Effect of oxygen (O₂) concentration

Concentration (%)	Standards and effect of concentration changes
Approx. 21	Standard atmosphere.
20.5	Ventilation air volume standard will be a guideline where concentration does not decrease more than 0.5% from normal value. (The Building Standard Law of Japan)
20 - 19	An oxygen deficiency of this amount does not directly endanger life in a normal air pressure, but if there is a combustion device in the area, the generation of CO will increase rapidly due to incomplete combustion.
18	Industrial Safety and Health Act. (Hypoxia prevention regulations.)
16	Normal concentration in exhaled air.
16 - 12	Increase in pulse and breathing resulting in dizziness and headaches.
15	Flame in combustion devices will extinguish.
12	Threat to life in short term.
7	Fatal

Effect of carbon monoxide (CO)

10,000 ppm = 1%

Concentration (ppm)	Effect of concentration changes	
0.01 - 0.2	Standard atmosphere.	
5	Considered to be the long-term tolerable value.	
10	The Building Standard Law of Japan, Law for Maintenance of Sanitation in Buildings. Environmental standard 24-hour average.	Apprx. 5 ppm is an annual average value in city areas. This value may exceed 100 ppm near roads, in tunnels and parking areas.
20	Considered to be the short-term tolerable value. Environmental standard 8-hour average.	
50	Tolerable concentration for labor environment. (Japan Industrial Sanitation Association)	
100	No effect for 3 hours. Effect noticed after 6 hours. Headache, illness after 9 hours; harmful for long-term but not fatal.	
200	Light headache in the forehead in 2 to 3 hours.	
400	Headache in the forehead, nausea in 1 to 2 hours; headache in the back of head in 2.5 to 3 hours.	
800	Headache, dizziness, nausea, convulsions in 45 minutes. Comatose in 2 hours.	
1,600	Headache, dizziness in 20 minutes. Death in 2 hours.	
3,200	Headache, dizziness in 5 to 10 minutes. Death in 30 minutes.	
6,400	Death in 10 to 15 minutes.	
12,800	Death in 1 to 3 minutes.	
Several 10,000 ppm (Several %)	This level may be found in automobile exhaust.	

Effect of carbon dioxide (CO₂)

Concentration (%)	Effect of concentration changes	
0.03 (0.04)	Standard atmosphere.	
0.04 - 0.06	City air.	
0.07	Tolerable concentration when many people stay for long time.	
0.10	General tolerable concentration. The Building Standard Law of Japan, Law for Maintenance of Sanitation in Buildings.	There is no toxic level in CO ₂ alone. However, these tolerable concentrations are a guideline of the contamination estimated when the physical and chemical properties of the air deteriorate in proportion to the increase of CO ₂ .
0.15	Tolerable concentration used for ventilation calculations.	
0.2 - 0.5	Observed as relatively poor.	
0.5 or more	Observed as the poorest.	
0.5	Long-term safety limits (U.S. Labor Sanitation) ACGIH, regulation of laborer offices.	
2	Depth of breathing and inhalation volume increases 30%.	
3	Work and physical functions deteriorate, breathing doubles.	
4	Normal exhalation concentration.	
4 - 5	The respiratory center is stimulated; depth and times of breathing increases. Dangerous if breathed in for a long period. If an O ₂ deficiency also occurs, trouble will occur sooner and be more dangerous.	
8	When breathed in for 10 minutes, breathing difficulties, redness in the face and headaches will occur. The trouble will worsen when there is also a deficiency of O ₂ .	
18 or more	Fatal	

Note: According to Facility Check List published by Kagekuni-sha.

1.3 Effect of air contamination in buildings

- Dirtiness of interior

New ceilings, walls and ornaments will turn yellow in one to two years. This is caused by dust and the tar in tobacco smoke.

2. Ventilation Standards

The legal standards for ventilation differ according to each country. Please follow the standards set by the country. In the US, Ashrae revised their standards in 1989 becoming more strict.

In Japan, regulations are set in the The Building Standard Law of Japan Enforcement Ordinance, the so-called "Building Management Law" for securing a sanitary environment in buildings. According to the Building Standards Law, a minimum of 20 m³/h per person of ventilation air is required.

3. Ventilation Method

3.1 Ventilation class and selection points




An appropriate ventilation method must be selected according to the purpose.

Ventilation is composed of "Supply air" and "Exhaust air" functions. These functions are classified according to natural flow or mechanical ventilation using a fan (forced ventilation).

Classification of ventilation (according to Building Standards Law)

	Supply	Exhaust	Ventilation volume	Room pressure
Class 1	Mechanical	Mechanical	Random (constant)	Random
Class 2	Mechanical	Natural	Random (constant)	Positive pressure
Class 3	Natural	Mechanical	Random (constant)	Negative pressure
Class 4	Natural	Mechanical & natural	Limited (inconstant)	Negative pressure

Classification of mechanical ventilation

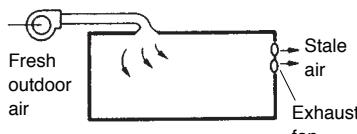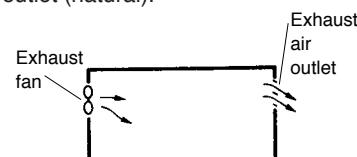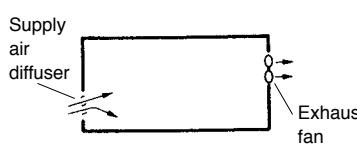	Ex. of application	System effect	Design and construction properties	Selection points
1. Class 1 ventilation Fresh outdoor air is mechanically brought in and simultaneously the stale air in the room is mechanically discharged.	<ul style="list-style-type: none"> Ventilation of air conditioned rooms. (buildings, hospitals, etc.) Ventilation of room not facing an outer wall. (basement, etc.) Ventilation of large room. (office, large conference room, hall, etc.) 	<p>By changing the balance of the supply fan and exhaust fan's air volumes, the pressure in the room can be balanced freely, and the interrelation with neighboring spaces can be set freely.</p>	<ul style="list-style-type: none"> An ideal design in which the supply air diffuser and exhaust air outlet position relation and air volume, etc., can be set freely is possible. A system which adjusts the temperature and humidity of the supply air diffuser flow to the room environment can be incorporated. The supply and exhaust volume can be set freely according to the changes in conditions. 	<ul style="list-style-type: none"> Accurate supply air diffuser can be maintained. The room pressure balance can be maintained. The supply air diffuser temperature and humidity can be adjusted and dust treatment is possible.
2. Class 2 ventilation Fresh outdoor air is mechanically brought in and the exhaust air is discharged from the exhaust air outlet (natural).	<ul style="list-style-type: none"> Surgery theatre. Clean rooms. Foodstuff processing factories. 	<p>As the room is pressurized, the flow of odors and dust, etc., from neighboring areas can be prevented.</p>	<ul style="list-style-type: none"> The position and shape of the supply air diffuser can be set. The temperature and humidity of the supply air diffuser flow can be set accordingly, and dust can be removed as required. 	<ul style="list-style-type: none"> The pressure is positive. The supply air diffuser temperature and humidity can be adjusted, and dust treatment is possible. The positional relation of the exhaust air outlet to the supply air diffuser is important.
3. Class 3 ventilation The stale air in the room is mechanically discharged and simultaneously fresh outdoor air is mechanically introduced from the supply air diffuser (natural).	<ul style="list-style-type: none"> Local ventilation in kitchens. Ventilation of hot exhaust air from machine room, etc. Ventilation of humid exhaust air from indoor pools, bathrooms, etc. General simple ventilation. 	<p>The exhaust air is removed from a local position in the room, and dispersion of the stale air can be prevented by applying an entire negative pressure.</p>	<ul style="list-style-type: none"> Effective exhausting of dispersed stale air generation sites is possible from a local exhaust air outlet. Ventilation in which the air flow is not felt is possible with the supply air diffuser setting method. 	<ul style="list-style-type: none"> The room pressure is negative. Local exhaust is possible. Ventilation without dispersing stale air is possible. Ventilation with reduced air flow is possible. The positional relation of the exhaust air outlet to the supply air diffuser is important.

3.2 Comparison of ventilation methods

There are two main types of ventilation methods.


Centralized ventilation method

This is mainly used in large buildings, with the fresh outdoor air intake being installed in one machine room. For this method, primary treatment of the fresh outdoor air, such as heat recovery to the intake air and dust removal is performed before distribution to the building by ducts.

Independent zoned ventilation method


This is mainly used in small to medium sized buildings, with areas being ventilated using fresh outdoor air intakes formed of independent ventilation devices. The rate of use of this method has recently increased as independent control is becoming ever more feasible.

Centralised ventilation method

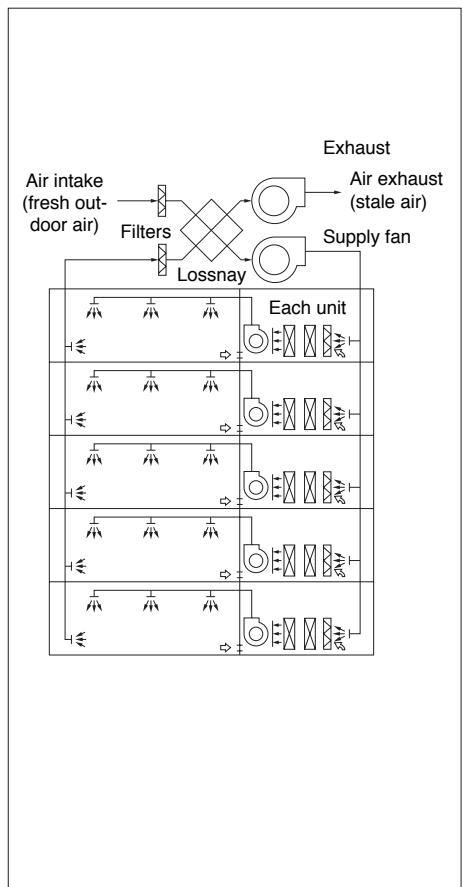


Independent zoned ventilation method


1) System operation with cassette-type air conditioner

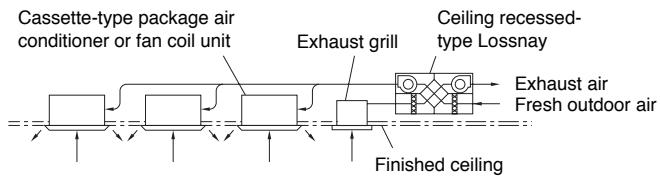

2) System operation with ceiling embedded-type air conditioner

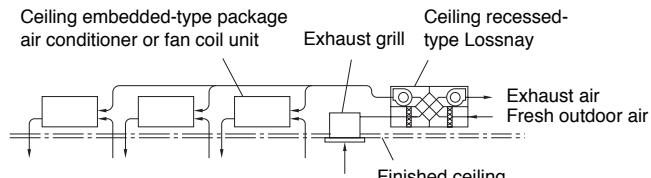

3) Independent operation with ceiling suspended-type air conditioner

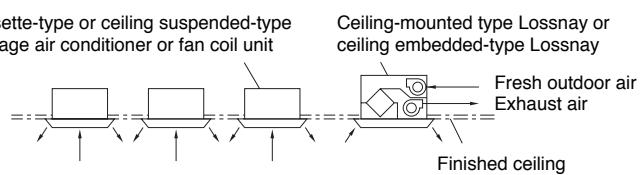

Comparison of centralised ventilation method and independent zoned ventilation method

	Centralized ventilation method	Independent zoned ventilation method
Fan power	The air transfer distance is long thus requiring much fan power.	As the air transfer distance is short, the fan power is small.
Installation space	<ul style="list-style-type: none"> • Independent equipment room is required. • Duct space is required. • Penetration of floors with vertical shaft is not desired in terms of fire prevention. 	<ul style="list-style-type: none"> • Independent equipment room is not required. • Piping space is required only above the ceiling.
Zoning	Generalized per system.	Can be utilised for any one area.
Designability	<ul style="list-style-type: none"> • Design of outer wall is not lost. • The indoor supply air diffuser and return grille can be selected freely for an appropriate design. 	<ul style="list-style-type: none"> • The number of intakes and exhaust air outlets on the outer wall will increase; design must be considered. • The design will be fixed due to the installation fittings, so the design of the intakes and exhaust air outlets must be considered.
Clarification of costs	As there are many common-use areas, if the building is a tenant building, an accurate assessment of operating cost is difficult.	Invoicing for each zone separately is possible, even in a tenant building.
Controllability	<ul style="list-style-type: none"> • As the usage time setting and ventilation volume control, etc., is performed in a central monitoring room, the user's needs may not be met appropriately. • A large amount of ventilation is required even for a few persons. 	<ul style="list-style-type: none"> • The user in each zone can operate the ventilator freely. • The ventilator can be operated even during off-peak hours.
Comfort	<ul style="list-style-type: none"> • An ideal supply air diffuser and return grille position can be selected as the supply air diffuser and return grilles can be laid out freely. • The only noise in the room is the aerodynamic sound. • Anti-vibration measures must be taken as the fan in the equipment room is large. 	<ul style="list-style-type: none"> • Consideration must be made of the noise from the main unit. • Anti-vibration measures are often not required as the unit is compact and the vibration generated can be dispersed.
Maintenance and management	<ul style="list-style-type: none"> • Centralized management is easy as it can be performed in the equipment room. • The equipment can be inspected at any time. 	<ul style="list-style-type: none"> • Work efficiency is poor as the equipment is not centrally located. • An individual unit can be inspected only when the room it serves is vacant.
Trouble correspondence	<ul style="list-style-type: none"> • Large as the entire system is affected. • Immediate inspection can be performed in the equipment room. 	<ul style="list-style-type: none"> • Limited as only independent units are affected. • Consultation with the tenant is required prior to inspection of an individual unit.

4. Ventilation Performance

The ventilation performance is largely affected by the installation conditions. Ample performance may not be achieved unless the model and usage methods are selected according to the conditions.

Generally, the ventilation performance is expressed by “Air volume” and “wind pressure (static pressure)”, and these are necessary when considering ventilation.

4.1 Air volume

Air volume expresses the volume of air exhausted (or supplied) by the unit in a given period. Generally, this is expressed as m^3/hr (hour).

4.2 Wind pressure

When a piece of paper is placed in front of a fan and let go, the piece of paper will be blown away. The force that blows the paper away is called the wind pressure, and this is normally expressed in units of Pa. The wind pressure is divided into the following three types:

4.2.1 Static pressure

This is the force that presses the surroundings when the air is still such as in an automobile tyre or rubber balloon. For example, in a water gun, the hydraulic pressure increases when pressed by a piston, and if there is a small hole, the water sprays out with force. The pressure of this water is equivalent to the static pressure for air. The higher the pressure is, the further the water (air) can be sprayed.

4.2.2 Dynamic pressure

This expresses the speed at which air flows, and can be thought of as the force at which a typhoon presses against a building.


4.2.3 Total pressure

This is the total force that wind has, and is the sum of the static pressure and dynamic pressure.


4.3 Measurement of the air volume and wind pressure

Mitsubishi measures the machine's air volume and wind pressure with a device as shown below according to the Japan Industrial Standards (JIS B 8628).

Measuring device using orifice (JIS B 8628 standards)

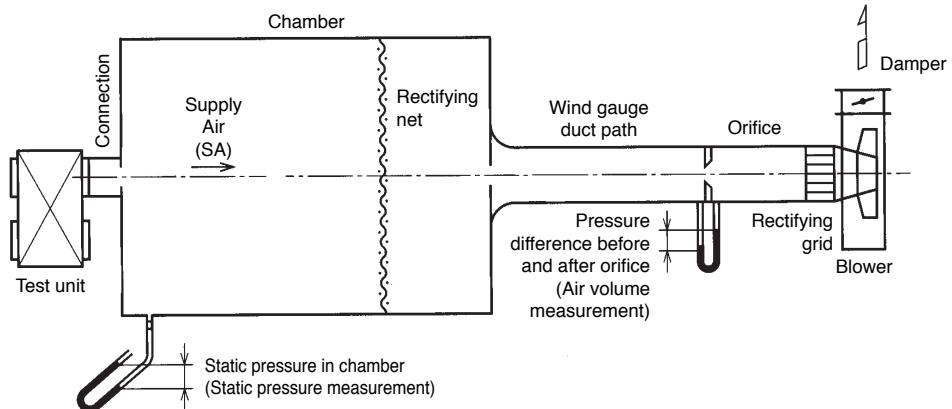


A) When measuring the supply air volume (with the orifice plate)

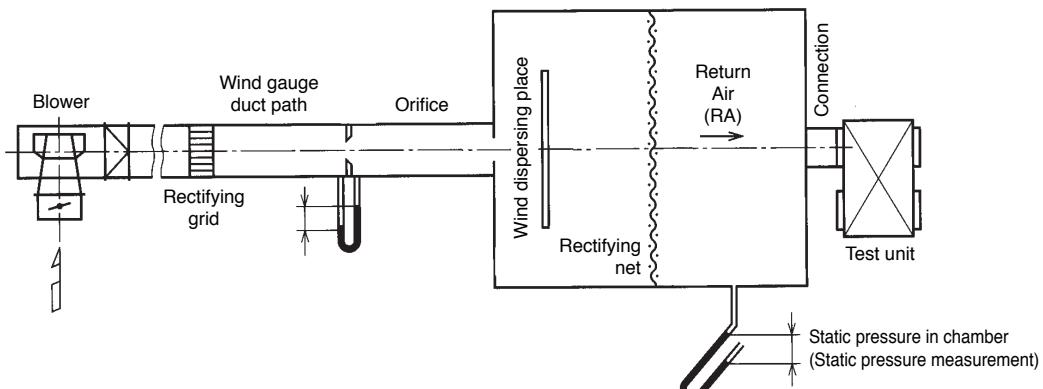

B) When measuring the return air volume (with the orifice plate)

Measurement method

The unit is operated with the throttle device fully closed. There is no air flow at this time, and the air volume is 0. The maximum point of the static pressure (A point, the static pressure at this point is called the totally closed pressure) can be obtained. Next, the throttle device is gradually opened, the auxiliary fan is operated, and the middle points (points B, C and D) are obtained. Finally, the throttle device is completely opened, and the auxiliary fan is operated until the static pressure in the chamber reaches 0. The maximum point of the air volume (point E, the air volume at this point is called the fully opened air volume) is obtained. The points are connected as shown below, and are expressed as air volume, static pressure curves (Q-H curve).

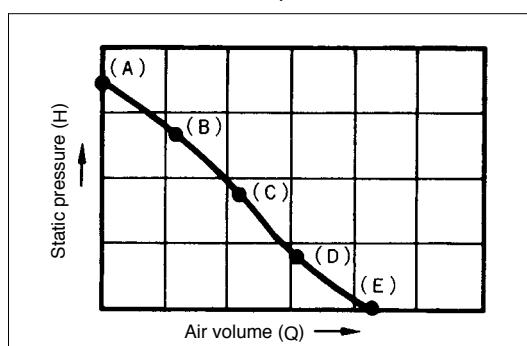

5. Outdoor Air (ventilation) Load

5.1 How to calculate each approximate load

The outdoor air load can be calculated with the following formula if the required outside air intake volume Q m³/h to be introduced is known:

$$(\text{Outdoor air load}) = \gamma \cdot QF \cdot (io - ir)$$

$$= \gamma [\text{kg/m}^3] \times S[\text{m}^2] \times k \times n [\text{person/m}^2] \times Vf [\text{m}^3/\text{h}\cdot\text{person}] \times (io - ir) : \Delta i [\text{kJ/kg}]$$

γ : Specific gravity of air - 1.2 kg/m³

S : Building's airconditioned area

k : Thermal coefficient; generally 0.7 - 0.8.

n : The average population concentration is the inverse of the occupancy area per person. If the number of persons in the room is unclear, refer to the Floor space per person table below.

Vf : Outdoor air intake volume per person

Refer to the Required outdoor air intake volume per person table below.

io : Outdoor air enthalpy - kJ/kg

ir : Indoor enthalpy - kJ/kg

Floor space per person table (m²)

(According to the Japan Federation of Architects and Building Engineers Associations)

	Office building	Department store, shop			Restaurant	Teatre or cinema hall
		Average	Crowded	Empty		
General design	4 - 7	0.5 - 2	0.5 - 2	5 - 8	1 - 2	0.4 - 0.6
value	5	3.0	1.0	6.0	1.5	0.5

Required outdoor air intake volume per person table (m³/h·person)

Degree of smoking	Application example	Required ventilation volume	
		Recommended value	Minimum value
Extremely heavy	Broker's office Newspaper editing room Conference room	85	51
Quite heavy	Bar Cabaret	51	42.5
Heavy	Office Restaurant	25.5	17 20
Light	Shop Department store	25.5	17
None	Theatre Hospital room	25.5 34	17 25.5

⚠ Caution

The application of this table to each type of room should be carefully considered in relation to the degree of smoking in the room.

Example calculations of determining ventilation load during both cooling and heating are given as follows:


5.2 Ventilation load during cooling (in general office building)

● Classification of cooling load

Class		
(a)	Indoor infiltration heat	Heat from walls (q _{ws}) Heat from glass { from direct sunlight (q _{GS}) from conduction & convection (q _{GC}) Accumulated heat load in walls (q _{ss})
(b)	Indoor generated heat	Generated heat from people { Sensible heat (q _{HS}) Latent heat (q _{HL}) Generated heat from electrical equipment { Sensible heat (q _{ES}) Latent heat (q _{EL})
(c)	Reheating load	(q _{RL})
(d)	Outdoor air load	{ Sensible heat (q _{FS}) Latent heat (q _{FL})

- (a) is the heat infiltrating the room, and often is 30 to 40% of the entire cooling load.
- (b) is the heat generated in the room.
- (c) applies only when reheating is necessary.
- (d) is the heat generated when outdoor air is mixed into part of the supply air diffuser volume and introduced into the room. The outdoor air is introduced to provide ventilation for the people in the room, and is referred to as the ventilating load.

Typical load values (during cooling)

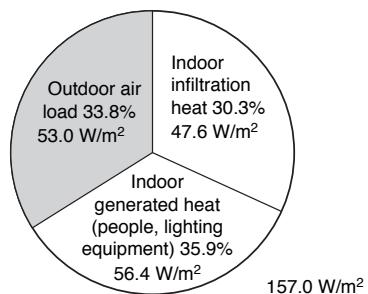

Type of load	Load
Outdoor air load	53.0 W/m ²
Indoor generated heat	26.4 W/m ²
	30.0 W/m ²
Indoor infiltration heat	47.6 W/m ²
Total	157.0 W/m ²

Conditions: Middle floor of a general office building facing south.

Cooling load per unit area

When the volume of outdoor air per person is 25 m³/h, and the number of persons per 1 m² is 0.2, the cooling load will be approximately 157.0 W/m².

How these values are determined can be seen as follows:

● Outdoor air load

Air conditions <Standard design air conditions in Tokyo>

		Dry bulb temp.	Relative humidity	Wet bulb temp.	Enthalpy	Enthalpy difference
Cooling	Outdoor air	33 °C	63%	27 °C	85 kJ/kg	31.8 kJ/kg
	Indoors	26 °C	50%	18.7 °C	53.2 kJ/kg	

When the load per floor area of 1 m² with a ventilation volume of 25 m³/h·person is calculated with the above air conditions, the following is obtained:

$$\begin{aligned} \text{Outdoor air (ventilation) load} &= 1.2 \text{ kg/m}^3 \text{ (Specific gravity of air)} \times 0.2 \text{ persons/m}^2 \text{ (no. of persons per } 1 \text{ m}^2) \\ &\times 25 \text{ m}^3/\text{h} \cdot \text{person (outdoor air volume)} \times 31.8 \text{ kJ/kg (air enthalpy difference indoors/outdoors)} \\ &= 190.8 \text{ kJ/h} \cdot \text{m}^2 \text{ (53.0 W/m}^2\text{)} \end{aligned}$$

The Lossnay recuperates approximately 70% of the exhaust air load and saves on approximately 20% of the total load.

CHAPTER 1 ● Ventilation for Healthy Living

● Determining internal heat gain

When classifying loads, the internal heat gain (indoor generated heat + indoor infiltration heat) will be the value of the outdoor air load subtracted from the approximate cooling load when it is assumed that there is no reheating load.

(Internal heat gain)

$$= 157.0 \text{ W/m}^2 - 53.0 \text{ W/m}^2 = 104.0 \text{ W/m}^2$$

- This value of internal heat gain is based on assumptions for typical loads. To determine individual levels of internal heat gain, the following is suggested:

● Indoor generated heat

- (1) Heat generated from people

Heat generation design value per person in office

Sensible heat (SH) = 63.0 W/person

Latent heat (LH) = 69.0 W/person

Total heat (TH) = 132.0 W/person

The heat generated per 1 m² of floor space is

(heat generated from people)

$$= 132.0 \text{ W/person} \times 0.2 \text{ person/m}^2 = 26.4 \text{ W/m}^2$$

- (2) Heat generated from electrical equipment (lighting)

The approximate value of the room illuminance and power for lighting for a general office with illuminance of 300 - 350 Lux, is 20 - 30 W/m².

● Indoor infiltration heat

This is the heat that infiltrates into the building from outside. This can be determined by subtracting the amount of heat generated by people and lighting from the internal heat gain.

(Indoor infiltration heat)

$$= 104.0 - (26.4 + 30.0) = 47.6 \text{ W/m}^2$$

The Lossnay recuperates approximately 70% of the outdoor air load and saves on approximately 20% of the total load.


5.3 Ventilation load during heating

● Classification of heating load

	Class	
(a)	Indoor heat loss	Heat lost from walls (qws) Heat lost from glass (qgs) Heat loss from conduction & convection (qcs) Accumulated heat load in walls (qss)
(b)	Outdoor air load	Sensible heat (qfs) Latent heat (qfl)

During heating, the heat generated by people and electrical equipment in the room can be subtracted from the heating load. However, as the warming up time at the start of heating is short, this generated heat may be ignored in some cases.

Percentage of load

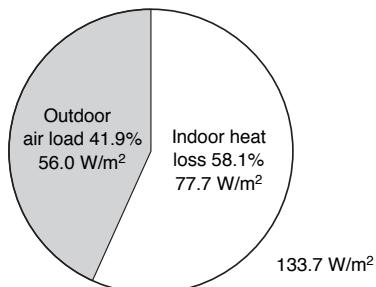

Type of load	Load
Outdoor air load	56.0 W/m ²
Internal heat	77.7 W/m ²
Total	133.7 W/m ²

Conditions: Middle floor of a general office building facing south.

Internal heat loss

In terms of load classification, the internal heat loss is the value of the outdoor air load subtracted from the approximate heating load.

$$\text{Internal heat loss} = 133.7 \text{ W/m}^2 - 56.0 \text{ W/m}^2 = 77.7 \text{ W/m}^2$$

Heating load per unit area

When the outdoor air volume per person is 25 m³/h, and the number of persons per 1 m² is 0.2 persons, the approximate heating load will be approximately 133.7 W/m².

● Outdoor air load

Air conditions <Standard design air conditions in Tokyo>

	Dry bulb temp.	Relative humidity	Wet bulb temp.	Enthalpy	Enthalpy difference
Cooling	Outdoor air	0 °C	50%	-3 °C	5.0 kJ/kg
	Indoors	20 °C	50%	13.7 °C	38.5 kJ/kg

When the load per 1 m² of floor area with a ventilation volume of 25 m³/h·person is calculated with the above air conditions, the following is obtained:

$$\begin{aligned} \text{Outdoor air (ventilation) load} &= 1.2 \text{ kg/m}^3 \times 0.2 \text{ persons/m}^2 \times 25 \text{ m}^3/\text{h} \cdot \text{person} \times 33.5 \text{ kJ/kg} \\ &= 201.0 \text{ kJ/h} \cdot \text{m}^2 (56 \text{ W/m}^2) \end{aligned}$$

The Lossnay recuperates approximately 70% of the outdoor air load and saves on approximately 30% of the total load.

CHAPTER 2


Lossnay Construction and Principle

1. Construction and Features of Lossnay

● Lossnay construction

The Lossnay is constructed so that the exhaust air passage from the indoor side to the outdoor side (RA → EA) and the fresh air passage from the outdoor side to the indoor side (OA → SA) cross. The Lossnay heat recovery unit (Lossnay Core) is installed at this cross point, and recovers the heat by conduction through the separating medium between these airflows. This enables the heat loss during exhaust to be greatly reduced.

- * RA : Return Air
- EA : Exhaust Air
- OA : Outdoor Air
- SA : Supply Air

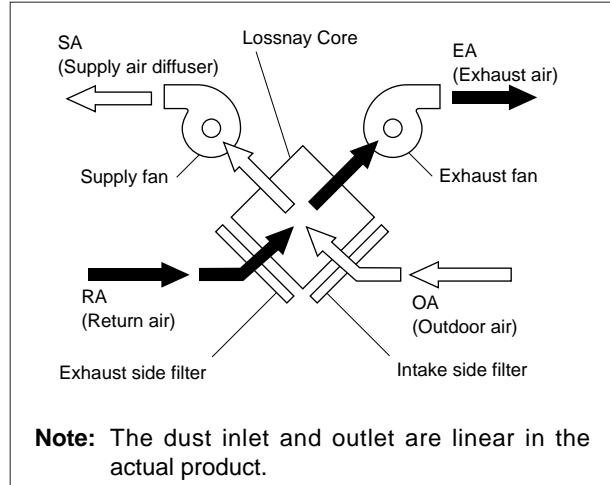

Main Features of Lossnay

- (1) Cooling and heating maintenance fees are saved while ventilating.
- (2) The capacity and performance of the air conditioner can be reduced.
- (3) Dehumidifying during summer, and humidifying during winter is possible.
- (4) Comfortable ventilation is possible, (the outdoor air being adjusted to the room temperature.)
- (5) Effective sound-proofing.

2. Construction and Principle of Core


● Simple construction

The Lossnay Core is a cross-flow total heat recovery unit constructed of plates and fins made of treated paper.

The fresh air and exhaust air passages are totally separated allowing the fresh air to be introduced without mixing with the exhaust air.

● Principle

The Lossnay Core uses the heat transfer properties and moisture permeability of the treated paper. Total heat (sensible heat plus latent heat) is transferred from the stale exhaust air to the fresh air being introduced into the system when they pass through the Lossnay. Try this simple experiment. Roll a piece of paper into a tube and blow through it. Your hand holding the paper will immediately feel warm. If cold air is blown through the tube, your hand will immediately feel cool. Lossnay is a total heat exchanger that utilizes these special properties of paper.

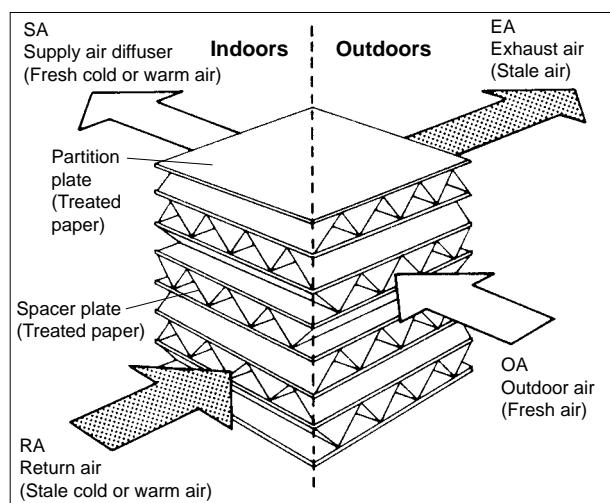

● Treated paper

The paper partition plates are treated with special chemicals so that the Lossnay Core is an appropriate heat recovery unit for the ventilator. This paper differs from ordinary paper, and has the following unique properties.

- (1) The paper is incombustible and is strong.
- (2) The paper has selective hydroscopicity and moisture permeability that permits the passage of water vapor only (including some water-soluble gases).
- (3) The paper has gas barrier properties that does not pass gases such as CO₂.

A comparison of the ordinary paper and the Lossnay Core plates is as shown in the table.

Ordinary paper	
Water vapor is transferred, but gas elements that are easily dissolved in water such as CO ₂ , NO ₂ are also transferred. 	Highly humid air → Water vapor, CO ₂ , NO ₂ Water vapor, CO ₂ , NO ₂ ← Low humid air
The contaminated air passes through the plates during ventilation and returns to the room.	
Treated paper	
Water vapor is transferred, but gas elements such as CO ₂ , NO ₂ are not transferred. 	Highly humid air → Water vapor, CO ₂ , NO ₂ Cellulose fibers Water vapor ← Low humid air Treatment (Selective permeable film) (Incombustible specifications)
The contaminated air does not return to the room when ventilated.	


● Total heat recovery mechanism

Sensible heat and latent heat

The heat that enters and leaves in accordance with changing temperature (rise or drop) is called sensible heat. The heat that enters and leaves due to the changes in a matter's physical properties (evaporation, condensation) is called latent heat.

(1) Temperature (sensible heat) recovery

- Heat conduction and heat passage is performed through a partition plate from the high temperature to low temperature side.
- As shown on the right, the heat recovery efficiency is affected by the resistance of the boundary layer, and for the Lossnay there is little difference when compared to materials such as copper or aluminium which also have high thermal conductivity.

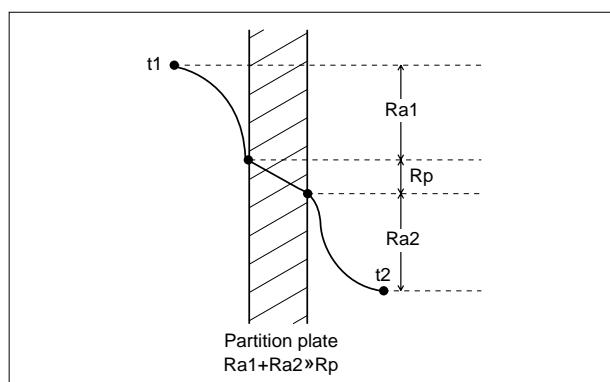


Heat resistance coefficients

	Treated paper	Cu	Al
Ra1	10	10	10
Rp	1	0.00036	0.0006
Ra2	10	10	10
Total	21	20.00036	20.0006

(2) Humidity (latent heat) recovery

- Water vapor is moved through the partition plate from the high humidity to low humidity side by means of the differential pressure in the vapor.

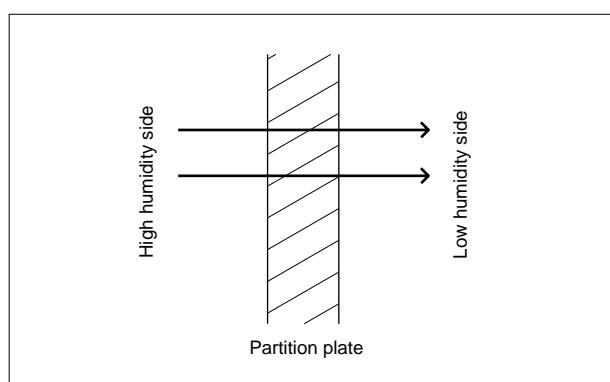

3. Calculation of the Total Heat Recovery Efficiency


The Lossnay Core's heat recovery efficiency can be considered using the following three transfer rates:

- (1) Temperature (sensible heat) recovery efficiency
- (2) Humidity (latent heat) recovery efficiency
- (3) Enthalpy (total heat) recovery efficiency

The heat recovery effect can be calculated if two of the above efficiencies are known. (The temperature and enthalpy efficiencies are indicated in the applicable catalogue.)

- Each recovery efficiency can be calculated with the formulas given below.
- When the supply air volume and exhaust air volume are equal, the heat recovery efficiencies on the supply and exhaust sides are the same.
- When the supply air volume and exhaust air volume are not equal, the total heat recovery efficiency is low if the exhaust volume is lower, and high if the exhaust volume is higher.

Refer to the Heat Recovery Efficiency Correction Curve in the applicable catalogue for more details.

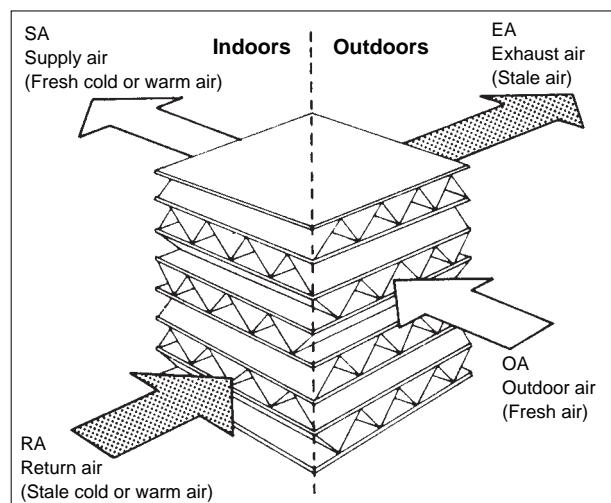

Item	Formula
Temperature recovery efficiency (%)	$\eta_t = \frac{t(OA) - t(SA)}{t(OA) - t(RA)} \times 100$
Enthalpy recovery efficiency (%)	$\eta_i = \frac{i(OA) - i(SA)}{i(OA) - i(RA)} \times 100$

η : Efficiency (%)

t : Dry bulb temperature (°C)

i : Enthalpy (kJ/kg)

Calculation of air conditions after passing through Lossnay

If the Lossnay heat recovery efficiency and the conditions of the room and outdoor air are known, the conditions of the air entering the room and the air exhausted outdoors can be determined with the following formulas.


	Supply side	Exhaust side
Temperature	$t_{SA} = t_{OA} - (t_{OA} - t_{RA}) \cdot \eta_t$	$t_{EA} = t_{RA} + (t_{OA} - t_{RA}) \cdot \eta_t$
Enthalpy	$i_{SA} = i_{OA} - (i_{OA} - i_{RA}) \cdot \eta_i$	$i_{EA} = i_{RA} + (i_{OA} - i_{RA}) \cdot \eta_i$

4. What is a Psychrometric Chart?

The chart which shows the properties of humid air is called a psychrometric chart. The psychrometric chart can be used to find the (1) Dry bulb temperature, (2) Wet bulb temperature, (3) Absolute humidity, (4) Relative humidity, (5) Dew point and (6) Enthalpy (total heat) of a certain air condition. If two of these values are known beforehand, the other values can be found with this chart. The way that the air will change when it is heated, cooled, humidified or dehumidified can also be seen easily on the chart.


(1) Dry bulb temperature t ($^{\circ}\text{C}$)

Generally referred to as standard temperature this is measured with a dry bulb thermometer (conventional thermometer). The obtained value is the dry bulb temperature.

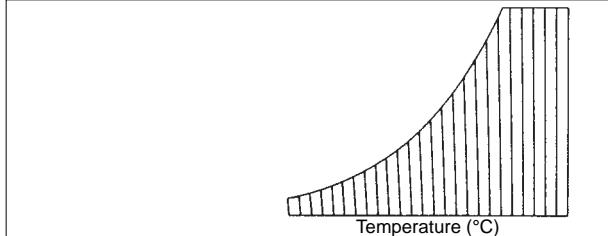


(2) Wet bulb temperature t' ($^{\circ}\text{C}$)

When a dry bulb thermometer's heat sensing section is wrapped in a piece of wet gauze and an ample air flow (3 m/s or more) is applied, the heat applied to the wet bulb by the air and the heat of the water vapor that evaporates from the wet bulb will balance at an equal state. The temperature indicated at this time is called the wet bulb temperature.

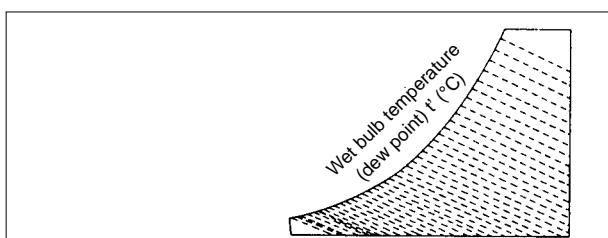

(3) Absolute humidity x ($\text{kg/kg}'$)


The weight (kg) of the water vapor that corresponds to the weight (kg') of the dry air in the humid air is called the absolute humidity.

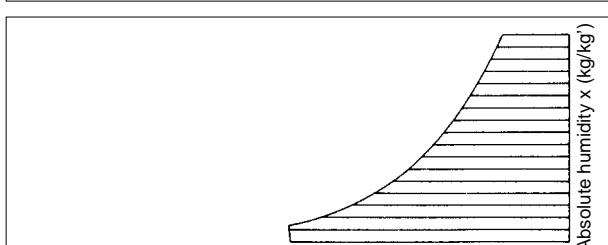

(4) Relative humidity φ (%)

The ratio of the water vapor pressure P_w in the humid air and the water vapor pressure P_{ws} in the saturated air at the same temperature is called the relative humidity. This is obtained with the following formula:


$$\varphi = P_w/P_{ws} \times 100$$

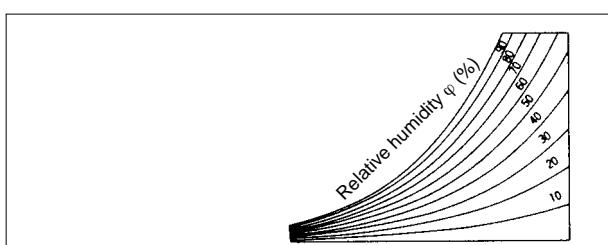

(5) Dew point t'' ($^{\circ}\text{C}$)


The water content in the air will start to condense when air is cooled.

The dry bulb temperature at this time is called the dew point.

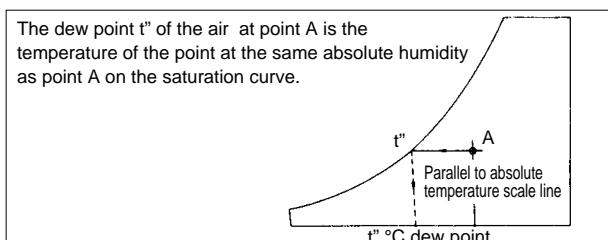

(6) Enthalpy i (kJ/kg)


Physical matter has a set heat when it is at a certain temperature and state. This retained heat is called the enthalpy, with dry air at 0 $^{\circ}\text{C}$ being set at 0.

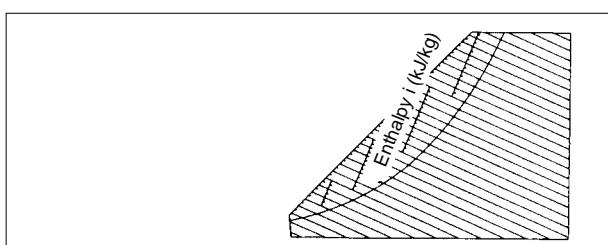

5. Calculation of Lossnay Heat Recovery

The following figure shows the conditions of various air states when fresh air is introduced through the Lossnay Core. If a conventional sensible heat recovery unit is used alone and is assumed to have the same heat recovery efficiency as Lossnay, the condition of the air supplied to the room is expressed by point A in the figure. This point shows that the air is very humid in summer and very dry in winter.

The air supplied to the room with Lossnay is indicated by point S in the figure. The air is precooled and dehumidified in the summer and preheated and humidified in the winter before it is introduced to the room.

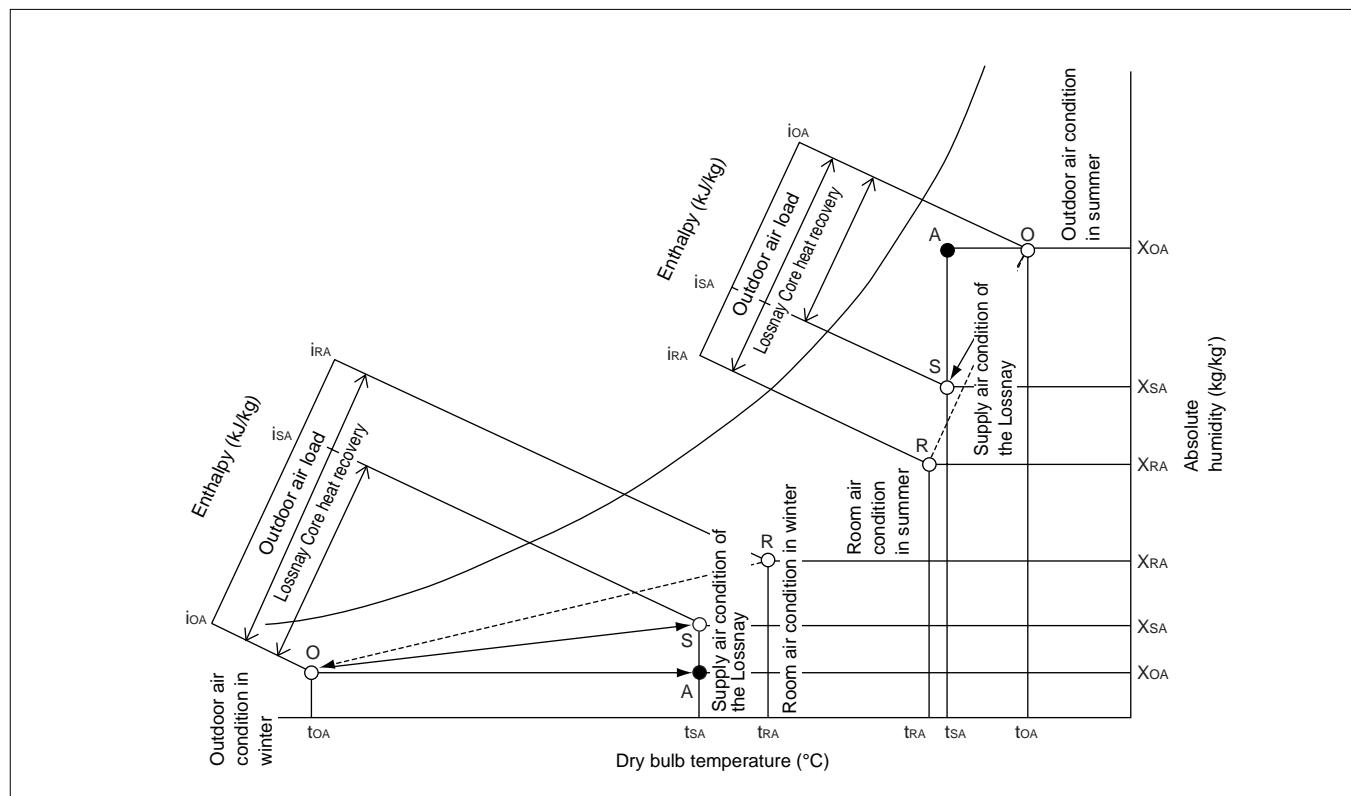

The quantity of heat recovered by using the Lossnay Core can be calculated with the following formula.

$$\begin{aligned} \text{Total heat recovered: } q_T &= \gamma \cdot Q \cdot (i_{OA} - i_{SA}) \text{ [W]} \\ &= \gamma \cdot Q \cdot (i_{OA} - i_{RA}) \times \eta_i \end{aligned}$$

Where γ = Specific weight of air under standard conditions 1.2 (kg/m³)

Q = Treated air volume (m³/h)

t = Temperature (°C)

x = Absolute humidity (kg/kg')

i = Enthalpy (kJ/kg)

η = Heat recovery efficiency (%)

- Suffix meanings

OA : Outdoor air

RA : Return air

SA : Supply air

CHAPTER 3

General Technical Considerations

1. Lossnay Heat Recovery Effect

1.1 Comparison of outdoor air load of various ventilators

Examples of formulas to compare the heat recovered and outdoor air load when ventilating with the Lossnay (total heat recovery unit), sensible heat recovery ventilation (sensible HRV) and conventional ventilators are shown below.

(1) Cooling during summer


Conditions

- Model LGH-50R type
(at 50Hz, high speed)
- Ventilation rate: 500 m³/h
(specific gravity of air $\rho = 1.2 \text{ kg/m}^3$)

- Heat recovery efficiency table (%)
(For summer)

	Lossnay	Sensible HRV	Conventional ventilator
Temperature (sensible heat)	77	77	—
Enthalpy (total heat)	61.5	18.2*	—

* Calculated volume under below conditions.

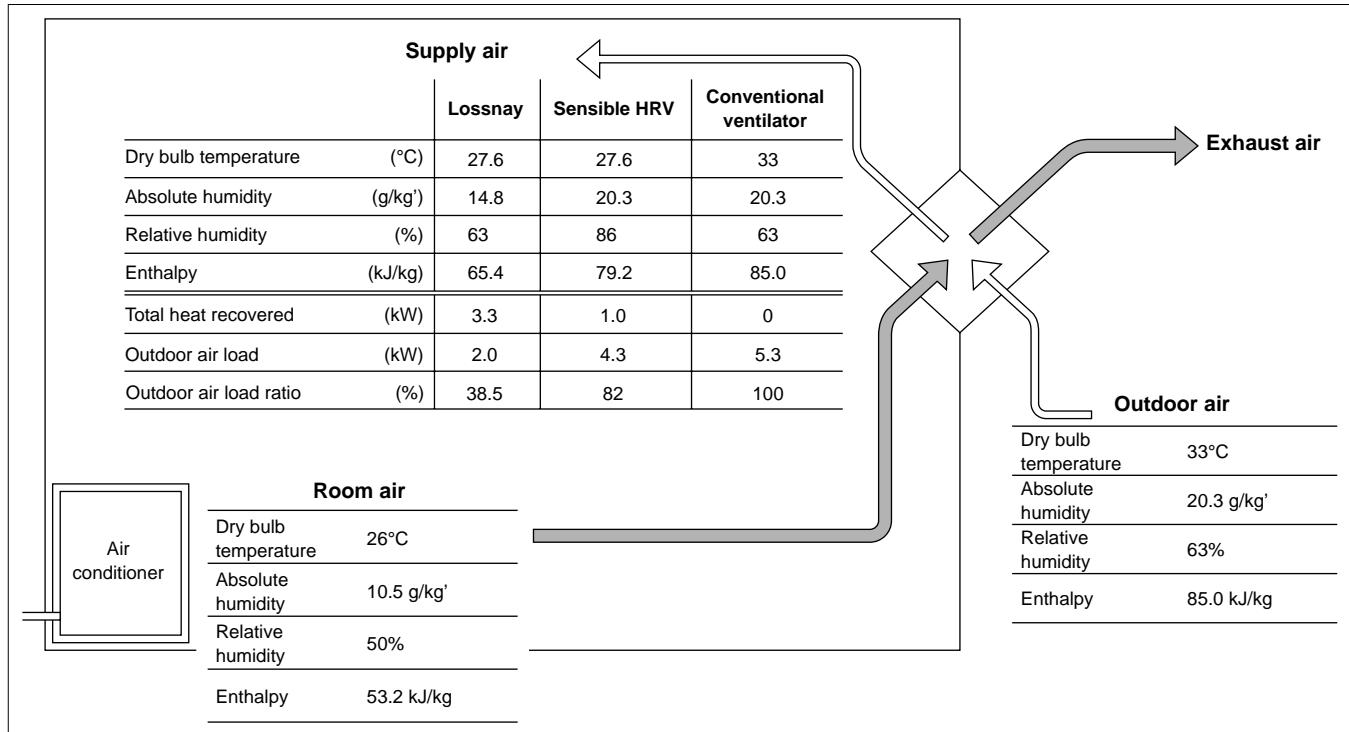

Calculation example

● Lossnay

$$(\text{Supply air diffuser temperature}) \quad t_{SA} = 33^\circ\text{C} - (33^\circ\text{C} - 26^\circ\text{C}) \times 0.77 = 27.6^\circ\text{C}$$

$$(\text{Supply air diffuser enthalpy}) \quad i_{SA} = 85.0 - (85.0 - 53.2) \times 0.615 = 65.4 \text{ kJ/kg}$$

$$\text{Heat recovered} \quad (85.0 - 65.4) \times 1.2 \times 500 = 11,760 \text{ kJ/h} = 3.3 \text{ kW}$$

$$\text{Outdoor air load} \quad (65.4 - 53.2) \times 1.2 \times 500 = 7,320 \text{ kJ/h} = 2.0 \text{ kW}$$

● Sensible HRV

$$(\text{Supply air diffuser temperature}) \quad t_{SA} = 33^\circ\text{C} - (33^\circ\text{C} - 26^\circ\text{C}) \times 0.77 = 27.6^\circ\text{C}$$

$$(\text{Supply air diffuser enthalpy}) \quad i_{SA} = 79.2 \text{ kJ/kg} \text{ (from psychrometric chart)}$$

$$\text{Heat recovered} \quad (85.0 - 79.2) \times 1.2 \times 500 = 3,480 \text{ kJ/kg} = 1.0 \text{ kW}$$

$$\text{Outdoor air load} \quad (79.2 - 53.2) \times 1.2 \times 500 = 15,600 \text{ kJ/H} = 4.3 \text{ kW}$$

$$[\text{Calculated enthalpy recovery efficiency } 3,480 \div (3,480 + 15,600) \times 100 = 18.2]$$


● Conventional ventilator

If a conventional ventilator is used, the heat recovered will be 0 as the supply air diffuser is equal to the outdoor air.

The outdoor air load is:

$$(85.0 - 53.2) \times 1.2 \times 500 = 19,080 \text{ kJ/h} = 5.3 \text{ kW}$$

Summer conditions

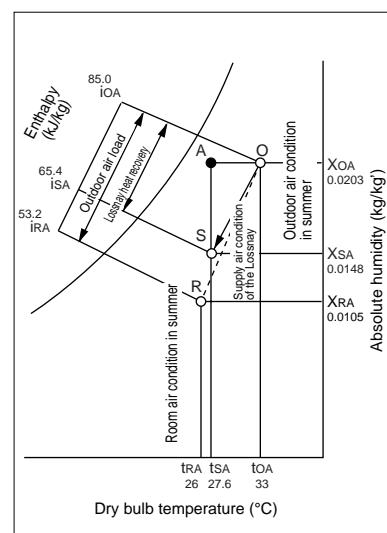

(2) Heating during winter


Conditions:

- Model LGH-50R type
(at 50Hz, high speed)
- Ventilation rate: 500 m³/h
(Specific gravity of air $\rho = 1.2 \text{ kg/m}^3$)

- Heat recovery efficiency table (%)
(For winter)

	Lossnay	Sensible HRV	Conventional ventilator
Temperature (sensible heat)	77	77	-
Enthalpy (total heat)	67	44.2*	-

* Calculated volume under below conditions.

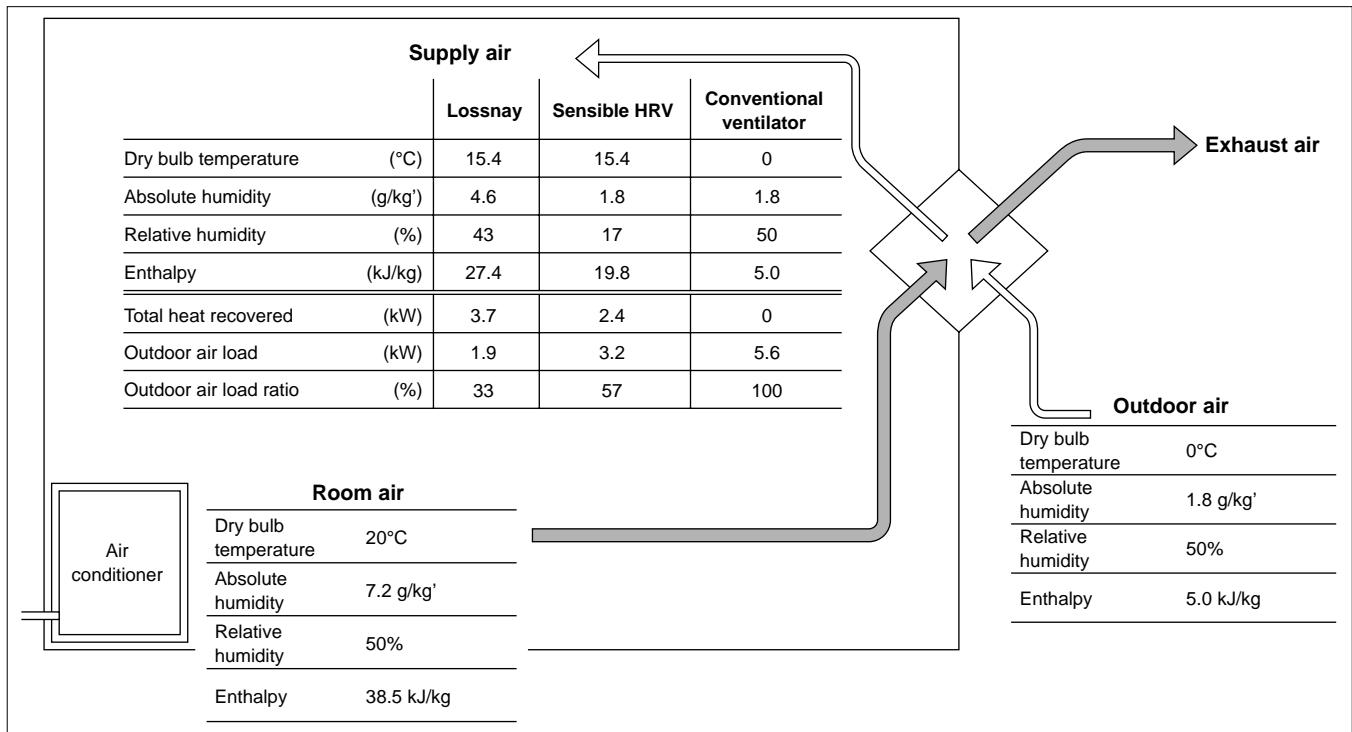

Calculation example

● Lossnay

$$\begin{aligned} (\text{Supply air diffuser temperature}) t_{SA} &= (20^\circ\text{C} - 0^\circ\text{C}) \times 0.77 + 0^\circ\text{C} = 15.4^\circ\text{C} \\ (\text{Supply air diffuser enthalpy}) i_{SA} &= (38.5 - 5.0) \times 0.67 + 5.0 \\ &= 27.4 \text{ kJ/kg} \end{aligned}$$

$$\begin{aligned} \text{Heat recovered } (27.4 - 5.0) \times 1.2 \times 500 &= 13,440 \text{ kJ/h} = 3.7 \text{ kW} \\ \text{Outdoor air load } (38.5 - 27.4) \times 1.2 \times 500 &= 6,660 \text{ kJ/h} = 1.9 \text{ kW} \end{aligned}$$

● Sensible HRV

$$\begin{aligned} (\text{Supply air diffuser temperature}) t_{SA} &= (20^\circ\text{C} - 0^\circ\text{C}) \times 0.77 + 0^\circ\text{C} = 15.4^\circ\text{C} \\ (\text{Supply air diffuser enthalpy}) i_{SA} &= 19.8 \text{ kJ/kg} \\ &\quad (\text{from psychrometric chart}) \end{aligned}$$

$$\begin{aligned} \text{Heat recovered } (19.8 - 5.0) \times 1.2 \times 500 &= 8,880 \text{ kJ/h} = 2.5 \text{ kW} \\ \text{Outdoor air load } (38.5 - 19.8) \times 1.2 \times 500 &= 11,200 \text{ kJ/h} = 3.1 \text{ kW} \end{aligned}$$


[Calculated enthalpy recovery efficiency $8,880 \div (8,880 + 11,200) \times 100 = 44.2\%$]

● Conventional ventilator

If a conventional ventilator is used, the supply air diffuser is the same as the outdoor air and the exhaust is the same as the room air.

Thus the heat recovered is 0 kJ/h and the outdoor air load is $(38.5 - 5.0) \times 1.2 \times 500 = 20,100 \text{ kJ/h} = 5.6 \text{ kW}$

Winter conditions

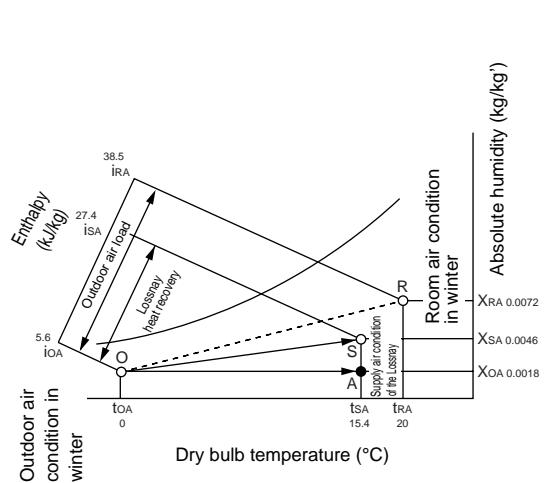

2. Example Heat Recovery Calculation

(1) Setting of conditions

(Note: Tokyo Power, industrial power 6 kV supply)

	Units	When Heating	When Cooling
Operation time	(Hr/year)	10h/day × 26 days/mo. × 5 mo./year = 1,300 Hr/year	10h/day × 26 days/mo. × 4 mo./year = 1,040 Hr/year
Electricity fee	(¥/kWh)	16.22	17.84
Capacity per 1 kW of electricity	(kW/kW)	3.1	2.6
Energy unit cost	(¥/kWh)	16.22/3.1 = 5.23	17.84/2.6 = 6.86

- Return air volume (RA) = 7,200 m³/Hr
- Outdoor air volume (OA) = 8,000 m³/Hr
- Air volume ratio (RA/OA) = 0.9
- Air conditions

Season	Winter heating					Summer cooling				
	Item	Dry bulb temp. DB [°C]	Wet bulb temp. WB [°C]	Relative humidity RH [%]	Absolute humidity × [kg/kg (DA)]	Enthalpy i [kJ/kg (DA)]	Dry bulb temp. DB [°C]	Wet bulb temp. WB [°C]	Relative humidity RH [%]	Absolute humidity × [kg/kg (DA)]
Outdoors	0	-2.7	50	0.0018	5.0 (1.2)	33	27.1	63	0.0202	85.0 (20.3)
Indoors	20	13.8	50	0.0072	38.5 (9.2)	26	18.7	50	0.0105	53.0 (12.7)

(2) Selection of Lossnay model (select from treatment air volume catalogue)

- Model name: LU-160 with combination of LU-1605 × 1 unit
- Processing air volume per unit RA = 7,200 m³/Hr, OA = 8,000 m³ Air volume ratio (RA/OA) = 0.9
- Heat recovery efficiency : Heat recovery efficiency = 73%, Enthalpy recovery efficiency (cooling) = 62%, Enthalpy recovery efficiency (heating) = 67%
- Static pressure loss (unit-type) RA = 156.9 Pa, OA = 186.3 Pa (Note: Each with filters)
- Power consumption (pack-type) = none because of unit type

(3) State of indoor supply air

	Heating	Cooling
Temperature [°C]	= { 20 (Indoor temperature) – 0 (outdoor air temperature) } × 0.73 (heat recovery efficiency) + 0 (outdoor air temperature) = 14.6	= 33 (Outdoor air temperature) – { 33 (outdoor air temperature) – 26 (indoor temperature) } × 0.73 (heat recovery efficiency) = 27.89
Enthalpy [kJ/kg (DA)]	= { 38.5 (Indoor enthalpy) – 5.0 (outdoor air enthalpy) } × 0.67 (enthalpy recovery efficiency) + 5.0(outdoor air enthalpy) = 27.4	= 85 (Outdoor air enthalpy) – { 85 (outdoor air enthalpy) – 53.2 (indoor enthalpy) } × 0.62 (enthalpy recovery efficiency) = 65.3
Numerical value obtained from above equation and psychometric chart	• Dry-bulb temperature = 14.6 °C • Wet-bulb temperature = 9.2 °C • Relative humidity = 49% • Absolute humidity = 0.005 kg/kg (DA) • Enthalpy = 27.4 kJ/kg (DA)	• Dry-bulb temperature = 27.89 °C • Wet-bulb temperature = 22.4 °C • Relative humidity = 62% • Absolute humidity = 0.0146 kg/kg (DA) • Enthalpy = 65.3 kJ/kg (DA)

Caution: See the psychrometric chart on the next page.


(4) Outdoor air load and heat recovered

	Heating	Cooling
Fresh air load without Lossnay (q ₁)	= 1.2 (Air specific gravity) × 8,000 (outdoor air volume) × { 38.5 (indoor enthalpy) – 5.0 (outdoor air enthalpy) } = 321,600 kJ/h = 89.3 kW	= 1.2 (Air specific gravity) × 8,000 (outdoor air volume) × { 85.0 (outdoor air enthalpy) – 53.2 (indoor enthalpy) } = 305,280 kJ/h = 84.8 kW
Outdoor air load with Lossnay (q ₂)	= 89.3 (Outdoor air load) (q ₁) × { 1 – 0.67 (enthalpy recovery efficiency) } = 29.5kW or = Air specific gravity × outdoor air volume × (indoor enthalpy – indoor blow enthalpy)	= 84.8 (Outdoor air load) (q ₁) × { 1 – 0.62 (enthalpy recovery efficiency) } = 32.2 kW or = Air specific gravity × outdoor air volume × (indoor enthalpy – indoor blow enthalpy)
Heat recovered (q ₃)	= q ₁ – q ₂ = 89.3 – 29.5 = 59.8 or = Outdoor air load (q ₁) × enthalpy recovery efficiency	= q ₁ – q ₂ = 84.8 – 32.2 = 56.2 kW or = Outdoor air load (q ₁) × enthalpy recovery efficiency
Outdoor air load (%)	• Outdoor air load = 89.3 kW = 100% • Outdoor air load with Lossnay = 29.5 kW = 33% • Heat recovered = 59.8 kW = 67%	• Outdoor air load = 84.8 kW = 100% • Outdoor air load with Lossnay = 32.2 kW = 38% • Heat recovered = 52.6 kW = 62%

(5) Recovered money (power rates)

	Heating	Cooling
Yearly saved money (¥)	= Heat recovered: kW × Unit price ¥/W × operation time Hr/year = 59.8 kW × 5.23 ¥/kWh × (1,300 Hr/year) = 406,580	= Heat recovered: kW × Unit price ¥/W × operation time Hr/year = 52.6 kW × 6.86 ¥/kWh × (1,040 Hr/year) = 375,269
Remarks	If recovered heat is converted to electricity : heating = 59.8 kW/3.1 = 19.3 kWh/h cooling = 52.6 kW/2.6 = 20.2 kWh/h	

● Psychrometric chart for calculating Lossnay economical effect

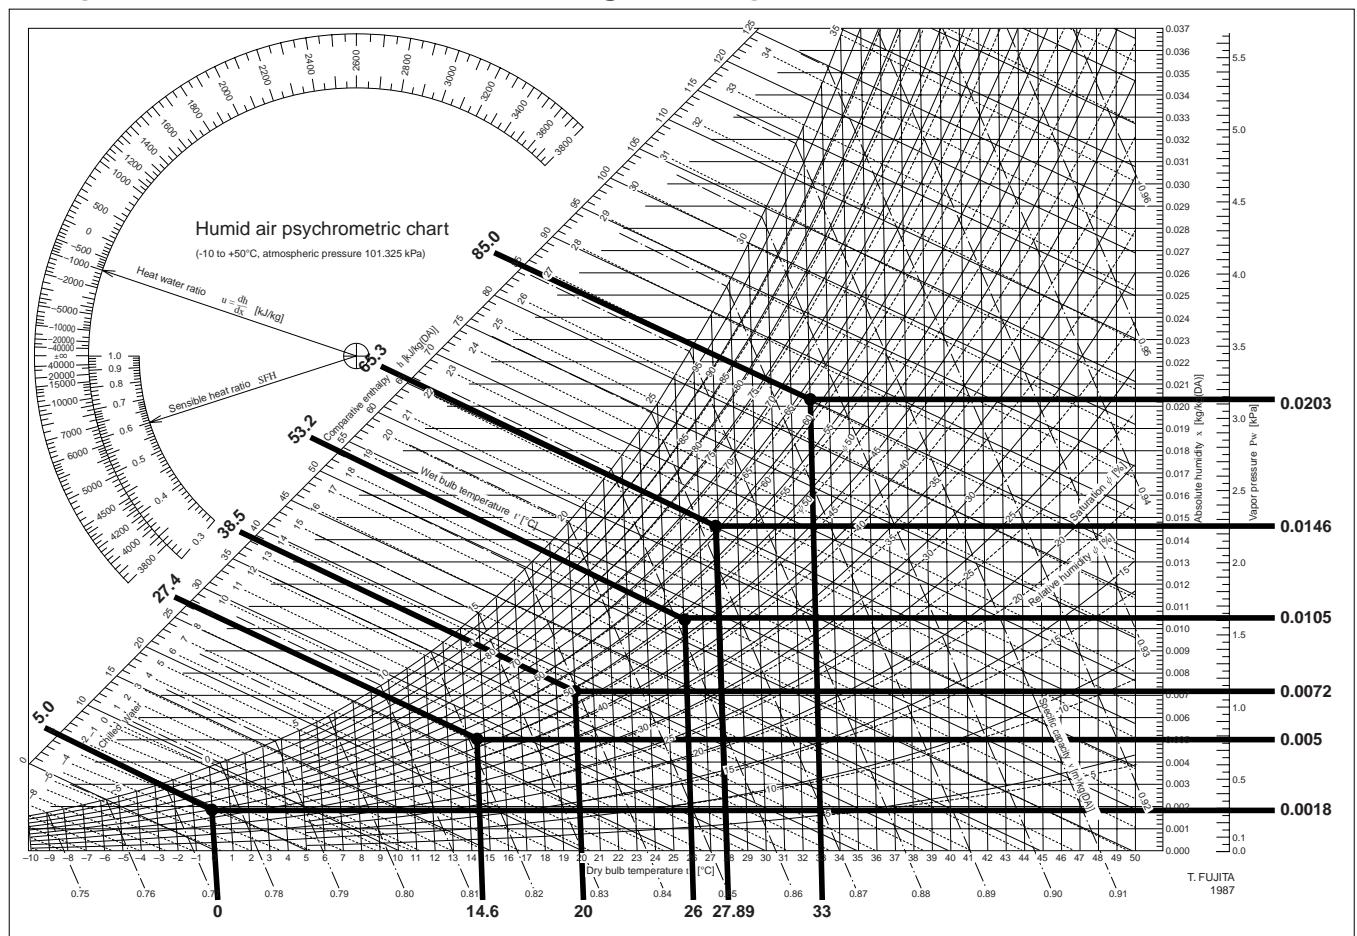

The following can be determined from the above calculation results:

- Saving of 59.8 kW of the heating load, and 52.6 kW of the cooling load is possible.

The heat source equipment and related ventilator capacity that is equivalent to this saved amount can be reduced, thus the operation and maintenance costs can also be saved.

- Approximately 400,000 yen can be saved in operation and maintenance costs during heating and 370,000 yen during cooling, for a total savings of approximately 770,000 yen. Furthermore, as 20.2 kW can be saved from the basic power rates during cooling, approximately 370,000 yen ($20.2 \times 1,560 \text{ ¥/month} \times 12 \text{ months}$) can be saved annually.

3. Calculation of Lossnay Economical Effects

The following is a sample questionnaire from which it is possible to assess the economical benefits of using the Lossnay in particular applications.

(1) Setting of conditions

- Return air volume (RA) = m³/Hr
- Outdoor air volume (OA) = m³/Hr
- Air volume ratio (RA/OA) =
- Air conditions

Season	Winter heating					Summer cooling				
	Item	Dry bulb temp. DB [°C]	Wet bulb temp. WB [°C]	Relative humidity RH [%]	Absolute humidity × [kg/kg']	Enthalpy i [kJ/kg]	Dry bulb temp. DB [°C]	Wet bulb temp. WB [°C]	Relative humidity RH [%]	Absolute humidity × [kg/kg']
Outdoors										
Indoors										

- Operation time: Heating = hours/day × days/month × months/year = hours/year
Cooling = hours/day × days/month × months/year = hours/year
- Energy: Heating = Type: Electricity Cost: ¥/kWh
Cooling = Type: Electricity Cost: ¥/kWh
Power rates: Winter: ¥/kWh Summer: ¥/kWh

(2) Selection of Lossnay model (select from treatment air volume catalog)

- Model name:
- Processing air volume per unit RA = m³/Hr, OA = m³/Hr, Air volume ratio (RA/OA) =
- Heat recovery efficiency : Heat recovery efficiency = %,
Enthalpy recovery efficiency (cooling) = %,
Enthalpy recovery efficiency (heating) = %

(3) State of indoor blow air

	Heating	Cooling
Temperature [°C]	= (Indoor temperature – outdoor air temperature) × heat recovery efficiency + outdoor air temperature =	= Outdoor air temperature – (outdoor air temperature – indoor temperature) × heat recovery efficiency =
Enthalpy [kJ/kg]	= (Indoor enthalpy – outdoor air enthalpy) × enthalpy recovery efficiency + outdoor air enthalpy =	= Outdoor air enthalpy – (outdoor air enthalpy – indoor enthalpy) × enthalpy recovery efficiency =
Numerical value obtained from above equation and psychometric chart	<ul style="list-style-type: none"> ● Dry-bulb temperature = °C ● Wet-bulb temperature = °C ● Relative humidity = % ● Absolute humidity = kg/kg' ● Enthalpy = kJ/kg 	<ul style="list-style-type: none"> ● Dry-bulb temperature = °C ● Wet-bulb temperature = °C ● Relative humidity = % ● Absolute humidity = kg/kg' ● Enthalpy = kJ/kg


(4) Outdoor air load and heat recovery

	Heating	Cooling
Fresh air load without Lossnay (q ₁)	= Air specific gravity × outdoor air volume × (indoor enthalpy – outdoor air enthalpy) =	= Air specific gravity × outdoor air volume × (outdoor air enthalpy – indoor enthalpy) =
Outdoor air load with Lossnay (q ₂)	= Outdoor air load (q ₁) × (1 – enthalpy recovery efficiency) = or = Air specific gravity × outdoor air volume × (indoor enthalpy – indoor blow enthalpy)	= Outdoor air load (q ₁) × (1 – enthalpy recovery efficiency) = or = Air specific gravity × fresh air volume × (indoor blow enthalpy – indoor enthalpy)
Heat recovery (q ₃)	= q ₁ – q ₂ = – = or = Outdoor air load (q ₁) × enthalpy recovery efficiency	= q ₁ – q ₂ = – = or = Outdoor air load (q ₁) × enthalpy recovery efficiency
Outdoor air load (%)	● Outdoor air load = W = % ● Outdoor air load with Lossnay = W = % ● Heat recovered = W = %	● Outdoor air load = W = % ● Outdoor air load with Lossnay = W = % ● Heat recovered = W = %

(5) Recovered money (power rates)

	Heating	Cooling
Yearly saved money (¥)	= Heat recovered: kW × Unit price ¥/kWh × operation time Hr/year = kW × ¥/kWh × = Hr/year =	= Heat recovered: kW × Unit price ¥/kWh × operation time Hr/year = kW × ¥/kWh × = Hr/year =

4. Psychrometric Chart

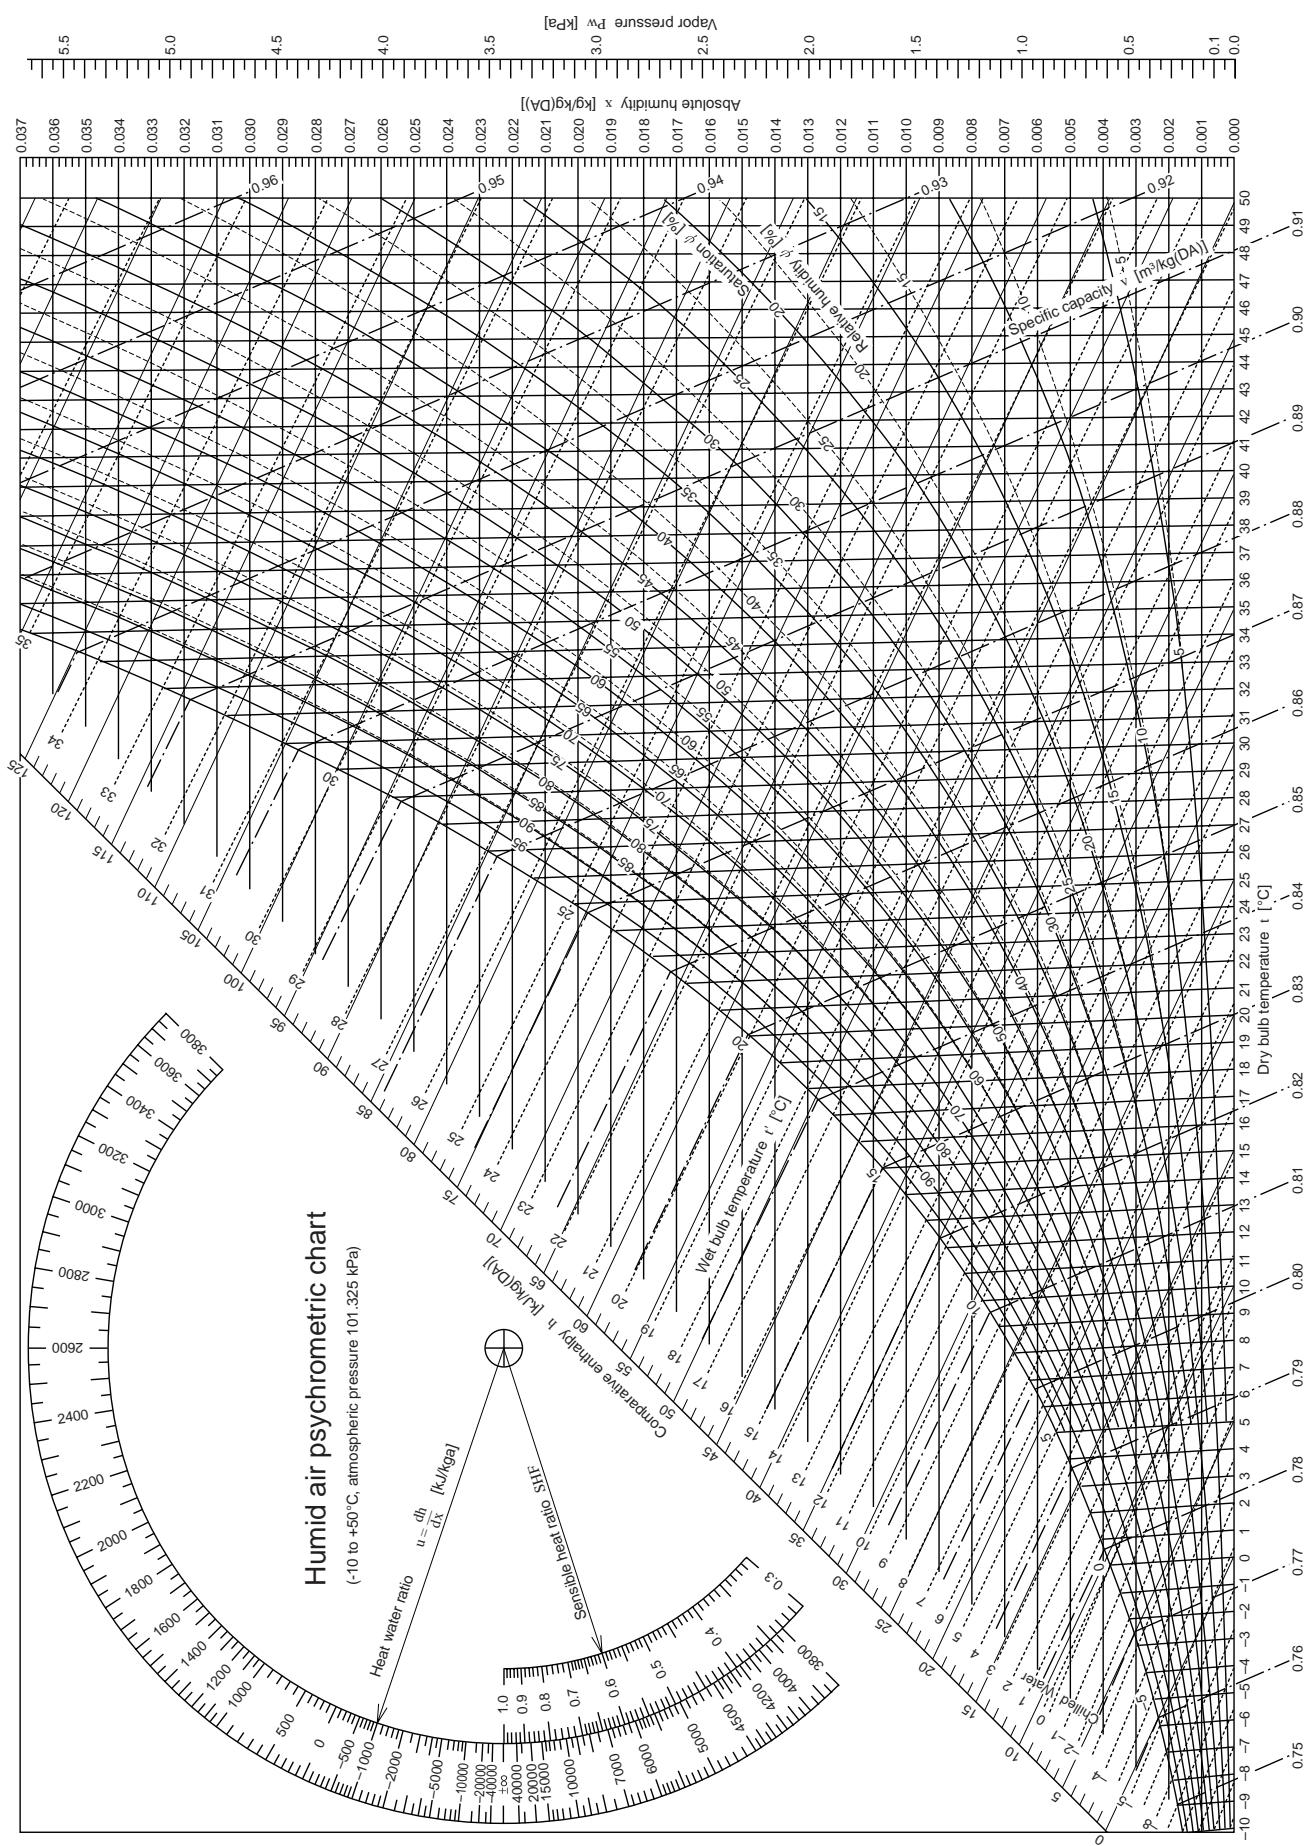

5. The Result of No Bacterial Cross Contamination for the Lossnay Core and Determining Resistance of the Lossnay Core to Molds

Test report

This document reports the result that there is no bacterial cross contamination for the Lossnay Core.

(1) Object

The object of this test is to verify that there is no bacterial cross contamination from the outlet air to the inlet air of the Lossnay Core in the heat recovery process.

(2) Client


MITSUBISHI ELECTRIC CO. NAKATSUGAWA WORKS.

(3) Test period

April 26, 1999 - May 28, 1999

(4) Test method

The configuration of the test equipment is shown below. The test bacteria suspension is sprayed in the outlet duct at a pressure of 1.5 kg/cm² with a sprayer whose dominant particle size is 0.3 - 0.5 µm. The air sampling tubes are installed at the each center of the locations of A, B, C, D, in the Lossnay inlet/outlet ducts so that their openings are directly against the air flow, and then connected to the impinger outside the duct. The impinger is filled with 100 mL physiological salt solution. The airborne bacteria in the duct air are sampled at the rate of 10L air/minute for three minutes.

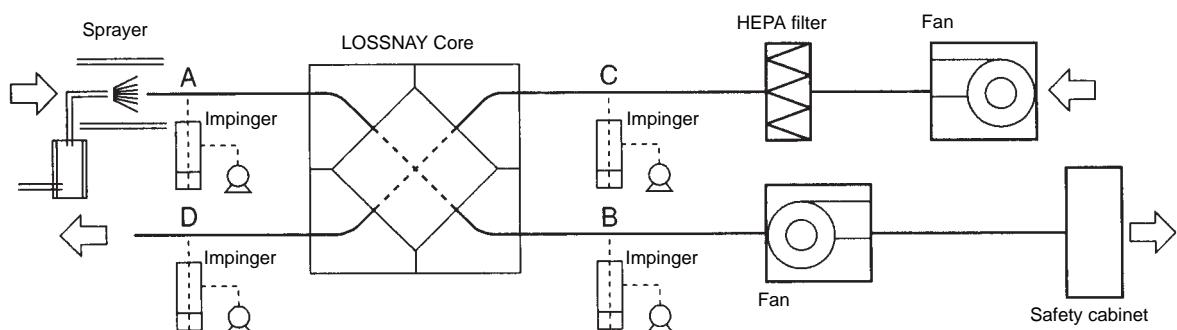

(5) Test bacteria

The bacteria used in this test are as followed;

Bacillus subtilis IFO 3134

Pseudomonas diminuta IFO14213 (JIS K 3835 Method of testing bacteria trapping capability of precision filtration film elements and modules; applicable to precision filtration film, etc. applied to air or liquid)

(6) Test result

The result of the test with Bacillus subtilis is shown in Table 1.

The result of the test with Pseudomonas diminuta is shown in Table 2.

Table 1 Test result with bacillus subtilis (CFU/30L air)

No.	A	B	C	D
1	5.4×10^4	5.6×10^4	< 10^3	< 10^3
2	8.5×10^3	7.5×10^3	< 10^3	< 10^3
3	7.5×10^3	< 10^3	< 10^3	< 10^3
4	1.2×10^4	1.2×10^4	< 10^3	< 10^3
5	1.8×10^4	1.5×10^3	< 10^3	< 10^3
Average	2.0×10^4	1.5×10^4	< 10^3	< 10^3

Table 2 Test result with pseudomonas diminuta (CFU/30L air)

No.	A	B	C	D
1	3.6×10^5	2.9×10^5	< 10^3	< 10^3
2	2.5×10^5	1.2×10^5	< 10^3	< 10^3
3	2.4×10^5	7.2×10^5	< 10^3	< 10^3
4	3.4×10^5	8.4×10^5	< 10^3	< 10^3
5	1.7×10^5	3.8×10^5	< 10^3	< 10^3
Average	2.7×10^5	4.7×10^5	< 10^3	< 10^3

(7) Considerations

Bacillus subtilis is commonly detected in the air and resistant to dry. Pseudomonas diminuta is susceptible to dry and only a few exists in the air. However, it is used in the performance verification of the bacteria trapping filter since the particle size is small (Cell diameter; 0.5 μm ; Cell length 1.0 to 4.0 μm).

Both Bacillus subtilis and Pseudomonas diminuta are detected at the location A and B in the outlet side duct where they are sprayed, but neither them are detected at location C (in the air filtered by the HEPA filter) and the location D (in the air crossed in the Lossnay Core) on the inlet side.

Since the number of bacteria in the location A is substantially equal to one in the location B, it is estimated that only a few bacteria are attached to the Lossnay Core on the outlet side. Also, no test bacteria is detected at the location D where the air is crossed in the Lossnay Core. Therefore, it can be concluded that the bacteria attached to the outlet side will not pass through the inlet side even after the heat is exchanged.

6. Flame-proofing Properties of Lossnay Core

The Lossnay Core satisfied all requirements of Paragraph 4-3 of the Fire Prevention Law Enforcement Rules. Details of the tests carried out are as seen below.

Notation format 2 - (3)

Notification of flame-proofing property test (For flame-proof materials and related items)

Flame-proofing committee test No., B-80028
April 17, 1980

Messrs.: Mitsubishi Electrical Corporation

Japan Flame-proofing committee

The results of the test, requested on April 8, 1980, are as follows.

Whereas

Part name	Air filter Total heat recovery unit	Material, Mixture ratio, Organization, Fan number, Density, Weight (g/m²)	Specially treated paper: (Partition (white) : Thickness 0.2 mm) (Filler block (blue) : Thickness 0.2 mm) Adhesive agent: Vinyl acetate (Specific gravity ratio 2.6%) 600 g/m ²
Product name (Brand)	Lossnay (ventilation fan) B		

Test No.	Test item	Residual flame (sec.)	Residual dust (sec.)	Carbonized area (cm ²)
2-min. heating	1 (Vertical)	0.	4.1	35.4
	2 (Vertical)	0.	7.7	38.2
	3 (Horizontal)	0.	1.4	35.9
6-sec. heating after igniting	1 (Vertical)	0.	0.	26.3
	2 (Horizontal)	0.	0.	20.3

Test No.	Test item	Carbonization length (cm)	No. of flame contact times (times)
1			
2			
3			
4			
5			

Evaluation	Passing
-------------------	---------

Remarks

Test method

Application of Paragraph 4-3 Standards of Fire Prevention Laws
Enforcement Rules (Ministry of Home Affairs Ordinance No. 6, 1961)
(Thick cloth test)

Passing standards

Residual flame : 5 sec. or less
Residual dust : 20 sec. or less
Carburized area : 40 cm² or less

Washing test

CHAPTER 3 ● General Technical Considerations

The Lossnay Core was also tested at the Japan Construction General Laboratories according to the fire retardancy test methods of thin materials for construction as set forth by JIS A 1322. The material was evaluated as Class 2 flame retardant. Details of the tests carried out are shown below.


Flame-proofing property test report			Acceptance No.	VF-93-11-(2)						
Messrs. Mitsubishi Electric Corp., Nakatsugawa Works			Data of acceptance	September 7, 1993						
			Data of report	October 12, 1993						
			Japan Construction General Laboratories 5-8-1 Fujishirodai, Saitama City 565 Tel: 06-872-0391 Hiorshi Wakabayashi Dr. of Engineering, Director							
Specimen and test body	Company name	Mitsubishi Electric Corp., Nakatsugawa Works								
	Address	1-3 Komanba-cho, Nakatsugawa, Gifu								
	Specimen type	Single-face laminated corrugated board	Product name	Lossnay Core (Total heat recovery unit)						
	Material structure and cross-sectional diagram, etc.	 Single-face laminated corrugated board ... Thickness: 4 mm (Single-face corrugated board with 2 mm cell size laminated alternately at right angle) Partition (Liner paper) Flame-proof treated paper ... Thickness: 0.085 mm, Weight: 70 g/m ² Adhesive agent ... Vinyl acetate resin ... Weight: 30 g/m ² (Solid) Filler (Flute paper) ... Colored wood free paper ... Thickness: 0.093 mm, Weight: 79 g/m ² Adhesive agent ... Vinyl acetate resin ... Weight: 30 g/m ² (Solid) Partition (Liner paper) Flame-proof treated paper ... Thickness: 0.085 mm, Weight: 70 g/m ²								
	Test body size and thickness (mm)	300 (Long side) × 200 (Short side) × 4 (Thickness)								
	Test body direction	The longer side is the vertical side.								
	Testing method	Testing standards	Pre-treatment of test body	Heating time	Heating surface class and direction					
	JIS A 1322 (45° Meckelian burner method)		Method A (drying method)	3 min.	The direction of which the corrugated board fold was vertical was set as the front of the heating surface.					
	Test date		October 5, 1993							
Test results	Test position		Residual frame (sec.)	Residual dust (sec.)	Carbonized length (Vertical × Horizontal) (cm)	Discoloration length (Vertical × Horizontal) (cm)	Remarks			
	Class	Direction	No.							
	Front	Vertical	1	0	0	8.2 × 4.7	18.7 × 7.3			
			2	0	0	8.4 × 4.9	24.3 × 7.8	*1		
			3	0	0	7.4 × 5.0	22.0 × 8.4			
Evaluation	The specimen conforms to Class 2 flame-proofing (heating time: 3 min.) according to the "Fire retardancy test methods of thin materials for construction" as set forth by JIS A 1322.									
Persons in charge of testing			Material Testing Laboratory Laboratory chief: Hiroshi Tamura, Technicians: Shigeru Fujikawa, Nobuaki Oohiro, Tetsuya Ogawa							

Note: Immediately after starting heating, the flame was ignited simultaneously with the generation of smoke. Penetration was observed approx. 2 min. 30 sec., after heating was started. There were no further changes.
 The Lossnay core was tested at the Underwriters Laboratories Inc. according to the standard of UL94, Test for Flammability of Plastic Materials for Parts in Devices and Appliances, 1998.
 The material was evaluated as per 5VA classified of flammability.

7. Lossnay Core's Soundproofing Properties Test

As the Lossnay Core is made of paper and the permeable holes are extremely small, the Core has outstanding soundproofing properties and is appropriate for ventilation in soundproof rooms.

For example, the exposed ceiling-type LGH-50E has soundproofing characteristics of 33.9 dB with a center frequency of 400 Hz. This means that a sound source of 96.9 dB can be shielded to 63 dB.

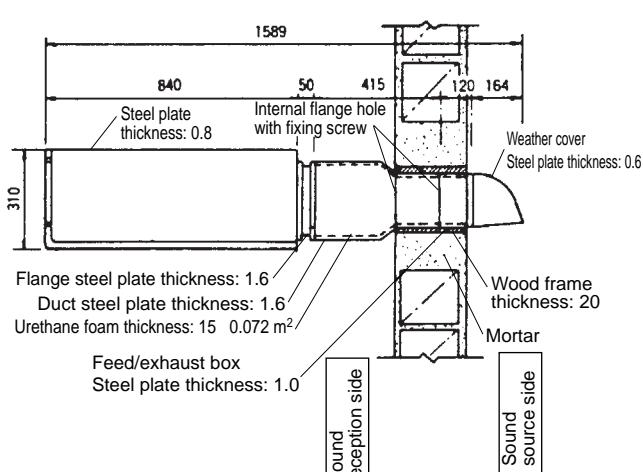Soundproofing effect test results For Mitsubishi Electric Corporation Nakatsugawa Works		No. 122-1 <table border="1"> <tr> <td>Test number</td><td>IVA-78-122</td></tr> <tr> <td>Acceptance data</td><td>: February 22, 1979</td></tr> <tr> <td>Report</td><td>: May 24, 1979</td></tr> </table>		Test number	IVA-78-122	Acceptance data	: February 22, 1979	Report	: May 24, 1979																																																																																																	
Test number	IVA-78-122																																																																																																									
Acceptance data	: February 22, 1979																																																																																																									
Report	: May 24, 1979																																																																																																									
The results of the tests are as noted below. General Building Research Corporation General Manager, S. Okushima		General Building Research Corporation Fujishirodai 5-125, Suita-shi, Osaka-Fu, Japan Person in charge of testing: Takeshi Tokura																																																																																																								
Certificate number IVA-78-122		Testing facility General Building Research Corporation																																																																																																								
Specimen <table border="1"> <tr> <td>Product name</td><td>LGH-50E</td></tr> <tr> <td>Item name</td><td>Heat exchange-type ventilator</td></tr> <tr> <td>Application</td><td>Ventilation</td></tr> <tr> <td>Date of manufacture</td><td>October 1978</td></tr> <tr> <td>Place of assembly</td><td>General Building Research Corporation</td></tr> <tr> <td>Dimensions</td><td>W 1250 × H 310 × D 1589</td></tr> <tr> <td>Area concentration</td><td>—</td></tr> <tr> <td>Remarks</td><td>An existing hole (4000 mm × 3000 mm) was covered with a hollow concrete block with double-faced mortar (thickness 20 mm each), with a wood frame with inner dimension of 580 mm × 190 mm × 230 mm being installed. The supply/exhaust box and duct was mounted in this, and the main unit and weather cover was mounted.</td></tr> <tr> <td>Peripheral</td><td>Oil clay was filled around the sound source sections</td></tr> </table>	Product name	LGH-50E	Item name	Heat exchange-type ventilator	Application	Ventilation	Date of manufacture	October 1978	Place of assembly	General Building Research Corporation	Dimensions	W 1250 × H 310 × D 1589	Area concentration	—	Remarks	An existing hole (4000 mm × 3000 mm) was covered with a hollow concrete block with double-faced mortar (thickness 20 mm each), with a wood frame with inner dimension of 580 mm × 190 mm × 230 mm being installed. The supply/exhaust box and duct was mounted in this, and the main unit and weather cover was mounted.	Peripheral	Oil clay was filled around the sound source sections	Client <table border="1"> <tr> <td>Address</td><td>1-3 Komanba-cho, Nakatsugawa, Gifu</td></tr> <tr> <td>Company name</td><td>Mitsubishi Electric Corporation Nakatsugawa Works</td></tr> </table>	Address	1-3 Komanba-cho, Nakatsugawa, Gifu	Company name	Mitsubishi Electric Corporation Nakatsugawa Works	Measurement results <table border="1"> <tr> <td>Centre frequency</td><td>125 Hz</td><td>500 Hz</td><td>2,000 Hz</td></tr> <tr> <td>Sound source side</td><td>Measurement point</td><td>1</td><td>101.5</td><td>96.5</td><td>98.5</td></tr> <tr> <td></td><td>2</td><td>99.0</td><td>—</td><td>—</td></tr> <tr> <td></td><td>3</td><td>100.0</td><td>97.5</td><td>98.5</td></tr> <tr> <td></td><td>4</td><td>102.0</td><td>—</td><td>—</td></tr> <tr> <td></td><td>5</td><td>101.5</td><td>96.5</td><td>98.5</td></tr> <tr> <td>Average level</td><td></td><td>100.9</td><td>96.9</td><td>98.5</td></tr> <tr> <td>Reception side</td><td>Measurement point</td><td>1</td><td>81.5</td><td>63.5</td><td>53.0</td></tr> <tr> <td></td><td>2</td><td>79.5</td><td>—</td><td>—</td></tr> <tr> <td></td><td>3</td><td>79.5</td><td>63.0</td><td>43.0</td></tr> <tr> <td></td><td>4</td><td>82.5</td><td>—</td><td>—</td></tr> <tr> <td></td><td>5</td><td>81.5</td><td>62.5</td><td>43.5</td></tr> <tr> <td>Average level</td><td></td><td>81.1</td><td>63.0</td><td>43.2</td></tr> <tr> <td>Average sound pressure level difference (dB)</td><td></td><td>19.8</td><td>33.9</td><td>55.3</td></tr> <tr> <td>Sound absorbed by reverberation chamber on reception side (m²)</td><td></td><td>2.79</td><td>3.90</td><td>7.22</td></tr> <tr> <td>Sound transmission loss (dB)</td><td></td><td>5.8</td><td>18.4</td><td>37.1</td></tr> </table>		Centre frequency	125 Hz	500 Hz	2,000 Hz	Sound source side	Measurement point	1	101.5	96.5	98.5		2	99.0	—	—		3	100.0	97.5	98.5		4	102.0	—	—		5	101.5	96.5	98.5	Average level		100.9	96.9	98.5	Reception side	Measurement point	1	81.5	63.5	53.0		2	79.5	—	—		3	79.5	63.0	43.0		4	82.5	—	—		5	81.5	62.5	43.5	Average level		81.1	63.0	43.2	Average sound pressure level difference (dB)		19.8	33.9	55.3	Sound absorbed by reverberation chamber on reception side (m²)		2.79	3.90	7.22	Sound transmission loss (dB)		5.8	18.4	37.1
Product name	LGH-50E																																																																																																									
Item name	Heat exchange-type ventilator																																																																																																									
Application	Ventilation																																																																																																									
Date of manufacture	October 1978																																																																																																									
Place of assembly	General Building Research Corporation																																																																																																									
Dimensions	W 1250 × H 310 × D 1589																																																																																																									
Area concentration	—																																																																																																									
Remarks	An existing hole (4000 mm × 3000 mm) was covered with a hollow concrete block with double-faced mortar (thickness 20 mm each), with a wood frame with inner dimension of 580 mm × 190 mm × 230 mm being installed. The supply/exhaust box and duct was mounted in this, and the main unit and weather cover was mounted.																																																																																																									
Peripheral	Oil clay was filled around the sound source sections																																																																																																									
Address	1-3 Komanba-cho, Nakatsugawa, Gifu																																																																																																									
Company name	Mitsubishi Electric Corporation Nakatsugawa Works																																																																																																									
Centre frequency	125 Hz	500 Hz	2,000 Hz																																																																																																							
Sound source side	Measurement point	1	101.5	96.5	98.5																																																																																																					
	2	99.0	—	—																																																																																																						
	3	100.0	97.5	98.5																																																																																																						
	4	102.0	—	—																																																																																																						
	5	101.5	96.5	98.5																																																																																																						
Average level		100.9	96.9	98.5																																																																																																						
Reception side	Measurement point	1	81.5	63.5	53.0																																																																																																					
	2	79.5	—	—																																																																																																						
	3	79.5	63.0	43.0																																																																																																						
	4	82.5	—	—																																																																																																						
	5	81.5	62.5	43.5																																																																																																						
Average level		81.1	63.0	43.2																																																																																																						
Average sound pressure level difference (dB)		19.8	33.9	55.3																																																																																																						
Sound absorbed by reverberation chamber on reception side (m²)		2.79	3.90	7.22																																																																																																						
Sound transmission loss (dB)		5.8	18.4	37.1																																																																																																						
Refer to page 35 for details of test results																																																																																																										
Remarks The soundproofed area of the specimen is small in this test, and as the transmission of sound through the surrounding concrete block wall cannot be ignored, the concrete block wall was measured after the main test, and the main test measurement results were corrected.																																																																																																										
Persons in charge of testing: Mitsuo Morimoto, Toshifumi Murakami																																																																																																										
																																																																																																										
Remarks Urethane foam (15 mm thick) was stuck onto the inside of the duct and feed/exhaust box.																																																																																																										

8. Change in Lossnay Core Over Time


The following details show an example of a building that has installed the Lossnay units, from which it is possible to assess the change in the units over time.

8.1 Outline of building where Lossnay is installed


- | | |
|---------------------------|--|
| (1) Building name | : Meiji Seimei, Nagoya Office/shop building
1-1 Shinsakae-machi Naka-ku, Nagoya |
| (2) No. of floors | : 16 above ground, 2-storey penthouse, 4 basement floors |
| (3) Total floor space | : 38,893 m ² |
| (4) Reference floor space | : 1,388 m ² |

8.2 Outline of installed ventilation equipment


- | | |
|-----------------------------------|---|
| (1) Air handling method | : 4 fan coil units (perimeter zone) per floor |
| Chilling unit | : Absorption-type 250 kT × 1 unit, turbo 250 kT × 2 units |
| Gas direct heating/cooling boiler | : 340 kT, heating 1630 kW |
| (2) Ventilation method | : Air - air total heat recovery unit "Lossnay"
LS-200 × 18 units installed in penthouse.
Outdoor air treatment volume 46,231 CMH,
Exhaust air treatment volume 54,335 CMH. |
| (3) Lossnay outline diagram | : LS-200 (with four Lossnay Cores) |

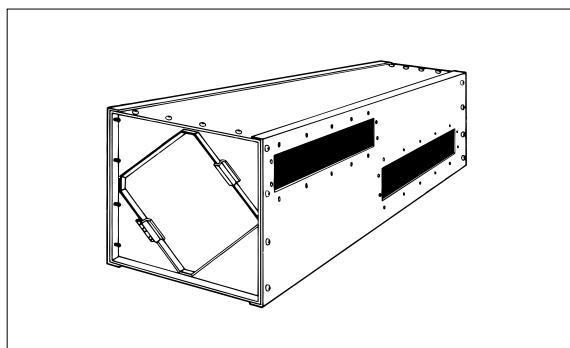

Lossnay duct system diagram

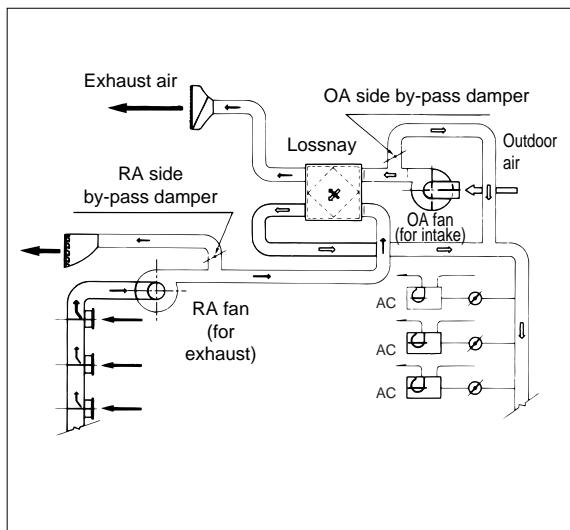

General diagram of penthouse Lossnay chamber

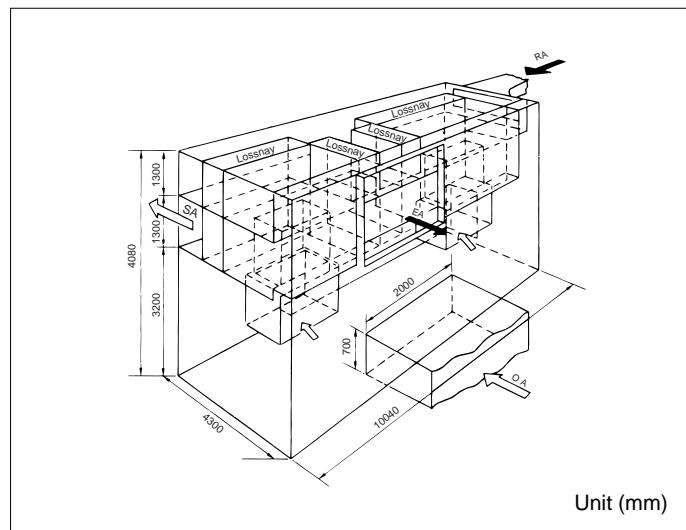


8.3 Outline of Lossnay operation

(1) Start of operation	: September 1972
Start of daily operation	: 7:00
End of daily operation	: 18:00 } Average daily operation 11 hours
(2) Inspection after usage	: November 1983
(3) Bypass operation month	: Three months of April, May, June
(4) Total operation time	: $(134 - 33) \text{ months} \times 25 \text{ days/month} \times 11 \text{ hours/day} = 27,775 \text{ hours}$

8.4 Characteristics in change of Lossnay Core over time

Two Lossnay Cores were removed from the 18 Lossnay LS-200 installed in the Meiji Seimei Building, and the static pressure loss and exchange efficiencies were measured. The comparison with the initial value is shown on the right. The appropriate air volume for one Lossnay Core is 500 m³/hr, and the measurement point was ±200 m³/hr of this value.

Characteristics in change of Lossnay Core over time

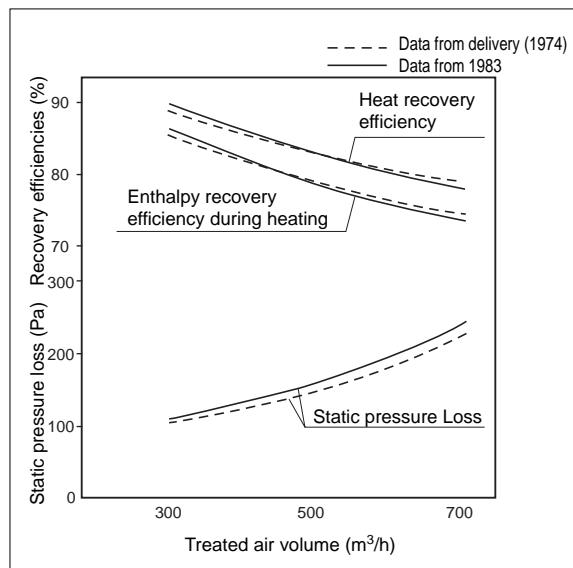

8.5 Conclusion

- (1) Changes in the characteristics of the Lossnay Core after approximately eleven years of use and an estimated 28,000 operation hours were not found.
In numerical values, the static pressure loss was 150 to 160 Pa at 500 m³/hr which was a 10 Pa increase, and the exchange efficiencies had decreased slightly at above 500 m³/hr. However, this is considered to be insignificant and remained in the measurement error range.
- (2) Looking at the appearance, the Core surface was black with dust, but there were no gaps, deformation or mold that would pose problems during practical use.

9. Comparison of Heat Recovery Techniques


The methods by which heat recovery devices can be categorised may be considered as follows:

Basic methods of total heat exchangers


	Type	Method	Air flow	Country of development
Heat recovery principle	Static (Mitsubishi Lossnay)	Conductive transmission type	Cross-flow	Japan
	Rotary type	Heat accumulation/humidity accumulation type	Counterflow	Sweden

9.1 Principle construction of rotary-type

- The rotary-type heat recovery unit is composed of a rotor that has a layered honeycomb structure made of kraft paper, drive motor and housing. A large quantity of moisture absorbent material (lithium chloride, etc.) is applied onto the rotor, and humidity is transferred. The rotor is rotated eight times a minute by the drive motor.

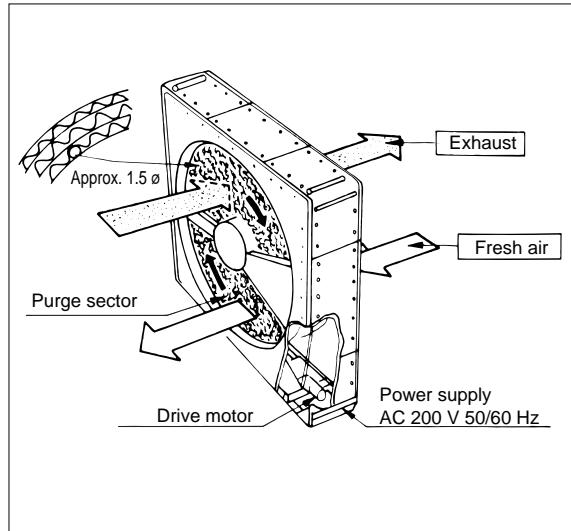


- The principle of this rotary-type is for example when cooling, the high temperature and high humidity fresh air passes through the rotor, with the heat and humidity being absorbed by the rotor. As the rotor is rotating, it moves into the exhaust air passage, and the heat and humidity is discharged to outdoors because the exhaust is cool and has a low humidity. The rotor rotates and returns to the fresh air passage to absorb the heat and humidity again.

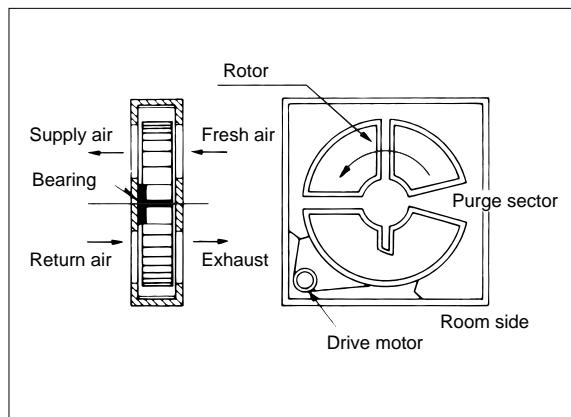

Function of purge sector

There are two separation plates (purge sector) in the front and back of the rotor to separate the flow of the air. As one of the plates is slightly shifted, part of the fresh air always flows into the exhaust air passage to prevent the exhaust air and fresh air from mixing. (A balanced pressure difference is required.)

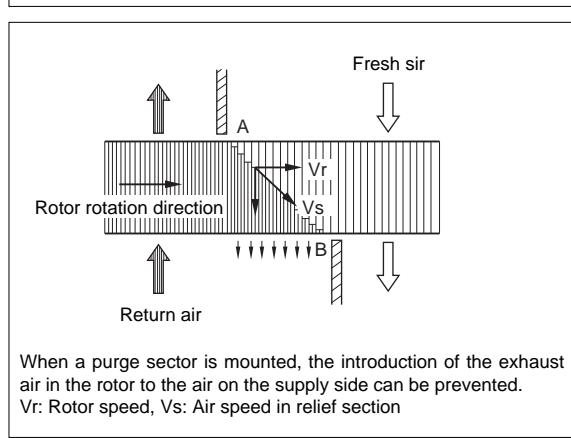

9.2 Comparison of static-type and rotary-type heat recovery units

Item	Static-type	Rotary-type		
Construction/principle	<p><Conductive transmission-type: cross-flow> Static-type transmission total heat recovery unit with orthogonally layered honeycomb shaped treated paper formed into multiple layers.</p> <ul style="list-style-type: none"> ● As the supply air and exhaust air pass through different passages (sequentially layered), the air passages are completely separated. 	<p><Heat accumulation/humidity accumulation-type: counterflow> The rotor core is composed of honeycomb-shaped kraft paper, etc., to which a moisture absorbent is applied (lithium chloride, etc.). This rotor is rotated, and heat accumulation/humidity accumulation - heat discharge/humidity discharge of total heat exchange is performed by passing the exhaust and intake airs into a honeycomb passage.</p> <ul style="list-style-type: none"> ✗ Supply air and exhaust airs flow into the same air passage because of the rotary-type construction. 		
Moving parts	● None Fixed core	<ul style="list-style-type: none"> ✗ Used (rotor driven with belt by gear motor) Rotor core (8rpm) 		
Material quality	Treated paper	Treated paper, aluminum plates, etc.		
Mounting of prefilter	Required (periodic cleaning required)	Required (periodic cleaning required)		
Element clogging	<ul style="list-style-type: none"> ● Occurs (state where dirt adheres onto element air passage surface. However, this is easily removed with a vacuum cleaner.) 	<ul style="list-style-type: none"> ✗ Occurs (Dust is smeared into element air passage filter.) (The dust adhered onto the core surface is smeared into the air passage by the purge sector packing. Thus, it cannot be removed easily and the air volume decreases.) 		
Air leakage Gas transmission rate	<p>Approximately 2.5% air leak at standard fan position. Leaks on the air supply side can be reduced to 0 by leaking the loss air volume (approx. 10%) on the exhaust side with the fan position to the core.</p> <ul style="list-style-type: none"> ● Gas transmission (Ammonia : 28%, hydrogen sulfide : approx. 6.7%) 	<ul style="list-style-type: none"> ✗ Purged air volume occurs To prevent leakage of exhaust to the air intake side, a purge air volume (6 to 14%) leak is created to the exhaust side. Thus, there are problems in the purge sector operation conditions (pressure difference, speed), and the air volume balance must be balanced. ✗ Gas transmission (Ammonia : 45-57%, hydrogen sulfide : approx. 3.2-4%) 		
Bacteria transmission rate	<ul style="list-style-type: none"> ● Low (As air intake/exhaust are separate, transmission is low.) 	<ul style="list-style-type: none"> ✗ High (As air intake/exhaust are the same, transmission is high.) 		
Operation during off-seasons	Bypass circuit required (SA pass or RA pass only)	<p>Bypass circuit required (Required on both air intake and exhaust air outlet sides) (In theory, operation is possible by stopping the rotation, but the core will over-absorb, causing rainage.)</p>		
Maintenance	<p>Core cleaning: More than once (every two years) The core surface will clog with lint and dirt, but cleaning is easy with a vacuum cleaner. Only the two core air passage intakes need to be cleaned.</p>	<p>Core cleaning: Once every one or two years Cleaning is difficult as dust is smeared into core with the packing.</p> <ul style="list-style-type: none"> ✗ Gear motor for rotor drive : Periodic inspection ✗ Rotor bearing, rotor drive belt : Periodic inspection 		
Life	Core: Semi-permanent (10 years or more) (The static-type does not break.)	<p>Core: Semi-permanent (10 years or more) (Periodic replacement is required according to the rotor bearings and core clogging.)</p> <ul style="list-style-type: none"> ✗ Rotor drive belt : Periodic replacement ✗ Drive motor, rotor bearing : Periodic replacement 		
Model system and comparison	<ul style="list-style-type: none"> ○ Available from small to large. ○ Characteristic design of small and medium models possible. Large models are easy to match to machine room layout. 	<p>Example LU-1605</p> <ul style="list-style-type: none"> Large type only ✗ Small models are difficult to design because of the rotor magnitude. 	Example EV-1500	
Standard treatment air volume	40 to 25,000 m ³ /h	8,000 m ³ /h	<ul style="list-style-type: none"> ○ 100 to 63,000 m³/h 	8,000 m ³ /h
Enthalpy recovery efficiency		Temperature:77% Enthalpy Heating : 71% Cooling : 66%		74%
Pressure loss		170 Pa		180 Pa
Installation space (W × D × H)(mm)	Effective for small to medium capacity (Layout is free according to combination.)	600 × 2100 × 2540	Large capacity models are effective	320 × 1700 × 1700

Measure of usability

● High ○ Average ✗ Poor

CHAPTER 4

Characteristics


1. How to Read the Characteristic Curves

1.1 Obtaining characteristics from static pressure loss

- (1) Static pressure loss from straight pipe duct length (at required air volume)
- (2) Static pressure loss at curved section (at required air volume)
- (3) Static pressure loss of related parts (at required air volume)




Total static pressure loss

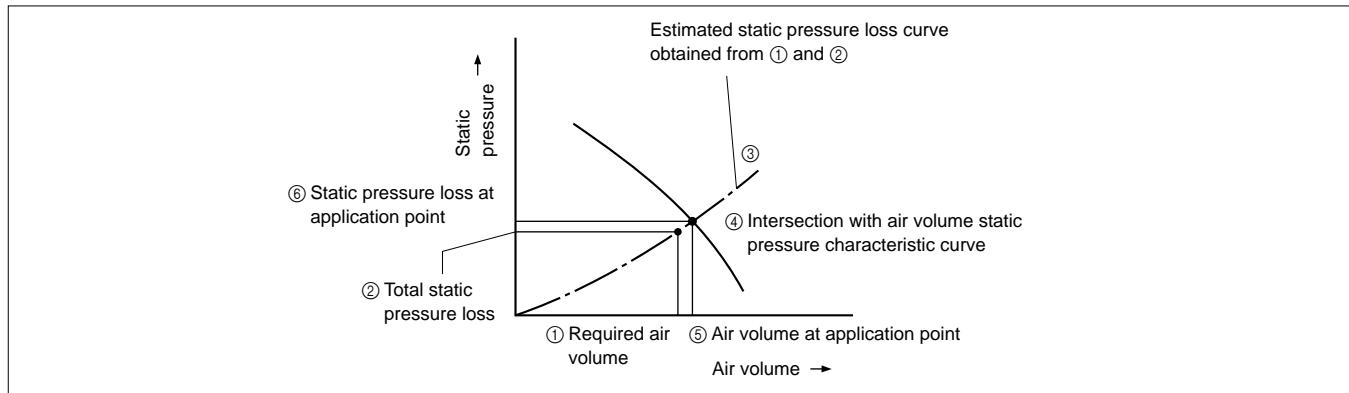

2. Calculating the Static Pressure Loss

2.1 How to read the air volume - static pressure curve

It is important to know the amount of static pressure loss applied onto the Lossnay when using parts such as ducts for the air distribution. If the static pressure increases, the air volume will decrease. The air volume - static pressure curve (Q-H curve) shows this percentage. A static pressure of 19.6 Pa is applied on to point A, and the air volume is 500 m³/h. The duct resistivity curve shows how the static pressure is applied when a duct is connected to the Lossnay. Thus, the L = 9.97 m duct resistivity curve in the diagram is the curve that shows how the static pressure is applied when a 10 m duct is connected. The intersecting point A with the Lossnay Q-H curve is the operation point.

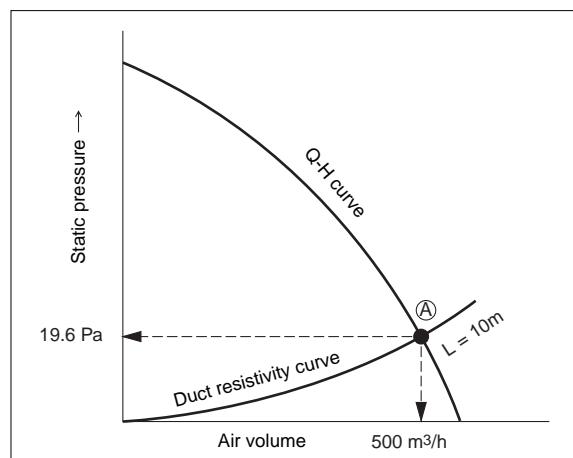


Duct resistivity curve

The duct resistivity curve shows how much static pressure a duct will apply on the Lossnay, as explained above.

In general, the interrelation between the duct and static pressure is as follows:

Duct	Static pressure
When duct is long	Increases
If length is the same but the air volume increases	Increases
If the duct diameter is narrow	Increases
If the duct inner surface is rough (such as a spiral)	Increases

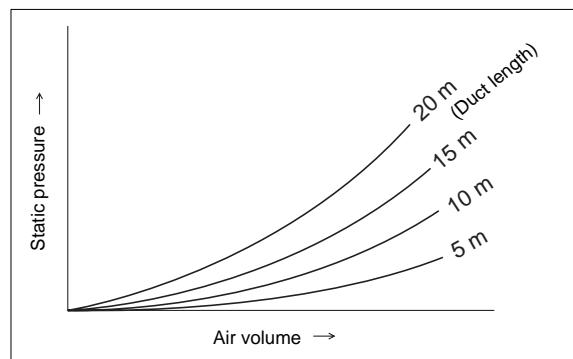


Reference

- The pressure loss caused by the outdoor air is as follows:

Pressure loss caused by outdoor air (Pa)

$$= \frac{r}{2} \times V^2 = \frac{1.2}{2} \times (\text{velocity})^2$$

{ r : Air weight 1.2 kg/m³
v : Velocity (m/s)

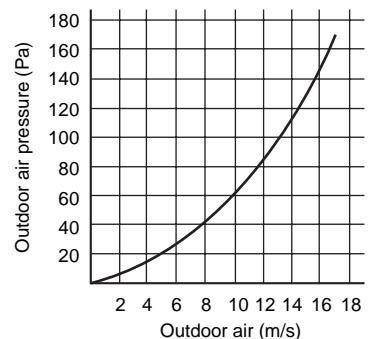


2.2 Calculation of duct pressure loss

When selecting a model that is to be used with a duct, calculate the volumes according to Tables 3, 4, 5 and 6, and then select the unit according to the air volume and static pressure curve.


(1) Calculation of a rectangular pipe

Table 3 Conversion table from rectangular pipe to circular pipe

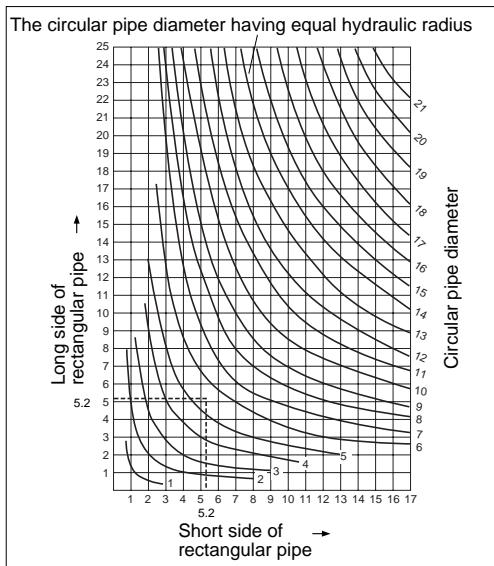

(2) How to obtain the duct resistivity

Table 4 Circular duct friction loss (steel plate duct, inner roughness ε = 0.18 mm)

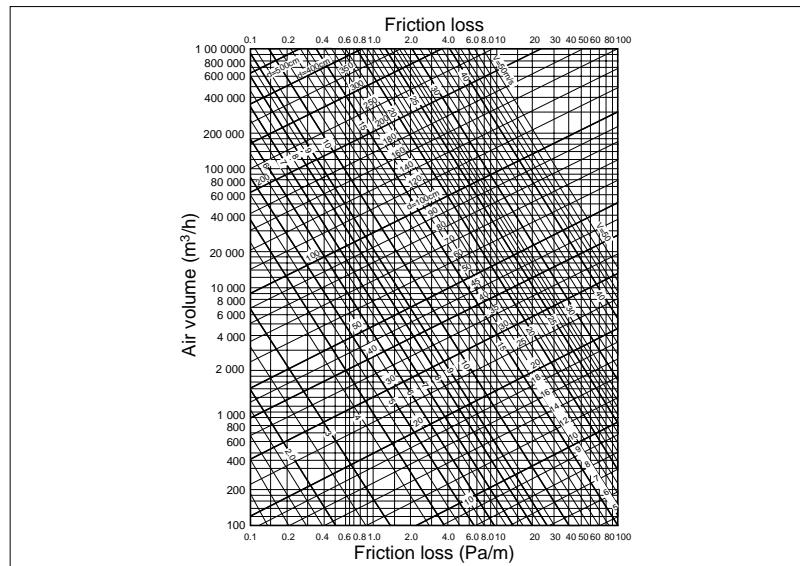

How to read Table 3


Select the unit as per each duct. In the above example, the □ 520 rectangular pipe only goes as far as 17. Thus, the long side, short side and converted circular pipe values are all multiplied by 100. The point 560 where the two lines cross is hence the value where the rectangular pipe equates to the circular pipe.

How to read Table 4

The point where the line of the circular duct diameter (leftward slanting line) and of the required air velocity (horizontal line) intersect is the pressure loss per 1 m of duct.

The value of the slanted line to the lower right of the intersecting point is the average velocity.

(Outline of Table 4)

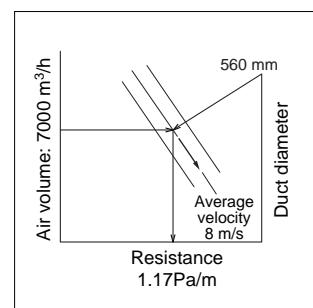

Duct diameter

Average velocity
8 m/s

Resistance
1.17Pa/m

Air volume
7000 m³/h

560 mm

Duct diameter

Resistance
1.17Pa/m

Average velocity
8 m/s

Air volume
7000 m³/h

560 mm

Duct diameter

Resistance
1.17Pa/m

Average velocity
8 m/s

Air volume
7000 m³/h

560 mm

Duct diameter

Resistance
1.17Pa/m

Average velocity
8 m/s

Air volume
7000 m³/h

560 mm

Duct diameter

Resistance
1.17Pa/m

Average velocity
8 m/s

Air volume
7000 m³/h

560 mm

Duct diameter

Resistance
1.17Pa/m

Average velocity
8 m/s

Air volume
7000 m³/h

560 mm

Duct diameter

Resistance
1.17Pa/m

Average velocity
8 m/s

Air volume
7000 m³/h

560 mm

Duct diameter

Resistance
1.17Pa/m

Average velocity
8 m/s

Air volume
7000 m³/h

560 mm

Duct diameter

Resistance
1.17Pa/m

Average velocity
8 m/s

Air volume
7000 m³/h

560 mm

Duct diameter

Resistance
1.17Pa/m

Average velocity
8 m/s

Air volume
7000 m³/h

560 mm

Duct diameter

Resistance
1.17Pa/m

Average velocity
8 m/s

Air volume
7000 m³/h

560 mm

Duct diameter

Resistance
1.17Pa/m

Average velocity
8 m/s

Air volume
7000 m³/h

560 mm

Duct diameter

Resistance
1.17Pa/m

Average velocity
8 m/s

Air volume
7000 m³/h

560 mm

Duct diameter

Resistance
1.17Pa/m

Average velocity
8 m/s

Air volume
7000 m³/h

560 mm

Duct diameter

Resistance
1.17Pa/m

Average velocity
8 m/s

Air volume
7000 m³/h

560 mm

Duct diameter

Resistance
1.17Pa/m

Average velocity
8 m/s

Air volume
7000 m³/h

560 mm

Duct diameter

Resistance
1.17Pa/m

Average velocity
8 m/s

Air volume
7000 m³/h

560 mm

Duct diameter

Resistance
1.17Pa/m

Average velocity
8 m/s

Air volume
7000 m³/h

560 mm

Duct diameter

Resistance
1.17Pa/m

Average velocity
8 m/s

Air volume
7000 m³/h

560 mm

Duct diameter

Resistance
1.17Pa/m

Average velocity
8 m/s

Air volume
7000 m³/h

560 mm

Duct diameter

Resistance
1.17Pa/m

Average velocity
8 m/s

Air volume
7000 m³/h

560 mm

Duct diameter

Resistance
1.17Pa/m

Average velocity
8 m/s

Air volume
7000 m³/h

560 mm

Duct diameter

Resistance
1.17Pa/m

Average velocity
8 m/s

CHAPTER 4 ● Characteristics

The figure obtained from Table 4 must then be corrected for duct type at various velocities. This can be done using Table 5 below.

Table 5 Friction coefficient compensation table

Duct inner surface	Example	Average velocity (m/sec)			
		5	10	15	20
Very rough surface	Concrete finish	1.7	1.8	1.85	1.9
Rough	Mortar finish	1.3	1.35	1.35	1.37
Very smooth	Drawn steel pipe Vinyl pipe	0.92	0.85	0.82	0.8

An alternative, more detailed method for determining the pressure loss in duct work is as shown using the following formula:

Circular pipe section pressure loss

$$\Delta p = \lambda \cdot \frac{\ell}{d} \cdot \frac{\rho}{2} \cdot v^2 \text{ (Pa)}$$

$$\begin{aligned}\Delta p &= C \cdot \frac{\rho}{2} \cdot v^2 \text{ (Pa)} \\ &= 0.6 C \cdot v^2\end{aligned}$$

λ : Friction resistance coefficient (smooth pipe 0.025)

C : Local loss coefficient (refer to Table 6)

d : Duct diameter (m)























ℓ : Duct length (m)

ρ : Air weight (1.2 kg/m²)

v : Wind velocity (m/s)


(3) How to calculate curved sections

Table 6 List of pressure losses in each duct section

No.	Duct section	Outline diagram	Conditions	C value	Length of equivalent circular pipe	No.	Duct section	Outline diagram	Conditions	C value	Length of equivalent circular pipe	
1	90° Smooth Elbow		R/D = 0.5 = 0.75 = 1.0 = 1.5 = 2.0	0.73 0.38 0.26 0.17 0.15	43D 23D 15D 10D 9D	12	Transformer			0.15	9D	
2	Rectangular Radius Elbow		W/D R/D			13	Abrupt Entrance			0.50	30D	
			0.5	0.5 0.75 1.0 1.5	1.30 0.47 0.28 0.18	79D 29D 17D 11D	14	Abrupt Exit			1.0	60D
			1-3	0.5 0.75 1.0 1.5	0.95 0.33 0.20 0.13	57D 20D 12D 8D	15	Bellmouth Entrance			0.03	2D
			No. of vanes	R/D			16	Bellmouth Exit			1.0	60D
3	Rectangular Vaned Radius Elbow		1	0.5 0.75 1.0 1.5	0.70 0.16 0.13 0.12	42D 10D 8D 7D	17	Re-entrant inlet			0.85	51D
			2	0.5 0.75 1.0 1.5	0.45 0.12 0.10 0.15	27D 7D 6D 9D	18	Sharp edge round orifice		V ₁ /V ₂ = 0 0.25 0.50 0.75 1	2.8 2.4 1.9 1.5 1.0	170D 140D 110D 90D 60D
4	90° Miter Elbow				0.87	53D				Loss is for V ₂		
5	Rectangular Square Square Elbow				1.25	76D	19	Pipe inlet (with circular hood)		β 20° 40° 60° 90° 120°	0.02 0.03 0.05 0.11 0.20	
6	Rectangular Vaned Square Elbow				0.35	21D	20	Pipe inlet (with rectangular hood)		β 20° 40° 50° 90° 120°	0.03 0.08 0.12 0.19 0.27	
7	Rectangular Vaned Square Junction		Same loss as circular duct. Velocity is based on inlet.				21	Abrupt contraction		V ₁ /V ₂ = 0 0.25 0.50 0.75	0.5 0.45 0.32 0.18	30D 27D 19D 11D
8	Rectangular Vaned Radius Junction		With or without vanes, rectangular or circular							Loss is for V ₂		
9	45° Smooth Elbow		a = 5° 10° 20° 30° 40°	0.17 0.28 0.45 0.59 0.73	10D 17D 27D 36D 43D		22	Abrupt expansion		V ₁ /V ₂ = 0 0.20 0.40 0.60 0.80	1.0 0.64 0.36 0.16 0.04	60D 39D 22D 9D 2D
10	Expansion		Loss is for hV ₁ - hV ₂							Loss is for V ₁		
11	Contraction		a = 30° 45° 60°	0.02 0.04 0.07	1D 2D 4D		23	Suction inlet (punched narrow plate)		Free air ratio 0.2 0.4 0.6 0.8	35 7.6 3.0 1.2	

3. How to Obtain Efficiency from Characteristic Curves

How to read characteristic curve


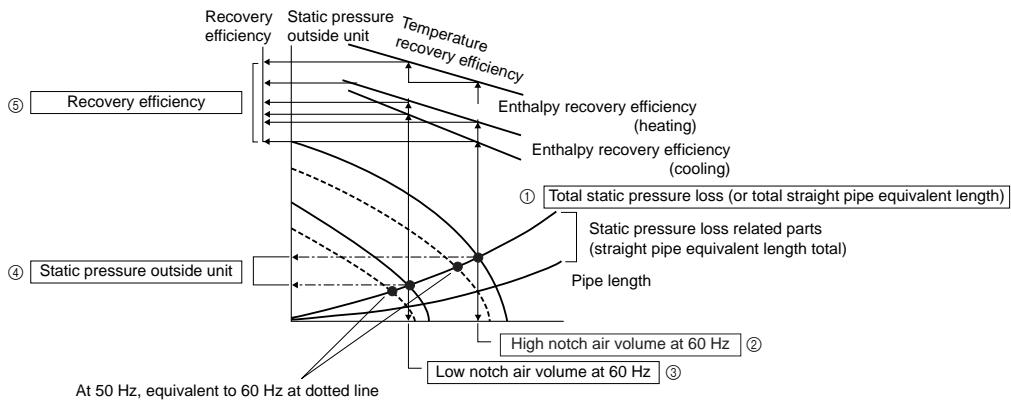


- Obtaining the efficiency when supply air and exhaust air volumes differ

The efficiency obtained from the intake side air volume in each characteristic curve can be corrected with the air volume ratio in the chart on the right.

If the intake side and exhaust side duct lengths differ greatly or if a differential air volume is required, obtain the intake side efficiency from the chart on the right.

Heat recovery efficiency correction curve

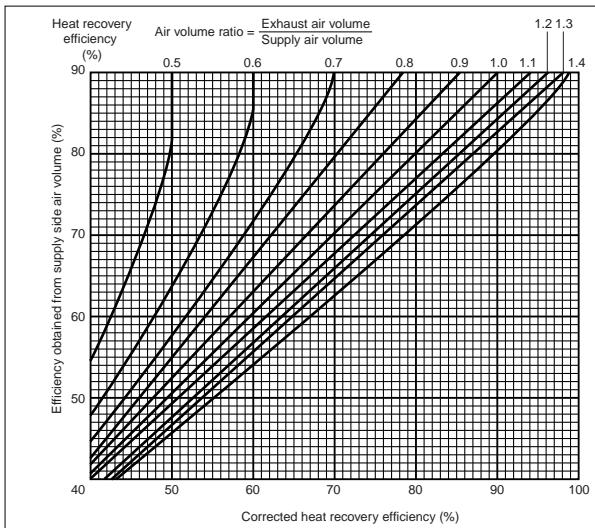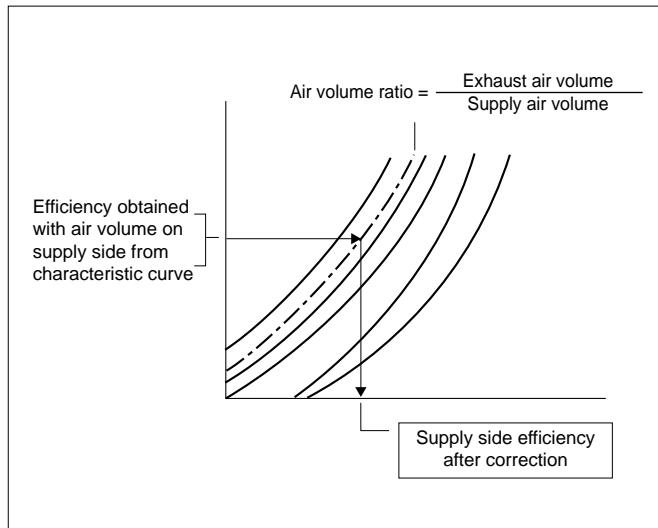

4. Sound

Sound is emitted when any object is excited causing it to vibrate. The object that vibrates is called the sound source, and the energy that is generated at the source is transmitted through the air to the human ear. Humans can hear the sound only when the ear drum vibrates.


4.1 Sound level and auditory perception

Sound level is the sound wave energy that passes through a unit area in a unit time, and is expressed in dB (decibel) units.

The sound heard by the human ear differs according to the strength of the sound and the frequency, and the relation to the pure tone sound is as shown on the right. The vertical line shows the strength of the sound and the horizontal line shows the frequency. For frequencies between 20 Hz to 15,000 Hz which can be felt by the human ear, the strength of sound that can be felt that is equivalent to a 1,000 Hz sound is obtained for each frequency. The point where these points cross is the sound level curve, and a sound pressure level numerical value of 1,000 Hz is expressed. These are called units of phons. For example, the point on the 60 curve is perceived as 60 phons.

- On average, the human senses a sound that is less than 1,000 Hz as rather weak, and a sound between 2,000 to 5,000 Hz as strong.


ISO audio perception curve

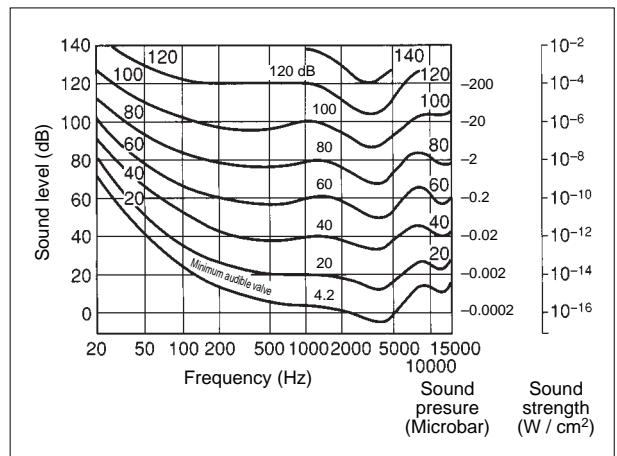

4.2 How to measure sound levels

A sound level meter (JIS C 1502, IEC 651) is used to measure sound levels. This sound level meter has three characteristics (A, B and C characteristics) as shown on the right. These represent various sound wave characteristics.

Generally, the A characteristic, which is the most similar to the human ear, is used.

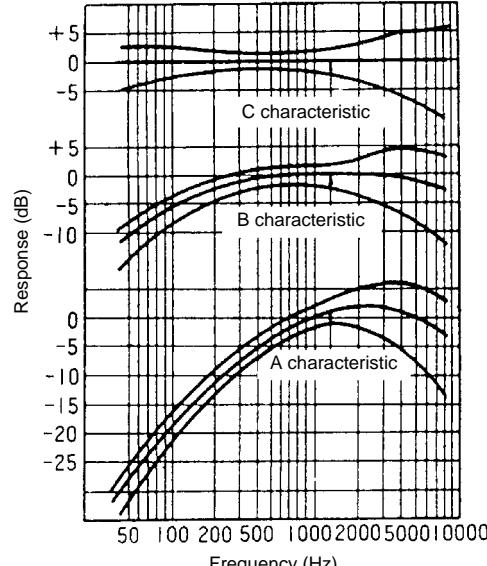


4.3 Frequency analysis of sound

It is said that the human ear senses differently according to the frequency. However, the sound generated from a vibration is not limited to one frequency, but instead, various frequencies are generated at differing levels. This is expressed by the NC curve, which is determined according to the difficulty of hearing a conversation.


- Even if the sound is a very low level, it is annoying if a specific frequency is emitted very loudly.

These sounds are suppressed to a minimum during product design stages, but, the sound may become very disturbing with resonance of the ceiling, wall, etc.

Example Continuous frequency analysis

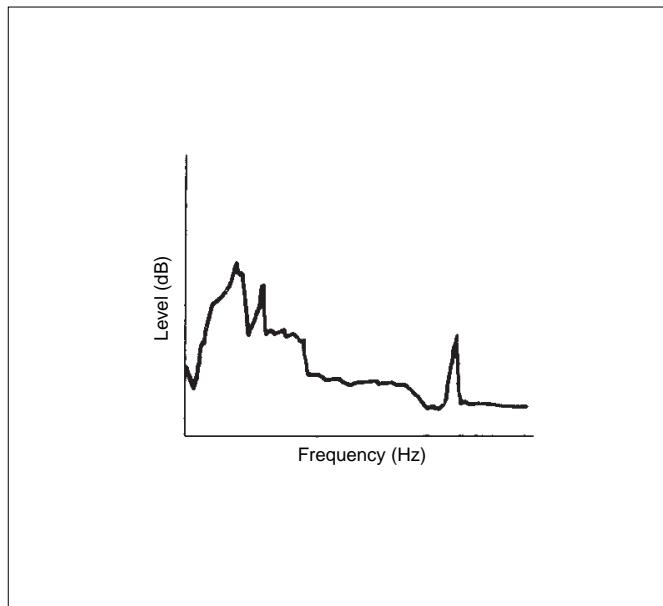


NC curve

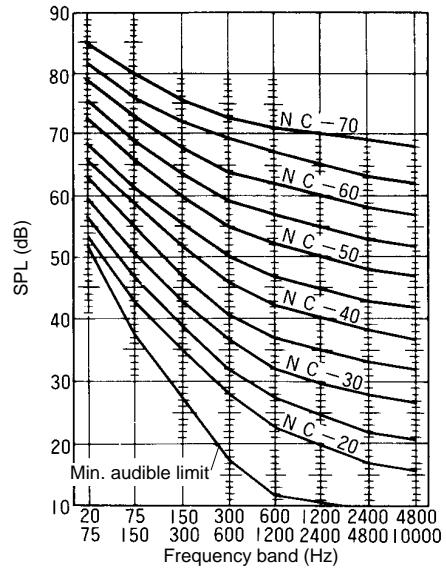

● Tolerable noise levels and NC values according to room application

Room application	dB	NC value	Room application	dB	NC value
Broadcasting studio	25	15 - 20	Cinema	40	30
Music hall	30	20	Hospital	35	30
Theatre (approx. 500 seats)	35	20 - 25	Library	40	30
Classroom	40	25	Small office	45	30 - 35
Conference room	40	25	Restaurant	50	45
Apartment	40	25 - 30	Gymnasium	55	50
Hotel	40	25 - 30	Large conference room	50	45
Housing (room)	40	25 - 30	Factory	70	50 or more

- * Approximate values of noise levels using practical examples
- The following diagram shows noises found near us.
- Approximate degree of noise levels can be seen with these examples.
- * Noise levels and perception

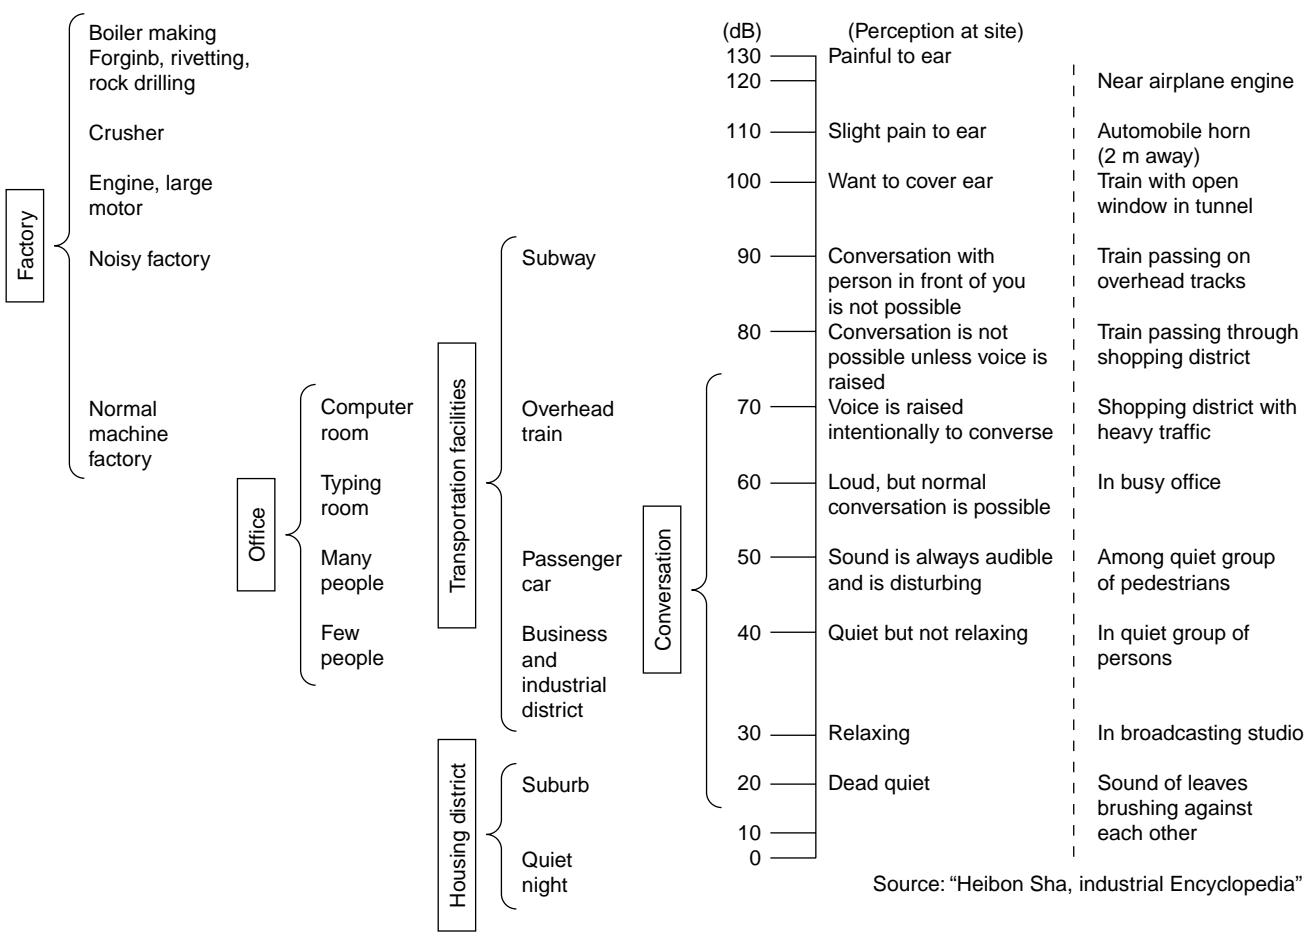

4.4 Indoor noise

(1) Principle of indoor noise

1) Power levels

The Power level (PWL) of the sound source must be understood when considering noise effects.

The following formula is used to obtain PWL from the measured sound pressure data (values noted in catalog) in an anechoic chamber.

PWL : Sound source power level (dB)

SPL₀ : Measured sound pressure in anechoic chamber (dB)

ro : Measurement distance (m)

2) Principal model

Consider the room shown in Figs. 1 and 2.

- Fig. 1 shows an example of the integrated main unit and supply air diffuser (and return grille). This is equivalent to the cassette-type Lossnay.

Fig. 2 shows an example of a separated main unit and supply air diffuser (and return grille). This is equivalent to the ceiling embedded-type Lossnay.

- ① is the direct sound from the supply air diffuser (return grille) and ② is the echo sound. ③ (④ to ⑥) is the direct sound that is emitted from the main unit and duct and passes through the finished ceiling and leaks. ⑦ is the echo sound of ③.

3) Setting of noise

- The following formula is used to obtain the noise value at a position in the room.

SPL : Sound pressure level at reception point [dB]

PWL : Sound source power level [dB]

Q : Directivity factor (Refer to Fig. 3)

r : Distance from sound source [m]

R : Room constant [$R = \bar{\alpha}S/(1 - \bar{\alpha})$]

$\bar{\alpha}$: Average sound absorption ratio in room

3. Average sound absorption rate
(Normally, 0.1 to 0.2)

Fig. 1

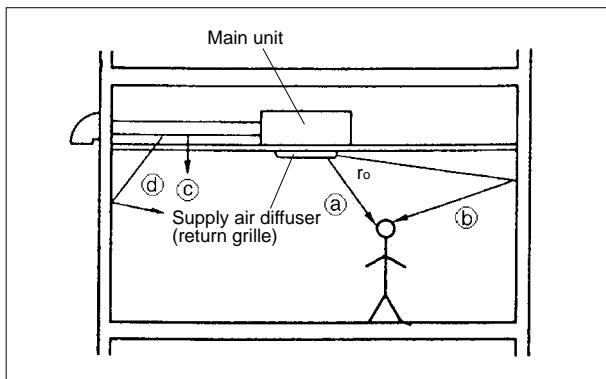


Fig. 2


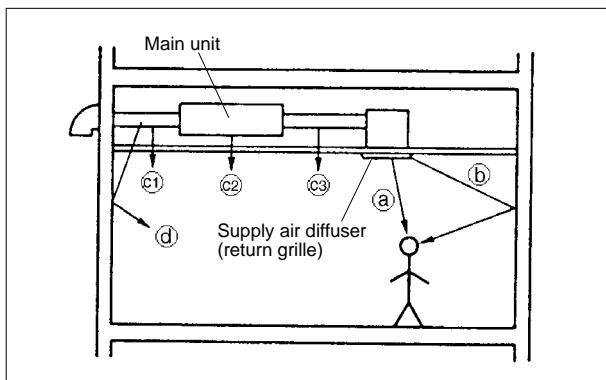


Fig. 3 (Sound source position and directivity factor Q)

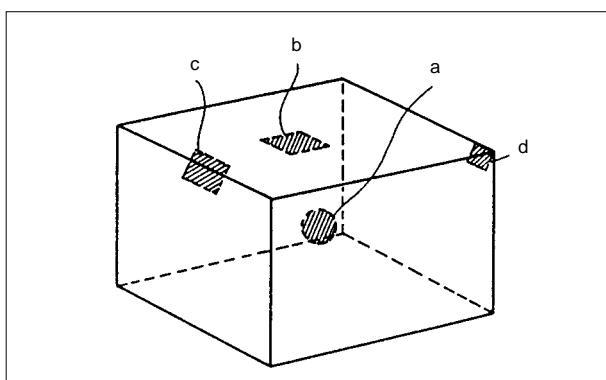

	Sound source position	Q
a	Centre of room	1
b	Centre of ceiling	2
c	Edge	4
d	Corner	8

- For the supply air diffuser (and return grille) in Fig. 2, PWL must be corrected for the noise alternation provided by the duct work (TL) such that:

$$PWL' = PWL - TL$$

- Item i in formula (II) is the direct sound (a, c), and ii is the echo sound (b, d).
- The number of sound sources in the room (main unit, supply air diffuser, return grille etc.) is obtained by calculating formula (II), and combining the number with formula (III).

$$SPL = 10 \log (10^{SPL_1/10} + 10^{SPL_2/10}) \dots \text{(III)}$$

- The average sound absorption rate in the room and the ceiling transmission loss differ according to the frequency, so formula (II) is calculated for each frequency band, and is combined with formula (III) for an accurate value.

Transmission loss in ceiling material (dB) Example

	Material () indicates thickness (mm)	Plaster board (7)	Plaster board (9)	Luan plywood (12)
Average	20	22	23	
Frequency band (Hz)	125	10	12	20
	250	11	15	21
	500	19	21	23
	1,000	26	28	26
	2,000	34	35	24
	4,000	42	39	—

(2) Avoiding noise disturbance from Lossnay unit

- When unit air passage behind ceiling is sound source (Fig. 1 c, d, Fig. 2 c₁ to c₃, d₁)
 - Avoid the following types of construction when disturbing noise may be emitted from large units. (Refer to Fig. 4)
 - Sudden contraction of duct diameter
(Ex. $\varnothing 250 \rightarrow \varnothing 150, \varnothing 200 \rightarrow \varnothing 100$)
 - Sudden curves in aluminum flexible ducts, etc.
(Especially right after unit outlet)
 - Opening in ceiling plates
 - Suspension on weak material
 - The following countermeasures should be taken.
(Refer to Fig. 5)
 - Use ceiling material with high soundproofing properties (high transmission loss). (Care is required for low frequency components as the difference in material is great).
 - Addition of soundproofing material to areas below sound source.
(The entire surface must be covered when using soundproofing sheets. Note, that in some cases, covering of the area around the unit may not be possible due to the heat generated from the unit.)

Fig. 4


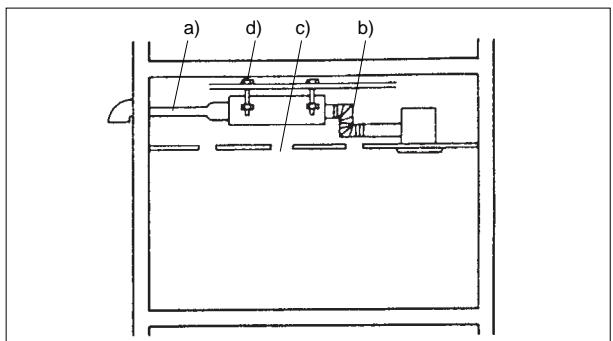


Fig. 5

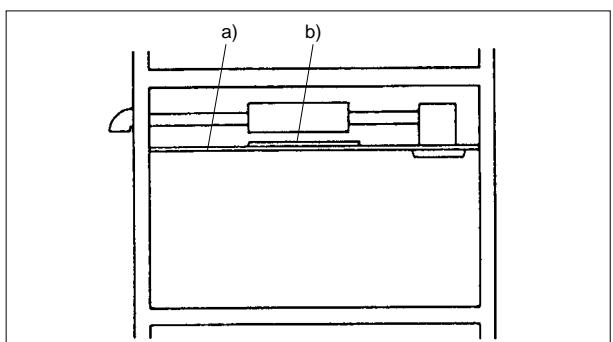

CHAPTER 4 ● Characteristics

2) When supply air diffuser (and return grille) is sound source

..... part 1

- (A) If the main unit is separated from the supply air diffuser (and return grille) as shown in Fig. 6, the use of a silencer box a), silence duct b) or silence grille c) is recommended.

- (B) If a draft sound is being emitted from the supply air diffuser (and return grille), branch the flow as shown in Fig. 7 a), lower the flow velocity with a grille, and add a silencer duct to section b).
(If the length is the same, a silencer duct with the small diameter is more effective.)

3) When supply air diffuser (and return grille) is sound source

..... part 2

- (A) If the main unit and supply air diffuser (and return grille) are integrated as shown in Fig. 8, or if the measures taken in 2) a) and b) are inadequate, the interior material in the room can be changed to that having a high sound absorbency as shown in Fig. 8 a).
This is not, however, very effective towards direct sounds.
- (B) Installing the sound source in the corner of the room as shown in Fig. 8 b) is effective towards the center of the room, but will be inadequate towards people in the corner of the room.

Fig. 6

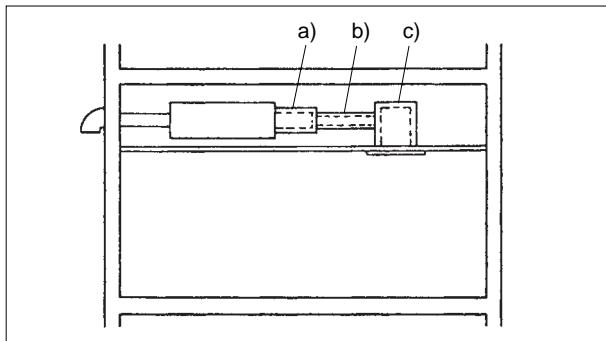


Fig. 7


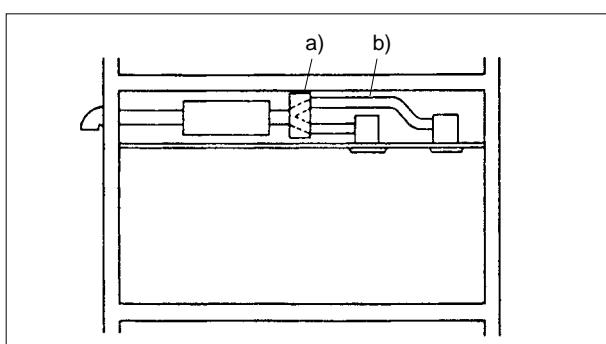



Fig. 8

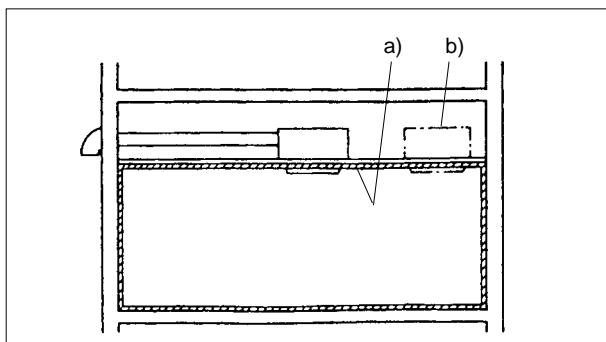


5. NC Curves

LGH-50RX type

Background noise : 25 dB or less (A range)
 Measurement site : Anechoic chamber
 Operation conditions : Lossnay ventilation
 Power supply : 208 V 60 Hz

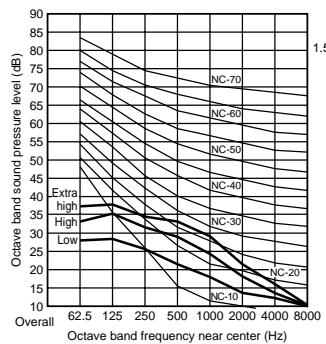


Background noise : 25 dB or less (A range)
 Measurement site : Anechoic chamber
 Operation conditions : Lossnay ventilation
 Power supply : 230 V 60 Hz

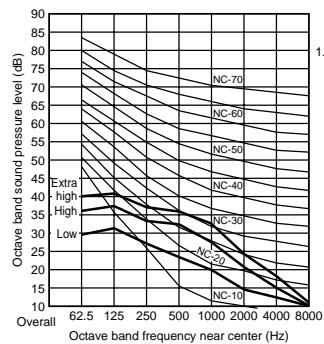


LGH-100RX type

Background noise : 25 dB or less (A range)
 Measurement site : Anechoic chamber
 Operation conditions : Lossnay ventilation
 Power supply : 208 V 60 Hz

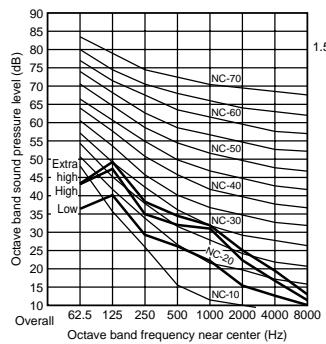


Background noise : 25 dB or less (A range)
 Measurement site : Anechoic chamber
 Operation conditions : Lossnay ventilation
 Power supply : 230 V 60 Hz

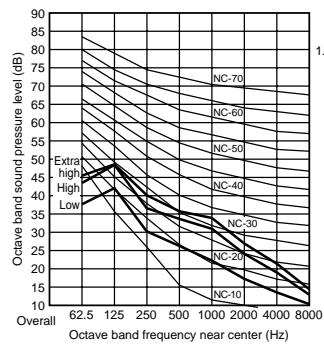


LGH-200RX type

Background noise : 25 dB or less (A range)
 Measurement site : Anechoic chamber
 Operation conditions : Lossnay ventilation
 Power supply : 208 V 60 Hz

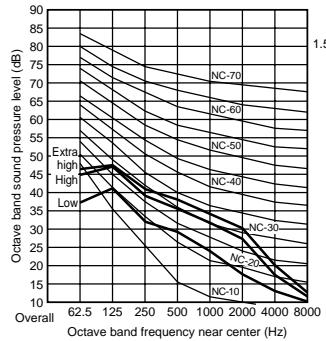

Background noise : 25 dB or less (A range)
 Measurement site : Anechoic chamber
 Operation conditions : Lossnay ventilation
 Power supply : 230 V 60 Hz

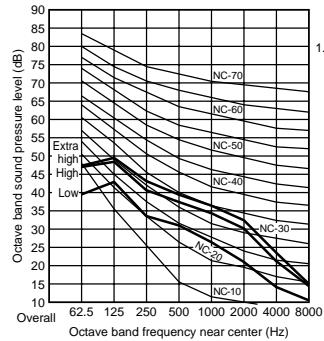


6. List of Models

6.1 Model specifications and list of material colours for Industrial Lossnay

MODEL	LGH-50RX3-CAN					
Control signal	Serial single communication (M-NET transmission)					
Heat exchange system	Air-to-air total heat (sensible heat + latent heat) exchange					
Heat exchanger material	Partition, spacing plate-special treated paper					
Cladding	Galvanized steel sheet					
Heat insulating material	Self-extinguishing urethane foam					
Motor	Totally enclosed capacitor permanent split-phase induction motor, 4 poles, 2 units					
Blower	222mm dia. centrifugal fan					
Filter material	Non-woven fabrics filter (Gravitational method 82%)					
Operating environment (Supply air)	-10°C to +40°C, RH 80% or less (-15°C (※) to +40°C, RH 80% or less)					
Functions	Lossnay ventilation/Bypass ventilation High(Extra high)-Low switching					
Weight	33Kg					
Power supply	Single phase 208-230V 60Hz					
Ventilation mode	Lossnay ventilation			Bypass ventilation		
Fan speed	Extra high	High	Low	Extra high	High	Low
Current (A)	1.23-1.25	1.00-1.04	0.56-0.60	1.28-1.37	1.02-1.11	0.57-0.62
Power consumption (W)	253-278	207-237	116-139	254-280	207-239	116-139
Air volume (m³/h)	500	420	260	500	420	260
	(L/s)	139	117	72	139	117
External static pressure (Pa)	110-205	70-145	30-70	110-205	70-145	30-70
Temperature recovery efficiency (%)	73	75	81	-	-	-
Enthalpy recovery efficiency (%)	Heating	66	69	75	-	-
	Cooling	47	49	57	-	-
Noise (dB)	Measured at 1.5m under the center of panel	33-36	30-32	24-25	33-36	30-32
	Air outlets	41-44	36-40	29-31	41-44	36-40
Starting current	Under 2.0A or less					
Insulation resistance	10MQ or more 500V megger					
Dielectric strength	AC 1500V 1 minute					

※The defrosting mode must be operated under -10°C or below.

Characteristic curve

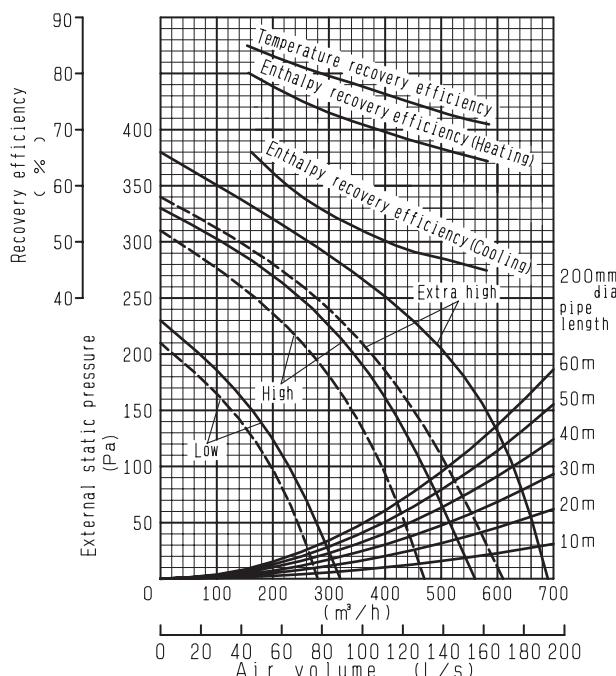


MODEL

LGH-100RX3-CAN

Control signal	Serial single communication (M-NET transmission)					
Heat exchange system	Air-to-air total heat (sensible heat + latent heat) exchange					
Heat exchanger material	Partition, spacing plate-special treated paper					
Cladding	Galvanized steel sheet					
Heat insulating material	Self-extinguishing urethane foam					
Motor	Totally enclosed capacitor permanent split-phase induction motor, 4 poles, 2 units					
Blower	245mm dia. centrifugal fan					
Filter material	Non-woven fabrics filter (Gravitational method 82%)					
Operating environment (Supply air)	-10°C to +40°C, RH 80% or less (-15°C (※) to +40°C, RH 80% or less)					
Functions	Lossnay ventilation/Bypass ventilation High(Extra high)-Low switching					
Weight	72Kg					
Power supply	Single phase 208-230V 60Hz					
Ventilation mode	Lossnay ventilation			Bypass ventilation		
Fan speed	Extra high	High	Low	Extra high	High	Low
Current (A)	2.9-2.9	2.5-2.5	1.6-1.7	2.8-2.8	2.5-2.5	1.6-1.7
Power consumption (W)	596-654	526-578	336-390	590-648	521-575	334-396
Air volume (m³/h)	1000	900	650-700	1000	900	650-700
(L/s)	278	250	181-194	278	250	181-194
External static pressure (Pa)	140-205	110-170	60-100	140-205	110-170	60-100
Temperature recovery efficiency (%)	74	76	79-79	-	-	-
Enthalpy recovery efficiency (%)	Heating 68 Cooling 48	69 50	73-72 56-54	-	-	-
Noise (dB)	Measured at 1.5m under the center of panel	37-39	35-37	28-30	38-40	36-39
	Air outlets	45-47	42-45	34-37	45-48	43-45
Starting current	Under 5.0A or less					
Insulation resistance	10MQ or more 500V megger					
Dielectric strength	AC 1500V 1 minute					

※The defrosting mode must be operated under -10°C or below.


Characteristic curve

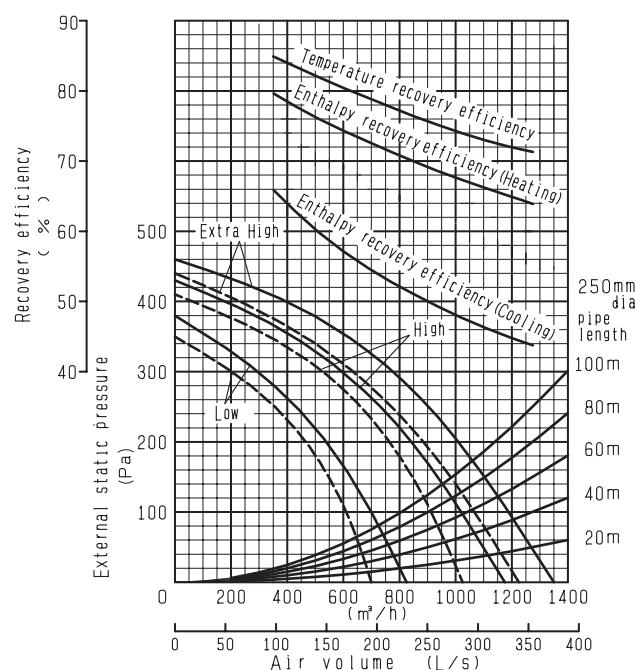

CHAPTER 4 ● Characteristics

MODEL	LGH-200R X3 - CAN					
Control signal	Serial single communication (M-NET transmission)					
Heat exchange system	Air-to-air total heat (sensible heat + latent heat) exchange					
Heat exchanger material	Partition, spacing plate-special treated paper					
Cladding	Galvanized steel sheet					
Heat insulating material	Self-extinguishing urethane foam					
Motor	Totally enclosed capacitor permanent split-phase induction motor, 4 poles, 4 units					
Blower	222mm dia. centrifugal fan					
Filter material	Non-woven fabrics filter (Gravitational method 82%)					
Operating environment (Supply air)	-10°C to +40°C, RH 80% or less (-15°C (※) to +40°C, RH 80% or less)					
Functions	Lossnay ventilation/Bypass ventilation High(Extra high)-Low switching					
Weight	179Kg					
Power supply	Single phase 208-230V 60Hz					
Ventilation mode	Lossnay ventilation			Bypass ventilation		
Fan speed	Extra high	High	Low	Extra high	High	Low
Current [A]	5.7-5.7	5.1-5.1	3.3-3.4	5.6-5.6	5.0-5.0	3.3-3.4
Power consumption [W]	1200-1290	1058-1161	682-786	1173-1265	1040-1135	676-776
Air volume [m³/h]	2000	1800	1250-1350	2000	1800	1250-1350
[L/s]	556	500	347-375	556	500	347-375
External static pressure (Pa)	115-200	90-160	45-90	115-200	90-160	45-90
Temperature recovery efficiency (%)	73	75	79-78	-	-	-
Enthalpy recovery efficiency (%)	Heating	68	69	74-73	-	-
Cooling	48	50	56-55	-	-	-
Noise (dB)	Measured at 1.5m under the center of panel	39-41	37-39	30-32	40-42	38-40
Air outlets		50-52	47-49	39-41	50-52	47-49
Starting current	Under 9.5A or less					
Insulation resistance	10MQ or more 500V megger					
Dielectric strength	AC 1500V 1 minute					
※The defrosting mode must be operated under -10°C or below.						
Characteristic Curve <p>The graph plots Recovery efficiency (%) on the y-axis (40 to 90) against External static pressure (Pa) on the left y-axis (0 to 500) and Air volume (m³/h) on the bottom x-axis (0 to 2500). Three sets of curves are shown for 230V (solid lines) and 208V (dashed lines) operation. Each set includes a 'Temperature recovery efficiency' curve and two 'Enthalpy recovery efficiency' curves for 'Heating' and 'Cooling'. Three fan speed levels are indicated: 'Extra High', 'High', and 'Low'. A vertical note on the right states '350mm dia pipe length'. A horizontal note at the bottom right specifies '100m 80m 60m 40m 20m'.</p>						

6.2 List of industrial/business Lossnay accessories

Model	Accessories	Duct packaging site
LGH-50RX type LGH-100RX type	<ul style="list-style-type: none"> ● Duct connection flanges × 4 ● Mounting screws × 34 ● Washers × 32 ● Protective cover × 1 <For installing upside down> ● Lossnay connection cable × 1 <div style="margin-left: 20px; margin-top: 10px; border-left: 1px solid black; padding-left: 10px; display: inline-block;"> <ul style="list-style-type: none"> ● IB × 1 ● IM × 1 </div> 	 <p>* Top view. There is a space between the EA side and the OA side.</p>
LGH-200RX type	<ul style="list-style-type: none"> ● Mounting screws × 18 ● Duct connection flange × 4 <double flanges at SA and EA sides> ● Protective cover × 1 <For installing upside down> ● Lossnay connection cable × 1 <div style="margin-left: 20px; margin-top: 10px; border-left: 1px solid black; padding-left: 10px; display: inline-block;"> <ul style="list-style-type: none"> ● IB × 1 ● IM × 1 </div> 	 <p>2 are inserted on top of each other at the SA and EA openings, in the opposite direction.</p> <p>* Top view.</p>  <p>* Top view. One is inserted at each opening in the opposite direction.</p>

CHAPTER 5

System Design Recommendations

1. Lossnay Usage Conditions


	Main unit installation conditions	Outdoor air and exhaust air conditions
Commercial-use Lossnay	-10°C to +40°C, RH80% or less.	-15°C to + 40°C, RH80% or less.

In some cases special attention needs to be paid to extreme operating conditions.

These are described as below:

1.1 Use in cold climates (outdoor temperature: -5°C or less)

Plot the Lossnay intake air conditions A and B on a psychrometric chart as shown on the right. If the high temperature side air B intersects the saturation curve such as at C, moisture condensation or frosting will occur on the Lossnay. In this case, the low temperature side air A should be preheated to the temperature indicated by point A' so that point C shifts to the point C'.

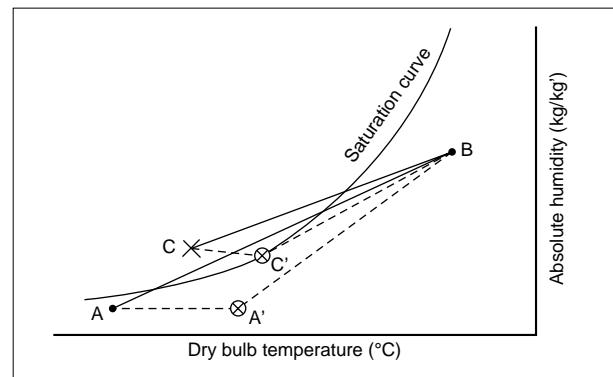

1.2 Use in high humidity conditions (Relative humidity: 80% or more)

When using the system in high humidity conditions such as heated pools, bathrooms, mushroom cultivation houses, high-fog areas etc., moisture will condense inside the Core, and drainage will occur. In these cases, the general purpose Lossnay that uses treated paper cannot be used.

1.3 Use in other special conditions

- The Lossnay cannot be used where toxic gases and corrosive element's such as acids, alkalis, organic solvents, oil mist or paints exist.
- Use where heat is recovered from odor-laden air and supplied to another place (area) is not possible.
- Avoid use where salt or hot water damage may occur.
- Pre-heating is necessary if using the system in a cold climate (locations where winter temperatures are below -15°C).

Refer to page 144 to set up the heater.

2. Noise Value of Lossnay with Built-in Fans

The noise level specified for Lossnay units is as that measured in an anechoic chamber. The sound level may increase by 8 to 11 dB according to the installation construction material, and room contents.

When using the Lossnay in a quiet room, it is recommended that measures such as installing a muffling duct, silencer intake/exhaust grill or silencer box be carried out.

3. Attachment of Air Filter

An air filter must be mounted to the air inlets (both intake and exhaust) of the Lossnay to clean the air and to prevent the Core from clogging. Always mount this filter, and periodically service it.

4. Duct Construction

- Always treat the two ducts on the outdoor side (outdoor air intake and exhaust outlet) with insulation to prevent frosting or condensation.
- The outdoor duct gradient must be 1/30 or more (to wall side) to prevent rain water from infiltrating the system.
- Do not use the standard vent caps or round hoods where they may come into direct contact with rain water.
(Instead, use of a deep hood is recommended.)

5. By-pass Ventilation

Do not operate with "By-pass ventilation" when heating during winter. Frost or condensation may generate on the main unit and cause discolouring of the ceiling, etc.

6. Transmission Rate of Various Gases and Related Maximum Workplace Concentration

Measurement conditions	Gas	Air volume ratio Q _{SA} /Q _{RA}	Exhaust air concentration C _{RA} (ppm)	Supply air concentration C _{SA} (ppm)	Transmission rate (%)	Max. workplace concentrations (ppm)
Measurement method	Hydrogen fluoride	1.0	36	<0.5	- 0	0.6
• Chemical analysis with colorimetric method for H ₂ SO ₄ , HCHO	Hydrogen chloride	1.0	42	<0.5	- 0	5
	Nitric acid	1.0	20	<0.5	- 0	10
	Sulfuric acid	1.0	2.6 mg/m ³	- 0 mg/m ³	- 0	0.25
• Ultrasonic method with gas concentration device for CO, SF ₆	Trichlene	1.0	85	2.5	2.9	200
	Acetone	1.0	5	0.13	2.5	1,000
	Xylene	1.0	110	2.5	2.3	150
• Infrared method with gas concentration device for CO ₂	Isopropyl alcohol	1.0	2,000	50	2.5	400
	Methanol	1.0	41	1.0	2.4	200
	Ethanol	1.0	35	1.0	2.9	1,000
	Ethyl acetate alcohol	1.0	25	0.55	2.2	400
	Ammonia	1.0	70	2	2.9	50
The fans are positioned at the air supply/exhaust suction positions of the element	Hydrogen sulfide	1.0	15	0.44	2.9	10
	Carbon monoxide	1.0	71.2	0.7	1.0	
	Carbon dioxide	1.0	44,500	1,400	1.8	
Measurement conditions: 27°C, 65% RH	Smoke	1.0	—	—	1 - 2	
	Formaldehyde	1.0	0.5	0.01	2	0.08
* OA density for CO ₂ is 600 ppm.	Sulfur hexafluoride	1.0	27.1	0.56	2.1	
	Skatole	1.0	27.1	0.56	2.0	
	Indole	1.0	27.1	0.56	2.0	
	Toluene	1.0	6.1	0.14	2.3	

⚠ CAUTION

The above does not apply to the moisture resistant total heat recovery unit.

7. Solubility of Odors and Toxic Gases, etc., in Water and Effect on Lossnay Core

Main generation site	Gas name	Molecular formula mist	Gas vapour odor	Non-toxic/toxic/	Sulubility in water		Max. workplace concentration	Useability of Lossnay
					mℓ/mℓ	g/100g		
Chemical plantor chemical laboratory	Sulfuric acid	H ₂ SO ₄	Mist	Found		2,380	0.25	×
	Nitric acid	HNO ₃	Mist	Found		180	10	×
	Phosphoric acid	H ₃ PO ₄	Mist	Found		41	0.1	×
	Acetic acid	CH ₃ COOH	Mist	Bad odor		2,115	25	×
	Hydrogen chloride	HCl	Gas	Found	427	58	5	×
	Hydrogen fluoride	HF	Gas	Found		90	0.6	×
	Sulfur dioxide	SO ₂	Gas	Found	32.8		0.25	△
	Hydrogen sulfide	H ₂ S	Gas	Found	2.3		10	△
	Ammonia	NH ₃	Gas	Bad odor	635	40	50	×
	Phosphine	PH ₃	Gas	Found	0.26		0.1	○
	Methanol	CH ₃ OH	Vapor	Found	Soluble		200	△
	Ethanol	CH ₃ CH ₂ OH	Vapor	Found	Soluble		1,000	△
Toilet	Ketone		Vapor	Found	Soluble		1,000	△
	Skatole	C ₉ H ₉ N	Gas	Bad odor	Minute			○
	Indole	C ₉ H ₇ N	Gas	Bad odor	Minute			○
Others	Ammonia	NH ₃	Gas	Bad odor	635	40	50	×
	Nitric monoxide	NO			0.0043		50	○
	Ozone	O ₃				0.00139	0.1	○
	Methane	CH ₄			0.0301			○
Air (reference)	Chlorine	Cl ₂			Minute		0.5	○
	Air	Mixed gases	Gas	None	0.0167			○
	Oxygen	O ₂	Gas	None	0.0283			○
	Nitrogen	N ₂	Gas	None	0.0143			○
	Carbon monoxide	CO	Gas	Found	0.0214			○
	Carbon dioxide	CO ₂	Gas	None	0.759			○

Note: 1. Water soluble gases and mists cannot be used because the amount that is transmitted with the water is too great.
 2. Acidic gases and mists cannot be used because these will accumulate in the Core and cause damage.
 3. The above does not apply to the moisture resistant total heat recovery unit.

8. Automatic Ventilation Switching

Effect of Automatic Ventilation Mode

The automatic damper mode automatically provides the correct ventilation for the conditions in the room. It eliminates the need for troublesome switch operations when setting the Lossnay ventilator to "By-pass" ventilation. The following shows the effect "By-pass" ventilation will have under various conditions.

(1) Reduces cooling load

If the air outside is cooler than the air inside the building during the cooling season (such as early morning or at night), "By-pass" ventilation will draw in the cooler outside air and reduce the cooling load on the system.

(2) Cooling using outdoor air

During cooler seasons (such as between spring and summer or between summer and fall), if the people in a room cause the temperature of the room to rise, "By-pass" ventilation draw in the cool outside air and use it as is to cool the room.

(3) Night purge

"By-pass" ventilation can be used to release hot air from inside the building that has accumulated in buildings a business district during the hot summer season.

(4) Office equipment room cooling

During cold season, outdoor air can be drawn in and used as is to cool rooms where the temperature has risen due to the use of office equipment.


(Only when interlocked with City Multi and Mr. Slim indoor unit)

9. Vertical Installation

Installation of ceiling embedded-type industrial Lossnay


9.1 Top/bottom reverse installation

All LGH-RX models can be installed in reverse.

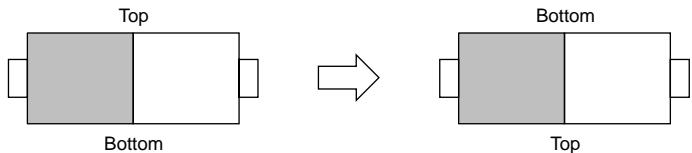

9.2 Vertical installation

Vertical installation is possible, but the installation pattern is limited for some models. Refer to the following table for the installation patterns.

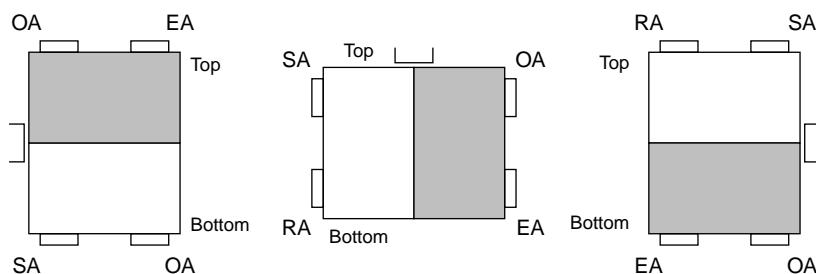

(Precautions)

- When constructing for vertical installation, make sure that rain water will not enter the Lossnay unit from outdoors.
- Always transport the unit in the specified state. Vertical installation applies only to after installation, and does not apply to transportation.
(The motor may be damaged if the unit is transported vertically.)

9.3 Slanted installation


Slanted installation is not possible.

Special note

The LGH-RX model was conventionally designed for being embedded in the ceiling. If possible, vertical installation should be avoided in regard to construction and maintenance.


10. Installation of Supplementary Fan Devices After Lossnay Unit

On occasions it may be necessary to install additional fans in the ductwork following the LGH type Lossnay. This is because of the inclusion of extra components such as control dampers, high-efficiency filters, sound attenuators, etc. which create a significant extra static pressure to the airflow. An example of such an installation is as shown below.

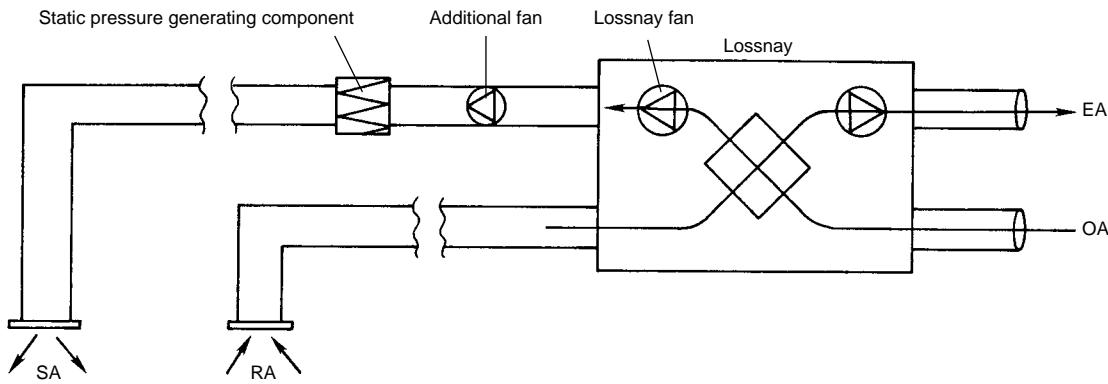


For such an installation care should be taken to avoid undue stress on the fan motors. Referring to the diagrams below, so long as $Q_1' \geq Q_2$, there is no adverse effect on the motors. This is generally such in the majority of cases.

Q-H for Lossnay without extra fan

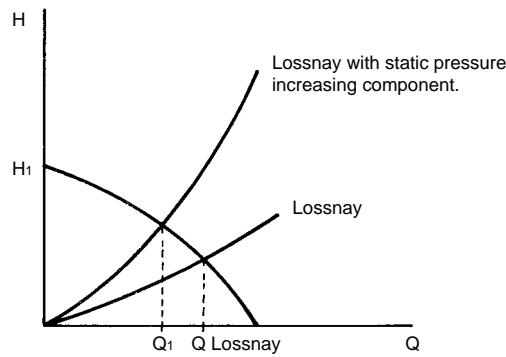

Q-H for Lossnay with extra fan

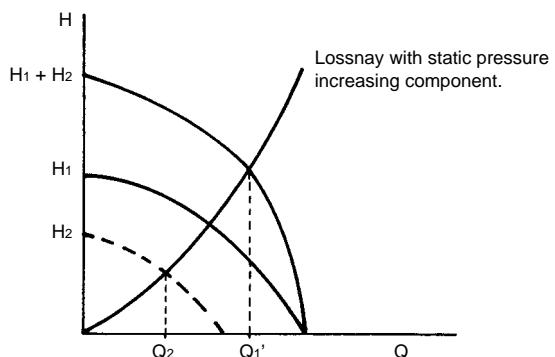

CHAPTER 6

Examples of Lossnay Applications

CHAPTER 6 ● Examples of Lossnay Applications

Lossnay ventilation systems are proposed for eight types of applications in this chapter. These systems are planned for Japanese use, and actual systems will differ according to each country. These should be used only as reference.

1. Large Office Building

1.1 System plan points

Conventional central systems in large buildings, run in floor and building ducts, have generally been preferred to individual room units. Thus, air conditioning and ventilation after working hours was not possible.

In this plan, an independent dispersed ventilation method has been applied to resolve this problem. Such a system's main advantage is that it allows 24-hour operation.

A package-type air conditioning unit is installed in the ceiling, and ventilation is performed with the ceiling-embedded-type Lossnay. Ventilation in the toilet, kitchenette and lift halls, etc., is performed with a straight centrifugal fan.


Setting outline

- Building form : Basement floor SRC (Slab Reinforced Concrete), 8 floors above ground S construction
Total floor space 30,350 m²
- Basement : Employee cafeteria
- Ground floor : Lobby, conference room
- 2 to 7th floor : Offices, salons, board room
- Air conditioning : Package air conditioning
- Ventilation : Ceiling embedded-type Lossnay, straight centrifugal fan

1.2 Current topics

- (1) Operation system that answers individual needs is required.
 - Free independent operation system
 - Simple control
- (2) Effective use of floor space
(elimination of machine room)
- (3) Application to Building Management Laws
 - Effective humidification
 - Elimination of indoor dust
- (4) Energy conservation

Installation state of office system air conditioning system
– The air supplied from the Lossnay is introduced into the intake side of the air conditioner, and the room stale air is directly removed from the inside of the ceiling.

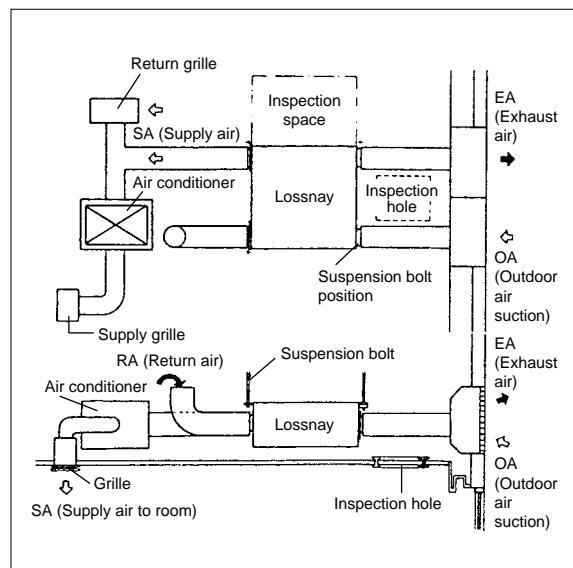

1.3 Proposed details


(1) Air conditioning

- In general offices, the duct method will be applied with several ceiling-embedded multiple cooling heat pump packages in each zone to allow total zone operation.
- Board rooms, conference rooms and salons will be air conditioned with a ceiling embedded-type or cassette-type multiple cooling heat pump package in each room.

(2) Ventilation


- For general offices, a ceiling embedded-type Lossnay will be installed in the ceiling. The inside of the ceiling will be used as a return chamber for exhaust, and the air from the Lossnay will be supplied to the air-conditioning return duct and mixed with the air in the air conditioning passage. (Exhaust air is taken in from the entire area, and supply air is introduced into the air conditioner to increase the ventilation effectiveness for large rooms.)
- For board rooms, conference rooms and salons, a ceiling embedded-type Lossnay will be installed in the ceiling. The stale air will be duct exhausted from the discharge grille installed in the centre of the ceiling. The supply air will be discharged into the ceiling, where after mixing with the return air from the air conditioner it is supplied to the air conditioner.
- The air in the toilet, kitchenette, and lift hall, etc., will be exhausted with a straight centrifugal fan in each room. The OA supply for this section will use the air supplied from the Lossnay. (The OA volume will be obtained by setting the Lossnay supply fan in the general office to the extra-high notch.)

Installation state of air conditioning system for board rooms, conference rooms, salons - the air supplied from the Lossnay is blown into the ceiling, and the stale air is removed from the discharge grille.

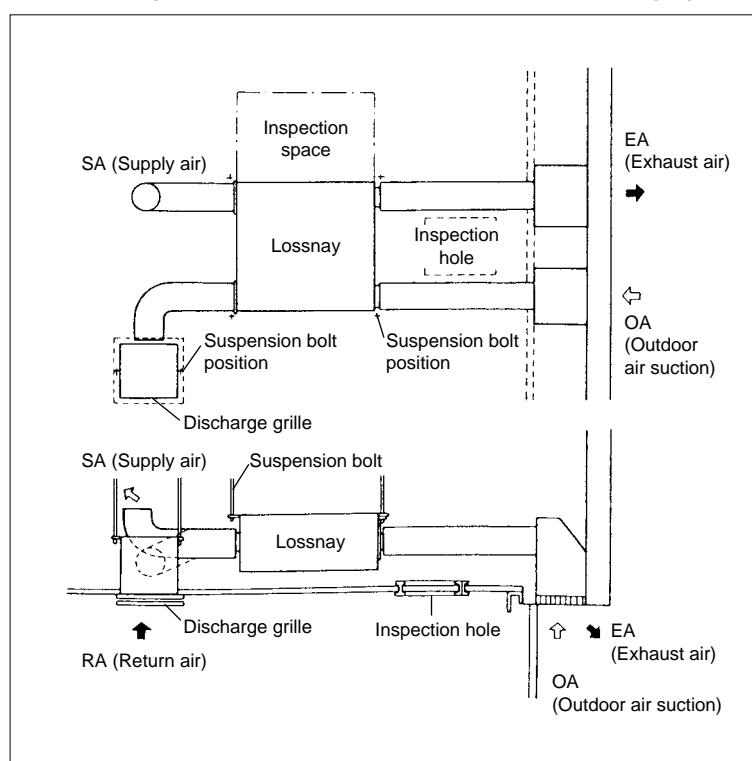

CHAPTER 6 ● Examples of Lossnay Applications

- A gallery will be constructed on the outer wall for the outer wall exhaust air outlets to allow for blending in with the exterior.

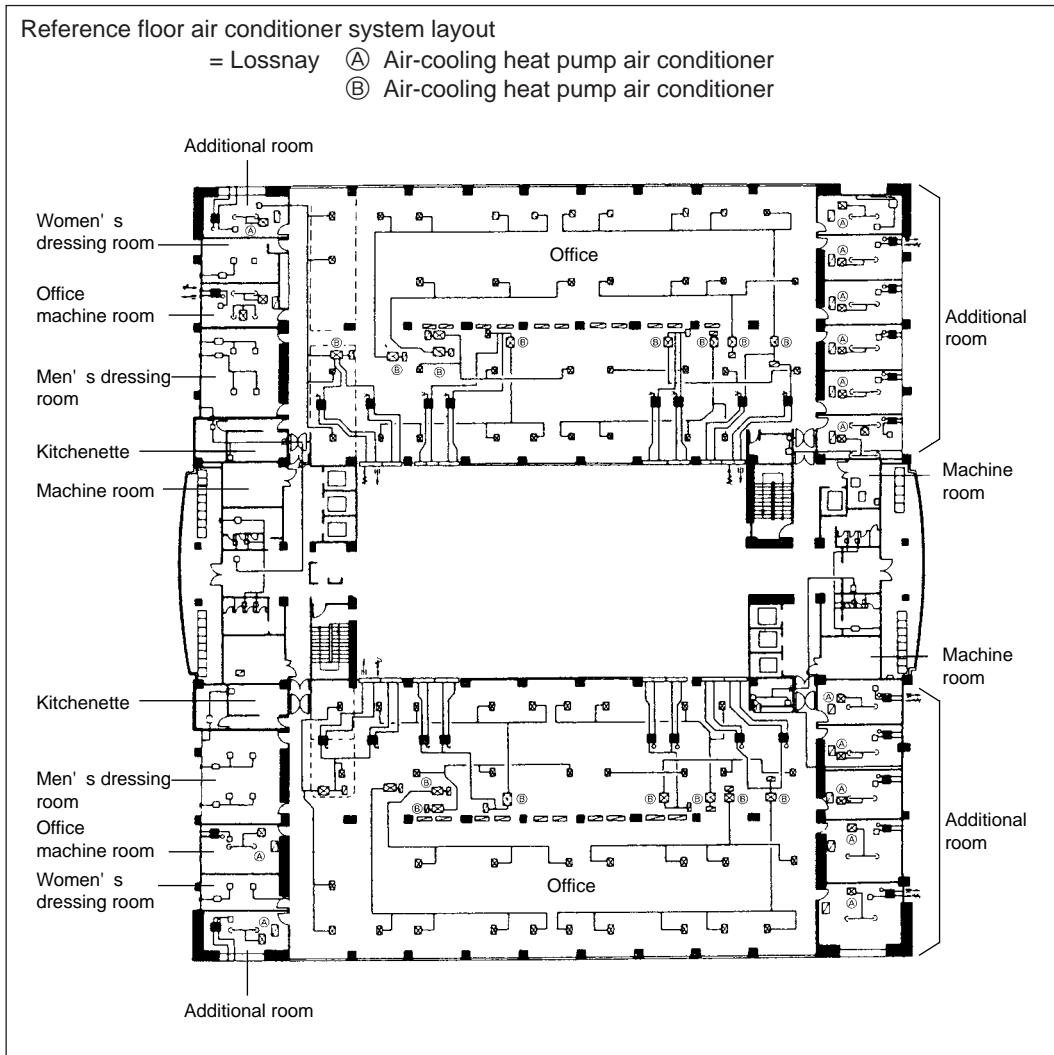

(3) Humidification

If the load fluctuation of the required humidification amount is proportional to the ventilation volume, it is ideal to combine the humidifier installation with the ventilation system. For this application, the humidifier is installed on with the air supply side of the Lossnay.

(4) Conformation to Building Laws

The most important consideration here is humidification and dust removal; in these terms, it is recommended that a humidifier is added to the air conditioning system for the office system to allow adequate humidification.

Installation of a filter on each air circulation system in the room is effective for dust removal, but if the outdoor air inlet is near the dust source, such as a road, a filter should also be installed on the ventilation system.

1.4 Effect

- (1) Air conditioning and ventilation needs can be met on an individual basis.
- (2) Operation is possible with a 24-hour system.
- (3) Operation is simple with the switches being in the room. (A controller is not required.)
- (4) Floor space is saved and thus the floor can be used to the maximum.
- (5) Energy is conserved with the independent heat recovery.
- (6) Fresh air air-conditioning is possible with the independent system.

2. Medium Size Office Building

2.1 System plan point

In recent building air conditioning systems, demands for a consistent rationalization from design through operation and control aspects are being made to meet diversified building needs.

In the entire air conditioning facility, either the cooling/heating source equipment or specific air conditioning equipment is considered as being only one element. Thus, it is important to design this element so that it covers the user's needs while providing total amenity.

This air conditioning system plan is for a so-called company building that is largely divided into the general office section (hereinafter referred to as general floors) and special room sections including board rooms and conference rooms (hereinafter referred to as special floors). Furthermore, Building Management Laws are applied to the building due to the scale.

Setting outline

- Building area : 862.2 m²
- Total floor area : 7,093 m²
- No. of floors : Basement, above ground 8, penthouse 1
- Application per floor : Basement Parking area
Ground floor Large hall
1 to 5 Offices
6 to 7 Special rooms

2.2 Current topics

For general office buildings of the past, centralised air conditioning methods allowing the total centralised control and systematization of the entire building (or divided into floor systems) were favoured due mainly to facility control, uniformity of operation hours, maintenance efficiency and building usage. However, when additional work was required to be done on these systems problems occurred.

A comparison of the following items in each system is shown in Table 1.

- Energy conservation (air conditioning power)
- Space saving (area required for air conditioning facilities)
- Flexibility (zoning and refurbishing)

Table 1 Comparison of air conditioning systems

	Air conditioning system	Air conditioning power (kW)			Required area (m ²)				Sleeve size of beam × Q'ty (Per floor)	Zoning	Refurbishing	Cleanliness (Building Management Law)	Noise
		Heat source	Load	Total	Shaft	Machine room	Roof	Total					
A	Air-cooling heat pump chiller + Air handling unit on each floor + Floor-type fan coil unit (perimeter)	317	105	422	80	513	140	733	ø100 × 162	Possible for each system (each air conditioner)	Same as left	Possible by assembling required specification filter on air conditioner	Noise control possible
B	Air-cooling heat pump chiller + Ceiling embedded-type fan coil unit + Ceiling embedded-type outdoor air treatment unit	317	45	362	80	–	140	220	ø100 × 162 ø250 × 108	Possible for each outdoor air treatment unit (Per unit size)	Same as left	Possible by assembling required specification filter on outdoor air treatment unit and fan coil unit	Little noise emitted
C	Air-cooling heat pump chiller Single suction method	393	67	460	50	567	–	617	ø100 × 45	Possible for each air conditioner	Same as left	Possible by assembling required specification filter on air conditioner	Relatively loud
D	Ceiling embedded-type air-cooling heat pump Package air conditioner (City Multi) + Ceiling embedded-type outdoor air treatment unit	239	47	286	80	–	150	230	ø250 × 189	Possible for each outdoor air treatment unit (Per unit size)	Same as left	Possible by assembling required specification filter on air conditioner and outdoor air treatment unit	Little noise emitted, but louder than B system
E	B system + D system (combined use) (B system for general floors) (D system for special floors)	285	53	338	80	–	200	280	ø100 × 144 ø250 × 21	Possible for each outdoor air treatment unit (Per unit size)	Same as left	Possible by assembling required specification filter on outdoor air treatment unit, air conditioner and fan coil unit	Little noise emitted


2.3 Proposed details

A) General floors


An independent dispersed-type control system incorporating an air cooling heat pump chiller and cassette-type fan coil unit for cooling and heating is used. This can cater for load fluctuations resulting from increases in office automation systems or changes in partitions hence requiring independent control of each module zone (approx. 70 m²). Outdoor-Air Processing unit is used for ventilation and humidification, and construction and space is reduced by using a system ceiling and ceiling chamber method. (Table 1 B system)

B) Special floors

City Multi and Outdoor-Air Processing unit are applied as package-type independent units, located so as to conform with lighting fixtures, air outlets and suction inlets in rooms where the interior is important while ensuring the required air-conditioning quality. (Table 1 D system)

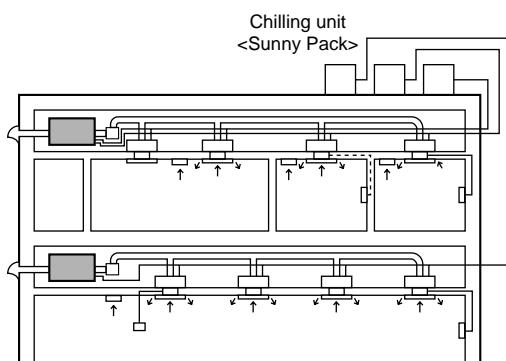

System using fan coil unit (general floors)

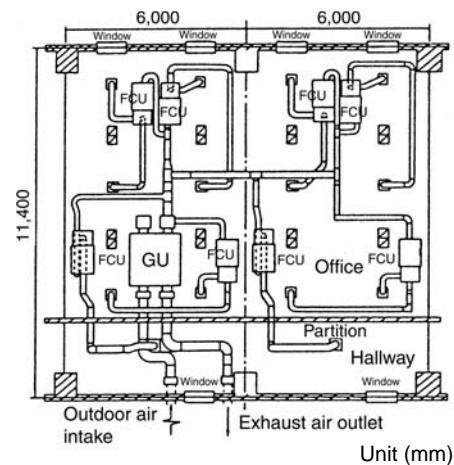

General floor air conditioning facilities

- : Air intake
- △ : Supply diffuser
- FCU : Fan coil unit
- GU : Outdoor-Air processing unit

2.4 Effect

(1) Individual control is possible

Individually dispersed air conditioning that creates a comfortable environment according to general floor and special floor needs is realised.

(2) Energy conservation

Wasted air conditioning energy is eliminated allowing great reduction in operation costs.

(3) Space saving

The Outdoor-Air Processing unit, fan coil unit and building air conditioner are all ceiling embedded-types, so the back of the ceiling is used effectively, saving machine room space and floor space.

(4) Construction saving


The ventilation functions have been unitised with the Outdoor-Air Processing unit, and all air conditioner units can be unitised allowing construction to be reduced.

(5) Simple architecture layout

Machine room space and main duct space for air conditioning are not required, so limits in the layout are reduced.

	New air conditioning system	Conventional air conditioning system
Heat source equipment	Air-cooling heat pump chiller	Air-cooling heat pump chiller
Air Conditioner	Outdoor air treatment unit Outdoor-Air Processing unit (8 units on each floor) Ceiling embedded-type fan coil unit	Air handling unit (1 unit on each floor) Floor-type fan coil unit

Ratio with conventional air conditioning system as 100

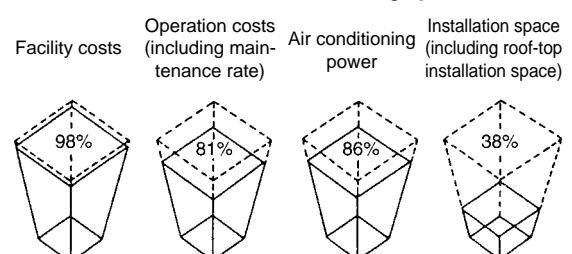

Comparison with conventional air conditioning system

2.5 System trends

- Creation of an environment including independence, management and control of each zone can be realised as work trends become more diversified.
- Simultaneous cooling/heating system due to necessity from increased fixed sash windows and increase in office automation systems.
- Attention is being paid to building management methods which manage not only air conditioning systems for several buildings at one location but also manage other information.

3. Urban Small-Scale Building

3.1 System plan points

This system is based on effectively using available space within a limited area by installing the air conditioner and ventilator in available excess space.



For this application, the air flow must be considered for the entire floor with the ventilator installed in the ceiling space.

Setting outline

- Application : Office
- Building form : RC (Reinforced Concrete)
- Total floor space : 552 m² (B1 to 5F)
- Application per floor : B1: Parking area
GF to 5F: Office
- Air conditioning : Package air conditioner
- Ventilation : Ceiling embedded-type and cassette-type Lossnay, straight centrifugal fan, duct ventilation fan.

3.2 Current topics

- (1) Three sides of the building are surrounded by other buildings, and windows cannot be installed. (Dependency on mechanical ventilation is high.)
- (2) Ample fresh outdoor air cannot be supplied. (Generally, only Class 3 ventilation (forced exhaust) is possible.)
- (3) If the exhaust in the room is large, odors from the toilet, etc., flow into the room.
- (4) Humidification during winter is not possible.

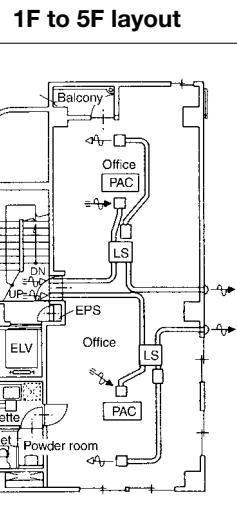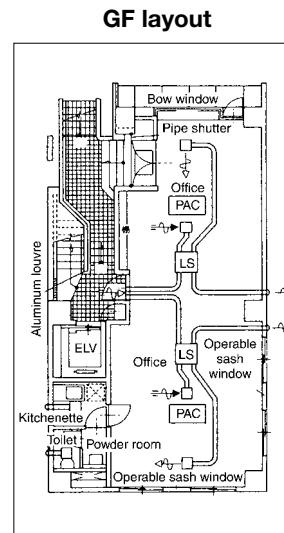

PAC: Package air conditioner
LS : Lossnay

3.3 Plan details

- (1) Air conditioning
 - Space efficiency and comfort during cooling/heating is improved with ceiling embedded cassette-type package air conditioner.
- (2) Ventilation
 - Room
 - Salon corner } Entire area is ventilated by installing several ceiling embedded-type Lossnay units.
Humidification is possible by adding a humidifier.
(Outdoor air is supplied to the toilet and kitchenette by setting the selection switch on the Lossnay unit for supply to the extra-high notch.)
 - Conference room } Area is independently ventilated by installing a ceiling embedded-type or cassette-type Lossnay in each room.
 - Board room }
 - Toilet, powder room } Area is exhausted with straight centrifugal fan or duct ventilation fan.
(An adequate exhaust volume can be obtained by taking in outdoor air, with the toilet being ventilated constantly.)
 - Kitchenette }
 - Position of air intake/exhaust air outlets on outer wall
The freshness of the outdoor air taken in by the Lossnay is important, thus considering that the building is surrounded by other buildings, the intake and exhaust ports must be separated as far as possible.

3.4 Effect

- (1) Accurate ventilation is possible with Class 1 ventilation (forced simultaneous air intake/exhaust) using the Lossnay.
- (2) Outdoor air supply to the toilet and kitchenette is possible with the Lossnay, and accurate ventilation is possible even in highly sealed buildings.
- (3) Flow of odors can be prevented with constant ventilation using an adequate ventilation volume.
- (4) Humidification is possible by adding a simple humidifying unit to the Lossnay.

4. Hospitals

4.1 System plan points

The principle of ventilation in hospitals requires adequate exhausting from the generation site and ensuring a supply of ample fresh air. An appropriate system would be an independent ventilation system with Class 1 ventilation (forced simultaneous air intake/exhaust).

The fan coil and package air conditioning are used according to material and place, and the air conditioned room is ventilated with the ceiling embedded-type Lossnay. The toilet and kitchenette, etc., are ventilated with a straight centrifugal fan.

Setting outline

- Building form : RC (Reinforced Concrete)
- Total floor space : 931 m² (GF to 2F)
- Application per floor : GF : Waiting room, diagnosis rooms, surgery theatre, director room, kitchen
1F : Patient rooms, nurse station, rehabilitation room, cafeteria
2F : Patient rooms, nurse station, head nurse room, office
- Air conditioning : Fan coil unit, package air conditioner
- Ventilation : Ceiling embedded-type Lossnay, straight centrifugal fan

4.2 Current topics

- (1) Prevention of in-hospital transmission of diseases
(Measures meeting needs for operating rooms, diagnosis rooms, waiting rooms and patient rooms are required.)
- (2) Adequate ventilation for places where odors are generated
(Measures to prevent odors from toilets from flowing to other rooms are required.)
- (3) Shielding of external noise
(Shielding of noise from outside of building and noise from adjacent rooms and hallway is required.)
- (4) Assurance of adequate humidity
- (5) Energy conservation

4.3 Plan proposals

(1) Air conditioning


- Centralised heat source control using a fan coil for the general system allows efficient operating time control and energy conservation.
- 24-hour system using a package air conditioner for special rooms (surgery theatre, nurse station, special patient rooms, waiting room) is the most practical.

(2) Ventilation

● Hall system

Independent system using centralised control with LP Lossnay or independent system with installation of ceiling suspended-type Lossnay

GF layout

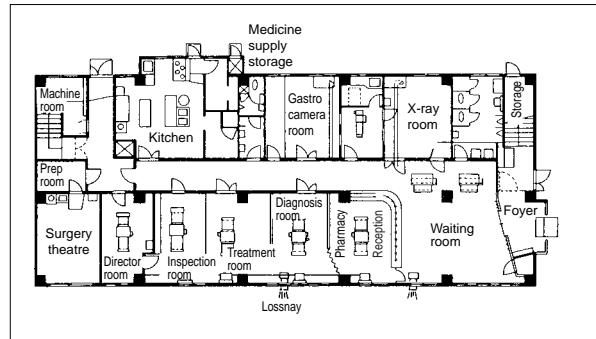

● Surgery theatre

Combination use of LP Lossnay and package air-conditioner with HEPA filter on room supply air outlet.

● Diagnosis rooms and examination room

Patient rooms

Nurse stations

Independent ventilation for each room using ceiling suspended/embedded-type Lossnay.

- Integral system with optional humidifier possible for required rooms.
- Positive/negative pressure adjustment, etc., is possible by setting main unit selection switch to extra-high notch (25R, 50R models) according to the room.

● Toilet/kitchenette

Straight centrifugal fan or duct ventilation fan

● Storage/linen closet

Positive pressure ventilation fan or duct ventilation fan
The outdoor air is supplied from the hallway ceiling with the straight centrifugal fan, and is distributed near the air conditioner after the air flow is reduced.


● Kitchen

Exhaust with negative pressure ventilation fan or straight centrifugal fan. Outdoor air is supplied with the straight centrifugal fan.


● Machine room

Exhaust with positive pressure ventilation fan.

1F layout

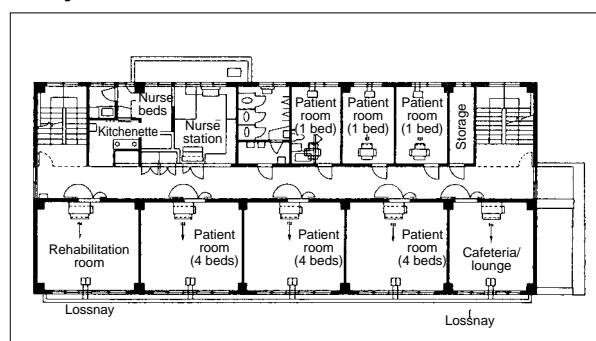

2F layout

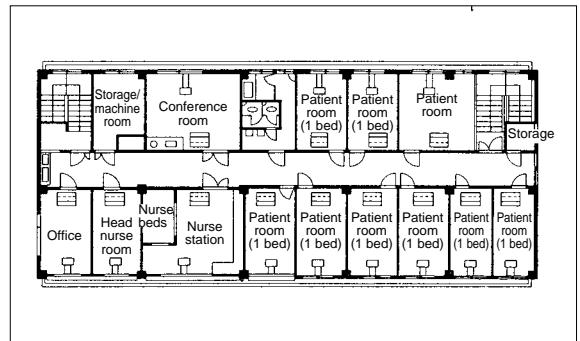

4.4 Effect

- (1) The following is possible by independently ventilating the air-conditioned rooms with the Lossnay:
 - Transmission of diseases can be prevented by shielding the air between rooms.
 - Infiltration of outside noise can be prevented with the Lossnay Core's soundproof properties.
 - As outdoor air does not need to be taken in from the hallway, the door can be sealed, shutting out hallway noise.
 - Humidification is possible by adding a humidifier.
- (2) By exhausting the toilet, etc., and supplying outdoor air to the hallway:
 - Flowing of odors to other rooms can be prevented.

5. Schools

5.1 System plan points

A comfortable environment in classrooms is necessary to improve the children and students' desire to study. Schools near airports, railroads and highways have sealed structures to soundproof the building, and thus air conditioning and ventilation facilities are required. This is also true for schools in polluted areas such as industrial districts. At university facilities which have a centralised design to efficiently use land and to improve the building functions, the room environment must also be maintained with air conditioning.

5.2 Current system details and problem points

- (1) Mainly single duct methods, fan coil unit methods, or package methods are used for cooling/heating, but the diffusion rate is still low, and water-based heaters are still the main source of heating.
- (2) The single duct method is difficult to control according to the usage state, and there are problems in running costs.
- (3) Rooms are often ventilated by opening the windows or using a ventilation gallery, where although this provides ample ventilation volume it may create a problem of infiltration of outside noise.

5.3 Building outline

Total floor space : 23,000 m²

Building outline : Prep school (high school wing)
Memorial hall wing
Library wing
Main management wing

5.4 Plan details


- (1) To pursue comfort, save energy and space, an air conditioning and ventilation system using a ceiling embedded-type fan coil unit and ceiling embedded-type Lossnay was applied.
- (2) Automatic operation using a weekly program timer was applied, energising when the general classrooms and special classrooms are to be used.
- (3) By using a ventilation system with a total heat recovery unit, energy is saved and soundproofing is realised.

5.5 Conditions for air-conditioning in schools

- (1) Zoning according to application must be possible.
- (2) Response to load fluctuations must be swift.
- (3) Ventilation properties must be good.
- (4) The system must be safe and rigid.
- (5) Expansion of the facility must be easy.
- (6) Installation on existing buildings must be possible.
- (7) Installation and maintenance cost must be low.

5.6 System trends

- (1) It is believed that environmental needs at schools will continue to progress towards high quality, and various factors such as temperature/humidity, noise, natural lighting, and colour must be considered at the design stages. Important topics are air conditioning, ventilation and soundproofing.
- (2) Independent heating using a centralised control method is mainly applied when the air conditioner is for heating only. For cooling/heating, a combination of a fan coil method and package-type is the main method used.
- (3) Highly accurate Class 1 ventilation is applied for the ventilation method, and the total heat recovery unit is mainly used in consideration of the energy saved during air conditioning and the high soundproofing properties.

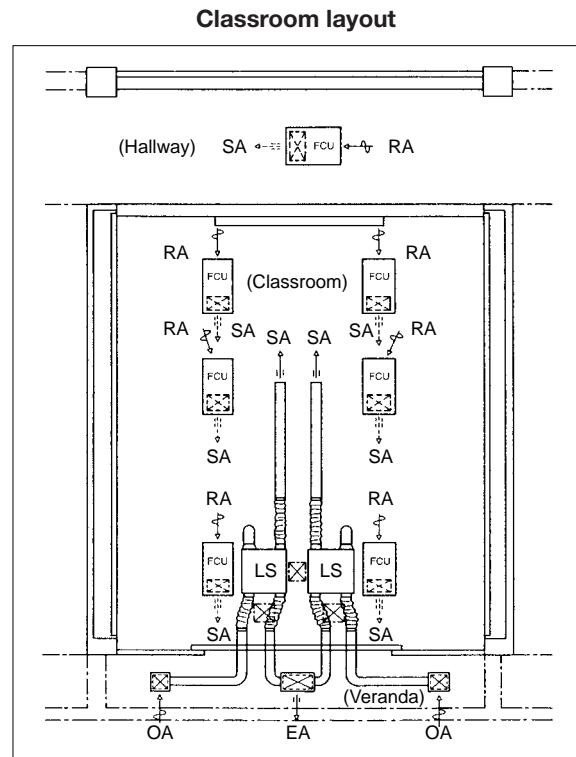

6. Public Halls (combination facilities such as day-care centres)

6.1 System plan points

Air conditioning and ventilation facilities for buildings located near airports and military bases, etc., that require soundproofing, have conventionally been of the centralised method. However, independent dispersed air conditioning and ventilation has been demanded due to the need for operation in zones, as well as for energy conservation purposes. This system is a plan for these types of buildings.

Setting outline

- Building form : Above ground 2, Total floor space: 385 m²
- Application : GF Study rooms (2 rooms), office, day-care room, lounge
1F Meeting room
- Air conditioning : GF Air-cooling heat pump chiller and fan coil unit
1F Air-cooling heat pump package air conditioner
- Ventilation : Ceiling embedded Lossnay

6.2 Conventional system and topics

- (1) Conventional systems have used centralised methods with air handling units, and air conditioning and ventilation were generally performed together.
- (2) Topics
 - 1) Special knowledge is required for operation, and there are problems in response to the users' needs.
 - 2) When the centralised method is used, the air even in rooms that are not being used is conditioned, increasing running costs unnecessarily.
 - 3) Machine room space is necessary.
 - 4) Duct space is necessary.

6.3 Plan details

(1) Air conditioning facilities

- 1) Small rooms : Air-cooling heat pump chiller and fan coil unit combination
- 2) Meeting rooms : Single duct method with air-cooling heat pump package air conditioner

(2) Ventilation facilities


- 1) A ceiling embedded-type Lossnay is used in each room, and a silence chamber, silence-type supply/return grille, silence duct, etc. is incorporated on the outer wall to increase the total soundproofing effect.

6.4 Effect


- (1) Operation is possible without special knowledge, so management is easy.
- (2) Operation is possible according to each room's needs, and is thus energy-saving.
- (3) Soundproof ventilation is possible with the separately installed ventilators.
- (4) Energy saving ventilation is possible with the heat recovery ventilation.
- (5) Space saving with the ceiling embedded-type.

Soundproofing standards	→ Soundproofing effect
High pressure level difference 30 dB or more	Study room: 34.0 dB Rest room : 47.2 dB

GF layout

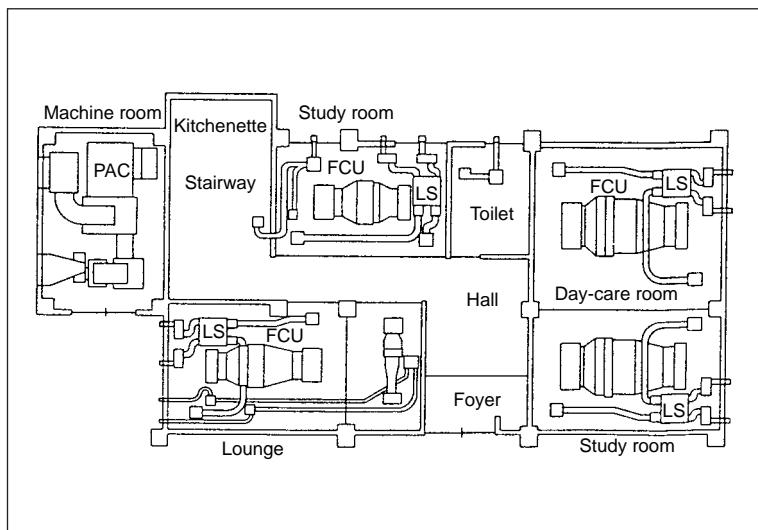

1F layout

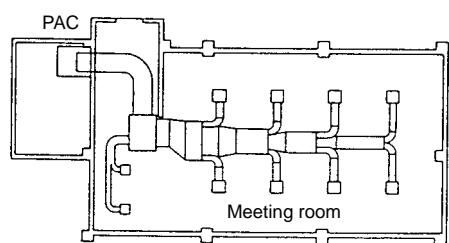


CHAPTER 7

Installation Considerations

CHAPTER 7 ● Installation Considerations

LGH- 50 · 100RX models

■ Installation diagram

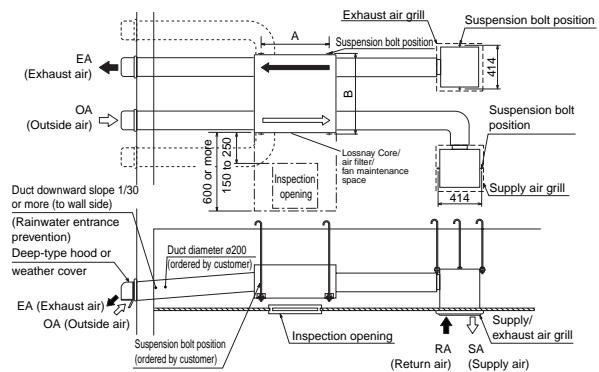


Unit (mm)

- Always leave inspection holes (□ 450 or □ 600) on the air filter and Lossnay Core removal side.
- Always insulate the two ducts outside the room (intake air and exhaust air ducts) to prevent frosting.
- It is possible to change the direction of the outside air ducts (OA and EA side).
- It is possible to attach a suspension bolt.
- Do not install the vent cap or round hood where it will come into direct contact with rain water.

Air volume (m ³ /h)	Model	Dimension	
		A	B
500	LGH-50RX type	790	1,048
1000	LGH-100RX type	1,030	1,263

LGH- 200RX model


■ Installation diagram

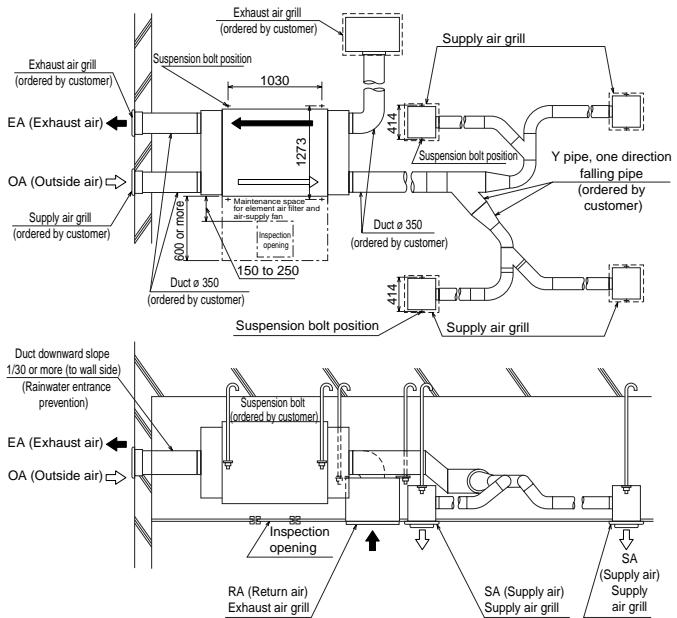


- Always leave inspection holes (□ 450 or □ 600) on the air filter and Lossnay Core removal side.
- Always insulate the two ducts outside the room (intake air and exhaust air ducts) to prevent frosting.
- If necessary, order a weather cover to prevent rain water from direct contact or entering the unit.

- (1) The ceiling embedded-type: 500 · 1000 and 2000 m³/h types are available.
Select an adequate model according to the room size, air volume for the application and noise levels.
- (2) All types have an extra-high notch. This setting is for when a long duct is used or when a large air volume is required. The positive and negative pressures of the room can also be adjusted with this.

LGH- 50 · 100RX types

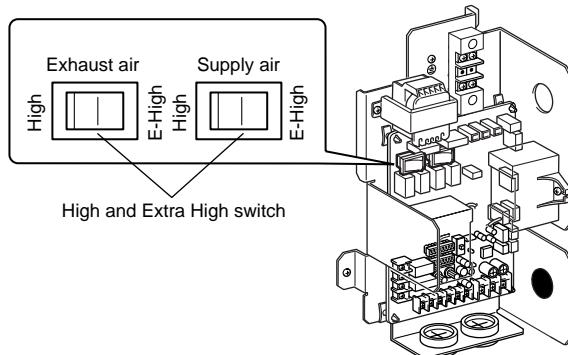



LGH- 200RX type

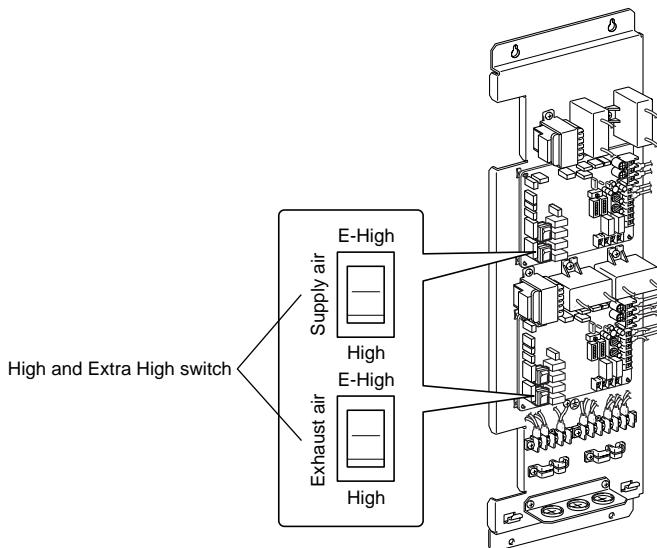

- (3) The units have a low-noise design, however, for further noise reduction a silencer-type supply/return grille for supply/return air in the room, a silencer box for reducing the air sound into the room, and a flexible silencer are available.

1.1 Selecting Duct Attachment Direction

You can choose between two directions for the outside duct (OA, EA) piping direction, to improve construction.

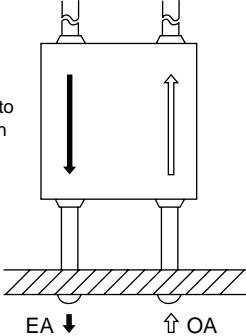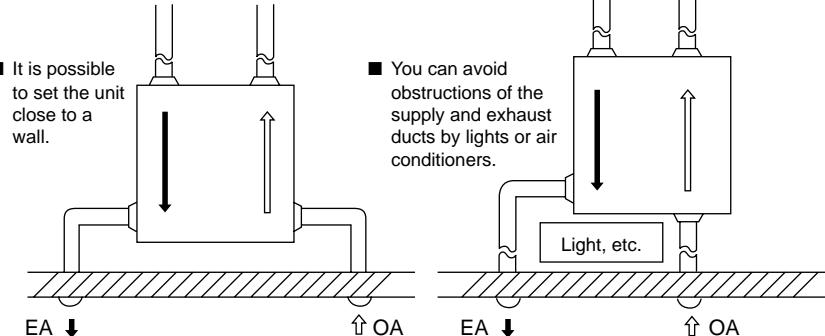Standard Construction	Construction with the Direction Changed
 <p>*A space is necessary to prevent rain water from entering.</p>	 <ul style="list-style-type: none"> It is possible to set the unit close to a wall. You can avoid obstructions of the supply and exhaust ducts by lights or air conditioners.


1.2 Installation and maintenance

- (1) Always leave an inspection hole (□ 450) on the filter and Lossnay Core removal side.
- (2) Always insulate the two ducts outside the room (intake air and exhaust air ducts) to prevent frosting.
- (3) Enforce measures to prevent rain water from entering.
 - Apply a slope of 1/30 or more towards the wall to the two ducts outside the room (intake air and exhaust air ducts).
 - Do not install the vent cap or round hood where it will come into direct contact with rain water.
- (4) Use the optional parts "control switch" (Ex. PZ-41SLB, etc.) for the RX-type.
A centralised controller can also be used.

1.3 Installation applications

(1) Combined installation of two units


The main unit's supply outlet and suction inlet and the room side and outdoor side positions cannot be changed. However, the unit can be turned over, and installed as shown below. (This is applicable when installing two units in one classroom, etc.)

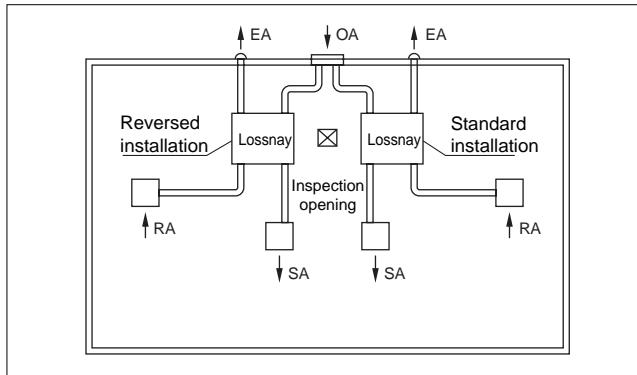

(2) System operation with air conditioner

Air conditioning systems with independent dispersed multiple unit air-conditioners are increasing due to merits such as improved controllability, energy conservation and space saving.

For these types of air conditioning systems, combined operation of the dispersed air conditioners with the Lossnay, is possible.

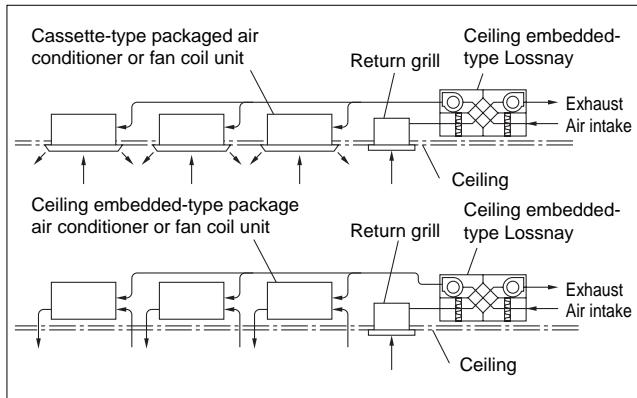

CHAPTER 8

Filtering for Freshness

1. Necessity of Filters

Clean air is necessary for humans to live a comfortable and healthy life. Besides atmospheric pollution that has been generated with the development of modern industries and the growth in the use of automobiles, air pollution in air-tight room has progressed to the point where it adversely affects the human body, and is now a major problem.

Hay fever is now a symptom often seen in the spring and demands for preventing pollen from entering rooms are increasing.

2. Data Regarding Dust

The particle diameter of dust and applicable range of filters are shown in Table 1, and representative data regarding outdoor air dust concentrations and indoor dust concentrations is shown in Table 2.

Table 1 Aerosol particle diameters and applicable ranges of various filters

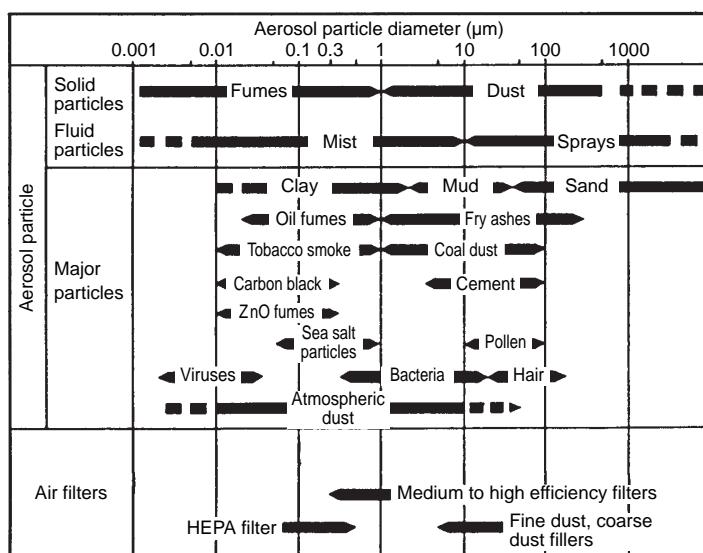


Table 2 Major dust concentrations

Type	Reference data	
Outdoor air floating dust concentration	Large city	0.1 - 0.15 mg/m ³
	Small city	0.1 mg/m ³ or less
	Industrial districts	0.2 mg/m ³ or more
Indoor dust concentration	General office	10 mg/h per person
	Stores (product vending stores)	5 mg/h per person
	Applications with no tobacco smoke	5 mg/h per person


Remarks:

1. The core diameter of outdoor air dust is said to be 2.1 μm , and the 11 types of dust (average diameter 2.0 μm) as set by JIS Z8901 as performance test particles are employed.
2. Dust in office rooms is largely caused by smoking, and the core diameter is 0.72 μm . The 14 types of dust (average 0.8 μm) as set by JIS Z 8901 as performance test particles are employed.
3. The core diameter of dust generated in rooms where there is no smoking is approximately the same as outdoor air.
4. Smoking in general offices (as per Japan):
 - Percentage of smokers : Approx. 70% (adult men)
 - Average number of cigarettes : Approx. 1/person·h (including non-smokers)
 - Smoking length of cigarette : Approx. 4 cm
 - Amount of dust generated by one cigarette : Approx. 10 mg/cigarette

3. Calculation Table for Dust Collection Efficiency of Each Lossnay Filter

Filter type	Measurement method Tested dust	Applicable model	AFI Gravitational method	ASHRAE Colorimetric method	Counting method (DOP method)		Application
			Compound dust	Atmospheric dust	JIS 14 types DOP 0.8 μm	DOP 0.3 μm	
Pre-filter	NP/400 (EU3)	Commercial Lossnay (LGH)	82%	8% - 12%	5% - 9%	2% - 5%	Protection of heat recovery element
High efficiency filter	Model PZ-50RFM PZ-100RFM (EU7)	Optional Part for model LGH-50-100-200RX type	99%	65%	60%	25%	Assurance of sanitary environment (According to Building Management Law)

3.1 High-Efficiency Filter (Optional Parts)

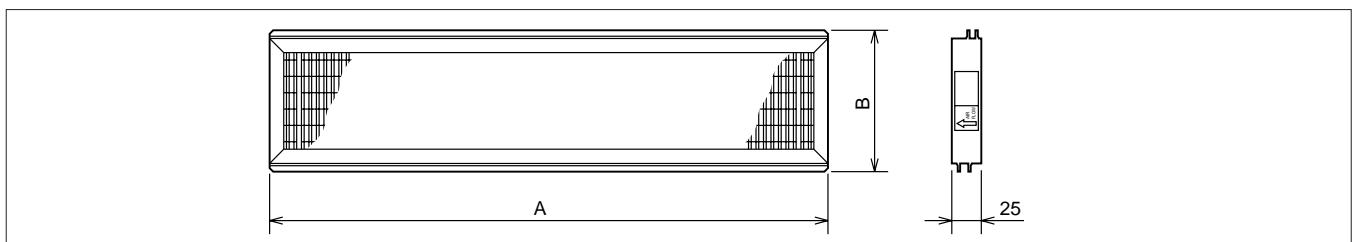


Model	PZ-50RFM	PZ-100RFM
Dimension (mm)	A	466
	B	174
Number of filters per set	2	2

Note: This is one set per main body.


3.2 Pressure Loss

■ Pressure Loss Characteristics

PZ-50RFM

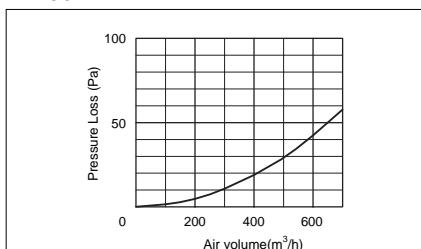


PZ-100RFM

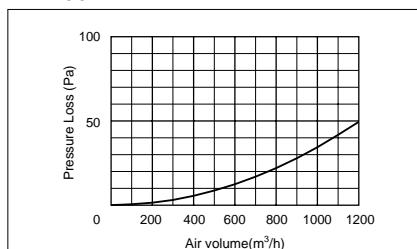

CHAPTER 8 ● Filtering for Freshness

The ability of the filters used within the Lossnay units are shown below, expressed in terms of collection ratio (%).

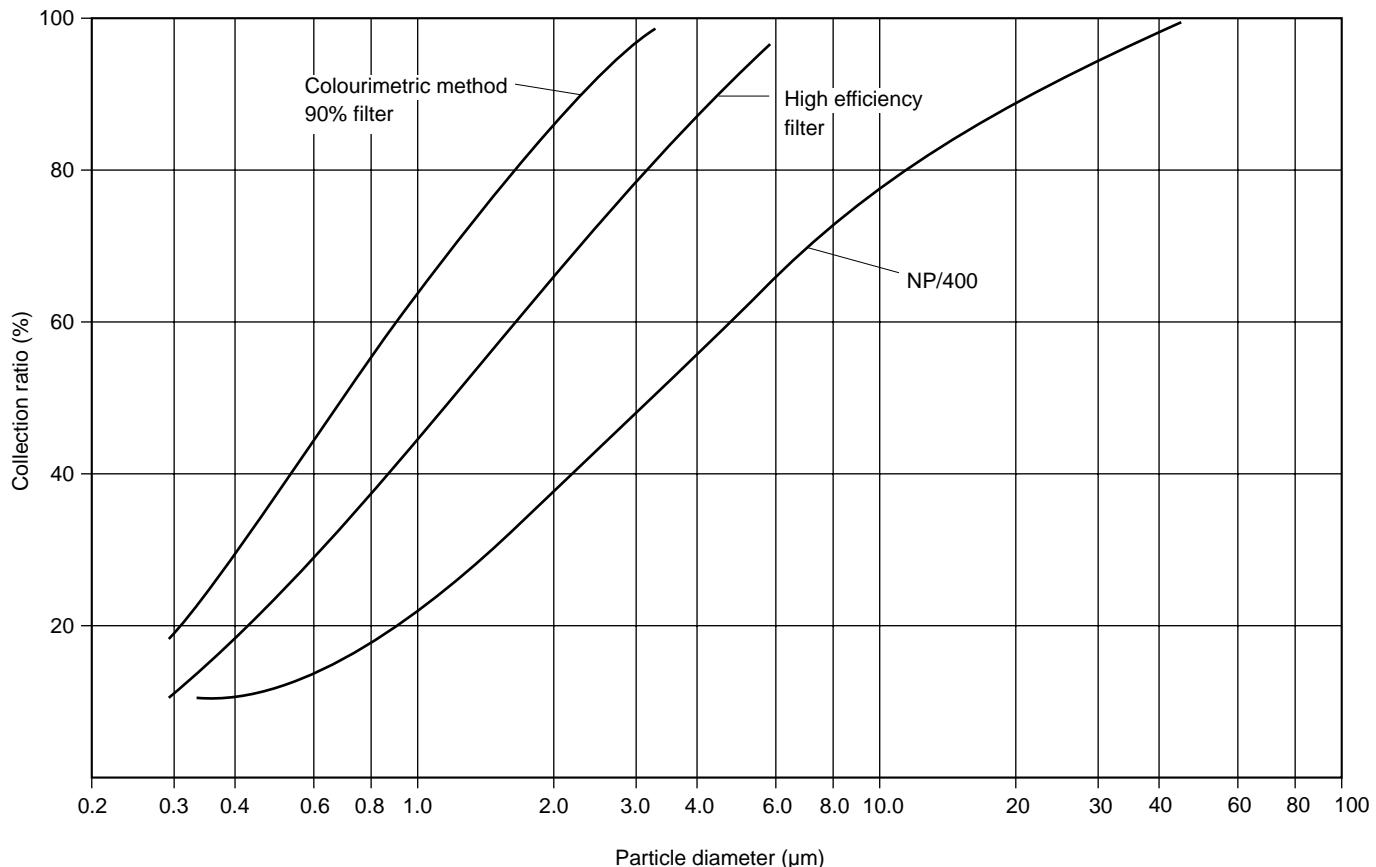

4. Comparison of Dust Collection Efficiency Measurement Methods


The gravitational, colorimetric and counting methods used for measuring dust collection efficiency each have differing features and must be used according to the application of the filter.

Test method	Test dust	Inward flow dust measurement method	Outward flow dust measurement method	Efficiency indication method	Type of applicable filters
AFI Gravitational method	Synthetic: • Dust on standard road in Arizona: 72% • K-1 carbon black: 25% • No.7 cotton lint: 3%	Dust weight measured beforehand	• Filter passage air volume measured • Weigh the dust remaining on the filter and compare	Gravitational ratio	Synthetic dust filters
NBS Colorimetric method	Atmospheric dust	Degree of contamination of white filter paper	Degree of contamination of white filter paper	Comparison of contamination of reduction in degree of contamination	Electrostatic dust percentage of (for air conditioning)
DOP Counting method	Diameter of dicoctyl-phthalate small drop particles: 0.3 µm	Electrical counting measurement using light aimed at DOP	Same as left	Counting ratio	Absolute filter and same type of high efficiency filter
ASHRAE Gravitational method	Synthetic: • Regulated air cleaner fine particles: 72% • Morocco Black: 23% • Cotton linter: 5%	Dust weight measured beforehand	• Filter passage air volume measured • Weigh the dust remaining on the filter and compare	Gravitational ratio	Pre-filter Filter for air conditioning (for coarse dust)
ASHRAE Colorimetric method	Atmospheric dust	Degree of contamination of white filter paper	Degree of contamination of white filter paper	Comparison of percentage of reduction in degree of contamination	Filter for air conditioning (for fine dust) Electrostatic dust collector
Air filter test for air conditioning set by Japan Air Cleaning Assoc. (Colorimetric test)	JIS 11 types of dust	Degree of contamination of white filter paper	Degree of contamination of white filter paper	Comparison of percentage of reduction in degree of contamination	Filter for air conditioning
Pre-filter test set by Japan Air Cleaning Assoc. (Gravitational test)	JIS 8 types of dust	Dust weight measured beforehand.	• Filter passage air volume measured • Weigh the dust remaining on the filter and compare.	Gravitational ratio	Pre-filter
Electrostatic air cleaning device test set by Japan Air Cleaning Assoc. (Colorimetric test)	JIS 11 types of dust	Degree of contamination of white filter paper	Degree of contamination of white filter paper	Comparison of percentage of reduction in degree of contamination	Electrostatic dust collector

Gravitational method

This method is used for air filters which remove coarse dust (10 µm or more). The measurement method is determined by the gravitational ratio of the dust amount on the in-flow side and out-flow sides.


$$\text{Dust collection ratio} = \frac{\text{In-flow side dust amount} - \text{Out-flow side dust amount}}{\text{In-flow side dust amount}} \times 100 (\%)$$

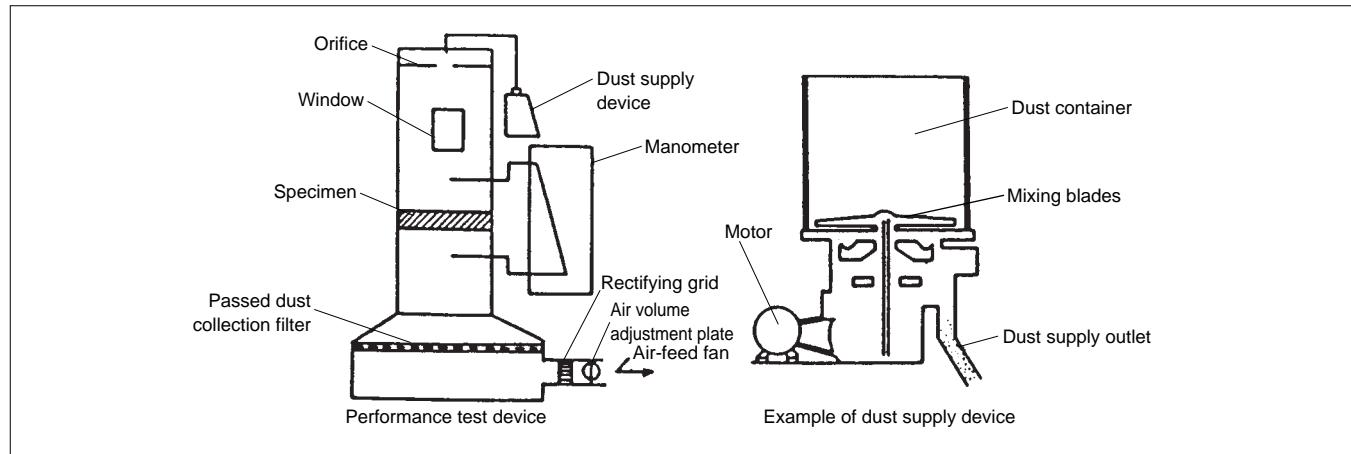

Colorimetric method

The in-flow side air and out-flow side air are sampled with a suction pump and passed through filtering paper. The sampled air is adjusted so that the degree of contamination on both filter papers is the same, and the results are determined by the sampled air volume ratios on both sides.


$$\text{Dust collection ratio} = \frac{\text{Out-flow side sampling amount} - \text{In-flow side sampling amount}}{\text{Out-flow side sampling amount}} \times 100 (\%)$$

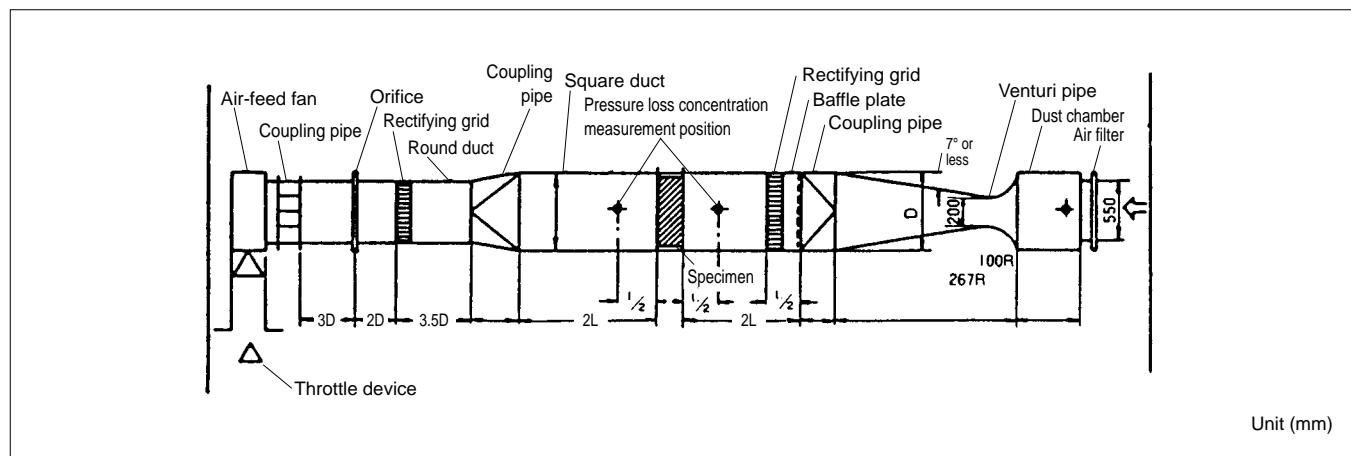

5. Calculation of Dust Concentration

An air conditioning system using the Lossnay is shown below. Using this diagram the level of dust concentration can be easily determined.

Dust concentration study diagram

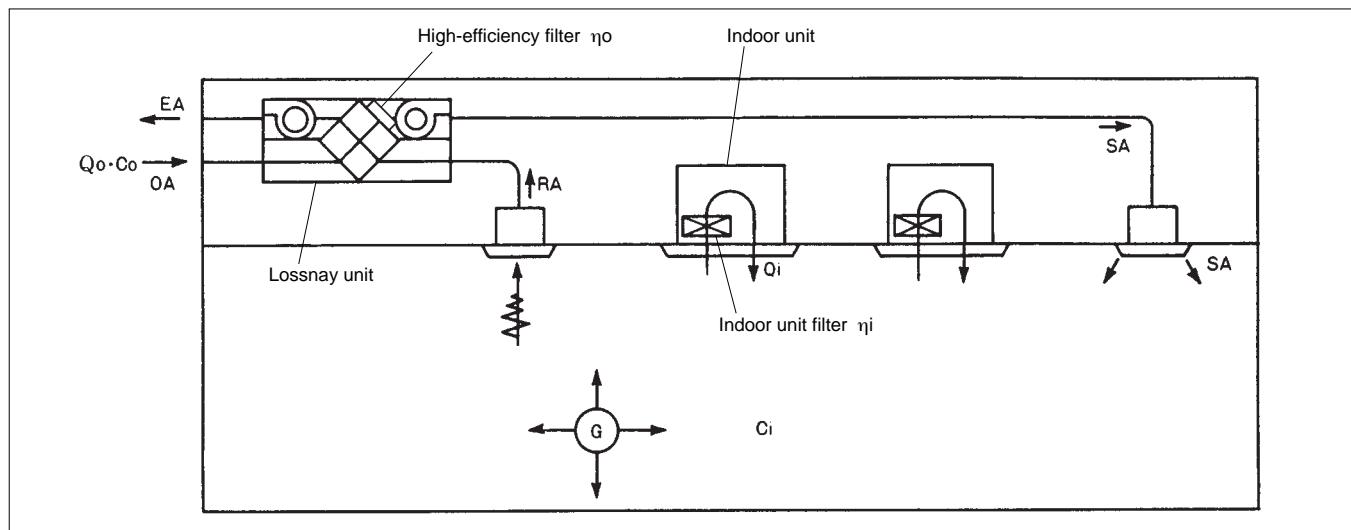

Q_o : Outdoor air intake amount (m^3/h) η_0 : Filtering efficiency of humidifier with high efficiency filter (%)
 $(\text{colorimetric method})$ C_o : Outdoor air dust concentration (mg/m^3)
 Q_i : Indoor unit air volume
 $(\text{Total air volume of indoor unit}) (\text{m}^3/\text{h})$ η_i : Filtering efficiency of filter for indoor unit (%) ($\text{colorimetric method}$) C_i : Indoor dust concentration (mg/m^3)
 G : Amount of dust generated indoors (mg/h)

In this type of system, when the performance of each machine is known, the indoor dust concentration C_i may be obtained with the filtering performance of the filters, η_0 and η_i , having been set to specific values as per manufacturer's data. The following formula is used:

$$C_i = \frac{G + C_o Q_o (1 - \eta_0)}{Q_o + Q_i \eta_i}$$

Also, with the value of C_i and η_0 known, the efficiency of the indoor unit can be found using:

$$\eta_i = \frac{G + C_o Q_o (1 - \eta_0) - C_i Q_o}{C_i Q_i} \times 100$$

[Calculation example]

The indoor dust concentration for the following types of design conditions with the above system shall be used in the following example.

● Outline of air conditioning

Air conditioning area	No. of persons in room	Outdoor air intake volume	Cooling capacity	Heating capacity
100 m ² (Office)	20 persons	25 m ³ /h per person × 20 persons = 500 m ³ /h	15,700 W	13,374 W

● Equipment used

Lossnay + with high efficiency filter	Model	Heat recovery during cooling		Heat recovery during heating		Intake volume	Filtering efficiency	
	LGH-50RX type + PZ-50RFM (with high efficiency filter) 1 unit	3,710 W	3,907 W	500 m ³ /h	65% (colorimetric method)			
Fan coil unit	Model	Cooling capacity	Heating capacity	Air volume	Filtering efficiency			
	LH-600CR-B3F (with high efficiency filter) 2 units	5,338 W	8,664 W	17 m ³ /min	65% (colorimetric method)			

Calculation

Intake volume

$$Q_o = 500 \text{ m}^3/\text{h}$$

Indoor unit air volume

$$Q_i = 17 \times 2 \times 60 = 2,040 \text{ m}^3/\text{h}$$

Filtering efficiency of humidifier with high efficiency filter

$$\eta_o = 65\% \quad (\eta'_o = 91\% \text{ Particle diameter } 2.1 \mu\text{m}*)$$

Filtering efficiency of filter for inside unit

$$\eta_i = 65\% \quad (\eta'_i = 57\% \text{ Particle diameter } 0.72 \mu\text{m}*)$$

Outdoor air floating dust concentration

$$C_o = 0.1 \text{ mg/m}^3$$

Amount of dust generated in room

$$G = \text{amount of dust generated per person} \times \text{no. of persons in room} \\ = 10 \text{ mg/h} \cdot \text{person} \times 20 \text{ persons} = 200 \text{ mg/h}$$

If the inside dust concentration Ci is found with the above, the following data is obtained:

$$C_i = \frac{200 + 0.1 \times 500 (1 - 0.65)}{500 + 2,040 \times 0.65} \div 0.12 \text{ mg/m}^3 \quad (\div 0.123 \text{ mg/m}^3*)$$

The result is less than the dust concentration limit of 0.15 mg/m³ set by the Building Standard Law of Japan. If the filtering efficiency of a filter for the indoor unit is obtained to set the inside dust concentration Ci to 0.15 mg/m³, the following is obtained:

$$\eta_i = \left\{ \frac{200 + 0.1 \times 500 (1 - 0.65) - 0.15 \times 500}{0.15 \times 2,040} \right\} \times 100 \div 47\% \quad (\div 42\%*)$$

This shows that the filtering efficiency of the indoor unit filter must be a minimum of 47% (colorimetric method).

* The result of a calculation using an average outdoor airborne particle diameter of 2.1 μm and an average indoor airborne particle diameter of 0.72 μm is shown.

CHAPTER 9

Service Life and Maintenance

1. Service Life

The Lossnay Core has no moving parts. This stationary design eliminates vibration troubles and also permits greater installation flexibility. In addition, chemicals are not used in the heat recovery system. Performance characteristics remain constant throughout the period of service.



A lifetime test, currently in progress and so far reaching 17,300 hours, has revealed no evidence of either reduction in heat recovery efficiency or deterioration of materials. If 2,500 hours is taken as the number of hours a conditioner is used during a year, 17,300 hours corresponds to about seven (7) years.

(This explanation is not a guarantee of the service life of the product.)

2. Cleaning the Lossnay Core and Pre-filter

The Lossnay Core should be cleaned with a vacuum cleaner at least once every 2 years. This will remove the dust that has accumulated at the surface and restore the functioning of the core to 98 to 100% of the original figure. A brush should not be used for cleaning because it may trap the dust in the core resulting in clogging.

The air filter on the intake side of the Lossnay Core should be cleaned at least once every year. After cleaning, reinstall the filter immediately.

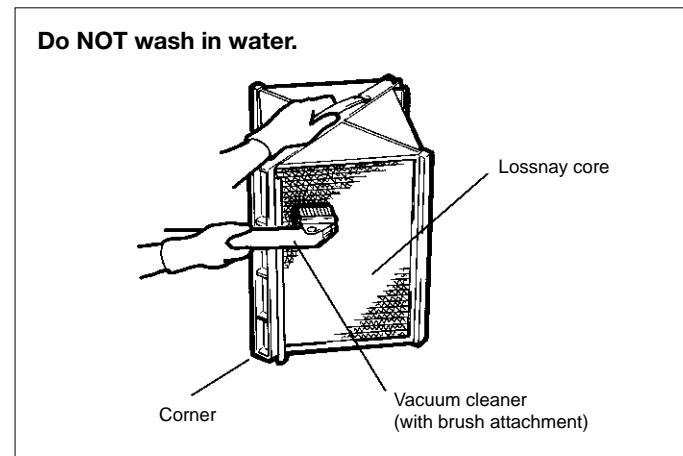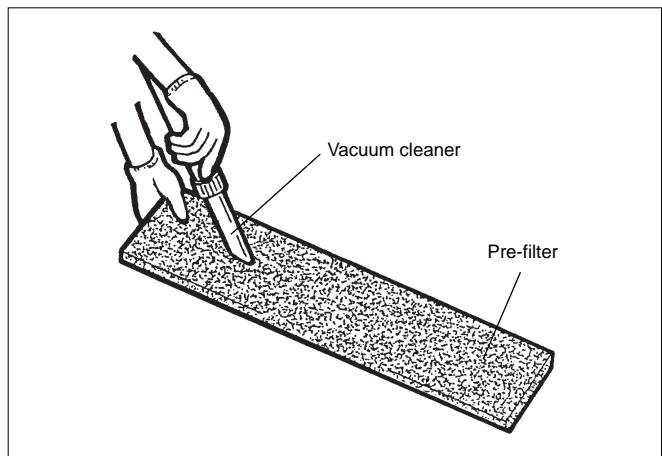

CHAPTER 10

Ventilation Standards in Each Country

1. Ventilation Standards in Each Country

1. Japan

Table Summary of Laws Related to Ventilation

Item Related Laws	Acceptable Range	Room Environment Standard Values												
Law for Maintenance of Sanitation in Buildings	Buildings of at least 3,000 m ² (for schools, at least 8,000 m ²)	<p>If a central air quality management system or mechanical ventilation equipment is installed, comply with the standard target values shown in the table below.</p> <table border="1"> <tr> <td>Impurity volume of floating particles</td><td>less than 0.15 mg per 1 m³ of air</td></tr> <tr> <td>CO rate</td><td>Less than 10 ppm. (Less than 20 ppm when outside supply air has a CO rate of more than 10 ppm.)</td></tr> <tr> <td>CO₂ rate</td><td>Less than 1,000 ppm.</td></tr> <tr> <td>Temperature</td><td>1) Between 17°C and 28°C 2) When making the room temperature cooler than the outside temperature, do not make the difference too great.</td></tr> <tr> <td>Relative humidity</td><td>40% - 70%</td></tr> <tr> <td>Ventilation</td><td>less than 0.5 m/sec</td></tr> </table>	Impurity volume of floating particles	less than 0.15 mg per 1 m ³ of air	CO rate	Less than 10 ppm. (Less than 20 ppm when outside supply air has a CO rate of more than 10 ppm.)	CO₂ rate	Less than 1,000 ppm.	Temperature	1) Between 17°C and 28°C 2) When making the room temperature cooler than the outside temperature, do not make the difference too great.	Relative humidity	40% - 70%	Ventilation	less than 0.5 m/sec
Impurity volume of floating particles	less than 0.15 mg per 1 m ³ of air													
CO rate	Less than 10 ppm. (Less than 20 ppm when outside supply air has a CO rate of more than 10 ppm.)													
CO₂ rate	Less than 1,000 ppm.													
Temperature	1) Between 17°C and 28°C 2) When making the room temperature cooler than the outside temperature, do not make the difference too great.													
Relative humidity	40% - 70%													
Ventilation	less than 0.5 m/sec													
The Building Standard Law of Japan	<p>Buildings with requirements for ventilation equipment 1) windowless rooms. 2) rooms in theaters, movie theaters, assembly halls, etc. 3) kitchens, bathrooms, etc.</p> <p>Rooms with equipment or devices using fire.</p>	<p>Central air quality management system ventilation capacity and characteristics</p> <p>Effective ventilation capacity $V \geq 20Af/N$ (m³) Af: floor space (m²), N: floor space occupied by one person</p> <p>Characteristics: Generally satisfy the table below.</p> <table border="1"> <tr> <td>Impurity volume of floating particles</td><td>less than 0.15 mg per 1 m³ of air</td></tr> <tr> <td>CO rate</td><td>Less than 10 ppm.</td></tr> <tr> <td>CO₂ rate</td><td>Less than 1,000 ppm.</td></tr> <tr> <td>Temperature</td><td>1) Between 17°C and 28°C 2) When making the room temperature cooler than the outside temperature, do not make the difference too great.</td></tr> <tr> <td>Relative humidity</td><td>40% - 70%</td></tr> <tr> <td>Ventilation</td><td>less than 0.5 m/sec</td></tr> </table>	Impurity volume of floating particles	less than 0.15 mg per 1 m ³ of air	CO rate	Less than 10 ppm.	CO₂ rate	Less than 1,000 ppm.	Temperature	1) Between 17°C and 28°C 2) When making the room temperature cooler than the outside temperature, do not make the difference too great.	Relative humidity	40% - 70%	Ventilation	less than 0.5 m/sec
Impurity volume of floating particles	less than 0.15 mg per 1 m ³ of air													
CO rate	Less than 10 ppm.													
CO₂ rate	Less than 1,000 ppm.													
Temperature	1) Between 17°C and 28°C 2) When making the room temperature cooler than the outside temperature, do not make the difference too great.													
Relative humidity	40% - 70%													
Ventilation	less than 0.5 m/sec													
Industrial Safety and Health Act	Offices where workers work. (Office sanitation regulated standards)	<p>For general ventilation, the effective ventilation area opening is at least 1/20 of the floor space and the ventilation equipment installed gives a CO density of 50 ppm and CO₂ density of 5,000 ppm or less. If a central air quality management system or mechanical ventilation equipment is installed, comply with the standard target values shown in the table below.</p> <table border="1"> <tr> <td>Impurity volume of floating particles</td><td>Air (1 atmospheric pressure, 25°C) less than 0.15 mg per 1 m³ of air</td></tr> <tr> <td>CO rate</td><td>Less than 10 ppm. (Less than 20 ppm when outside supply air has a CO rate of more than 10 ppm.)</td></tr> <tr> <td>CO₂ rate</td><td>Less than 1,000 ppm.</td></tr> <tr> <td>Air flow in room</td><td>Air speed in room is less than 0.5 m/s, and air taken into the room does not blow directly on or reach specific workers.</td></tr> <tr> <td>Heat and humidity conditions</td><td>Heat between 17°C - 28°C Relative humidity 40% - 70%</td></tr> </table>	Impurity volume of floating particles	Air (1 atmospheric pressure, 25°C) less than 0.15 mg per 1 m ³ of air	CO rate	Less than 10 ppm. (Less than 20 ppm when outside supply air has a CO rate of more than 10 ppm.)	CO₂ rate	Less than 1,000 ppm.	Air flow in room	Air speed in room is less than 0.5 m/s, and air taken into the room does not blow directly on or reach specific workers.	Heat and humidity conditions	Heat between 17°C - 28°C Relative humidity 40% - 70%		
Impurity volume of floating particles	Air (1 atmospheric pressure, 25°C) less than 0.15 mg per 1 m ³ of air													
CO rate	Less than 10 ppm. (Less than 20 ppm when outside supply air has a CO rate of more than 10 ppm.)													
CO₂ rate	Less than 1,000 ppm.													
Air flow in room	Air speed in room is less than 0.5 m/s, and air taken into the room does not blow directly on or reach specific workers.													
Heat and humidity conditions	Heat between 17°C - 28°C Relative humidity 40% - 70%													

2. U.S.

ASHRAE standard 62 - 1999

Application	Outdoor air recommendation	Occupancy
Dry Cleaner	30 cfm/person	30 people/100 m ²
Dining room	20 cfm/person	70 people/100 m ²
Bars	30 cfm/person	100 people/100 m ²
Kitchens	15 cfm/person	20 people/100 m ²
Hotel bedroom	30 cfm/room	—
Hotel living room	30 cfm/room	—
Hotel lobby	15 cfm/person	30 people/100 m ²
Casino	30 cfm/person	120 people/100 m ²
Office space	20 cfm/person	7 people/100 m ²
Conference room	20 cfm/person	50 people/100 m ²
Smoking lounge	60 cfm/person	70 people/100 m ²
Bowling alley (seating area)	25 cfm/person	70 people/100 m ²

3. U.K.

CIBSE

Application	Outdoor air			Smoking
	Recommended	Minimum		
		Per person	Per person	Per m ²
Factories	8 l/s /person	5 l/s /person	0.8 l/s / m ²	None
Offices (open plan)	8 l/s /person	5 l/s /person	1.3 l/s / m ²	Some
Shops, department stores and supermarkets	8 l/s /person	5 l/s /person	3.0 l/s / m ²	Some
Theatres	8 l/s /person	5 l/s /person	—	Some
Dance halls	12 l/s /person	8 l/s /person	—	Some
Hotel bedrooms	12 l/s /person	8 l/s /person	1.7 l/s / m ²	Heavy
Laboratories	12 l/s /person	8 l/s /person	—	Some
Offices (private)	12 l/s /person	8 l/s /person	1.3 l/s / m ²	Heavy
Residences (average)	12 l/s /person	8 l/s /person	—	Heavy
Restaurant (cafeteria)	12 l/s /person	8 l/s /person	—	Heavy
Cocktail bars	18 l/s /person	12 l/s /person	—	Heavy
Conference rooms (average)	18 l/s /person	12 l/s /person	—	Some
Residence	18 l/s /person	12 l/s /person	—	Heavy
Restaurant	18 l/s /person	12 l/s /person	—	Heavy
Board rooms executive offices and conference rooms	25 l/s /person	18 l/s /person	6.0 l/s / m ²	Very Heavy
Corridors	N/A	N/A	1.3 l/s / m ²	N/A
Kitchens (domestic)	N/A	N/A	10.0 l/s / m ²	N/A
Kitchens (restaurant)	N/A	N/A	20.0 l/s / m ²	N/A
Toilets	N/A	N/A	10.0 l/s / m ²	N/A

CHAPTER 11




Lossnay Q and A




CHAPTER 11 ● Lossnay Q and A

	Question	Answer	Remarks
1	Paper is used for the material, but is the life adequate?	There is no problem with the life of the paper unless it is intentionally damaged, directly placed in water or in direct sunlight (ultra-violet rays). The life is longer than metal as it does not rust. It can be used for a minimum of ten years.	Depending on how it is stored, paper can be stored for up to 2,000 years without deteriorating, such as documents in temples and churches.
2	Is paper not an insulation material? (Poor conductor of heat)	Paper is very thin, and thus the conductivity of the material is low, with heat being transferred approximately the same as with metal. Test this by placing a piece of paper between your hands and you will feel the warmth of your palms. The recovery of humidity can also be felt by blowing on the paper and feeling the moisture in your breath transfer to your palm.	
3	If paper can recover humidity, will it not become wet?	Maybe you have seen the phenomenon during heating in winter where the window pane is wet but the paper blinds are dry. This is because the humidity is transferred through the paper membrane. The Lossnay is kept dry by employing this same principle.	
4	When is the forced simultaneous air intake/exhaust-type more efficient?	When a building is sealed and normal ventilation is used, accurate exhaust is not possible unless a suction inlet is created. The Lossnay has both an air-supply fan and air-exhaust fan so Class 1 ventilation is possible.	
5	What are the energy conservation properties of the Lossnay?	For an example, in an approx. 13 m ² room with five people, a ventilation volume of 100 m ³ /h is required. The amount of power consumed in this case is approximately 45 W, and the amount of heat recovered during cooling is approximately 700 W or more. The coefficient of performance (C.O.P.) obtained when converted with the unit power generation amount is 16. In consideration that the popular heat pump-type has a C.O.P. of 2 to 3, the Lossnay is a high energy conserving machine. If a general-purpose ventilator is installed, the cooled air will be lost, thus increasing electrical costs throughout the year.	

	Question	Answer	Remarks																											
6	What are the economical factors? (This is for Japan)	<p>Between 55 to 60% of the heat energy that escapes with ventilation is recovered by the Lossnay, so the cooling/heating cost can be reduced by approximately 43,000 yen per year. The initial costs can be suppressed down to a 59,000 yen increase when comparing the air conditioner, Lossnay, and ventilator (list- price base).</p> <p>Calculation conditions</p> <p>Cooling:</p> <ul style="list-style-type: none"> Room temperature/humidity 26°C, 50% Outdoor air temperature/humidity 32°C, 70% <p>Heating:</p> <ul style="list-style-type: none"> Room temperature/humidity 20°C, 50% Outdoor air temperature/humidity 0°C, 50% <p>Building:</p> <ul style="list-style-type: none"> General office facing south on middle floor 100 m² Cooling load (room) 104 W/m² Heating load (room) 77.7 W/m² <p>Ventilation volume: 500 m³/h</p> <ul style="list-style-type: none"> Without Lossnay: Straight lock fan BFS-50SU 2 units With Lossnay: Lossnay LGH-50RX type. 1 unit <p>Cooling/heating load (W):</p> <table border="1" style="width: 100%; border-collapse: collapse; text-align: center;"> <thead> <tr> <th rowspan="2"></th> <th colspan="3">Without Lossnay</th> <th colspan="3">With Lossnay</th> </tr> <tr> <th>Room</th> <th>Outdoors</th> <th>Total</th> <th>Room</th> <th>Outdoors</th> <th>Total</th> </tr> </thead> <tbody> <tr> <td>Cooling</td> <td>10400</td> <td>5560</td> <td>15960</td> <td>10400</td> <td>2340</td> <td>12740</td> </tr> <tr> <td>Heating</td> <td>7770</td> <td>5630</td> <td>13400</td> <td>7770</td> <td>2140</td> <td>9910</td> </tr> </tbody> </table> <p>Air conditioner:</p> <ul style="list-style-type: none"> Without Lossnay : Ceiling-suspended cassette-type air conditioner PLZ-J140KA9G9 1 unit With Lossnay : PLZ-J112KA9G9 1 unit <p>Operation time:</p> <ul style="list-style-type: none"> Cooling 10 hours/day, 26 days/month, 4 months/year, operation ratio 0.7 Heating 10 hours/day, 26 days/month, 5 months/year, operation ratio 0.7 <p>Power costs (Tokyo Power special industrial power 6 kV supply) Summer 16.15 ¥/kWh, Other 14.65¥/kWh</p>		Without Lossnay			With Lossnay			Room	Outdoors	Total	Room	Outdoors	Total	Cooling	10400	5560	15960	10400	2340	12740	Heating	7770	5630	13400	7770	2140	9910	There are also "savings in maintenance cost", "ventilation functions", "soundproofing effects" as well as "comfort" and "safety" which are not visible.
	Without Lossnay			With Lossnay																										
	Room	Outdoors	Total	Room	Outdoors	Total																								
Cooling	10400	5560	15960	10400	2340	12740																								
Heating	7770	5630	13400	7770	2140	9910																								
7	If the air ventilated from the toilet is heat recovered, will the odors be transferred to other rooms?	<p>For an example if the total ventilation volume is 100, and the amount of odors generated from the toilet, etc., is 30, the total volume of conditioned air is still three times the ventilation amount. Thus, if the leakage rate of odors is 7% (hydrogen sulphide), this will be: $100 \times 30\% \times 1/3 \times 7\% = 0.7\%$. Thus, no problem is seen in terms of total air conditioned air volume. However, exhaust is usually performed with a separate system. In the case of ammonia, the rate is 2.8% using the same formula.</p> <p>Note: (The rotary-type has approximately the same transmission rate, but for ammonia, the transmission rate is 50% or more than the Lossnay heat recovery method.)</p>	<p><Gas/smoke transmission rate></p> <p>CO : 1% CO₂ : 2% H₂S : 3% NH₃ : 3% Smoke : 1% - 2%</p> <p><Conditions> (Supply and exhaust fans installed for suction feed. Standard treatment air volume.)</p>																											

CHAPTER 11 ● Lossnay Q and A

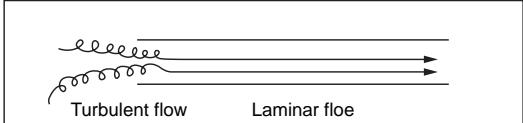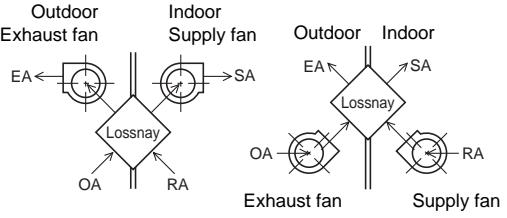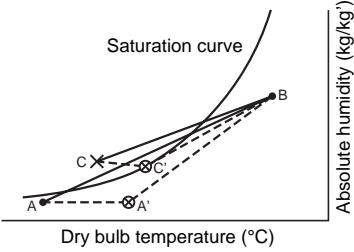	Question	Answer	Remarks
8	Can the Lossnay be used for hospital air conditioning?	<p>According to the results obtained from the test performed by the Tokyo University Hospital (Inspection Centre, Prof. Kihachiro Shimizu), as the supply air and exhaust air pass through different passages, transmission of bacteria from exhaust side to supply side is low. They found:</p> <ol style="list-style-type: none"> 1) Bacteria does not propagate in the Lossnay Core. 2) Even if bacteria accumulated in the Lossnay, it died off in approximately two weeks. 	
9	Since the entry to the Lossnay Core is fine and the incident air turbulent, won't it clog easily?	<p>Normally, the original state of the filter can be regained by cleaning it more than once every one year, and the two intake side surfaces of the Lossnay Core more than once two years with a vacuum cleaner. Dust will not adhere in the passage due to the laminar flow if the air is normal.</p> 	<p>Normal air refers to air that does not contain oil mist, etc. When exhausting air containing oil mist, etc., install a filter at return grille to remove the oil mist.</p>
10	What is the air leakage rate?	<p>This will differ on the position of the fans, but for both suction or both forced, the rate is 2% to 3%.</p>  <p>If the static pressure difference between SA and RA and between EA and OA is 500 Pa, the air leakage rate will be 2.5%, and 3.4%. This value is considered to be of no problem for actual use. However, the single suction or single forced methods will have a leakage rate of 10% or higher and should be avoided.</p>	
11	Can the Lossnay be used in extreme cold climates (-10°C or lower)?	<p>If the winter room air temperature is above 20°C along with the humidity above 50%, and the outdoor temperature is -10°C or lower, moisture condensation or frosting will occur on the Lossnay Core. In this case, the intake air must be preheated.</p> <p>Plot the Lossnay intake side air conditions A and B on a psychrometric chart as shown below. If the high temperature side air B intersects the saturation curve such as at C, moisture condensation or frosting will occur on the Lossnay. In this case, the air should be preheated to the temperature indicated by point A' so that point C reaches the C' point.</p> 	

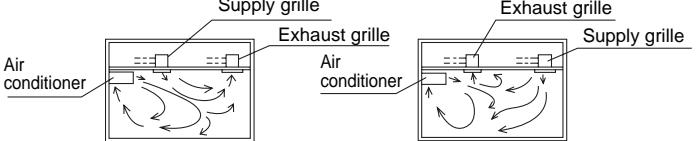	Question	Answer	Remarks								
12	Will tobacco nicotine and tar affect the Lossnay Core?	Tobacco smoke tends to stick to dust in the air, and when it passes through the Lossnay Core, most of the nicotine and tar will be filtered by the air filter. However, in very smoky places (ex. pachinko parlour), or when used for a long period, the tobacco odor will accumulate and move to the intake side. In this case, the Core and filter should be replaced.	Ample filtering will not be possible with a saran net air filter.								
13	Are there any places where the Lossnay cannot be used?	The Lossnay cannot be used where toxic gases and corrosive Core's such as acids, alkalis, organic solvents, oil mist or paints exist. The Lossnay cannot be used to recover the heat of air containing odors.									
14	What are the soundproofing properties for music rooms and karaoke bars?	When an LGH-50R ₅ ⁺ was installed in a karaoke bar and the noise was measured, the following results were obtained. When the noise in the room was 96.5 dB (A), the noise level at a point 30 cm from the intake/exhaust grille on the outside wall was 67.5 dB (A). This shows a soundproofing effect of 29.0 dB (A). The soundproofing effect when the noise level is 100 dB (A) is approximately 30 dB (A).	+: Japanese domestic market model. Same model as LGH-50RX type.								
15	What is the short circulation of the air intake/exhaust air outlet?	The Lossnay uses the forced simultaneous supply/exhaust method so the insufficient ventilation found in standard ventilators with no air intake is not found. Caution (1) The fresh air supplied to the room should not short circulate being drawn back into the return grille. It should flow through the entire room.  (2) The relation of the supply and suction flows of the air conditioner must be also considered.  ■ The air intake/exhaust grille on the outer wall is in the open and so there is a natural wind, with the result that short circulation will not occur easily. However, if the wind blows from the exhaust grille towards the intake grille, short circulation may occur, so these should be placed as far apart as possible. The guideline for the distance is three times the duct diameter. <table border="1" data-bbox="528 1724 830 1870"> <tr> <th>Duct diameter</th> <th>L (mm)</th> </tr> <tr> <td>ø200</td> <td>600</td> </tr> <tr> <td>ø250</td> <td>750</td> </tr> <tr> <td>ø350</td> <td>1050</td> </tr> </table> 	Duct diameter	L (mm)	ø200	600	ø250	750	ø350	1050	
Duct diameter	L (mm)										
ø200	600										
ø250	750										
ø350	1050										
16	Is total operation possible with switches?	Several units can be operated with the optional control switch.									

CHAPTER 11 ● Lossnay Q and A

	Question	Answer	Remarks																									
17	What is the difference between the rotary-type and static-type?	Refer to "Chapter 3 Section 9 Performance comparisons with various heat recovery units and ventilators".																										
18	Is an inspection hole necessary?	For the ceiling embedded-type, the unit is installed in the false ceiling, so an inspection hole is required at the Core and filter removal section and fan maintenance section. Refer to the catalog for details.																										
19	What must be performed during maintenance?	Periodic inspection and cleaning of the Lossnay Core and air filter is necessary. Refer to "Chapter 9 Service Life and Maintenance" for details.																										
20	What are Class 1 ventilating facilities?	<p>Class 1 ventilation refers to mechanical ventilation (forced simultaneous air supply/exhaust) using both intake and exhaust fans for suction feed. All Lossnay models (with built-in air-feed fans) are Class 1 ventilators. The ventilation method is classified in relation to the degree of natural and/or mechanical ventilation employed.</p> <p><Classification of ventilation></p> <table border="1"> <thead> <tr> <th></th> <th>Intake</th> <th>Exhaust</th> <th>Ventilation volume</th> <th>Room pressure</th> </tr> </thead> <tbody> <tr> <td>Class 1</td> <td>Mechanical</td> <td>Mechanical</td> <td>Random (constant)</td> <td>Random</td> </tr> <tr> <td>Class 2</td> <td>Mechanical</td> <td>Natural</td> <td>Random (constant)</td> <td>Positive pressure</td> </tr> <tr> <td>Class 3</td> <td>Natural</td> <td>Mechanical</td> <td>Random (constant)</td> <td>Negative pressure</td> </tr> <tr> <td>Class 4</td> <td>Natural</td> <td>Assisted natural</td> <td>Limited (inconstant)</td> <td>Negative pressure</td> </tr> </tbody> </table>		Intake	Exhaust	Ventilation volume	Room pressure	Class 1	Mechanical	Mechanical	Random (constant)	Random	Class 2	Mechanical	Natural	Random (constant)	Positive pressure	Class 3	Natural	Mechanical	Random (constant)	Negative pressure	Class 4	Natural	Assisted natural	Limited (inconstant)	Negative pressure	
	Intake	Exhaust	Ventilation volume	Room pressure																								
Class 1	Mechanical	Mechanical	Random (constant)	Random																								
Class 2	Mechanical	Natural	Random (constant)	Positive pressure																								
Class 3	Natural	Mechanical	Random (constant)	Negative pressure																								
Class 4	Natural	Assisted natural	Limited (inconstant)	Negative pressure																								
21	What are the anti-vibration measures for the Lossnay?	Measures are not required as a principle.																										
22	Can the LGH-RX types be installed vertically?	Vertical installation is possible in some cases. Refer to Chapter 5 Section 9 for details.																										

Lossnay

Remote Controller

1. Summary

This is a technical manual relating to the controls for implementing the following systems of the commercial-type Lossnay (LGH-RX Series).

Possible System Configurations

- (1) When using only the Lossnay remote controller.
- (2) Linking Lossnay and City Multi units.
- (3) Linking Mr. Slim (A-control).
- (4) Lossnay central control systems.
- (5) Linking with external equipment (BMS).

2. Applicable Models

● Lossnay (LGH-RX type)

These models have temperature sensors at RA and OA sides. It can automatically switch to the ventilation mode. (Lossnay/By-pass)

LGH-50RX ₃ -CAN	LGH-100RX ₃ -CAN	LGH-200RX ₃ -CAN
----------------------------	-----------------------------	-----------------------------

● Lossnay Remote Controller (PZ-41SLB-E)

Use when operating from 1 to 15 Lossnay units together at the same time. When using M-NET transmission to operate from centralised control, use the PZ-52SF-E.

It can start and stop the unit, change fan speed, switch the ventilation mode. It also includes indicators that show errors and when filter maintenance is required. Refer to page 170.

● Lossnay M-NET Remote Controller (PZ-52SF-E)

It can be used in combination with Mitsubishi Electric Air conditioner Network system (MELANS). Refer to page 176. Since this remote controller is supplied the power from the M-NET transmission line, it cannot be linked with Mr. Slim and other such systems that do not use M-NET.

Please refer to the technical documentation for the other systems: City Multi, Mr. Slim and the central controller (MELANS).

3. Terminology

● Interlocked Lossnay

This is a Lossnay linked to City Multi, or Mr. Slim indoor units. This is a Lossnay that has been set to interlocked group setting to receive signals and operate via indoor unit's remote controller → indoor unit → Lossnay.

● Non-interlocked Lossnay

This is a Lossnay that is not set to interlocked group setting with City Multi nor Mr. Slim indoor units. It operates using direct operating signals from the Lossnay remote controller and/or centralised controller.

● Ventilation Mode

This mode controls the Lossnay damper and permits selection of heat recovery (Heat ex.), by-pass or auto modes.

● Delayed Operation

The Lossnay that has been set to interlocked group setting with the indoor unit will have its operation delayed for 30 minutes after the operation of the indoor unit. When using PZ-41SLB-E, the time setting that can be set for delayed operation are 10, 20, 30, 40, 50 and 60 minutes.

● External Control Input

This is an input signal for operating the Lossnay that has been sent from an external device. It is compatible with 12V-24V DC or uncharged a-contact signal.

● Operation Mode


This mode is used for selecting enabling/disabling of the on/off control signal from an external device and for setting interlocked operation of the external device and the Lossnay.

Please Refer to page 128 for details.

ON/OFF interlock:	Enables both "ON → OFF" and "OFF → ON" external signals.
ON interlock:	Enables "OFF → ON" external signal. Disables "ON → OFF" external signal.
OFF interlock:	Enables "ON → OFF" external signal. Disables "OFF → ON" external signal.
External priority:	Same as on/off interlock but the OFF signal from the remote controller is ignored when the external control signal is on.

● Setting Pulse Input

When the control signal from the external device outputs a pulse such as the one shown below, pulse input setting is performed by the Lossnay. (Optional setting DIP switch 2-2 ON)

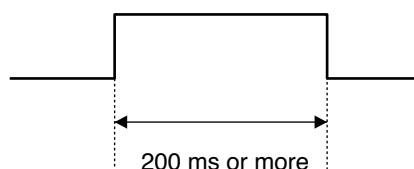

● Operation in Cold Areas

When the outdoor air is less than -10°C, continuous operation of the fan for drawing in supply air is cancelled, and intermittent operation is started.

● RA (Return Air)

This is the abbreviation for return air, which is the air drawn in from indoor.

● OA (Outdoor Air)

This is the abbreviation for outdoor air, which is the air drawn in from outdoor.




4. System Features and Examples



4.1 Features

Classification	Item	Notes/Cautions
Control	<ul style="list-style-type: none">• Multiple unit operation• Remote controller operation• External device operation• External pulse control• External monitor signal output• Supply air fan monitor output• External control operation mode setting• Delayed start• Automatic recovery following power supply interruption (*1)• Power supply start/stop function• High/low change input• Remote/Local control change• The M-NET air conditioning operation.• Centralised control by Mitsubishi building air control management system• Interlocked with Mr. Slim	<p>Maximum 15 units with PZ-41SLB-E; 16 units with PZ-52SF-E or other M-NET controller.</p> <p>Last touch priority</p> <p>Signal form: 12VDC, 24VDC, uncharged a-contact</p> <p>Ditto</p> <p>Uncharged a-contact (external monitor/supply air fan monitor change)</p> <p>Ditto</p> <p>ON/OFF, ON, OFF and External priority ON/OFF mode.</p> <p>Delayed time can be varied only when the PZ-41SLB-E is connected.</p> <p>Return power automatic return is fixed when the PZ-41SLB-E is connected.</p> <p>Impossible when the PZ-41SLB-E is connected.</p> <p>Uncharged a-contact (Part sold separately is necessary)</p> <p>Uncharged a-contact (Part sold separately is necessary) (Connection is impossible when using PZ-41SLB-E)</p> <p>Only when M-NET transmission cable is connected</p> <p>Ditto</p> <p>Can not use the PZ-41SLB-E</p>
Function	<ul style="list-style-type: none">• Lossnay (heat recovery) ventilation/By-pass ventilation automatic switch• For cold area operation	
Installation	<ul style="list-style-type: none">• Remote controller 2 wires wiring (non-polar)• Address setting unnecessary• Test operation switch	<p>When the PZ-41SLB-E is connected: PVC cable Ø 0.65 to 1.2 or strand wire 0.3 mm² to 1.25 mm².</p> <p>When M-NET is connected: shielded wire or equivalent 1.25 mm² to 2.00 m².</p> <p>Excluding central controller system (except automatic address)</p> <p>For Lossnay single unit test operation</p>
Maintenance	<ul style="list-style-type: none">• Filter maintenance display (remote controller display)• Inspection display (remote controller, control board LED)• M-NET power supply display (control board LED)	

*1 The operation condition is stored, and when the power is turned off and then back on, the operation condition returns to the previous condition. (When using PZ-41SLB-E, the start/stop condition from an external device is not stored.)

4.2 System Example

Basic System (refer to page 115)	1 Lossnay with 1 remote controller	Multiple Lossnay units with 1 remote controller	2 remote controller system with 1 Lossnay
	 <p>Non-polar □ 2 wires</p> <p>Lossnay</p> <p>Power supply</p> <p>Remote controller □ PZ-41SLB-E</p>	 <p>Non-polar □ 2 wires</p> <p>Lossnay (Main)</p> <p>Power supply</p> <p>Remote controller □ PZ-41SLB-E</p> <p>Lossnay (Sub)</p> <p>Power supply</p>	 <p>Non-polar □ 2 wires</p> <p>Lossnay</p> <p>Power supply</p> <p>Remote controller □ PZ-41SLB-E</p>

<p>Operating with an Air Conditioning Unit (refer to page 118)</p>  <pre> graph LR RC[Remote controller] --- L[Lossnay] RC --- IU[Mr. Slim (indoor unit)] L --- PS1[Power supply] IU --- PS2[Power supply] </pre> <p>The diagram illustrates the connection between a remote controller, a Lossnay valve, and an indoor unit. The remote controller is connected to both the Lossnay valve and the indoor unit via power supplies. The Lossnay valve is also connected to its own power supply.</p>	<p>Operating with Mr. Slim (A-control)</p>
<p>Operating with an external device (refer to page 127)</p>  <pre> graph LR RC1[Remote controller PZ-41SLB-E] --- L[Lossnay] RC2[Remote controller] --- IU[Indoor unit] L --- PS1[Power supply] IU --- PS2[Power supply] RC1 --- ED[External Device] </pre> <p>The diagram illustrates the connection between a remote controller (PZ-41SLB-E), a Lossnay valve, an indoor unit, and an external device. The remote controller (PZ-41SLB-E) is connected to the Lossnay valve and the indoor unit via power supplies. The Lossnay valve is also connected to its own power supply. The external device is connected to the remote controller (PZ-41SLB-E).</p>	<p>Operating with an external device</p>

Air conditioning device and system control

Outdoor unit

Indoor unit Lossnay
MA remote controller

Group 1

Indoor unit Lossnay
MA remote controller

Group 2

Indoor unit Lossnay
MA remote controller

Group 3

Indoor unit Lossnay
MA remote controller

Group 4

Indoor unit Lossnay
MA remote controller

Group 5

Refrigerant 1

Refrigerant 2

Outdoor unit

Indoor unit Lossnay
MA remote controller

Group 1

Indoor unit Lossnay
MA remote controller

Group 2






Indoor unit Lossnay
MA remote controller

Group 3

Indoor unit Lossnay
MA remote controller

The diagram illustrates the Centralised Management System for M-NET. It features a 'Centralised controller' at the top, connected via lines to five distinct groups of units. Each group is enclosed in a dashed box. The units within each group are interconnected. Group 1 consists of a 'Power supply unit', a 'Lossnay' unit, and a 'Lossnay M-NET remote controller PZ-52SF-E'. Group 2 consists of a 'Lossnay' unit. Group 3 consists of three 'Lossnay' units. Group 4 consists of a 'Lossnay' unit and two 'PZ-52SF-E' units. Group 5 consists of two 'Lossnay' units and a 'Lossnay M-NET remote controller PZ-52SF-E'.


* In the case of LGH-200RX type, there are 2 circuit boards installed in each unit, so count each unit as 2 Lossnay units.

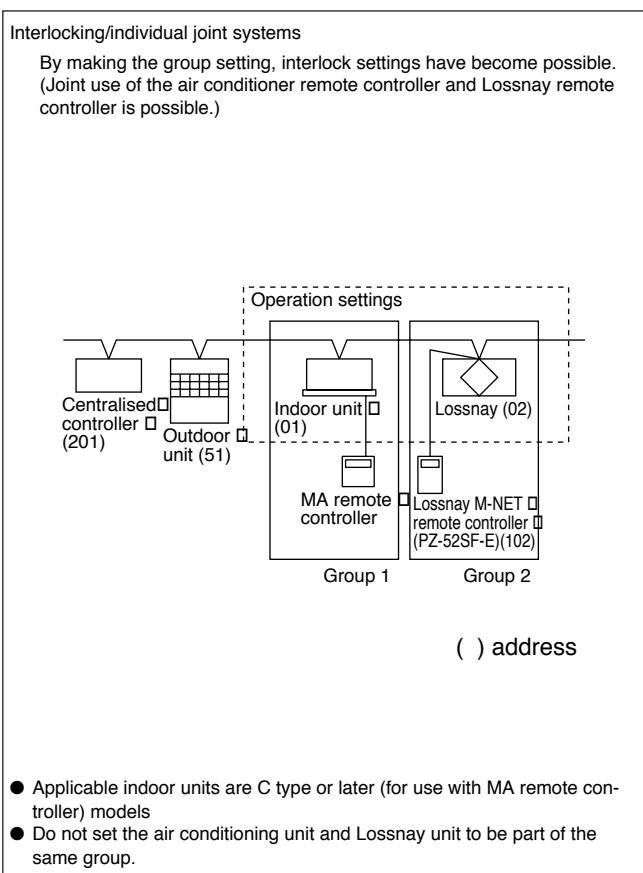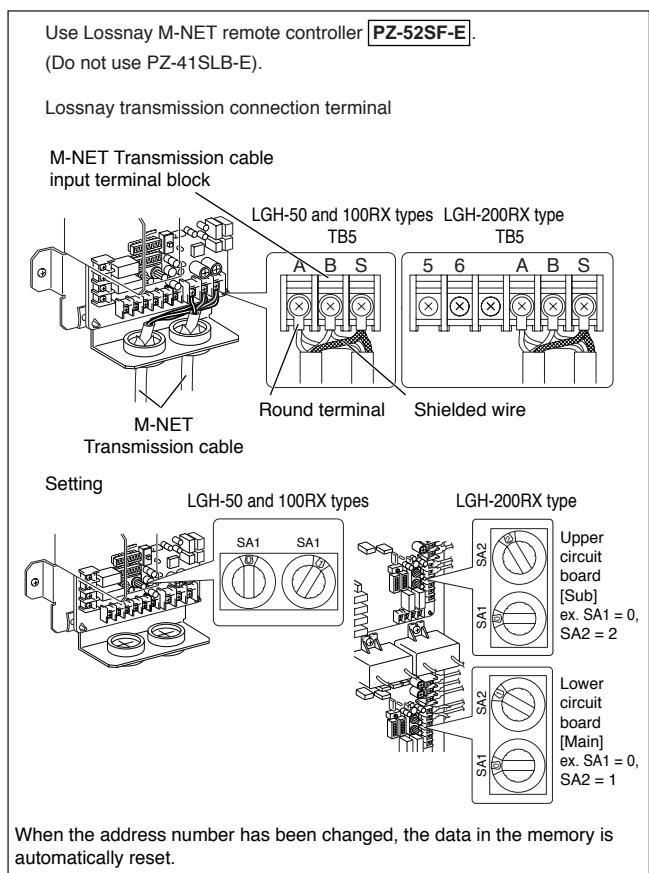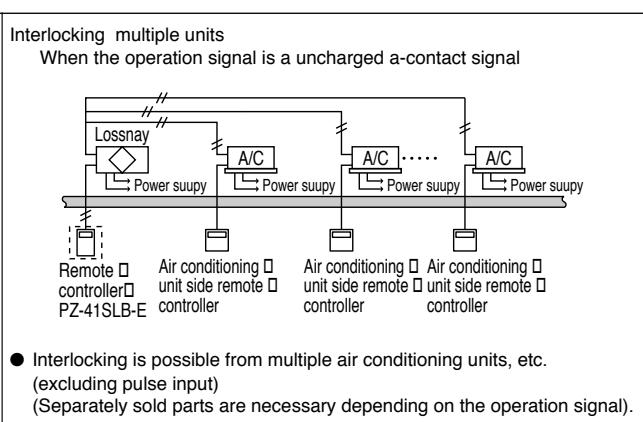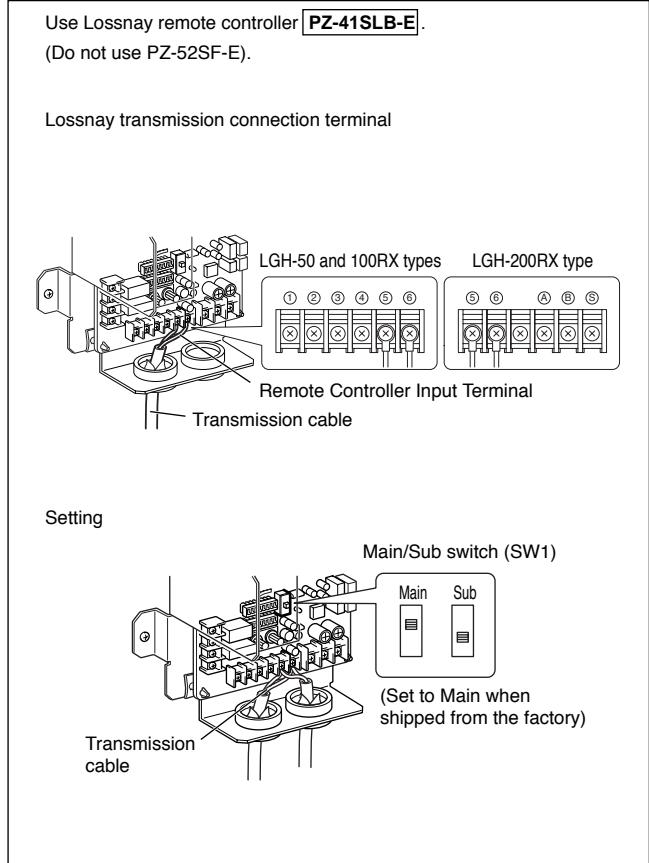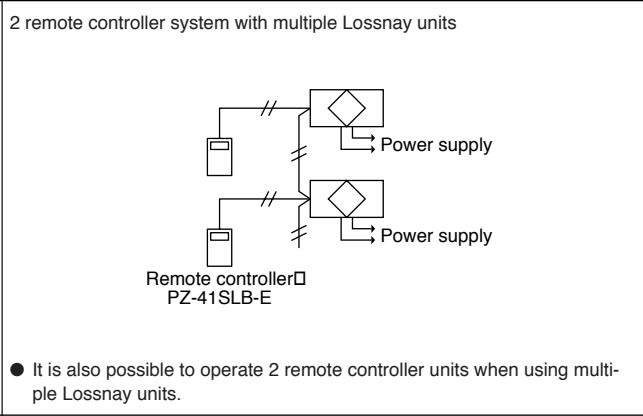

4.3 System Selection

Interlocked with City Multi (Refer to page 122)


Lossnay operation when indoor unit is stopped	<input type="radio"/>
Lossnay stopping when indoor unit is operating	<input type="radio"/>
Switching Lossnay fan speed	
When interlocked with indoor unit for compatibility with both R22, R407C and R410A	High/Low
When interlocked with indoor unit for other than the above	Fixed to high
Ventilation mode	Fixed to automatic
Filter maintenance indicator	<input type="radio"/>
Lossnay error indicator	<input type="radio"/>
Delayed operation	<input type="radio"/>
External control operating mode selection	<input checked="" type="checkbox"/>
Number of indoor units for interlocked group setting with one Lossnay unit	16 units
Number of Lossnay units for interlocked group setting with one indoor unit	1 unit

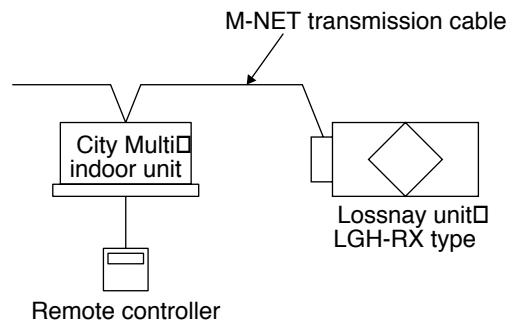

Interlocked with Mr. Slim (Refer to page 118)


When using A-control remote controller

Lossnay operation when indoor unit is stopped	<input type="radio"/>
Lossnay stopping when indoor unit is operating	<input checked="" type="checkbox"/>
Lossnay fan speed switching	High/Low
Other common items	
Lossnay error indicator	<input checked="" type="checkbox"/>
Ventilation mode	Fixed to automatic
Filter maintenance indicator	<input checked="" type="checkbox"/>
Delayed operation	<input type="radio"/>
External control operating mode selection	<input checked="" type="checkbox"/>
Number of indoor units for interlocked group setting with one Lossnay unit	1 unit
Number of Lossnay units for interlocked group setting with one indoor unit	1 unit

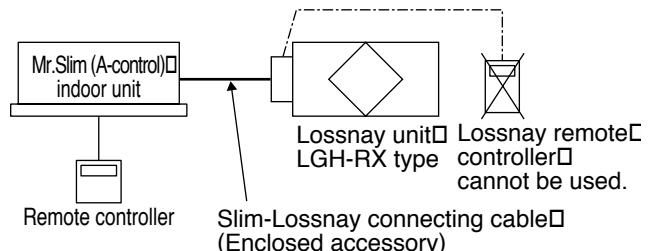


Independent Lossnay Unit (Not interlocked with City Multi or Mr. Slim systems.) (Refer to page 115)

Start/Stop	<input type="radio"/>
Fan speed switching	High/Low
Ventilation mode	Heat ex. / By-pass/ Auto
Filter maintenance indicator	<input type="radio"/>
Lossnay error indicator	<input type="radio"/>
Delayed operation	<input type="radio"/>
External control operating mode selection	<input type="radio"/>
Number of Lossnay units (In the case of LGH-200RX type, count each unit as two for calculation)	15 units
Number of remote controllers	2 units

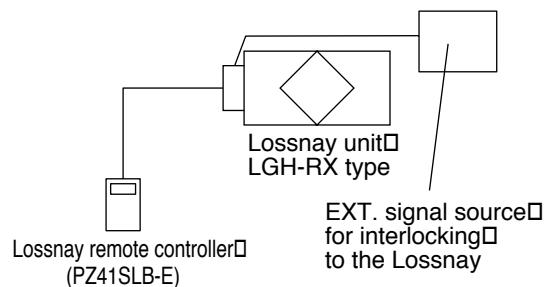


Interlocked with external device (BMS) (Refer to page 127)

Start/Stop	<input type="radio"/>
Fan speed switching	Fixed to high
Ventilation mode switching	Fixed to automatic
Filter maintenance indicator	<input checked="" type="checkbox"/>
Lossnay error indicator	<input checked="" type="checkbox"/>
Delayed operation	<input type="radio"/>
External control operating mode selection	<input type="radio"/>

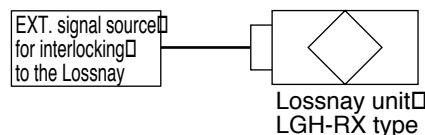

Central Controller System

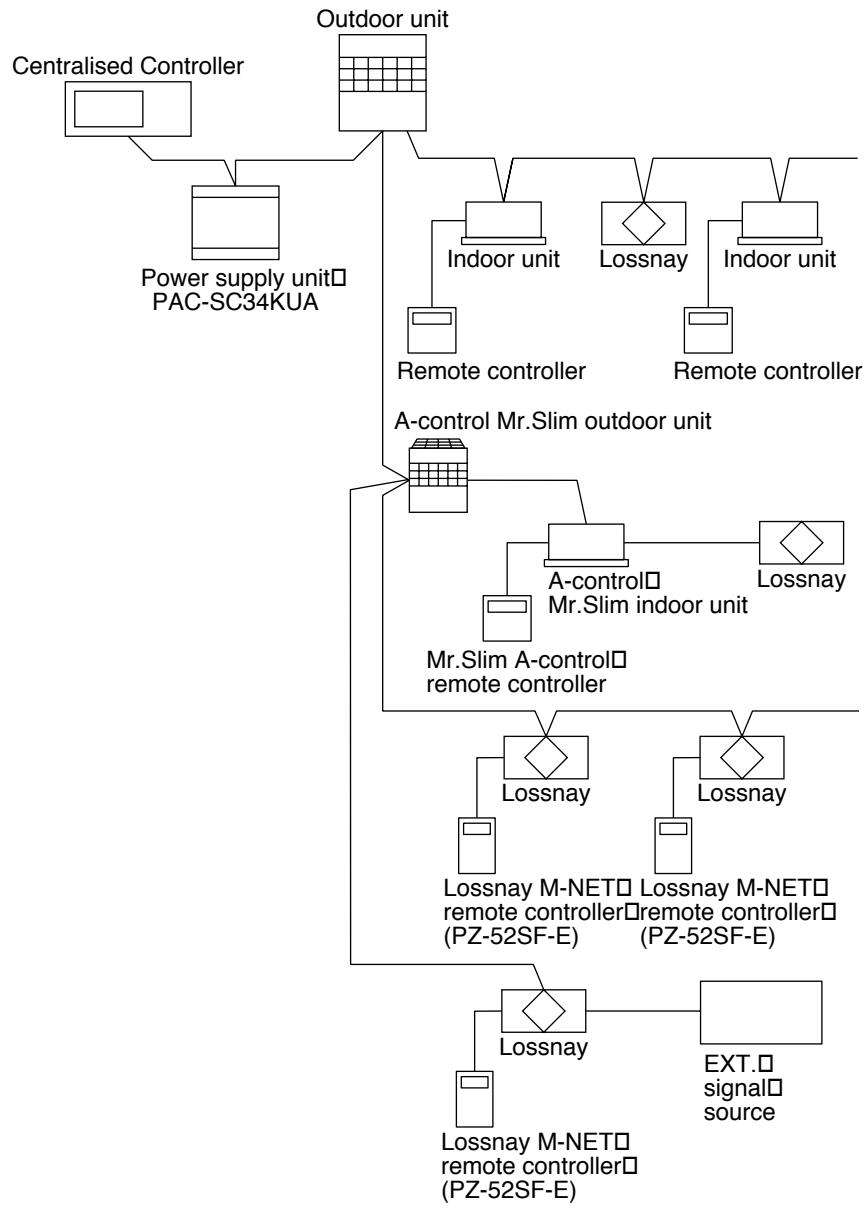

Central Con-
troller Sys-
tem

Caution:

- Lossnay remote controller PZ-41SLB-E can not be used.


Reference: Remote controller for the Lossnay and indoor unit.

Refer to the technical documentation related to the Remote controller for the indoor unit.

Remote controllers for Lossnay unit


Lossnay remote controller (PZ-41SLB-E)

With Lossnay interlock switches and indicators.

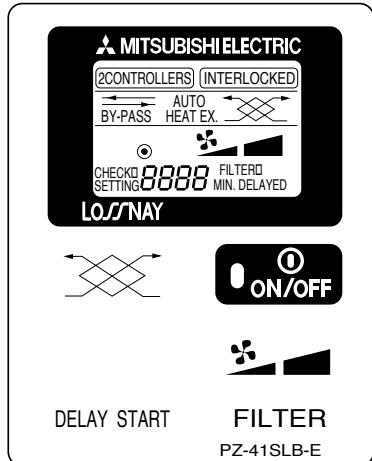

Lossnay M-NET remote controller (PZ-52SF-E)


Without Lossnay interlock switches and indicators.

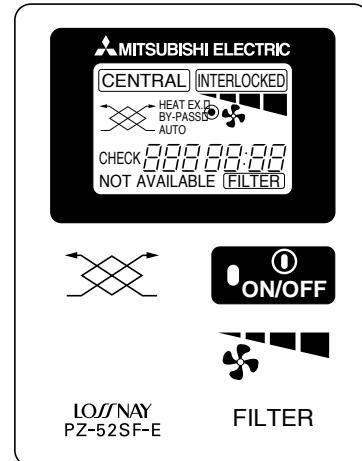

Remote controllers for City Multi indoor unit


Network remote controller (PAR-20MAA)

With Lossnay interlock switches and indicators.

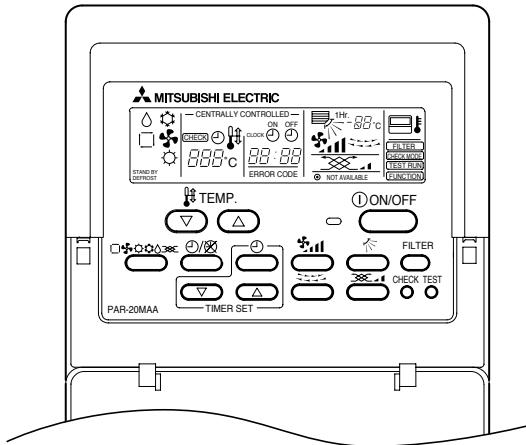

Simple remote controller (PAR-F27MEA)


Without Lossnay interlock switches and indicators.

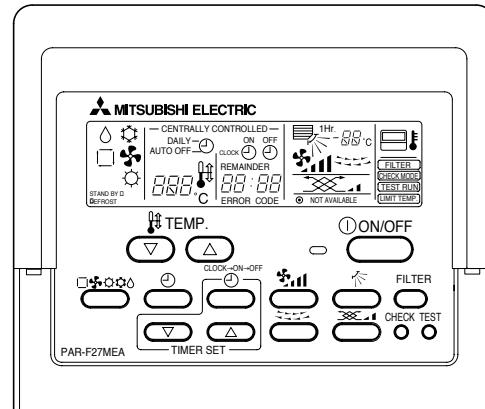

Remote controllers for Mr. Slim indoor unit

A-control remote controller (PAR-27AA)


With Lossnay interlock switches and indicators.

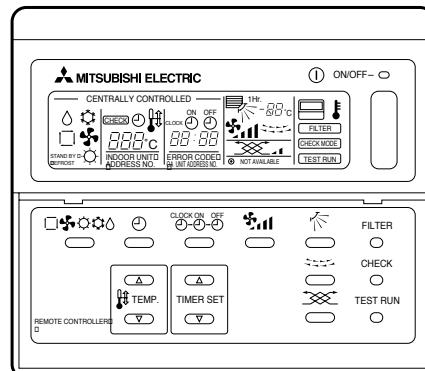

4.4 Basic System


4.4.1 System Summary

Design Example 1 Basic system

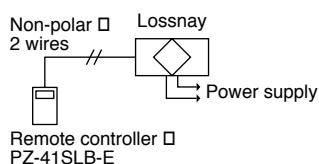


- This is a simple system.
A Lossnay is operated independently with 1 remote controller.

Design Example 2 Lossnay control of multiple units

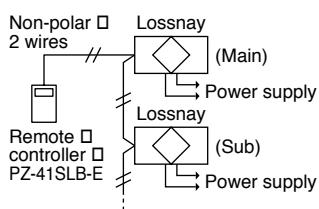

- Up to 15 Lossnay units can be controlled at one time with 1 remote controller switch.
(up to 7 units when using LGH-200RX type)

Design Example 3 2 remote controller system

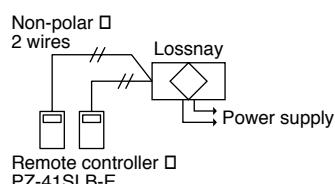

- The Lossnay can be controlled from 2 remote locations.
The remote controller gives priority to the last touch.


4.4.2 Operation of Multiple Units

Feature	For LGH-50/100RX types, 1 remote controller can operate from 1 to 15 Lossnay units. For using LGH-200RX type, 1 remote controller can operate from 1 to 7 Lossnay units.
Ordered part	Remote controller PZ-41SLB-E
Notes	<ul style="list-style-type: none"> Also connect the power to the second and following Lossnay units. The maximum extension of the transmission cable is 500 m or less (between Lossnay and remote controller switch, between Lossnay and Lossnay). The main or Sub setting on the Lossnay is necessary.

Note:

- The external device operation signal, and pulse signals can only be connected to the Lossnay on the "Main" setting.
- When the M-NET system is connected, do not connect the transmission cable to TM2.

System Example

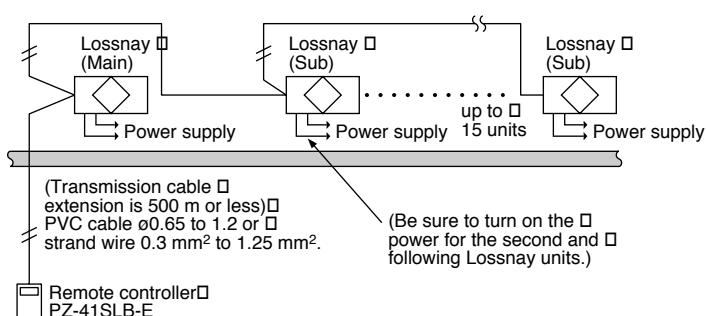


Combined Line Method

Connect the transmission cable from the first Lossnay to the second, the second to the third, and so on up to a maximum of 15 units.

(1) Up to four wires can be connected to one signal terminal when a transmission cable is Ø0.65 or strand wire 0.3 mm², or up to 2 wires in other cases.

(2) The signal is non-polar, so it is not necessary to align polarity.

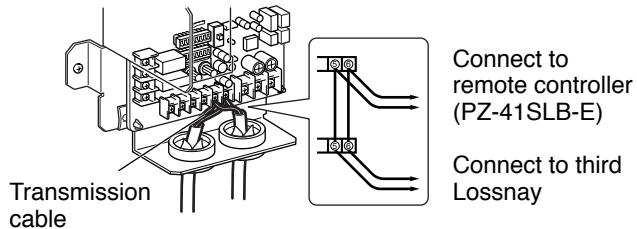


Lossnay Main/Sub Setting


Be sure to make the Main/Sub setting when operating multiple Lossnay units.

When operating multiple Lossnay units, set the first one to "Main," set the second and following to "Sub."

Be sure the power is off when making the settings.

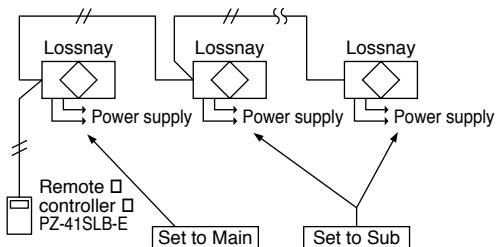


Change the Main/Sub switch (SW1) on the control board to "Sub" for the second and following Lossnay units.

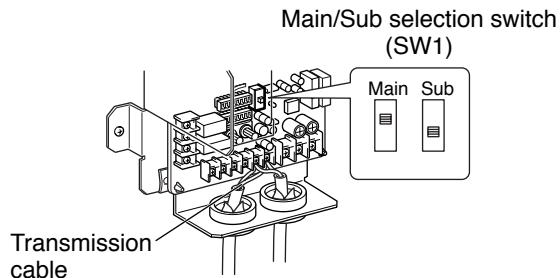

Operation Method

Up to 15 Lossnay units (up to seven units when using LGH-200RX type) can be operated when running at the same time.
(Individual control is not possible)

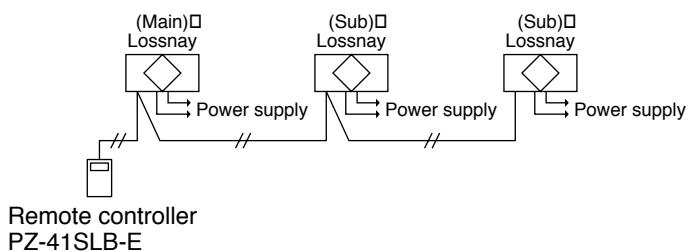


Note:

- In the case of LGH-200RX type, there are two circuit boards installed in each unit. Therefore, count each unit as two units in calculations when controlling multiple units. For example, 5 LGH-200RX type units would count as 10 units. (For 200RX type only, a maximum of seven units is possible.)

4.4.3 Operation with 2 Remote controllers


Characteristics	Remote controller	Note
<ul style="list-style-type: none"> Lossnay can be operated from two remote locations. Lossnay conditions can be checked from two remote locations. The remote controller gives priority to the last touch. 	Lossnay remote controller PZ-41SLB-E	<ul style="list-style-type: none"> Use only up to 2 remote controller (Operation will not go normally if 3 remote controller switches are connected.)

System Example

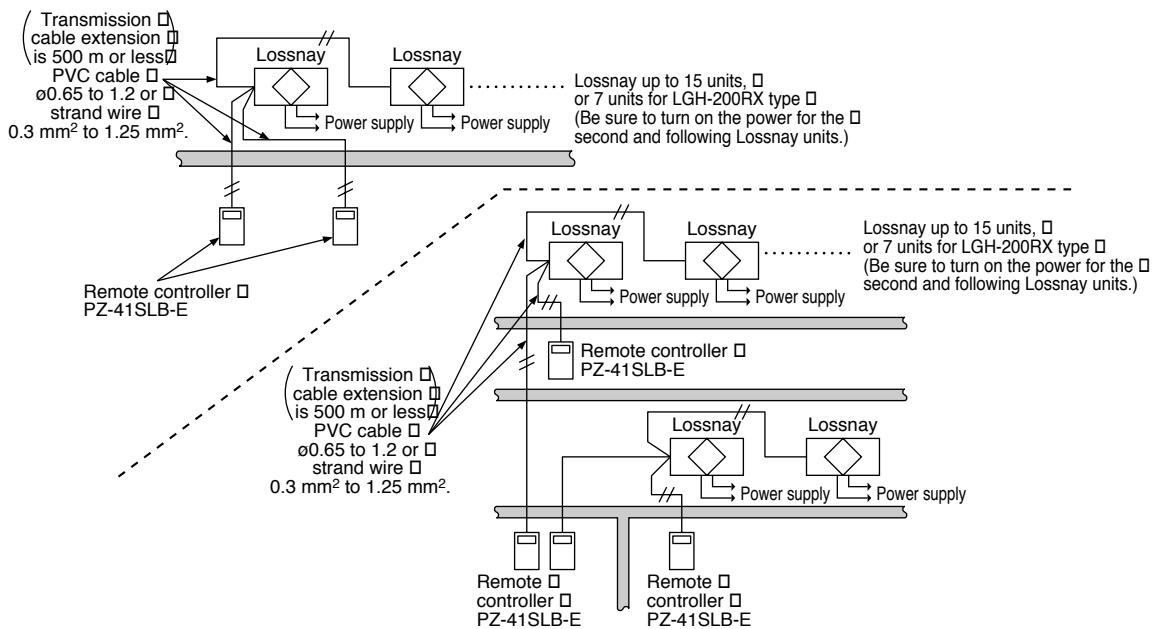

Operation Method

- When there are 2 remote controllers, "2 CONTROLLERS" will display on the LCD readout's upper region.
- The operation is the same with each remote controller. In this case, the Lossnay gives operating priority to the last button push.

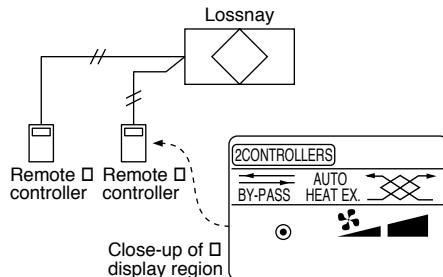


4.5 Interlocking with Mr. Slim

4.5.1 Interlocked Mr. Slim and Lossnay System

Features

- Interlocked operation with Mitsubishi air-conditioners is possible.

System Example

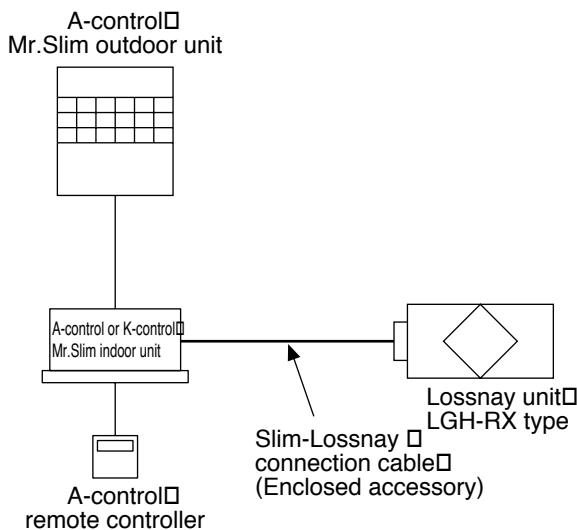

Lossnay Function Table (Interlocked settings)

Item	Details
Number of indoor units that can be set to interlocked operation with 1 Lossnay unit in each group	1 unit
Number of Lossnay units that can be set to interlocked operation with 1 indoor unit	1 unit
Operation of Lossnay unit only (When indoor unit is stopped)	Possible
Independent Lossnay unit start and stop (When indoor unit is operating)	Not possible
Delayed operation (Optional setting)	30 minute delayed operation when indoor unit cooling/heating is started
Fan speed switching	High/Low
Ventilation mode	Fixed to automatic
Filter indicator	Not possible
Error	Not possible
Restrictions and precautions	* The Lossnay remote controller cannot be used on systems interlocked with Mr. Slim. When connecting a PZ-41SLB-E to a Lossnay unit, ON/OFF and High/Low operation by the PZ-41SLB-E cannot be reflected to the display of the Mr. Slim's A-control remote controller.

Controller Function Table especially regarded to the Lossnay unit

Model		Local Remote	
		A-control remote controller	Lossnay remote controller
		PAR-20MAA	PZ-41SLB-E, PZ-52SF-E
Operation	Start/Stop	○	Not used to the interlocked Lossnays
	Fan speed switching	○	
	Ventilation mode switching	✗ (Automatic)	
	Priority instructions. Local permitted/prohibited	✗	
Monitoring	Status (Operation/Stop)	○	Not used to the interlocked Lossnays
	Fan speed switching	○	
	Ventilation mode	✗	
	Error	✗	
	Error content	✗	
	Filter sign	✗	
	Local permitted/prohibited	✗	

Switched and display

○ : Group only (or function available) ✗ : Not available

- For details on using the MA remote controller to set the functions of the indoor unit in order to operate the machine continuously, refer to section 15.3 on page 191.

4.6 Combination with City Multi


4.6.1 Independent Lossnay System with Lossnay M-NET Remote Controller and MELANS

Features

- The Mitsubishi Electric air-conditioner network system (MELANS) can operate and monitor each group of Lossnay units and air-conditioners.
- Can also perform operations using Lossnay M-NET remote controller.

System Examples: 1

The following groups can be configured.

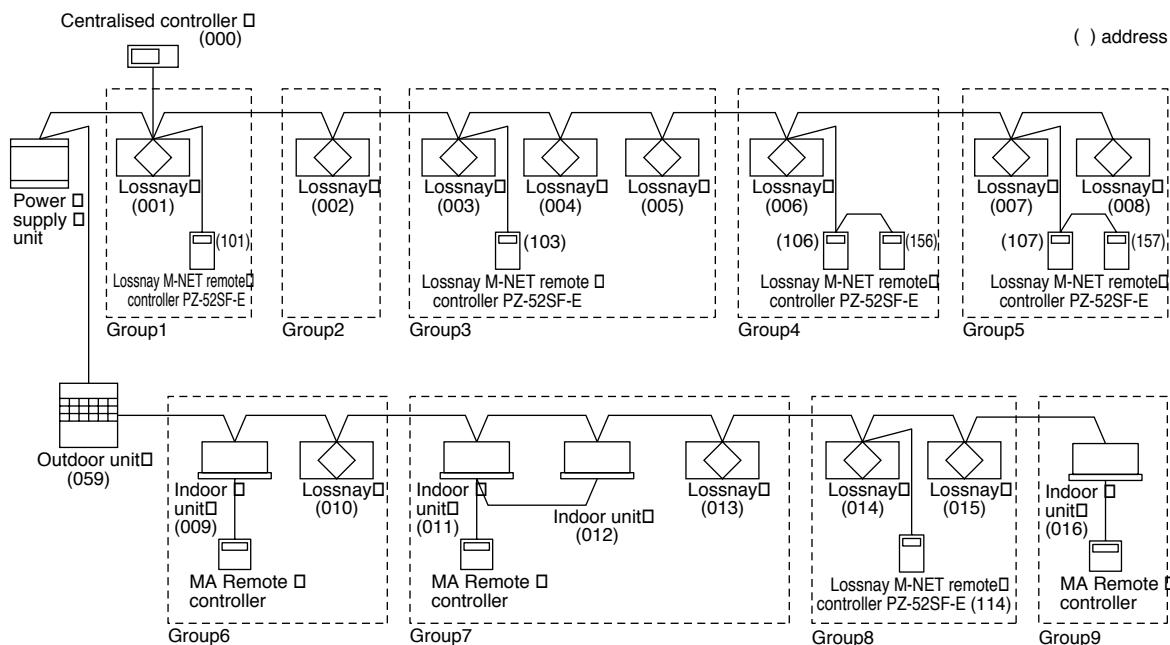

- Group 1 : Group of 1 Lossnay unit and 1 Lossnay M-NET remote controller.
Group 2 : Group without Lossnay M-NET remote controller.
Group 3 : Group of multiple Lossnay units and 1 Lossnay M-NET remote controller.
Group 4 : Group of 1 Lossnay unit and 2 Lossnay M-NET remote controllers.
Group 5 : Group of multiple Lossnay units and 2 Lossnay M-NET remote controllers.
Group 6 : Group of 1 indoor unit and 1 Lossnay unit in interlocked operation.
Group 7 : Group of multiple indoor units and 1 Lossnay unit in interlocked operation.
Group 8 : Group of multiple Lossnay units connected to 1 indoor unit transmission cable and 1 Lossnay M-NET remote controller.
Group 9 : Group with no Lossnay units.

Caution:

- Lossnay remote controller PZ-41SLB-E can not be used.

Lossnay Function Table (Group Setting)

Item	Details
Number of Lossnay remote controllers and/or MELANS units that can be connected to 1 Lossnay unit	5 units (Number of Lossnay remote controller is 2 units max.)
Operation of 2 remote controllers in 1 group	Possible
Fan speed switching	High/Low
Ventilation mode	Heat ex. / By-pass / Automatic
Filter indicator	3000 hours / 1500 hours / 4500 hours / No display
Error	Display

Controller Function Table

Model	Local Remote			MELANS Series	
	Lossnay M-NET remote controller	ME remote controller	MA remote controller	Centralised controller	Centralised controller
	PZ-52SF-E	PAR-F27MEA	PAR-20MAA	MJ-103MTRA	MJ-180A
No. of controllable (Groups/Units)	1 Group/ 16 Units			50 Groups/ 50 Units	100 Groups/ 100 Units (*200 Groups/ 200 Units)
Operation	Start/Stop	<input type="radio"/>		<input type="radio"/>	<input type="radio"/>
	Fan speed switching	<input type="radio"/>		<input type="radio"/>	<input type="radio"/>
	Ventilation mode switching	<input type="radio"/>		<input type="radio"/>	<input type="radio"/>
	Priority instructions. Local permitted/prohibited	×		<input type="radio"/>	<input type="radio"/>
Monitoring	Status (Operation/Stop)	<input type="radio"/>		<input type="radio"/>	<input type="radio"/>
	Fan speed switching	<input type="radio"/>		<input type="radio"/>	<input type="radio"/>
	Ventilation mode	<input type="radio"/>		<input type="radio"/>	<input type="radio"/>
	Error	<input type="radio"/>		<input type="radio"/>	<input type="radio"/>
	Error content	<input type="radio"/>		<input type="radio"/>	<input type="radio"/>
	Filter sign	<input type="radio"/>		<input type="radio"/>	<input type="radio"/>
	Local permitted/prohibited	<input type="radio"/>		<input type="radio"/>	<input type="radio"/>
Scheduling/ Recording	Weekly	×		<input type="radio"/>	<input type="radio"/>
	Stop/Starts per day	×		3	6
	Stop/Starts per week	×		21	42
	Minimum setting (minutes)	×		10	1
	Error record	×		<input type="radio"/>	<input type="radio"/>

Switches and display

: Group/batch

: Group only (or function available)

× : Not available

* Can be expanded to 200 units by using 2 gateway units.

- For details about the operation or display of the Lossnay M-NET remote controller (PZ-52SF-E) refer to page 176.
- For details about the operation or display of the Centralised controller (MJ-103MTRA) refer to page 181.

4.6.2 City Multi and Lossnay Interlocked System


Characteristics

- Interlocked operation with Mitsubishi air-conditioners is possible.
- Can also perform independent Lossnay operations using MA remote controller or ME remote controller.

System Examples


The following groups can be configured.

Single Refrigerant System

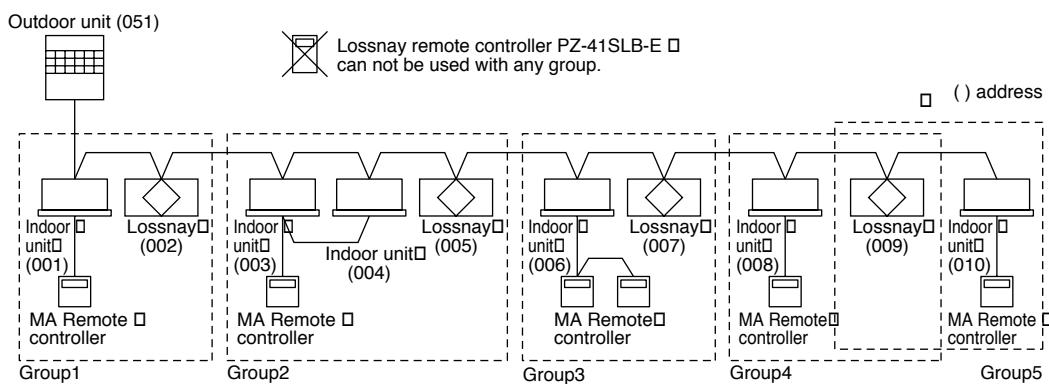

- Group 1 : Group of 1 indoor unit and 1 Lossnay in interlocked operation.
Group 2 : Group of multiple indoor units and 1 Lossnay unit in interlocked operation.
Group 3 : Group of 1 indoor unit with 2 remote controllers and 1 Lossnay unit in interlocked operation.
Group 4, 5 : Group of multiple groups and 1 Lossnay unit in interlocked operation.

Multiple Refrigerants System

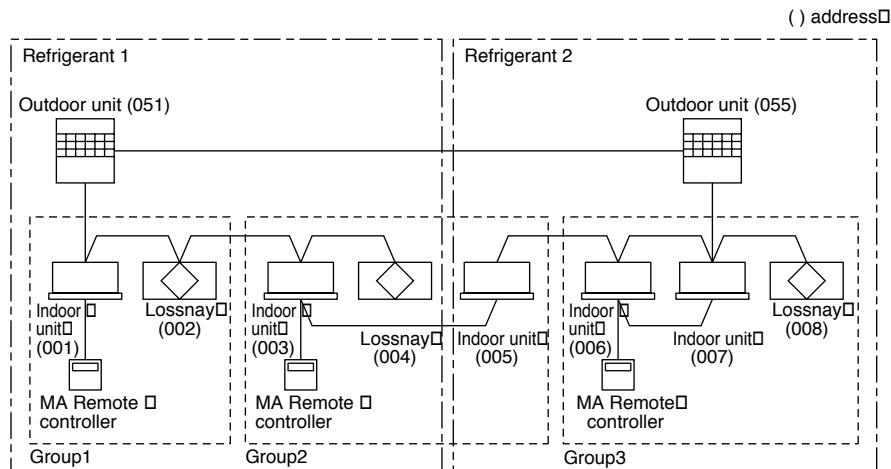

- Group 1 : Group of 1 indoor unit and 1 Lossnay in interlocked operation.
Group 2 : Group of multiple indoor units (with different refrigerants) and 1 Lossnay unit in interlocked operation.
Group 3 : Group of multiple indoor units (with same refrigerant) and 1 Lossnay unit in interlocked operation.

Lossnay Function Table (Interlocked Settings)

Item		Details
Number of indoor units that can be set to interlocked operation with 1 Lossnay unit in each group		16 units per group
Number of Lossnay units that can be set to interlocked operation with 1 indoor unit		1 unit
Independent start/stop of ventilation (Lossnay)		Possible
Delayed operation (Optional setting)	Indoor unit compatible with both R22, R407C and R410A	30 minute delayed operation when indoor unit cooling/heating is started
	Units other than the above	Fixed to high
Fan speed switching	Indoor unit compatible with both R22, R407C and R410A	High/Low
Ventilation mode	Units other than the above	Fixed to automatic
Filter maintenance indicator		3000 hours / 1500 hours / 4500 hours / No display
Error		Display
Restrictions and precautions		* Lossnays cannot be interlocked to the indoor units using K-transmission converter.

Controller Function Table especially regarded to the Lossnay unit

Model		Local Remote		
		Lossnay M-NET remote controller	ME remote controller	MA remote controller
			PZ-52SF-E	PAR-F27MEA
Operation	Start/Stop	○	○	○
	Fan speed switching	○	○	○
	Ventilation mode switching	○	✗ (Automatic)	✗ (Automatic)
	Priority instructions. Local permitted/prohibited	✗	✗	✗
Monitoring	Status (Operation/Stop)	○	○	○
	Fan speed switching	○	○	○
	Ventilation mode	○	✗	✗
	Error	○	○	○
	Error content	○	○	○
	Filter sign	○	○	○
	Local permitted/prohibited	○	○	○
Scheduling/ Recording	Weekly	✗	✗ (Dayly)	✗
	Stop/Starts per day	✗	2	2
	Stop/Starts per week	✗	✗	✗
	Minimum setting (minutes)	✗	10	10
	Error record	✗	✗	✗

Switches and display

○ : Function available ✗ : Not available

- For details about the operation or display of the remote controller (PAR-F27MEA, PAR-20MAA), please refer to those Manuals.

4.6.3 MA Remote Controller/ME Remote Controller in Combination with Lossnay M-NET Remote Controller

System


The MA remote controller, ME remote controller, and Lossnay M-NET remote controller can be used in combination.

Combination of Air Conditioner Remote Control and Lossnay Remote Control

Indoor Unit	Lossnay LGH-RX type
Model for MA remote control (Type C or later)	○
Model for other than MA remote control (Type B or earlier)	×

○ : Compatible × : Incompatible

System Examples: 1

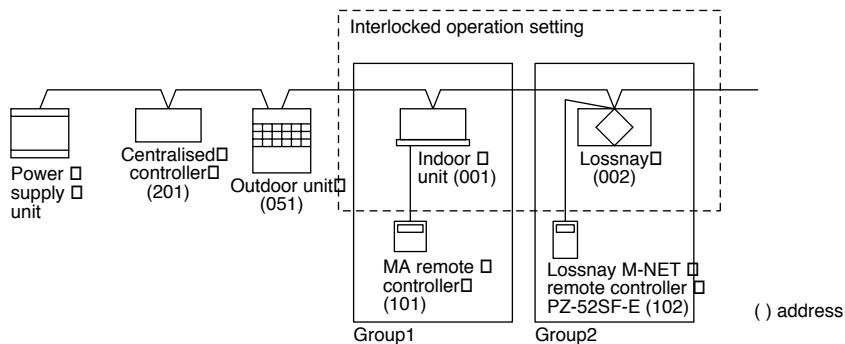

Setting Method

- (1) Make the Group setting for the indoor unit.
- (2) Make the Group setting for the Lossnay unit.
- (3) Set the indoor unit and Lossnay unit in interlocked operation.

When using the centralised controller, make both the Group setting and operation setting for the previously mentioned units. Though the MJ-180A cannot set interlocked settings, it should set at MA/ME remote controllers.

Characteristics

- (1) When the indoor unit is set for interlocked operation in 1 group:
Interlocked operation with the indoor unit from the air conditioner remote controller is possible and can switch between High/Low/Off.
From the air conditioner remote controller it is possible to switch the Lossnay only between High/Low/Off.
From the Lossnay remote controller it is possible to switch the Lossnay between High/Low/Off.
- (2) When the 2 or more indoor units with different group are set for interlocked operation, the Lossnay will operate if at least 1 group operates. The Lossnay will stop operation if all groups stop operation.
From an air conditioner remote controller it is possible to switch the Lossnay only between High/Low when other groups are operating.
From the Lossnay remote controller it is possible to switch the Lossnay between High/Low/Off.

Note:

- If the display on the MA remote controller/ME remote controller, or other air conditioner remote controller, is cancelled, the air conditioner remote controller will not show the ventilation display even if you operate the Lossnay from the Lossnay M-NET remote controller.

Note:


Transmission cable power control for indoor units

Be sure usage is within the following boundaries.

- Indoor units + ME remote controllers (compact remote controllers) + Lossnay M-NET remote controllers is less than or equal to 40 units.
- Indoor units are less than or equal to 20 units.
(The numbers of MA remote controllers and Lossnay units are not included in the above number of units.)

System Examples: 2


A mixed system including the City Multi can also be configured.

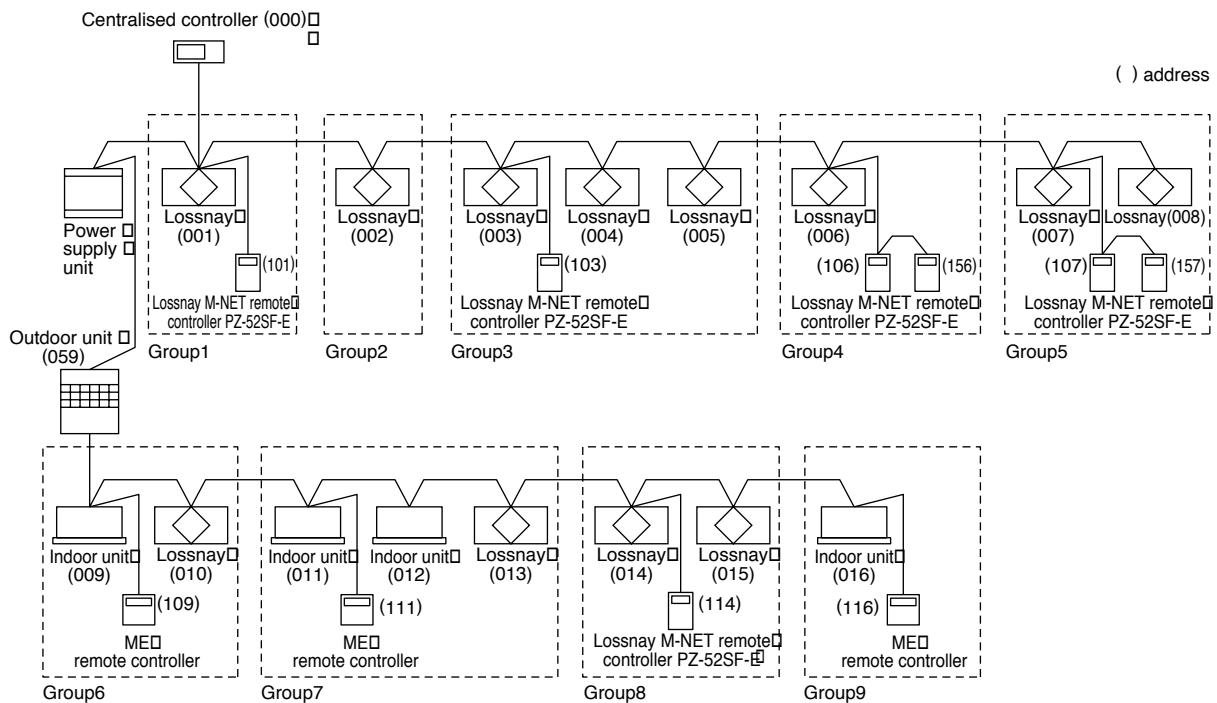

- Group 1 : Group of 1 Lossnay unit and 1 Lossnay M-NET remote controller.
- Group 2 : Group with no Lossnay M-NET remote controller.
- Group 3 : Group of multiple Lossnay units and 1 Lossnay M-NET remote controller.
- Group 4 : Group of 1 Lossnay unit and 2 Lossnay M-NET remote controllers.
- Group 5 : Group of multiple Lossnay units and 2 Lossnay M-NET remote controllers.
- Group 6 : Group of 1 indoor unit and 1 Lossnay unit in interlocked operation.
- Group 7 : Group of multiple indoor units and 1 Lossnay unit in interlocked operation.
- Group 8 : Group of multiple Lossnay units connected to an indoor unit transmission cable and 1 Lossnay M-NET remote controller.
- Group 9 : Group with no Lossnay units.

Note:

- Do not use Lossnay remote controller PZ-41SLB-E in case of a system using M-NET transmission cable.

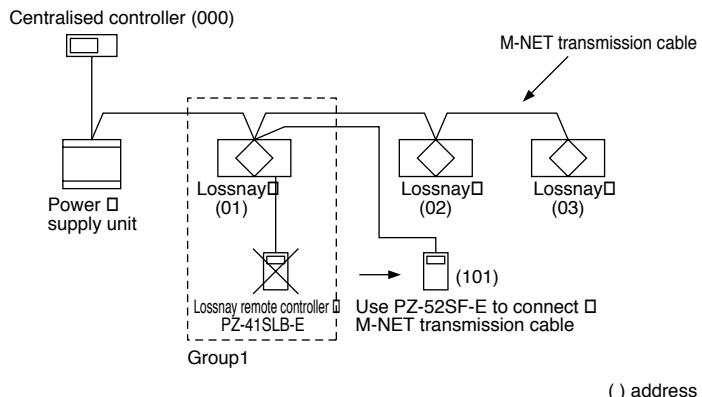

4.6.4 When Using the LONWORKS® Compatible Adaptor (LMAP02-E) to Connect to LONWORKS®

By using the LON® adaptor (model name: LMAP02-E), it is possible to control and observe Lossnays on a building management system using the LONWORKS®.


* For specifications and functions of the LON® adaptor, refer to the materials regarding the LONWORKS® compatible adaptor.

Table of Functions

	Contents	Individual Lossnay (Lossnay not set for interlocked operation)	Interlocked Lossnay (Lossnay set for interlocked opera- tion with City Multi)
Operation	ON/OFF	○	×
	Change fan to High/Low	○	×
	Change ventilation mode	○	×
	Local prohibit ON/OFF	○	×
Observation	Operation condition	○	×
	Fan speed	○	×
	Ventilation mode (conditions)	○	×
	Errors	○	○
	Filter maintenance sign	○	×
	Local prohibit ON/OFF state	○	×

System Example

(Using M-NET)

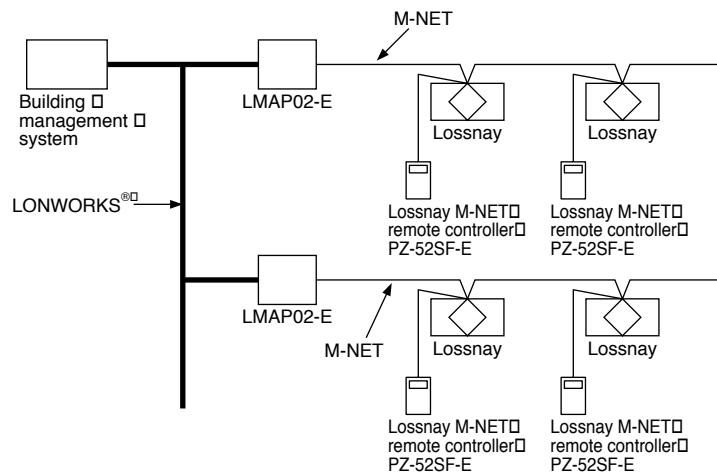

Connect the M-NET transmission cable to TB5 A,B of the Lossnay terminal block. (Refer to page 165).

The Lossnay remote controller (PZ-41SLB-E) can not be used with this system.

Up to 50 units can be connected with 1 LMAP02-E (The LGH-200RX type should be counted as two).

For details about the system or connection cables of the LMAP02-E, refer to the technical materials, etc., regarding the LMAP02-E.

* LONWORKS® is a registered international trademark, registered in the U.S.A to the Echelon Corporation.

5. Examples of Applications Using External Control Input Terminals, Operation Monitor Output Terminals and Malfunction Monitor Output Terminals


Various applications are possible by using the input/output terminals as shown below.

Input/Output Specifications

	Terminal	Specification	Page
1	External control input terminal block (TM2 ① ② ③)	This is the input terminal block for start/stop the Lossnay unit using external equipment, such as a Mr. Slim (A-control) indoor unit or the BMS (Building Management System). Signal input can be by voltage (12V-24V DC) or uncharged a-contact signal. (Both voltage and no-voltage signals are compatible with pulse input. Set DIP switch 2-2 to ON. A pulse signal duration of 200 ms or more is needed.)	128/130 131/132
2	Operation monitor output terminal block (TM3 ⑨ ⑩)	Output terminal during Lossnay unit operation. (uncharged a-contact signal output.) Contact point rating: 2A/240V AC Within 2A/24V DC	131/133
3	Malfunction monitor output terminal block (TM3 ⑦ ⑧)	Output terminal during Lossnay unit malfunction. (uncharged a-contact signal output.) Contact point rating: 1A/240V AC Within 1A/24V DC	132 to 133

Lossnay Main/Sub Setting

For a multiple Lossnay system that will begin operation from one signal from an air conditioner or the like, make sure the unit connected to the signal cable from the air conditioner is set to "Main," and all the others are set to "Sub."

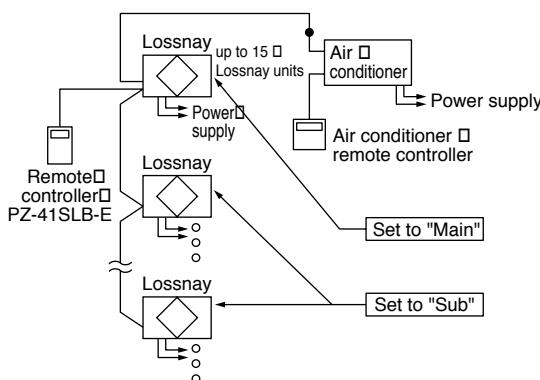

5.1 External Control Operating Mode Selection

There are four modes when operating using signals from external equipment.

1. ON/OFF interlock (the last trigger from either external signal or remote control switch has priority)
2. ON interlock
3. OFF interlock
4. External priority ON/OFF interlock

Operating Signal

Mode	When external signal is level signal.	When external signal is pulse signal. (Optional setting)
ON/OFF inter-lock	<p>External signal</p> <p>Remote controller [ON/OFF] button pressed</p> <p>Operating condition Stopped</p>	<p>External signal</p> <p>Remote controller [ON/OFF] button pressed</p> <p>Operating condition Stopped</p>
ON inter-lock	<p>External signal</p> <p>Remote controller [ON/OFF] button pressed</p> <p>Operating condition Operating</p>	<p>External signal</p> <p>Remote controller [ON/OFF] button pressed</p> <p>Operating condition Operating</p>
OFF inter-lock	<p>External signal</p> <p>Remote controller [ON/OFF] button pressed</p> <p>Operating condition Stopped</p>	<p>External signal</p> <p>Remote controller [ON/OFF] button pressed</p> <p>Operating condition Stopped</p>
External priority ON/OFF inter-lock	<p>External signal</p> <p>Remote controller [ON/OFF] button pressed</p> <p>Operating condition Operating</p>	<p>This mode does not exist.</p>

Setting Method

When PZ-41SLB-E is used . . . Set with the remote controller. (Refer to page 174)
 When PZ-41SLB-E is Not used . . . Set with the dip switch. (Refer to page 168)

5.2 Delayed Interlocked Operation (PZ-41SLB-E, M-NET)

- (1) It is possible to delay operation of the Lossnay with respect to the operation of the external device. (Energy saving effect.)
- (2) The times that can be set for delayed operation are 10, 20, 30, 40, 50, and 60 minutes.
- (3) Delayed operation does not occur if the Lossnay operation was cancelled within the last 2 hours.
(If turned off for a short time, for example during a lunch break, if the direction to restart operation is given within 2 hours, the Lossnay will restart immediately.)
- (4) If an operation button is pressed on the remote controller while the delay timer is operating, the delayed operation is cancelled and normal operation begins.

Setting Method

When PZ-41SLB-E is used . . . Set with the remote controller. (Refer to page 174)


When PZ-41SLB-E is Not used . . . Set with the dip switch but fixed only for 30 minutes. (Refer to page 167)

5.3 Multiple External device Operation (PZ-41SLB-E, M-NET)

When there are multiple air conditioners or other external devices		
Characteristics	Ordered parts	Notes
Lossnay operates when any of the external devices operate.	Remote controller	<ul style="list-style-type: none">• External signals that can be received are listed below.Level signal, uncharged a-contact• If the external device is a pulse signal or charged signal multiple connections can not be made.

System Example

When the Operation Signal is a Uncharged a-contact Level Signal

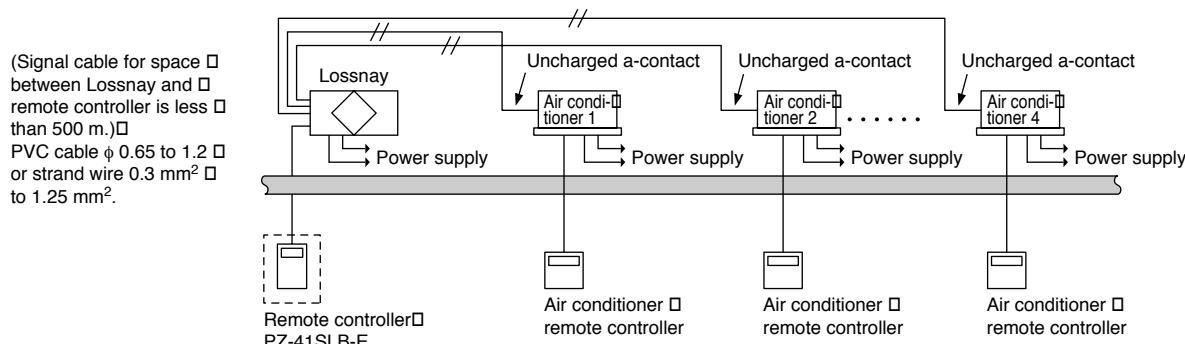


* Illustration shows an example when using PZ-41SLB-E.

5.4 Multiple Lossnay Units in Interlocked Operation with One Indoor Unit. (M-NET only)

[Example: System 1]

Set the Main/Sub switch of the Lossnay connected to the M-NET transmission cable to “Main,” set the second and following Lossnay units to “Sub,” and connect ⑤ and ⑥ of the Lossnay remote controller’s (PZ-41SLB-E) transmission cable terminal (TM2) to the corresponding point on the next unit.

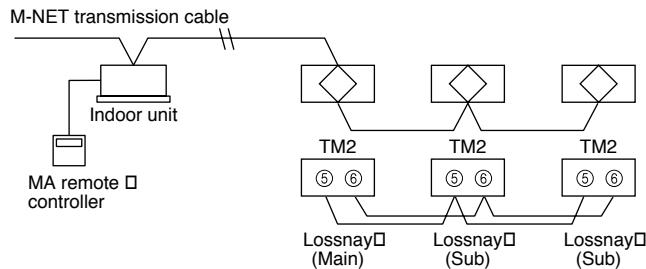


(One Point Advice)

Register the first Lossnay unit and the indoor unit to be interlocked.

It is not necessary to set the address or direct control for the second or following Lossnay units.
Malfunctions of the Lossnay units after the second unit will not appear on the remote controller.

[Example: System 2]

Use the Lossnay remote controller to set the air conditioners and Lossnay units to separate groups. Both interlocked operation of an air conditioner and Lossnay units can be performed independently by connecting the remote display output for the indoor unit and the external control input for the Lossnay unit.

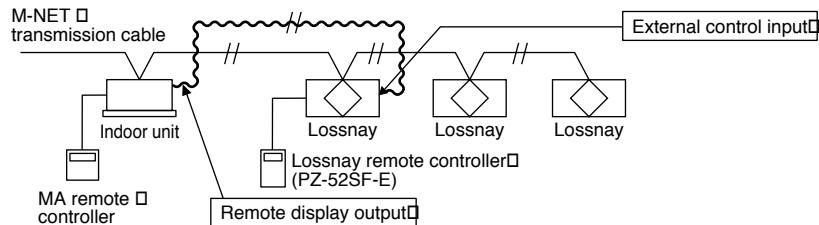


(One Point Advice)

Do not register the indoor unit and Lossnay unit to be interlocked. In addition, ventilation switch on the MA remote controller will be invalid, and the Lossnays’ error indicator will appear only on the Lossnay remote controller.


5.5 Interlocked Operation of Equipment such as the Electrically Operated Damper and Booster Fan. (M-NET only)

[Example: System 3]

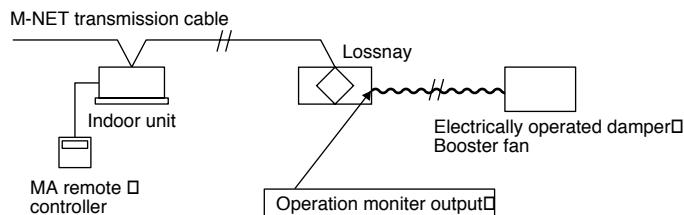


5.6 To Pick Up an Error Signal Externally (PZ-41SLB-E, M-NET)

[Example System]

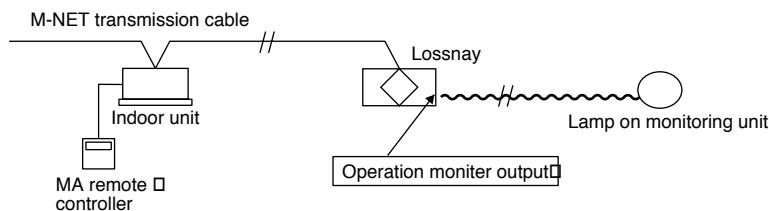


5.7 Connection Method (PZ-41SLB-E, M-NET)

1. Using a Mr. Slim (A-control) indoor unit

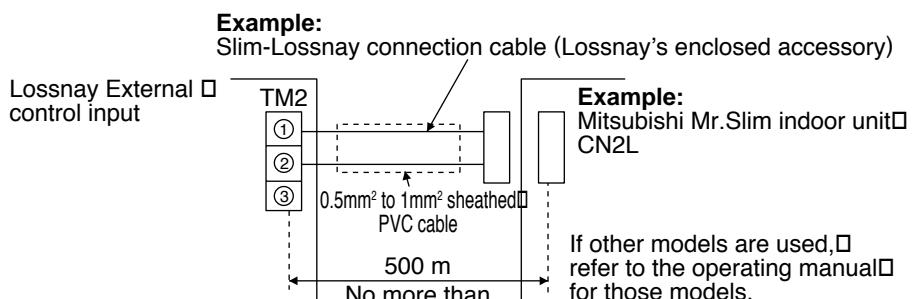


2. Using a 12V DC or 24V DC voltage signal


[When voltage pulse signal (12V DC or 24V DC) is used]

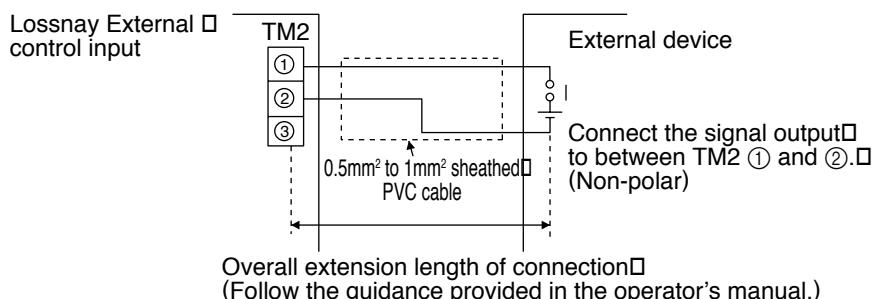


3. Uncharged a-contact

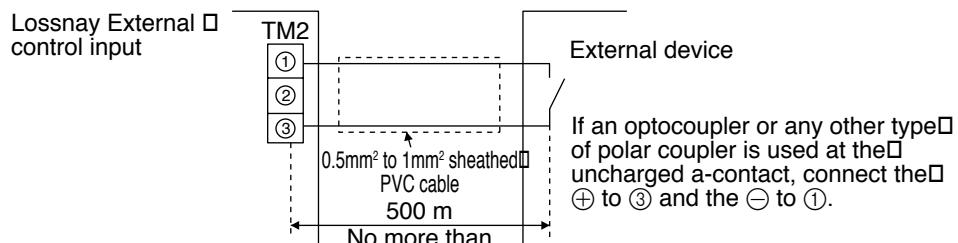

4. Many uncharged a-contacts.

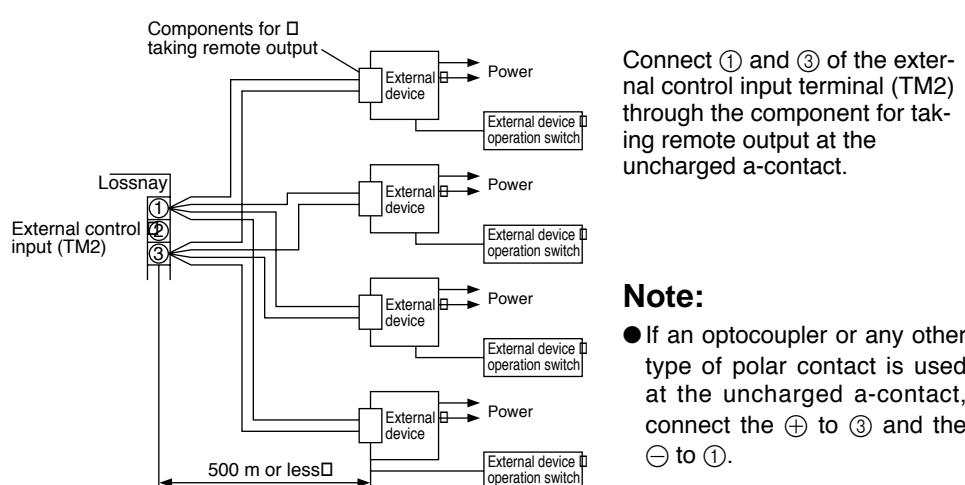

5. Connecting to equipment such as an electrically operated damper and picking up the operating signals.

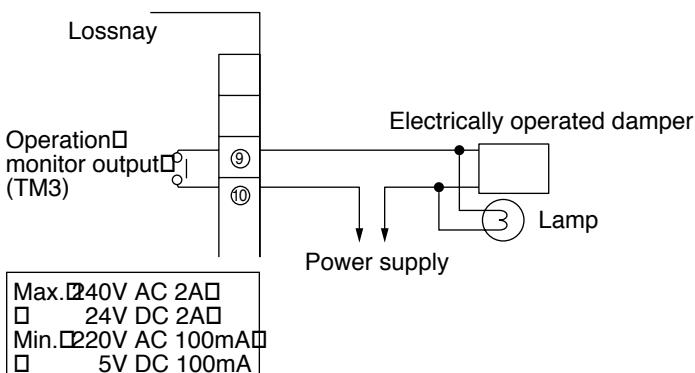


Connect the power supply cable from the electrically operated damper to ⑨ and ⑩ of the operation monitor output terminal (TM3).

Note:

- The response time to an external control input signal is shown in the table below.

External Signal Type	Response Type
Level signal	Maximum 7 seconds
Pulse signal	Maximum 200 milliseconds

6. Picking up an error signal.

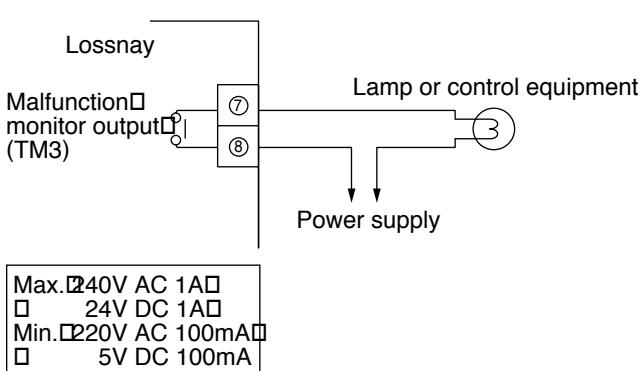


Connect to ⑦ and ⑧ of Malfunction monitor output terminal (TM3)

5.8 High/Low Change Input (PZ-41SLB-E, M-NET)

The fan speed of the Lossnay can be changed externally by using a commercially available CO₂ sensor, etc. The separately sold remote ON/OFF adaptor (PAC-SE55RA-E) is necessary for connection.


Connection Method

● Externally Directed "High" fan speed Operation

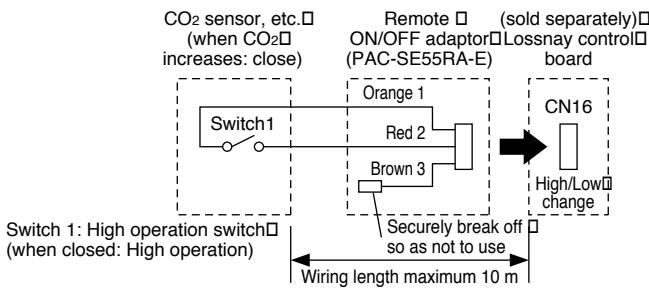

When switch 1 is ON, the Lossnay operates at the "High" fan speed regardless of the remote controller setting. If you usually ventilate at "Low" fan speed operation, switch to "High" fan speed operation when the external sensor shows the air quality going down.


● Externally Directed "Low" fan speed Operation

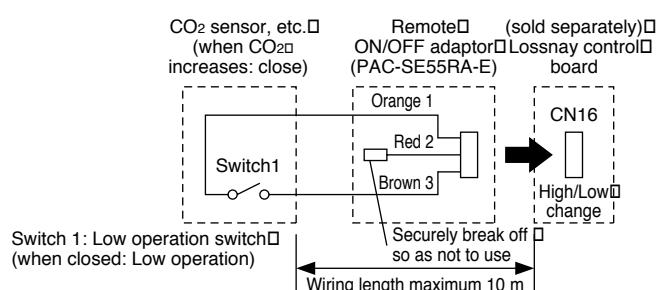

When switch 1 is ON, the Lossnay operates at the "Low" fan speed regardless of the remote controller setting. If you usually ventilate at "High" fan speed operation, switch to "Low" fan speed operation when the external sensor shows few impurities in the air.


1 When using PZ-41SLB-E to connect multiple units

- Connect the sensor to the Lossnay with the “Main” setting.
- It is not necessary to connect to any Lossnay with the “Sub” setting.
- Connect any sensor, etc., connected to external change input to the Lossnay with the “Main” setting.
- Any Lossnay with the “Sub” setting will operate at the same High/Low setting as the Lossnay with the “Main” setting when there is sensor signal input.

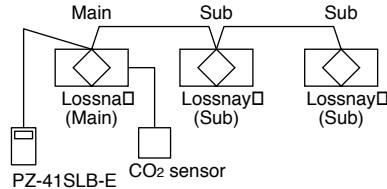

2 When using M-NET for a group of multiple units

- For multiple groups, connect the sensor to each Lossnay.
- Even if the units are in the same group, you can only change Lossnay units connected to the sensor between High/Low operation.

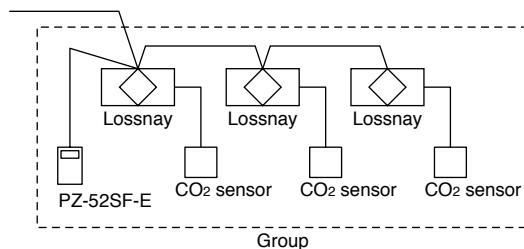


Note:

- When using the M-NET system, the fan speed being input by this sensor signal will not be displayed on the remote controller.

5.9 Remote/Local control Change and ON/OFF Input (M-NET only)

The separately sold remote ON/OFF adaptor (PAC-SE55RA-E) is necessary for connection. Remote/Local changing is impossible when using PZ-41SLB-E.

- Insert the separately sold remote ON/OFF adaptor (PAC-SE55RA-E) into CN32 on the Lossnay control table

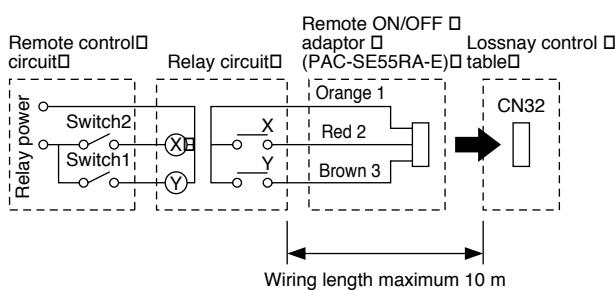

Switch 1 : When on, can not use the local remote controller (PZ-52SF-E) to turn ON/OFF.
* When using PZ-41SLB-E, Remote/Local changing is impossible.

Switch 2 : When Switch 1 is ON, you can turn Switch 2 ON to operate the Lossnay, or turn Switch 2 to OFF to turn off the Lossnay.

Switch 1 : Remote/Local change switch
Switch 2 : ON/OFF switch

X, Y : Relay (Contact rating DC 1 mA)

Note:


- External control input and Remote/Local changing can not be used at the same time.

6. Precautions When Designing Systems of M-NET

6.1 Power Supply of the M-NET Transmission Cable

On an M-NET system, the remote controller or central controller operate on power received from the transmission cable. Accordingly, there is need to provide power to the transmission cable.

There are two systems for supplying power. The central system is supplied by a power supply unit. The indoor unit system is supplied by a outdoor unit. The Lossnay and the Lossnay remote controller can be connected to either system.

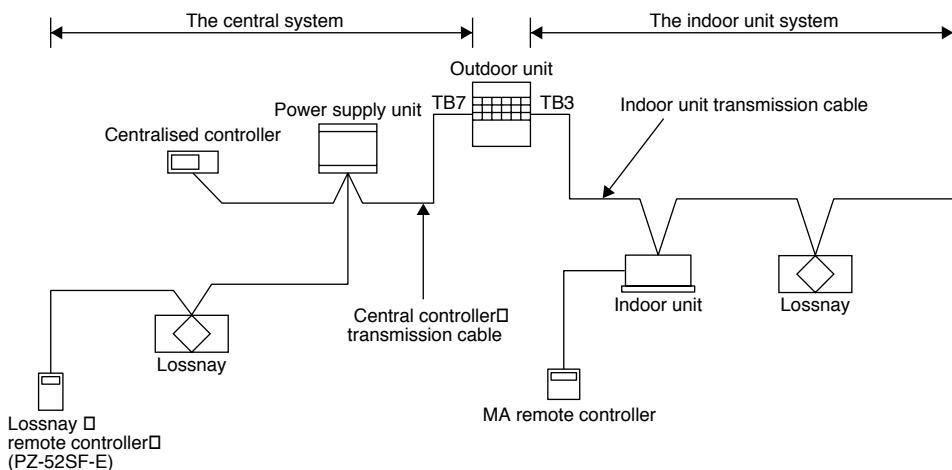


6.2 Restrictions When the Lossnay Units are Connected to the Central Controller M-NET Transmission Cable.

Due to the limited capacity of the power supply unit, the number of Lossnay remote controllers is restricted when the Lossnay M-NET remote controllers and Lossnay units are connected to the central controller transmission cable.

This does not apply to Lossnay units that do not receive power from the central controller transmission cable.

Number of centralised controllers	Non	1 unit	2 units	3 units	4 units
Number of Lossnay M-NET remote controllers that can be connected.	Power supply unit PAC-SC34KUA	Max. 30 units	Max. 26 units	Max. 22 units	Max. 18 units
	Transmission Booster PAC-SF46EPA	Max. 50 units	Max. 46 units	Max. 42 units	Max. 38 units

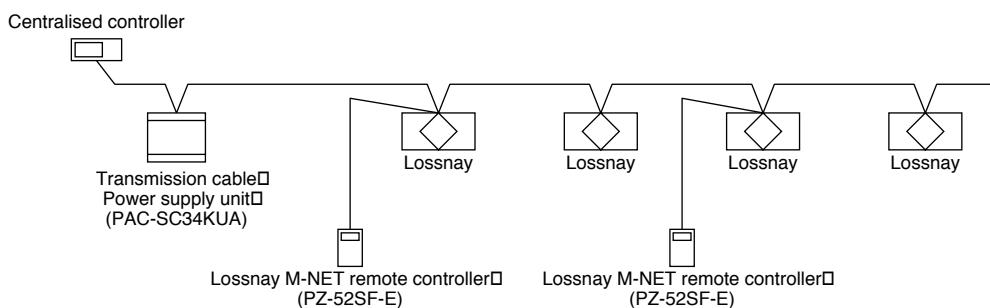


- In the case that a greater number of Lossnay remote controllers than that shown above is connected due to the use of a power supply unit (PAC-SC34KUA), a transmission booster (PAC-SF46EPA) becomes necessary.
- Transmission Booster (PAC-SF46EPA) can be used without a power supply unit (PAC-SC34KUA) if TB2 (OUTDOOR UNIT SIDE) is opened, and the M-NET transmission cable is connected to TB3 (ADDITIONAL INDOOR UNIT SIDE).

6.3 Wiring Example

Example

<Centralised controller and Lossnay units>

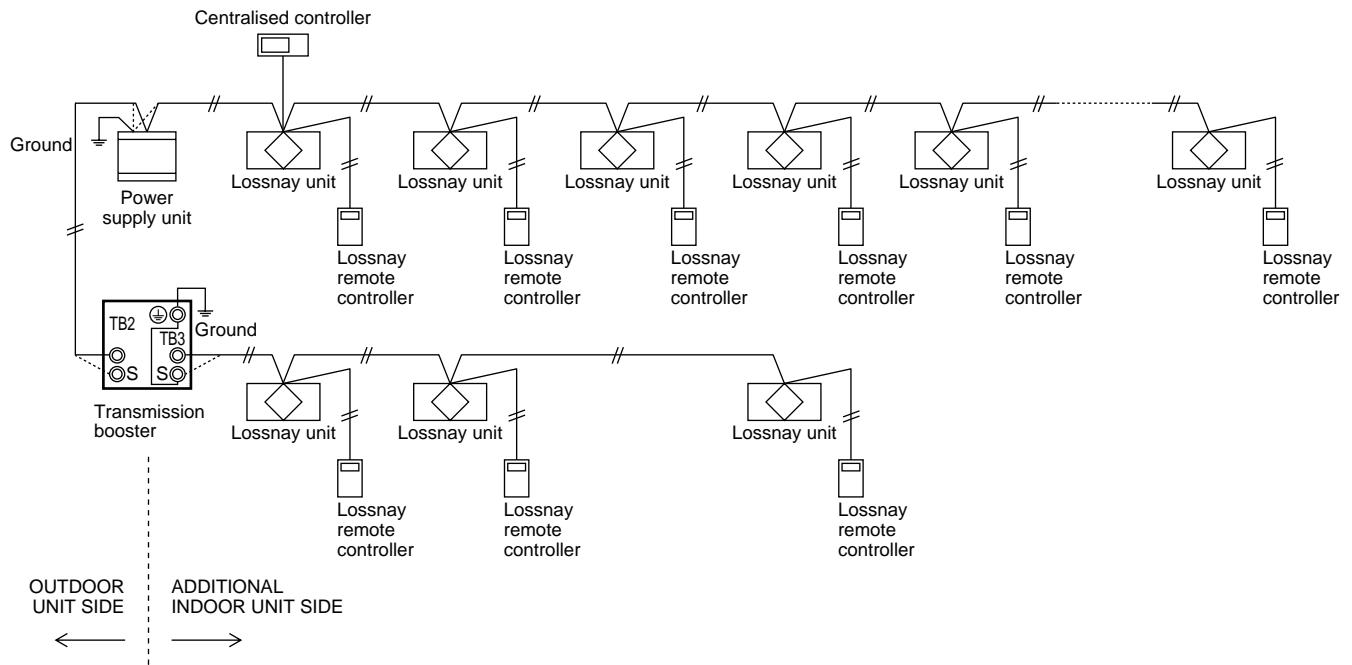


Note:

- This unit cannot be used to extend the transmission cable.

6.4 Power Supply to the Indoor Unit Transmission Cable.

In principle, the number of indoor units ME remote controllers and Lossnay M-NET remote controllers that can be connected to one outdoor unit will depend on the type of outdoor unit. The following are the general guidelines when connecting multiple indoor units and Lossnay units to an outdoor unit.



Indoor units + Remote controllers (Simple remote controllers) + Lossnay M-NET remote controllers ≤ 35
* MA remote controllers and Lossnay unit's are Not counted.

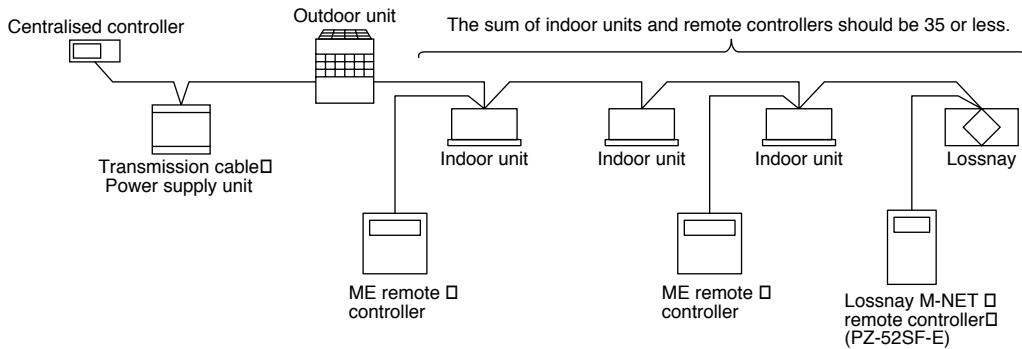

7. Cable Installation of the M-NET

7.1 Precautions When Installing Wiring.

1. When routing transmission cable outside of the unit, position it 5 cm or more away from the power supply so that it will not pick up electrical noise. (Never use multi-core cable or place the transmission cable in the same conduit as the power supply cable.)
2. Never connect the power cable to the terminal block for the transmission cable. This erroneous connection will burn out the circuit board.
3. Always use 2-core cable for the transmission cable. Routing this transmission cable with the transmission cable from another system on the same multi-core cable will result in erroneous sending and receiving of signals which will cause misoperation.

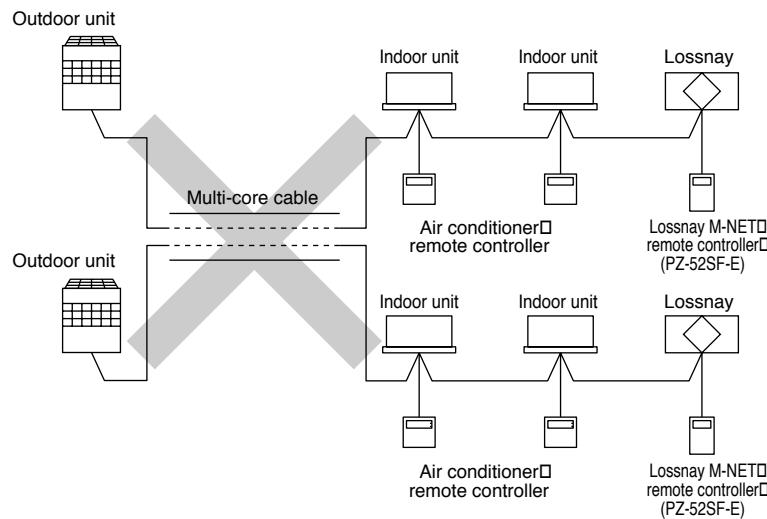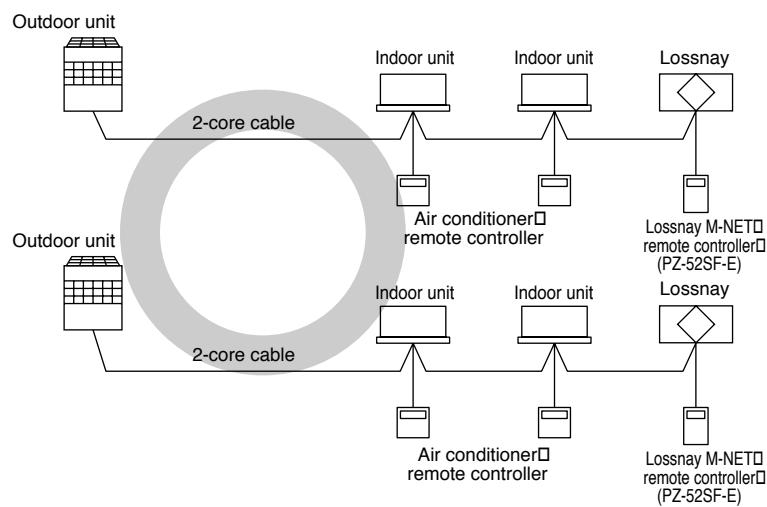

7.2 Electrical Wiring

Types of control cables

1. Wiring the M-NET transmission cables

- Types of transmission cables
Design cable in accordance with the following <Table 1>.
- Cross-sectional area
1.25 mm² to 2.00 mm²

<Table 1>

System configuration	Single-refrigerant system		Multi-refrigerant system
Transmission cable length	Less than 120 m	More than 120 m	Regardless of length
Type of facility (Electrical noise potential)	Private residence or facility with no electrical noise.	Building free of electrical noise caused by inverters, electrical generators and/or high-frequency equipment (such as hospitals and radio stations.)	All facilities.
Type of facility (Electrical noise potential)	VCTF, VCTFK, CVV, CVS, VVR, VVF, or shielded cable such as CVVS or CPEVS		Shielded cable, such as CVVS or CPEVS.

2. Lossnay M-NET remote controller (PZ-52SF-E)


	Lossnay M-NET remote controller
Type of cables	Non-shielded cable up to 10 m in length sheathed PVC (2-core) 0.75 mm ² to 1.25 mm ² or equivalent. (The same specifications as table 1 for more than 10 m.)
Length	Add any portion exceeding 10 m up to the longest permissible transmission cable length of 200 m. (Shielded sections shall have a cross-sectional area of 1.25 mm ² to 2.00 mm ² .)

7.3 Length of Control Cable

- Maximum power supply cable length. ($L_1 + L_2, L_1 + L_3, L_1 + L_4$): The longest length of the cable from the power supply unit or the indoor unit to the farthest terminal shall be less than 200 m.
- Maximum distance between ends ($L_2 + L_3, L_2 + L_4, L_3 + L_4$): The length of cable between ends shall be less than 500 m.
- Remote controller cable length (ℓ): The distance between the remote controller and the terminal connected to it shall be 10 m or less.

System Example

When using Lossnay remote controller or ME remote controller.

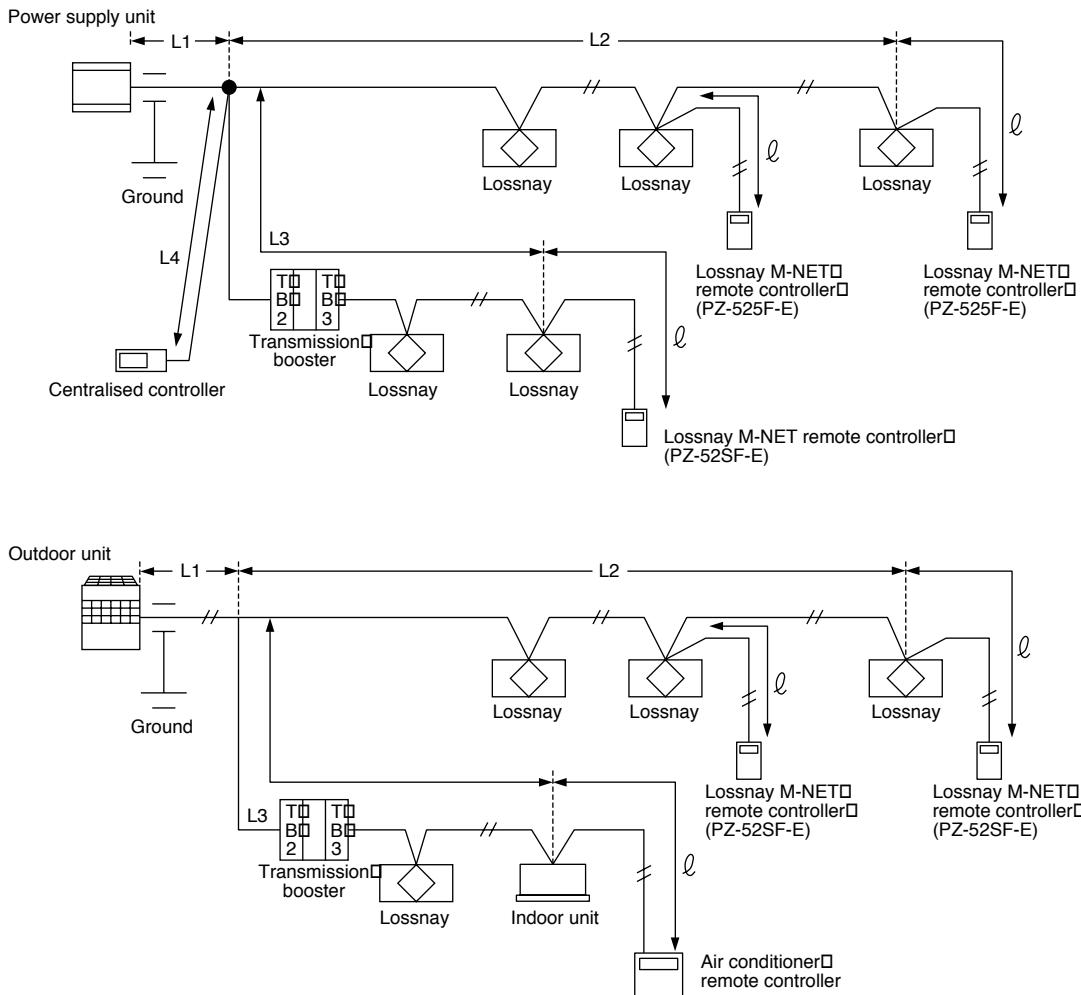

Please:

- Always install the ground cable for the transmission cables in the following way. Route the central control system through the power supply unit. Route the indoor unit system through the ground terminal on the outdoor unit.
- If the cable length (ℓ) for the remote controller exceeds 10 m, use 0.75 mm^2 , change the section exceeding 10 m to the cable having a cross-sectional area of 1.25 mm^2 to 2.0 mm^2 . Add the exceeding section within the "maximum power supply cable length" restriction of 200 m and the "maximum distance between ends" restriction of 500 m.
- If the cable exceeds the maximum cable length and overall extended length, voltage will drop and cause malfunctioning.

8. System Designs of M-NET

8.1 Address Definitions


An address is a unique number used to identify each air conditioner and controller.

Device	Description	Address definition range
Indoor unit	Set to specify in order each refrigerant system.	001 to 050
Lossnay	Set to specify in order each refrigerant system.	001 to 050 (Note)
Outdoor unit	Minimum address of the indoor unit within the same refrigerant system. (+50)	051 to 100
Branch controllers	Minimum address of an outdoor unit. (+1)	052 to 100
Local remote controller (master)	Minimum address of an indoor unit or a Lossnay unit within the same group. (+100)	101 to 150
Local remote controller (secondary)	Minimum address of the indoor unit or a Lossnay unit inside the same group. (+150)	151 to 200
Central controller	When the K-control unit is in control. (000)	0, 201 to 250
K-transmission converter	Minimum address of the K-control type indoor unit. (+200) This cannot overlap with a system controller.	201 to 250

Note:

- There is no need to set the address unless the Lossnay is connected to the M-NET transmission cable.

System configuration example

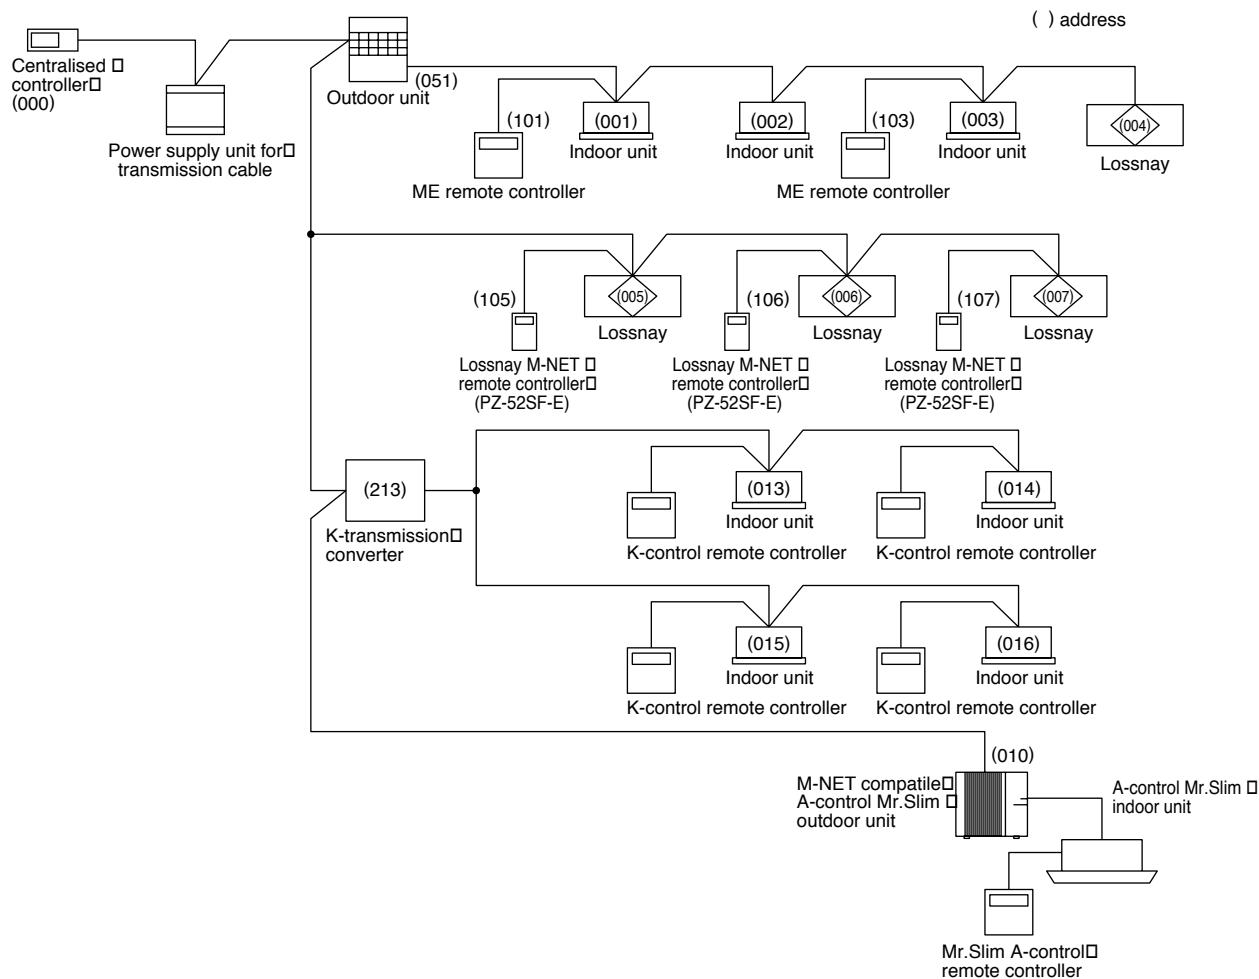

8.2 Precautions When Performing Group Settings (when not interlocked with City Multi indoor unit)

Precautions	
1	The maximum number of Lossnay units in one group is 16. (Refer to page 121.)
2	When two remote controllers are used within the same group, set one remote controller as the master (address 101 to 150) and the other as the slave (address 151 to 200). (Refer to page 120.)
3	Group settings: ① Perform group settings at the centralised controller MJ-103MTRA when being used. If 2 or more centralised controllers are being used in combination, perform the group settings at the host one. (Refer to page 183.) ② If a centralised controller is not being used, use the Lossnay remote controller to perform the settings. (Refer to page 179.)
4	Do not set air conditioners and Lossnay units in the same group. If these units are set to the same group, the indoor unit or Lossnay will not operate.
5	Turn on the power source for the Lossnay when performing group settings.
6	If the group settings are performed by MELANS, be sure to also set the address for the Lossnay remote controllers to the group setting. If the remote controller address is not registered, "H0" remains displayed and the system does not start up.
7	No more than three Lossnay remote controllers can be set to the same group in a system using a central controller.

8.3 Precautions When Performing Interlock Settings (when interlocked with City Multi indoor unit)

Precautions	
1	The maximum number of indoor units that can be interlocked is 16. (Refer to page 123.)
2	1 Lossnay can be interlocked with an indoor unit. (Refer to page 123.)
3	Interlock settings: ① When a centralised controller (MJ-103 MTRA) is being used: if 2 or more centralised controllers are being used in combination, perform the group settings at the host one. (Refer to page 183.) ② When MA or ME remote controllers are being used except above ①: Use the MA or ME remote controller for the interlock settings. (Interlock settings cannot be performed with the MJ-180A.) (If ① or ② do not apply, interlock settings cannot be made.)
4	Do not register the Lossnay units in a group to be interlocked. Lossnay units that have been set to interlocked operation within the same group will not operate.
5	When performing the settings using a MA or ME remote controller, always set for interlocked operation to the smallest address indoor unit in a group. If the setting is not made in this manner, the message "This function is not available" will appear when operating the ventilation button and interlocking with the Lossnay unit will not be possible.
6	Turn on the power source for the Lossnay when performing interlock settings.

9. Automatic Ventilation Switching

9.1 Effect of Automatic Ventilation Mode

The automatic damper mode automatically provides the correct ventilation for the conditions in the room. It eliminates the need for troublesome switch operations when setting the Lossnay ventilator to "By-pass" ventilation. The following shows the effect "By-pass" ventilation will have under various conditions.

1. Reduces cooling load

If the air outside is cooler than the air inside the building during the cooling season (such as early morning or at night), "By-pass" ventilation will draw in the cooler outside air and reduce the cooling load on the system.

2. Cooling using outdoor air

During cooler seasons (such as between spring and summer or between summer and fall), if the people in a room cause the temperature of the room to rise, "By-pass" ventilation draw in the cool outside air and use it as is to cool the room.

3. Night purge

"By-pass" ventilation can be used to release hot air from inside the building that has accumulated in buildings a business district during the hot summer season.

4. Office equipment room cooling

During cold season, outdoor air can be drawn in and used as is to cool rooms where the temperature has risen due to the use of office equipment.

(Only when interlocked with City Multi and Mr. Slim indoor unit)


9.2 Switching between Heat Recovery and By-pass in the Automatic Ventilation Mode

Control of the automatic ventilation mode is performed according to the table below and automatic algorithm temperature maps. Note that operation is fixed at heat recovery when the fan is stopped or when there is an abnormality with the thermistor.


Conditions	Temperature Map
When in automatic ventilation mode when not interlocked with City Multi or Mr. Slim indoor unit. (Including when interlocked by external control input.)	According to (a).
When the outside temperature has been 28°C or higher in the last 24 hours.	According to (b).
Interlocked with City Multi indoor unit	Fan mode operation for all interlocked indoor units.
	Heating mode for one or more interlocked indoor units.
	When indoor units are stopped and only Lossnay unit is operated.
	Conditions other than the above.
Interlocked with Mr. Slim indoor unit	Mr. Slim in fan mode.
	Mr. Slim in heating mode.
	Mr. Slim in ventilation mode.
	Conditions other than the above.

Note:


- There is a maximum delay of 30 seconds during damper switching.
- Even if "By-pass" is selected by the Lossnay remote controller, Lossnay ventilation will be performed if the outdoor temperature is 8°C or less. This is to prevent condensation.
- When multiple City Multi indoor units are connected in a group, the average set temperature for each indoor unit will be the target temperature. The set temperature is the target temperature for the Mr. Slim indoor unit.
- In the case of (b) when the indoor unit is stopped for the winter, cooling with outdoor air is performed because equipment in the room may cause a rise in indoor temperature.

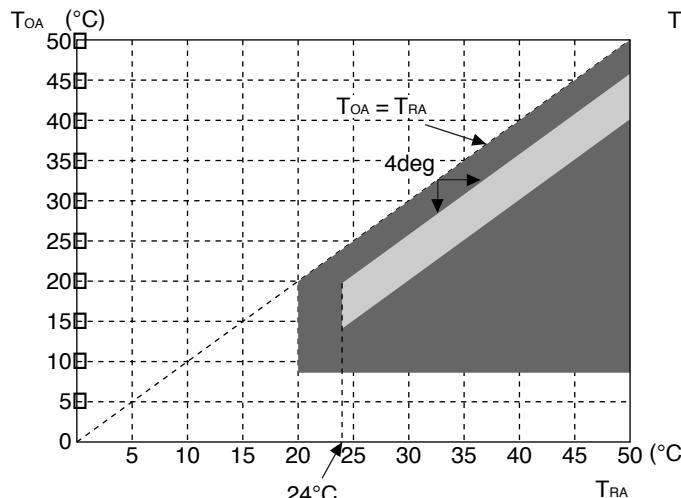


(a) When there is no target temperature

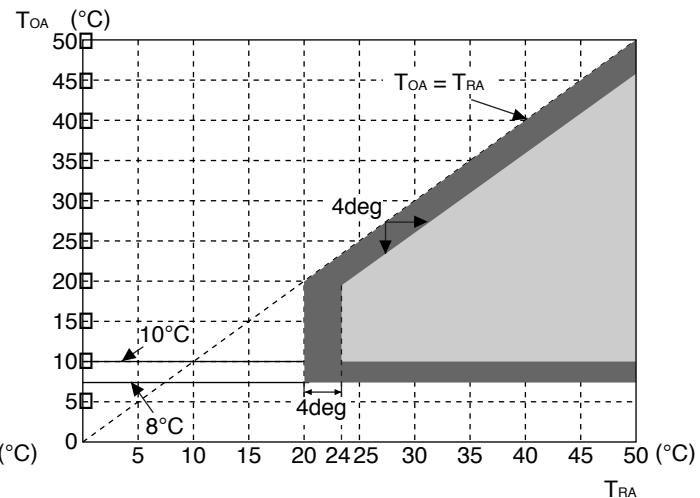

(b) When there is no target temperature and the outside temperature has been 28°C or higher in the last 24 hours.

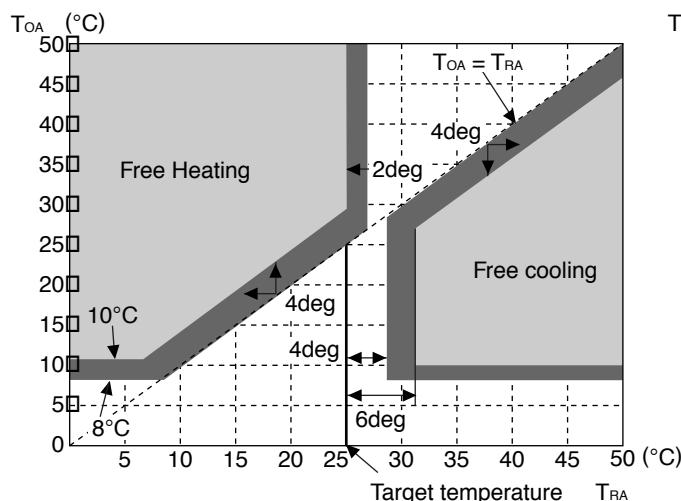

(c) When there is a target temperature (Heating)

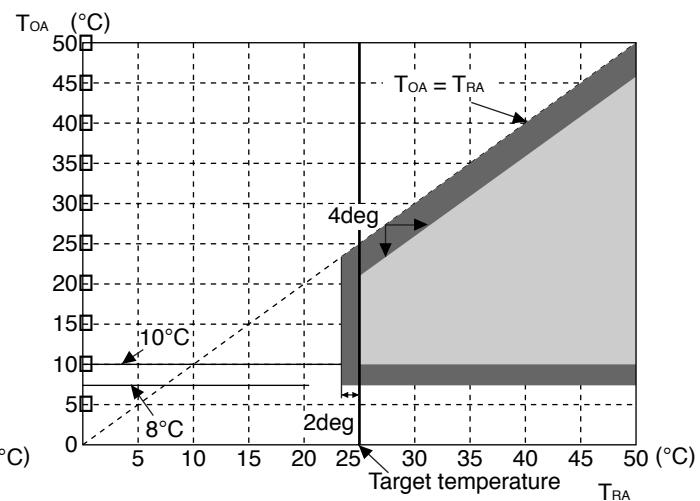

(d) When there is a target temperature (Cooling)
 □ Or the outside temperature has been 28°C or higher in the last 24 hours when interlocked with Mr.Slim and Mr.Slim in ventilation mode.

Lossnay ventilation

By-pass ventilation

Comfortzone (Maintains the condition held prior to entering the range.)

T_{OA} : Outdoor air temperature

T_{RA} : Indoor air temperature



The indoor air and outdoor air temperature are detected by the two temperature sensors (thermistors) built into the main Lossnay unit.

10. Cold Weather Area Operation Specifications

When the OA temperature falls below -10°C during operation, the SA fan will change to intermittent operation, off for 10 minutes, on for 60 minutes. However, intermittent operation can not take place for 60 minutes after starting operation.

During cold weather, the pre-heat unit is required if the OA temperature falls below -15°C . Set up the pre-heat unit as seen in the system example on the next page.

CITY MULTI + LOSSNAY (LGH) + PRE-HEAT UNIT INSTALLATION

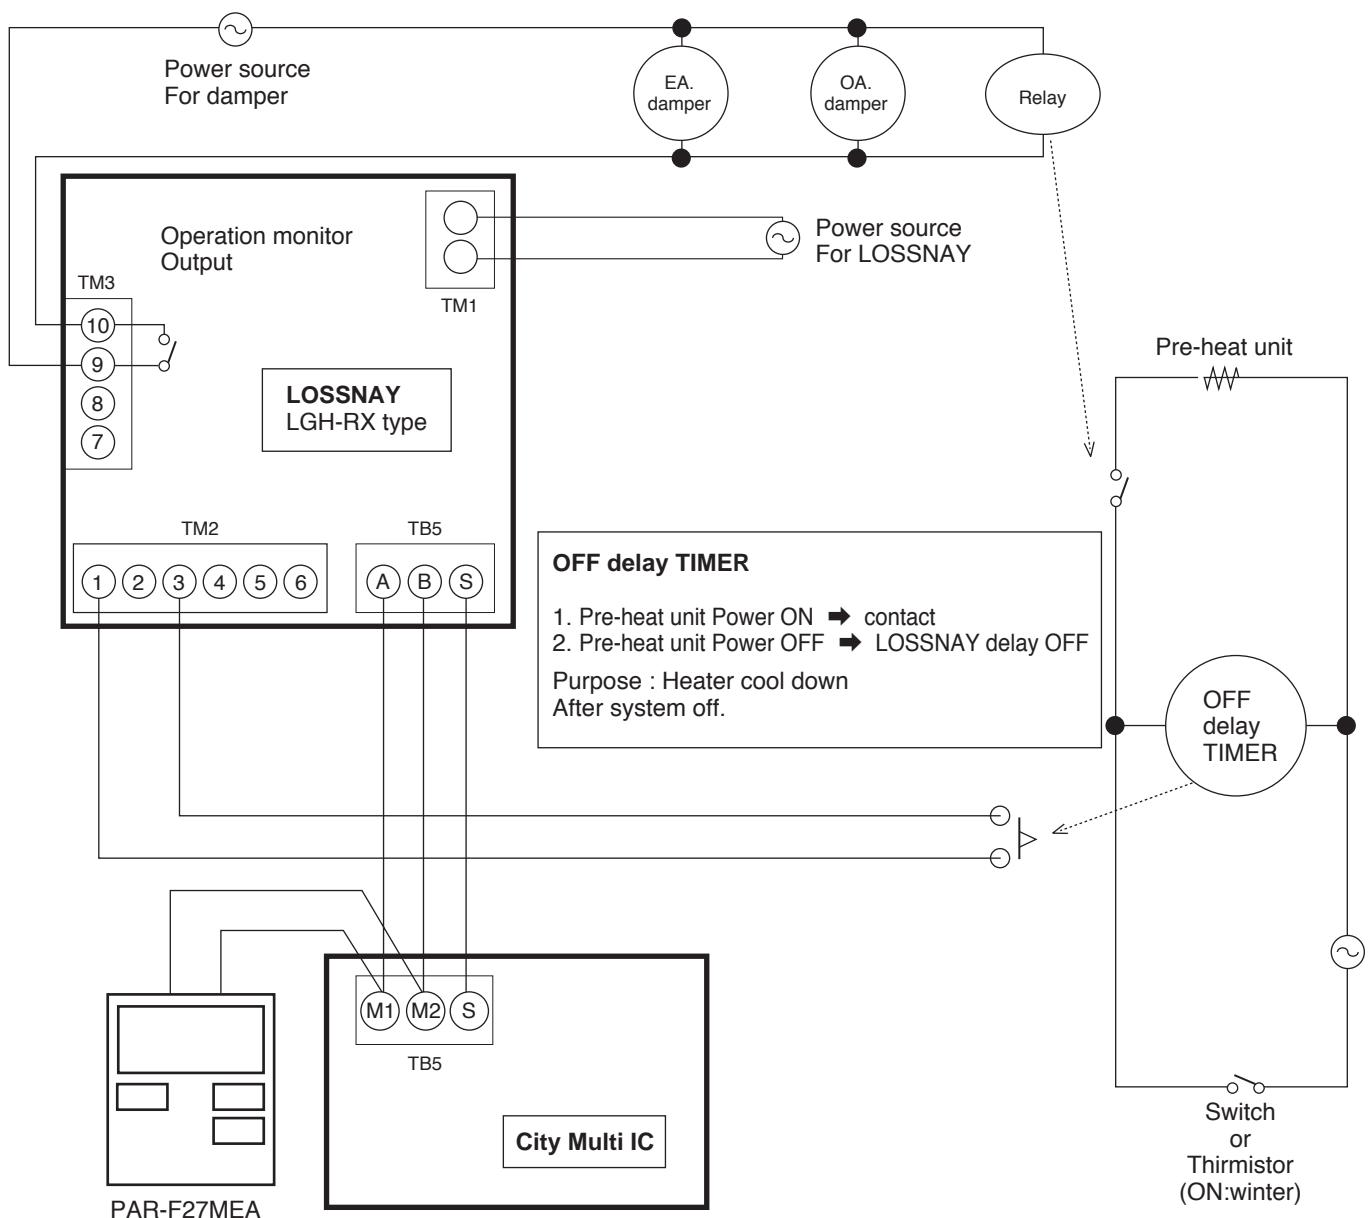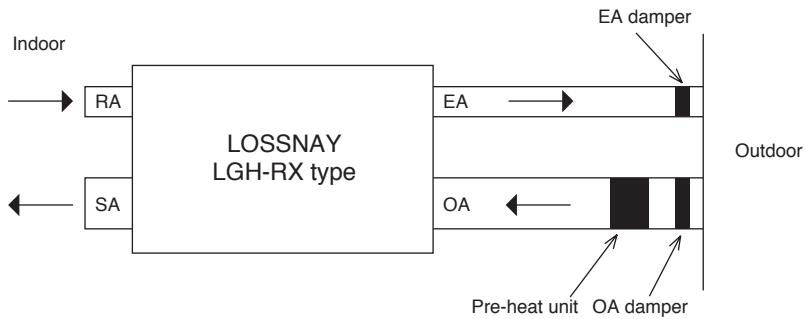

! CAUTION:

- All installation work should be carried out in accordance with local regulation.
 - Select and operate Pre-heat unit that Lossnay supply intake air temperature becomes between -10 to 40 degree C.
 - Pre-heat unit must be installed from Lossnay unit as far as possible, because of fire prevention.

11. Troubleshooting

11.1 Service Flow


Confirmation items

- ① Condition of trouble – remote controller display, etc.
- ② Frequency of trouble – date of start of operation and occurrence
- ③ Occurrence timing
- ④ Existence of drawings, equipment (including controllers and equipment sold separately), cables, wiring, and settings.

Applicable models

Lossnay
LGH-50 to 200RX types

Remote controller
PZ-41SLB-E
PZ-52SF-E

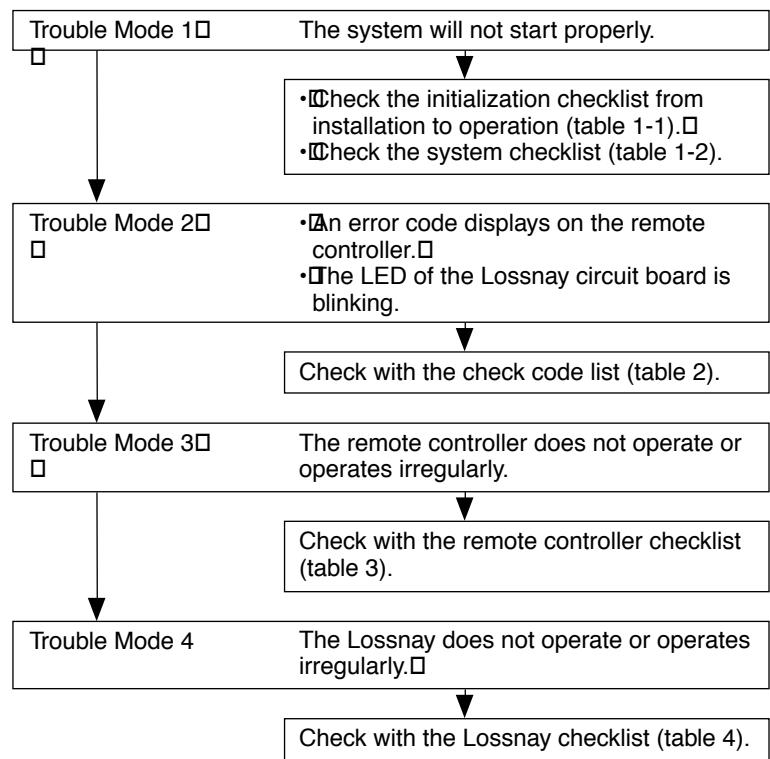

Precautions when diagnosing malfunctions

- When removing a transistor or printed circuit board, make sure the breaker is thrown.
- When removing the circuit board, always hold it at both ends and remove carefully so as not to apply force to the surface mounted parts.
- When removing the circuit board, be careful of the metal edges on the board.
- When removing or inserting the connectors for the circuit board, hold the entire housing section. Never pull on the lead wires.
- When servicing, be sure to recreate the malfunction 2 to 3 times before starting repairs.
- If a malfunction of the printed circuit board is suspected, check for disconnected wires in the print pattern, burnt parts or discoloration.
- If the printed circuit board is replaced, make sure that the switch settings on the new board are the same as the old board.

11.1.1 Error List

Classification	Error item	Measures taken by Lossnay	Remote controller display error code	LED 1 (green) Display (No. of blinks)	LED 2 (red) Display (No. of blinks)	Error monitor output	Cancellation measures			
							Reset power supply	Change address	Stop ↓ Start	Error delete
Unit error	Fan motor operation device error	• Cancellation	4000/4116 *1)	2 times	—	○	○	○	—	○
	Damper motor error	• Cancel damper operation • Other controls as normal	3602	3 times	—	○	○	○	○	—
	OA temperature sensor error	• Lossnay ventilation fixed (for "Auto" modes) • Other controls as normal	5101	4 times	—	○	○	○	—	○
	RA temperature sensor error	• Lossnay ventilation fixed (for "Auto" modes) • Other controls as normal	5102	5 times	—	○	○	○	—	○
	Test operation	• Fan: High speed • Lossnay ventilation fixed	0900	—	—	—	—	—	—	—
Communication error	Dual address	—	6600	—	6 times	○	○	○	○	—
	No ACK	—	6607	—	—	—	○	○	—	○
	No response	—	6608	—	—	—	○	○	—	○
	Controller communication error	• Cancellation	6607/6608	—	8 times	○	○	○	—	○
	Communication circuit error	—	6602/6603/ 6604	—	1 - 5 times	○	○	○	—	○
	Polarity not set	—	—	—	LED 6 turn off	—	○	○	—	○
	PZ-41SLB-E communication error	• Cancellation	6608	9 times	—	○	○	—	—	○

*1) "4000" is displayed on PZ-41SLB-E only.

11.2 Items to Check

Trouble Mode 1: The system will not start properly.

Initialization checklist from installation to operation (Table 1-1)

After checking the system, check the points below up to operation.

No.	Checkpoint
1	Do the capacity of the main power supply on/off unit and wiring span meet specification?
2	Is the specified power supplied to the Lossnay power terminal (TM1)? (refer to page 161)
3	Is the wiring length of the transmission cable within specifications? When using PZ-41SLB-E: Overall extension within 500 m When using M-NET: Maximum power supply length within 200 m, maximum distance between ends within 500 m (refer to page 139)
4	Does the transmission cable meet regulations? (Type, diameter) (refer to page 163)
5	Is the transmission cable wired at least 5 cm away from the power supply cable?
6	Are multiple transmission or signal cables wired to the same power cable duct?
7	Are multiple transmission cables wired with multi core cables?
8	Is the transmission cable connected to the terminal unit? (PZ-41SLB-E to TM2 ⑤, ⑥; M-NET to TB5 Ⓐ, Ⓑ)
9	Is the transmission cable securely connected to the Lossnay terminal unit? (refer to page 163, 165)
10	When not using M-NET If using 1 Lossnay unit, is the Main/Sub change switch (SW1) on the Lossnay circuit board set to "Main"? If using 2 or more Lossnay units, is the Main/Sub switch set to "Main" on only one unit, and the other units are set to "Sub"? (refer to page 164)
11	When using M-NET Is the address switch on the Lossnay circuit board (SA1, SA2) set to the correct number? (refer to page 166)
12	When using external control input Do the specifications of the external signal match specifications of signals that can be input to the Lossnay? (refer to page 163)
13	When the external input signal is a pulse signal Is the pulse input switch (SW2-2) on the Lossnay circuit board set to ON? (refer to page 164)
14	When the external signal is 12V DC, 24V DC, or Mr. Slim (A-control) signal Is it connected to ①, ② on the Lossnay external control input terminal unit (TM2)?
15	When the external signal is an uncharged a-contact signal Is it connected to ①, ③ on the Lossnay external control input terminal unit (TM2)?
16	When M-NET is not being used Is the external input signal connected to the Lossnay set to "Main"?
17	Is the signal cable length within wiring specifications? 12V DC, 24V DC signal: Within limitation of the external device Uncharged a-contact signal: Within 500 m Mr. Slim (A-control) signal: Within 500 m
18	Is the signal cable wired at least 5 cm away from the power supply cable?
19	Is the output capacity of the Lossnay operation monitor/error monitor within specifications? Operation monitor output: Maximum 240V AC/24V DC 2A, minimum 220V AC/5V DC 100 mA Error monitor output: Maximum 240V AC/24V DC 1A, minimum 220V AC/5V DC 100 mA
20	Are the power supply cable, transmission cable, signal cable, etc., securely connected to the proper terminals?
21	Are the settings for the Mai/Sub switch, address switch, and function select switch correct?

System checklist

(1) Use this checklist when using a PZ-41SLB-E or an external device (Table 1-2-1)

No.	Symptom	Cause	Corrective action						
1	Remote controller display does not appear.	<ul style="list-style-type: none"> <input type="radio"/> Power is not supplied to the Lossnay, or power outside specifications is connected. <input type="radio"/> When using only 1 Lossnay, the Main/Sub switch (SW1) on the Lossnay circuit board is set to "Sub." <input type="radio"/> The overall wiring length of the transmission cable is longer than specifications (longer than 500 m). <input type="radio"/> The remote controller is connected to TB5 (M-NET transmission cable). <input type="radio"/> PZ-52SF-E is connected to the Lossnay local remote controller. 	<ul style="list-style-type: none"> <input type="radio"/> Check the power supply to the Lossnay. <input type="radio"/> Set the Main/Sub (SW1) switch to "Main." (refer to page 164) <input type="radio"/> Check the length of the transmission cable wiring. <input type="radio"/> Connect the transmission cable to TM2 ⑤,⑥. (refer to page 163) <input type="radio"/> Change to the PZ-41SLB-E remote controller. 						
2	Remote controller does not operate (Communication error display)	<ul style="list-style-type: none"> <input type="radio"/> When using multiple Lossnay units, the Main/Sub switch (SW1) on the Lossnay circuit board of the second or following unit is set to "Main." <input type="radio"/> The overall wiring length of the transmission cable is longer than specifications (longer than 500 m). <input type="radio"/> Multiple transmission cables are wired with multi core cables. 	<ul style="list-style-type: none"> <input type="radio"/> Set the Main/Sub switch (SW1) of the second and following Lossnay units to "Sub." (refer to page 164) <input type="radio"/> Check the length of the transmission cable wiring. <input type="radio"/> For the applied transmission cable, wire the transmission cables away from the other transmission cable. 						
3	Interlocked operation with external device does not occur.	<ul style="list-style-type: none"> <input type="radio"/> The type of external signal does not match the connected terminal unit (charged, uncharged, Mr. Slim signal). <input type="radio"/> The type of external signal does not match the pulse input switch (SW2-2) setting (level signal, pulse signal). <input type="radio"/> The external device signal is not being input. <input type="radio"/> The external device and signal cable wiring is longer than specifications. <div style="margin-left: 20px; margin-top: 10px;"> <table border="0" style="width: 100%;"> <tr> <td style="vertical-align: top; width: 30%;">12V DC, 24V DC:</td> <td style="vertical-align: top;">Longer than limitations of external device</td> </tr> <tr> <td style="vertical-align: top;">Uncharged a-contact:</td> <td style="vertical-align: top;">Longer than 500 m</td> </tr> <tr> <td style="vertical-align: top;">Mr. Slim signal:</td> <td style="vertical-align: top;">Longer than 500 m</td> </tr> </table> </div> <input type="radio"/> The Delayed Start mode is set at the remote controller (PZ-41SLB-E). <input type="radio"/> The ON Interlocked Operation mode or OFF Interlocked Operation mode is set at the remote controller (PZ-41SLB-E). <input type="radio"/> When using multiple Lossnay units, the external control input signal is connected to a unit with the "Sub" setting made. 	12V DC, 24V DC:	Longer than limitations of external device	Uncharged a-contact:	Longer than 500 m	Mr. Slim signal:	Longer than 500 m	<ul style="list-style-type: none"> <input type="radio"/> Check the connection to the external control input terminal (TM2) for the type of external signal. (refer to page 163, 164) <input type="radio"/> Check the type of external signal and the setting of the pulse input switch (SW2-2). (refer to page 164) <input type="radio"/> Check the external device. <input type="radio"/> Check the length of the signal cable wiring. <input type="radio"/> Check the Delayed Start mode setting at the remote controller (PZ-41SLB-E). (refer to page 171) <input type="radio"/> Check the Interlocked Operation mode setting at the remote controller (PZ-41SLB-E). (refer to page 171) <input type="radio"/> Connect the external control input signal to the Lossnay unit set to "Main."
12V DC, 24V DC:	Longer than limitations of external device								
Uncharged a-contact:	Longer than 500 m								
Mr. Slim signal:	Longer than 500 m								

(2) System checklist when using the M-NET (Table 1-2-2)

No.	Symptom	Cause	Corrective action
1	Does not interlock with City Multi. (The Lossnay cannot be operated by the ventilation switch on the ME remote controller, MA remote controller, or MELANS.)	<ul style="list-style-type: none"> <input type="radio"/> The Lossnay is not set for interlocked operation, or is set for interlocked operation at the wrong address. <input type="radio"/> The length of the M-NET transmission cable wiring from the outdoor unit or the system's overall wiring length is longer than specifications. (Longer than 200 m from the outdoor unit, longer than 500 m between ends.) <input type="radio"/> PZ-41LSB-E is connected to the Lossnay local remote controller. 	<ul style="list-style-type: none"> <input type="radio"/> Check the Lossnay address, and set for an address corresponding to interlocked operation. (refer to "15. Appendix") <input type="radio"/> Check the length of the transmission cable wiring. <input type="radio"/> Change to the PZ-52SF-E remote controller (PZ-41SLB-E can not be used with the M-NET).
2	Cannot operate using the MELANS or Lossnay remote controller.	<ul style="list-style-type: none"> <input type="radio"/> The address that has been set for the group in MELANS and the address for the Lossnay are different. <input type="radio"/> The length of the M-NET transmission cable wiring from the power supply unit or the system's overall wiring length is longer than specifications. (Longer than 200 m from the power supply unit, longer than 500 m between ends.) <input type="radio"/> PZ-41LSB-E is connected to the Lossnay local remote controller. 	<ul style="list-style-type: none"> <input type="radio"/> Check the registered address in MELANS. (refer to "15. Appendix") <input type="radio"/> Check the length of the transmission cable wiring. <input type="radio"/> Change to the PZ-52SF-E remote controller (PZ-41SLB-E can not be used with a M-NET system).
3	A unit should operate independently by MELANS or the Lossnay remote controller, but it interlocks with another City Multi unit.	<ul style="list-style-type: none"> <input type="radio"/> It has been set for interlocked operation with the City Multi unit. 	<ul style="list-style-type: none"> <input type="radio"/> Cancel the interlocked operation setting. (refer to "15. Appendix")
4	Cannot perform group settings for the Lossnay using MELANS, ME remote controller, or MA remote controller. (The remote controller shows "88" at the time of registration.)	<ul style="list-style-type: none"> <input type="radio"/> Power is not supplied to the Lossnay, or power outside specifications is connected. <input type="radio"/> The M-NET transmission cable is connected to TM2 ⑤,⑥. <input type="radio"/> The transmission cable is not properly connected to the MELANS or the City Multi. <input type="radio"/> The length of the transmission cable wiring is longer than specifications (longer than maximum 200 m from the power supply unit, longer than 500 m between ends.) 	<ul style="list-style-type: none"> <input type="radio"/> Check the power for the Lossnay and perform the registration again. (refer to "15. Appendix") <input type="radio"/> Connect the transmission cable to TB5 Ⓐ, Ⓑ. (refer to page 165) <input type="radio"/> Check the transmission cable connection. (refer to page 165) <input type="radio"/> Check the length of the transmission cable wiring.
5	When power is supplied to the system, the Lossnay remote controller continues to display "HO" and does not start. (Group registration information disappears.)	<ul style="list-style-type: none"> <input type="radio"/> The Group setting was made on a Lossnay remote controller in a system connected to a centralised controller MELANS. <input type="radio"/> The length of the transmission cable wiring is longer than specifications (longer than maximum 200 m from the power supply unit, longer than 500 m between ends.) 	<ul style="list-style-type: none"> <input type="radio"/> In a system connected to MELANS, make the group setting with the MELANS (Do not make the group setting with the Lossnay remote controller). (refer to "15. Appendix" or page 179) <input type="radio"/> Check the length of the transmission cable wiring.
6	When power is supplied to the system, the remote control display goes blank and the system does not start.	<ul style="list-style-type: none"> <input type="radio"/> Over the number of units that can be controlled with the Lossnay remote controller. <input type="radio"/> The length of the transmission cable wiring is longer than specifications (longer than maximum 200 m from the power supply unit, longer than 500 m between ends.) 	<ul style="list-style-type: none"> <input type="radio"/> Check remote control unit number limitations when using a power supply unit (refer to page 134). <input type="radio"/> Check the length of the transmission cable wiring.


No.	Symptom	Cause	Corrective action
7	The power display “●” does not display when power is supplied to the system.	① When using City Multi and Lossnay interlocked system (connected to the indoor unit system) ○ The transmission cable is not correctly connected to the Lossnay remote controller. ○ The power is not turned on for the outdoor unit. ○ The length of wiring for the outdoor unit's M-NET transmission cable is longer than specification (longer than 200 m).	○ Check the transmission cable connection. (refer to page 177) ○ Check the power to the outdoor unit. ○ Check the length of the transmission cable wiring.
		② When using a Lossnay individual system or City Multi and Lossnay interlocked system connected to the central system. ○ The power supply unit is not connected to the transmission cable. ○ The power to the power supply unit is not turned on. ○ The length of wiring of the M-NET transmission cable from the power supply unit is longer than specification (longer than 200 m).	○ Connect to the power supply unit. (refer to page 166) ○ Check the power to the power supply unit. ○ Check the length of the transmission cable wiring.
8	The “HO” on the remote controller continues to flash when the power is supplied to the system.	○ Lossnay is Not supplied with specified power. ○ The address for the Lossnay remote controller does not have a group setting at the MELANS. ○ The M-NET transmission cable is connected to TM2 ⑤,⑥. ○ For a Lossnay individual system with no MELANS, Lossnay registration has not been performed by the Lossnay remote controller.	○ Check the power to the Lossnay. ○ Check the Lossnay remote controller address registration with the MELANS (“HO displays for 3 – 10 minute when electricity is supplied to the system). (refer to “15. Appendix”) ○ Connect the transmission cable to TB5 Ⓐ, Ⓑ. (refer to page 165) ○ Check the Lossnay registration with the Lossnay remote controller. (refer to “15. Appendix”)
9	“LC 6608” displays on the remote controller and the Lossnay does not operate.	○ The remote controller is PZ-41LSB-E and connected to the TB5 Ⓐ, Ⓑ.	○ Change to the PZ-52SF-E remote controller (PZ-41SLB-E can not be used with a M-NET system).
10	The operation specified by the centralised controller differs from the operation of the Lossnay.	○ The remote controller is PZ-41SLB-E and connected to the TM2 ⑤,⑥.	○ Change to the PZ-52SF-E remote controller (PZ-41SLB-E can not be used with a M-NET system).

Trouble Mode 2

● An error code displays on the remote controller.

● The LED of the Lossnay circuit board is blinking.

An error code displayed on the remote controller (PZ-41SLB-E, PZ-52SF-E) or the M-NET controller and blinking or illumination of LED1 (green) or LED2 (red) on the circuit board shows the type of error. The LED blink interval is 0.25 seconds for both on and off. The display duration is approximately 5 seconds.

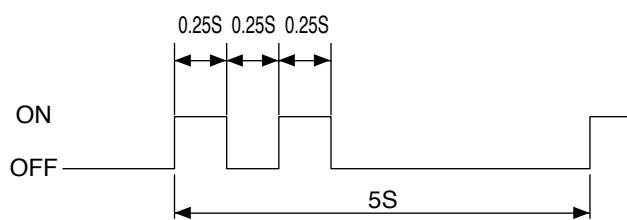

Error display example: Fan motor operation device error

(1) Checklist of error codes displayed on the PZ-41SLB and LED displays (Table 2-1)

Error code	LED1 (green)	LED 2 (red)	Symptom	Cause	Corrective action
LC 6608	—	—	Lossnay communication error	<ul style="list-style-type: none"> <input type="radio"/> When using multiple Lossnay units, the main/sub setting has not been made for the second unit and following units. <input type="radio"/> Multiple transmission cables have been wired using multi core wires. <input type="radio"/> Transmission cable and power cable are too close. <input type="radio"/> Transmission cable is not securely connected. <input type="radio"/> The length of wiring of the transmission cable is longer than specification (longer than 500 m). 	<ul style="list-style-type: none"> <input type="radio"/> Turn off the main power supply and set the Main/Sub switch (SW1) (first unit to main, second and following units to sub). (refer to page 164) <input type="radio"/> Wire the transmission cable away from the other transmission cable. <input type="radio"/> Wire the transmission cable at least 5 cm away from the power supply cable. <input type="radio"/> Check the transmission cable connection. (refer to page 163) <input type="radio"/> Check the length of the transmission cable wiring.
RC6608 SRC 6608	—	—	Communication error between remote controllers (when 2 remote controllers are connected)	<ul style="list-style-type: none"> <input type="radio"/> Multiple transmission cables have been wired using multi core wires. <input type="radio"/> Transmission cable and power supply cable are too close. <input type="radio"/> Transmission cable is not securely connected. <input type="radio"/> The length of wiring of the transmission cable is longer than specification (longer than 500 m). 	<ul style="list-style-type: none"> <input type="radio"/> Wire the transmission cable away from the other transmission cable. <input type="radio"/> Wire the transmission cable at least 5 cm away from the power supply cable. <input type="radio"/> Check the transmission cable connection. (refer to page 174) <input type="radio"/> Check the length of the transmission cable wiring.
LC 0900 SLC 0900	—	—	Lossnay trial operation	<ul style="list-style-type: none"> <input type="radio"/> Trial operation switch on the Lossnay circuit board (SW 2-1 or SW 2-3) is set to ON board. 	<ul style="list-style-type: none"> <input type="radio"/> Check the test operation switch. (refer to page 169)
LC 4000 SLC 4000	2 blinks	—	Fan motor operation device error	<ul style="list-style-type: none"> <input type="radio"/> Lossnay fan will not stop. 	<ul style="list-style-type: none"> <input type="radio"/> Replace the table.
LC 3602 SLC 3602	3 blinks	—	Damper related error	<ul style="list-style-type: none"> <input type="radio"/> Damper board operation is not correct. <input type="radio"/> Connectors for the damper unit are not correctly connected. 	<ul style="list-style-type: none"> <input type="radio"/> Remove the load and check or move the damper board by hand. <input type="radio"/> Check the connection of the lead wire's connectors and the circuit connector.
LC 5101 SLC 5101	4 blinks	—	OA thermistor related error	<ul style="list-style-type: none"> <input type="radio"/> Connectors for the thermistor are not correctly connected. 	<ul style="list-style-type: none"> <input type="radio"/> Check the connection of the lead wires connectors and the circuit connector.
LC 5102 SLC 5102	5 blinks	—	RA thermistor related error	<ul style="list-style-type: none"> <input type="radio"/> Connectors for the thermistor are not correctly connected. 	<ul style="list-style-type: none"> <input type="radio"/> Check the connection of the lead wires connectors and the circuit connector.
----	9 blinks	—	Remote controller communication error	<ul style="list-style-type: none"> <input type="radio"/> Multiple transmission cables have been wired using multi core wires. <input type="radio"/> Transmission cable and power supply cable are too close. <input type="radio"/> Transmission cable is not securely connected. <input type="radio"/> The length of wiring of the transmission cable is longer than specification (longer than 500 m). 	<ul style="list-style-type: none"> <input type="radio"/> Wire the transmission cable away from the other transmission cable. <input type="radio"/> Wire the transmission cable at least 5 cm away from the power supply cable. <input type="radio"/> Check the transmission cable connection. (refer to page 163, 164) <input type="radio"/> Check the length of the transmission cable wiring.
"Filter" blinking	—	—	Warning to clean air filter by cumulative operation time	<ul style="list-style-type: none"> <input type="radio"/> Interval for cleaning Lossnay air filter has elapsed. 	<ul style="list-style-type: none"> <input type="radio"/> After cleaning the air filter press the "Filter" button on the remote controller 2 times.
"HO" blinking	blinking	—	System is starting	<ul style="list-style-type: none"> <input type="radio"/> LED1 blinks at 1 second intervals during starting operation (maximum of 45 seconds.) 	<ul style="list-style-type: none"> <input type="radio"/> There is no error.

*1 LC: Lossnay set to Main SLC: Lossnay set to Sub RC, SRC: remote controller (PZ-41SLB-E)

*2 Because the LGH-200RX type is loaded with 2 control circuit units, "SLC" may display even with only 1 Lossnay. When "SLC" displays, check and perform maintenance on the upper side circuit.

(2) Checklist of error codes displayed on the PZ-52SF-E, M-NET controllers, and LED displays (Table 2-2)

Error code	LED1 (green)	LED 2 (red)	Symptom	Cause	Corrective action
6600	—	6 blinks	Multiple address error	<input type="radio"/> There is another unit with the same address setting.	<input type="radio"/> Check the addresses of devices in the system.
6607 6608	—	8 blinks	No ACK error No answer error (M-NET communication error)	<input type="radio"/> Power supply to Lossnay is not turned on. <input type="radio"/> Lossnay address was changed. <input type="radio"/> Multiple transmission cables have been wired using multi core wires. <input type="radio"/> Transmission cable is not securely connected. <input type="radio"/> The length of wiring of the transmission cable is longer than specifications (longer than maximum 200 m from the power supply unit, longer than 500 m between ends).	<input type="radio"/> Check the power to the Lossnay. <input type="radio"/> Check the Lossnay address. <input type="radio"/> Wire the transmission cable away from the other transmission cable. <input type="radio"/> Check the transmission cable connection. (refer to page 165) <input type="radio"/> Check the length of the transmission cable wiring.
0900	—	—	Lossnay trial operation	<input type="radio"/> Trial operation switch on the Lossnay circuit board (SW 2-1 or SW 2-3) is set to ON.	<input type="radio"/> Check the trial operation switch. (refer to page 169)
4116	2 blinks	—	Fan motor operation device error	<input type="radio"/> Lossnay fan will not stop.	<input type="radio"/> Replace the table.
3602	3 blinks	—	Damper related error	<input type="radio"/> Damper board operation is not correct. <input type="radio"/> Connectors for the damper unit are not correctly connected.	<input type="radio"/> Remove the load and check or move the damper board by hand. <input type="radio"/> Check the connection of the lead wires connectors and the circuit connector.
5101	4 blinks	—	OA thermistor related error	<input type="radio"/> Connectors for the thermistor are not correctly connected.	<input type="radio"/> Check the connection of the lead wires connectors and the circuit connector.
5102	5 blinks	—	RA thermistor related error	<input type="radio"/> Connectors for the thermistor are not correctly connected.	<input type="radio"/> Check the connection of the lead wires connectors and the circuit connector.
6602 6603 6604	—	1 - 5 blinks	Communication circuit section error	<input type="radio"/> Error with transmission cable. <input type="radio"/> Controller where error originally occurred is defective. <input type="radio"/> Lossnay board is defective.	<input type="radio"/> Check transmission cable relations. <input type="radio"/> Check the controller where the error occurred. <input type="radio"/> Replace the circuit board.
----	—	Lit	No M-NET connection information	<input type="radio"/> Lossnay does not have Group setting (registration) made.	<input type="radio"/> Check the Lossnay address and confirm that the group setting is made. (refer to page 179 or "15. Appendix")
Filter blinking	—	—	Warning to clean air filter by cumulative operation time	<input type="radio"/> Interval for cleaning Lossnay air filter has elapsed.	<input type="radio"/> After cleaning the air filter press the "Filter" button on the remote controller 2 times.
----	Lit	—	In delayed start operation	<input type="radio"/> Delayed start operation is set at the function select switch (SW 5-1) on the Lossnay circuit board.	<input type="radio"/> There is no error.
----	LED6 (red) off	—	No power to M-NET transmission cable	<input type="radio"/> Power supply is not supplied to the M-NET transmission cable. <input type="radio"/> Wiring length of the transmission cable is from the power supply unit or the outdoor unit is longer than specification (maximum extension 200 m).	<input type="radio"/> Check the connection of the power supply unit, outdoor unit and transmission cable. <input type="radio"/> Check the length of the transmission cable wiring.

*1 The letters "LC" that display with the error code show a Lossnay unit type, and the number in the third column shows the address.

*2 Because the LGH-200RX type is loaded with 2 control circuit units, 1 Lossnay unit has 2 addresses. Check and perform maintenance on the table related to the address set at the address switch (SA1, SA2).

Trouble Mode 3: The remote controller does not operate or operates irregularly.

(1) Checklist for when using the PZ-41SLB-E (Table 3-1)

No.	Symptom	Cause	Corrective action
1	Nothing displays on the LCD.	<ul style="list-style-type: none"> <input type="radio"/> Transmission cable is connected to the wrong terminal <input type="radio"/> No Lossnay is set to "Main." <input type="radio"/> Power supply to the Lossnay is not turned on. <input type="radio"/> Lossnay is connected to a power supply with a rating outside specification. <input type="radio"/> Transmission cable is not securely connected. <input type="radio"/> The length of wiring of the transmission cable is longer than specification (longer than 500 m). 	<ul style="list-style-type: none"> <input type="radio"/> Check the transmission cable connection (connected to ⑤,⑥ of terminal unit TM2 on the Lossnay board). (refer to page 163) <input type="radio"/> Turn off the main power supply and set the Main/Sub switch (SW1) (first unit to main, second and following units to sub). (refer to page 164) <input type="radio"/> Check the power supply to the Lossnay. <input type="radio"/> Check the power supply. <input type="radio"/> Check the transmission cable connection. (refer to page 163) <input type="radio"/> Check the length of the transmission cable wiring.
2	Starts or stops, or the display changes, by itself.	<ul style="list-style-type: none"> <input type="radio"/> Multiple transmission cables have been wired using multi core wires. <input type="radio"/> Transmission cable and power supply cable are too close. 	<ul style="list-style-type: none"> <input type="radio"/> Wire the transmission cable away from the other transmission cable. <input type="radio"/> Wire the transmission cable at least 5 cm away from the power supply cable.
3	Displays a error code that is not in the check list.	<ul style="list-style-type: none"> <input type="radio"/> Letters on the remote controller LCD are dim. <input type="radio"/> The release of the Delay Start button or the Filter Reset button is not good. 	<ul style="list-style-type: none"> <input type="radio"/> Replace the remote control. <input type="radio"/> Replace the remote control.
4	Cannot stop the Lossnay with the remote controller (display shows "Interlocked").	<ul style="list-style-type: none"> <input type="radio"/> External priority ON/OFF setting is made. 	<ul style="list-style-type: none"> <input type="radio"/> Check the interlocked operation mode setting. (refer to page 171)
5	Cannot switch fan speed with the remote controller.	<ul style="list-style-type: none"> <input type="radio"/> High/Low change input (CN16) is ON. <input type="radio"/> The function select switch (SW2-4.5) on the Lossnay circuit has the fixed high or fixed low speed set. 	<ul style="list-style-type: none"> <input type="radio"/> Check the High/Low change input (CN16). (refer to page 165) <input type="radio"/> Check the function select switch (SW 2-4.5) (refer to page 167)
6	Lossnay operates when the main power supply turns on and the remote controller displays.	<ul style="list-style-type: none"> <input type="radio"/> Main power supply was cut during Lossnay operation. 	<ul style="list-style-type: none"> <input type="radio"/> Stop the Lossnay with the remote controller, then wait at least 10 second and turn off the main power supply .

(2) Checklist for when using PZ-52SF-E (Table 3-2)

No.	Symptom	Cause	Corrective action
1	Nothing displays on the LCD.	<ul style="list-style-type: none"> <input type="radio"/> Transmission cable is connected to the wrong terminal <input type="radio"/> There is no power supply unit (for Lossnay only systems). <input type="radio"/> The power supply unit is not turned on. <input type="radio"/> Transmission cable is not securely connected. <input type="radio"/> Wiring length of the transmission cable is from the power supply unit or the outdoor unit is longer than specifications (maximum extension 200 m). 	<ul style="list-style-type: none"> <input type="radio"/> Check the transmission cable connection (connected to Ⓐ, Ⓑ of terminal unit TB5 on the Lossnay board). (refer to page 165) <input type="radio"/> Install the power supply unit. <input type="radio"/> Check the power to the power supply unit. <input type="radio"/> Check the transmission cable connection. (refer to page 165) <input type="radio"/> Check the length of the transmission cable wiring.

No.	Symptom	Cause	Corrective action
2	Displays "HO" and does not start.	<ul style="list-style-type: none"> <input type="radio"/> It is less than 10 minutes since the power was supplied to the system. <input type="radio"/> Group setting (registration) has not been made. <input type="radio"/> Remote control address has not been registered in the group setting by the centralised controller. <input type="radio"/> Power supply to the Lossnay is not turned on. <input type="radio"/> Lossnay is connected to a power supply with a rating outside specification. <input type="radio"/> Lossnay transmission cable connection terminal is wrong. <input type="radio"/> Lossnay address was changed. <input type="radio"/> Lossnay board was changed. <input type="radio"/> The length of wiring of the transmission cable is longer than specifications (longer than maximum 200 m from the power supply unit, longer than 500 m between ends). 	<ul style="list-style-type: none"> <input type="radio"/> After supplying power to the system, HO blinks for a maximum of about 10 minutes. (This is not an error.) <input type="radio"/> Make the group setting (registration). If using a system with a centralised controller, register at the centralised controller. If there is only the Lossnay remote controller, register at the remote controller. (refer to "15. Appendix" or page 179) <input type="radio"/> Check the group setting at the MELANS. (refer to "15. Appendix") <input type="radio"/> Check the power supply to the Lossnay. (refer to page 161) <input type="radio"/> Check the power supply. <input type="radio"/> Check the transmission cable connection (connected to \textcircled{A}, \textcircled{B} of terminal unit TB5 on the Lossnay board). (refer to page 165) <input type="radio"/> Check the Lossnay address. (refer to page 166) <input type="radio"/> If the board has been replaced, reset the group settings. (refer to "15. Appendix") <input type="radio"/> Check the length of the transmission cable wiring.
3	Cannot register the Lossnay from the remote controller or the controller.	<ul style="list-style-type: none"> <input type="radio"/> Power supply to the Lossnay is not turned on. <input type="radio"/> Lossnay is connected to a power supply with a rating outside specification. <input type="radio"/> Transmission cable to the Lossnay is not connected. <input type="radio"/> Lossnay transmission cable connection terminal is wrong. <input type="radio"/> Lossnay address is wrong. <input type="radio"/> The length of wiring of the transmission cable is longer than specifications (longer than maximum 200 m from the power supply unit, longer than 500 m between ends). 	<ul style="list-style-type: none"> <input type="radio"/> Check the power supply to the Lossnay. (refer to page 161) <input type="radio"/> Check the power supply. <input type="radio"/> Check the transmission cable connection. (refer to page 165) <input type="radio"/> Check the transmission cable connection (connected to \textcircled{A}, \textcircled{B} of terminal unit TB5 on the Lossnay table). (refer to page 165) <input type="radio"/> Check the Lossnay address. (refer to page 166) <input type="radio"/> Check the length of the transmission cable wiring.
4	Starts or stops, or the display changes, by itself.	<ul style="list-style-type: none"> <input type="radio"/> Set for interlocked operation with City Multi. 	<ul style="list-style-type: none"> <input type="radio"/> Cancel interlocked operation setting. (refer to "15. Appendix")
5	Displays a error code that is not in the checklist.	<ul style="list-style-type: none"> <input type="radio"/> Letters on the remote controller LCD are dim. 	<ul style="list-style-type: none"> <input type="radio"/> Replace the remote controller.
6	Cannot stop the Lossnay with the remote controller (display shows "Central").	<ul style="list-style-type: none"> <input type="radio"/> "Cancel Operation" setting is made from the MELANS. <input type="radio"/> External priority ON/OFF setting is made. <input type="radio"/> Remote/nearby switch input (CN32) is set to "Remote." 	<ul style="list-style-type: none"> <input type="radio"/> Check the settings of the MELANS. <input type="radio"/> Check the interlocked operation mode setting. (refer to page 168) <input type="radio"/> Check the remote/nearby change input (CN32).

Trouble Mode 4: The Lossnay does not operate or operates irregularly.

Lossnay checklist (Table 4).

No.	Symptom	Cause	Corrective action
1	The fan does not operate. The fan does not operate normally.	<ul style="list-style-type: none"> <input type="radio"/> Connectors for the fan connection or connectors for the control circuit section connection are not secure. <input type="radio"/> Power supply is not supplied to the Lossnay, or power outside specifications is connected. <input type="radio"/> Lossnay group setting is not made by using the M-NET. (LED2 lights) 	<ul style="list-style-type: none"> <input type="radio"/> Check the lead wire connectors and the control circuit section connectors. <input type="radio"/> Check the power supply. (refer to page 161) <input type="radio"/> Check the Lossnay address and the group setting (LED2 lights when not using M-NET. This is no error.)
2	Interlocked operation with external device (air conditioner) does not occur.	<ul style="list-style-type: none"> <input type="radio"/> The type of external signal does not match the connected terminal unit (charged, uncharged, Mr. Slim signal). <input type="radio"/> The type of external signal does not match the pulse input switch (SW2-2) setting (level signal, pulse signal). <input type="radio"/> The external device signal is not being input. <input type="radio"/> The external device and signal cable wiring is longer than specifications (12V DC, 24V DC: Longer than limitations of external device Uncharged a-contact: Longer than 500 m Mr. Slim signal: Longer than 500 m) <input type="radio"/> The Delayed Start mode is set at the remote controller (PZ-41SLB-E) or the function select switch (SW 5-1) on the Lossnay circuit board. <input type="radio"/> The ON Interlocked Operation mode or OFF Interlocked Operation mode is set at the remote controller (PZ-41SLB-E) or the function select switch (SW 5-7,8) on the Lossnay circuit board. <input type="radio"/> When using multiple Lossnay units, the external control input signal is connected to a unit with the "Sub" setting made. <input type="radio"/> In a group of multiple Lossnay units with the M-NET, the external control input signal is connected to a Lossnay unit other than the one with the smallest address. <input type="radio"/> There is a communication error with the remote controller or controller. 	<ul style="list-style-type: none"> <input type="radio"/> Check the external signal type and the external control input terminal (TM2) connection. (refer to page 163, 164) <input type="radio"/> Check the external signal type and the pulse input switch (SW2-2) setting. (refer to page 164) <input type="radio"/> Check the external device. <input type="radio"/> Check the wiring length of the signal cable. <input type="radio"/> Check the delayed start settings of the remote controller (PZ41SLB-E) and the function select switch (SW5-1). (refer to page 167, 171) <input type="radio"/> Check the interlocked operation mode settings of the remote controller (PZ41SLB-E) and the function select switch (SW5-7, 8). (refer to page 168, 171) <input type="radio"/> Connect the external control input signal to the Lossnay set to "Main." (refer to page 164) <input type="radio"/> Connect the external control input signal to the Lossnay in the group with the lowest address. <input type="radio"/> Check the remote controller or controller.
3	Fan will not stop.	<ul style="list-style-type: none"> <input type="radio"/> The trial operation switch (SW 2-1) is ON. 	<ul style="list-style-type: none"> <input type="radio"/> Check the test operation switch (SW2-1). (refer to page 169)
4	Lossnay operates when main power is turned on.	<ul style="list-style-type: none"> <input type="radio"/> The PZ-41SLB-E is being used. <input type="radio"/> By using the M-NET, the power supply ON/OFF setting is set to ON at the function select switch (SW 2-6) on the Lossnay circuit board. <input type="radio"/> By using the M-NET, the automatic recovery following power supply interruption (refer to page 168) setting is made at the function select switch (SW 5-4) on the Lossnay circuit board. 	<ul style="list-style-type: none"> <input type="radio"/> When the main power supply is turned off while the Lossnay is operating from the remote controller, the Lossnay will resume operation when the main power is turned back on (this is no error). <input type="radio"/> Check the power supply ON/OFF setting of the function select switch (SW2-6). (refer to page 167) <input type="radio"/> Check the automatic recovery following power supply interruption setting of the function select switch (SW5-4). (refer to page 168)

No.	Symptom	Cause	Corrective action
5	Supply air fan periodical-ly stops operating.	<ul style="list-style-type: none"> <input type="radio"/> When the outdoor air temperature is -10°C or less, operation stops after a fixed period of about 10 minutes to keep the Lossnay Core from freezing. (Cold weather area spec) <input type="radio"/> When connected to a Mr. Slim or a City Multi by a duct, operation stops when the air conditioner is defrosting. 	<ul style="list-style-type: none"> <input type="radio"/> This is no error. <input type="radio"/> This is no error.
6	Takes in air from out-doors during interlocked operation with a Mr. Slim or a City Multi, but supply air fan doesn't stop operating when defrosting.	<ul style="list-style-type: none"> <input type="radio"/> The indoor unit's outside air intake selection is invalid. 	<ul style="list-style-type: none"> <input type="radio"/> Set the outdoor air intake selec-tion of a indoor unit to "ON."
7	The supply air fan and exhaust fan both periodi-cally stop operating.	<ul style="list-style-type: none"> <input type="radio"/> When connected to Mr. Slim or City Multi by a duct and the function select switch (SW 5-3) on the Lossnay circuit board is ON, operation stops when the air conditioner is defrosting. 	<ul style="list-style-type: none"> <input type="radio"/> Check the function select switch (SW5-3). (refer to page 167)
8	Fan speed will not change.	<ul style="list-style-type: none"> <input type="radio"/> The High/Low switching extermary input (CN16) is set to ON. <input type="radio"/> The function select switch (SW2-4.5) on the Lossnay cir-cuit board is set to the high fixed or low fixed fan speed. <input type="radio"/> The trial operation switch (SW2-1) is turned ON. 	<ul style="list-style-type: none"> <input type="radio"/> Check the High/Low change input (CN16). (refer to page 165) <input type="radio"/> Check the function select switch (SW2-4,5). (refer to page 167) <input type="radio"/> Check the trial operation switch (SW2-1). (refer to page 169)
9	Damper board does not operate.	<ul style="list-style-type: none"> <input type="radio"/> The outside air temperature is less than 8°C. <input type="radio"/> The damper board operation is defective. <input type="radio"/> The thermistor related connectors are not securely connected. <input type="radio"/> The damper related connectors are not securely connected. <input type="radio"/> The trial operation switch (SW2-1 or SW2-3) is turned ON. <input type="radio"/> When using the remote controller to change ventilation mode, there may be a delayed start of up to 30 seconds depending on the timing. 	<ul style="list-style-type: none"> <input type="radio"/> Check the outdoor air temperature. <input type="radio"/> Remove the load and check or move the damper board by hand. <input type="radio"/> Check the connections of the lead wire connectors and the circuit connectors. <input type="radio"/> Check the connections of the lead wire connectors and the control circuit connectors. <input type="radio"/> Check the trial operation switch (SW2-1 or SW2-3). (refer to page 169) <input type="radio"/> This is no error.
10	Operation monitor output is late with regard to external control input ON/OFF.	<ul style="list-style-type: none"> <input type="radio"/> When using the PZ-41SLB-E there is a maximum delay of 7 seconds, or without using there is a maximum delay of 3 seconds. 	<ul style="list-style-type: none"> <input type="radio"/> This is no error.
11	Operation monitor output is OFF during operation.	<ul style="list-style-type: none"> <input type="radio"/> When the function select switch (SW 5-2) on the Lossnay circuit board is ON, for operation monitor output for interlocked operation with the supply air fan, it turns OFF when the out-side air is -10°C or less or when the air conditioner is defrosting. 	<ul style="list-style-type: none"> <input type="radio"/> Check the function select switch (SW5-2). (refer to page 167)
12	Delayed start operation does not work when Delayed start is set.	<ul style="list-style-type: none"> <input type="radio"/> When using the PZ-41SLB-E, the circuit func-tion select switch is set for delayed start. 	<ul style="list-style-type: none"> <input type="radio"/> Set delayed start at the remote controller (the circuit board switch is not in effect when using the PZ-41SLB-E). (refer to page 171)
13	Lossnay does not operate when power is on even when the power on/off setting is made.	<ul style="list-style-type: none"> <input type="radio"/> Using the PZ-41SLB-E. 	<ul style="list-style-type: none"> <input type="radio"/> The power supply ON/OFF set-ting is not in effect when using PZ-41SLB-E.
14	Interlocked operation is different from the set-tings.	<ul style="list-style-type: none"> <input type="radio"/> When using the PZ-41SLB-E, the circuit func-tion select switch is set for interlocked opera-tion. 	<ul style="list-style-type: none"> <input type="radio"/> Set interlocked operation at the remote controller (the circuit board switch is not in effect when using the PZ-41SLB-E). (refer to page 171)


Temperaturers vs. thermistor resistance table

Temperature (°C)	Resistance value (kΩ)								
-40	88.85 - ∞	-7	17.92	8	9.57	23	5.38	38	3.17
⋮	⋮	-6	17.16	9	9.20	24	5.19	39	3.06
-20	32.43	-5	16.43	10	8.84	25	5.00	40	2.96
-19	30.92	-4	15.74	11	8.49	26	4.82	41	2.86
-18	29.50	-3	15.08	12	8.17	27	4.65	42	2.77
-17	28.14	-2	14.45	13	7.85	28	4.49	43	2.68
-16	26.87	-1	13.86	14	7.55	29	4.33	44	2.59
-15	25.65	0	13.29	15	7.27	30	4.18	45	2.51
-14	24.51	1	12.74	16	6.99	31	4.03	46	2.43
-13	23.42	2	12.22	17	6.73	32	3.89	47	2.35
-12	22.39	3	11.72	18	6.48	33	3.76	48	2.28
-11	21.41	4	11.25	19	6.24	34	3.63	49	2.21
-10	20.48	5	10.80	20	6.01	35	3.51	50	2.14
-9	19.58	6	10.37	21	5.79	36	3.39	⋮	⋮
-8	18.73	7	9.96	22	5.58	37	3.28	87.5 -	0.72 - 0

11.3 Circuit Test Point

LED1 (green)

- When blinking, there is an error with the Lossnay unit (number of blinks indicates the type of error).
- Blinks at 1 second intervals when starting.
- Lit during delayed start, normally off at other times.

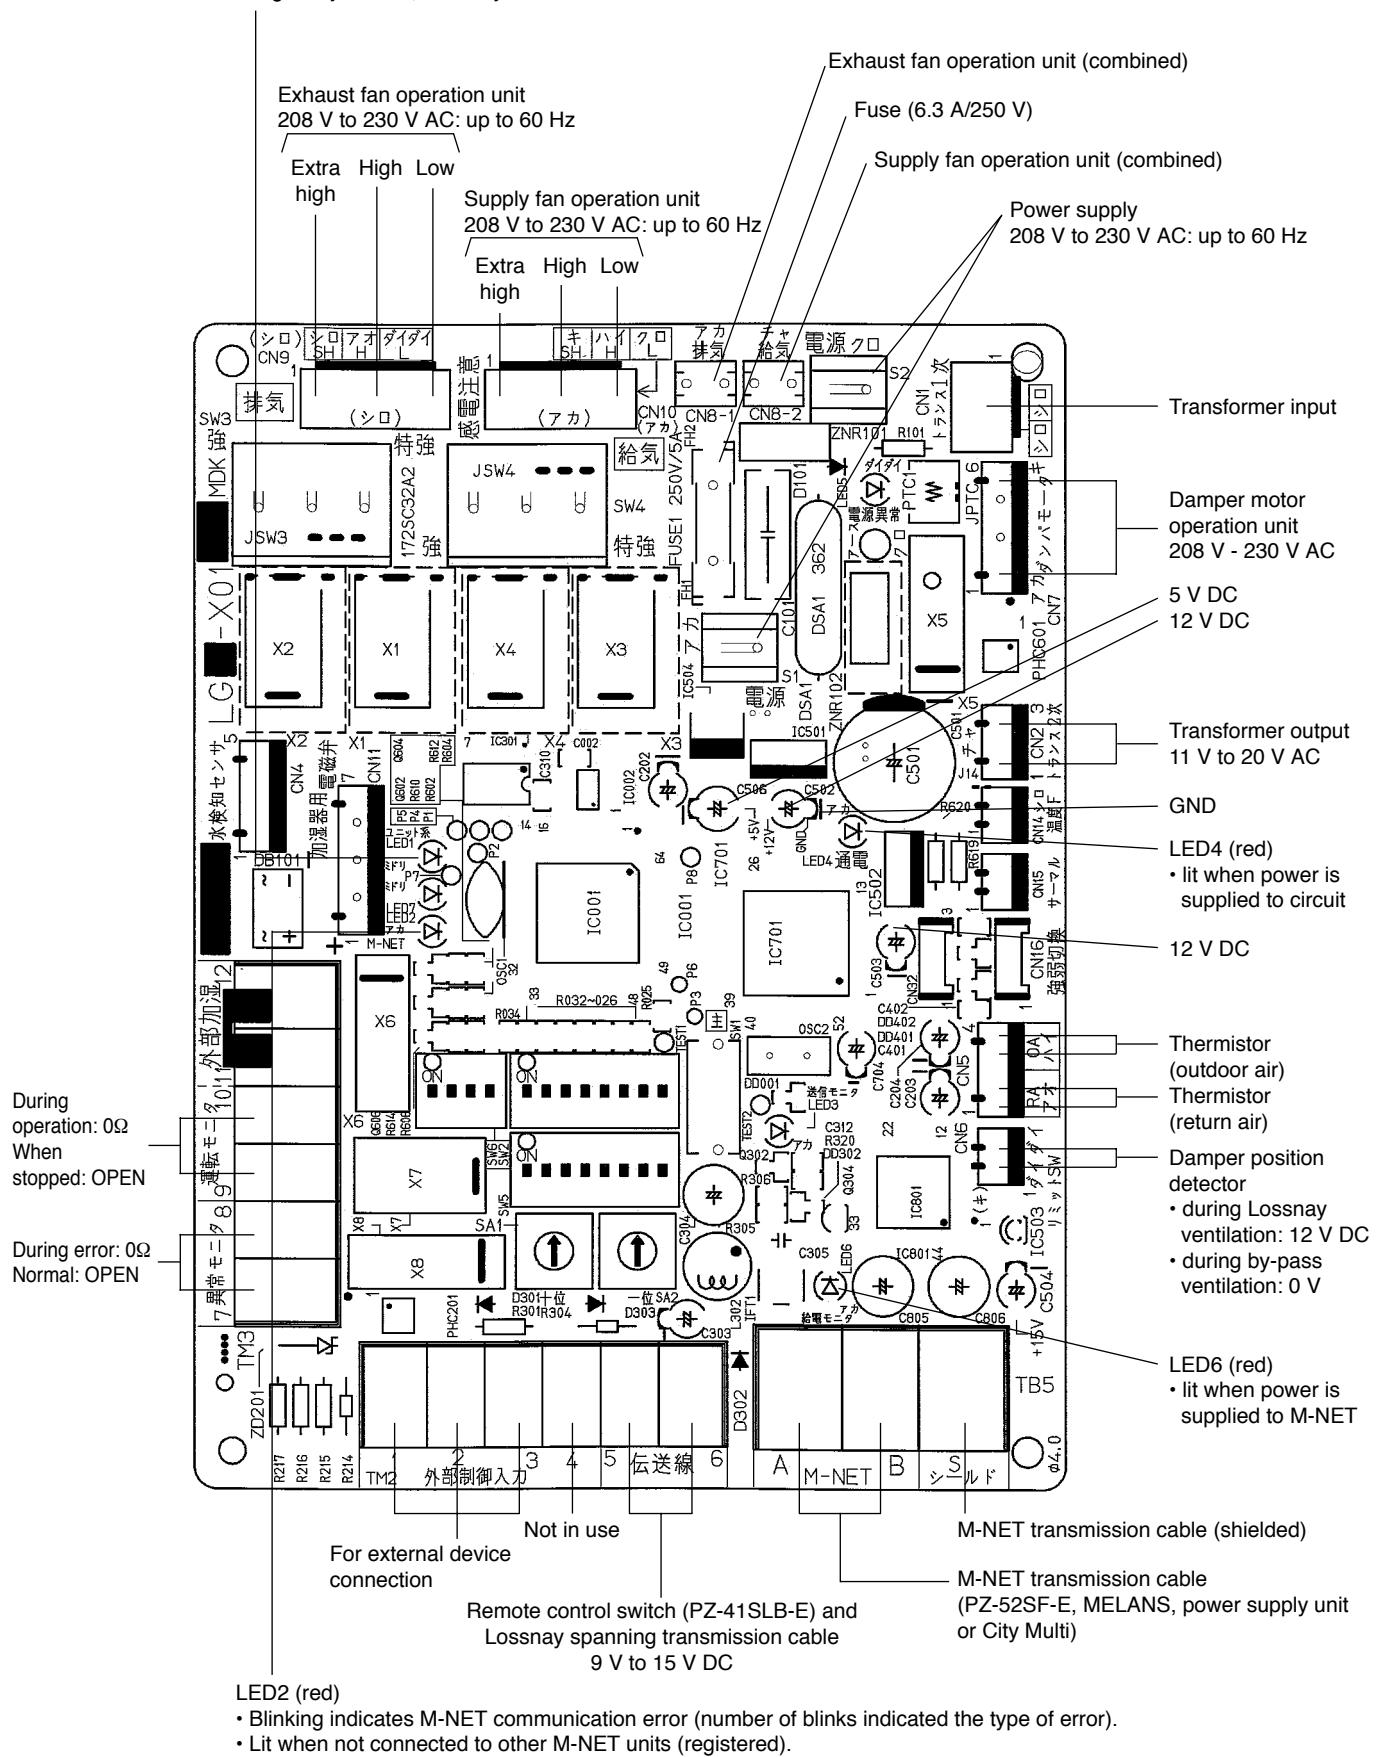


12. Installation method

12.1 Electrical installation


With this product, the wiring installation method will vary according to the design of the system. Perform electrical installation for each of the required sections.

12.1.1 Names of components in control box

LGH-50 and LGH-100RX types

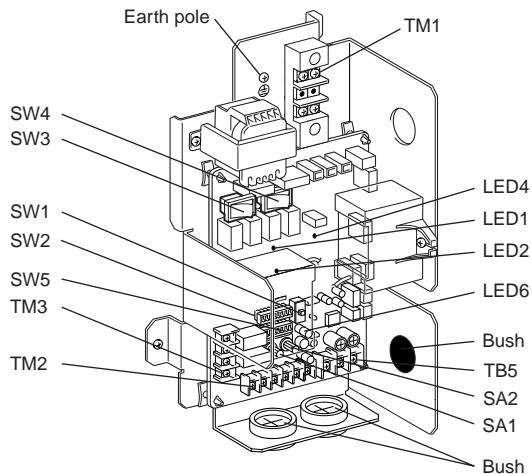


LGH-200RX type

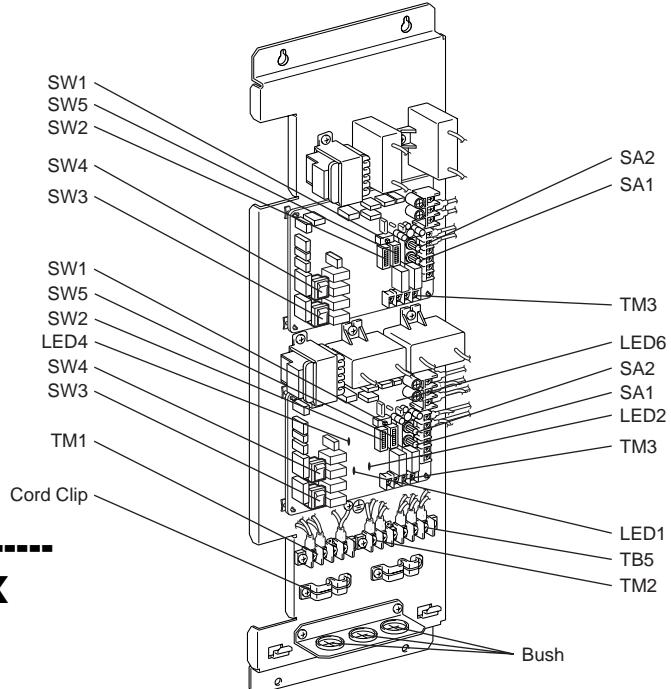

12.1.2 Wire connection diagram ----- Models LGH-50 and 100RX

- * Connect the wires shown as dotted lines.
- * Be sure to connect the grounding wire.
- * Breaker should be provided by the customer.

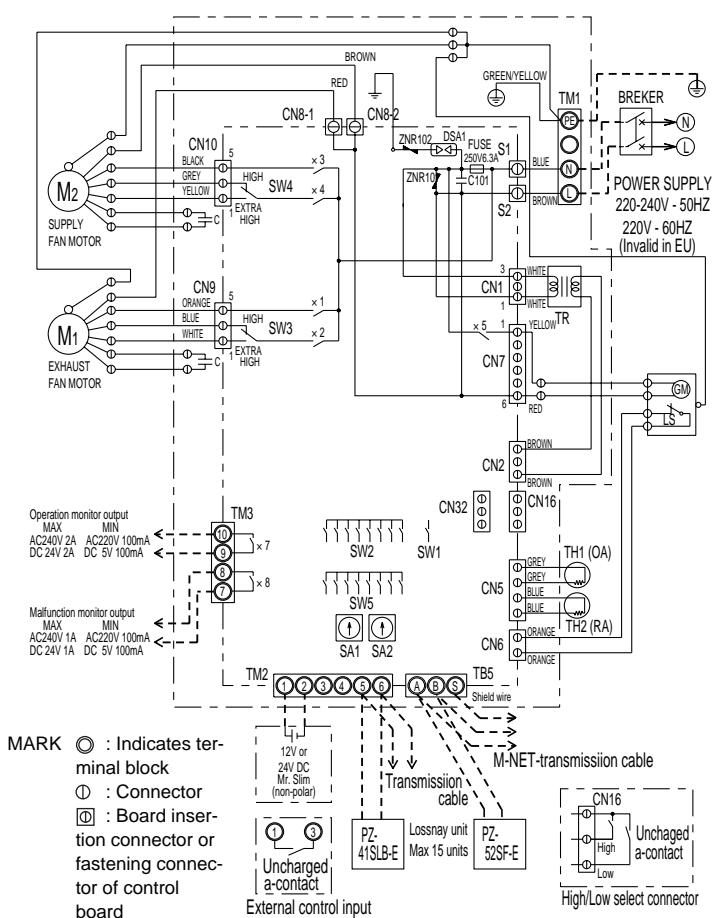


Symbol explanation	
M1:	Motor for exhaust fan
M2:	Motor for supply fan
C:	Capacitor
GM:	Motor for Bypass movement
LS:	Microswitch
TH1:	Thermistor for outside air
TH2:	Thermistor for return air
SW1:	Switch (Main/Sub change)
SW2,5:	Switch (Function selection)
SW3:	High/E.High select switch (Exhaust fan)
SW4:	High/E.High select switch (Supply fan)
TM1:	Terminal block (Power supply)
TM2:	Terminal block (Transmission cable and external control input)
TM3:	Terminal block (Monitor output)
TB5:	Terminal block (M-NET Transmission cable)
S1,S2:	Connector (Power supply)
TR:	Control circuit transformer
X7:	Relay contact (For operation monitor output)
SA1:	Address setting rotary switch (10 digit)
SA2:	Address setting rotary switch (1 digit)
LED1:	Inspection indicator lamp
LED2:	Inspection indicator lamp
LED4:	Power supply indicator lamp
LED6:	M-NET indicator lamp

• PZ-41SLB-E and PZ-52SF-E cannot be used simultaneously.

12.1.3 Wire connection diagram ----- Model LGH-200RX

- * Connect the wires shown as dotted lines.
- * Be sure to connect the grounding wire.
- * Breaker should be provided by the customer.

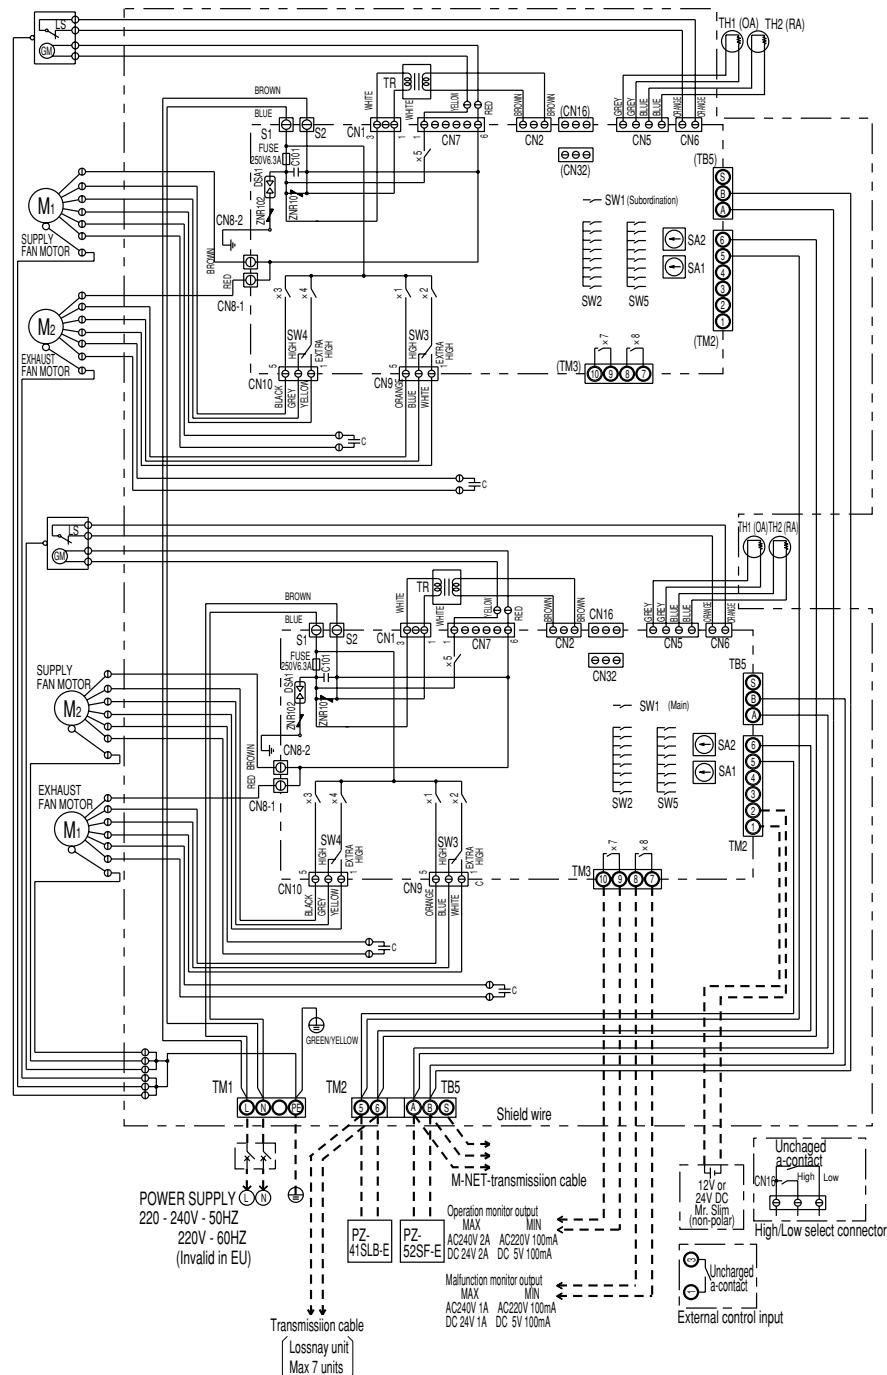


Symbol explanation			
M1: Motor for exhaust fan	TM1: Terminal block (Power supply)	CN1: Connector (Transformer primary)	CN32: Connector (Remote control selection)
M2: Motor for supply fan	TM2: Terminal block (Transmission cable and external control input)	CN2: Connector (Transformer secondary)	SA1: Address setting rotary switch (10 digit)
C: Capacitor	TM3: Terminal block (Monitor output)	CN5: Connector (Thermistor)	SA2: Address setting rotary switch (1 digit)
GM: Motor for Bypass movement	TB5: Terminal block (M-NET Transmission cable)	CN6: Connector (Microswitch)	MARK : Indicates terminal block
LS: Microswitch	S1, S2: Connector (Power supply)	CN7: Connector (Motor for bypass operation)	① : Connector
TH1: Thermistor for outside air	TR: Control circuit transformer	CN8-1: Tab connector (Fan motor)	② : Board insertion connector or fastening connector of control board
TH2: Thermistor for return air	X7: Relay contact (For operation monitor output)	CN8-2: Tab connector (Fan motor)	
SW1: Switch(Main/Sub change)	X8: Relay contact (For malfunction monitor output)	CN9: Connector (Fan motor)	
SW2,5: Switch (Function selection)		CN10: Connector (Fan motor)	
SW3: High/E.High select switch (Exhaust fan)		CN16: Connector (High/Low switch)	
SW4: High/E.High select switch (Supply fan)			


- PZ-41SLB-E and PZ-52SF-E cannot be used simultaneously.

12.2 Connecting the power supply cable


LGH-50 and 100RX types

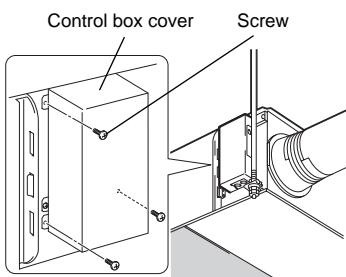



LGH-200RX type

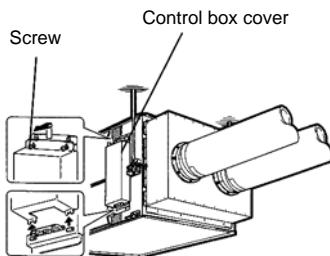

LGH-50 and 100RX types

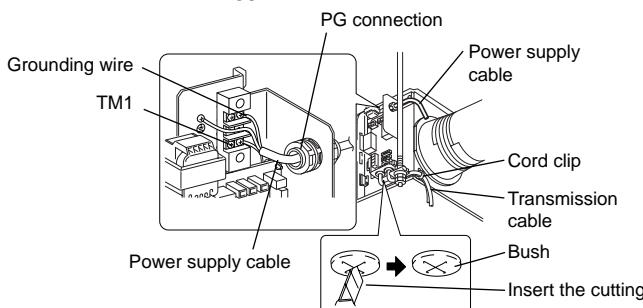

LGH-200RX type

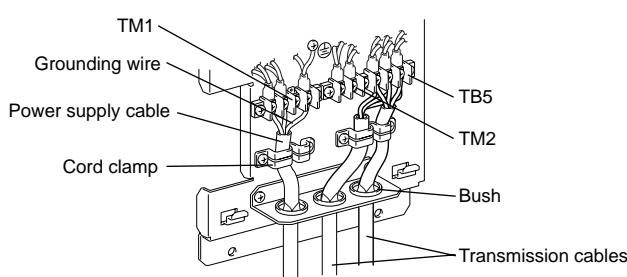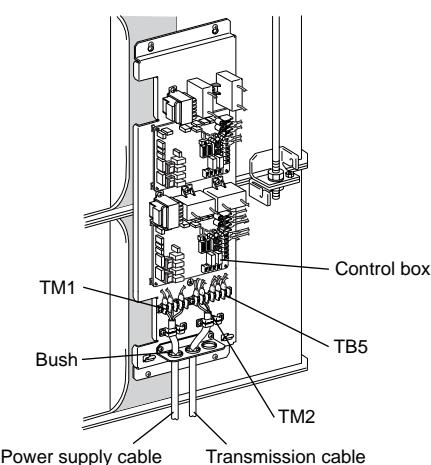

1. Remove the screws and open the control box cover

2. Connecting the power supply cable and transmission cable

Pass the power cable through the bush* and connect to the TM1 terminal block using the round terminals. Connect the grounding wire to the grounding terminal and secure tightening the bush. (*: for PG connection or the like)


CAUTION:

- Always separate the power supply cable and transmission cable by 5 cm or more to prevent malfunctioning of the unit.
- If the length of the stripped power cables wires is too long, the conductors may touch and cause shorting.


- (1) Refer to the wiring diagram and screw down the grounding wire and transmission cables to the terminal block.
- (2) Secure the power supply cable and transmission cables using the cord clamp.

Upon completion of the wiring connections, replace the control box cover.


LGH-50 and 100RX types

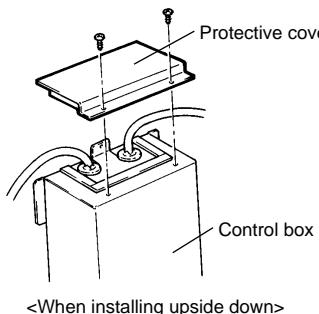


LGH- 200RX type

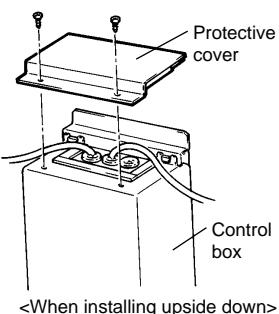

LGH-50 and 100RX types

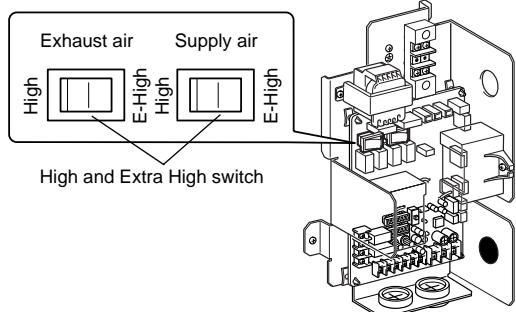

LGH-200RX type

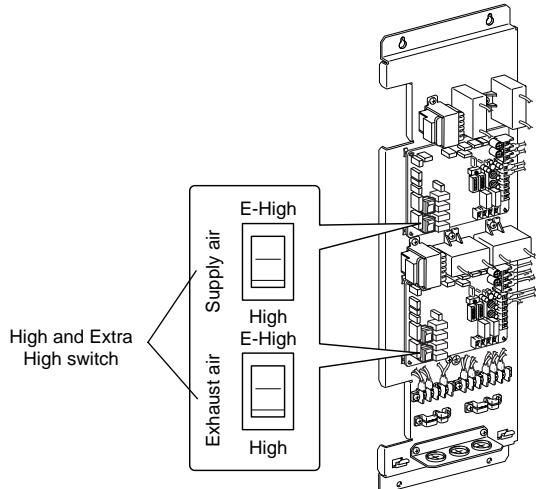

3. When installing upside down

CAUTION:

- If installing and using this product upside down, the power supply cable outlet will be at the top. Be sure to attach the protective cover so that no drops of water can get inside the control box.





4. Changing the switch for High and Extra High

To increase the air volume, change the switch from "high" to "extra high".

- The factory setting is "High".
- Can be switched for each supply and exhaust separately.

The following system configuration can be created. Connect the necessary parts.

1. When connecting with remote controller (PZ-41SLB-E).
2. When interlocking with air conditioner or other external device.
3. When interlocking with a pulse output unit.
4. When operating multiple Lossnay units.
5. When connecting to CO₂ sensor when switching the High/Low switch externally.
6. When connecting to City Multi, Lossnay remote controller (PZ-52SF-E) or Mitsubishi Electric Air-Conditioner Network System (MELANS).

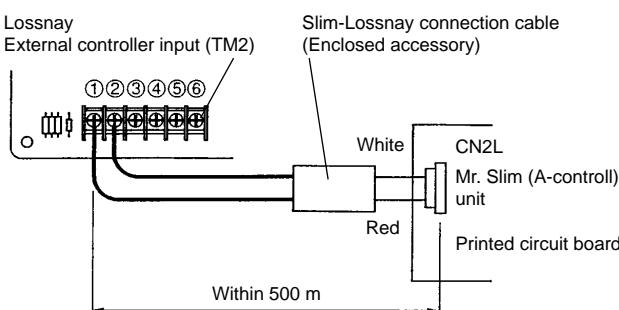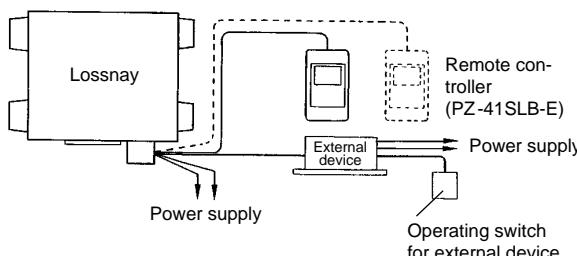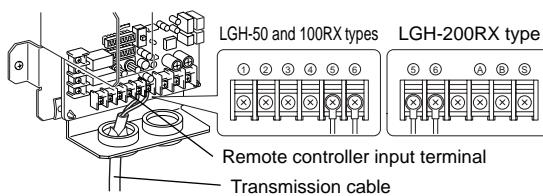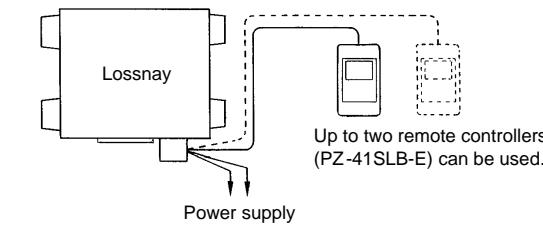

1. When connecting to remote controller (PZ-41SLB-E)

- * The PZ-41SLB-E cannot be used when centralised control of the Lossnay is used. Then follow the procedure for connecting the wire shown in 6. and use the Lossnay remote controller (PZ-52SF-E).

Securely connect the transmission cable (PVC insulated PVC jacketed and either between ø0.65 and ø1.2, or between 0.3 mm² and 1.25 mm² in cross section) from the remote controller to 5 and 6 of the input terminal block (TM2). (No polarity)

- If there are two remote controllers, connect them in the same way.

Note:

- Up to four 0.3 mm² stranded wires or ø0.65 PVC wires can be connected to one input terminal.
- For other types of wire up to two can be connected.

2. When interlocked with air conditioner or other external device

- (1) Connect the output signal cable from the external device to the input terminal block (TM2) of the external controller.
- LGH-200RX type are connected to the lower circuit board. (Main circuit board)

CAUTION:

- The connection may vary according to the output signal type of the external device.

When using Mr. Slim air conditioner and (A-control) Interlock operation of except Mr. Slim (A-control) unit is not possible.

Connect the interlocking cable connector side to CN2L on the circuit board for the indoor Mr. Slim unit and connect the lead wire side to the ① and ② of the input terminal block (TM2) for the Lossnay external controller input. (No polarity)


- Always separate the power supply cable and the Slim-Lossnay connection cable for the Lossnay by 5 cm or more to prevent malfunctioning of the unit.
- **The Slim-Lossnay connection cable is 0.25 m long. When wiring, extend it as far as necessary.**

Note:

- The Lossnay remote controller (PZ-41SLB-E) cannot be used with this system.
- The ventilation mode is "automatic ventilation".
- The Slim-Lossnay connection cable may be extended to a maximum length of 500 m (Extension cable specifications are as detailed below).


Ensure that all connections are secure and that the appropriate insulation is provided.

Extension cable sheathed PVC cable or cable-0.5 mm² to 1.0 mm².

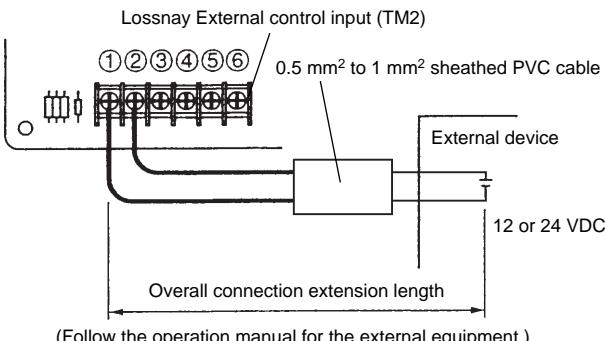

When the external device has a charged operating signal of 12V DC or 24 V DC

- Connect the operating signal (wire) from the external device via the remote output retrieval component (sold separately) to ① and ② on the external control input terminal block (TM2). (No polarity)

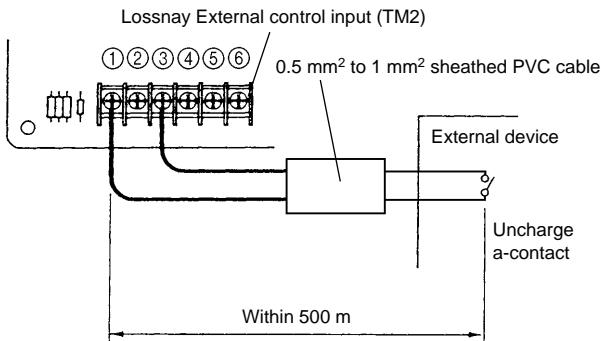

When the external device has an uncharged a-contact signal

- Connect the operating signal (wire) from the external device via the remote output retrieval component (sold separately) to ① and ③ on the external control input terminal block (TM2).


Note:

- If an optocoupler or any other type of polar coupler is used at the uncharged a-contact, connect the positive side to 3 and the negative side to 1.



3. When interlocking with a pulse output unit

- (1) Move the pulse input switch [SW2-2] to the ON position. On the LGH-200RX type, set both the upper and lower circuit boards the same.
- (2) Connect the pulse output device (i.e., building management system) to the external control input terminal block [TM2]. The LGH-200RX type connected to the lower circuit board. (Main circuit board)
 - A pulse width of at least 200 msec will be needed.
- (3) Wiring is to be performed in the same way as for item 2 above.

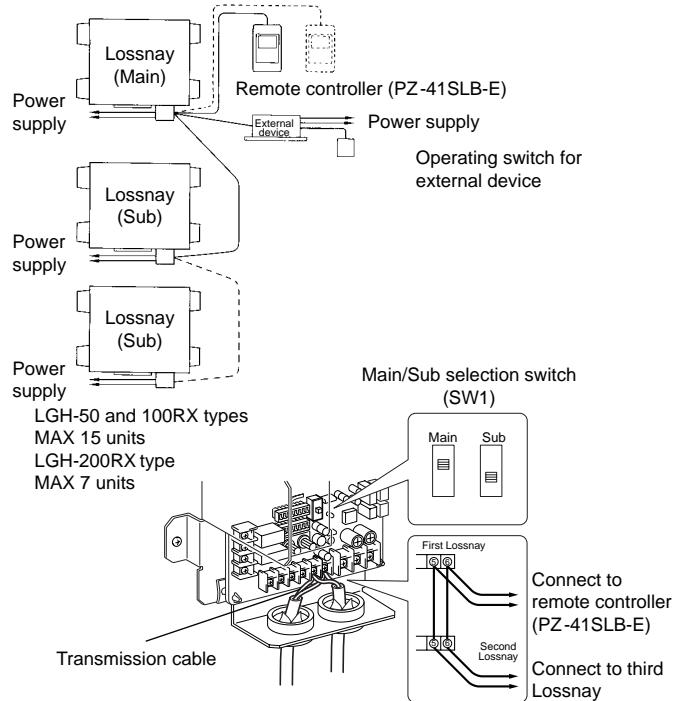

4. When operating multiple Lossnay units

- (1) Connect from Lossnay unit 1 to Lossnay unit 2, and from unit 2 to unit 3 and so on up to a maximum of 15 units (7 units for type 200) using a transmission cable (PVC insulated PVC jacketed and either between Ø0.65 and Ø1.2, or between 0.3 mm² and 1.25 mm² in cross section).
- (2) Change the setting on the main/sub switch (SW1) on the second and subsequent Lossnay units to "sub".

Note:

- Up to four 0.3 mm² stranded wires or Ø0.65 PVC wires can be connected to one input terminal.
- For other types of wire up to two can be connected.
- The operation signal and pulse signal can be connected to the external device of the main Lossnay only.
- Connect the power to each respective Lossnay unit.

5. When switching High/Low speed externally (when CO₂ sensor or other unit is connected)

If a commercially available CO₂ sensor or other such unit is used as shown in the drawing, connect by inserting Remote ON/OFF Adaptor (PAC-SE55RA-E) (sold separately) to the CN16 connector (for switching between High/Low).




* The LGH-200RX type are connected to the lower circuit unit. (Main circuit board)

* Note that if the remote controller is connected to a CO₂ sensor, the actual high and low fan speeds may not match on the remote controller.

- To force high speed externally

When external switch is "ON" fan speed of the Lossnay will be set to "High".

Regardless of the remote control setting.

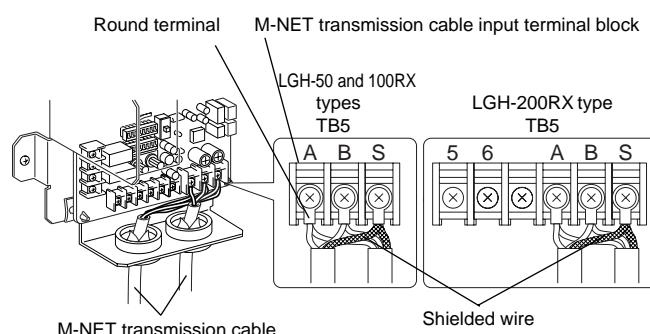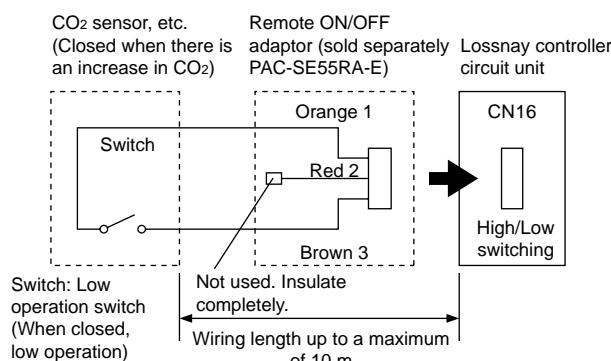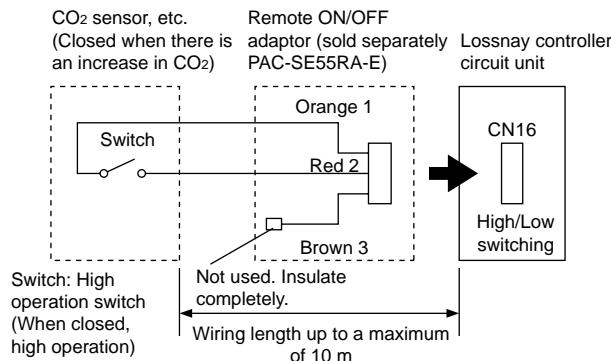

6. When connecting to the City Multi, Lossnay M-NET remote controller (PZ-52SF-E) or Mitsubishi Electric Air-Conditioner Network System (MELANS)

* If centralised control is performed according the wire connection shown in this section, the remote controller (PZ-41SLB-E) cannot be used.

- One shielded wire is connected to the other shielded wire. (Terminal connection)




Address setting is required. (Refer to function setting section.)

M-NET transmission cable: Connect any of the following -- City Multi indoor unit, Lossnay remote controller (PZ-52SF-E) or Mitsubishi Electric Air-Conditioner Network System (MELANS) - to the Lossnay.

Type: (Shielded wire, CVVS/CPEVS)

Wire diameter: 1.25 mm² to 2.0 mm²

- Securely connect the M-NET transmission cable to Ⓐ and Ⓑ on the transmission cable input terminal block (TB5). (Non-Polar)

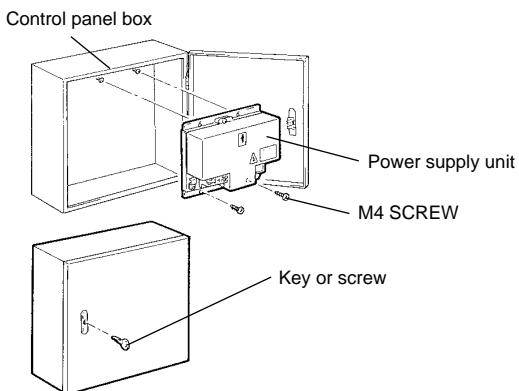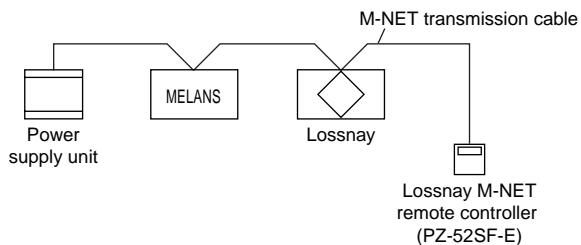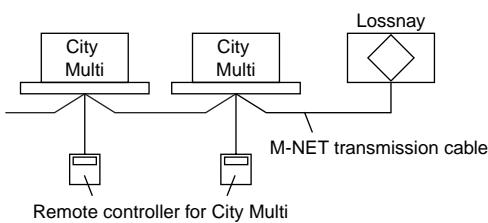

When interlocking with the City Multi

- Keep the overall length of the transmission cable within 500 meters. Note that the wiring length between the Lossnay and power supply unit (sold separately) or outdoor unit should be 200 meters or less.

Lossnay M-NET remote controller (PZ-52SF-E) or MELANS

- Connect the power supply unit (PAC-SC34 KUA)

● To use the power supply unit

Install the power supply unit on the control panel box as follows.


- (1) Screw the M4 SCREWS into the control panel box enough to keep them from falling out of place. Set them towards the top of the box.
- (2) Hang the power supply unit (from the top end) on the M4 SCREWS.
- (3) Lock the bottom end down with the M4 SCREW.
- (4) Tighten the top end screw securely.
- (5) Once installed, close the control panel box door for safety reasons and lock with the key or screw.

For more information, see the installation manual of the power supply unit.


12.3 Function settings

You must set the address when connecting to the City Multi, Lossnay M-NET remote controller (PZ-52SF-E) and MELANS.

12.3.1 Setting the address

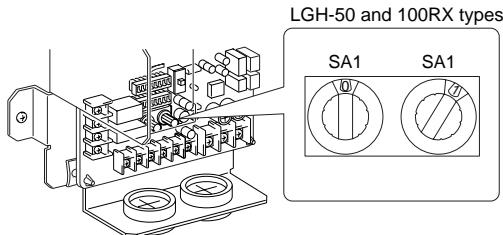

- * When the address number has been changed, the data in the memory is automatically reset.

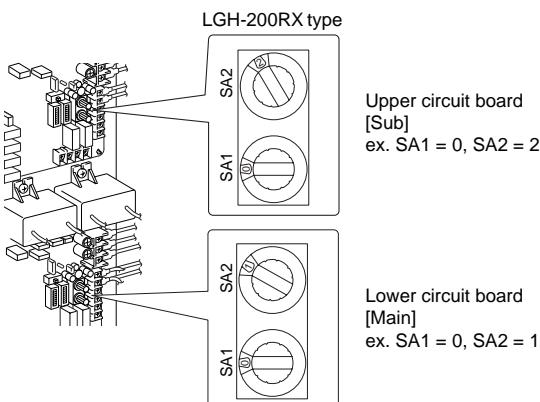

Use the following procedure when performing the address setting for dedicated Lossnay.

(The method to be employed in the determination of addresses will be dependent on the existing system. Refer to the appropriate technical documents for details.)

- (1) Remove the control box cover.
- (2) Use a straight-blade screwdriver to turn the address setting switch on the circuit board.
 - SA1 indicates the 10 digit and SA2 indicates the 1 digit.
 - The factory setting is "00"
 - On the LGH-200RX type, each upper and lower circuit board has an address. The lower circuit board takes the smaller number and the upper table takes the larger number.

12.3.2 Switching function selection switches (SW-2 and 5)

Perform the necessary function settings using the function selection switches (SW-2 and 5).

- The setting can be changed at any time.
- On the LGH-200RX type, set both the upper and lower circuit boards similarly.

1. Settings for pulse input

Set as shown when connecting the pulse signal equipment from a building maintenance system to an external input.

SW2	OFF	ON	Mode
	2		No pulse input (factory setting)
	2		Pulse input

2. Setting for selection of fan speed method

Set when operation is fixed at high speed or low speed operation. There are three modes that can be set.

SW2	OFF	ON	Mode	Operation
	4		Normal (Factory setting)	Switches High/Low by operation of the fan speed from remote control.
	4		Fixed at high mode	Normally operated at high speed.
	5		Fixed at low mode	Normally operated at low speed.

3. Power supply ON/OFF function (cannot be set when PZ-41SLB-E is used)

Set can be switch when operation and stopping is performed by turning the power supply (208-230 V) for the Lossnay on and off.

SW2	OFF	ON	Mode	Operation
	6		OFF (Factory setting)	Stopping and operation is performed according to settings of SW5-4 when the power is on.
	6		ON	Operation possible by turning power on and off.

4. Settings for delay (of operation at start-up of heating or cooling)

This is the mode for delaying the operation of the Lossnay for 30 minutes when the City Multi or Mr. Slim is started and when a external device is started. (If the PZ-41SLB-E is used, set it at the remote control. Refer to page 168.)

SW5	OFF	ON	Mode
	1		No operation delay (factory setting)
	1		Operation delay of 30 minutes * This function is invalid with in 2 hours' restart

5. Supply air fan monitor

SW5	OFF	ON	Mode
	2		Corresponds to operation mode output (TM3 ⑨,⑩) exhaust fan (factory setting)
	2		Corresponds to operation mode output (TM3 ⑨,⑩) supply fan (The operation monitor output is off when the supply fan is stopped for operation in cold regions or during the City Multi or Mr. Slim defrosting.)

6. Stopping exhaust fan when defrosting air conditioner

Sets the operation of the exhaust fan (when the air supply fan is stopped) during defrosting of the air conditioner when Mr. Slim or City Multi indoor unit is connected to a duct.

SW5	OFF	ON	Operation
	3		Exhaust fan operation (factory setting)
	3		Exhaust fan stopped

7. Settings for automatic recovery following power supply interruption (cannot be set when PZ-41SLB-E is used)

Sets for automatic recovery following power supply interruption.

	OFF	ON	Mode	Operation
SW5	4	<input type="checkbox"/>	No automatic recovery (factory setting)	Stop after recovery
	4	<input checked="" type="checkbox"/>	Automatic recovery	Recover to operate in mode used before power outage

8. Settings for filter cleaning

Set the time for filter cleaning based on the estimated concentration of dust in the air. The factory setting is unlimited. (If the PZ-41SLB-E is used, set it at the remote control. Refer to page 174.)

The four combinations of settings shown in the drawing to the bottom are available settings for air filter cleaning.

	OFF	ON	Maintenance
SW5	5	<input type="checkbox"/>	3000 hours
	6	<input checked="" type="checkbox"/>	
	5	<input checked="" type="checkbox"/>	1500 hours
	6	<input type="checkbox"/>	
5	5	<input type="checkbox"/>	4500 hours
	6	<input checked="" type="checkbox"/>	
6	5	<input checked="" type="checkbox"/>	Unlimited (No "FILTER" display on remote controller) (factory setting)
	6	<input type="checkbox"/>	

⚠ CAUTION:

- When the setting for the cumulative operation time of the Lossnay is exceeded, the filter cleaning display will appear on the air conditioner remote controller or the remote controller for the Lossnay. After cleaning the filter, the filter cleaning display can be reset by following the procedure for canceling the cumulative operation time as shown in the manual.

9. Settings for interlock mode

These settings will indicate how the Lossnay should operate when external devices are started or stopped. (If the PZ-41SLB-E is used, set it at the remote control. Refer to page 174.)

	OFF	ON	Mode	Units
SW5	7	<input type="checkbox"/>	ON/OFF interlock (Factory setting)	The Lossnay will start and stop in accordance with starting and stopping of an external devices. Subsequent operation will be possible using the remote controller for the Lossnay or MELANS.
	8	<input checked="" type="checkbox"/>		
	7	<input checked="" type="checkbox"/>	On interlock	The Lossnay will operate whenever an external devices are operated. Stopping of the Lossnay will be possible using its remote controller or MELANS.
	8	<input type="checkbox"/>	Off interlock	The Lossnay will stop whenever an external devices are stopped. Starting of the Lossnay will be possible using its remote controller or MELANS.
7	7	<input type="checkbox"/>	External input given priority	The Lossnay will start and stop in accordance with starting and stopping of an external devices. Control using the remote controller for the Lossnay or MELANS will only be possible when an external devices are stopped.
	8	<input checked="" type="checkbox"/>		

12.4 Trial operation

After the overall system has been installed, before the ceiling panel is installed, make sure that no wires are wrongly connected, then carry out trial operation, referring to the user's manual for the remote controller.

12.4.1 Trial operation with the remote controllers (PZ-41SLB-E and PZ-52SF-E)

Follow the procedure shown in the operator's manual for the remote controller for confirming the following items.

- (1) Starting operation.
- (2) Fan speed selection.
- (3) Function selection.
- (4) Stopping operation.

12.4.2 Lossnay independent trial operation

- (1) Remove the control box cover.
- (2) Turn the trial operation switch (SW2-1and SW2-3) "ON."
 - Operation will start with the "High" setting and with Bypass ventilation operating. (This will take approximately 45 seconds after the power is turned on.)
 - On the LGH-200RX type, set both the upper and lower circuit boards the same.
- (3) Turn the trial operation switch (SW2-1and SW2-3) "OFF."
- (4) Install the cover in its original position on the control box.

SW2	OFF	ON	Operation
	1	3	
			Power supply will be supplied to the motor for the Lossnay fan and operation will be performed at the "High" setting.
			Power supply will be supplied to the motor for the Lossnay by-pass and operation of the damper plate will be performed.

12.4.3 Trial operation within the complete system

- Interlock system containing an air conditioner and/or external device
 - Use the remote controller for the air conditioner or the operating switches for the external device and confirm that the air conditioner and Lossnay are interlocked.
 - If delay time has been set, check that the Lossnay operates after the delay time has passed.
- If MELANS System
 - Use MELANS to confirm the operation of the Lossnay.


12.4.4 If trouble occurs during trial operation

Symptom	Remedy														
Will not operate even when the operation switch for the remote controller (PZ-41SLB-E) and/or operation switch for the Lossnay remote controller (PZ-52SF-E) is pressed.	<ul style="list-style-type: none"> • Check the power supply. (The specified power supply is single-phase 208-230 V to 60 Hz.) • Check for a short circuit or disconnection in the transmission cable. (Check that the voltage between terminals in the transmission cables is 9 to 15 V DC for the PZ-41SLB-E and 20 to 30 V DC for the PZ-52SF-E.) • Check that there is 5 cm or more separating the transmission cable from the power supply cable and any other transmission cables. • Run the Lossnay independently using the trial operation switch (SW2-1) and check if it runs. <table border="1" style="margin-left: 20px;"> <tr> <td>Lossnay runs</td> <td>→</td> <td>Check the signal cables</td> </tr> <tr> <td>Lossnay doesn't run</td> <td>→</td> <td>Check the power supply</td> </tr> </table> • Check if there are three or more remote controller connected (PZ-41SLB-E). (The maximum is two.) • Perform the registration operation using the remote controller for the Lossnay (PZ-52SF-E) or MELANS. (Refer to the installation instructions for the remote controller for the Lossnay or MELANS.) 	Lossnay runs	→	Check the signal cables	Lossnay doesn't run	→	Check the power supply								
Lossnay runs	→	Check the signal cables													
Lossnay doesn't run	→	Check the power supply													
"HO" flashes in remote controller for Lossnay (PZ-52SF-E).	<ul style="list-style-type: none"> • Check whether or not there is a power supply unit and that the power has been turned on. (On systems with only a Lossnay, a power supply unit is required.) 														
Air conditioner or external device does not interlock.	<ul style="list-style-type: none"> • Check if the pulse input switch (SW2-2) is off. • Check the overall length between the air conditioner or external device and Lossnay. (Refer to technical publications or other such documents.) • Check the connections at the external control input terminal block (TM2). <p>In the case of voltage charged 12 or 24 V DC output unit: Connect to external control input terminals ① and ② . In the case of uncharged a-contact output unit: Connect to external control input terminals ① and ③. In the case of Mr. Slim (A-control): Connect to external control input terminals ① and ②.</p> • Perform the registration operation using the remote control for the air conditioner or MELANS. (Refer to the installation instructions for the remote control for the air conditioner or MELANS.) • Check if the delay has been set. • Check the overall length of the transmission cable between the external device and Lossnay. (Refer to technical publications or other such documents.) • Check if the transmission cable from the external device has come off of the external control input terminal. <table border="1" style="margin-left: 20px;"> <tr> <th></th> <th>Operation signal</th> <th>Stop signal</th> </tr> <tr> <td>Charged 12 or 24 VDC output unit</td> <td>12 or 24 V DC</td> <td>0 V DC</td> </tr> <tr> <td>Uncharged a-contact output unit</td> <td>Resistance: 0 W</td> <td>Unlimited resistance W</td> </tr> <tr> <td>Mr. Slim (A-control)</td> <td>2 to 6 V DC</td> <td>2 to 6 V DC</td> </tr> </table> • Check, in the case of multiple units, whether the Main/Sub selection switch on the Lossnay unit which is connected to the external control input terminal is set on the Master setting, and check whether the Main/Sub selection switch on other Lossnay units are set to Sub. 		Operation signal	Stop signal	Charged 12 or 24 VDC output unit	12 or 24 V DC	0 V DC	Uncharged a-contact output unit	Resistance: 0 W	Unlimited resistance W	Mr. Slim (A-control)	2 to 6 V DC	2 to 6 V DC		
	Operation signal	Stop signal													
Charged 12 or 24 VDC output unit	12 or 24 V DC	0 V DC													
Uncharged a-contact output unit	Resistance: 0 W	Unlimited resistance W													
Mr. Slim (A-control)	2 to 6 V DC	2 to 6 V DC													
Lossnay does not stop.	<ul style="list-style-type: none"> • Check that the trial operation switch (SW2-1) is set to off. 														
The inspection indicator lamp (LED 1 Green) in the control box flashes.	<table border="1" style="width: 100%;"> <tr> <td>2 flashes</td> <td>Failure of Lossnay circuit</td> <td rowspan="4" style="vertical-align: middle; text-align: center;">Turn off the power supply and immediately contact your dealer.</td> </tr> <tr> <td>3 flashes</td> <td>Failure of damper motor system</td> </tr> <tr> <td>4 flashes</td> <td>Failure of Lossnay (OA side) motor system</td> </tr> <tr> <td>5 flashes</td> <td>Failure of Lossnay (RA side) motor system</td> </tr> <tr> <td>ON</td> <td>In delay periodc</td> <td>If there is no remote controller (PZ-41SLB-E), the lamp will go out after 30 minutes (of operation) has passed.</td> </tr> </table>	2 flashes	Failure of Lossnay circuit	Turn off the power supply and immediately contact your dealer.	3 flashes	Failure of damper motor system	4 flashes	Failure of Lossnay (OA side) motor system	5 flashes	Failure of Lossnay (RA side) motor system	ON	In delay periodc	If there is no remote controller (PZ-41SLB-E), the lamp will go out after 30 minutes (of operation) has passed.		
2 flashes	Failure of Lossnay circuit	Turn off the power supply and immediately contact your dealer.													
3 flashes	Failure of damper motor system														
4 flashes	Failure of Lossnay (OA side) motor system														
5 flashes	Failure of Lossnay (RA side) motor system														
ON	In delay periodc	If there is no remote controller (PZ-41SLB-E), the lamp will go out after 30 minutes (of operation) has passed.													
The inspection indicator lamp (LED 2 Red) in the control box flashes.	<table border="1" style="width: 100%;"> <tr> <td>1 to 8 flashes</td> <td>Error in M-NET communication</td> <td rowspan="2" style="vertical-align: middle; text-align: center;">Turn off the power and immediately contact your dealer.</td> </tr> <tr> <td>ON</td> <td>Registration operation has not been performed.</td> </tr> </table>	1 to 8 flashes	Error in M-NET communication	Turn off the power and immediately contact your dealer.	ON	Registration operation has not been performed.									
1 to 8 flashes	Error in M-NET communication	Turn off the power and immediately contact your dealer.													
ON	Registration operation has not been performed.														

- When an inspection number blinks on the remote controller, follow the procedures shown in the installation and operating manuals provided with the switch.
- If the remote controller is not used, operate approximately 45 seconds after turning on the power for the Lossnay.

13. Lossnay Remote Controller (PZ-41SLB-E)

13.1 Operation

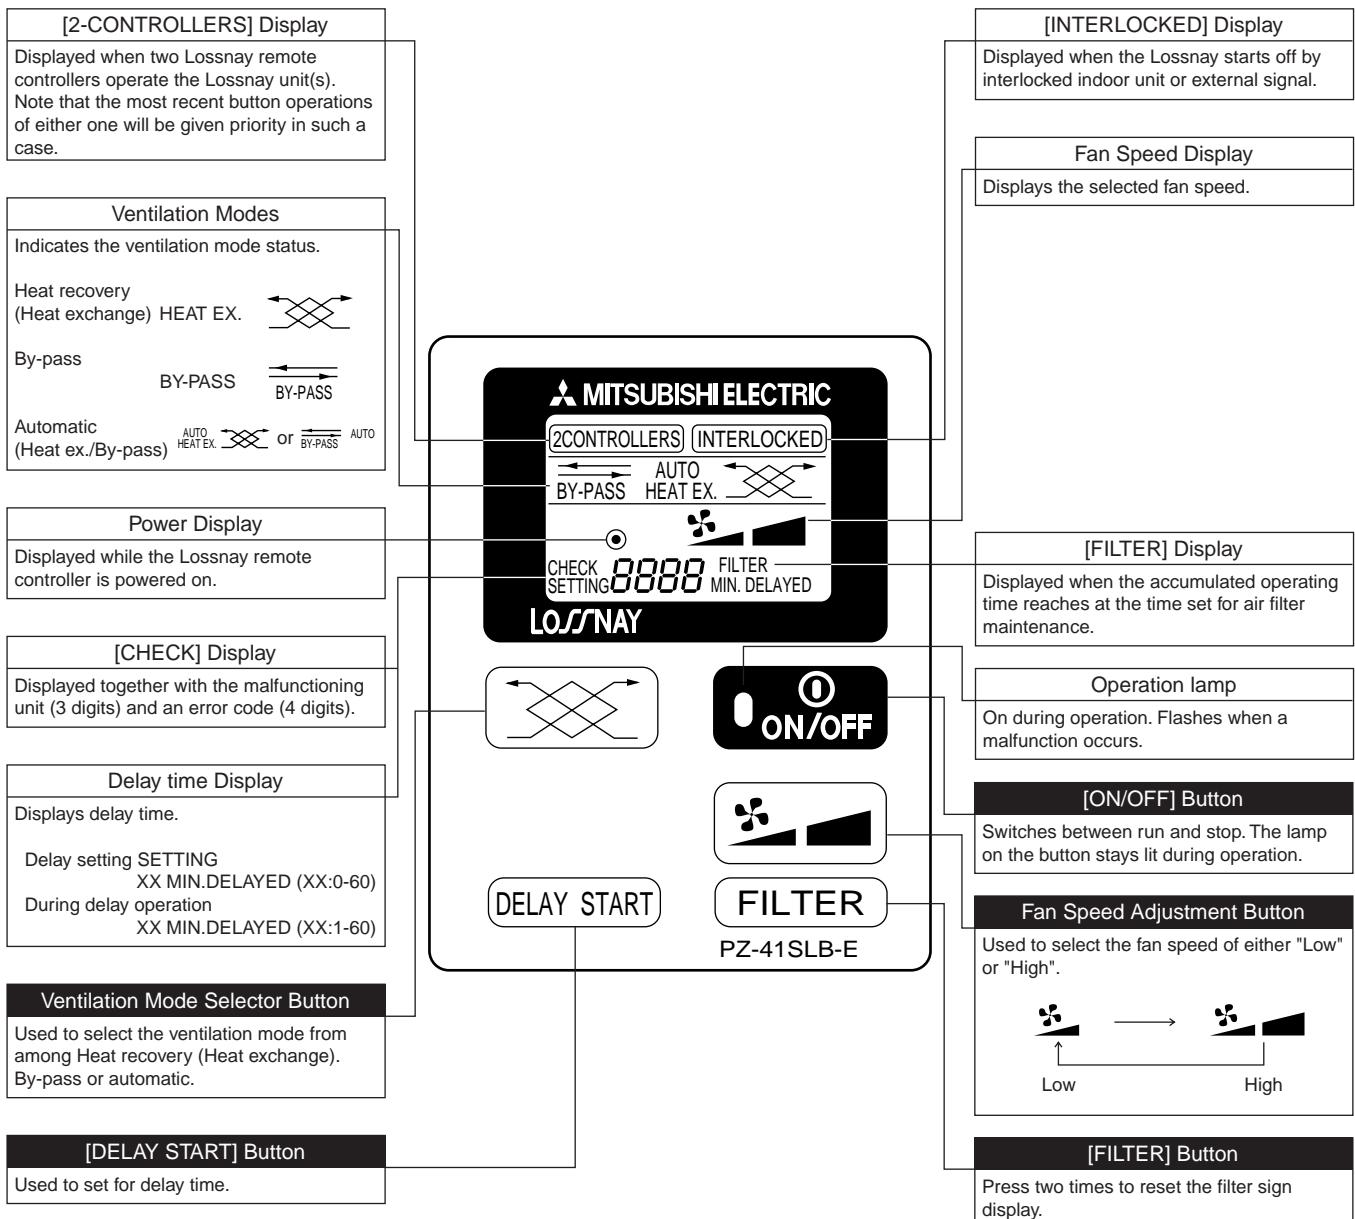








* Entire panel is displayed for explanation.

Note:

- When power is restored after an outage or when the corresponding breaker for the distribution box is reset, all modes will return to the condition before the supply of power was interrupted.

13.2 Mode of Use





● Independent Operation of the Lossnay Unit:

Operation	Relevant button	Relevant display items	Sequence
1. Starting the Lossnay unit	 Operation lamp		Press the ON/OFF button and confirm that the Operation lamp turns on. The 2CONTROLLERS display item will be turned on if a double set of remote controllers is currently in use.
2. Setting the Ventilation mode		 The above display indicates that the unit is operating in non-automatic, bypass ventilation mode.	Press the Function selector button: Each time it is pressed, the corresponding display will change in accordance with the sequence [HEAT EX.] (non-automatic) → [BY-PASS] (non-automatic) → [AUTO]. If [AUTO] is selected, the display will change to indicate the current situation after two seconds have passed. 
3. Selecting the fan speed		 The above display indicates current operation with a gentle fan speed.	Press the Fan Speed selector button to select either Low or High fan speed.
4. Stopping the Lossnay unit	 Operation lamp		Press the ON/OFF button. (Press the ON/OFF button to turn off the Operation lamp.)

● Interlocked Operation with Indoor unit or external signal.

The Lossnay unit can be set up in such a way that it may be turned on and off by external device such as an air conditioners. In such a case, the remote controller's [INTERLOCKED] display will be turned on. Note that the selection of ventilation mode and of fan speed can be performed in the same way as for independent operation of the Lossnay unit.

Settings for Interlocking the Lossnay unit with an external device

Setting	Relevant button	Relevant display items	Sequence
Delay time This setting is used to determine how long will elapse after the start of operation of the external device until the Lossnay unit begins to operate.	 Delay Start button	 The above display indicates a delay time of 30 minutes.	Each time the Delay Start button is pressed, the delay time will change in accordance with the repeating sequence (minutes)  When the button is released before 5 seconds have elapsed, the display will turn off and the current delay time will be selected. Note that a delay time of 0 minutes is set before shipment from the manufacturing plant.
Interlocked mode This setting is used to determine the way in which the Lossnay will respond to starting and stopping of Interlocked to an external device such as an air conditioner, etc. *: Note that the delay time will be invalidated in situations where a setting of [3] has been selected for the Operation mode or when the Lossnay unit is interlocked with a building-management system.		  The above indicates a setting of [2].	1. Press and hold the Function selector button for at least 5 seconds to display the interlock setting. Note that this is set to [1] before shipment from the manufacturing plant. 2. Press the Function selector button to change the setting in the repeating sequence  When the button is released before 5 seconds have elapsed, the display will turn off and the current setting will be selected.



Mode of Use (cont.)

Interlocked Operation mode types and actions

Display number	Interlocked Operation mode	Action (of the external unit)	Action (of the building-management system)
1	ON/OFF Interlocking: Subsequent operation with the remote controller possible (factory setting)	When the external device begins to operate, the Lossnay unit will also begin to operate; when the external air conditioner stops operating, the Lossnay unit will also stop operating.	The Lossnay unit toggles between ON and OFF conditions in response to signals (or pulses) which are input from a building-management system or the like.
2	ON Interlocking	When the external device begins to operate, the Lossnay unit will also begin to operate; stopping of the Lossnay unit must be performed using the remote controller.	The Lossnay unit begins to operate in response to a signal (or pulse) which is input from a building-management system or the like; stopping of the Lossnay unit must be performed using the remote controller.
3	OFF Interlocking	When the external device stops operating, the Lossnay unit will also stop operating; starting of the Lossnay unit must be performed using the remote controller.	The Lossnay unit stops operating in response to a signal (or pulse) which is input from a building-management system or the like; starting of the Lossnay unit must be performed using the remote controller.
4	ON/OFF Interlocking: External inputs have priority	Same as for setting 1 above; however, it is not possible to stop the Lossnay unit using the remote controller while the external device is operating.	Same as for setting 1 above.

13.3 Care and Upkeep

Actions required when the Filter Cleaning display begins to flash:

	Relevant button	Relevant display items	Sequence
Filter reset (i.e., clearing the total Lossnay-unit operating time)	 (Press twice)		Press the [Filter] button twice in immediate succession and confirm that the Filter display turns off.
Cleaning of the Lossnay unit's filter	Perform cleaning of the air filter and the Lossnay core in accordance with the instructions in the user's manual which was provided with the Lossnay unit.		
Care of the remote controller	To remove dirt from the remote controller's display window, wipe with a cloth to which detergent has been applied, and then wipe with a dry cloth to remove any remaining detergent. ● Paint thinner, alcohol, benzene, gasoline, kerosene, spray cleaner, cleaning alkali, etc.		


13.4 After-Sales Service

- If any of the following inspection numbers should be displayed on the remote controller, please contact the dealer from where this product was purchased for more information.

4000, 5101, 5102, 3602, 0900

- After-sales servicing of the remote controller unit should be ordered from the retail outlet from where this product was purchased.

13.5 Component Names and External Dimensions

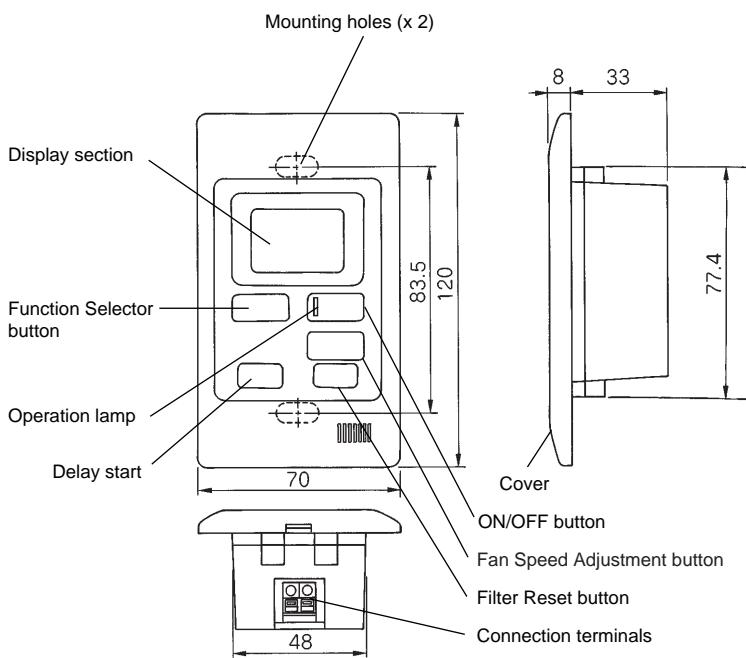


Accessory parts

Screws (x 2)


Typical System Setup

<Independent operation of the Lossnay unit:>


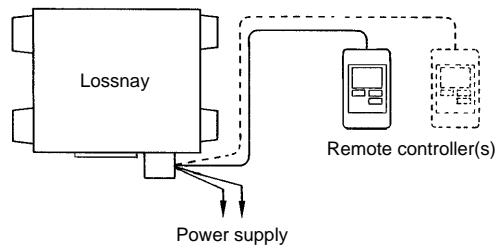


- When two individual remote controllers have been installed, the most recent control signals will be given priority.

<Interlocked operation with an air conditioners, etc.:>

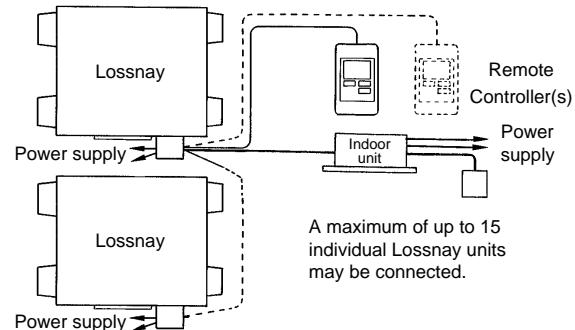

13.6 Installation Dimensions

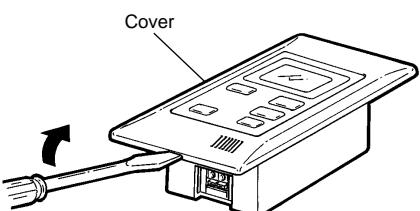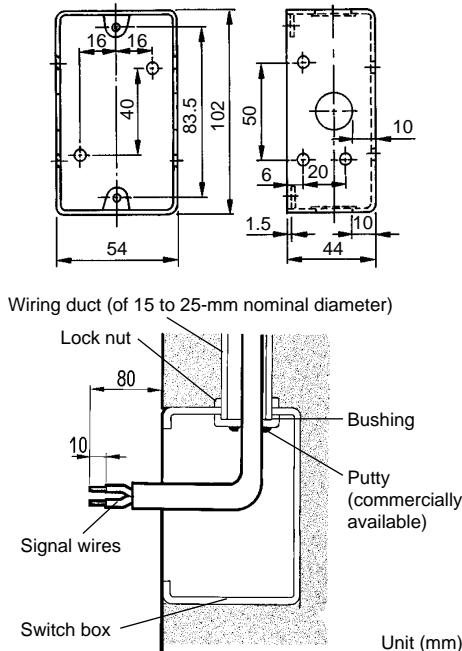

1. Wiring

- (1) Perform insertion of a single-unit switch box (without a cover).
- (2) Lay the wiring duct to the switch box.
- (3) Connect the signal wires from the Lossnay unit to the switch box.
(Note that 2-core telephone cable should be used; furthermore, this cable should be of PVC insulated PVC jacketed and either between $\varnothing 0.65$ and $\varnothing 1.2$, or between 0.3 mm^2 and 1.25 mm^2 in cross section.)
- (4) Use standard putty to create a secure seal to prevent frosting due to the intake of outdoor air.

Note:


- Confirm that the Lossnay unit's power supply is not turned on before connecting its signal wire to the switch box.

2. Cover removal

To remove the cover, insert the tip of a flat-head screwdriver into the notch and turn.

Note:

- Take care during removal of the cover to avoid any damage being caused.

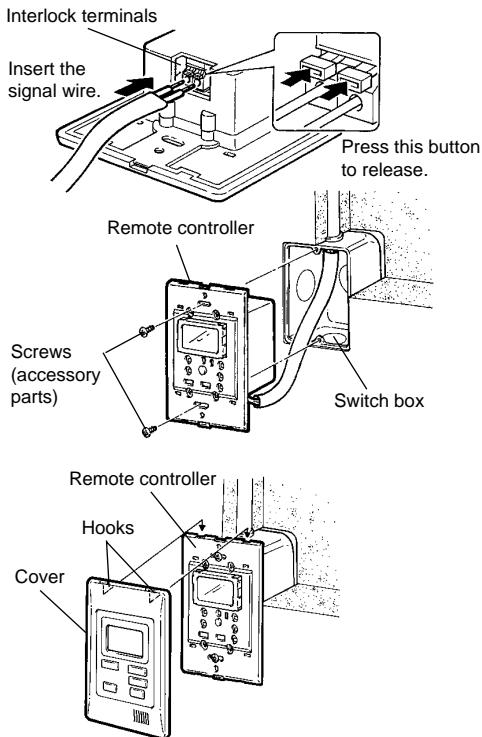


3. Connection of wiring and remote-controller mounting:

- (1) Fully insert the (non-polar) signal wiring into the connection terminals.
- (2) Gently tug on the wiring to confirm that it is being securely gripped.
- (3) Mount the remote controller on the switch box using the two screws provided as accessory parts.

5. Switching of function selection

(1) Setting for filter maintenance



When Lossnay unit has operated for the time set as the cumulative-operation time, the Filter display will begin to flash indicating the cleaning of the filter is required. This setting time should be selected in accordance with the degree of contamination of the air in the unit's installation location. To perform an actual setting, press and hold the FILTER button for at least five seconds to display the setting value and to turn on the Filter display.

FILTER Then, press the Filter button to change the setting value in the repeating sequence


(factory setting)

3000 → 4500 → OFF → 1500

↑

When the button is released before 5 seconds have elapsed, the display will turn off and the current replacement time will be selected. Note that this value is set to [3000] before shipment from the manufacturing plant.

(2) Setting for delayed interlocked operation



The delay-time setting is used to determine the length of the period that will elapse after the start of operation of the external devices until the Lossnay unit begins to operate. To perform an actual setting, press and hold the DELAY START button for at least five seconds while the Lossnay unit is currently stopped to display the setting value as shown in the diagram.

DELAY START Each time the DELAY START button is pressed, the delay time will change in accordance with the repeating sequence

(factory setting)

0 → 10 → 20 → 30 → 40 → 50 → 60 minutes.

↑

(0:original setting at factory shipment)

When the button is released before 5 seconds have elapsed, the display will turn off and the current delay time will be selected. Note that a delay time of 0 minutes is set before shipment from the manufacturing plant. Note also that when OFF Interlock mode has been selected, this setting value will be invalidated.

4. Mounting of the cover

To mount the cover, secure the two hooks at its upper edge and press on its lower section until it is heard to snap into place.

(3) Setting for interlocked mode



The Interlocked-mode setting is used to determine the way in which the Lossnay unit will respond to starting and stopping of interlocked external device such as an air conditioner, etc. To perform an actual setting, press and hold the **[X]** button for at least five seconds while the Lossnay unit is currently stopped to display the setting value as shown in the diagram.

[X] Press the switch to change the setting in the repeating sequence

(factory setting)

1 → 2 → 3 → 4

↑

(1:original setting at factory shipment)

When the button is released before 5 seconds have elapsed, the display will turn off and the current setting will be selected. Note that this value is set to [1] before shipment from the manufacturing plant.

	Interlocked Operation mode	Action
1	ON/OFF Interlocking	Starting and stopping of the Lossnay unit will be performed from external device -- specifically, when the external device begins to operate, the Lossnay unit will also begin to operate; when the external device stops operating, the Lossnay unit will also stop operating. Note that subsequent operation using the remote controller will be possible.
2	ON Interlocking	Starting of the Lossnay unit will be performed from external device -- specifically, when the external device begins to operate, the Lossnay unit will also begin to operate. Stopping of the Lossnay unit must be performed using the remote controller.
3	OFF Interlocking	Stopping of the Lossnay unit will be performed from external device -- specifically, when the external device stops operating, the Lossnay unit will also stop operating. Starting of the Lossnay unit must be performed using the remote controller.
4	ON/OFF Interlocking (with external-signal priority)	Starting and stopping of the Lossnay unit will be performed from external device -- specifically, when the external device begins to operate, the Lossnay unit will also begin to operate; when the external device stops operating, the Lossnay unit will also stop operating. However, it is not possible to stop the Lossnay unit using the remote controller while the external device is operating.

13.7 Trial Operation

After installation has been completed, it is of the utmost importance that trial operation of the Lossnay unit and any external device such as an air conditioner is carried out.

When power supply is supplied to the remote controller the [HO] display will flash (for approximately 40 seconds); following this, the system will switch to operation-start mode.

	Relevant button	Relevant display items	Sequence
1		- L N -	Initiate the supply of power to the Lossnay unit. (The [HO] display will flash for approximately 40 seconds)
2			Press the ON/OFF button. The Operation lamp will turn on and the Lossnay unit will begin to operate.
3			Press the Function selector button: Each time it is pressed, the corresponding display will change in accordance with the sequence [HEAT EX.] (non-automatic) → [BY-PASS] (non-automatic) → [AUTO].
4			Press the Fan Speed Adjustment button to toggle between Low and High.
5			Press the Operation switch. The Operation lamp will turn off and the Lossnay unit will stop operating.


- Note that when the Ventilation Mode selector button is pressed, it will take up to 40 seconds before the operation of the damper changes accordingly.

If an inspection number should be flashed, refer to the following table and take the required action.

Inspection number	Cause	Required action
0900	The SW2 trial-operation switch from the Lossnay unit's controll box is On.	Turn off the trial-operation switch. (refer to page 169)
6608	If two or more Lossnay units are currently being used together, this number will indicate that the correct setting has not been performed using the units' Main/Sub switches.	Turn off the power supply and use the Main/Sub switches to specify one Lossnay unit as the Main and the others as Sub. Following this, turn the supply of power back on. Note that all Lossnay units are specified as Main before shipment from the manufacturing plant. (refer to page 164)
	If two remote controllers are currently being used together, this number may indicate that one of these controllers is not connected.	Turn off the power supply, connect the remote controller, and turn the power supply back on. (refer to page 174)
	If two remote controllers are used together, this number may indicate that both of these controllers are not set automatically when the power supply is turned on.	Turn off the power supply and turn the power supply back on.
	Multi-core cable has been used in place of a number of signal wires.	Switch back to the use of standard wiring and install each signal wire separately.
4000	A circuit abnormality has occurred in the Lossnay unit.	Turn off the supply of power and contact the retail outlet from where this product was purchased for further instructions.
5101	A breakdown has occurred in the Lossnay thermo (OA side).	
5102	A breakdown has occurred in the Lossnay thermo (RA side).	
3602	A breakdown has occurred in the damper motor.	

14. Lossnay M-NET Remote Controller (PZ-52SF-E)

14.1 Operation

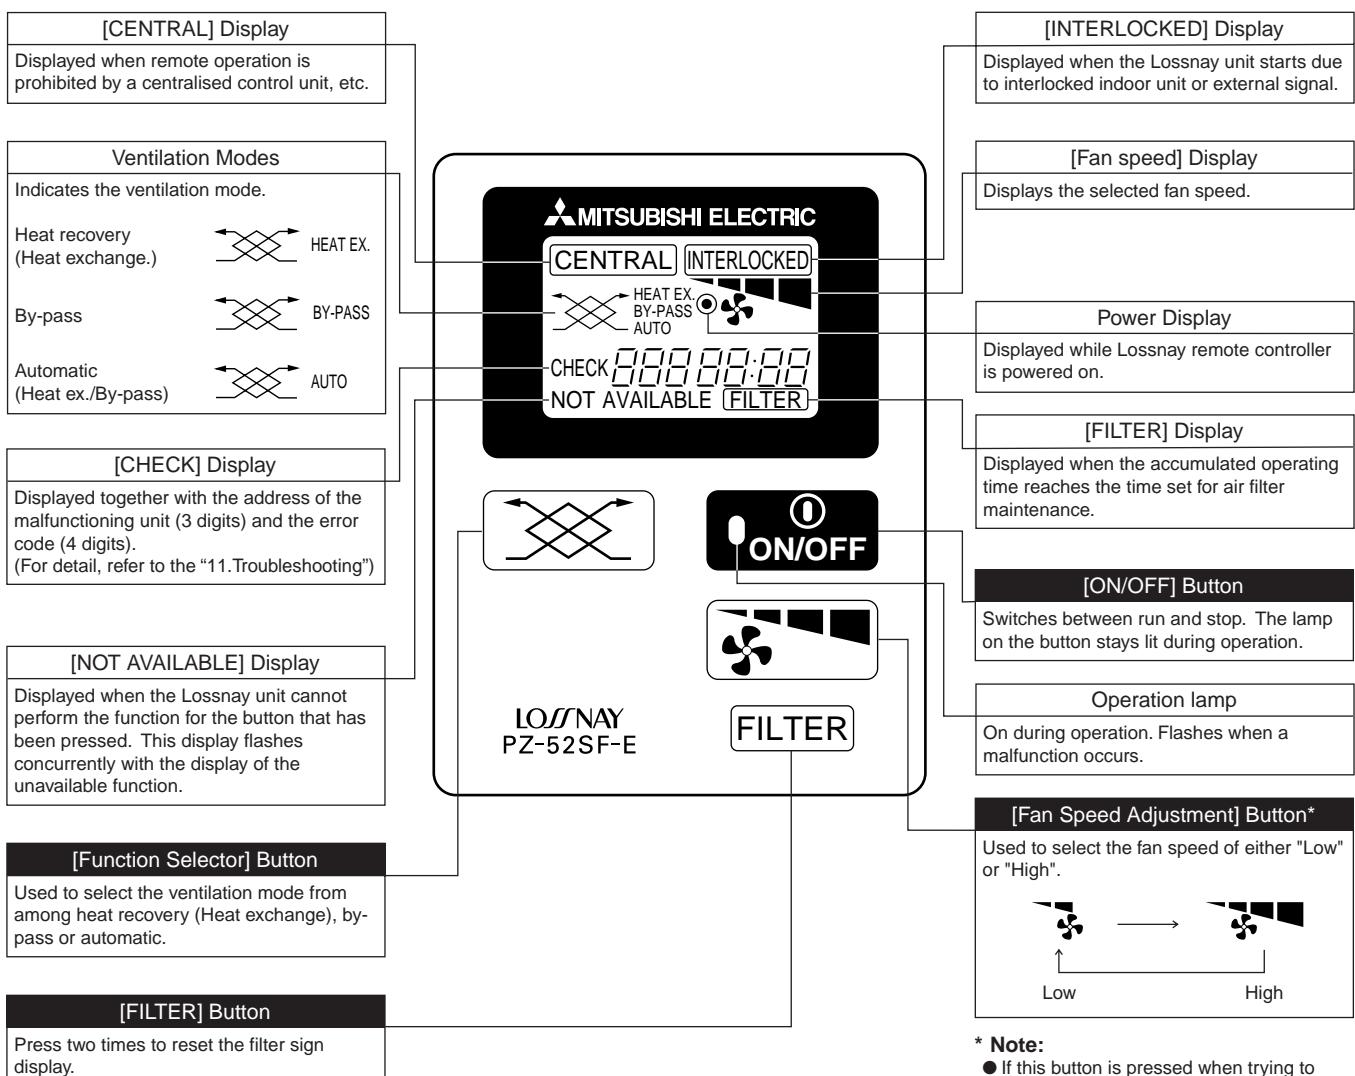


* Note:

- If this button is pressed when trying to switch the fan speed of a Lossnay unit not equipped with the fan speed adjustment, the fan speed display and the "NOT AVAILABLE" display flash and the fan speed does not change.

This remote controller can not be used on Lossnay units set for interlocked operation with Mr. Slim units.

14.2 Installing the Lossnay M-NET Remote Controller

14.2.1 Mount the switch box.

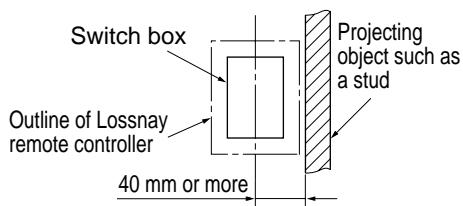


1. Install the switch box (purchased separately) as explained below.

Note:

- Be sure to install the switch box with the clearance shown in the illustration at the left. (Check the space between the unit and any projections, such as a stud.)
- Leave a space of 120 mm or more below the Lossnay M-NET remote controller so that a screwdriver can be used.


2. Purchase the thin copper wiring conduit, lock nuts and bushings separately.

14.2.2 Install the Lossnay M-NET Remote Controller.

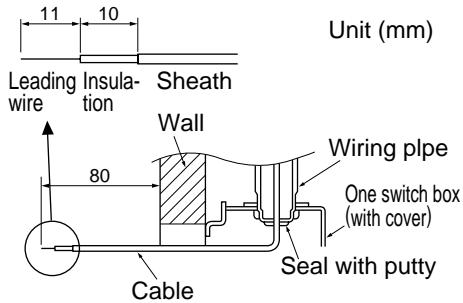

1. Pull out approximately 80 mm of cable from the wall and remove the insulation at the end.


2. Use putty to seal the cable hole in order to prevent insects from damaging the wiring and to prevent condensation on the Lossnay M-NET remote controller circuit board. If this hole is not sealed well, the Lossnay M-NET remote controller circuit board may be damaged.

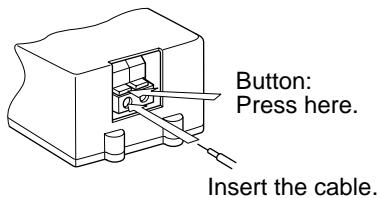

3. Connect the cable to the terminal board at the bottom rear of the Lossnay M-NET remote controller unit.


- The cable does not have polarity.
- When connecting stranded cable, hold down the tab on the terminal board while inserting the cable.
- The cable connects to the main terminal board when it is inserted into the bottom terminal.
- When disconnecting the cable, hold down the tab while pulling out the cable.
- After inserting the cable, slightly tug on it to check that it does not easily disconnect. If the cable is not securely connected, a short-circuit or malfunction may occur.


4. Remove the Lossnay M-NET remote controller cover using a standard screwdriver. Attach the Lossnay M-NET remote controller unit to the switch box using the two enclosed cross-recessed pan head screws. Use a standard screwdriver with a blade that is 4 mm or wider to remove the cover.

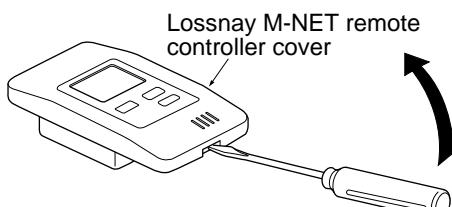

! CAUTION:

- Forcing off the cover using a screwdriver that is less than 4 mm wide may result in damage to the equipment or injuries.
- Attach the Lossnay M-NET remote controller to a level surface. Do not over-tighten the screws. Tight screws could damage or deform the case.

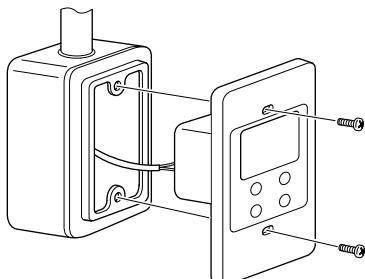

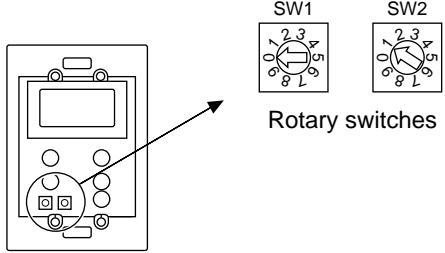

5. Set the Lossnay M-NET remote controller address.
Set the Lossnay M-NET remote controller address using the rotary switches SW1 and SW2 on the front of the Lossnay M-NET remote controller.

■ Setting range: 101 to 200

- Rotary switch SW1 indicates the tens column and SW2 indicates the ones column. In addition, 100 is automatically added to the setting as shown below.

Rotary switch setting	01 – 99	00
Lossnay M-NET remote controller address	101 – 199	200

The address is set to 01 when the Lossnay M-NET remote controller is shipped from the manufacturer.

⚠ CAUTION:

The address must be set if the Lossnay M-NET remote controller is to be used as a part of a multi-unit system. Set the address according to its position in the system. In addition, refer to page 166 for more information concerning the setting of the addresses.

6. After setting the Lossnay M-NET remote controller address, attach the Lossnay M-NET remote controller cover.


When attaching the Lossnay M-NET remote controller cover, set the top of the cover onto the two top hooks and then push in at the bottom of the cover until it snaps into place.

If the bottom of the cover is attached first, the top of the cover cannot be attached. Forcefully pushing in the top of the cover to attach it may break the hooks.

14.3 Registering the Lossnay Unit with the Lossnay M-NET Remote Controller


Initial registration mode operation

A Lossnay unit must be registered with the Lossnay M-NET remote controller in a group arrangement. Register a Lossnay unit using the initial registration mode as shown below. In addition, the initial registration mode can be used to search for a Lossnay unit registered to the group or to delete a registration.

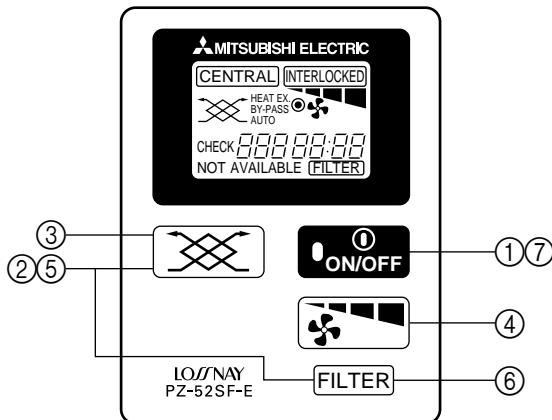

Setting Procedure


- ① Turn off the unit.
(Perform the following operation after "HO" flashes on the display.)
- ② Hold down both **HEAT EX** and **FILTER** for more than 2 seconds.
This starts the initial registration mode and the set Lossnay M-NET remote controller address flashes on the display.



- ③ Press **HEAT EX** to select the address of the Lossnay unit that you wish to register with this Lossnay M-NET remote controller.
After the button is pressed once, the Lossnay M-NET remote controller address and then the Lossnay unit address is displayed. Afterwards, each press of the button increase the Lossnay unit address by 1 as shown below. Holding down the button changes the address more quickly.

[101] → [---] → [001] → [002] → ⋯ → [098] → [099]
(Set Lossnay M-NET remote controller address) ↑
Flashes

- ④ When the address of the Lossnay unit that you wish to register is displayed, press **ON/OFF** to begin registering.
If the registration is completed correctly, the display appears as shown below.

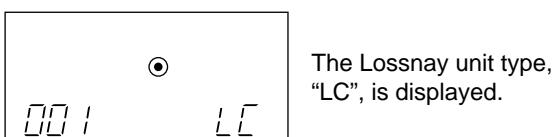

If the registration is not completed correctly, "88" flashes in the display. Check that the selected Lossnay unit address and the wiring are correct.

In the case of LGH-200RX type, there are 2 circuit boards installed in each unit. Because of this, set a separate address for each of the circuit boards, and register both of those addresses at the remote control.

- ⑤ After registering, hold down both **HEAT EX** and **FILTER** for more than 2 seconds to end the initial registration mode and the normal display appears.

Confirmation of registered address

- ⑥ To display the addresses of the Lossnay units that are registered with this Lossnay M-NET remote controller.


Each press of **FILTER** in step ② or ④ displays the address of a registered Lossnay unit and its type, "LC".

If no Lossnay unit is registered, " --- " appears in the address display and no type is displayed.


Address deletion

- ⑦ To delete the address of a Lossnay unit registered with this Lossnay M-NET remote controller.

Hold down [ON/OFF] twice for 2 seconds each time in either step ④ or after the registration is completed to delete the registration of the Lossnay unit that is currently displayed.



When the display appears as shown above, hold down [ON/OFF] for 2 seconds each time.



If the registration is deleted correctly, "--" appears in the display.

If the registration is not deleted correctly, "BB" flashes in the display. Check that the selected Lossnay unit addresses and the wiring are correct.

Note:

- In the case of LGH-50/100RX types, up to 16 Lossnay units can be registered. In the case of LGH-200RX type, up to 8 units can be registered.
- If the registration cannot be completed or deleted correctly, either the set address or the wiring of the Lossnay unit whose registration you wish to add or delete may be incorrect. Check the wiring and the address that is set.




15. Appendix

15.1 Centralised Controller (MJ-103MTRA)

15.1.1 Operation setting

- There are two methods for the operation, performing the operation classified by groups or collective operation.

Group operation setting

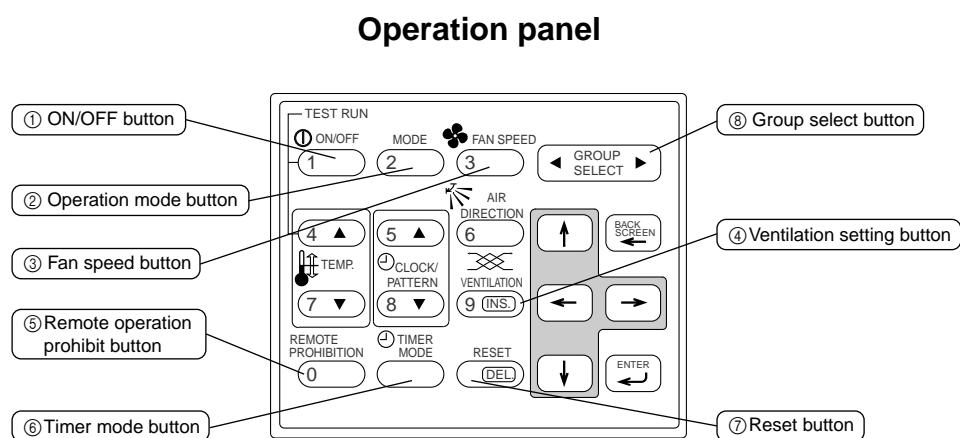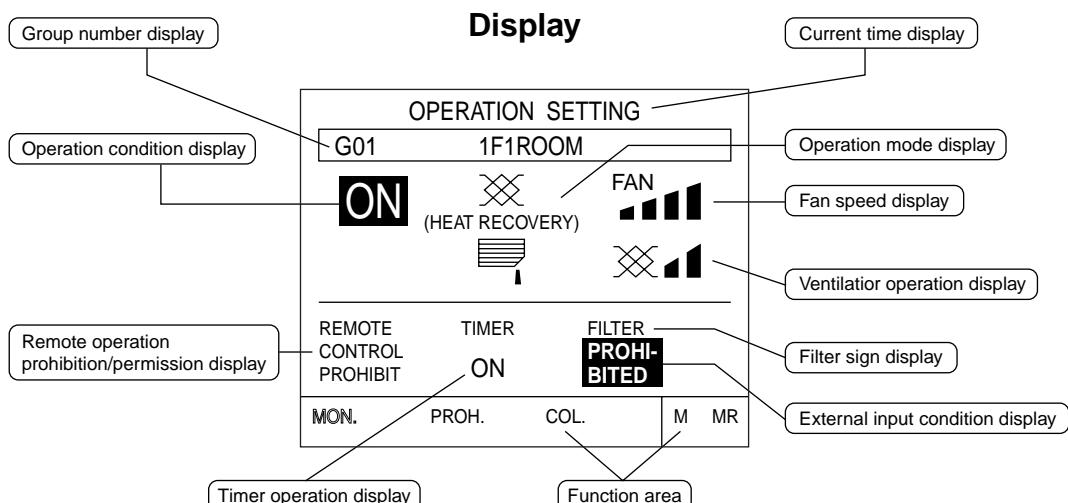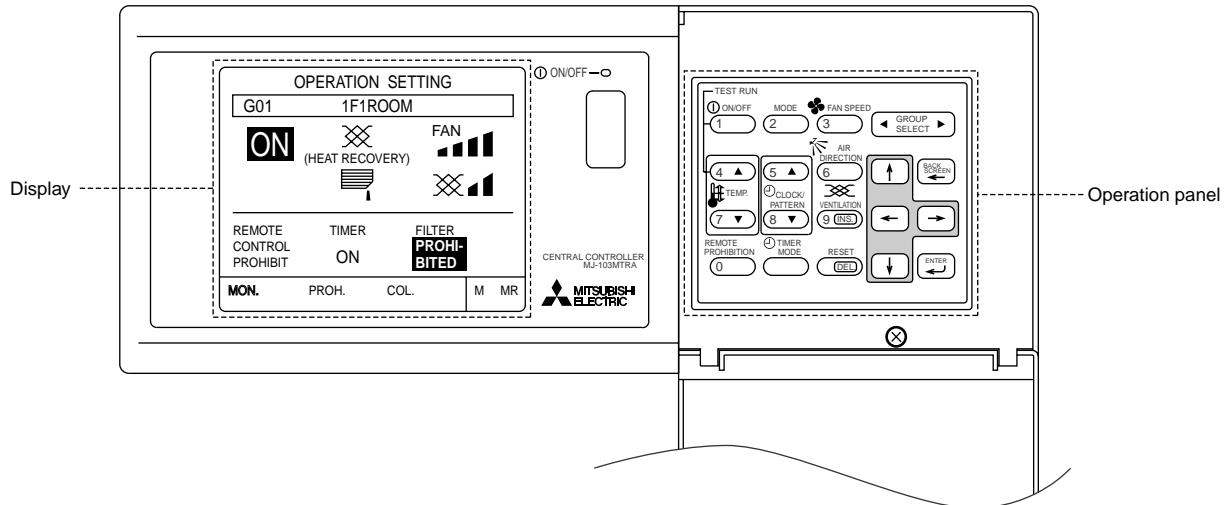


No.	Name of switches	Function	Display
①	ON/OFF button	The ON/OFF condition of the displayed group is switched. * When there is an interlocked Lossnay unit, turning this switch ON starts operation in a [High] fan speed state.	Operation status display → [ON] → [OFF] → * When there is an interlocked Lossnay unit, turning this switch ON starts operation in a [High] fan speed state.
②	Operation mode button	Used to the type of the operation mode selection.	On the group composed of independent Lossnay units, operation mode is selected in a sequence that goes from HEAT RECOVERY, AUTO, BYPASS and back to HEAT RECOVERY. → → →
③	Fan speed button	The Fan speed can be selected as high or low.	Fan speed display → → * In the case of a group composed only of Lossnay units this does not display.
④	Ventilation setting button	The operation mode of the interlocked Lossnay unit can be performed. * Where there is no interlocked Lossnay unit, the operation of this button is invalid.	Ventilation volume setting display → → →
⑤	Remote operation prohibit button	Used to prohibit for the local remote control.	PROHIBIT : Local remote control specified on the prohibit setting screen is not possible. PERMIT : Local remote control is possible.
⑥	Timer more button	The timer operation can be performed according to a previously set operation pattern.	Timer operation display [ON] → [OFF]
⑦	Reset button	The filter sign display reset is performed. The reset processing is completed by pressing this button two times.	Filter display [Filter] → No display
⑧	Group select button	The display group is changed.	Group number display This switch displays 1 to 50 group numbers. The switch can also display group names.

15.1.2 Initial setting

DIP switch and rotary switch setting

- Remove the cover from the controller and perform the DIP switch and rotary switch setting.

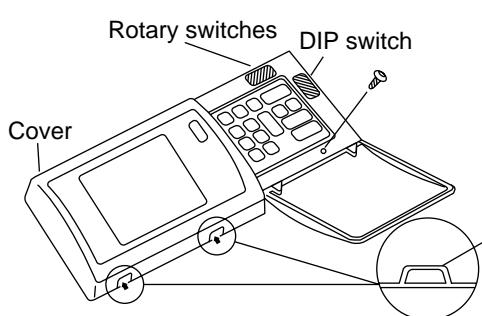

- ① Remove the cover screw.

Note:

- When this controller is shipped from the factory, the screw is contained in the same package.

- ② Insert a standard screwdriver into the slot and twist it to remove the cover from the upper case.

1. DIP switch setting

- The functions of this controller are set according to the DIP switch settings.
 - Each switch is set to the OFF and ON positions as shown below.




- The functions of this controller are selected by DIP switch.
 - The DIP switches are set to OFF when the controller is shipped from the factory.

DIP switch

1	<input checked="" type="checkbox"/>	ON	OFF: User operation mode	ON: Initial setting mode
2	<input checked="" type="checkbox"/>	OFF	OFF: Master system controller	ON: Slave system controller
3	<input checked="" type="checkbox"/>	OFF	OFF: No K-transmission converter installed	ON: K-transmission converter installed
4	<input checked="" type="checkbox"/>	OFF	OFF: Operation prohibit setting valid	ON: Operation prohibit setting invalid
5	<input checked="" type="checkbox"/>	OFF	Reserved for future use (Leave this switch set to OFF)	
6	<input checked="" type="checkbox"/>	OFF	External input changeover	
7	<input checked="" type="checkbox"/>	OFF		
8	<input checked="" type="checkbox"/>	OFF	The range of a controller which the operation is prohibited OFF: Both of the system controller and the local remote controller ON : Only the local remote controller	

2. Rotary switch setting

- The address of this controller is set by the rotary switch.
 - When this controller is shipped from the factory, the address is set to “000”.



Setting range: 000, 201-250


(Always set the address to "000" when K-transmission converter is being controlled.)

15.1.3 Group configuration setting

- Registration can be made for the indoor units, local remote controllers and slave system controllers in the same group.
 - Registration can also be performed for the group that is composed of only Lossnay.

Example of a group configuration

- Supply the power from the power supply unit (PAC-SC34KUA) through the M-NET transmission cable.

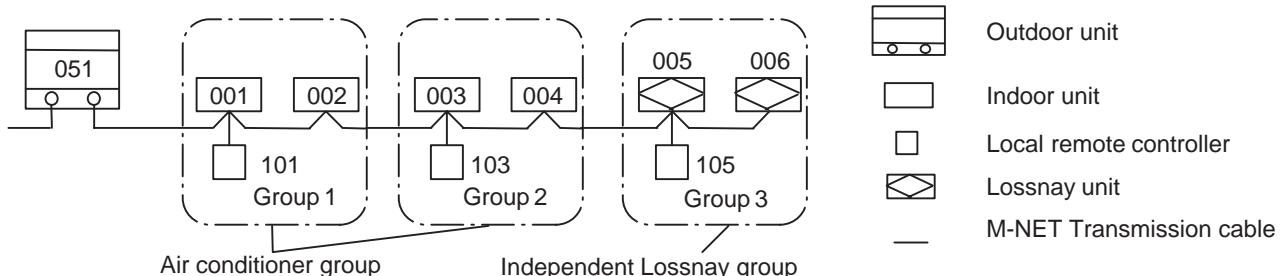

- Perform the following procedures to set the group configuration because the interlocked operation setting will not be performed for the group configuration settings that have not been set.

MENU

1 GROUP SETTING

**PLEASE SET
GROUP CONFIGURATION**

- ① When the power is supplied to the controller, the screen shown on the left is displayed.
 - ② Press the button to select “1 GROUP SETTING”.

GROUP SETTING	
G01	
ADDRESS	
UNIT	<input type="text"/>
REMOTE CONTROLLER	
SYSTEM CONTROLLER	
GROUP NAME SET	
GROUP SETTING	
G01	
ADDRESS	
UNIT	
001	002
REMOTE CONTROLLER	
101	
SYSTEM CONTROLLER	
GROUP NAME SET	

The configuration setting screen is displayed.

- ③ Press the  button to display the group number to be set.
 - ④ Press the     button to move the cursor to the address display position to be set.
 - ⑤ Use the numeric keypad to set the address of the indoor unit, local remote controller, and slave system controller in the display group number.

Operation example

For an indoor unit with an address of 012.

- 1) Input "0"
2) Input "1"
3) Input "2"
4) Press the  button. 012
* It is also possible to enter "1" "2".

When the input is incorrect

Press the → button and continue to input the data. After pressing the → button, move the cursor to the addresses to be deleted and press the  button to delete these addresses.

Note:

- Do not set Lossnay units with the intention of interlocked operation, such as Lossnay, on this group setting menu.
 - Even if the addresses are input in a non-sequential order, they will be switched to sequential order starting with the lowest address.
 - The independent Lossnay unit cannot be set to the indoor unit group and it cannot be set as an interlocked Lossnay unit.

GROUP SETTING	
G03	
ADDRESS	
UNIT	
005 006	
REMOTE CONTROLLER	
SYSTEM CONTROLLER	
GROUP NAME SET	

This is the procedure for registering all units and controllers in the displayed group number.

⑥ Repeat operation ③ to ⑤ to set all the groups controlled by this controller.

⑦ When all settings have been completed, press the  button.

Note:

- Be sure to set the local remote controller address when there is a local remote controller in the system. The local remote controller will not operate if the address setting is not performed.



⑧ The initial setting screen is displayed.

Registration processing for the group configuration information and initial set up processing for each unit and each controller is executed when DIP switch No. 1 is set to OFF.

(This process takes approximately five minutes.)

Note:

- If DIP switch No. 1 is set to ON at this time, the initial setting menu screen is displayed without the initial setting screen.

⑨ The user operation menu is displayed.

Once the group configuration settings are completed, user operation can be performed. Refer to Section "15.1.4 Interlocked Operation Setting" when performing interlock operation settings.

Additions:

Deleting all group configuration data.

- Display "G00" on the group configuration setting screen and press the  button two times consecutively to delete all group configuration data and all interlocked operation data.


Note:

- Group registration cannot be made when this unit is set to the slave system controller by the DIP switch No. 2. However, confirmation of the contents of the group registration is possible.
- To change the group configuration setting, set DIP switch No. 1 in the cover to ON. This will bring up the initial setting menu screen. From that screen, select "1 GROUP SETTING" on the setting menu screen. Wait for the screen to appear and then change the setting.

15.1.4 Interlocked operation setting

- This is the procedure for registering the interlocked operation of an Lossnay unit with a single or multiple indoor units.
All indoor units to be interlocked with an Lossnay unit for operation should be registered as group before-hand.

Example of an interlocked group configuration

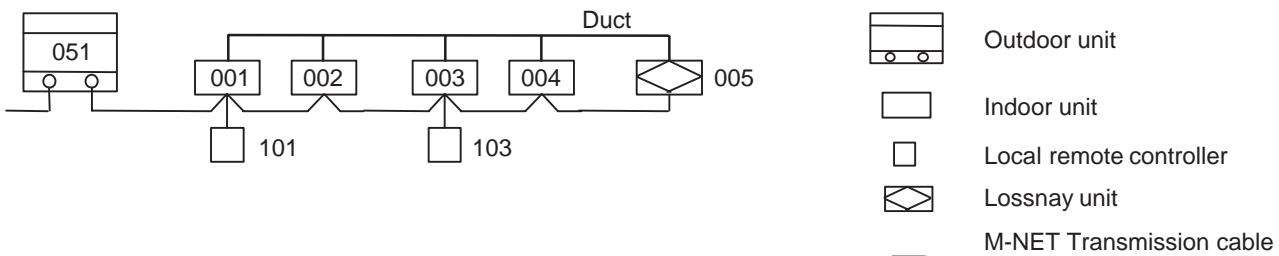

MENU	WED 15:29
1 OPERATION MONITOR 2 OPERATION SETTING 3 SCHEDULE SETTING 4 MALFUNCTION MONITOR 5 CURRENT TIME SETTING	

① Set DIP switch No. 1 in the cover to ON.

Note:

- Always uses the DIP switch No. 1 to change the setting.
This operation will be invalid if performed on another screen.

MENU	
1 GROUP SETTING 2 INTERLOCKED SETTING 3 REFRIGERANT MONITOR 4 MALFUNCTION LOG MONITOR 5 USER SETTING	

② The initial menu screen is displayed.

③ Press the **[2]** button to select "2 INTERLOCKED SETTING".

INTERLOCKED SETTING	
INTERLOCKED UNIT ADDRESS	005
UNIT ADDRESS	<input type="text"/>

④ The interlocked setting screen is displayed.

The minimum address of the interlocked processing unit that can be set to interlocked operation with an indoor unit is displayed in "INTERLOCKED UNIT ADDRESS". The cursor is displayed in the unit address display position.

⑤ Press the **[GROUP SELECT]** button to display the address number of the interlocked Lossnay unit that the setting will be performed on.

INTERLOCKED SETTING	
INTERLOCKED UNIT ADDRESS	005
UNIT ADDRESS	<input type="text"/>

- ⑥ Use the numeric keypad to set the address of the indoor unit to operate with the displayed Lossnay unit.

Operation example

For an indoor unit with an address of 012.

- 1) Input "0". 0
- 2) Input "1". 01
- 3) Input "2". 012
- 4) Press the button. 012
* It is also possible to enter "1" "2".

When the input is incorrect

Press the button and continue to input the data. After pressing the button, move the cursor to the addresses to be deleted and press the button to delete these addresses.

INTERLOCKED SETTING	
INTERLOCKED UNIT ADDRESS	005
UNIT ADDRESS	001 002 003 004 <input type="text"/>

- ⑦ Set the indoor units to operate with the displayed interlocked Lossnay unit.
- ⑧ Repeat operation ⑤ to ⑦ to set the indoor units in interlocked operation controlled by this controller.
- ⑨ When all settings are completed, press the button.

MENU	
1 GROUP SETTING	
2 INTERLOCKED SETTING	
3 REFRIGERANT MONITOR	
4 MALFUNCTION MONITOR	
5 USER SETTING	

Initial setting screen is displayed.

This ends the interlocked operation setting.

Return to where user operations are performed to set DIP switch No. 1 to OFF. After the initial settings processing has been completed, the initial setting screen will be displayed.

Note:


- The interlocked operation settings cannot be adjusted when this unit is set to being a slave system controller by the DIP switch No. 2. However, monitoring of the contents of the interlocked operation settings is possible.

Please refer to the related documentation for details about the centralised controller.

15.2 Remote Controllers for Mr. Slim indoor unit

A-control remote controller (PAR-20MAA)

Without Lossnay interlock switches and indicators.

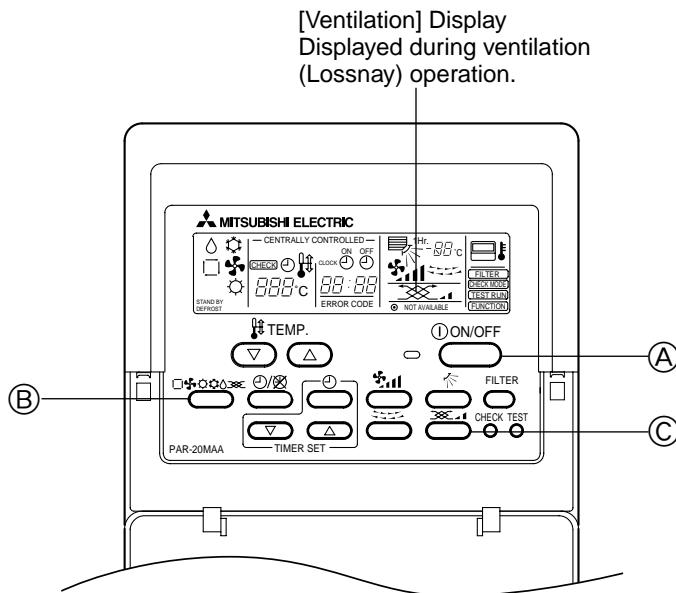


15.2.1 Method for operating Lossnay with A-control remote controller (when interlocked with Mr. Slim)

When operating Lossnay separately

- Press the "ON/OFF" button ④.
- Press the "Selecting operation" button ⑤. The display will show .
 - Use when you only want ventilation and there is no need for heating or cooling operation.
 - The does not display when the unit is not connected for interlocked operation with a ventilation unit.

When changing Lossnay fan speed

- Press the "Ventilation" button ⑥.



- The setting changes each time you press the button.

When running interlocked ventilation operation

- Press the "ON/OFF" button ④.
- If there is a ventilation unit connected for interlocked operation, the ventilation unit will start operating automatically.
- Press the "Ventilation" button ⑥.
- The Lossnay fan speed can be set to High or Low.

15.2.2 Function Selection

Perform only when change is necessary with Mr. SLIM air conditioner.

(Cannot be performed with CITY MULTI control system.)

Set the functions of each indoor unit from the remote controller, as required. The functions of each indoor unit can be selected only from the remote controller. Set the functions by selecting the necessary items from Table 1.



Table 1. Function selection contents (For a detailed description of the factory settings and mode of each indoor unit, refer to the indoor unit installation manual.)

Function	Settings	Mode No.	Setting No.	Check	Object unit address No.
Power failure automatic recovery	Not available	01	1		Unit address No. 00 These items are set for all indoor units.
	Available (Approximate 4 minutes wait-period after power is restored.)	01	2		
Indoor temperature detecting	Indoor unit operating average	02	1		
	Set by indoor unit's remote controller	02	2		
	Remote controller's internal sensor	02	3		
LOSSNAY connectivity	Not Supported	03	1		Unit address No. 01 to 04 or AL
	Supported (indoor unit is not equipped with outdoor-air intake)	03	2		
	Supported (indoor unit is equipped with outdoor-air intake)	03	3		
Power voltage	240 V	04	1		
	220 V, 230 V	04	2		
AUTO mode	Energy saving cycle automatically enabled	05	1		
	Energy saving cycle automatically disabled	05	2		
Filter sign	100 Hr	07	1		
	2500 Hr	07	2		
	No filter sign indicator	07	3		
Fan speed	Quiet	08	1		
	Standard	08	2		
	Standard	08	3		
High ceiling ①	High ceiling ①	PL(H)(A)-P-AA type			
	High ceiling ②	PL(H)(A)-P-AA type			
	High ceiling ③	PL(H)(A)-P-AA type			
No. of air outlets	4 directions	09	1		
	3 directions	09	2		
	2 directions	09	3		
Installed options (high-performance filter)	Not supported	10	1		
	Supported	10	2		
Up/down vane setting	No vanes	11	1		
	Equipped with vanes (No. 1 set)	11	2		
	Equipped with vanes (No. 2 set)	11	3		
Energy saving air flow (Heating mode)	Disabled	12	1		
	Enabled	12	2		
Humidifier (Direct Add-on type)	Not supported	13	1		
	Supported	13	2		

NOTE: When the indoor unit functions were changed using the function selection after installation is complete, always indicate the set contents by entering ○ or other mark in the appropriate check field of Table 1.

[Function selection flow]

First grasp the function selection flow. The following describes setting of Room temperature detection position of Table 1 as an example. (For the actual setting procedure, see [Setting procedure] ① to ⑩.)

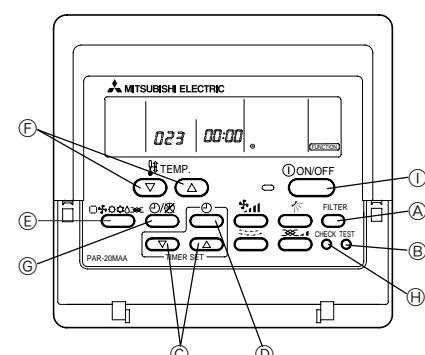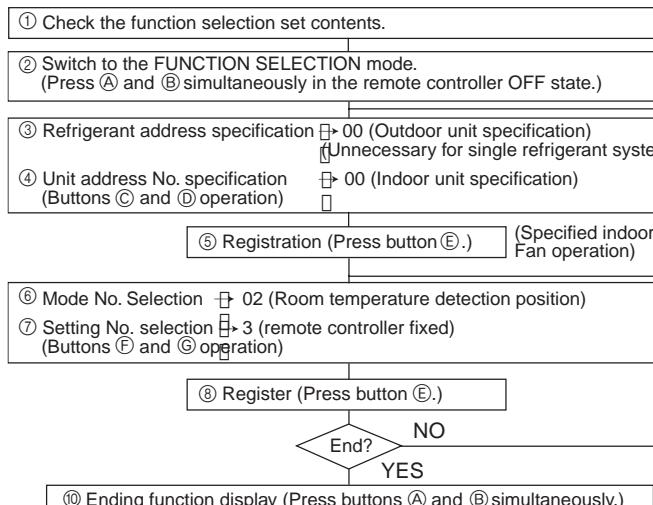

[Procedure] (Set only when change is necessary.)

- ① Check the set contents of each mode. When the set contents of a mode were changed by function selection, the functions of that mode also change.
Check the set contents as described in steps ② to ⑦ and change the setting based on the entries in the Table 1 check field. For the factory settings, refer to the indoor unit installation manual.

② Set the remote controller to Off.

Press and hold down the Ⓐ [FILTER] and Ⓑ [TEST] buttons at the same time for two seconds or longer.
"FUNCTION" blinks for a while, then the remote controller display changes to the display shown below.



* If the remote controller enters the OFF state after the "FUNCTION" and room temperature displays "88" have flashes for two seconds, communication is probably abnormal. Make sure there are no noise sources near the transmission line.

NOTE: If you make a mistake during operation, end function selection by step ⑩ and repeat selection from step ②.

③ Set the outdoor unit refrigerant address No.


When the Ⓒ [TIMER SET (▽) and (△)] buttons are pressed, the refrigerant address No. decreases and increases between 00 and 15. Set it to the refrigerant address No. whose function you want to select. (This step is unnecessary for single refrigerant system.)



* If the remote controller enters the OFF state after the "FUNCTION" and room temperature displays "88" have flashes for two seconds, communication is probably abnormal. Make sure there are no noise sources near the transmission line.

④ Set the indoor unit address No.

Press the Ⓓ [Timer selection] button. The unit address No. display "—" flashes.



When the Ⓒ [TIMER SET (▽) and (△)] buttons are pressed, the unit address No. changes in 00 → 01 → 02 → 03 → 04 → AL order. Set it to the unit address No. of the indoor unit whose function you want to set.


* When setting mode 1 to 3, set the unit address No. to "00".

* When setting modes 7 to 11:

- When setting for each indoor unit, set the unit address No. to "01-04".
- When batch setting for all indoor units, set the unit address No. to "AL".

⑤ Refrigerant address and unit address No. registration

Press the Ⓔ [Mode selection] button. The refrigerant address and unit address No. are registered.
After a while, the mode No. display "—" flashes.




* When "88" flashes at the room temperature display, the selected refrigerant address is not in the system.

When "F" is displayed at the unit address No. display, and when it flashes together with the refrigerant address display, the selected unit address No. does not exist. Correctly set the refrigerant address and unit address No. by repeating steps ② and ③.

When registered using the Ⓔ [Mode selection] button, the registered indoor unit begins fan operation. When you want to know the location of the indoor units of the unit address No. whose functions were selected, check here. When the unit address No. is 00 or AL, all the indoor units of the selected refrigerant address perform the fan operation.

Ex) When refrigerant address 00, unit address No. = 02 registered

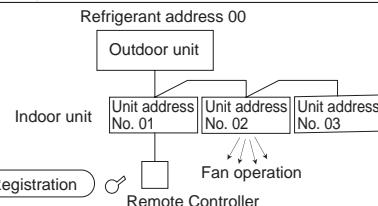


* When grouping by different refrigerant systems and an indoor unit other than the specified refrigerant address performs the fan operation, the refrigerant address set here is probably duplicated.

Recheck the refrigerant address at the outdoor unit rotary switches.

⑥ Mode No. selection

Select the mode No. you want to set with the Ⓕ [TEMP. (▽) and (△)] buttons. (Only the settable mode numbers can be selected.)




Mode No. 02 = Room temperature detection position

⑦ Select the setting contents of the selected mode.

When the Ⓒ [Timer selection] button is pressed, the current setting No. flashes. Use this to check the currently set contents.

Select the setting No. using the Ⓕ [TEMP. (▽) and (△)] buttons.




Setting No. 1 = Simultaneous operation indoor units balance

Setting No. 3 = Remote controller built-in sensor

⑧ The contents set at steps ③ to ⑦ are registered.

When the Ⓔ [Mode selection] button is pressed, the mode No. and setting No. flash and registration begins. The flashing mode No. and setting No. change to a steady light and setting ends.




* When "—" appears at the mode No. and setting No. displays and "88" flashes at the room temperature display, communication is probably abnormal. Make sure there are no noise sources near the transmission line.

⑨ To select more functions, repeat steps ③ to ⑧.

⑩ End function selection.

Press and hold down the Ⓐ [FILTER] and Ⓑ [TEST] buttons at the same time for two seconds or longer.


After a while, the function selection display disappears and the remote controller returns to the air conditioner off display.



* Do not operate the air conditioner from the remote controller for 30 seconds after the end of function selection.

NOTE: When the functions of an indoor unit were changed by function selection after the end of installation, always indicate the set contents by entering a ○ or other mark in the appropriate check field of Table 1.

15.3 Network Remote Controller (PAR-F27MEA)

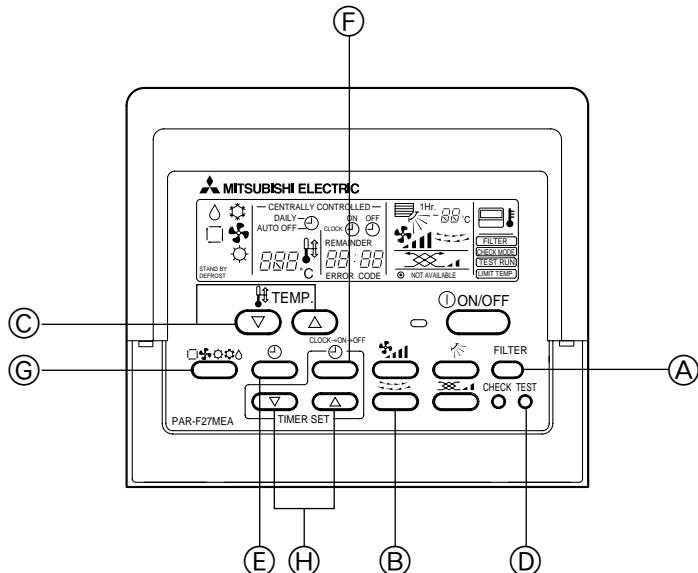


15.3.1 Method for Operating Lossnay with Network remote Controller (When Interlocked with City Multi Indoor Unit)

Operation method is same as A-control remote controller. Refer to page 190.

15.3.2 Initial registration mode


This is the procedure for registering the address of the indoor unit with the remote controller.

- ① Stop the remote controller by pressing the [ON/OFF] button.
 - If not indoor unit is registered, the "HO" display appears in the room temperature display. In this condition, registration can be performed as follows.
- ② Display "INDOOR UNIT ADDRESS NO."
 - Press and hold down both the [FILTER] button (shown as Ⓐ) and the "Louver" button (shown as Ⓑ) at the same time for 2 seconds. The following display will appear.

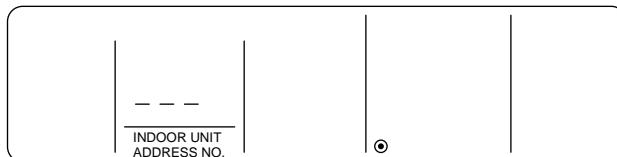


15.3.3 Interlocked registration

- ③ Display the "OA UNIT ADDRESS NO."
 - Press the "Operation mode" button (shown as Ⓒ) and the following display will appear.
Press once again to return to "INDOOR UNIT ADDRESS NO." shown in Step ②.

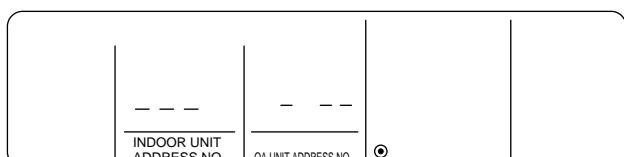


Both "INDOOR UNIT ADDRESS NO." and "OA UNIT ADDRESS NO." will appear simultaneously.

- Use the Δ and ∇ [TEMP] buttons (shown as Ⓓ) to select the address of the indoor unit.
Set it to the address of the indoor unit to be interlocked.
- Use the Δ and ∇ [TIMER SET] buttons (shown as Ⓔ) to select the address of the Lossnay unit to be registered.

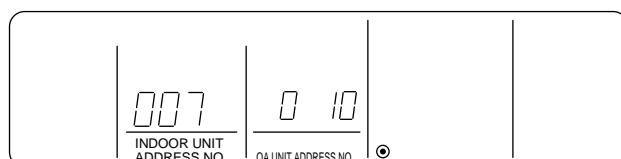

- ④ To register the interlocked operation of the Lossnay unit and the indoor unit.
- Use the [TEST RUN] buttons (shown as ⑩) to register the relationship of the interlock between the Lossnay indicated in "OA UNIT ADDRESS NO." and the indoor unit indicated in "INDOOR UNIT ADDRESS NO."

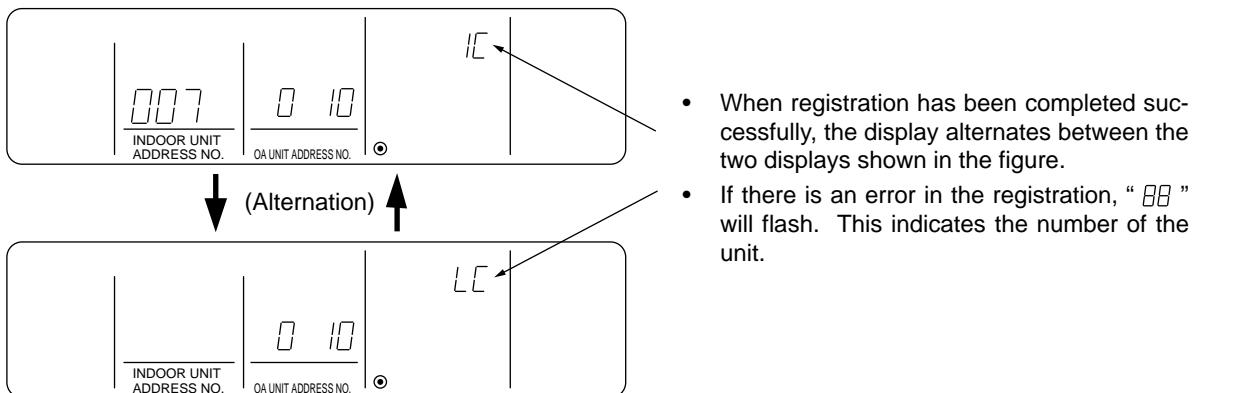


- ⑤ To return to the normal operation mode.
- Press and hold down both the [FILTER] button (shown as Ⓐ) and the "Louver" button (shown as Ⓑ) at the same time. This returns the unit to the normal operation mode. (OFF)

Note:


- Be sure to set the indoor unit to the lowest address number in a group followed by the Lossnay unit. If this is not performed, the Lossnay unit will not operate.
- If there are multiple indoor units to be interlocked with the Lossnay unit, perform Steps ③ and ④ above for each of them.

15.3.4 Searching for interlocked registered units


- ⑥ Display the indoor unit address No. at "OA UNIT ADDRESS NO."
- Press the "Operation mode" button (shown as ⑩) and the following display will appear. Press once again to return to "INDOOR UNIT ADDRESS NO." shown in Step ②.

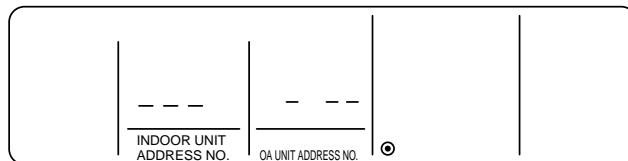


- ⑦ Use the ▲ and ▼ [TIMER SET] buttons (shown as ⑪) to select the address of the indoor unit to be registered. Select the indoor unit address number to be confirmed.

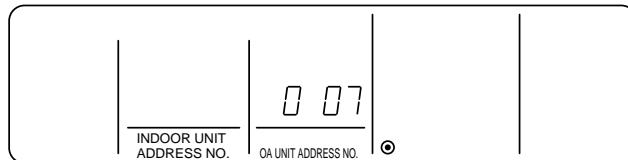

- ⑧ Press the "Timer/continuous" button (shown as ⑫). The display alternates between the two displays shown here.

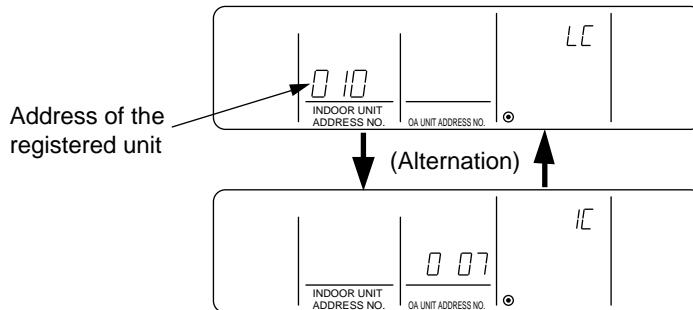

- ⑨ Press the “Timer/continuous” button (shown as ⑤) once again. The display will now alternate between the registered unit and the address of the next registered unit. (The way of display is the same as in step ⑧.)

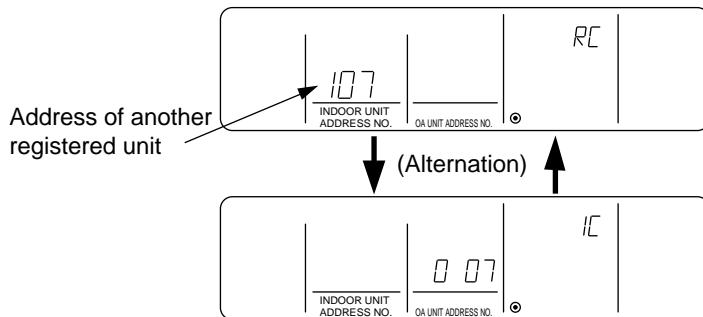


- ⑩ To return to the normal operation mode.


Press and hold down both the [FILTER] button (shown as ④) and the “Louver” button (shown as ②) at the same time. This returns the unit to the normal operation mode (OFF).

15.3.5 To delete linked unit entries

- ⑪ From the initial registration mode display, perform an address search for linked units. Display the addresses of the Lossnay units to be deleted. Press the “Time conversion” button (shown as ⑥) twice to delete these units which are displayed according to their address number with the indoor unit.

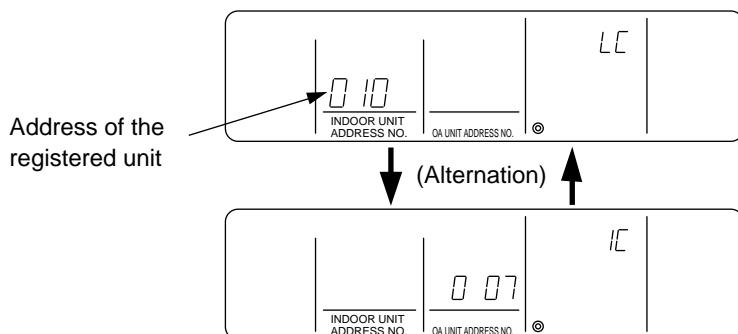

When the above is displayed, press the “Time conversion” button (shown as ⑥) twice.

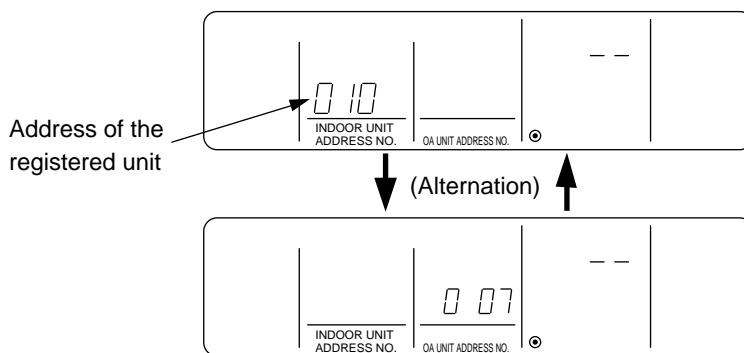

If the transmission is faulty, the properties will flash as “*BB*”. Check the wiring and the address definitions and then do the above operation again.

- ⑫ To return to the normal operation mode.

Press and hold down both the [FILTER] button (shown as ④) and the “Louver” button (shown as ②) at the same time. This returns the unit to the normal operation mode (OFF).

MEMO



MITSUBISHI ELECTRIC CORPORATION