

TWINNING REQUIREMENTS
FOR P-SERIES STANDARD AIR-CONDITIONING / HEAT-PUMP & HYPER HEAT-PUMP SYSTEMS

Job Name:	Location:	Date:
Purchaser:	Engineer:	
Submitted to:	For <input type="checkbox"/> Reference <input type="checkbox"/> Approval <input type="checkbox"/> Construction	
System Designation:	Schedule No.:	

Indoor Units:



Outdoor Units:



Note: Mitsubishi Electric (MESCA) supports the use of only MESCA supplied and approved Snow Guard / Wind Deflectors / Windscreens and accessories for proper functioning of the unit(s). Use of non-MESCA supported Snow Guard / Wind Deflectors / Windscreens and accessories will affect warranty coverage.

GENERAL FEATURES

- Through twinning, operate two indoor units from one outdoor unit—ideal for single area and unusually shaped rooms/zones or long narrow rooms/zone applications
- One hard-wired, wall-mounted PAR-33MAA remote controller simultaneously controls both indoor units.
- Supply voltage (L1, L2) from the outdoor unit, supplies power to both indoor units through S1, S2, S3.
- A-Control: The S1, S2, S3 wire from the outdoor unit, goes directly to indoor unit 1 and then to indoor unit 2.
- Control signal is transmitted between outdoor unit and both indoor units via data over the power connections
- Required Accessory for Combining Indoor Units: MSDD-50TR-E Distribution Pipe Kit (includes one distribution pipe each for liquid and gas, and choice of joint adapters)

TWINNING REQUIREMENTS

Outdoor Units	Indoor Units X 2			
PUY/PUZ-A24NHA7	PEAD-A12AA(7)(8)	PKA-A12LA	PLA-A12EA7*1	PVA-A12AA7
PUY/PUZ-A36NKA7	PEAD-A18AA(7)(8)	PKA-A18LA	PLA-A18EA7*1	PVA-A18AA7
PUZ-HA36NKA	PEAD-A18AA(7)(8)	PKA-A18LA	PLA-A18EA7*1	PVA-A18AA7


*1 Refer to the piping length limitation

Model	PEAD-A12AA7	PEAD-A18AA7	PKA-A12HA7	PKA-A18HA7	PLA-A12EA7	PLA-A18EA7	PVA-A12AA7	PVA-A18AA7	PU(Y)(Z)-A24NHA7	P(Y)(Z)-A36NKA7	PUZ-HA36NKA
MCA (A)	1.45	1.69	1	1	1	1	3	3	19	25	26
MOCP (A)	-	-	-	-	-	-	-	-	26	31	42
Breaker Size (A)	-	-	-	-	-	-	-	-	25	30	35

Please refer to Twinning Application Piping Information for special case rules.

PIPE SIZE AND LIMIT TO REFRIGERANT PIPE

Actual pipe length (m)		Height Difference (m)		Note *2 Number of bends	
Indoor-Outdoor	A + B + C =	Indoor-Indoor	Indoor-Outdoor		Indoor-Indoor
PUZ-A24 PUZ-A36	50m or less	B - C = 8m or less	H = 30m or less	h = 1m or less	15 or less
PUY-A24/36 PUZ-HA36	75m or less				

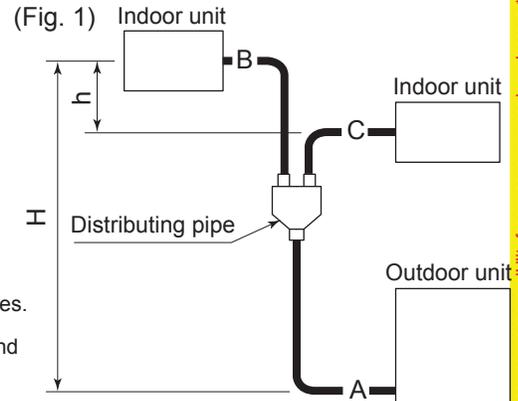

Note 2 Limit the number of bends for refrigerant pipes to 8 in each of the (A+B) and (A+C) ranges.

See the installation manual provided with the main unit for details on chargeless pipe length and refrigerant additional charge amount.

- Maximum total piping length for PUY/PUZ-A24,36:
 - with 2x PLA-A12EA7 is 59 ft (18m)
 - with 2x PLA-A18EA7 is 98 ft (30m)
 - All other combinations is 165 ft (50m)
- Maximum total piping length for PUZ-HA36 Outdoor Units: 245' (75 m)
- Maximum height difference from IDU to IDU: 3 ft (1 m)
Maximum length difference from IDU to IDU: 26 ft (8 m)
- Maximum height difference from ODU to IDUs: 100' (31 m); note: piping lengths to each IDU unit do not have to be equal
- For the NH/KA7 generation: both IDUs must have the same capacity, but do not have to be the same style. (PEA, PEAD, PKA, PLA, and PVA IDUs can be combined for one system.)
- Twinned IDUs operate simultaneously only; individual IDU control is not available
- One PAR-40MAA remote controller controls both IDUs simultaneously
- Temperature setpoint is set from the PAR-40MAA, choose one of three options on the controller to set the temperature sensing
 - Average of the data from both IDU return air sensors (factory setting) - Data from the return air sensor in the IDU directly connected to the PAR-40MAA - Data from the sensor in the PAR-40MAA only
- ODU is automatically controlled using Mitsubishi Electric's INVERTER Technology; compressor, frequency, and LEV position will be adjusted as needed to maintain selected room conditions
- Refer to P-Series Installation or Technical Service Manuals for wiring diagrams

Should this document be altered or changed without MIESCA's permission, it becomes null and void. MIESCA assumes no responsibility for any consequences in such cases.

