

Job Name:

Schedule Reference:

Date:



OUTDOOR VRF HEAT PUMP SYSTEM

UNIT OPTION

Standard Model.....PQHY-P360TSLMU-A1

ACCESSORIES

- Twinning Kit ... (Required - sold separately) CMY-Y200CBK2
- T-Branch Joint (≤ 72,000 Btu/h) CMY-Y102SS-G2
- T-Branch Joint (73,000 - 144,000 Btu/h) CMY-Y102LS-G2
- T-Branch Joint (145,000 - 234,000 Btu/h) CMY-Y202S-G2
- T-Branch Joint (≥ 235,000 Btu/h) CMY-Y302S-G2
- Header - 4 Branch (Capacity: ≤ 72,000 Btu/h) CMY-Y104C-G
- Header - 8 Branch (Capacity: ≤ 144,000 Btu/h) CMY-Y108C-G
- Header - 10 Branch (Capacity: ≤ 234,000 Btu/h) CMY-Y1010C-G

* All electrical work shall comply with National (NEC) and local codes and regulations.

Specifications		System	Module 1	Module 2
Unit Type		PQHY-P360TSLMU-A1	PQHY-P192TLMU-A1	PQHY-P168TLMU-A1
Nominal Cooling Capacity	Btu/h	360,000	192,000	168,000
Nominal Heating Capacity	Btu/h	405,000	215,000	188,000
External Dimensions (H x W x D)	In. / mm	Refer to Module Data	57-1/8 x 34-11/16 x 21-11/16 / 1,450 x 880 x 550	57-1/8 x 34-11/16 x 21-11/16 / 1,450 x 880 x 550
Net Weight	Lbs. / kg	962 / 436	481 / 218	481 / 218
Electrical Power Requirements	Voltage, Phase, Hertz	Refer to Module Data**	208/230V, 3-phase, 60Hz	
Cooling Power Input	kW	29.43	Refer to System Data	
Heating Power Input	kW	22.85	Refer to System Data	
Cooling Current (208/230V)	A	90.7-82.0	Refer to System Data	
Heating Current (208/230V)	A	70.4-63.7	Refer to System Data	
Minimum Circuit Amp. (MCA)** (*)	A	Refer to Module Data**	54 / 49**	44 / 39**
Maximum Fuse Size**	A	Refer to Module Data**	90 / 80**	70 / 70**
Circulating Water (quality must meet regulations)				
Flow Rate	GPM / L/s	63.4 / 4	31.7 / 2	31.7 / 2
Pressure Drop	psi	12.7	6.38	6.38
Operation Volume Range	GPM / L/s	39.6 - 101.8 / 2.6 - 6.4	19.8-50.9/ 1.3-3.2	19.8-50.9/ 1.3-3.2
Maximum Water Pressure	MPa / psi	4 / 580	2 / 290	2 / 290
Water-source Connections (Each for Inlet and Outlet)	In.	Refer to Module Data**	NPT1-1/2 Screw (Install strainer (more than 50 meshes) at water inlet piping of the unit)	
Piping Diameter				
From Twinning Kit to Indoor Units (Brazed) (In. / mm)	Liquid (High Pressure)	3/4 / 19.05	Refer to System Data	
	Gas (Low Pressure)	1-5/8 / 41.28	Refer to System Data	
From Modules to Twinning Kit (Brazed) (In. / mm)	Liquid (High Pressure)	Refer to Module Data	5/8 / 15.88	5/8 / 15.88
	Gas (Low Pressure)	Refer to Module Data	1-1/8(28.58)	1-1/8(28.58)
Indoor Unit	Total Capacity	50 to 130% of WSUs	Refer to System Data	
	Model / Quantity	P06 ~ P96 / 2 to 50	Refer to System Data	
Sound Pressure Levels	dB(A)	60	58	56
Compressor Operating Range		8- 100%	Refer to System Data	
Compressor Type x Quantity		Refer to Module Data	Inverter-driven Scroll Hermetic x 1	Inverter-driven Scroll Hermetic x 1
Compressor Motor Output	kW	Refer to Module Data	12.4	11.0
Compressor Crankcase Heater	kW	Refer to Module Data	-	-
Refrigerant		Refer to Module Data	R410A	
Lubricant		Refer to Module Data	MEL32	
High-pressure Protection Device		Refer to Module Data	601 psi / 4.15 MPa	601 psi / 4.15 MPa
Compressor / Fan Protection Device		Refer to Module Data	Overheat Protection	Overheat Protection
Inverter Protection Device		Refer to Module Data	Overheat / Overcurrent Protection	Overheat / Overcurrent Protection

** Each individual module requires a separate electrical connection. Reference electrical data for each individual module.


Should this document be altered or changed without MESCA's permission, it becomes null and void. MESCA assumes no responsibility for any consequences in such cases.

Note: Mitsubishi Electric (MESCA) supports the use of only MESCA supplied and approved accessories for proper functioning of the unit(s). Use of non-MESCA supported accessories will affect warranty coverage.



Specifications are subject to change without notice.

Unit: mm(in)

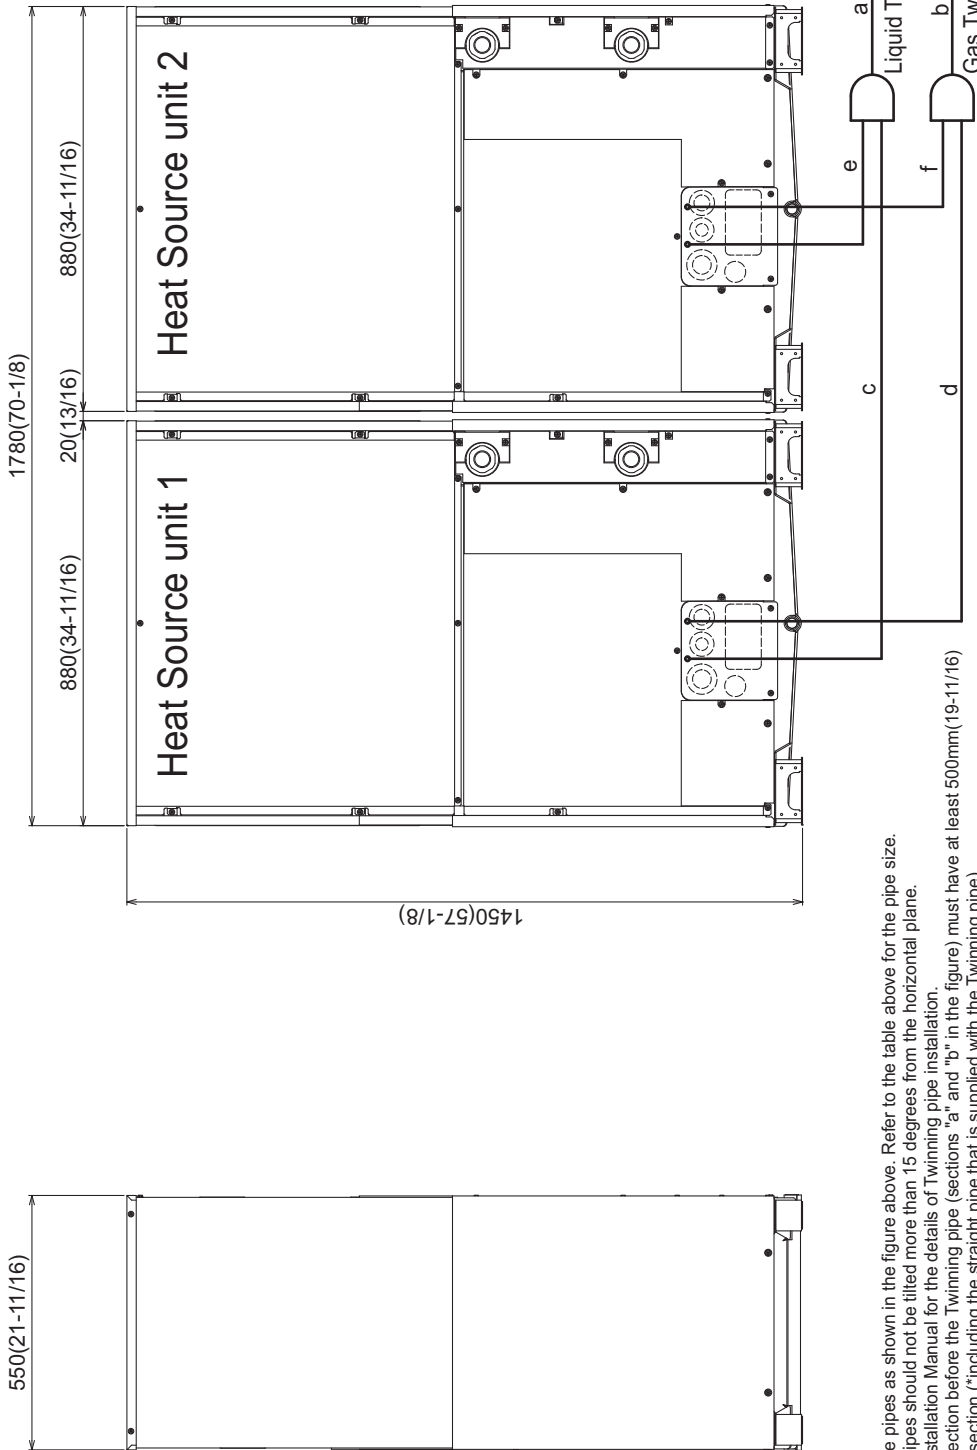

- Note 1. Connect the pipes as shown in the figure above. Refer to the table above for the pipe size.
 2. Twinning pipes should not be tilted more than 15 degrees from the horizontal plane.
 3. See the Installation Manual for the details of Twinning pipe installation.
 4. The pipe section before the Twinning pipe (sections "a" and "b" in the figure) must have at least 500mm(19-11/16) of straight section (*including the straight pipe that is supplied with the Twinning pipe).
 5. Only use the Twinning pipe by Mitsubishi (optional parts).

Twinning pipe connection size

Package unit name	PQHY-P288TSLMU-A1	PQHY-P317TSLMU-A1	PQHY-P336TSLMU-A1	PQHY-P360TSLMU-A1
Component unit name	Heat Source unit 1	PQHY-P144TSLMU-A1	PQHY-P168TSLMU-A1	PQHY-P192TSLMU-A1
Component unit name	Heat Source unit 2	PQHY-P144TSLMU-A1	PQHY-P168TSLMU-A1	PQHY-P168TSLMU-A1
Twinning Kit(optional parts)	CMY-Y200CBK2			
Indoor unit-Twinning pipe	ø19.05(3/4)			
Liquid	a			
Gas	b			
Twinning pipe-Heat Source unit 1	ø34.93(1-3/8)		ø41.28(1-5/8)	
Liquid	c	ø15.88(5/8)		
Gas	d	ø28.58(1-1/8)		
Twinning pipe-Heat Source unit 2	ø12.7(1/2)		ø15.88(5/8)	
Liquid	e	ø28.58(1-1/8)		
Gas	f	ø28.58(1-1/8)		


Specifications are subject to change without notice.

Should this document be altered or changed without MESCA's permission, it becomes null and void. MESCA assumes no responsibility for any consequences in such cases.


Modules: 1 : PQHY-P168TLMU-A1 - DIMENSIONS

Unit: mm(in)

- Refrigerant (Liquid) conn. pipe.....1pc.
- (P144/P168/P192; Packaged in the accessory kit)
- Refrigerant (Gas) conn. elbow.....1pc.
- (P144/P168/P192; Packaged in the accessory kit)
- Water stopper(Liquid,Gas).....1pc. each
- (P144/P168/P192; Packaged in the accessory kit)
- Sealing material for water stopper (Liquid,Gas).....1pc. each
- (P144/P168/P192; Packaged in the accessory kit)
- Sealing material for field piping (Liquid,Gas).....1pc. each
- (P144/P168/P192; Packaged in the accessory kit)
- Sealing material for drain socket.....1pc.
- (P144/P168/P192; Packaged in the accessory kit)
- Pipe cover for gas.....1pc.
- (P144/P168/P192; Packaged in the accessory kit)
- Sealing material for base leg (two types).....4pc. each
- (P144/P168/P192; Packaged in the accessory kit)
- Sealing material for panel.....1pc.
- (P144/P168/P192; Packaged in the accessory kit)




Top view

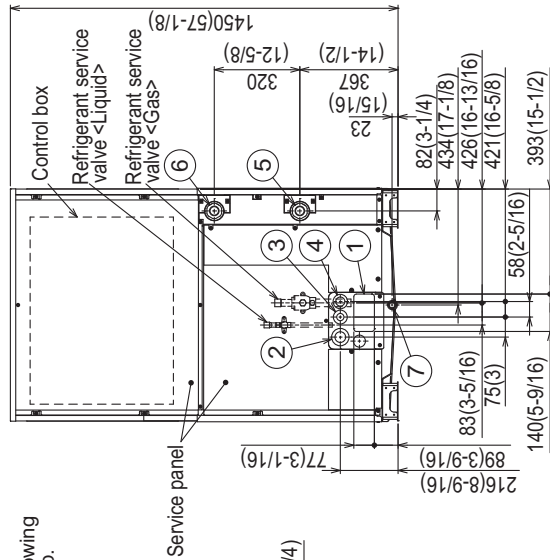

Front view

2x2-14(9/16)x31(1-1/4) Oval hole

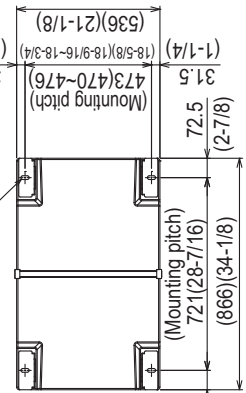

Bottom view

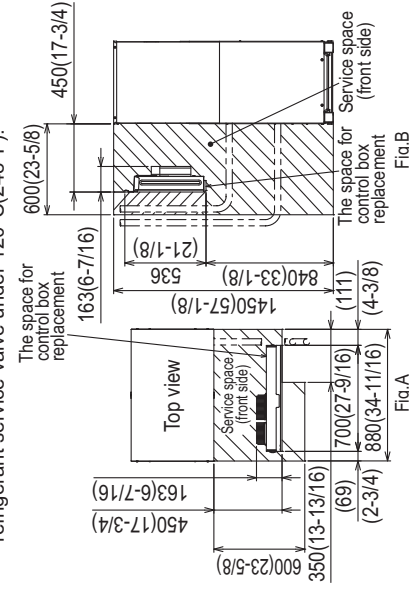


Fig. A


Fig. B

Model	Refrigerant pipe		Service valve	
	Liquid	Gas	Liquid	Gas
PQHY-P168TLMU-A1	ø12.7 Braze (1/2) *1 *2	ø28.58 Braze (1-1/8) *1	ø15.88 (5/8)	ø28.58 (1-1/8)
PQHY-P168TLMU-A1	ø15.88 Braze (5/8) *1	ø28.58 Braze (1-1/8) *1	ø15.88 (5/8)	ø28.58 (1-1/8)
PQHY-P192TLMU-A1	ø15.88 Braze (5/8) *1	ø28.58 Braze (1-1/8) *1	ø15.88 (5/8)	ø28.58 (1-1/8)


Connecting pipe specifications

- *1 Connect by using the connecting pipes and elbow that are supplied.
- *2 Use the pipe joint(field supply) and connect to the refrigerant service valve piping.

Back view

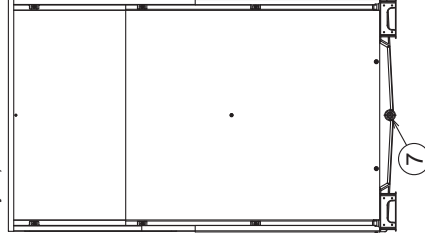

Right side view

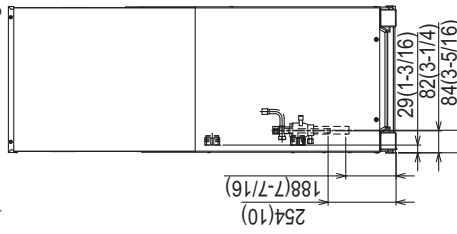

NO.	For pipes	Usage	Specifications
①	For pipes	Front through hole	140 x 77 Knockout hole (5-9/16) (3-1/16)
②	For wires	Front through hole	ø62.7 or ø34.5 Knockout hole (2-1/2) (1-3/8)
③	For transmission cables	Front through hole	ø43.7 or ø22.2 Knockout hole (1-3/4) (7/8)
④	For transmission cables	Front through hole	ø34 Knockout hole (1-3/8)
⑤	Water pipe inlet	inlet	NPT1-1/2 Screw
⑥	Water pipe outlet	outlet	NPT1-1/2 Screw
⑦	Drain pipe	Drain pipe	Rc3/4 Screw


- Note1. Close a hole of the water piping, the refrigerant piping, the power supply, and the control wiring and unused knockout holes with the putty etc. so as not to infiltrate rain water etc.(field erection work)
- Note2. At the time of product shipment, the front side piping specification serves as the local drainage connection. When connecting on the rear side, please remove the rear side plug sealing corks, and attach a front side. Ensure there is no leak after the attachment has been fitted.
- Note3. Take notice of service space as Fig.A. (In case of single installation, 600mm(23-5/8) or more of back space as front space makes easier access when servicing the unit from rear side.)
- Note4. If water pipes or refrigerant pipes stretch upward, required space for service and maintenance due to replacement of control box is shown in Fig.B.
- Note5. Environmental condition for installation; -20~40°C(DB) (-4~104°F) as indoor installation.
- Note6. In case the temperature around the heat source unit has possibility to drop under 0°C(32°F), be careful for the following point to prevent the pipe burst by the water pipe freeze-up.
- Circulate the water all the time even if the heat source unit is not in operation.
 - Drain the water from inside of the heat source unit when the heat source unit will not operate for a long term.
- Note7. Ensure that the drain piping is downward with a pitch of more than 1/100.
- Note8. At brazing of pipes, wrap the refrigerant service valve with wet cloth and keep the temperature of refrigerant service valve under 120°C(248°F).

Should this document be altered or changed, without MESCA's permission, it becomes null and void. MESCA assumes no responsibility for any consequences in such cases.


Modules: 1 : PQHY-P192TLMU-A1 - DIMENSIONS

Unit: mm(in)


- Refrigerant (Liquid) conn. pipe1pc.
(P-144/P168/P192; Packaged in the accessory kit)
- Refrigerant (Gas) conn. elbow1pc.
(P-144/P168/P192; Packaged in the accessory kit)
- Water stopper(Liquid, Gas)1pc. each
(P-144/P168/P192; Packaged in the accessory kit)
- Sealing material for water stopper (Liquid, Gas)1pc. each
(P-144/P168/P192; Packaged in the accessory kit)
- Sealing material for field piping (Liquid, Gas)1pc. each
(P-144/P168/P192; Packaged in the accessory kit)
- Sealing material for drain socket1pc.
(P-144/P168/P192; Packaged in the accessory kit)
- Pipe cover for gas1pc.
(P-144/P168/P192; Packaged in the accessory kit)
- Sealing material for base leg (two types)4pc. each
(P-144/P168/P192; Packaged in the accessory kit)
- Sealing material for panel1pc.
(P-144/P168/P192; Packaged in the accessory kit)




Top view

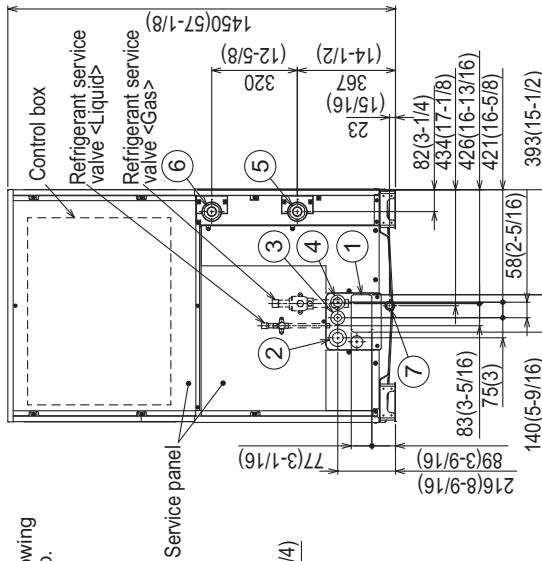

Front view

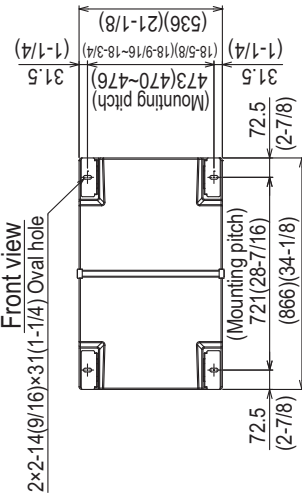

Bottom view

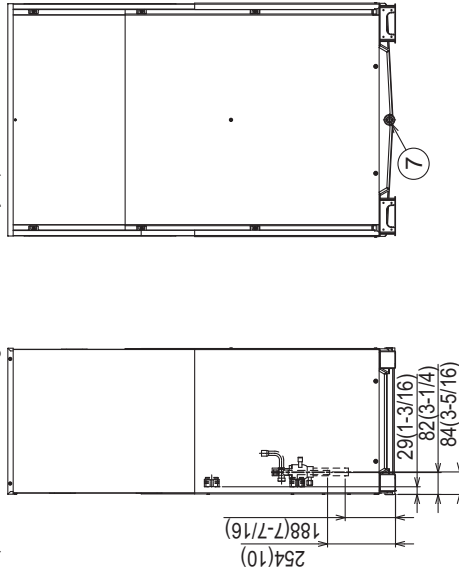

Right side view

Back view

NO.	For pipes	Usage	Specifications
①	For pipes	Front through hole	140 x 77 Knockout hole (5-9/16) (3-1/16)
②	For wires	Front through hole	ø62.7 or ø34.5 Knockout hole (2-1/2) (1-3/8)
③	For transmission cables	Front through hole	ø43.7 or ø22.2 Knockout hole (1-3/4) (7/8)
④	Water pipe inlet	Front through hole	ø34 Knockout hole (1-3/8)
⑤	Water pipe outlet	inlet	NPT1-1/2 Screw
⑥	Drain pipe	outlet	NPT1-1/2 Screw
⑦			RC3/4 Screw

Note 1. Close a hole of the water piping, the refrigerant piping, the power supply, and the control wiring and unused knockout holes with the putty etc. so as not to infiltrate rain water etc.(field erection work)

Note 2. At the time of product shipment, the front side piping specification serves as the local drainage connection. When connecting on the rear side, please remove the rear side plug sealing corks, and attach a front side.

Note 3. Ensure there is no leak after the attachment has been fitted. Take notice of service space as Fig.A. (In case of single installation, 600mm(23-5/8) or more of back space as front space makes easier access when servicing the unit from rear side.)

Note 4. If water pipes or refrigerant pipes stretch upward, required space for service and maintenance due to replacement of control box is shown in Fig.B.

Note 5. Environmental condition for installation: -20~40°C(DB) (-4~104°F) as indoor installation.

Note 6. In case the temperature around the heat source unit has possibility to drop under 0°C(32°F), be careful for the following point to prevent the pipe burst by the water pipe freeze-up.

• Circulate the water all the time even if the heat source unit is not in operation.

• Drain the water unit inside of the heat source unit when the heat source unit will not operate for a long term.

Note 7. Ensure that the drain piping is downward with a pitch of more than 1/100.

Note 8. At brazing of pipes, wrap the refrigerant service valve with wet cloth and keep the temperature of refrigerant service valve under 120°C(248°F).

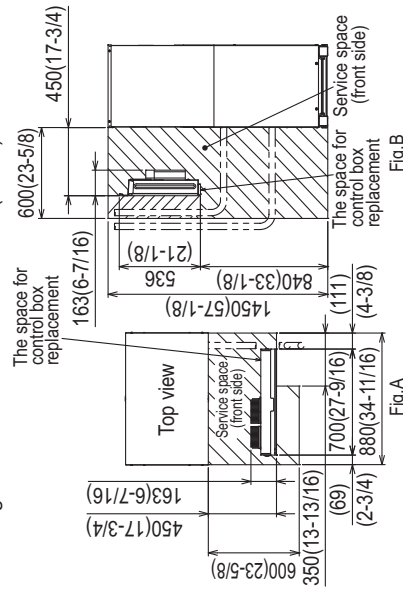


Fig.A

Fig.B

Connecting pipe specifications

Model	Refrigerant pipe		Service valve	
	Liquid	Gas	Liquid	Gas
PQHY-P144TLMU-A1	ø12.7 Braze (1/2) *1 *2	ø28.58 Braze (1-1/8) *1	ø15.88 (5/8)	ø28.58 (1-1/8)
PQHY-P168TLMU-A1	ø15.88 Braze (5/8) *1	ø28.58 Braze (1-1/8) *1	ø15.88 (5/8)	ø28.58 (1-1/8)
PQHY-P192TLMU-A1	ø15.88 Braze (5/8) *1	ø28.58 Braze (1-1/8) *1	ø15.88 (5/8)	ø28.58 (1-1/8)

*1. Connect by using the connecting pipes and elbow that are supplied.


*2. Use the pipe joint(field supply) and connect to the refrigerant service valve piping.

Should this document be altered or changed without MESCA's permission, it becomes null and void. MESCA assumes no responsibility for any consequences in such cases.


CMY-Y200CBK2

in.


For Gas pipe:

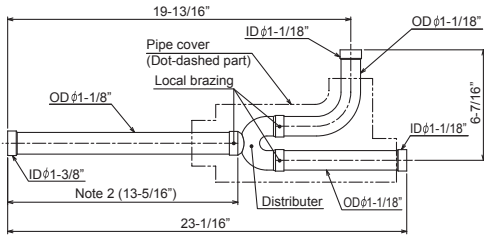

For Liquid pipe:

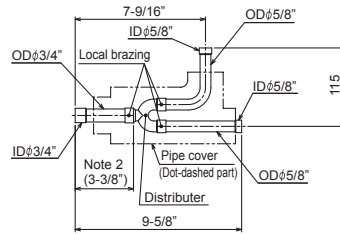


<Deformed pipe(Accessory)>



ID: Inner Diameter OD: Outer Diameter

Note 1. Reference the attitude angle of the branch pipe below the fig.




The angle of the branch pipe for high pressure is within $\pm 15^\circ$ against the horizontal plane.

2. Use the attached pipe to braze the port-opening of the distribute
3. Pipe diameter is indicated by inside diamete
4. Only use the Twining pipe by Mitsubishi (optional parts)

Should this document be altered or changed without MESCA's permission, it becomes null and void. MESCA assumes no responsibility for any consequences in such cases.

Notes:

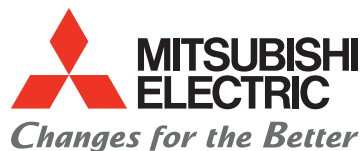

for a greener tomorrow

