


TECHNICAL & SERVICE MANUAL

Series PKFY Wall Mounted

Indoor unit
[Model Name]

[Service Ref.]

PKFY-WL04NLMU-E	PKFY-WL04NLMU-E.TH
PKFY-WL06NLMU-E	PKFY-WL06NLMU-E.TH
PKFY-WL08NLMU-E	PKFY-WL08NLMU-E.TH
PKFY-WL12NLMU-E	PKFY-WL12NLMU-E.TH
PKFY-WL15NLMU-E	PKFY-WL15NLMU-E.TH

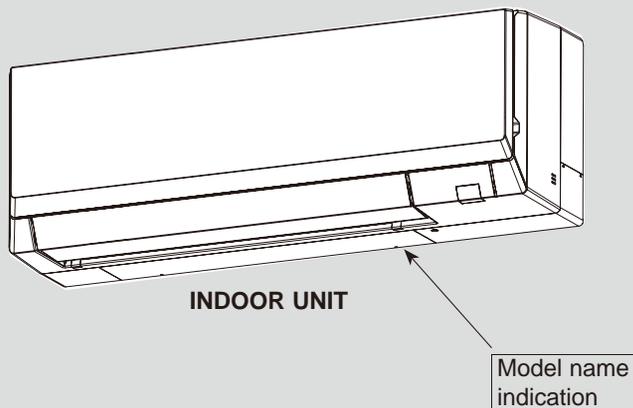

CONTENTS

1. SAFETY PRECAUTION	2
2. PARTS NAMES AND FUNCTIONS	3
3. SPECIFICATION	4
4. NOISE CRITERION CURVES	6
5. OUTLINES AND DIMENSIONS	8
6. WIRING DIAGRAM	12
7. REFRIGERANT SYSTEM DIAGRAM ...	13
8. MICROPROCESSOR CONTROL.....	13
9. TROUBLESHOOTING.....	20
10. DISASSEMBLY PROCEDURE	27
11. REMOTE CONTROLLER	31

PARTS CATALOG (TCB122)

CITY MULTI

Read before installation and performing electrical work

- Thoroughly read the following safety precautions prior to installation.
- Observe these safety precautions for your safety.
- This equipment may have adverse effects on the equipment on the same power supply system.
- Contact the local power authority before connecting to the system.

Symbol explanations

WARNING

This symbol indicates that failure to follow the instructions exactly as stated poses the risk of serious injury or death.

CAUTION

This symbol indicates that failure to follow the instructions exactly as stated poses the risk of serious injury or damage to the unit.



Indicates an action that must be avoided.



Indicates important instructions.



Indicates a parts that requires grounding.



Indicates that caution must be taken with rotating parts. (This symbol is on the main unit label.) <Color: Yellow>



Indicates that the parts that are marked with this symbol pose a risk of electric shock. (This symbol is on the main unit label.) <Color: Yellow>

WARNING

Carefully read the labels affixed to the main unit.

WARNING

•**Do not use refrigerant other than the type indicated in the manuals provided with the unit and on the nameplate.**

- Doing so may cause the unit or pipes to burst, or result in explosion or fire during use, during repair, or at the time of disposal of the unit.
- It may also be in violation of applicable laws.

MITSUBISHI ELECTRIC CORPORATION cannot be held responsible for malfunctions or accidents resulting from the use of the wrong type of refrigerant.

•**Ask your dealer or a qualified technician to install the unit.**

- Improper installation by the user may result in water leakage, electric shock, or fire.

•**Properly install the unit on a surface that can withstand its weight.**

- Unit installed on an unstable surface may fall and cause injury.

•**Only use specified cables. Securely connect each cable so that the terminals do not carry the weight of the cable.**

- Improperly connected cables may produce heat and start a fire.

•**Take appropriate safety measures against wind gusts and earthquakes to prevent the unit from toppling over.**

- Improper installation may cause the unit to topple over and cause injury or damage to the unit.

•**Only use accessories (i.e., air cleaners, humidifiers, electric heaters) recommended by Mitsubishi Electric.**

•**Do not make any modifications or alterations to the unit.**

Consult your dealer for repair.

- Improper repair may result in water leakage, electric shock, or fire.

•**Do not touch the heat exchanger fins with bare hands.**

- The fins are sharp and pose a risk of cuts.

•**Properly install the unit according to the instructions in the Installation Manual.**

- Improper installation may result in water leakage, electric shock, or fire.

•**Have all electrical work performed by an authorized electrician according to the local regulations and the instructions in this manual. Use a dedicated circuit.**

- Insufficient power supply capacity or improper installation of the unit may result in malfunctions of the unit, electric shock, or fire.

•**Keep electrical parts away from water.**

- Wet electrical parts pose a risk of electric shock, smoke, or fire.

•**Securely attach the control box cover.**

- If the cover is not installed properly, dust or water may infiltrate and pose a risk of electric shock, smoke, or fire.

•**Only use the type of refrigerant that is indicated on the unit when installing or relocating the unit.**

- Infiltration of any other types of refrigerant or air into the unit may adversely affect the refrigerant cycle and may cause the pipes to burst or explode.

•**Consult your dealer or a qualified technician when moving or reinstalling the unit.**

- Improper installation may result in water leakage, electric shock, or fire.

•**After completing the service work, check for a refrigerant leak.**

- If leaked refrigerant is exposed to a heat source, such as a fan heater, stove, or electric grill, toxic gases will be generated.

•**Do not try to defeat the safety features of the unit.**

- Forced operation of the pressure switch or the temperature switch by defeating the safety features for these devices, or the use of accessories other than the ones that are recommended by Mitsubishi Electric may result in smoke, fire, or explosion.

•**Consult your dealer for proper disposal method.**

•**Do not use a leak detection additive.**

Precautions for handling units for use with water

CAUTION

•**Do not use the existing water piping.**

- Store the piping materials indoors, and keep both ends of the pipes sealed until immediately before installation. Keep the joints wrapped in plastic bags. If dust or dirt enters the water circuit, it may damage the heat exchanger and cause water leakage.

•**Only use water.**


- Only use clean water as a refrigerant. The use of water outside the specification may damage the refrigerant circuit.

•**Install the unit so that external force is not applied to the water pipes.**

2

PARTS NAMES AND FUNCTIONS

2-1. Indoor unit

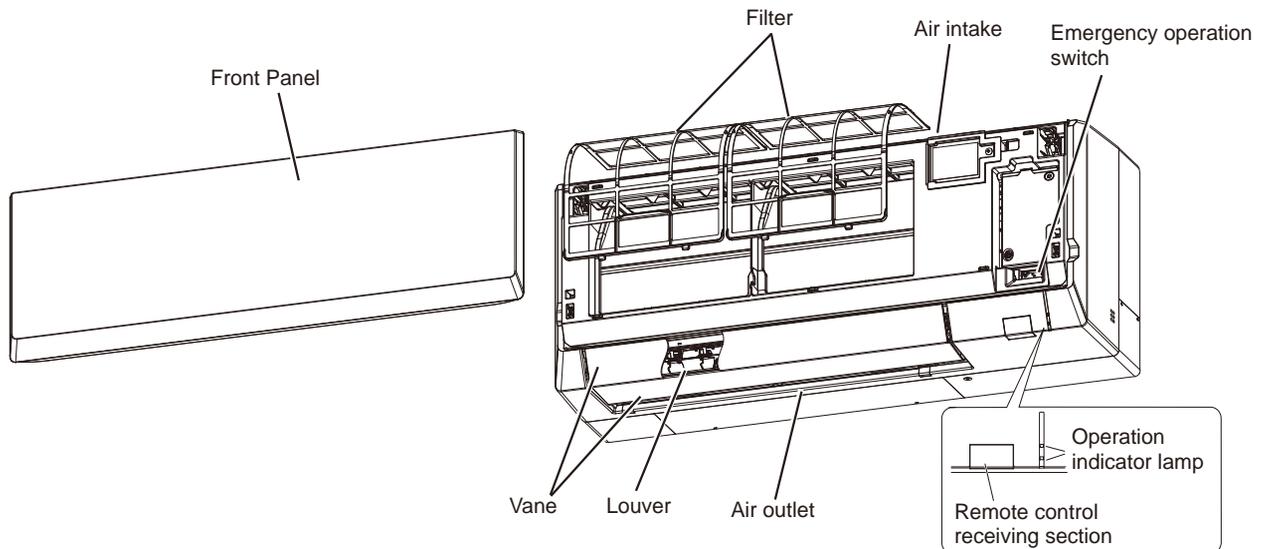

2-2. Wired Remote Controller <PAR-41MAA>

Wired remote controller function

The functions which can be used are restricted according to each model.

○ : Supported × : Unsupported

	Function	PAR-41MAA	
		Slim	CITY MULTI
Body	Product size H x W x D	(mm) 120 x 120 x 14.5	(inch) 4-3/4 x 4-3/4 x 9/16
	LCD	Full Dot LCD	
	Backlight	○	
Energy saving	Energy saving operation schedule	○	×
	Automatic return to the preset temperature	○	
Restriction	Setting the temperature range restriction	○	
Function*	Operation lock function	○	
	Weekly timer	○	
	ON/OFF timer	○	
	High Power	○	×
	Manual vane angle	○	

*Some functions may not be available depending on model types.

3

SPECIFICATION

3-1. SPECIFICATIONS

Model		PKFY-WL04NLMU-E.TH	PKFY-WL06NLMU-E.TH	PKFY-WL08NLMU-E.TH	PKFY-WL12NLMU-E.TH	PKFY-WL15NLMU-E.TH
Power source		1-phase 208/230 V 60Hz				
Cooling capacity	*1 BTU/h	4,000	6,000	8,000	12,000	15,000
	*1 kW	1.2	1.8	2.3	3.5	4.4
Power input	kW	0.02	0.03	0.04		0.05
	Current input	A	0.20	0.25	0.35	
Heating capacity	*2 BTU/h	4,500	6,700	9,000	13,500	17,000
	*2 kW	1.3	2.0	2.6	4.0	5.0
Power input	kW	0.01	0.02	0.03		0.04
	Current input	A	0.15	0.20	0.30	
External finish		Plastic, MUNCELL (0.7PB 9.2/0.4)				
External dimension H x W x D	inch	11-25/32 x 30-7/16 x 9-11/32			11-25/32 x 35-3/8 x 9-11/32	
	mm	299 x 773 x 237			299 x 898 x 237	
Net weight	lbs (kg)	24 (11)			29 (13)	
Heat exchanger		Cross fin (Aluminum fin and copper tube)				
Water volume	L	0.6	0.7		1.0	1.1
FAN	Type x Quantity		Line flow fan x 1			
	External static press.	in.WG	0			
		Pa	0			
	Motor type		DC motor			
	Motor output	kW	0.030			
	Driving mechanism		Direct-driven			
	Airflow rate (Low-Mid2-Mid1-High)	cfm	117 - 134 - 145 - 159	141 - 177 - 212 - 247	141 - 191 - 247 - 297	222 - 268 - 318 - 367
m ³ /min		3.3 - 3.8 - 4.1 - 4.5	4.0 - 5.0 - 6.0 - 7.0	4.0 - 5.4 - 7.0 - 8.4	6.3 - 7.6 - 9.0 - 10.4	6.4 - 8.2 - 10.0 - 11.9
L/s		55 - 63 - 68 - 75	67 - 83 - 100 - 117	67 - 90 - 117 - 140	105 - 127 - 150 - 173	107 - 137 - 167 - 198
Sound pressure level (Low-Mid2-Mid1-High) (measured in anechoic room)	dB <A>	22 - 26 - 28 - 30	22 - 28 - 33 - 36	22 - 30 - 36 - 41	29 - 34 - 38 - 41	30 - 36 - 41 - 45
Insulation material		Polyethylene sheet				
Air filter		PP honeycomb				
Protection device		Fuse				
Refrigerant control device		—				
Connectable HBC controller		CMB-WP-NU-AA, CMB-WP-NU-AB				
Water piping diameter *3,*4	Connection size	Inlet	mm O.D.			
		Outlet	mm O.D.			
	Field pipe size	Inlet	mm I.D.			
		Outlet	mm I.D.			
Field drain pipe size	inch (mm)	I.D. 5/8 (16)				
Drawing	External	VK01B214				
	Wiring	VG79N339				
	Refrigerant cycle	—				
standard attachment	Document	Installation Manual, Instruction Book				
	Accessory	Mount board, Screw, Felt tape, L-shape connection pipe, I-shape connection pipe, Insulation, Tie band				
Optional parts	Drain pump	PAC-SK01DM-E				
	External heater adapter	PAC-YU25HT				
Remarks		* Details on foundation work, duct work, insulation work, electrical wiring, power source switch, and other items shall be referred to the Installation Manual. * Due to continuing improvement, above specifications may be subject to change without notice.				
Notes:					Unit converter	
1. Nominal cooling conditions Indoor: 80°F D.B./67°F W.B. (26.7°C D.B./19.4°C W.B.), Outdoor: 95°F D.B. (35°C D.B.) Pipe length: 25 ft. (7.6 m), Level difference: 0 ft. (0 m)					Btu/h = kW x 3,412	
2. Nominal heating conditions Indoor: 70°F D.B. (21.1°C B.), Outdoor: 47°F D.B./43°F W.B. (8.3°C D.B./6.1°C W.B.) Pipe length: 25 ft. (7.6 m), Level difference: 0 ft. (0 m)					cfm = m ³ /min x 35.31	
3. Be sure to install a valve on the water inlet/outlet.					lb = kg/0.4536	
4. Install a strainer (40 mesh or more) on the pipe next to the valve to remove the foreign matters.					*Above specification data is subject to rounding variation.	


3-2. ELECTRICAL PARTS SPECIFICATIONS

Parts name	Service Ref.	Symbol	PKFY-WL04NLMU-E.TH PKFY-WL06NLMU-E.TH PKFY-WL08NLMU-E.TH	PKFY-WL12NLMU-E.TH PKFY-WL15NLMU-E.TH
Room temperature detection thermistor		TH21	Resistance 32°F/15 kΩ, 50°F/9.6 kΩ, 68°F/6.3 kΩ, 77°F/5.4 kΩ, 86°F/4.3 kΩ, 104°F/3.0 kΩ	
Pipe temperature detection thermistor/liquid		TH22	Resistance 32°F/15 kΩ, 50°F/9.6 kΩ, 68°F/6.3 kΩ, 77°F/5.4 kΩ, 86°F/4.3 kΩ, 104°F/3.0 kΩ	
Pipe temperature detection thermistor/gas		TH23	Resistance 32°F/15 kΩ, 50°F/9.6 kΩ, 68°F/6.3 kΩ, 77°F/5.4 kΩ, 86°F/4.3 kΩ, 104°F/3.0 kΩ	
Fuse (Indoor controller board)		FUSE	T3.15AL250V	
Fan motor (with thermal fuse)		MF	8 X 30W / RC0J30-CV	
Vane motor (Upper)		MV1	MSBPC20 DC12V	
Vane motor (Lower)		MV2	MSBPC20 DC12V	
Power supply terminal block		TB2	(L1, L2) Rated to 250V 20A *	
Transmission terminal block		TB5	(M1, M2, S) Rated to 250V 20A *	
MA-Remote controller terminal block		TB15	(1, 2) Rated to 250V 10A *	

*Refer to WIRING DIAGRAM for the supplied voltage.

3-3. SOUND PRESSURE LEVEL

PKFY-WL•NLMU-E

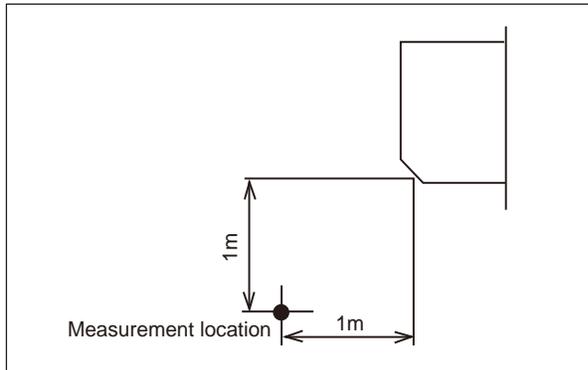

* Measured in anechoic room.


Sound pressure level at anechoic room : Low-Mid2-Mid1-High

Model name	Sound pressure level dB (A)
PKFY-WL04NLMU-E.TH	22-26-28-30
PKFY-WL06NLMU-E.TH	22-28-33-36
PKFY-WL08NLMU-E.TH	22-30-36-41
PKFY-WL12NLMU-E.TH	29-34-38-41
PKFY-WL15NLMU-E.TH	30-36-41-45

NOISE CRITERION CURVES


PKFY-WL04NLMU-E.TH

FAN	SPL(dB)	LINE
High	30	○—○
Medium1	28	●—●
Medium2	26	□—□
Low	22	■—■

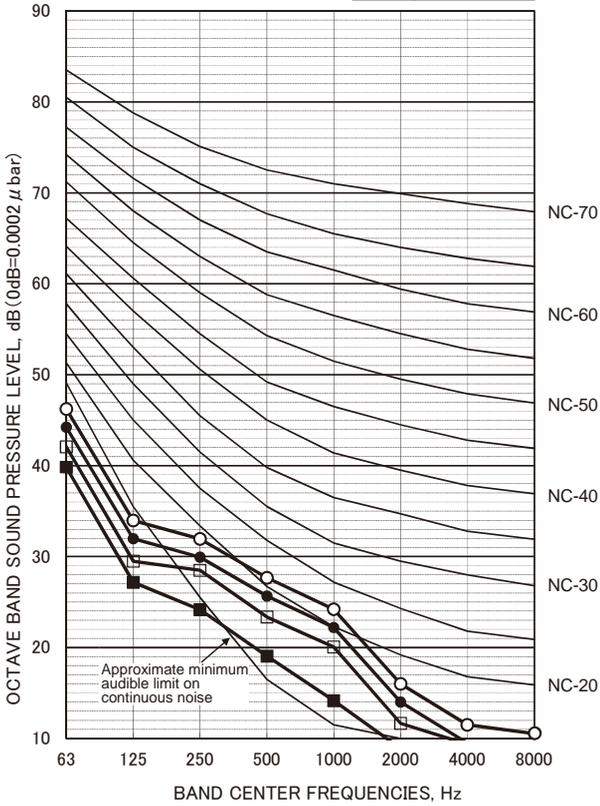


PKFY-WL06NLMU-E.TH

FAN	SPL(dB)	LINE
High	36	○—○
Medium1	33	●—●
Medium2	28	□—□
Low	22	■—■

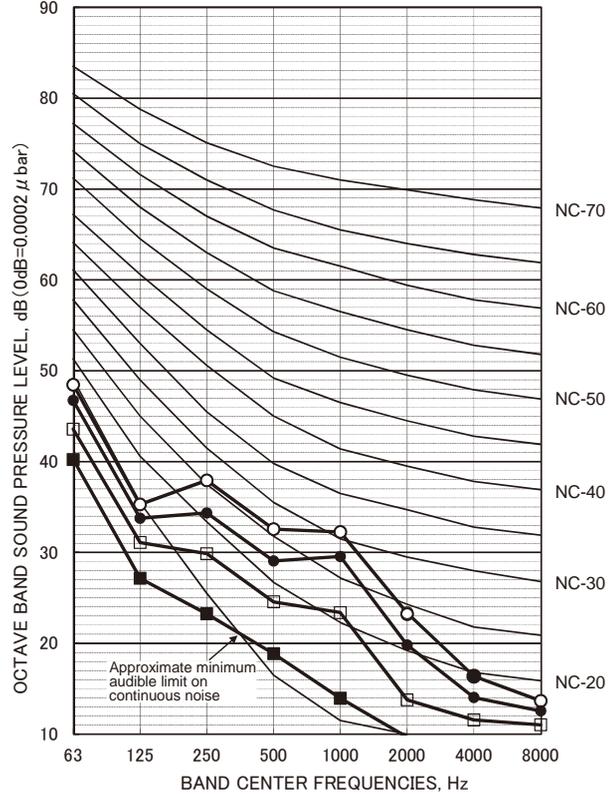


PKFY-WL08NLMU-E.TH


FAN	SPL(dB)	LINE
High	41	○—○
Medium1	36	●—●
Medium2	30	□—□
Low	22	■—■

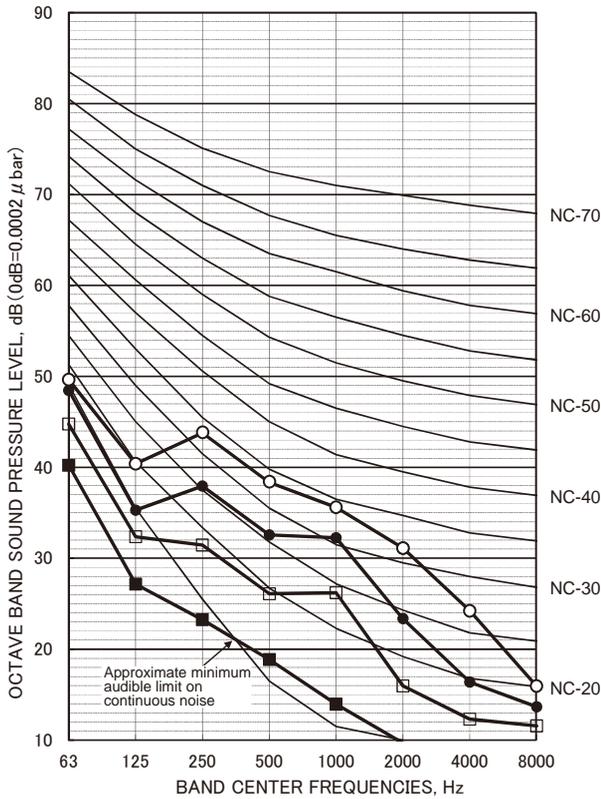

PKFY-WL12NLMU-E.TH


FAN	SPL(dB)	LINE
High	41	○—○
Medium1	38	●—●
Medium2	34	□—□
Low	29	■—■

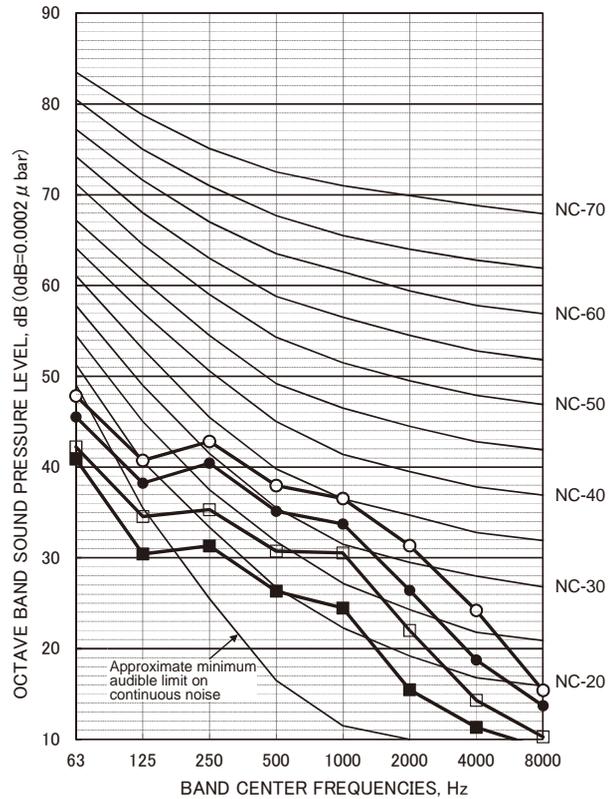



PKFY-WL15NLMU-E.TH

FAN	SPL(dB)	LINE
High	45	○—○
Medium1	41	●—●
Medium2	36	□—□
Low	30	■—■

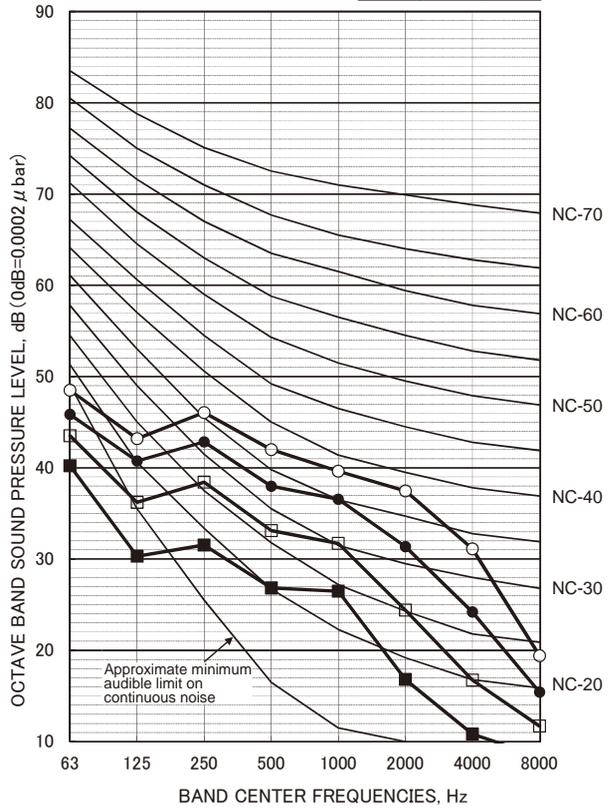


PKFY-WL04NLMU-E.TH
 PKFY-WL08NLMU-E.TH

PKFY-WL06NLMU-E.TH


Unit: inch(mm)

FOR RIGHT BOTTOM PIPING WORK

FRONT(OPEN THE GRILLE)


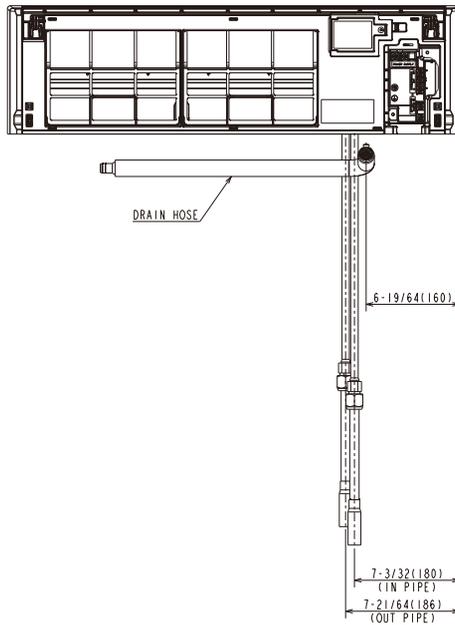


RIGHT(OPEN THE GRILLE)

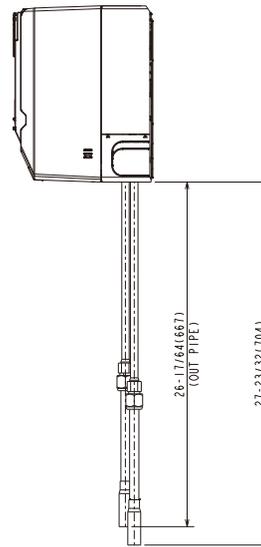

FOR RIGHT REAR PIPING WORK

RIGHT(OPEN THE GRILLE)

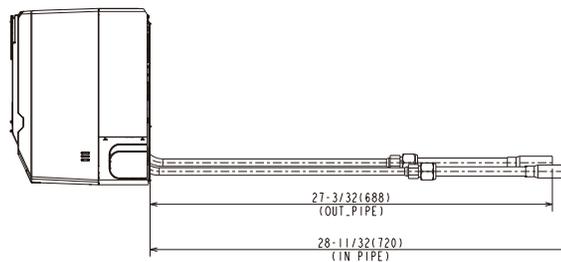

PKFY-WL12NLMU-E.TH


PKFY-WL15NLMU-E.TH

Unit: inch(mm)

FOR RIGHT BOTTOM PIPING WORK


FRONT(OPEN THE GRILLE)

RIGHT(OPEN THE GRILLE)

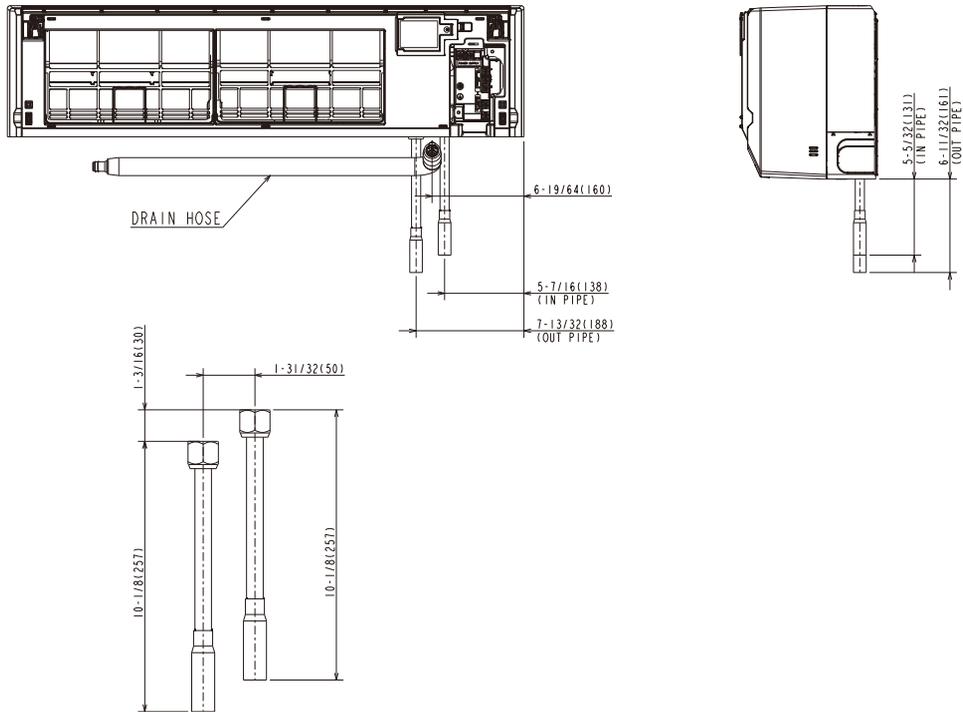

FOR RIGHT REAR PIPING WORK


RIGHT(OPEN THE GRILLE)

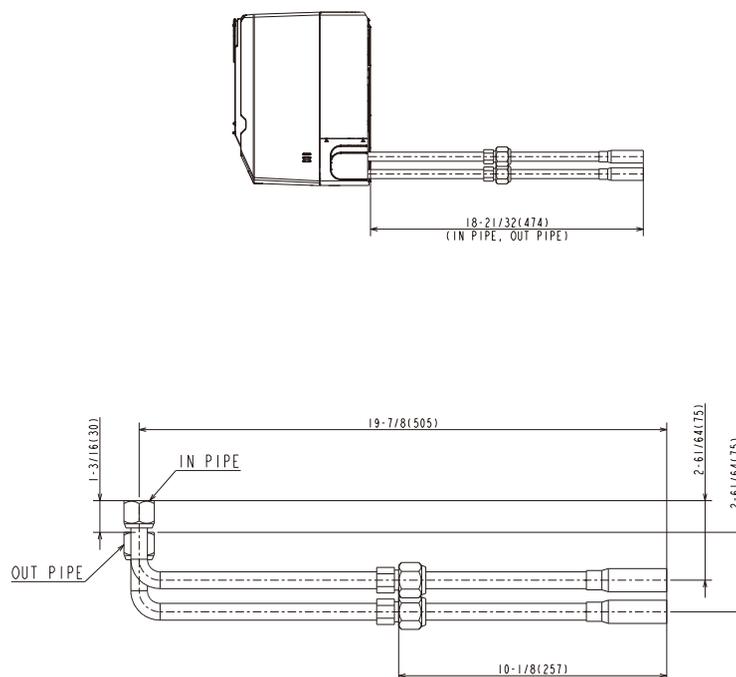

PKFY-WL04NLMU-E.TH
PKFY-WL12NLMU-E.TH

PKFY-WL06NLMU-E.TH
PKFY-WL15NLMU-E.TH

PKFY-WL08NLMU-E.TH

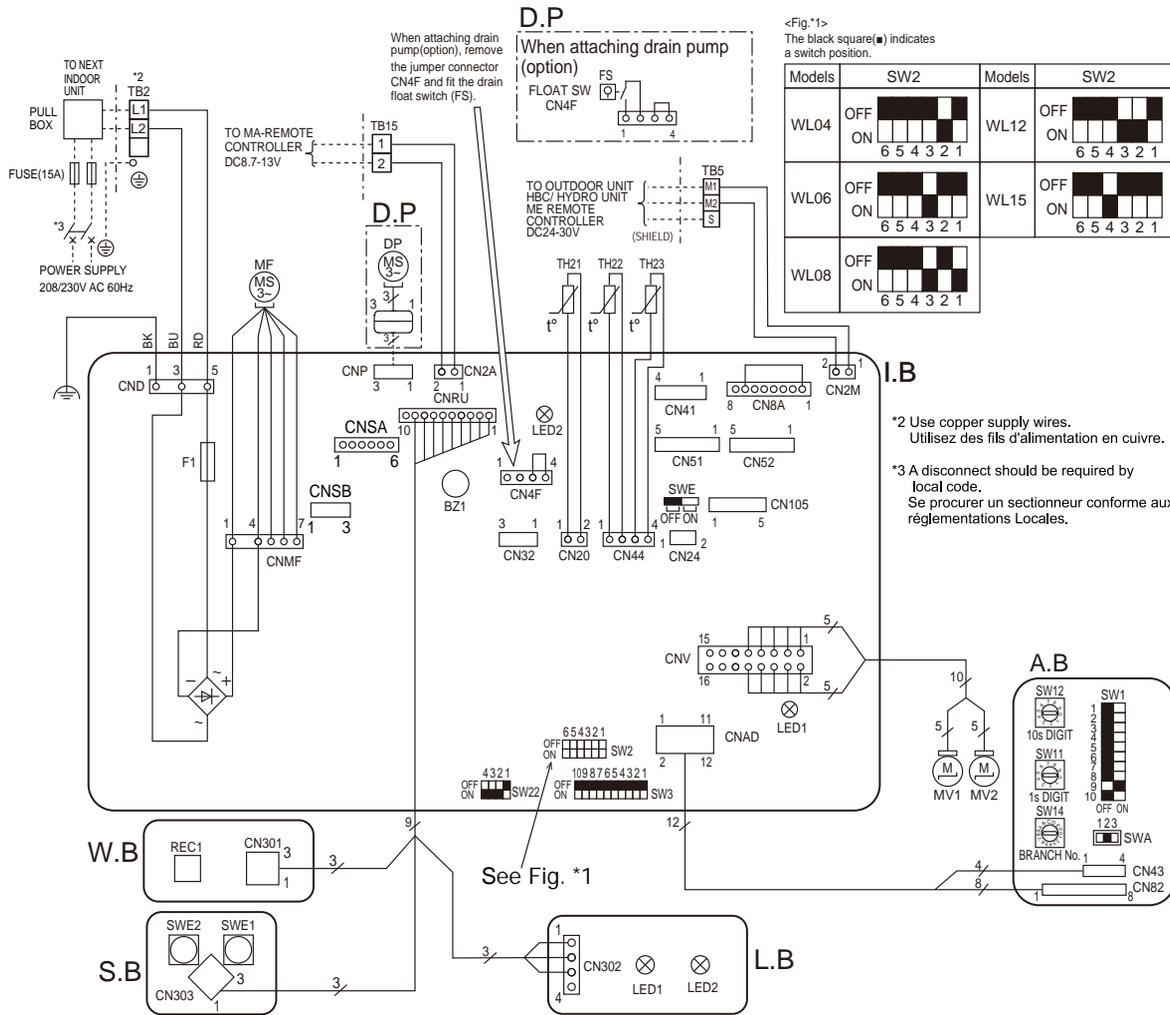

SYMBOL	NAME	SYMBOL	NAME
I.B	INDOOR CONTROLLER BOARD	TH21	THERMISTOR
CN24	CONNECTOR	TH22	ROOM TEMP. DETECTION (32°F/15kΩ, 77°F/5.4kΩ)
CN32	CONNECTOR	TH23	PIPE TEMP. DETECTION / INLET WATER (32°F/15kΩ, 77°F/5.4kΩ)
CN51	CONNECTOR		PIPE TEMP. DETECTION / OUTLET WATER (32°F/15kΩ, 77°F/5.4kΩ)
CN52	CONNECTOR	A.B	ADDRESS BOARD
CN105	CONNECTOR	SW1	SWITCH
BZ1	BUZZER	SW11	SWITCH
F1	FUSE (T3.15AL250V)	SW12	SWITCH
LED1	POWER SUPPLY (I.B.)	SW14	SWITCH
LED2	POWER SUPPLY (MA-REMOTE CONTROLLER)	S.B	SWITCH BOARD
SW2	SWITCH	SWE1	EMERGENCY OPERATION(HEAT)
SW3	SWITCH	SWE2	EMERGENCY OPERATION(COOL)
SW22	SWITCH	W.B	PCB FOR WIRELESS REMOTE CONTROLLER
SWE	FAN+DRAIN PUMP (TEST MODE)	REC1	RECEIVING UNIT
MF	FAN MOTOR	L.B	LED BOARD
MV1	VANE MOTOR (UPPER)	LED1	LED(OPERATING INDICATOR:GREEN)
MV2	VANE MOTOR (LOWER)	LED2	LED(STANDBY FOR HEATING: ORANGE)
TB2	TERMINAL	D.P	DRAIN PUMP KIT (OPTION)
TB5	BLOCK	FS	DRAIN FLOAT SWITCH
TB15	BLOCK	DP	DRAIN PUMP

NOTES:

- 1.At servicing for outdoor unit,always follow the wiring diagram of outdoor unit.
- 2.In case of using MA-Remote controller, please connect to TB15. (Remote controller wire is non-polar.)
- 3.In case of using M-NET, please connect to TB5. (Transmission line is non-polar.)
- 4.Symbol [S]of TB5 is the shield wire connection.
- 5.Symbols used in wiring diagram above are, [] : terminal block, [] : connector.
- 6.The setting of the SW2 dip switches differs in the capacity. For the detail, refer to the Fig.*1.

LED on indoor controller board for service

Symbol	Meaning	Function
LED1	Main power supply	Main power supply (Indoor unit:208/230V) Power on → lamp is lit
LED2	Power supply for MA-Remote controller	Power supply for MA-Remote controller on → lamp is lit


7

REFRIGERANT SYSTEM DIAGRAM

PKFY-WL04NLMU-E.TH
PKFY-WL12NLMU-E.TH

PKFY-WL06NLMU-E.TH
PKFY-WL15NLMU-E.TH

PKFY-WL08NLMU-E.TH

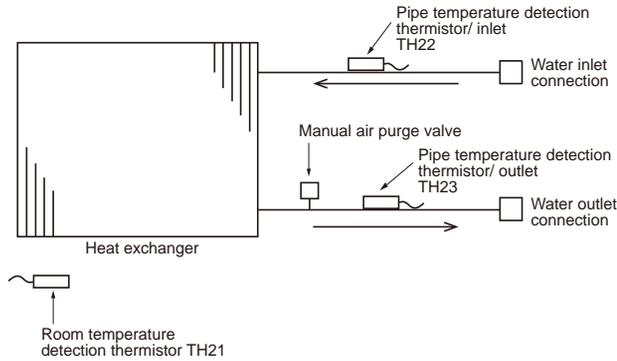


Unit: in (mm)

Item	Model	PKFY-WL04/06/08/12/15NLMU-E
Water inlet		7/8 (22)
Water outlet		7/8 (22)

8

MICROPROCESSOR CONTROL


INDOOR UNIT CONTROL 8-1. COOL OPERATION



<How to operate>

- ① Press ON/OFF button.
- ② Press [F1] button to display COOL.
- ③ Press [F2] [F3] button to set the set temperature.


NOTE: The settable temperature range varies with the model of outdoor units and remote controller.









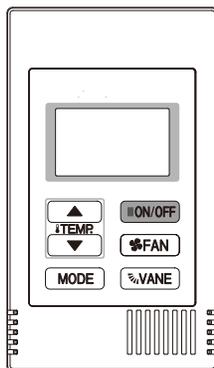


<How to operate>


- ① Press POWER ON/OFF button.
- ② Press the operation MODE button to display COOL.
- ③ Press the TEMP. button to set the set temperature.

NOTE: The set temperature changes 1°F when the  or  button is pressed one time. Cooling 67 to 87°F



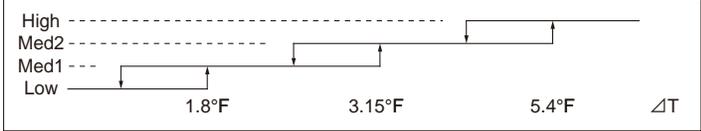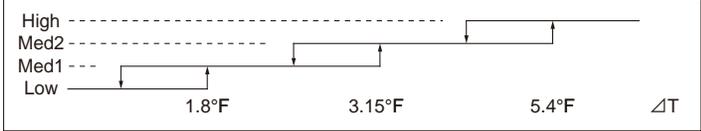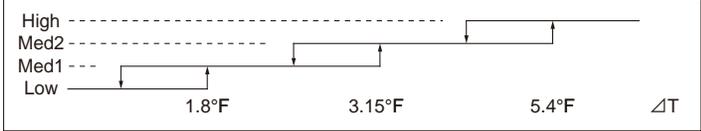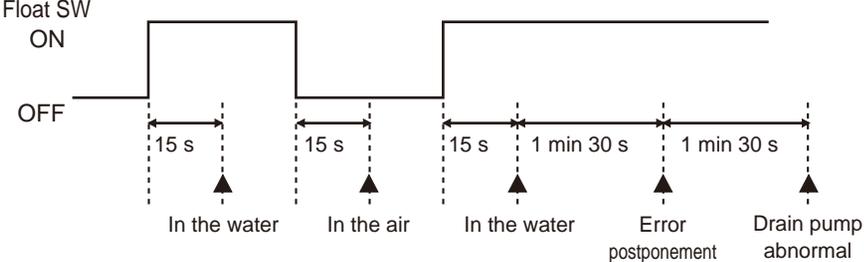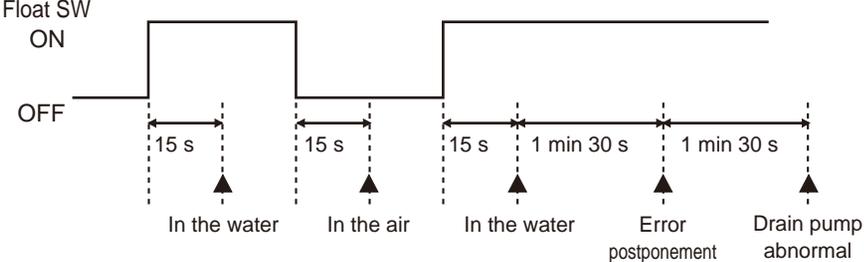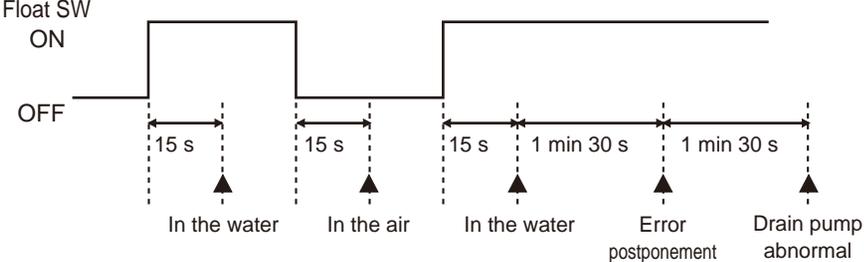
Control Mode	Control Details	Remarks												
1. Temperature adjustment function	<p>1-1. Determining temperature adjustment function (Function to prevent restarting for 3 minutes)</p> <ul style="list-style-type: none"> Room temperature \geq Set temperature + 2°F ... Thermo-ON Room temperature \leq Set temperature ... Thermo-OFF <p>1-2. Anti-freeze control</p> <ul style="list-style-type: none"> Condition to detect When the pipe temperature detection thermistor/liquid (TH22) detects 32°F or less in 16 minutes from thermo-ON, the anti-freeze control initiates, and the unit enters to the thermo-OFF. Condition to release The timer which prevents reactivating is set for 3 minutes, and anti-freeze control is cancelled when any one of the following conditions has been satisfied: <ul style="list-style-type: none"> ① Pipe temperature detection thermistor/liquid (TH22) reaches 50°F or above. ② The condition of thermo-OFF has been completed by the thermostat. ③ The operation has changed to a mode other than COOLING. 	<ul style="list-style-type: none"> The ON/OFF commands by the indoor unit thermostatic control are not an ON/OFF commands to the compressor but an open/close commands to the linear expansion valve. (The compressor stops only when the thermostatic control for all the indoor units connected to the same outdoor unit turns OFF.) 												
2. Fan	<p>By the remote controller setting (switch of 4 speeds+Auto)</p> <table border="1" data-bbox="321 776 1036 927"> <thead> <tr> <th>Type</th> <th>Fan speed notch</th> </tr> </thead> <tbody> <tr> <td>4 speeds + Auto type</td> <td></td> </tr> </tbody> </table> <p>When [Auto] is set, fan speed is changed depending on the value of: $\Delta T = \text{Room temperature} - \text{Set temperature}$</p> <table border="1" data-bbox="326 996 1027 1127"> <thead> <tr> <th>High</th> <th>Med2</th> <th>Med1</th> <th>Low</th> </tr> </thead> <tbody> <tr> <td colspan="4"></td> </tr> </tbody> </table>	Type	Fan speed notch	4 speeds + Auto type		High	Med2	Med1	Low					
Type	Fan speed notch													
4 speeds + Auto type														
High	Med2	Med1	Low											
														
3. Drain pump	<p>3-1. Drain pump control</p> <ul style="list-style-type: none"> The drain pump will always run when the unit is in COOL or DRYING mode. (Regardless of the thermo ON/OFF) Whenever the operation is changed over to the other modes (including Stop), the drain pump will stop pumping after approximately 3 minutes. <p>Float switch control</p> <ul style="list-style-type: none"> Float switch control judges whether the sensor is in the air or in the water by turning the float switch ON/OFF. In the water: Detected that the float switch is ON for 15 seconds. In the air: Detected that the float switch is OFF for 15 seconds <p>Float SW</p> <table border="1" data-bbox="326 1478 1190 1740"> <thead> <tr> <th>Float SW</th> <th>ON</th> <th>OFF</th> </tr> </thead> <tbody> <tr> <td colspan="3"></td> </tr> </tbody> </table>	Float SW	ON	OFF										
Float SW	ON	OFF												
														
4. Vane (up/down vane change)	<p>(1) The initial vane setting for COOL mode will be the horizontal position.</p> <p>(2) Vane position: Horizontal → Downward A → Downward B → Downward C → Downward D → Swing → Auto</p> <p>(3) Restriction of the downward vane setting If the vane position is set to Downward A/B/C/D in [Med1], [Med2], or [Low], the vane will return to the horizontal position after 1 hour has passed.</p>	<ul style="list-style-type: none"> "1h" appears on the wired remote controller. 												

8-2. DRYING OPERATION



<How to operate>

- ① Press ON/OFF button.
- ② Press [F1] button to display DRYING.
- ③ Press [F2] [F3] button to set the set temperature.

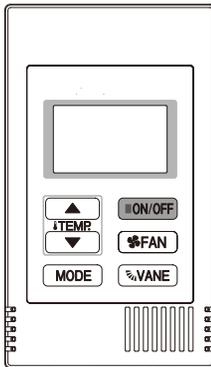


<How to operate>

- ① Press POWER ON/OFF button.
- ② Press the operation MODE button to display DRYING.
- ③ Press the TEMP. button to set the set temperature.

NOTE: The set temperature changes 1°F when the ∇ or \triangle button is pressed one time. Dry 67 to 87°F


Control Mode	Control Details	Remarks																													
1. Temperature adjustment function	1-1. Determining temperature adjustment function (Function to prevent restarting for 3 minutes) Setting the Dry thermo by the thermostat signal and the room temperature (TH21). Dry thermo-ON Room temperature \geq Set temperature + 2°F Dry thermo-OFF Room temperature \leq Set temperature																														
	<table border="1"> <thead> <tr> <th rowspan="2">Room temperature</th> <th colspan="2">3 minutes passed since starting operation</th> <th rowspan="2">Dry thermo-ON time (min)</th> <th rowspan="2">Dry thermo-OFF time (min)</th> </tr> <tr> <th>Thermostat signal</th> <th>Room temperature (T1)</th> </tr> </thead> <tbody> <tr> <td rowspan="4">Over 64°F</td> <td rowspan="4">ON</td> <td>T1 \geq 83°F</td> <td>9</td> <td>3</td> </tr> <tr> <td>83°F > T1 \geq 79°F</td> <td>7</td> <td>3</td> </tr> <tr> <td>79°F > T1 \geq 75°F</td> <td>5</td> <td>3</td> </tr> <tr> <td>75°F > T1</td> <td>3</td> <td>3</td> </tr> <tr> <td>Below 64°F</td> <td>OFF</td> <td>Unconditional</td> <td>3</td> <td>10</td> </tr> <tr> <td colspan="5" style="text-align: center;">Dry thermo OFF</td> </tr> </tbody> </table>		Room temperature	3 minutes passed since starting operation		Dry thermo-ON time (min)	Dry thermo-OFF time (min)	Thermostat signal	Room temperature (T1)	Over 64°F	ON	T1 \geq 83°F	9	3	83°F > T1 \geq 79°F	7	3	79°F > T1 \geq 75°F	5	3	75°F > T1	3	3	Below 64°F	OFF	Unconditional	3	10	Dry thermo OFF		
Room temperature	3 minutes passed since starting operation			Dry thermo-ON time (min)	Dry thermo-OFF time (min)																										
	Thermostat signal	Room temperature (T1)																													
Over 64°F	ON	T1 \geq 83°F	9	3																											
		83°F > T1 \geq 79°F	7	3																											
		79°F > T1 \geq 75°F	5	3																											
		75°F > T1	3	3																											
Below 64°F	OFF	Unconditional	3	10																											
Dry thermo OFF																															
	1-2. Anti-freeze control No control function																														
2. Fan	Indoor fan operation controlled depends on the compressor conditions. <table border="1"> <thead> <tr> <th>Dry thermo</th> <th colspan="2">Fan speed notch</th> </tr> </thead> <tbody> <tr> <td>ON</td> <td colspan="2">[Low]</td> </tr> <tr> <td rowspan="2">OFF</td> <td>Excluding the following</td> <td>Stop</td> </tr> <tr> <td>Room temp. < 64°F</td> <td>[Low]</td> </tr> </tbody> </table> Note: Fan speed change is not allowed during DRYING operation.	Dry thermo	Fan speed notch		ON	[Low]		OFF	Excluding the following	Stop	Room temp. < 64°F	[Low]																			
Dry thermo	Fan speed notch																														
ON	[Low]																														
OFF	Excluding the following	Stop																													
	Room temp. < 64°F	[Low]																													
3. Drain pump	Operates as it would in COOL operation.																														
4. Vane (up/down vane change)	Settings are the same in DRYING operation as they are in COOL operation.																														

8-3. FAN OPERATION



<How to operate>

- ① Press ON/OFF button.
- ② Press [F1] button to display FAN.

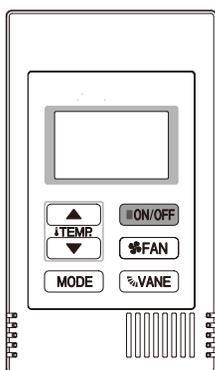


<How to operate>

- ① Press POWER ON/OFF button.
- ② Press the operation MODE button to display FAN.

Control Mode	Control Details	Remarks				
1. Temperature adjustment function	<p>Set by remote controller.</p> <table border="1" style="width: 100%;"> <tr> <td style="text-align: center;">Type</td> <td style="text-align: center;">Fan speed notch</td> </tr> <tr> <td style="text-align: center;">4 speeds + Auto type</td> <td style="text-align: center;"> </td> </tr> </table> <p>When [Auto] is set, fan speed becomes [Low].</p>	Type	Fan speed notch	4 speeds + Auto type		
Type	Fan speed notch					
4 speeds + Auto type						
2. Drain pump	<p>2-1. Drain pump control The drain pump turns ON for the specified amount of time when any of the following conditions has been satisfied:</p> <ul style="list-style-type: none"> ① ON for 3 minutes after the operation mode is switched from COOL or DRYING to another operation mode (FAN). ② ON for 6 minutes after the float switch is submerged in the water when the float switch control judges the sensor is in the water. <p>2-2. Float switch control</p> <ul style="list-style-type: none"> • Float switch control judges whether the sensor is in the air or in the water by turning the float switch ON/OFF. In the water : Detected that the float switch is ON for 15 seconds. In the air : Detected that the float switch is OFF for 15 seconds. 	<ul style="list-style-type: none"> • Operates as it would in COOL operation. 				
3. Vane (up/down vane change)	Same as the control performed during the COOL operation, but with no restriction on the vane's downward blow setting					


8-4. HEAT OPERATION



<How to operate>

- ① Press ON/OFF button.
- ② Press [F1] button to display HEAT.
- ③ Press [F2] [F3] button to set the set temperature.




NOTE: The settable temperature range varies with the model of outdoor units and remote controller.

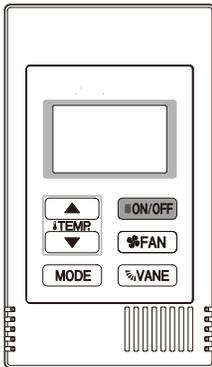


<How to operate>


- ① Press POWER ON/OFF button.
- ② Press the operation MODE button to display HEAT.
- ③ Press the TEMP. button to set the set temperature.

NOTE: The set temperature changes 1°F when the  or  button is pressed one time. Heating 63 to 83°F


Control Mode	Control Details	Remarks				
1. Temperature adjustment function	1-1. Determining temperature adjustment function (Function to prevent restarting for 3 minutes) <ul style="list-style-type: none"> • Room temperature \leq Set temperature -2°F ...Thermo-ON • Room temperature \geq Set temperature ...Thermo-OFF 					
2. Fan	By the remote controller setting (switch of 4 speeds+Auto) <table border="1" style="margin: 10px auto; width: 80%;"> <thead> <tr> <th>Type</th> <th>Fan speed notch</th> </tr> </thead> <tbody> <tr> <td>4 speeds + Auto type</td> <td>  </td> </tr> </tbody> </table> <p>When [Auto] is set, fan speed is changed depending on the value of: $\Delta T = \text{Set temperature} - \text{Room temperature}$</p> <p>Give priority to under-mentioned controlled mode</p> <p>2-1. Hot adjust mode 2-2. Residual heat exclusion mode 2-3. Thermo-OFF mode (When the compressor off by the temperature adjustment function) 2-4. Cool air prevention mode (Defrosting mode)</p>	Type	Fan speed notch	4 speeds + Auto type		
Type	Fan speed notch					
4 speeds + Auto type						

Continue to the next page.



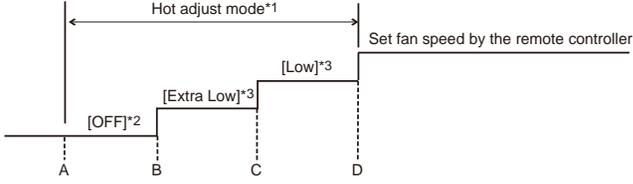Control Mode	Control Details	Remarks													
	<p>2-1. Hot adjust mode The fan controller becomes the hot adjuster mode for the following conditions.</p> <p>① When starting the HEAT operation ② When the temperature adjustment function changes from OFF to ON. ③ When release the HEAT defrosting operation</p>  <p>A: Hot adjust mode starts. B: 5 minutes have passed since the condition A or the indoor liquid pipe temperature reached 86°F or more. C: 5 minutes have passed since the condition A or the indoor liquid pipe temperature reached 95°F or more. D: 2minutes have passed since the condition C. (Terminating the hot adjust mode)</p> <table border="1" data-bbox="893 734 1437 918"> <thead> <tr> <th colspan="2" rowspan="2"></th> <th colspan="2">DIP SW 1-8</th> </tr> <tr> <th>ON</th> <th>OFF</th> </tr> </thead> <tbody> <tr> <td rowspan="2">DIP SW 1-7</td> <td>ON</td> <td>B to C [Extra Low] C to D [Low]</td> <td>B to C [Low] C to D [Low]</td> </tr> <tr> <td>OFF</td> <td>B to C [Setting airflow] C to D [Setting airflow]</td> <td>B to C [Extra Low] C to D [Low] Note: Initial setting</td> </tr> </tbody> </table>			DIP SW 1-8		ON	OFF	DIP SW 1-7	ON	B to C [Extra Low] C to D [Low]	B to C [Low] C to D [Low]	OFF	B to C [Setting airflow] C to D [Setting airflow]	B to C [Extra Low] C to D [Low] Note: Initial setting	<p>*1 "Heat Standby" will be displayed during the hot adjust mode.</p> <p>*2 The step change of A to B will not be performed at the first thermo-ON mode since the HEAT operation has started.</p> <p>*3 The fan speed varies according to the setting of DIP SW1-7 and 1-8 as shown in the table below.</p>
				DIP SW 1-8											
		ON	OFF												
DIP SW 1-7	ON	B to C [Extra Low] C to D [Low]	B to C [Low] C to D [Low]												
	OFF	B to C [Setting airflow] C to D [Setting airflow]	B to C [Extra Low] C to D [Low] Note: Initial setting												
3. Drain pump	<p>3-1. Drain pump control The drain pump turns ON for the specified amount of time when any of the following conditions has been satisfied:</p> <p>① ON for 3 minutes after the operation mode is switched from COOL or DRYING to another operation mode (FAN). ② ON for 6 minutes after the float switch is submerged in the water when the float switch control judges the sensor is in the water.</p> <p>3-2. Float switch control</p> <ul style="list-style-type: none"> Float switch control judges whether the sensor is in the air or in the water by turning the float switch ON/OFF. <p>In the water: Detected that the float switch is ON for 15 seconds. In the air : Detected that the float switch is OFF for 15 seconds.</p>	<ul style="list-style-type: none"> This control is same for the model without auxiliary heater. Operates as it would in COOL operation. 													
4. Vane control (Up/down vane change)	<p>(1) Initial setting: OFF → HEAT...[last setting] When the last setting is [Swing] ... [Downward D] When changing the mode from exception of HEAT to HEAT operation ...[Downward D]</p> <p>(2) Vane position: Horizontal →Downward A →Downward B →Downward C→Downward D→Swing→Auto</p> <p>(3) Restriction of vane position</p> <p>① The vane is horizontally fixed for the following modes. (The control by the remote controller is temporally invalidated and control by the unit.)</p> <ul style="list-style-type: none"> Thermo-OFF Hot adjust [Extra low] mode Heat defrost mode 														


8-5. AUTO OPERATION [AUTOMATIC COOL/HEAT CHANGE OVER OPERATION]



<How to operate>

- ① Press ON/OFF button.
- ② Press [F1] button to display AUTO.
- ③ Press [F2] [F3] button to set the set temperature.

NOTE: The settable temperature range varies with the model of outdoor units and remote controller.

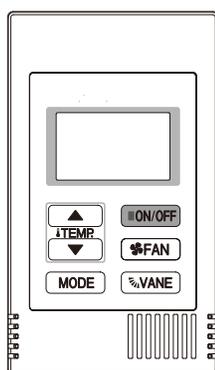

<How to operate>

- ① Press POWER ON/OFF button.
- ② Press the operation MODE button to display AUTO.
- ③ Press the TEMP. button to set the set temperature.

NOTE: The set temperature changes 1°F when the  or  button is pressed one time. Automatic 67 to 83°F

Control Mode	Control Details	Remarks
1. Initial value of operation mode	HEAT mode for room temperature < Set temperature COOL mode for room temperature ≥ Set temperature	
2. Mode change	(1) HEAT mode → COOL mode Room temperature ≥ Set temperature + 3°F or 3 minutes have passed. (2) COOL mode → HEAT mode Room temperature ≤ Set temperature - 3°F or 3 minutes have passed.	
3. COOL mode	Operates as it would in COOL operation.	
4. HEAT mode	Operates as it would in HEAT operation.	

8-6. WHEN UNIT IS STOPPED CONTROL MODE

Control Mode	Control Details	Remarks
1. Drain pump	1-1. Drain pump control The drain pump turns ON for the specified amount of time when any of the following conditions has been satisfied: ① ON for 3 minutes after the operation mode is switched from COOL or DRYING to another operation mode (FAN). ② ON for 6 minutes after the float switch is submerged in the water when the float switch control judges the sensor is in the water.	
	1-2. Float switch control • Float switch control judges whether the sensor is in the air or in the water by turning the float switch ON/OFF. In the water : Detected that the float switch is ON for 15 seconds. In the air : Detected that the float switch is OFF for 15 seconds.	• Operates as it would in COOL operation.


9-1. HOW TO CHECK THE PARTS


PKFY-WL04NLMU-E.TH
PKFY-WL12NLMU-E.TH

PKFY-WL06NLMU-E.TH
PKFY-WL15NLMU-E.TH

PKFY-WL08NLMU-E.TH

Parts name	Checkpoints																
Room temperature detection thermistor (TH21) Pipe temperature detection thermistor/liquid (TH22) Pipe temperature detection thermistor/gas (TH23)	Disconnect the connector then measure the resistance with a multimeter. (At the ambient temperature 50 to 86°F) <table border="1" style="margin-left: 20px;"> <tr> <td style="text-align: center;">Normal</td> </tr> <tr> <td style="text-align: center;">4.3 to 9.6 kΩ</td> </tr> </table> Refer to "9-1-1. Thermistor".	Normal	4.3 to 9.6 kΩ														
Normal																	
4.3 to 9.6 kΩ																	
Vane motor (MV1) 	Measure the resistance between the terminals with a multimeter. (At the ambient temperature 77°F) <table border="1" style="margin-left: 20px;"> <tr> <td colspan="4" style="text-align: center;">Normal</td> </tr> <tr> <td style="text-align: center;">⑩ - ④</td> <td style="text-align: center;">⑩ - ③</td> <td style="text-align: center;">⑩ - ⑦</td> <td style="text-align: center;">⑩ - ⑥</td> </tr> <tr> <td style="text-align: center;">Red-Sky Blue</td> <td style="text-align: center;">Red-Sky Blue</td> <td style="text-align: center;">Red-Sky Blue</td> <td style="text-align: center;">Red-Sky Blue</td> </tr> <tr> <td colspan="4" style="text-align: center;">300 Ω ±7%</td> </tr> </table>	Normal				⑩ - ④	⑩ - ③	⑩ - ⑦	⑩ - ⑥	Red-Sky Blue	Red-Sky Blue	Red-Sky Blue	Red-Sky Blue	300 Ω ±7%			
Normal																	
⑩ - ④	⑩ - ③	⑩ - ⑦	⑩ - ⑥														
Red-Sky Blue	Red-Sky Blue	Red-Sky Blue	Red-Sky Blue														
300 Ω ±7%																	
Vane motor (Lower (MV2)) 	Measure the resistance between the terminals with a multimeter. (At the ambient temperature 77°F) <table border="1" style="margin-left: 20px;"> <tr> <td colspan="4" style="text-align: center;">Normal</td> </tr> <tr> <td style="text-align: center;">⑤ - ④</td> <td style="text-align: center;">⑤ - ③</td> <td style="text-align: center;">⑤ - ②</td> <td style="text-align: center;">⑤ - ①</td> </tr> <tr> <td style="text-align: center;">Red-Sky Blue</td> <td style="text-align: center;">Red-Sky Blue</td> <td style="text-align: center;">Red-Sky Blue</td> <td style="text-align: center;">Red-Sky Blue</td> </tr> <tr> <td colspan="4" style="text-align: center;">300 ±26.3 Ω</td> </tr> </table>	Normal				⑤ - ④	⑤ - ③	⑤ - ②	⑤ - ①	Red-Sky Blue	Red-Sky Blue	Red-Sky Blue	Red-Sky Blue	300 ±26.3 Ω			
Normal																	
⑤ - ④	⑤ - ③	⑤ - ②	⑤ - ①														
Red-Sky Blue	Red-Sky Blue	Red-Sky Blue	Red-Sky Blue														
300 ±26.3 Ω																	
Fan motor (MF)	Refer to "9-1-3. DC Fan motor (fan motor/indoor controller board)																
Flow control valve (FCV) 	Disconnect the connector then measure the resistance between terminals with a multimeter. Refer to the next page for details. <table border="1" style="margin-left: 20px;"> <tr> <td colspan="4" style="text-align: center;">Normal</td> <td style="text-align: center;">Abnormal</td> </tr> <tr> <td style="text-align: center;">1-5 Yellow-Blue</td> <td style="text-align: center;">2-5 Orange-Blue</td> <td style="text-align: center;">3-5 Red-Blue</td> <td style="text-align: center;">4-5 Green-Blue</td> <td rowspan="2" style="text-align: center;">Open or short</td> </tr> <tr> <td colspan="4" style="text-align: center;">55 Ω ±5.6 Ω (at 77°F)</td> </tr> </table>	Normal				Abnormal	1-5 Yellow-Blue	2-5 Orange-Blue	3-5 Red-Blue	4-5 Green-Blue	Open or short	55 Ω ±5.6 Ω (at 77°F)					
Normal				Abnormal													
1-5 Yellow-Blue	2-5 Orange-Blue	3-5 Red-Blue	4-5 Green-Blue	Open or short													
55 Ω ±5.6 Ω (at 77°F)																	
Drain pump (DP) 	① Check if the drain float switch works properly. ② Check if the drain pump works and drains water properly in cooling operation. ③ If no water drains, confirm that the check code 2502 will not be displayed 10 minutes after the operation starts. Note: The drain pump for this model is driven by the internal DC motor, so it is not possible to measure the resistance between the terminals. Normal Red-Black: Input 13 VDC → The pump motor starts to rotate.																
Drain float switch (FS) 	Measure the resistance between the terminals with a multimeter. <table border="1" style="margin-left: 20px;"> <thead> <tr> <th>State of moving part</th> <th>Normal</th> <th>Abnormal</th> <th>Drain float switch connector terminal</th> </tr> </thead> <tbody> <tr> <td style="text-align: center;">UP</td> <td style="text-align: center;">Short</td> <td style="text-align: center;">Other than short</td> <td style="text-align: center;">①(+) - ②(-)</td> </tr> <tr> <td style="text-align: center;">DOWN</td> <td style="text-align: center;">Open</td> <td style="text-align: center;">Other than open</td> <td style="text-align: center;">①(+) - ②(-)</td> </tr> <tr> <td style="text-align: center;">-</td> <td style="text-align: center;">Short</td> <td style="text-align: center;">Other than short</td> <td style="text-align: center;">③(+) - ④(-)</td> </tr> </tbody> </table>	State of moving part	Normal	Abnormal	Drain float switch connector terminal	UP	Short	Other than short	①(+) - ②(-)	DOWN	Open	Other than open	①(+) - ②(-)	-	Short	Other than short	③(+) - ④(-)
State of moving part	Normal	Abnormal	Drain float switch connector terminal														
UP	Short	Other than short	①(+) - ②(-)														
DOWN	Open	Other than open	①(+) - ②(-)														
-	Short	Other than short	③(+) - ④(-)														



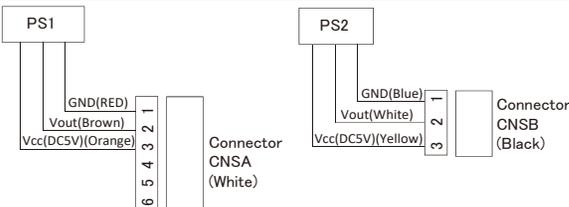Parts name	Checkpoints
Pressure sensor (Optional parts)	<ul style="list-style-type: none"> Pressure sensor (inner water) PS1 Pressure sensor (outlet water) PS2 <p>1. Check that the pressure sensor is connected. 2. Check the pressure sensor wiring for breakage.</p> <p>Pressure 0-1.0 MPa [145 psi] Vout 0.5-4.5 V 0.392 V / 0.098 MPa [14 psi] Pressure [MPa] = 0.25 × Vout [V] - 0.125 Pressure [psi] = (0.25 × Vout [V] - 0.125) × 145</p> 

9-1-1. Thermistor

<Thermistor characteristic graph>

Thermistor for lower temperature


- thermistor (TH21) (Room temperature detection)
- thermistor (TH22) (Pipe temperature detection/ inlet)
- thermistor (TH23) (Pipe temperature detection/ outlet)

Thermistor $R_0=15\text{ k}\Omega \pm 3\%$
Fixed number of $B=3480 \pm 2\%$

$$R_t = 15 \exp \left\{ 3480 \left(\frac{1}{273 + (t-32)/1.8} - \frac{1}{273} \right) \right\}$$

30°F	15.8kΩ
50°F	9.6kΩ
70°F	6.0kΩ
80°F	4.8kΩ
90°F	3.9kΩ
100°F	3.2kΩ

< Thermistor for lower temperature >

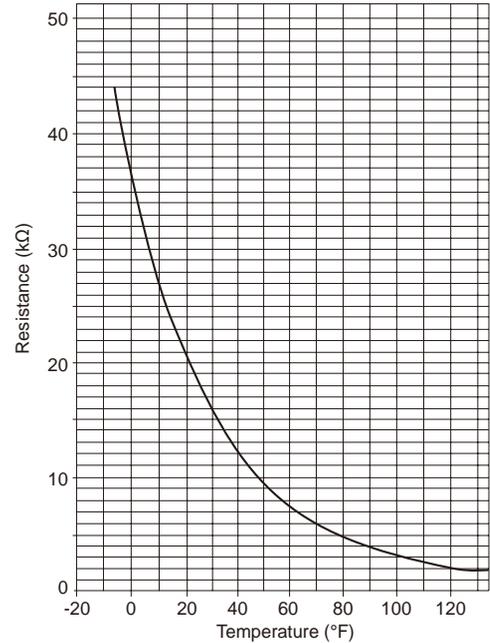


9-1-2. Flow control valve (FCV)

① Summary of flow control valve (FCV) operation

- The FCV is operated by a stepping motor, which operates by receiving a pulse signal from the indoor control board.
- The FCV position changes in response to the pulse signal.

Indoor control board and FCV connection

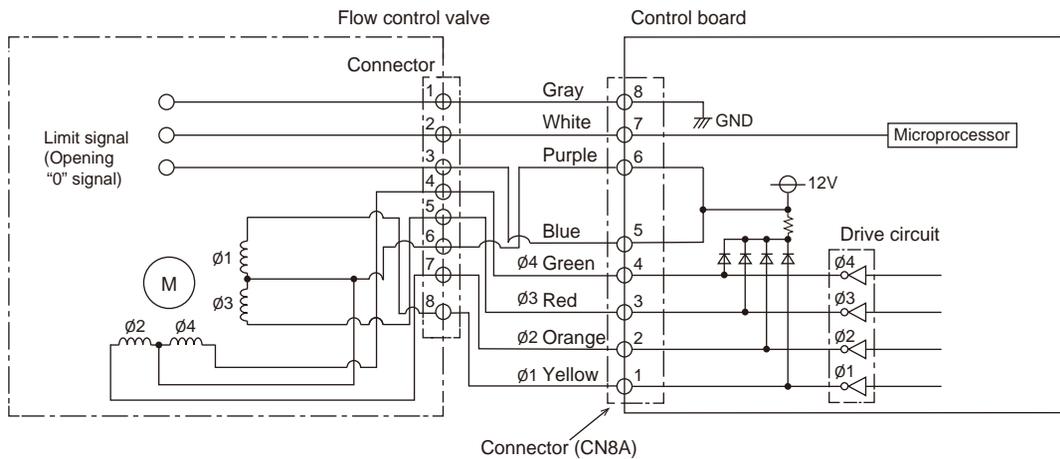


Pulse signal output and valve operation

Output (phase) number	Output status			
	1	2	3	4
φ1	OFF	ON	ON	OFF
φ2	ON	ON	OFF	OFF
φ3	ON	OFF	OFF	ON
φ4	OFF	OFF	ON	ON

The output pulse changes in the following order:
When the valve closes 1 -> 2 -> 3 -> 4 -> 1
When the valve opens 4 -> 3 -> 2 -> 1 -> 4

② FCV operation

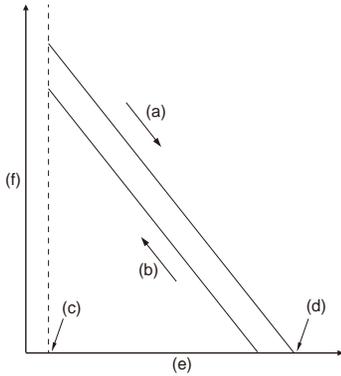

- (a) Close
- (b) Open
- (c) Fully open valve (85 pulses)
- (d) Fully close valve (770 pulses)
- (e) No. of pulses
- (f) Valve opening degree

9-1-3. DC Fan motor (fan motor/indoor controller board)


Check method of indoor fan motor (fan motor/indoor controller board)

① Notes

- High voltage is applied to the connector (CNMF) for the fan motor. Pay attention to the service.
- Do not pull out the connector (CNMF) for the motor with the power supply on.
(It causes trouble of the indoor controller board and fan motor.)

② Self check

Conditions : The indoor fan cannot rotate.

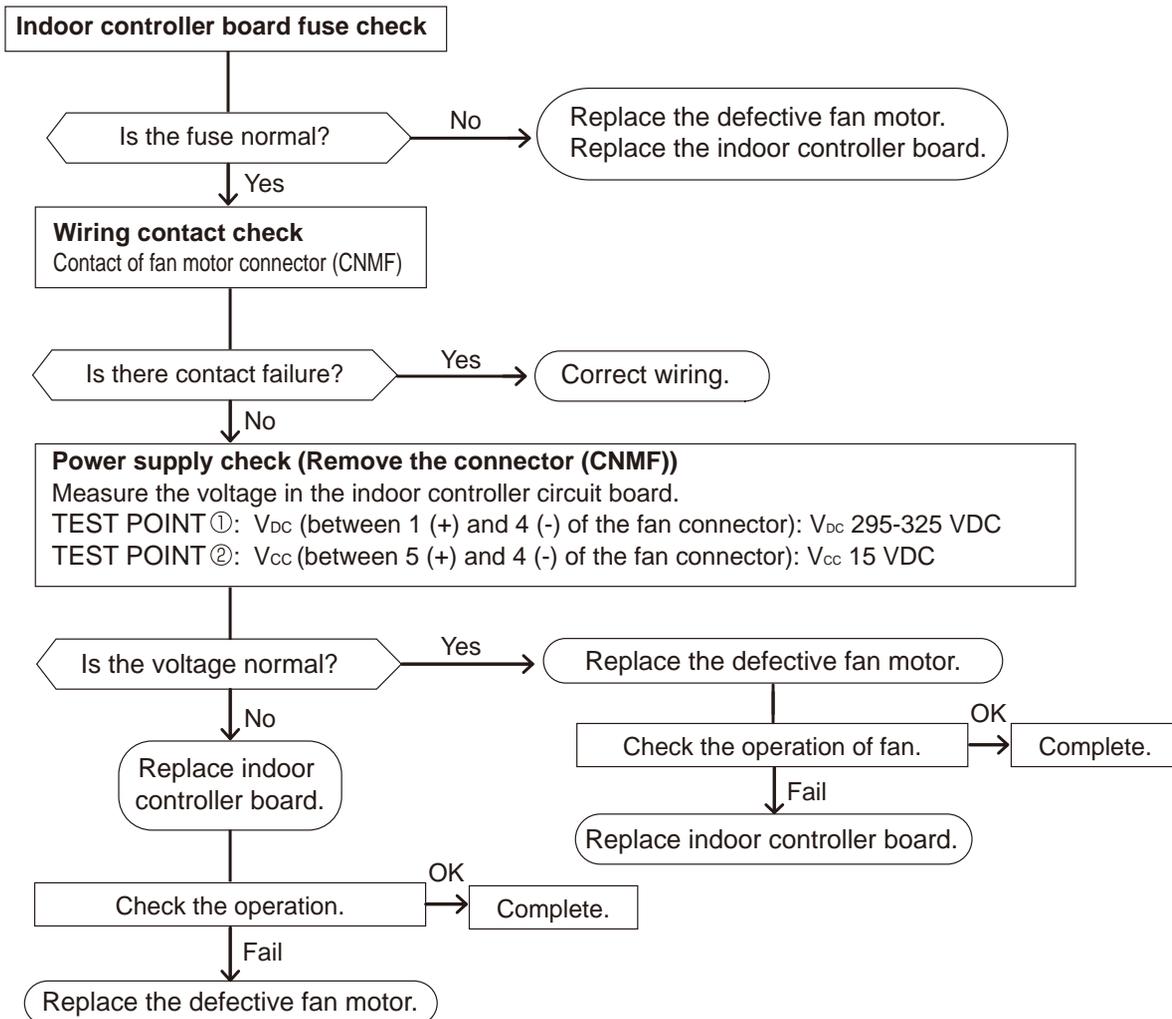

9-2. FUNCTION OF DIP SWITCH

PKFY-WL04NLMU-E.TH
PKFY-WL12NLMU-E.TH

PKFY-WL06NLMU-E.TH
PKFY-WL15NLMU-E.TH

PKFY-WL08NLMU-E.TH

The black square (■) indicates a switch position.










Switch	Pole	Function	Operation by switch		Effective timing	Remarks																																																																																																																																																																														
			ON	OFF																																																																																																																																																																																
SW1 Mode Selection	1	Thermistor <Intake temperature detection> position	Built-in remote controller	Indoor unit	Under suspension	<div style="border: 1px solid black; padding: 5px; margin-bottom: 5px;">Address board</div> <Initial setting> ON <table border="1" style="display: inline-table; vertical-align: middle;"><tr><td> </td><td> </td><td> </td><td> </td><td> </td><td> </td><td> </td><td> </td><td> </td><td> </td></tr><tr><td> </td><td> </td><td> </td><td> </td><td> </td><td> </td><td> </td><td> </td><td> </td><td> </td></tr></table> OFF <table border="1" style="display: inline-table; vertical-align: middle;"><tr><td> </td><td> </td><td> </td><td> </td><td> </td><td> </td><td> </td><td> </td><td> </td><td> </td></tr><tr><td> </td><td> </td><td> </td><td> </td><td> </td><td> </td><td> </td><td> </td><td> </td><td> </td></tr></table> 1 2 3 4 5 6 7 8 9 10																																																																																																																																																																														
	2	Filter clogging	Provided	Not provided																																																																																																																																																																																
	3	Filter sign indication	2,500 hr	100 hr																																																																																																																																																																																
	4	Air intake*1	Not effective	Not effective																																																																																																																																																																																
	5	Remote indication switching	Thermo-ON signal indication	Fan output indication																																																																																																																																																																																
	6	Humidifier control	Fan operation at Heating mode	Thermo-ON operation at heating mode																																																																																																																																																																																
7	Airflow set in case of heat thermo-OFF	Low*2	Extra low*2																																																																																																																																																																																	
8		Setting airflow*1	Depends on SW1-7																																																																																																																																																																																	
9	Auto restart function	Effective	Not effective																																																																																																																																																																																	
10	Power ON/OFF	Effective	Not effective																																																																																																																																																																																	
SW2 Capacity code setting	1-4	<table border="1" style="width: 100%; text-align: center;"> <thead> <tr> <th>Models</th> <th>SW2</th> <th>Models</th> <th>SW2</th> </tr> </thead> <tbody> <tr> <td>WL04</td> <td>OFF <table border="1" style="display: inline-table; vertical-align: middle;"><tr><td> </td><td> </td><td> </td><td> </td><td> </td><td> </td><td> </td><td> </td></tr><tr><td> </td><td> </td><td> </td><td> </td><td> </td><td> </td><td> </td><td> </td></tr></table> ON <table border="1" style="display: inline-table; vertical-align: middle;"><tr><td> </td><td> </td><td> </td><td> </td><td> </td><td> </td><td> </td><td> </td></tr><tr><td> </td><td> </td><td> </td><td> </td><td> </td><td> </td><td> </td><td> </td></tr></table> 6 5 4 3 2 1</td> <td>WL12</td> <td>OFF <table border="1" style="display: inline-table; vertical-align: middle;"><tr><td> </td><td> </td><td> </td><td> </td><td> </td><td> </td><td> </td><td> </td></tr><tr><td> </td><td> </td><td> </td><td> </td><td> </td><td> </td><td> </td><td> </td></tr></table> ON <table border="1" style="display: inline-table; vertical-align: middle;"><tr><td> </td><td> </td><td> </td><td> </td><td> </td><td> </td><td> </td><td> </td></tr><tr><td> </td><td> </td><td> </td><td> </td><td> </td><td> </td><td> </td><td> </td></tr></table> 6 5 4 3 2 1</td> </tr> <tr> <td>WL06</td> <td>OFF <table border="1" style="display: inline-table; vertical-align: middle;"><tr><td> </td><td> </td><td> </td><td> </td><td> </td><td> </td><td> </td><td> </td></tr><tr><td> </td><td> </td><td> </td><td> </td><td> </td><td> </td><td> </td><td> </td></tr></table> ON <table border="1" style="display: inline-table; vertical-align: middle;"><tr><td> </td><td> </td><td> </td><td> </td><td> </td><td> </td><td> </td><td> </td></tr><tr><td> </td><td> </td><td> </td><td> </td><td> </td><td> </td><td> </td><td> </td></tr></table> 6 5 4 3 2 1</td> <td>WL15</td> <td>OFF <table border="1" style="display: inline-table; vertical-align: middle;"><tr><td> </td><td> </td><td> </td><td> </td><td> </td><td> </td><td> </td><td> </td></tr><tr><td> </td><td> </td><td> </td><td> </td><td> </td><td> </td><td> </td><td> </td></tr></table> ON <table border="1" style="display: inline-table; vertical-align: middle;"><tr><td> </td><td> </td><td> </td><td> </td><td> </td><td> </td><td> </td><td> </td></tr><tr><td> </td><td> </td><td> </td><td> </td><td> </td><td> </td><td> </td><td> </td></tr></table> 6 5 4 3 2 1</td> </tr> <tr> <td>WL08</td> <td>OFF <table border="1" style="display: inline-table; vertical-align: middle;"><tr><td> </td><td> </td><td> </td><td> </td><td> </td><td> </td><td> </td><td> </td></tr><tr><td> </td><td> </td><td> </td><td> </td><td> </td><td> </td><td> </td><td> </td></tr></table> ON <table border="1" style="display: inline-table; vertical-align: middle;"><tr><td> </td><td> </td><td> </td><td> </td><td> </td><td> </td><td> </td><td> </td></tr><tr><td> </td><td> </td><td> </td><td> </td><td> </td><td> </td><td> </td><td> </td></tr></table> 6 5 4 3 2 1</td> <td></td> </tr> </tbody> </table>		Models	SW2	Models	SW2	WL04	OFF <table border="1" style="display: inline-table; vertical-align: middle;"><tr><td> </td><td> </td><td> </td><td> </td><td> </td><td> </td><td> </td><td> </td></tr><tr><td> </td><td> </td><td> </td><td> </td><td> </td><td> </td><td> </td><td> </td></tr></table> ON <table border="1" style="display: inline-table; vertical-align: middle;"><tr><td> </td><td> </td><td> </td><td> </td><td> </td><td> </td><td> </td><td> </td></tr><tr><td> </td><td> </td><td> </td><td> </td><td> </td><td> </td><td> </td><td> </td></tr></table> 6 5 4 3 2 1																																	WL12	OFF <table border="1" style="display: inline-table; vertical-align: middle;"><tr><td> </td><td> </td><td> </td><td> </td><td> </td><td> </td><td> </td><td> </td></tr><tr><td> </td><td> </td><td> </td><td> </td><td> </td><td> </td><td> </td><td> </td></tr></table> ON <table border="1" style="display: inline-table; vertical-align: middle;"><tr><td> </td><td> </td><td> </td><td> </td><td> </td><td> </td><td> </td><td> </td></tr><tr><td> </td><td> </td><td> </td><td> </td><td> </td><td> </td><td> </td><td> </td></tr></table> 6 5 4 3 2 1																																	WL06	OFF <table border="1" style="display: inline-table; vertical-align: middle;"><tr><td> </td><td> </td><td> </td><td> </td><td> </td><td> </td><td> </td><td> </td></tr><tr><td> </td><td> </td><td> </td><td> </td><td> </td><td> </td><td> </td><td> </td></tr></table> ON <table border="1" style="display: inline-table; vertical-align: middle;"><tr><td> </td><td> </td><td> </td><td> </td><td> </td><td> </td><td> </td><td> </td></tr><tr><td> </td><td> </td><td> </td><td> </td><td> </td><td> </td><td> </td><td> </td></tr></table> 6 5 4 3 2 1																																	WL15	OFF <table border="1" style="display: inline-table; vertical-align: middle;"><tr><td> </td><td> </td><td> </td><td> </td><td> </td><td> </td><td> </td><td> </td></tr><tr><td> </td><td> </td><td> </td><td> </td><td> </td><td> </td><td> </td><td> </td></tr></table> ON <table border="1" style="display: inline-table; vertical-align: middle;"><tr><td> </td><td> </td><td> </td><td> </td><td> </td><td> </td><td> </td><td> </td></tr><tr><td> </td><td> </td><td> </td><td> </td><td> </td><td> </td><td> </td><td> </td></tr></table> 6 5 4 3 2 1																																	WL08	OFF <table border="1" style="display: inline-table; vertical-align: middle;"><tr><td> </td><td> </td><td> </td><td> </td><td> </td><td> </td><td> </td><td> </td></tr><tr><td> </td><td> </td><td> </td><td> </td><td> </td><td> </td><td> </td><td> </td></tr></table> ON <table border="1" style="display: inline-table; vertical-align: middle;"><tr><td> </td><td> </td><td> </td><td> </td><td> </td><td> </td><td> </td><td> </td></tr><tr><td> </td><td> </td><td> </td><td> </td><td> </td><td> </td><td> </td><td> </td></tr></table> 6 5 4 3 2 1																																		Indoor controller board	<Initial setting> Set for each capacity.
		Models	SW2	Models	SW2																																																																																																																																																																															
		WL04	OFF <table border="1" style="display: inline-table; vertical-align: middle;"><tr><td> </td><td> </td><td> </td><td> </td><td> </td><td> </td><td> </td><td> </td></tr><tr><td> </td><td> </td><td> </td><td> </td><td> </td><td> </td><td> </td><td> </td></tr></table> ON <table border="1" style="display: inline-table; vertical-align: middle;"><tr><td> </td><td> </td><td> </td><td> </td><td> </td><td> </td><td> </td><td> </td></tr><tr><td> </td><td> </td><td> </td><td> </td><td> </td><td> </td><td> </td><td> </td></tr></table> 6 5 4 3 2 1																																	WL12	OFF <table border="1" style="display: inline-table; vertical-align: middle;"><tr><td> </td><td> </td><td> </td><td> </td><td> </td><td> </td><td> </td><td> </td></tr><tr><td> </td><td> </td><td> </td><td> </td><td> </td><td> </td><td> </td><td> </td></tr></table> ON <table border="1" style="display: inline-table; vertical-align: middle;"><tr><td> </td><td> </td><td> </td><td> </td><td> </td><td> </td><td> </td><td> </td></tr><tr><td> </td><td> </td><td> </td><td> </td><td> </td><td> </td><td> </td><td> </td></tr></table> 6 5 4 3 2 1																																																																																																																																															
WL06	OFF <table border="1" style="display: inline-table; vertical-align: middle;"><tr><td> </td><td> </td><td> </td><td> </td><td> </td><td> </td><td> </td><td> </td></tr><tr><td> </td><td> </td><td> </td><td> </td><td> </td><td> </td><td> </td><td> </td></tr></table> ON <table border="1" style="display: inline-table; vertical-align: middle;"><tr><td> </td><td> </td><td> </td><td> </td><td> </td><td> </td><td> </td><td> </td></tr><tr><td> </td><td> </td><td> </td><td> </td><td> </td><td> </td><td> </td><td> </td></tr></table> 6 5 4 3 2 1																																	WL15	OFF <table border="1" style="display: inline-table; vertical-align: middle;"><tr><td> </td><td> </td><td> </td><td> </td><td> </td><td> </td><td> </td><td> </td></tr><tr><td> </td><td> </td><td> </td><td> </td><td> </td><td> </td><td> </td><td> </td></tr></table> ON <table border="1" style="display: inline-table; vertical-align: middle;"><tr><td> </td><td> </td><td> </td><td> </td><td> </td><td> </td><td> </td><td> </td></tr><tr><td> </td><td> </td><td> </td><td> </td><td> </td><td> </td><td> </td><td> </td></tr></table> 6 5 4 3 2 1																																																																																																																																																	
WL08	OFF <table border="1" style="display: inline-table; vertical-align: middle;"><tr><td> </td><td> </td><td> </td><td> </td><td> </td><td> </td><td> </td><td> </td></tr><tr><td> </td><td> </td><td> </td><td> </td><td> </td><td> </td><td> </td><td> </td></tr></table> ON <table border="1" style="display: inline-table; vertical-align: middle;"><tr><td> </td><td> </td><td> </td><td> </td><td> </td><td> </td><td> </td><td> </td></tr><tr><td> </td><td> </td><td> </td><td> </td><td> </td><td> </td><td> </td><td> </td></tr></table> 6 5 4 3 2 1																																																																																																																																																																																			
SW3 Function Selection	1	Heat pump/Cool only	Cooling only	Heat pump	Under suspension	<div style="border: 1px solid black; padding: 5px; margin-bottom: 5px;">Indoor controller board</div> <Initial setting> ON <table border="1" style="display: inline-table; vertical-align: middle;"><tr><td> </td><td> </td><td> </td><td> </td><td> </td><td> </td><td> </td><td> </td><td> </td><td> </td></tr><tr><td> </td><td> </td><td> </td><td> </td><td> </td><td> </td><td> </td><td> </td><td> </td><td> </td></tr></table> OFF <table border="1" style="display: inline-table; vertical-align: middle;"><tr><td> </td><td> </td><td> </td><td> </td><td> </td><td> </td><td> </td><td> </td><td> </td><td> </td></tr><tr><td> </td><td> </td><td> </td><td> </td><td> </td><td> </td><td> </td><td> </td><td> </td><td> </td></tr></table> 1 2 3 4 5 6 7 8 9 0																																																																																																																																																																														
	2	—	—	—																																																																																																																																																																																
	3	—	—	—																																																																																																																																																																																
	4	—	—	—																																																																																																																																																																																
	5	—	—	—																																																																																																																																																																																
	6	—	—	—																																																																																																																																																																																
7	—	—	—																																																																																																																																																																																	
8	Heating 4 degree up	Not effective	Effective																																																																																																																																																																																	
9	—	—	—																																																																																																																																																																																	
10	—	—	—																																																																																																																																																																																	

<Table A>

SW1-7	SW1-8	
OFF	OFF	Extra low
ON	OFF	Low
OFF	ON	Setting airflow
ON	ON	stop

Continue to the next page

The black square (■) indicates a switch position.

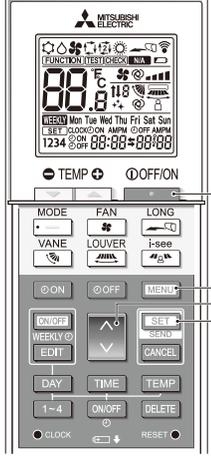Switch	Pole	Function	Effective timing	Remarks																																			
SWA (Fan speed)	1-3	Fan speed can be changed depending on SWA setting. <table border="1" style="margin-left: auto; margin-right: auto;"> <tr> <td></td> <td>Setting</td> </tr> <tr> <td>PKFY-WL**NLMU-E</td> <td>2</td> </tr> </table>		Setting	PKFY-WL**NLMU-E	2	Under operation or suspension	<div style="border: 1px solid black; padding: 2px; width: fit-content; margin: 0 auto;">Address board</div> <Initial setting> It follows as the left table.																															
	Setting																																						
PKFY-WL**NLMU-E	2																																						
SW11 1s digit address setting SW12 10s digit address setting	Rotary switch	Address setting should be done when M-NET remote controller is being used.  	Before power supply ON	<div style="border: 1px solid black; padding: 2px; width: fit-content; margin: 0 auto;">Address board</div> <Initial setting>  																																			
SW14 Connection No. setting	Rotary switch	This is the switch to be used when the indoor unit is operated with R2 series outdoor unit as a set. 		<div style="border: 1px solid black; padding: 2px; width: fit-content; margin: 0 auto;">Address board</div> <Initial setting> 																																			
SW22 Function selection	Jumper	<table border="1" style="margin-left: auto; margin-right: auto;"> <thead> <tr> <th>Function</th> <th>ON</th> <th>OFF</th> </tr> </thead> <tbody> <tr> <td>1</td> <td>—</td> <td>—</td> </tr> <tr> <td>2</td> <td>—</td> <td>—</td> </tr> <tr> <td>3 Pair No. of wireless remote controller</td> <td colspan="2" rowspan="2">Depends on SW22-3, 22-4</td> </tr> <tr> <td>4 Pair No. of wireless remote controller</td> </tr> </tbody> </table> <ul style="list-style-type: none"> To operate each indoor unit by each remote controller when installed 2 indoor units or more are near, Pair No. setting is necessary. <ul style="list-style-type: none"> Pair No. setting is available with the 4 patterns. Pair No. setting is not set necessarily when operating it by one remote controller. Setting for indoor unit. <p>Wireless remote controller pair number:</p> <ul style="list-style-type: none"> Setting operation (Fig. 1 (A)) <ol style="list-style-type: none"> Press the  button ① to stop the air conditioner. Press the  button ②. Check that function No. "1" is displayed, and then press the  button ③. The Screen display setting screen will be displayed. (Fig. 2.) Pair No. changing operation (Fig. 2 (B)) <ol style="list-style-type: none"> Press the  button ④. Each time the  button ④ is pressed, the pair No. 0-3 changes. Press the  button ③ to check the setting. Press the  button ②. <table border="1" style="margin-left: auto; margin-right: auto;"> <thead> <tr> <th colspan="2">Indoor unit SW22</th> <th rowspan="2">Pair No. of wireless remote controller</th> <th rowspan="2"></th> </tr> <tr> <th>SW22-3</th> <th>SW22-4</th> </tr> </thead> <tbody> <tr> <td>ON</td> <td>ON</td> <td>0</td> <td>Initial setting</td> </tr> <tr> <td>OFF</td> <td>ON</td> <td>1</td> <td>—</td> </tr> <tr> <td>ON</td> <td>OFF</td> <td>2</td> <td>—</td> </tr> <tr> <td>OFF</td> <td>OFF</td> <td>3-9</td> <td>—</td> </tr> </tbody> </table>	Function	ON	OFF	1	—	—	2	—	—	3 Pair No. of wireless remote controller	Depends on SW22-3, 22-4		4 Pair No. of wireless remote controller	Indoor unit SW22		Pair No. of wireless remote controller		SW22-3	SW22-4	ON	ON	0	Initial setting	OFF	ON	1	—	ON	OFF	2	—	OFF	OFF	3-9	—	Under operation or suspension	<Initial setting>   Fig. 1  Fig. 2
Function	ON	OFF																																					
1	—	—																																					
2	—	—																																					
3 Pair No. of wireless remote controller	Depends on SW22-3, 22-4																																						
4 Pair No. of wireless remote controller																																							
Indoor unit SW22		Pair No. of wireless remote controller																																					
SW22-3	SW22-4																																						
ON	ON	0	Initial setting																																				
OFF	ON	1	—																																				
ON	OFF	2	—																																				
OFF	OFF	3-9	—																																				
SWE Test run for Drain pump	Connector	Drain pump and fan are activated simultaneously after the connector SWE is set to ON and turn on the power.   The connector SWE is set to OFF after test run.	Under operation	<Initial setting> 																																			


9-3. TEST POINT DIAGRAM

9-3-1. Indoor controller board (I.B)

PKFY-WL04NLMU-E.TH
PKFY-WL12NLMU-E.TH

PKFY-WL06NLMU-E.TH
PKFY-WL15NLMU-E.TH

PKFY-WL08NLMU-E.TH

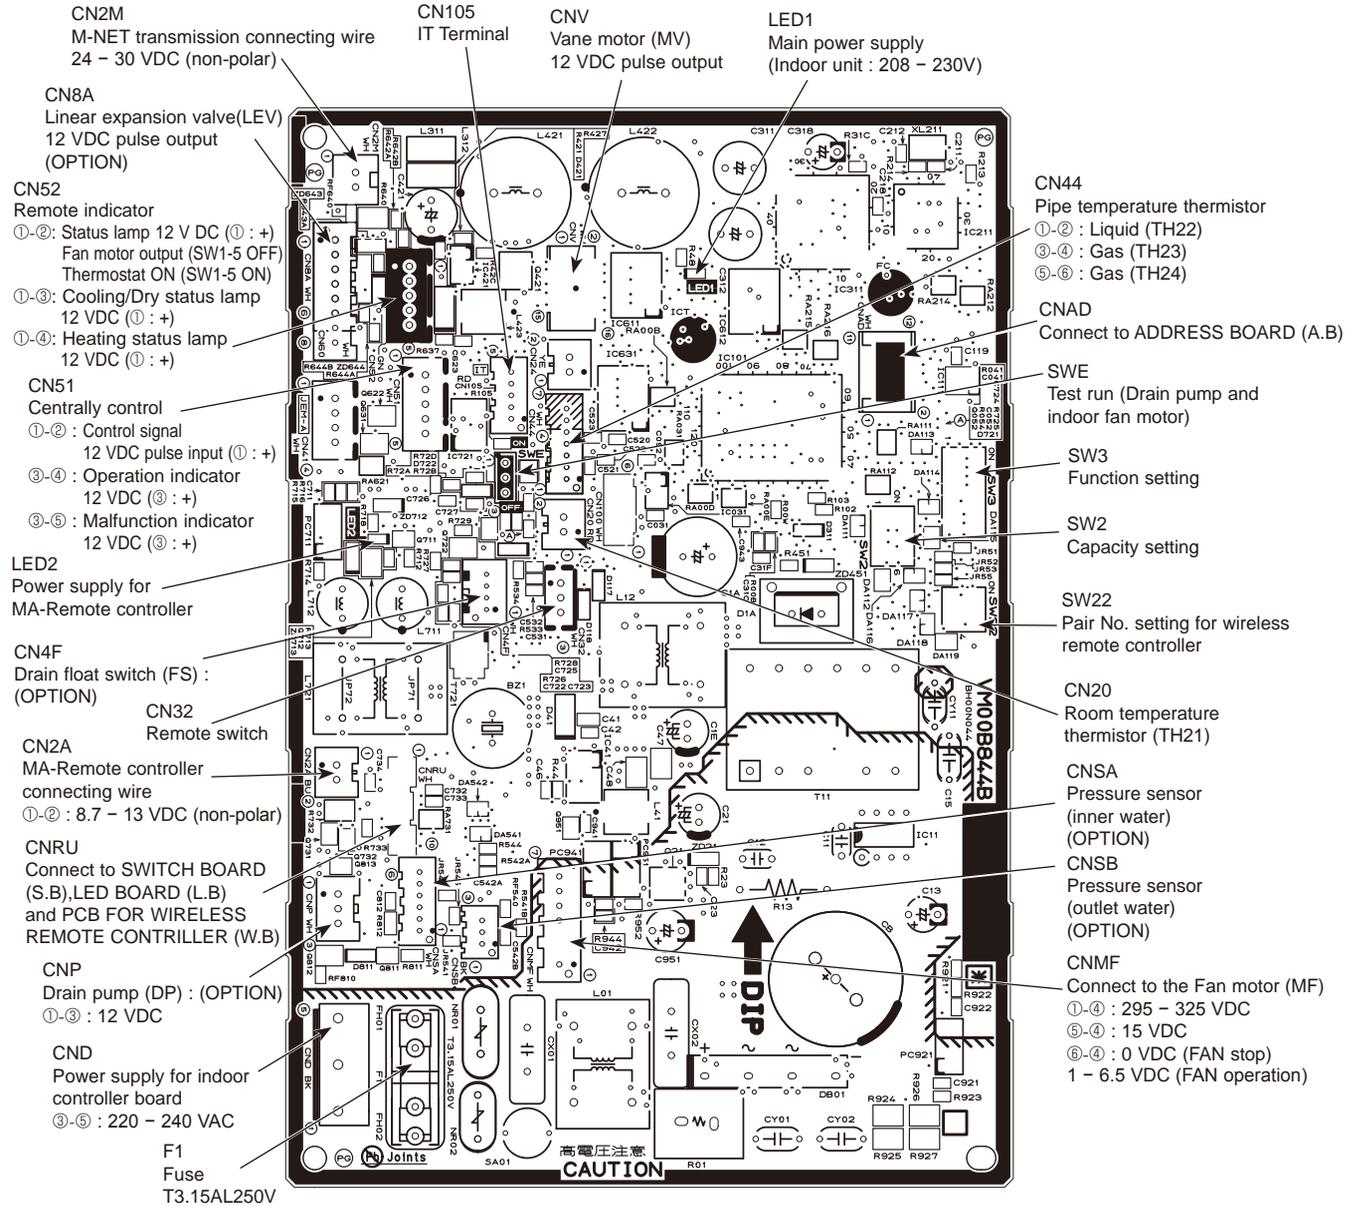

Note: The voltage range of 12 VDC in this page is between 11.5 to 13.7 VDC.


**9-3-2. PCB FOR WIRELESS REMOTE CONTROLLER (W.B),
SWITCH BOARD (S.B) and LED BOARD (L.B)**

PKFY-WL04NLMU-E.TH
PKFY-WL12NLMU-E.TH


PKFY-WL06NLMU-E.TH
PKFY-WL15NLMU-E.TH

PKFY-WL08NLMU-E.TH


**PCB FOR WIRELESS
REMOTE CONTROLLER (W.B)**

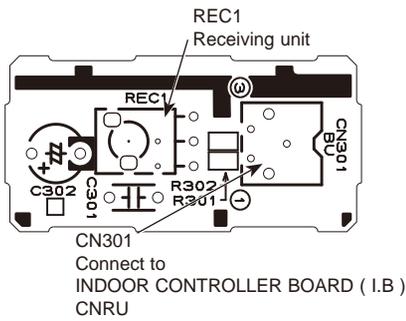

SWITCH BOARD (S.B)

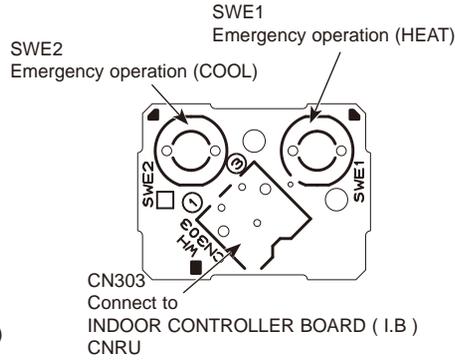


LED BOARD (L.B)

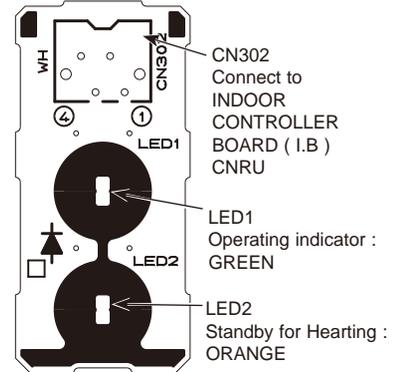

**9-3-3. Address board (A.B)
PKFY-WL04NLMU-E.TH
PKFY-WL12NLMU-E.TH**

PKFY-WL06NLMU-E.TH
PKFY-WL15NLMU-E.TH

PKFY-WL08NLMU-E.TH

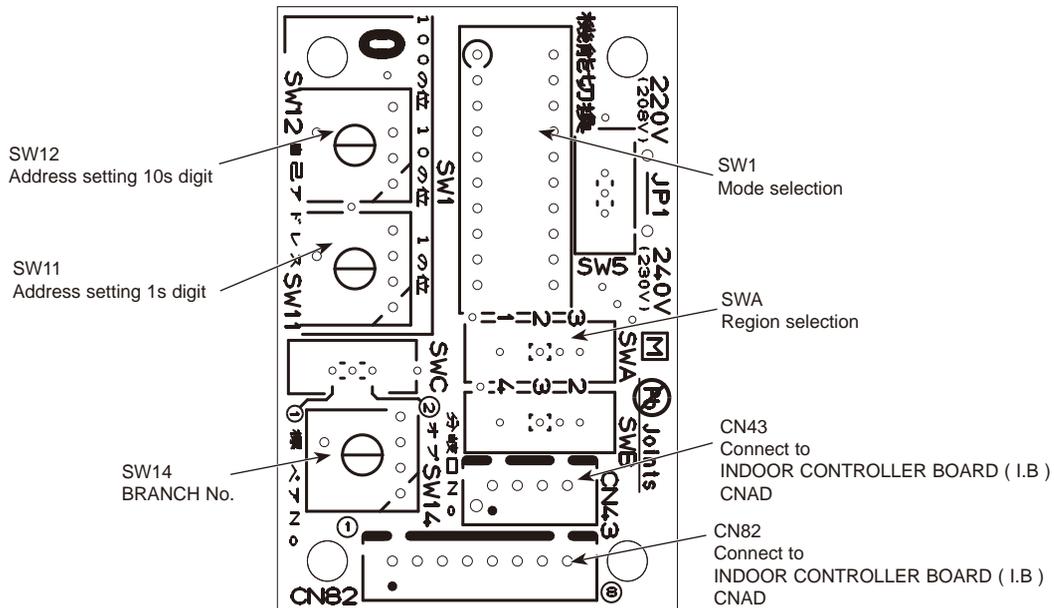





PKFY-WL04NLMU-E.TH
PKFY-WL12NLMU-E.TH


PKFY-WL06NLMU-E.TH
PKFY-WL15NLMU-E.TH

PKFY-WL08NLMU-E.TH

NOTE: Turn OFF the power supply before assembly.

Be careful when removing heavy parts.

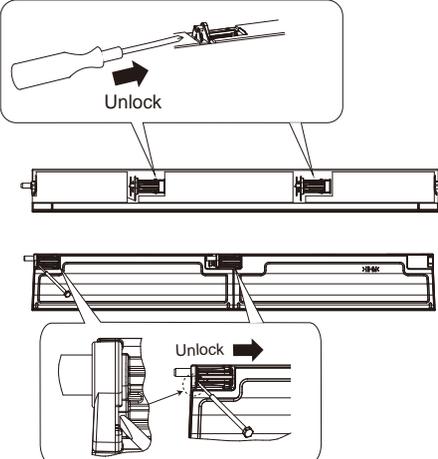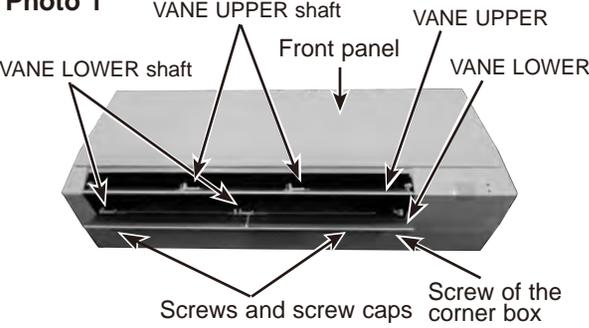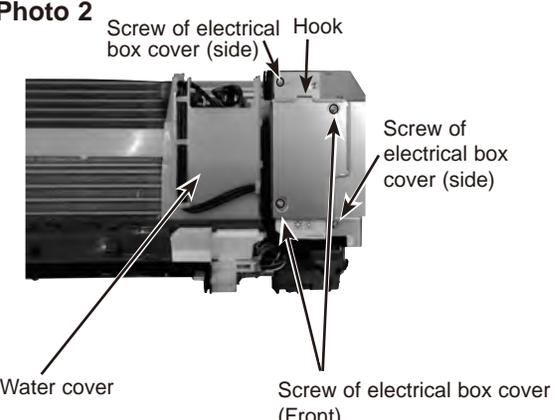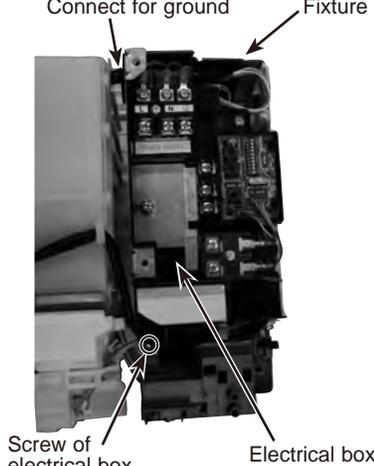OPERATION PROCEDURE	PHOTOS/FIGURES
<p>1. REMOVING THE PANEL</p> <p>(1) Insert the screwdriver to the hole at VANE LOWER shaft and slide the VANE LOWER shaft (2 places each). Push VANE UPPER shaft with the screwdriver.</p> <p>(2) Pull the VANE LOWER and VANE UPPER from unit.</p> <p>(3) Remove 2 screw caps of the front panel. Remove 2 screws. (See Photo 1)</p> <p>(4) Hold the lower part of both ends of the front panel and pull it slightly toward you, and then remove the front panel by pushing it upward.</p> <p>(5) Remove the screw of the corner box. (See Photo 1) Remove the corner box.</p> <div data-bbox="266 897 782 1471" style="border: 1px solid black; padding: 5px; margin-top: 10px;"> <p>Unlock the stopper and remove the horizontal vanes using following tool like a screwdriver.</p>  </div>	<p>Photo 1</p>  <p>Photo 2</p> 
<p>2. REMOVING THE ELECTRICAL BOX</p> <p>(1) Remove the panel and the corner box. (Refer procedure to 1)</p> <p>(2) Remove the front and side electrical box covers (each 2 screw).</p> <p>(3) Remove the transmission wiring of TB5, the power supply wiring of TB2 and the wiring of MA-remote controller (TB15).</p> <p>(4) Disconnect the connectors on the indoor controller board.</p> <p>(5) Disconnect the connector for ground wire.</p> <p>(6) Remove the screw on lower side of the electrical box. (See Photo 3)</p> <p>(7) Push up the upper fixture catch to remove the box, then remove it from the box fixture.</p>	<p>Photo 3</p> 



OPERATION PROCEDURE

3. REMOVING THE ADDRESS BOARD, THE INDOOR CONTROLLER BOARD, THE WIRELESS CONTROLLER BOARD, LED BOARD

- (1) Remove the panel and the corner box. (Refer to procedure 1)
- (2) Remove the front and side electrical box covers (each 2 screw).
- (3) Disconnect the connectors of address board.
- (4) Disconnect the connectors on the indoor controller board. (See Photo 4)
- (5) Remove the switch board holder and open the cover.
- (6) Pull out the indoor controller board toward you then remove the indoor controller board and switch board. (See Photo 4)
- (7) Remove the holder of wireless remote controller board and LED board.
- (8) Disconnect the connector of wireless remote controller board and LED board.
- (9) Remove the wireless remote controller board and LED board from the holder.

4. REMOVING THE NOZZLE ASSEMBLY (with VANE and VANE MOTOR) AND DRAIN HOSE

- (1) Remove the panel and corner box. (Refer to procedure 1)
- (2) Remove the electrical box covers. (Refer to procedure 2)
- (3) Disconnect the vane motor connector (CNV) on the indoor controller board.
- (4) Push fixture and pull out the drain hose from the nozzle assembly, and remove nozzle assembly. (See Photo 6)

5. REMOVING THE VANE MOTOR

- (1) Remove the nozzle assembly. (Refer to procedure 4)
- (2) Remove 2 screws of the vane motor unit cover, and pull out the vane motor unit.
- (3) Remove screw of the vane motor (LOWER).
- (4) Remove the vane motor (LOWER) from the vane motor unit cover.
- (5) Disconnect the connector (white) from the vane motor. (LOWER)
- (6) Remove 2 screw of the vane motor (UPPER).
- (7) Remove the vane motor (UPPER) from the vane motor unit cover.
- (8) Disconnect the connector (blue) from the vane motor (UPPER).

PHOTOS/FIGURES

Photo 4

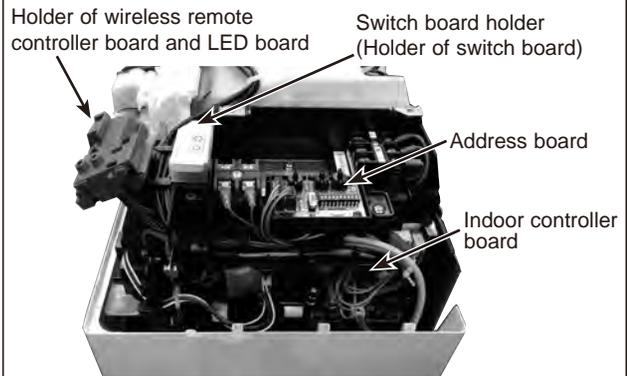


Photo 5 (see the bottom)

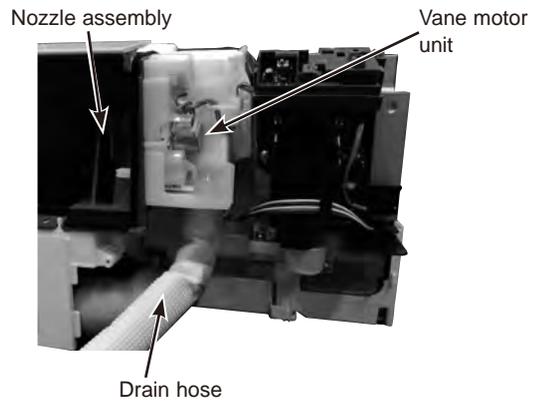


Photo 6



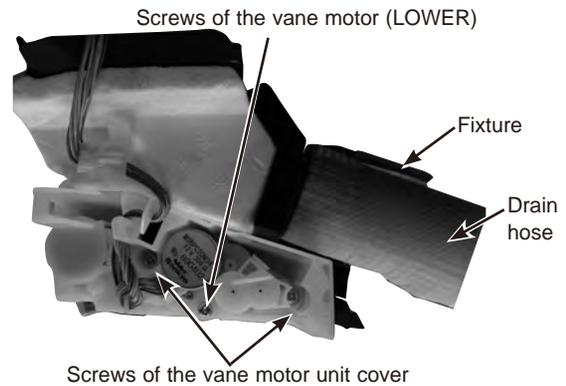


Photo 7

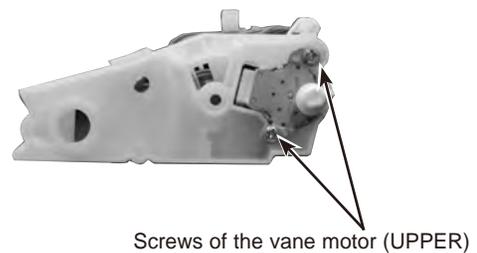



OPERATION PROCEDURE

6. REMOVING THE INDOOR FAN MOTOR AND THE LINE FLOW FAN

- (1) Remove the panel and the corner box. (Refer to procedure 1)
- (2) Remove the electrical box (Refer to procedure 2) and the nozzle assembly (Refer to procedure 4).
- (3) Remove the water cover. (See Photo 2)
- (4) Loosen the screw fixing the line flow fan. (See Photo 9)
- (5) Remove 3 screws fixing the motor bed. (See Photo 8)
- (6) Remove the motor bed together with fan motor and motor band.
- (7) Release the 2 hooks of the motor band. Remove the motor band. Pull out the indoor fan motor.
- (8) Remove 2 screws fixing the left side of the heat exchanger. (See Photo 10)
- (9) Lift the heat exchanger, and pull out the line flow fan to the lower-left.

Note: When attaching the line flow fan, screw the line flow fan so 4mm gap is provided between the right end of the line flow fan and the right wall of the air passage of the box. (See Photo 9)

PHOTOS/FIGURES

Photo 8

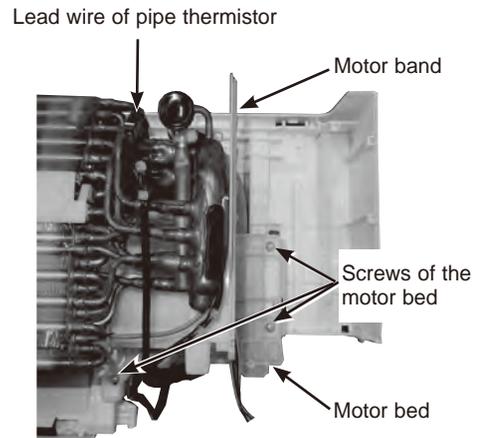


Photo 9


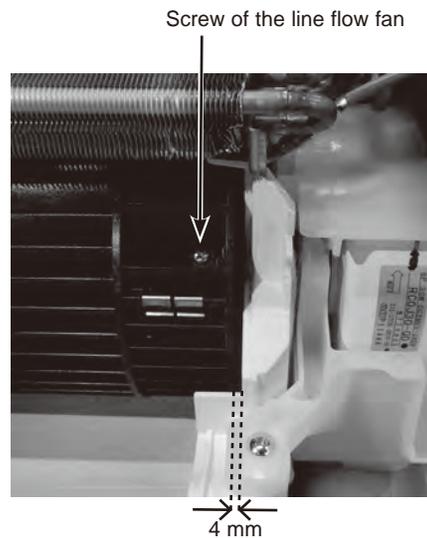



Photo 10

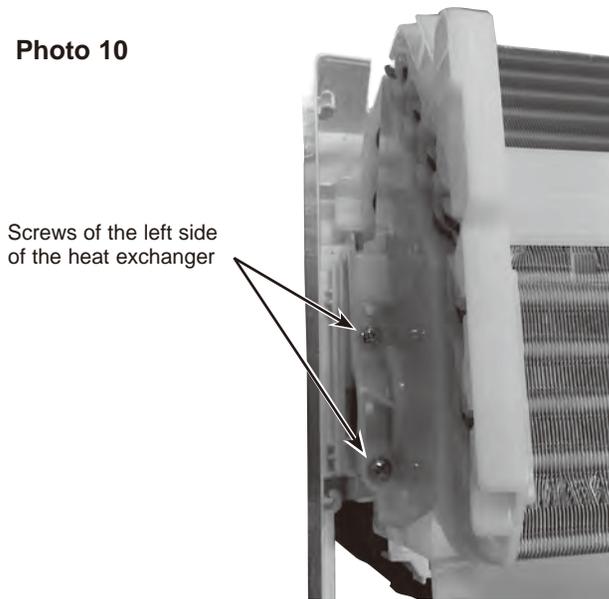





7. REMOVING PIPE THERMISTOR AND AIR PURGE VALVE

- (1) Remove the panel and the corner box. (Refer to procedure 1)
- (2) Remove the electrical box covers. (Refer to procedure 2)
- (3) Remove the water cover. (See Photo 2)
- (4) Remove the inlet pipe thermistor and outlet pipe thermistor.
- (5) Disconnect the connector (CN44) on the indoor controller board. (TH22 and TH23/CN44)
- (6) Remove the air purge valve

Photo 11

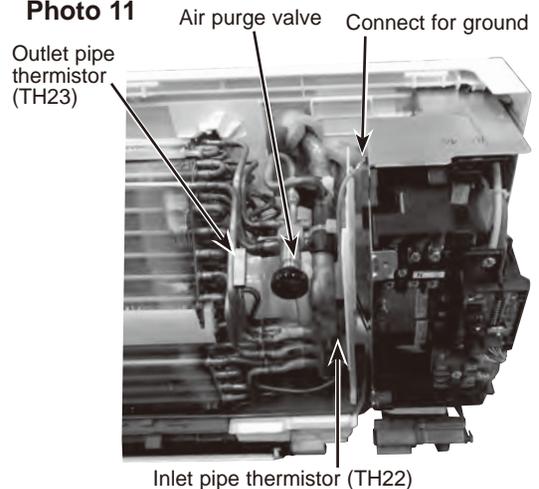




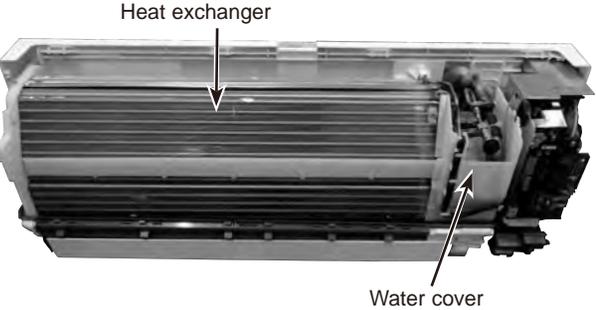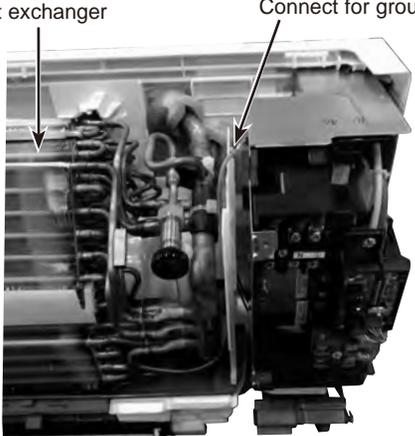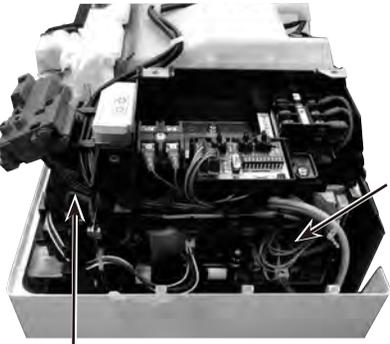OPERATION PROCEDURE	PHOTOS/FIGURES
<p>8. REMOVING THE HEAT EXCHANGER</p> <ol style="list-style-type: none">(1) Remove the panel and the corner box (Refer to procedure 1).(2) Remove the electrical box (Refer to procedure 3) and the nozzle assembly (Refer to procedure 4).(3) Remove the water cover.(4) Remove the pipe thermistors. (Refer to procedure 7).(5) Disconnect the connector (CN60) on the indoor controller board.(6) Remove the motor bed together with fan motor and motor band (Refer to procedure 6).(7) Remove 2 screws fixing the left side of the heat exchanger. (See Photo 10)(8) Remove the heat exchanger.	<p>Photo 12</p>  <p>Heat exchanger</p> <p>Water cover</p> <p>Photo 13</p>  <p>Heat exchanger</p> <p>Connect for ground</p>
<p>9. REMOVING THE ROOM TEMPERATURE THERMISTOR</p> <ol style="list-style-type: none">(1) Remove the panel and corner box. (Refer to procedure 1)(2) Remove the electrical box covers. (Refer to procedure 2)(3) Remove the room temperature thermistor.(4) Disconnect the connector (CN20) on the indoor controller board.	<p>Photo 14</p>  <p>Indoor controller board</p> <p>Room temp. thermistor (TH21)</p>

11-1. REMOTE CONTROLLER FUNCTIONS


<PAR-41MAA>

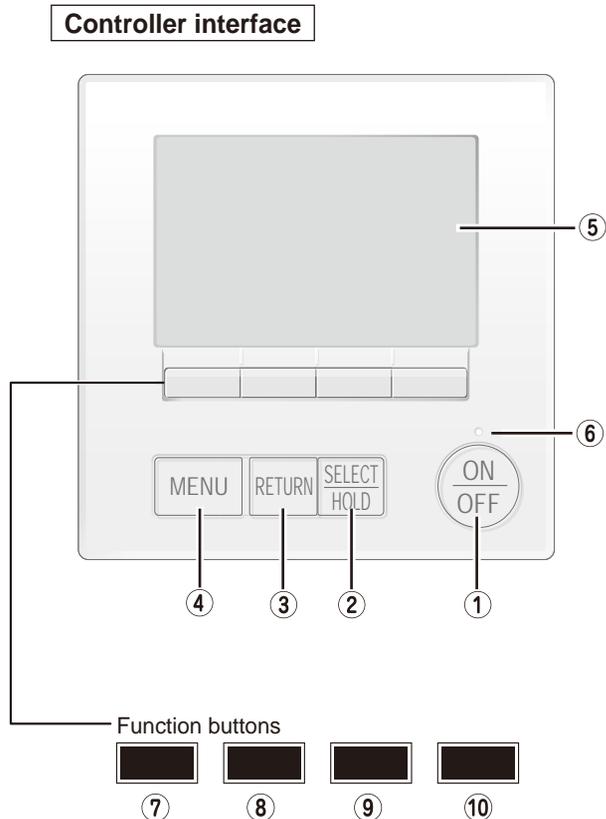

The functions of the function buttons change depending on the screen.

Refer to the button function guide that appears at the bottom of the LCD for the functions they serve on a given screen.

When the system is centrally controlled, the button function guide that corresponds to the locked button will not appear.

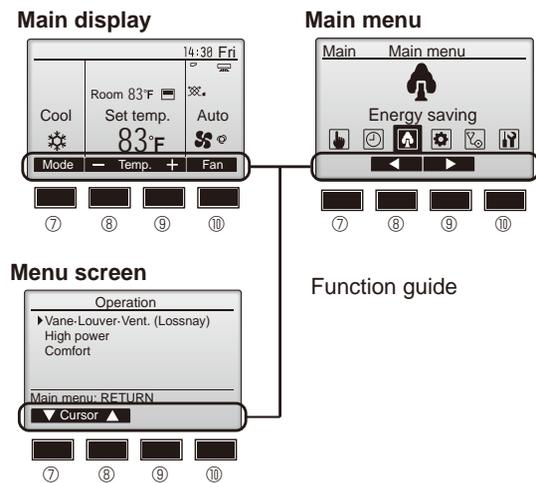**① [ON/OFF] button**

Press to turn ON/OFF the indoor unit.

② [SELECT/HOLD] button

Press to save the setting.
When the Main menu is displayed, pressing this button will enable/disable the HOLD function.

③ [RETURN] button

Press to return to the previous screen.

④ [MENU] button

Press to bring up the Main menu.

⑤ Backlit LCD

Operation settings will appear.
When the backlight is off, pressing any button turns the backlight on and it will stay lit for a certain period of time depending on the screen.

When the backlight is off, pressing any button turns the backlight on and does not perform its function. (except for the [ON/OFF] button)

⑥ ON/OFF lamp

This lamp lights up in green while the unit is in operation. It blinks while the remote controller is starting up or when there is an error.

⑦ Function button [F1]

Main display: Press to change the operation mode.
Menu screen: The button function varies with the screen.

⑧ Function button [F2]

Main display: Press to decrease temperature.
Main menu: Press to move the cursor left.
Menu screen: The button function varies with the screen.

⑨ Function button [F3]

Main display: Press to increase temperature.
Main menu: Press to move the cursor right.
Menu screen: The button function varies with the screen.

⑩ Function button [F4]


Main display: Press to change the fan speed.
Menu screen: The button function varies with the screen.

Display


The main display can be displayed in two different modes: "Full" and "Basic". The initial setting is "Full". To switch to the "Basic" mode, change the setting on the Main display setting. (Refer to operation manual included with remote controller.)

<Full mode>

All icons are displayed for explanation.

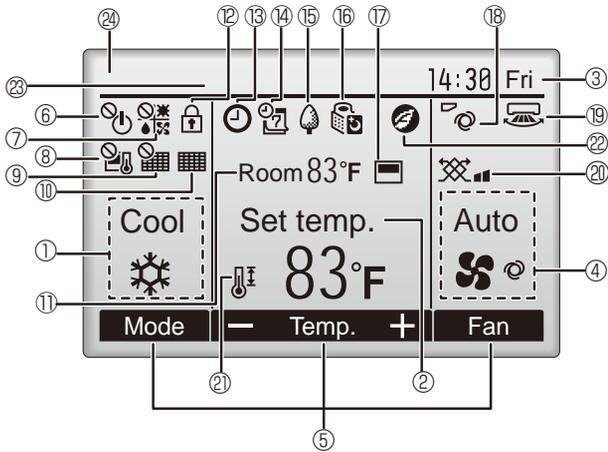

<Basic mode>

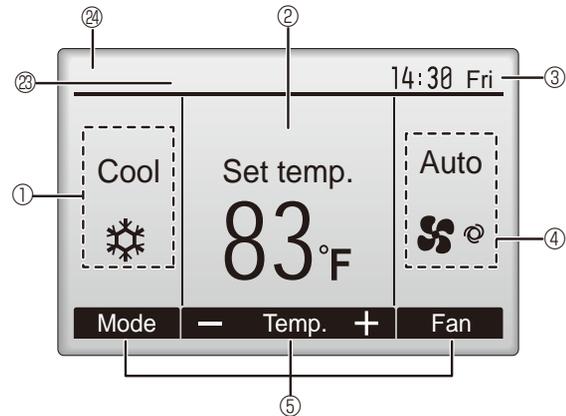

① Operation mode

② Preset temperature

③ Clock

④ Fan speed

⑤ Button function guide

Functions of the corresponding buttons appear here.



Appears when the ON/OFF operation is centrally controlled.



Appears when the operation mode is centrally controlled.



Appears when the preset temperature is centrally controlled.



Appears when the filter reset function is centrally controlled.



Indicates when filter needs maintenance.

⑪ Room temperature



Appears when the buttons are locked.



Appears when the On/Off timer or Auto-off timer function is enabled.

appears when the timer is disabled by the centralized control system.

appears when the HOLD function is enable.



Appears when the Weekly timer is enabled.



Appears while the units are operated in the energy saving mode. (Will not appear on some models of indoor units)



Appears while the outdoor units are operated in the silent mode.



Appears when the built-in thermistor on the remote controller is activated to monitor the room temperature (1).

appears when the thermistor on the indoor unit is activated to monitor the room temperature.



Indicates the vane setting.



Indicates the louver setting.



Indicates the ventilation setting.



Appears when the preset temperature range is restricted.



Appears when an energy saving operation is performed using a "3D i-See sensor" function.

⑳ Centrally controlled


Appears for a certain period of time when a centrally-controlled item is operated.

㉑ Preliminary error display

A check code appears during the preliminary error.


Most settings (except ON/OFF, mode, fan speed, temperature) can be made from the Main menu.

Menu structure

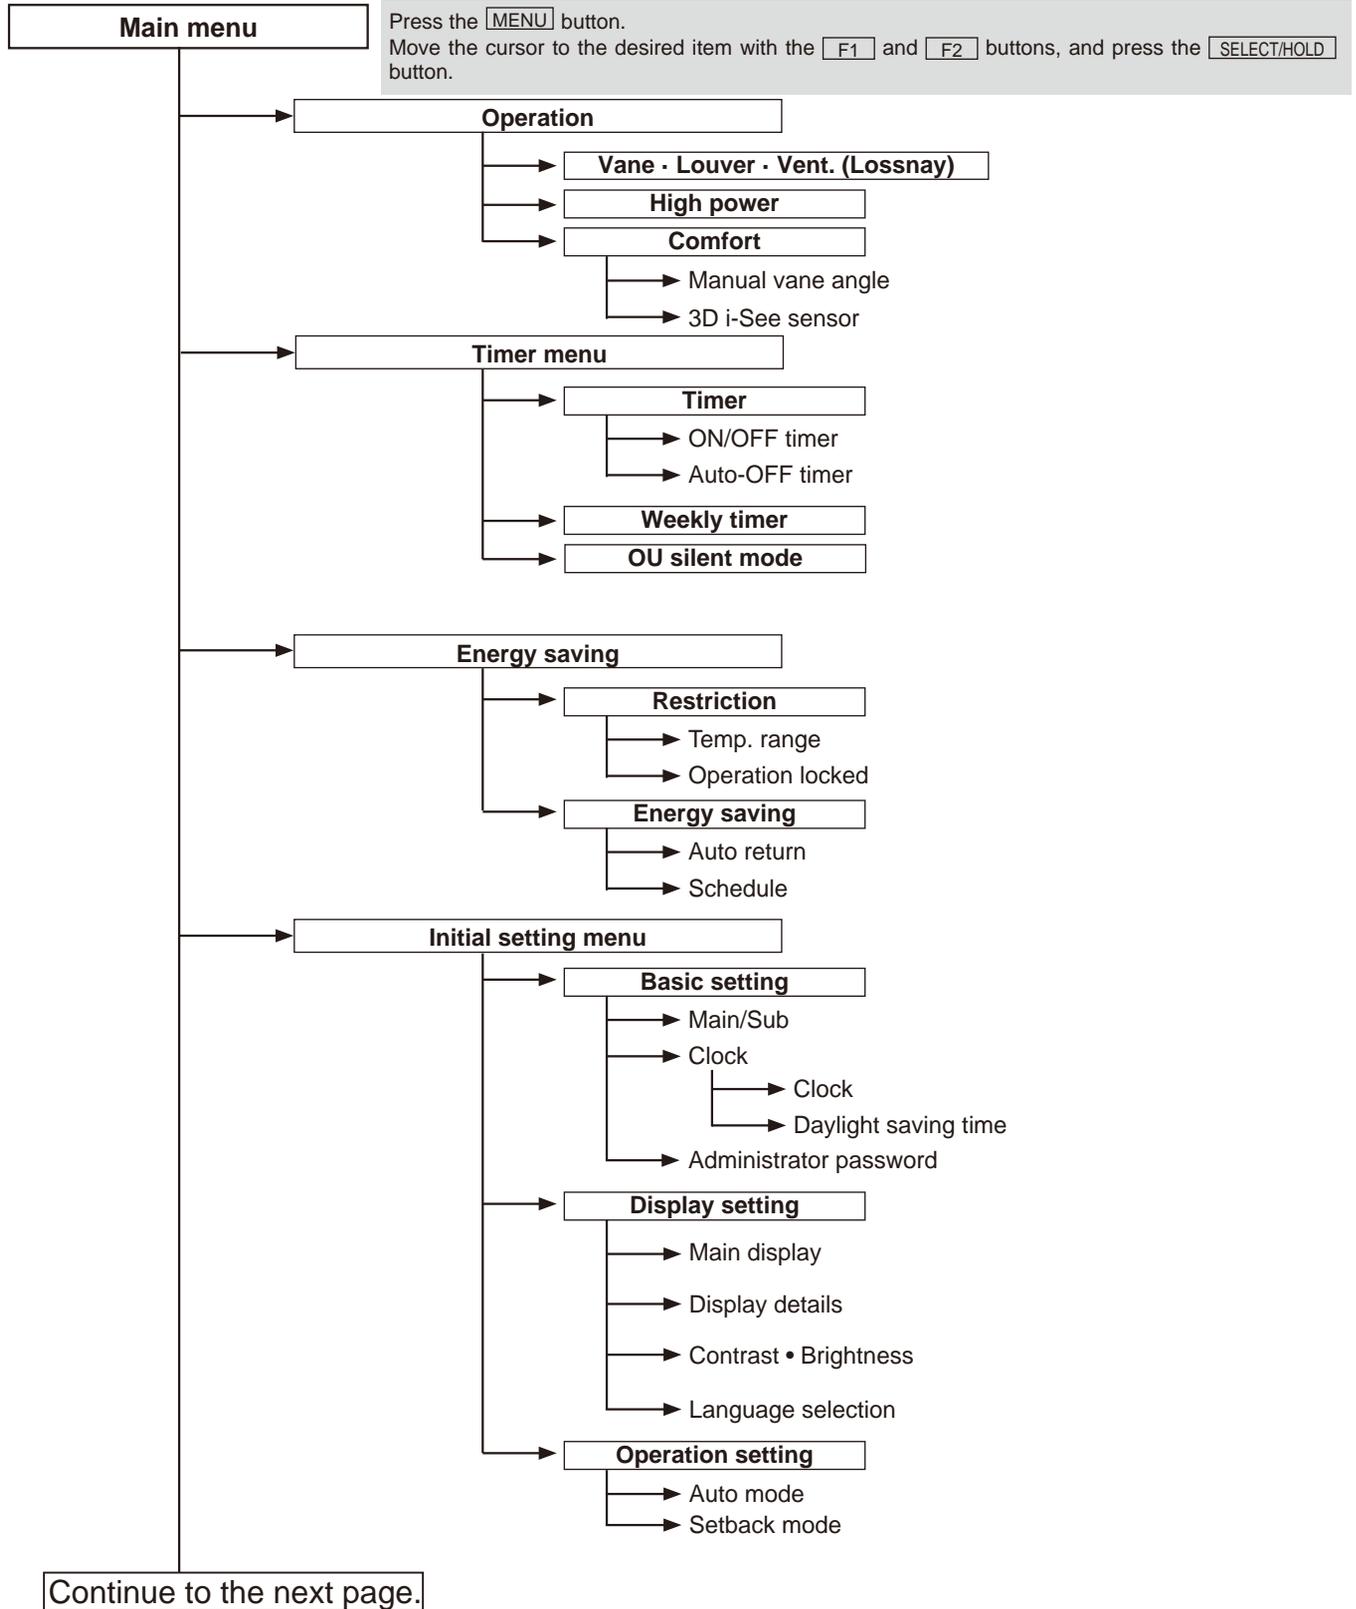

Not all functions are available on all models of indoor units.

Continue from the previous page.

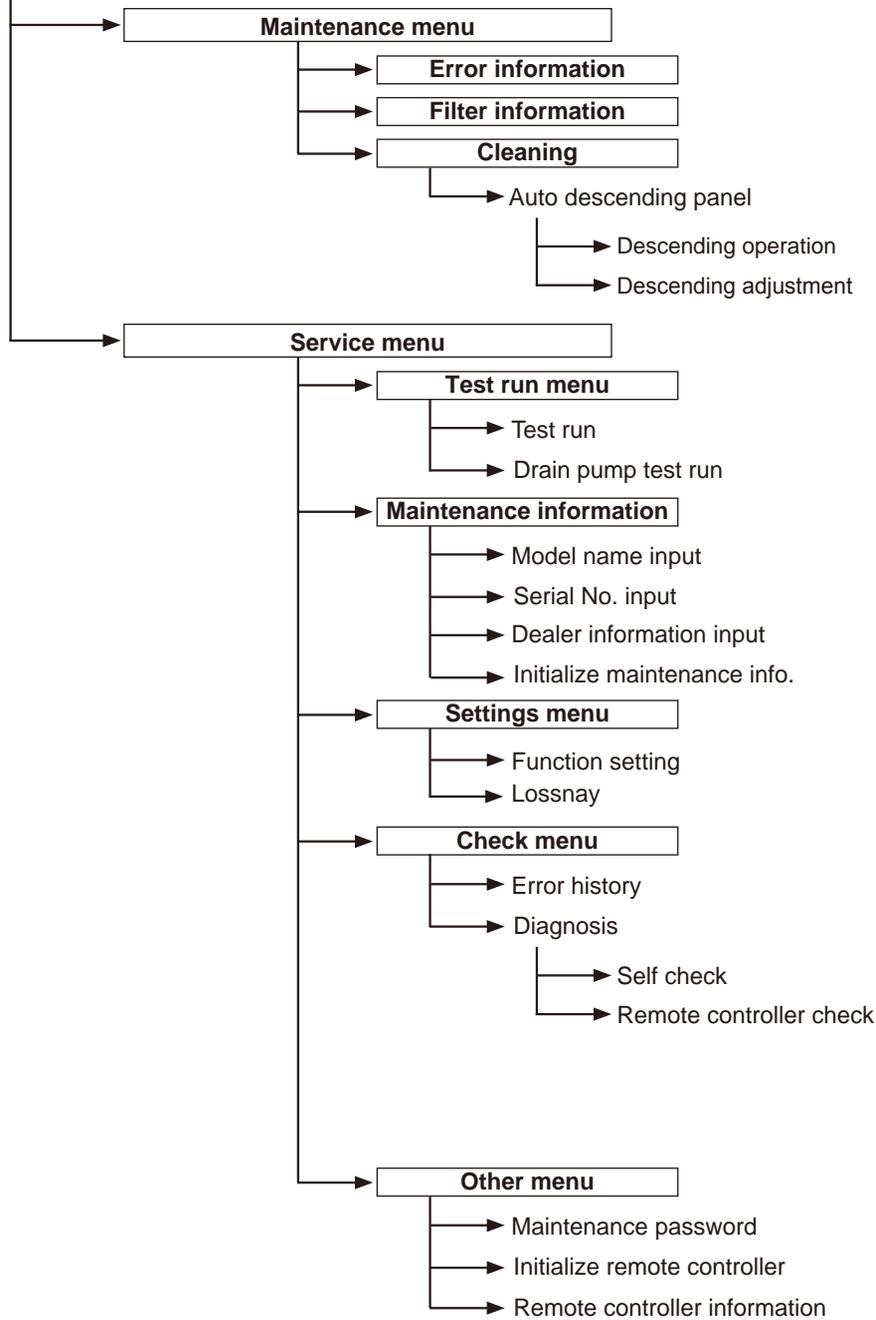

Not all functions are available on all models of indoor units.

Main menu list

Main menu	Setting and display items		Setting details
Operation	Vane · Louver · Vent. (Lossnay)		<p>Use to set the vane angle.</p> <ul style="list-style-type: none"> • Select a desired vane setting from 5 different settings. <p>Use to turn ON/OFF the louver.</p> <ul style="list-style-type: none"> • Select a desired setting from "ON" and "OFF." <p>Use to set the amount of ventilation.</p> <ul style="list-style-type: none"> • Select a desired setting from "Off," "Low," and "High."
	High power		<p>Use to reach the comfortable room temperature quickly.</p> <ul style="list-style-type: none"> • Units can be operated in the High-power mode for up to 30 minutes.
	Comfort	Manual vane angle	<p>Use to fix each vane angle.</p>
		3D i-see Sensor	<p>Use to set the following functions for 3D i-see Sensor.</p> <ul style="list-style-type: none"> • Air distribution • Energy saving option • Seasonal airflow
Timer	Timer	ON/OFF timer *1	<p>Use to set the operation ON/OFF times.</p> <ul style="list-style-type: none"> • Time can be set in 5-minute increments.
		Auto-Off timer	<p>Use to set the Auto-Off time.</p> <ul style="list-style-type: none"> • Time can be set to a value from 30 to 240 in 10-minute increments.
	Weekly timer *1, *2		<p>Use to set the weekly operation ON/OFF times.</p> <ul style="list-style-type: none"> • Up to 8 operation patterns can be set for each day. (Not valid when the ON/OFF timer is enabled.)
	OU silent mode *1		<p>Use to set the time periods in which priority is given to quiet operation of outdoor units over temperature control. Set the Start/Stop times for each day of the week.</p> <ul style="list-style-type: none"> • Select the desired silent level from "Normal," "Middle," and "Quiet."
Energy saving	Restriction	Temp. range *2	<p>Use to restrict the preset temperature range.</p> <ul style="list-style-type: none"> • Different temperature ranges can be set for different operation modes.
		Operation lock	<p>Use to lock selected functions.</p> <ul style="list-style-type: none"> • The locked functions cannot be operated.
	Energy saving	Auto return *2	<p>Use to get the units to operate at the preset temperature after performing energy saving operation for a specified time period.</p> <ul style="list-style-type: none"> • Time can be set to a value from 30 and 120 in 10-minute increments. (This function will not be valid when the preset temperature ranges are restricted.)
		Schedule *1	<p>Set the start/stop times to operate the units in the energy saving mode for each day of the week, and set the energy saving rate.</p> <ul style="list-style-type: none"> • Up to 4 energy saving operation patterns can be set for each day. • Time can be set in 5-minute increments. • Energy saving rate can be set to a value from 0% or 50 to 90% in 10% increments.

*1 Clock setting is required.


*2 33.8°F (1°C) increments.



Main menu	Setting and display items		Setting details
Initial setting	Basic setting	Main/Sub	When connecting 2 remote controllers, one of them needs to be designated as a sub controller.
		Clock	Use to set the current time.
		Daylight saving time	Set the daylight saving time.
		Administrator password	The administrator password is required to make the settings for the following items. • Timer setting • Energy saving setting • Weekly timer setting • Restriction setting • Outdoor unit silent mode setting • Night set back
	Display setting	Main display	Use to switch between "Full" and "Basic" modes for the Main display. • The initial setting is "Full."
		Display details	Make the settings for the remote controller related items as necessary. Clock: The initial settings are "Yes" and "24h" format. Temperature: Set either Celsius (°C) or Fahrenheit (°F). Room temp. : Set Show or Hide. Auto mode: Set the Auto mode display or Only Auto display.
		Contrast • Brightness	Use to adjust screen contrast and brightness.
		Language selection	Use to select the desired language.
Operation setting	Auto mode	Whether or not to use the Auto mode can be selected by using the button. This setting is valid only when indoor units with the Auto mode function are connected.	
	Setback mode	Whether or not to use the Setback mode can be selected by using the button. This setting is valid only when indoor units with the Setback mode function are connected.	
Maintenance	Error information		Use to check error information when an error occurs. • Check code, error source, refrigerant address, unit model, manufacturing number, contact information (dealer's phone number) can be displayed. (The unit model, manufacturing number, and contact information need to be registered in advance to be displayed.)
	Filter information		Use to check the filter status. • The filter sign can be reset.
	Cleaning	Auto descending panel	Use to lift and lower the auto descending panel (Optional parts).
Service	Test run		Select "Test run" from the Service menu to bring up the Test run menu. • Test run • Drain pump test run
	Input maintenance		Select "Input maintenance Info." from the Service menu to bring up the Maintenance information screen. The following settings can be made from the Maintenance Information screen. • Model name input • Serial No. input • Dealer information input • Initialize maintenance info.
	Settings	Function setting	Make the settings for the indoor unit functions via the remote controller as necessary.
		LOSSNAY setting	This setting is required only when the operation of CITY MULTI units is interlocked with LOSSNAY units.
	Check	Error history	Display the error history and execute "delete error history".
		Diagnosis	Self check: Error history of each unit can be checked via the remote controller. Remote controller check: When the remote controller does not work properly, use the remote controller checking function to troubleshoot the problem.
	Other	Maintenance password	Use to change the maintenance password.
		Initialize remote controller	Use to initialize the remote controller to the factory shipment status.
Remote controller information		Use to display the remote controller model name, software version, and serial number.	

<PAR-SL101A-E>


Controller interface

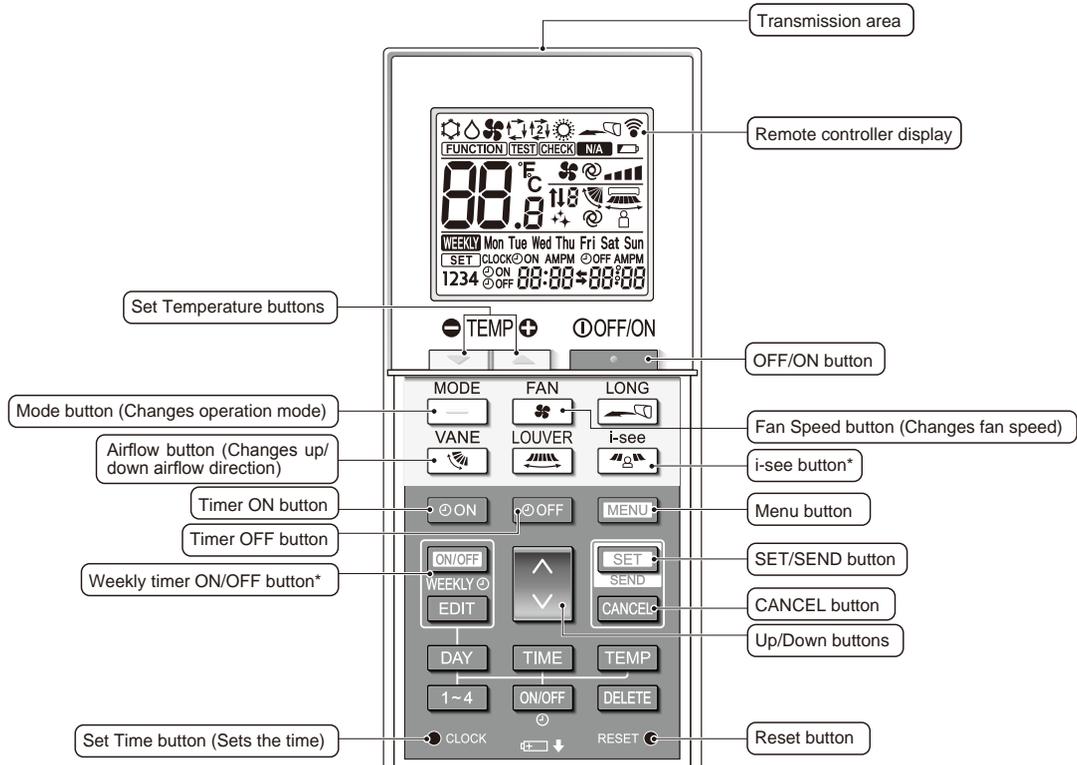

Note:

* This button is enabled or disabled depending on the model of the indoor unit.

Display

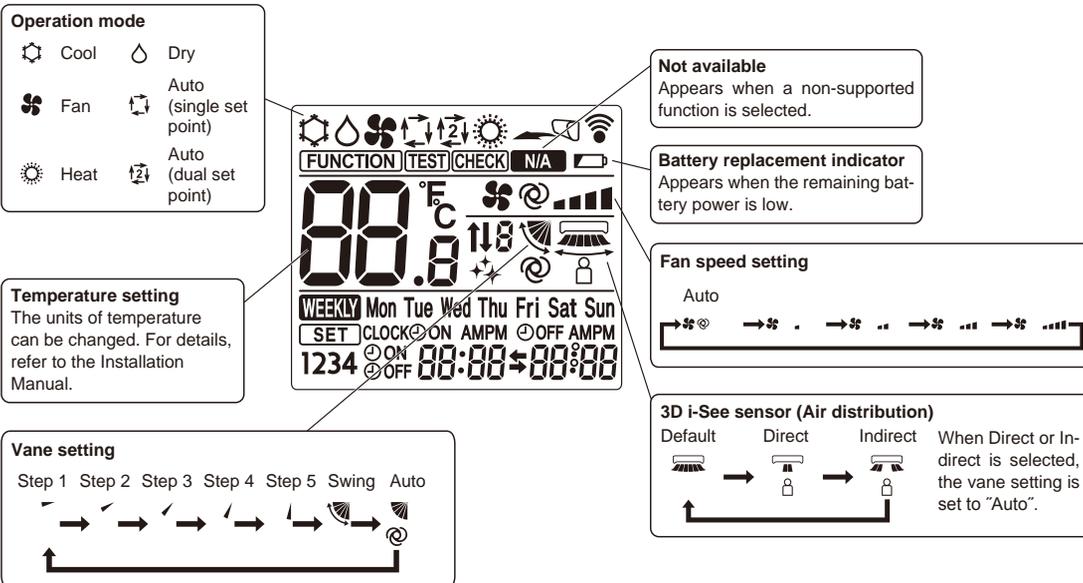


11-2. ERROR INFORMATION

When an error occurs, the following screen will appear.
Check the error status, stop the operation, and consult your dealer.

1. Check code, error unit, refrigerant address, model name, and serial number will appear.
The model name and serial number will appear only if the information has been registered.

Press the **[F1]** or **[F2]** button to go to the next page.

Error information 1/2
 Error code A3
 Error unit IU 8 Unit#1
 Time Occurred 02/01 4:48
 Model name
 Serial No.
 Reset error: Reset button
 ▼ Page ▲ Reset

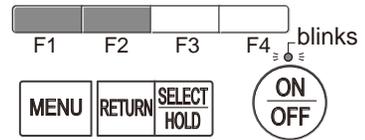


Contact information (dealer's phone number) will appear if the information has been registered.

Error information 2/2
 Contact information
 Dealer
 Tel
 Reset error: Reset button
 ▼ Page ▲ Reset

2. Press the **[F4]** button or the **[ON/OFF]** button to reset the error that is occurring.


Errors cannot be reset while the ON/OFF operation is prohibited.

Error information 1/2
 Error code A3
 Error unit IU 8 Unit#1
 Time Occurred 02/01 4:48
 Model name
 Serial No.
 Reset error: Reset button
 ▼ Page ▲ Reset

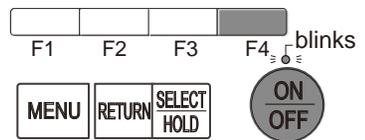

Select "OK" with the **[F4]** button.

Error reset
 Reset current error?
 Cancel OK




Error reset
 Error reset
 Main menu: MENU

Navigating through the screens

- To go back to the Service menu **[MENU]** button

• Checking the error information

While no errors are occurring, page 2/2 of the error information can be viewed by selecting "Error information" from the Maintenance menu. Errors cannot be reset from this screen.

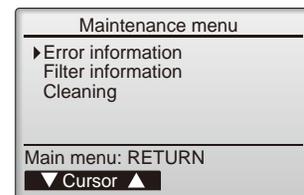


11-3. SERVICE MENU

Maintenance password is required

1. Select "Service" from the Main menu, and press the [SELECT/HOLD] button.

*At the main display, the menu button and select "Service" to make the maintenance setting.



2. When the Service menu is selected, a window will appear asking for the password.


To enter the current maintenance password (4 numerical digits), move the cursor to the digit you want to change with the [F1] or [F2] button.



Set each number (0 through 9) with the [F3] or [F4] button.



Then, press the [SELECT/HOLD] button.

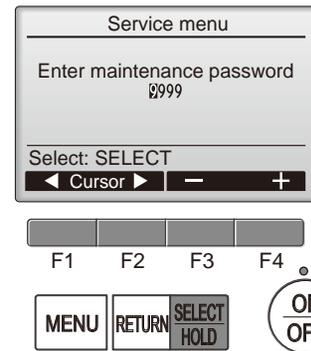


Note: The initial maintenance password is "9999". Change the default password as necessary to prevent unauthorized access. Have the password available for those who need it.

: If you forget your maintenance password, you can initialize the password to the default password "9999" by pressing and holding the [F1] button for 10 seconds on the maintenance password setting screen.

3. If the password matches, the Service menu will appear.

The type of menu that appears depends on the connected indoor units' type.

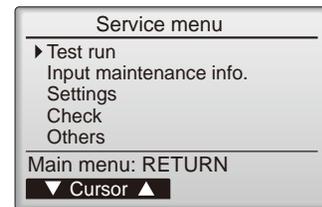

Note: Air conditioning units may need to be stopped to make only at "Settings". There may be some settings that cannot be made when the system is centrally controlled.



A screen will appear that indicates the setting has been saved.

Navigating through the screens

- To go back to the Service menu [MENU] button
- To return to the previous screen..... [RETURN] button


11-4. TEST RUN

11-4-1. PAR-41MAA


1. Select "Service" from the Main menu, and press the [SELECT/HOLD] button.



Select "Test run" with the [F1] or [F2] button, and press the [SELECT/HOLD] button.

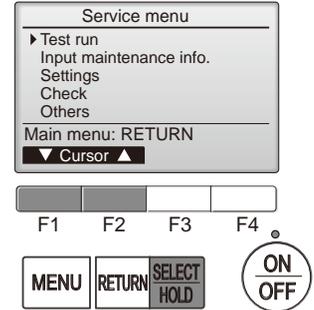

2. Select "Test run" with the [F1] or [F2] button, and press the [SELECT/HOLD] button.

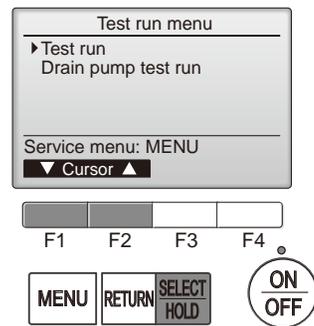

Test run operation


Press the [F1] button to go through the operation modes in the order of "Cool and Heat".

Cool mode: Check the cold air blows out.
Heat mode: Check the heat blows out.

Check the operation of the outdoor unit's fan.



Press the [SELECT/HOLD] button and open the Vane setting screen.

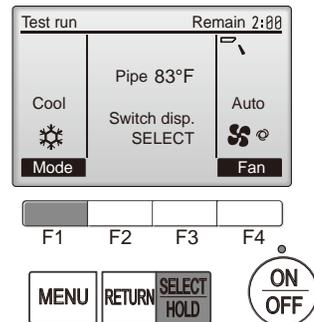

Auto vane check

Check the auto vane with the [F1] [F2] buttons.




Press the [RETURN] button to return to "Test run operation".



Press the [ON/OFF] button.


When the test run is completed, the "Test run menu" screen will appear.
The test run will automatically stop after 2 hours.

*The function is available only for the model with vanes.

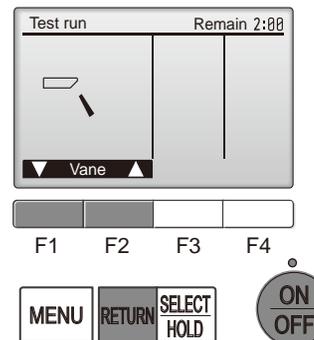

11-4-2. PAR-SL101A-E

1. Press the  button ① to stop the air conditioner.
 - If the weekly timer is enabled (**WEEKLY** is on), press the  button ③ to disable it (**WEEKLY** is off).
2. Press the  button ② for 5 seconds.
 - **CHECK** comes on and the unit enters the service mode.
3. Press the  button ②.
 - **TEST**  comes on and the unit enters the test run mode.
4. Press the following buttons to start the test run.
 - : Switch the operation mode between cooling and heating and start the test run.
 - : Switch the fan speed and start the test run.
 - : Switch the airflow direction and start the test run.
 - : Switch the louver and start the test run.
 - : Start the test run.
5. Stop the test run.
 - Press the  button ① to stop the test run.
 - After 2 hours, the stop signal is transmitted.

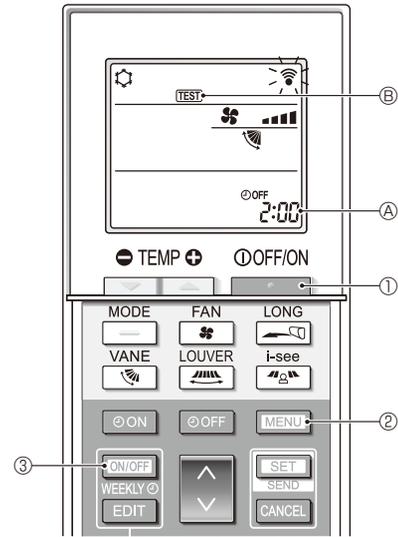



11-5. FUNCTION SETTING

11-5-1. PAR-41MAA

1. Select "Service" from the Main menu, and press the [SELECT/HOLD] button.

Select "Setting" from the Service menu, and press the [SELECT/HOLD] button.

Select "Function setting", and press the [SELECT/HOLD] button.



2. The Function setting screen will appear.

Press the [F1] or [F2] button to move the cursor to one of the following: M-NET address, function setting number, or setting value. Then, press the [F3] or [F4] button to change the settings to the desired settings.

Once the settings have been completed, press the [SELECT/HOLD] button.

A screen will appear indicating that the settings information is being sent.




To check the current settings of a given unit, enter the setting for its M-NET address and function setting number, select Conf for the Function, and press the [SELECT/HOLD] button.

A screen will appear indicating that the settings are being searched for.

When the search is done, the current settings will appear.

When the settings information has been sent, a screen will appear indicating its completion.

To make additional settings, press the [RETURN] button to return to the screen shown in the above step. Set the function numbers for other indoor units by following the same steps.



Note:

- Refer to the indoor unit Installation Manual for information about the factory settings of indoor units, function setting numbers, and setting values.
- Be sure to write down the settings for all functions if any of the initial settings has been changed after the completion of installation work.

11-5-2. PAR-SL101A-E




Fig. 1

1. Going to the function select mode
Press the **MENU** button between of 5 seconds.
(Start this operation from the status of remote controller display turned off.)
[CHECK] is lit and "00" blinks. (Fig. 1)
Press the **↓** button to set the "50".
Direct the wireless remote controller toward the receiver of the indoor unit and press the **SET** button.

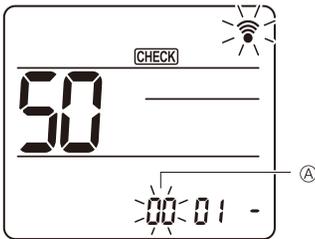


Fig. 2

2. Setting the unit number
Press the **↓** button to set unit number **A**. (Fig. 2)
Direct the wireless remote controller toward the receiver of the indoor unit and press the **SET** button.

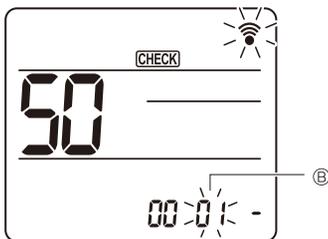


Fig. 3

3. Select a mode
Press the **↓** button to set Mode number **B**. (Fig. 3)
Direct the wireless remote controller toward the receiver of the indoor unit and press the **SET** button.
Current setting number:
1=1 beep (1 second)
2=2 beep (1 second each)
3=3 beep (1 second each)

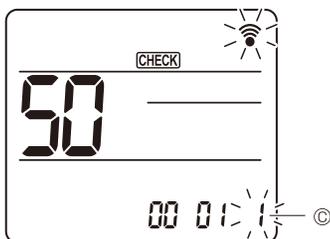


Fig. 4

4. Selecting the setting number
Use the **↓** button to change the Setting number **C**. (Fig. 4)
Direct the wireless remote controller toward the receiver of the indoor unit and press the **SET** button.
5. To select multiple functions continuously
Repeat select ③ and ④ to change multiple function settings continuously.
6. Complete function selection
Direct the wireless remote controller toward the sensor of the indoor unit and press the **OFF/ON** button.


Note: Be sure to write down the settings for all functions if any of the initial settings has been changed after the completion of installation work.

11-6. ERROR HISTORY


1. Select "Service" from the Main menu, and press the [SELECT/HOLD] button.



Select "Check" with the [F1] or [F2] button, and press the [SELECT/HOLD] button.




2. Select "Error history" with the [F1] or [F2] button, and press the [SELECT/HOLD] button.



3. 16 error history records will appear.

4 records are shown per page, and the top record on the first page indicates the latest error record.



4. Deleting the error history

To delete the error history, press the [F4] button (Delete) on the screen that shows error history. A confirmation screen will appear asking if you want to delete the error history.



Press the [F4] button (OK) to delete the history.



"Error history deleted" will appear on the screen.

Press the [RETURN] button to go back to the Check menu screen.



11-7. SELF-DIAGNOSIS



11-7-1. PAR-41MAA

1. Select "Service" from the Main menu, and press the [SELECT/HOLD] button.

Select "Check" from the Service menu, and press the [SELECT/HOLD] button.

Select "Diagnosis" from the Check menu, and press the [SELECT/HOLD] button.



Select "Self check" with the [F1] or [F2] button, and press the [SELECT/HOLD] button.



2. Select "Self check" from the Diagnosis menu, and press the [SELECT/HOLD] button to view the Self check screen.

With the [F1] or [F2] button, enter the M-NET address, and press the [SELECT/HOLD] button.

Check code, unit number, attribute, and indoor unit demand signal ON/OFF status at the contact will appear. "-" will appear if no error history is available.

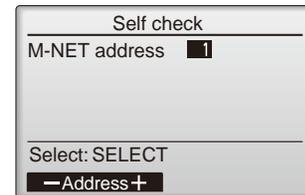


When there is no error history




3. Resetting the error history


Press the [F4] button (Reset) on the screen that shows the error history. A confirmation screen will appear asking if you want to delete the error history.

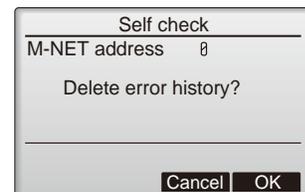

Press the [F4] button (OK) to delete the error history. If deletion fails, "Request rejected" will appear, and "Unit not exist" will appear if indoor units that correspond to the entered address are not found.

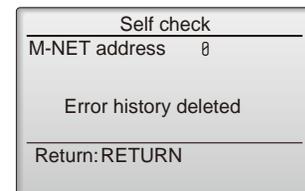

11-7-2. PAR-SL101A-E

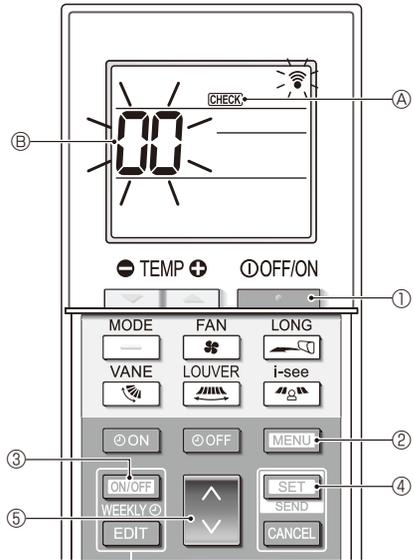

1. Press the **OFF/ON** button ① to stop the air conditioner.
 - If the weekly timer is enabled (**WEEKLY** is on), press the **ON/OFF WEEKLY** button ③ to disable it (**WEEKLY** is off).
2. Press the **MENU** button ② for 5 seconds.
 - **CHECK** ① comes on and the unit enters the self-check mode.
3. Press the **ON/OFF WEEKLY** button ③ to select the refrigerant address (M-NET address) ② of the indoor unit for which you want to perform the self-check.
4. Press the **SET** button ④.
 - If an error is detected, the check code is indicated by the number of beeps from the indoor unit and the number of blinks of the OPERATION INDICATOR lamp.
5. Press the **ON/OFF WEEKLY** button ③.
 - **CHECK** ① and the refrigerant address (M-NET address) ② go off and the self-check is completed.

11-8. REMOTE CONTROLLER CHECK


If operations cannot be completed with the remote controller, diagnose the remote controller with this function.

1. Select "Service" from the Main menu, and press the [SELECT/HOLD] button.

Select "Check" from the Service menu, and press the [SELECT/HOLD] button.

Select "Diagnosis" from the Check menu, and press the [SELECT/HOLD] button.



Select "Remote controller check" with the [F1] or [F2] button, and press the [SELECT/HOLD] button.

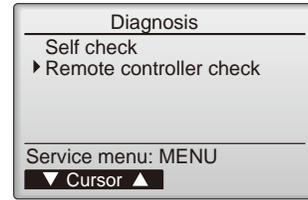

2. Select "Remote controller check" from the Diagnosis menu, and press the [SELECT/HOLD] button to start the remote controller check and see the check results.


To cancel the remote controller check and exit the "Remote controller check" menu screen, press the [MENU] or the [RETURN] button.

The remote controller will not reboot itself.



3.
 - OK: No problems are found with the remote controller. Check other parts for problems.
 - E3, 6832: There is noise on the transmission line, or the indoor unit or another remote controller is faulty. Check the transmission line and the other remote controllers.
 - NG (ALLO, ALL1): Send-receive circuit fault. The remote controller needs replacing.
 - ERC: The number of data errors is the discrepancy between the number of bits in the data transmitted from the remote controller and that of the data that was actually transmitted over the transmission line. If data errors are found, check the transmission line for external noise interference.

Remote controller check results screen

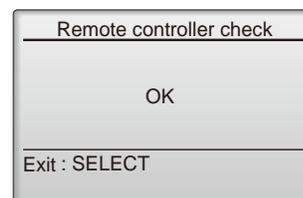

If the [SELECT/HOLD] button is pressed after the remote controller check results are displayed, remote controller check will end, and the remote controller will automatically reboot itself.

Check the remote controller display and see if anything is displayed (including lines). Nothing will appear on the remote controller display if the correct voltage (8.5–12 VDC) is not supplied to the remote controller. If this is the case, check the remote controller wiring and indoor units.

CITY MULTI

MITSUBISHI ELECTRIC CORPORATION

HEAD OFFICE: TOKYO BUILDING, 2-7-3, MARUNOUCHI, CHIYODA-KU TOKYO 100-8310, JAPAN

MITSUBISHI ELECTRIC CONSUMER PRODUCTS (THAILAND) CO., LTD.
700/406 MOO 7, TAMBON DON HUA ROH,
AMPHUR MUANG, CHONBURI 20000 THAILAND
Published: Jul. 2023. No. TCH122
Made in Thailand

Specifications are subject to change without notice.