

HEAT SOURCE UNITS

1. SPECIFICATIONS	2 - 778
2. EXTERNAL DIMENSIONS	2 - 812
3. CENTER OF GRAVITY	2 - 822
4. ELECTRICAL WIRING DIAGRAMS	2 - 823
5. REFRIGERANT CIRCUIT DIAGRAMS	2 - 827
6. SOUND LEVELS	2 - 830
7. OPERATION TEMPERATURE RANGE.....	2 - 834
8. CAPACITY TABLES	2 - 835
8-1. Correction by temperature	2 - 835
8-2. Correction by total indoor.....	2 - 869
8-3. Correction by refrigerant piping length.....	2 - 875
9. SYSTEM DESIGN GUIDE	2 - 878
9-1. Designing of water circuit system	2 - 878
9-2. Water piping work	2 - 890
10. OPTIONAL PARTS.....	2 - 894
10-1.JOINT	2 - 894
10-2.HEADER.....	2 - 895
10-3.OUTDOOR TWINNING KIT	2 - 896

1. SPECIFICATIONS

U11 2nd

Heat Source Model			PQHY-P72TLMU-A			
Indoor Model			Non-Ducted	Ducted		
Power source			3-phase 3-wire 208-230 V ±10% 60 Hz			
Cooling capacity (Nominal)		*1	BTU/h	72,000		
			kW	21.1		
		(208-230)	Power input	kW	3.23	
			Current input	A	9.9-9.0	
(Rated)			BTU/h	69,000		
			kW	20.2		
		(208-230)	Power input	kW	2.96	3.12
			Current input	A	9.1-8.2	9.6-8.7
Temp. range of cooling		Indoor	W.B.	59~75°F (15~24°C)		
		Circulating water	°F	50~113°F (10~45°C)		
Heating capacity (Nominal)		*2	BTU/h	80,000		
			kW	23.4		
		(208-230)	Power input	kW	3.63	
			Current input	A	11.1-10.1	
(Rated)			BTU/h	76,000		
			kW	22.3		
		(208-230)	Power input	kW	3.34	3.36
			Current input	A	10.3-9.3	10.3-9.3
Temp. range of heating		Indoor	D.B.	59~81°F (15~27°C)		
		Circulating water	°F	50~113°F (10~45°C)		
Indoor unit connectable		Total capacity		50~130% of heatsource unit capacity		
		Model/Quantity		P06~P96/1~15		
Sound pressure level (measured in anechoic room)			dB <A>	46.0		
Refrigerant piping diameter		Liquid pipe	in. (mm)	3/8 (9.52) Brazed		
		Gas pipe	in. (mm)	3/4 (19.05) Brazed		
Minimum Circuit Ampacity			A	13-12		
Maximum Overcurrent Protection			A	20-20		
Circulating water	Water flow rate	G/h	1,522			
		G/min	25.4			
		m³/h	5.76			
		L/min	96			
		cfm	3.4			
	Pressure drop	psi	3.48			
		kPa	24			
	Operating volume range	G/h	793 ~ 1,902			
		G/min	13.2 ~ 31.7			
		m³/h	3.0 ~ 7.2			
Compressor	Type x Quantity		Inverter scroll hermetic compressor x 1			
	Manufacture		AC&R Works, MITSUBISHI ELECTRIC CORPORATION			
	Starting method		Inverter			
	Motor output	kW	4.3			
	Case heater	kW	-			
	Lubricant		MEL32			
External finish			Galvanized steel sheets			
External dimension H x W x D		in.	43-5/16 x 34-11/16 x 21-11/16			
		mm	1,100 x 880 x 550			
Protection devices	High pressure protection		High pressure sensor, High pressure switch at 4.15 MPa (601 psi)			
	Inverter circuit		Over-heat protection, Over-current protection			
	Compressor		Over-heat protection			
Refrigerant	Type x original charge		R410A x 11 lbs + 1 oz (5.0 kg)			
	Control		LEV and HIC circuit			
Net weight		lbs (kg)	384 (174)			
Heat exchanger			plate type			
			Water volume in plate	G	1.32	
				l	5.0	
			Water pressure Max.	psi	290	
MPa	2.0					
HIC circuit (HIC: Heat Inter-Changer)			Copper pipe, tube-in-tube structure			
Drawing	External		KJ94T131			
	Wiring		KE94C966			
Standard attachment	Document		Installation Manual			
	Accessory		Details refer to External Drw			
Optional parts			joint: CMY-Y102SS-G2, CMY-Y102LS-G2 Header: CMY-Y104/108/1010C-G			
Remarks			Details on foundation work, duct work, insulation work, electrical wiring, power source switch, and other items shall be referred to the Installation Manual. Due to continuing improvement, above specifications may be subject to change without notice. The ambient temperature of the Heat Source Unit needs to be kept below 104°F.D.B. (40°C.D.B.) The ambient relative humidity of the Heat Source Unit needs to be kept below 80%. The Heat Source Unit should not be installed at outdoor. Be sure to mount a strainer (more than 50 meshes) at the water inlet piping of the unit. Be sure to provide interlocking for the unit operation and water circuit. Install the supplied insulation material to the unused drain-socket. When installing insulation material around both water and refrigerant piping, follow the installation manual.			

Notes:		Unit converter
1.Nominal cooling conditions (Test conditions are based on AHRI 1230) Indoor: 81°F.D.B./66°F.W.B. (27°C.D.B./19°C.W.B.), Water temperature: 86°F (30°C)		BTU/h =kW x 3.412
2.Nominal heating conditions (Test conditions are based on AHRI 1230) Indoor: 68°F.D.B. (20°C.D.B.), Water temperature: 68°F (20°C)		cfm =m³/min x 35.31
		lbs =kg/0.4536
		*Above specification data is subject to rounding variation.

1. SPECIFICATIONS

U11 2nd

Heat Source Model			PQHY-P96TLMU-A		
Indoor Model			Non-Ducted		Ducted
Power source			3-phase 3-wire 208-230 V ±10% 60 Hz		
Cooling capacity (Nominal)		*1	BTU/h	96,000	
			kW	28.1	
(208-230)	Power input		kW	4.65	
	Current input		A	14.3-12.9	
(Rated)			BTU/h	92,000	
			kW	27.0	
(208-230)	Power input		kW	4.26	5.19
	Current input		A	13.1-11.8	16.0-14.4
Temp. range of cooling		Indoor	W.B.	59~75°F (15~24°C)	
		Circulating water	°F	50~113°F (10~45°C)	
Heating capacity (Nominal)		*2	BTU/h	108,000	
			kW	31.7	
(208-230)	Power input		kW	5.05	
	Current input		A	15.5-14.0	
(Rated)			BTU/h	103,000	
			kW	30.2	
(208-230)	Power input		kW	4.65	4.48
	Current input		A	14.3-12.9	13.8-12.4
Temp. range of heating		Indoor	D.B.	59~81°F (15~27°C)	
		Circulating water	°F	50~113°F (10~45°C)	
Indoor unit connectable		Total capacity	50~130% of heatsource unit capacity		
		Model/Quantity	P06~P96/1~20		
Sound pressure level (measured in anechoic room)			dB <A>	48.0	
Refrigerant piping diameter		Liquid pipe	in. (mm)	3/8 (9.52) Brazed (1/2 (12.7) Brazed, total length >= 90 m)	
		Gas pipe	in. (mm)	7/8 (22.2) Brazed	
Minimum Circuit Ampacity			A	19-17	
Maximum Overcurrent Protection			A	30-25	
Circulating water		Water flow rate	G/h	1,522	
			G/min	25.4	
			m³/h	5.76	
			L/min	96	
			cfm	3.4	
		Pressure drop	psi	3.48	
			kPa	24	
		Operating volume range	G/h	793 ~ 1,902	
			G/min	13.2 ~ 31.7	
			m³/h	3.0 ~ 7.2	
Compressor		Type x Quantity		Inverter scroll hermetic compressor x 1	
		Manufacture		AC&R Works, MITSUBISHI ELECTRIC CORPORATION	
		Starting method		Inverter	
		Motor output	kW	6.0	
		Case heater	kW	-	
		Lubricant		MEL32	
External finish			Galvanized steel sheets		
External dimension H x W x D		in.	43-5/16 x 34-11/16 x 21-11/16		
		mm	1,100 x 880 x 550		
Protection devices		High pressure protection		High pressure sensor, High pressure switch at 4.15 MPa (601 psi)	
		Inverter circuit		Over-heat protection, Over-current protection	
		Compressor		Over-heat protection	
Refrigerant		Type x original charge		R410A x 11 lbs + 1 oz (5.0 kg)	
		Control		LEV and HIC circuit	
Net weight		lbs (kg)	384 (174)		
Heat exchanger			plate type		
			Water volume in plate	G	1.32
				l	5.0
			Water pressure Max.	psi	290
MPa	2.0				
HIC circuit (HIC: Heat Inter-Changer)			Copper pipe, tube-in-tube structure		
Drawing		External		KJ94T131	
		Wiring		KE94C966	
Standard attachment		Document		Installation Manual	
		Accessory		Details refer to External Drw	
Optional parts			joint: CMY-Y102SS-G2, CMY-Y102LS-G2 Header: CMY-Y104/108/1010C-G		
Remarks			Details on foundation work, duct work, insulation work, electrical wiring, power source switch, and other items shall be referred to the Installation Manual. Due to continuing improvement, above specifications may be subject to change without notice. The ambient temperature of the Heat Source Unit needs to be kept below 104°F.D.B. (40°C.D.B.) The ambient relative humidity of the Heat Source Unit needs to be kept below 80%. The Heat Source Unit should not be installed at outdoor. Be sure to mount a strainer (more than 50 meshes) at the water inlet piping of the unit. Be sure to provide interlocking for the unit operation and water circuit. Install the supplied insulation material to the unused drain-socket. When installing insulation material around both water and refrigerant piping, follow the installation manual.		

Notes:		Unit converter
1.Nominal cooling conditions (Test conditions are based on AHRI 1230) Indoor: 81°F.D.B./66°F.W.B. (27°C.D.B./19°C.W.B.), Water temperature: 86°F (30°C)		BTU/h =kW x 3.412
2.Nominal heating conditions (Test conditions are based on AHRI 1230) Indoor: 68°F.D.B. (20°C.D.B.), Water temperature: 68°F (20°C)		cfm =m³/min x 35.31
		lbs =kg/0.4536
		*Above specification data is subject to rounding variation.

1. SPECIFICATIONS

U11 2nd

Heat Source Model			PQHY-P120TLMU-A	
Indoor Model			Non-Ducted	Ducted
Power source			3-phase 3-wire 208-230 V ±10% 60 Hz	
Cooling capacity (Nominal)		*1	BTU/h	120,000
			kW	35.2
(208-230)	Power input		kW	7.24
	Current input		A	22.3-20.1
(Rated)			BTU/h	114,000
			kW	33.4
(208-230)	Power input		kW	6.66
	Current input		A	20.5-18.5
Temp. range of cooling		Indoor	W.B.	59~75°F (15~24°C)
		Circulating water	°F	50~113°F (10~45°C)
Heating capacity (Nominal)		*2	BTU/h	135,000
			kW	39.6
(208-230)	Power input		kW	6.83
	Current input		A	21.0-19.0
(Rated)			BTU/h	129,000
			kW	37.8
(208-230)	Power input		kW	6.29
	Current input		A	19.3-17.5
Temp. range of heating		Indoor	D.B.	59~81°F (15~27°C)
		Circulating water	°F	50~113°F (10~45°C)
Indoor unit connectable		Total capacity		
		Model/Quantity		
Sound pressure level (measured in anechoic room)		dB <A>	54.0	
Refrigerant piping diameter		Liquid pipe	in. (mm)	3/8 (9.52) Brazed (1/2 (12.7) Brazed, total length >= 40 m)
		Gas pipe	in. (mm)	7/8 (22.2) Brazed
Minimum Circuit Ampacity		A	29-26	
Maximum Overcurrent Protection		A	50-45	
Circulating water	Water flow rate	G/h	1,522	
		G/min	25.4	
		m³/h	5.76	
		L/min	96	
		cfm	3.4	
	Pressure drop	psi	3.48	
		kPa	24	
	Operating volume range	G/h	793 ~ 1,902	
		G/min	13.2 ~ 31.7	
		m³/h	3.0 ~ 7.2	
Compressor		Type x Quantity		
		Manufacture		
		Starting method		
		Motor output	kW	7.7
		Case heater	kW	-
		Lubricant	MEL32	
External finish		Galvanized steel sheets		
External dimension H x W x D		in.	43-5/16 x 34-11/16 x 21-11/16	
		mm	1,100 x 880 x 550	
Protection devices	High pressure protection		High pressure sensor, High pressure switch at 4.15 MPa (601 psi)	
	Inverter circuit		Over-heat protection, Over-current protection	
	Compressor		Over-heat protection	
Refrigerant	Type x original charge		R410A x 11 lbs + 1 oz (5.0 kg)	
	Control		LEV and HIC circuit	
Net weight		lbs (kg)	384 (174)	
Heat exchanger		plate type		
		Water volume in plate	G	1.32
			l	5.0
		Water pressure Max.	psi	290
MPa	2.0			
HIC circuit (HIC: Heat Inter-Changer)		Copper pipe, tube-in-tube structure		
Drawing	External		KJ94T131	
	Wiring		KE94C966	
Standard attachment	Document		Installation Manual	
	Accessory		Details refer to External Drw	
Optional parts		joint: CMY-Y102SS-G2, CMY-Y102LS-G2, CMY-Y202S-G2 Header: CMY-Y104/108/1010C-G		
Remarks		Details on foundation work, duct work, insulation work, electrical wiring, power source switch, and other items shall be referred to the Installation Manual. Due to continuing improvement, above specifications may be subject to change without notice. The ambient temperature of the Heat Source Unit needs to be kept below 104°F.D.B. (40°C.D.B.) The ambient relative humidity of the Heat Source Unit needs to be kept below 80%. The Heat Source Unit should not be installed at outdoor. Be sure to mount a strainer (more than 50 meshes) at the water inlet piping of the unit. Be sure to provide interlocking for the unit operation and water circuit. Install the supplied insulation material to the unused drain-socket. When installing insulation material around both water and refrigerant piping, follow the installation manual.		

Notes:		Unit converter
1.Nominal cooling conditions (Test conditions are based on AHRI 1230) Indoor: 81°F.D.B./66°F.W.B. (27°C.D.B./19°C.W.B.), Water temperature: 86°F (30°C)		BTU/h =kW x 3,412
2.Nominal heating conditions (Test conditions are based on AHRI 1230) Indoor: 68°F.D.B. (20°C.D.B.), Water temperature: 68°F (20°C)		cfm =m³/min x 35.31
		lbs =kg/0.4536
		*Above specification data is subject to rounding variation.

1. SPECIFICATIONS

U11 2nd

Heat Source Model			PQHY-P144TLMU-A		
Indoor Model			Non-Ducted		Ducted
Power source			3-phase 3-wire 208-230 V ±10% 60 Hz		
Cooling capacity (Nominal)		*1	BTU/h	144,000	
			kW	42.2	
(208-230)	Power input		kW	8.78	
	Current input		A	27.0-24.4	
(Rated)			BTU/h	137,000	
			kW	40.2	
(208-230)	Power input		kW	8.07	9.98
	Current input		A	24.8-22.5	30.7-27.8
Temp. range of cooling		Indoor	W.B.	59~75°F (15~24°C)	
		Circulating water	°F	50~113°F (10~45°C)	
Heating capacity (Nominal)		*2	BTU/h	160,000	
			kW	46.9	
(208-230)	Power input		kW	8.11	
	Current input		A	25.0-22.6	
(Rated)			BTU/h	152,000	
			kW	44.5	
(208-230)	Power input		kW	7.47	7.90
	Current input		A	23.0-20.8	24.3-22.0
Temp. range of heating		Indoor	D.B.	59~81°F (15~27°C)	
		Circulating water	°F	50~113°F (10~45°C)	
Indoor unit connectable		Total capacity	50~130% of heatsource unit capacity		
		Model/Quantity	P06~P96/1~31		
Sound pressure level (measured in anechoic room)			dB <A>	54.0	
Refrigerant piping diameter		Liquid pipe	in. (mm)	1/2 (12.7) Brazed	
		Gas pipe	in. (mm)	1-1/8 (28.58) Brazed	
Minimum Circuit Ampacity			A	35-32	
Maximum Overcurrent Protection			A	60-50	
Circulating water	Water flow rate	G/h	1,902		
		G/min	31.7		
		m³/h	7.20		
		L/min	120		
		cfm	4.2		
		psi	6.38		
	Pressure drop	kPa	44		
		Operating volume range	G/h	1,189 ~ 3,054	
	G/min		19.8 ~ 50.9		
	m³/h		4.5 ~ 11.6		
Compressor	Type x Quantity		Inverter scroll hermetic compressor x 1		
	Manufacture		AC&R Works, MITSUBISHI ELECTRIC CORPORATION		
	Starting method		Inverter		
	Motor output	kW	9.5		
	Case heater	kW	-		
	Lubricant		MEL32		
External finish			Galvanized steel sheets		
External dimension H x W x D		in.	57-1/8 x 34-11/16 x 21-11/16		
		mm	1,450 x 880 x 550		
Protection devices	High pressure protection		High pressure sensor, High pressure switch at 4.15 MPa (601 psi)		
	Inverter circuit		Over-heat protection, Over-current protection		
	Compressor		Over-heat protection		
Refrigerant	Type x original charge		R410A x 13 lbs + 4 oz (6.0 kg)		
	Control		LEV and HIC circuit		
Net weight		lbs (kg)	481 (218)		
Heat exchanger			plate type		
			Water volume in plate	G	1.32
				l	5.0
			Water pressure Max.	psi	290
MPa	2.0				
HIC circuit (HIC: Heat Inter-Changer)			Copper pipe, tube-in-tube structure		
Drawing	External		KJ94T132		
	Wiring		KE94C968		
Standard attachment	Document		Installation Manual		
	Accessory		Details refer to External Drw		
Optional parts			joint: CMY-Y102SS-G2, CMY-Y102LS-G2, CMY-Y202S-G2 Header: CMY-Y104/108/1010C-G		
Remarks			Details on foundation work, duct work, insulation work, electrical wiring, power source switch, and other items shall be referred to the Installation Manual. Due to continuing improvement, above specifications may be subject to change without notice. The ambient temperature of the Heat Source Unit needs to be kept below 104°F D.B. (40°C D.B.) The ambient relative humidity of the Heat Source Unit needs to be kept below 80%. The Heat Source Unit should not be installed at outdoor. Be sure to mount a strainer (more than 50 meshes) at the water inlet piping of the unit. Be sure to provide interlocking for the unit operation and water circuit. Install the supplied insulation material to the unused drain-socket. When installing insulation material around both water and refrigerant piping, follow the installation manual.		

Notes:		Unit converter
1.Nominal cooling conditions (Test conditions are based on AHRI 1230) Indoor: 81°F D.B./66°F W.B. (27°C D.B./19°C W.B.), Water temperature: 86°F (30°C)		BTU/h =kW x 3,412
2.Nominal heating conditions (Test conditions are based on AHRI 1230) Indoor: 68°F D.B. (20°C D.B.), Water temperature: 68°F (20°C)		cfm =m³/min x 35.31
		lbs =kg/0.4536
		*Above specification data is subject to rounding variation.

1. SPECIFICATIONS

U11 2nd

Heat Source Model			PQHY-P168TLMU-A		
Indoor Model			Non-Ducted	Ducted	
Power source			3-phase 3-wire 208-230 V ±10% 60 Hz		
Cooling capacity (Nominal)		*1	BTU/h	168,000	
			kW	49.2	
(208-230)	Power input		kW	12.05	
			A	37.1-33.6	
	Current input		BTU/h	161,000	
			kW	47.2	
	(Rated)	Power input		11.10	11.88
				34.2-30.9	36.6-33.1
(208-230)	Current input				
Temp. range of cooling		Indoor	W.B.	59~75°F (15~24°C)	
		Circulating water	°F	50~113°F (10~45°C)	
Heating capacity (Nominal)		*2	BTU/h	188,000	
			kW	55.1	
(208-230)	Power input		kW	9.86	
			A	30.4-27.5	
	Current input		BTU/h	179,000	
			kW	52.5	
	(Rated)	Power input		9.09	9.72
				28.0-25.3	29.9-27.1
(208-230)	Current input				
Temp. range of heating		Indoor	D.B.	59~81°F (15~27°C)	
		Circulating water	°F	50~113°F (10~45°C)	
Indoor unit connectable		Total capacity	50~130% of heatsource unit capacity		
		Model/Quantity	P06~P96/1~36		
Sound pressure level (measured in anechoic room)			dB <A>	56.0	
Refrigerant piping diameter		Liquid pipe	in. (mm)	5/8 (15.88) Brazed	
		Gas pipe	in. (mm)	1-1/8 (28.58) Brazed	
Minimum Circuit Ampacity			A	44-39	
Maximum Overcurrent Protection			A	70-70	
Circulating water		Water flow rate	G/h	1,902	
			G/min	31.7	
			m³/h	7.20	
			L/min	120	
			cfm	4.2	
		Pressure drop	psi	6.38	
			kPa	44	
		Operating volume range	G/h	1,189 ~ 3,054	
			G/min	19.8 ~ 50.9	
			m³/h	4.5 ~ 11.6	
Compressor		Type x Quantity		Inverter scroll hermetic compressor x 1	
		Manufacture		AC&R Works, MITSUBISHI ELECTRIC CORPORATION	
		Starting method		Inverter	
		Motor output	kW	11.0	
		Case heater	kW	-	
		Lubricant	MEL32		
External finish			Galvanized steel sheets		
External dimension H x W x D		in.	57-1/8 x 34-11/16 x 21-11/16		
		mm	1,450 x 880 x 550		
Protection devices		High pressure protection		High pressure sensor, High pressure switch at 4.15 MPa (601 psi)	
		Inverter circuit		Over-heat protection, Over-current protection	
		Compressor		Over-heat protection	
Refrigerant		Type x original charge		R410A x 13 lbs + 4 oz (6.0 kg)	
		Control		LEV and HIC circuit	
Net weight		lbs (kg)	481 (218)		
Heat exchanger			plate type		
			Water volume in plate	G	1.32
				l	5.0
			Water pressure Max.	psi	290
				MPa	2.0
HIC circuit (HIC: Heat Inter-Changer)			Copper pipe, tube-in-tube structure		
Drawing		External		KJ94T132	
		Wiring		KE94C968	
Standard attachment		Document		Installation Manual	
		Accessory		Details refer to External Drw	
Optional parts			joint: CMY-Y102SS-G2, CMY-Y102LS-G2, CMY-Y202S-G2 Header: CMY-Y104/108/1010C-G		
Remarks			Details on foundation work, duct work, insulation work, electrical wiring, power source switch, and other items shall be referred to the Installation Manual. Due to continuing improvement, above specifications may be subject to change without notice. The ambient temperature of the Heat Source Unit needs to be kept below 104°F.D.B. (40°C.D.B.) The ambient relative humidity of the Heat Source Unit needs to be kept below 80%. The Heat Source Unit should not be installed at outdoor. Be sure to mount a strainer (more than 50 meshes) at the water inlet piping of the unit. Be sure to provide interlocking for the unit operation and water circuit. Install the supplied insulation material to the unused drain-socket. When installing insulation material around both water and refrigerant piping, follow the installation manual.		

Notes:		Unit converter
1.Nominal cooling conditions (Test conditions are based on AHRI 1230) Indoor: 81°F.D.B./66°F.W.B. (27°C.D.B./19°C.W.B.), Water temperature: 86°F (30°C)		BTU/h =kW x 3.412
2.Nominal heating conditions (Test conditions are based on AHRI 1230) Indoor: 68°F.D.B. (20°C.D.B.), Water temperature: 68°F (20°C)		cfm =m³/min x 35.31
		lbs =kg/0.4536
		*Above specification data is subject to rounding variation.

1. SPECIFICATIONS

U11 2nd

Heat Source Model			PQHY-P192TLMU-A		
Indoor Model			Non-Ducted		Ducted
Power source			3-phase 3-wire 208-230 V ±10% 60 Hz		
Cooling capacity (Nominal)		*1	BTU/h	192,000	
			kW	56.3	
(208-230)	Power input		kW	15.05	
	Current input		A	46.4-41.9	
(Rated)			BTU/h	183,000	
			kW	53.6	
(208-230)	Power input		kW	13.87	14.19
	Current input		A	42.7-38.6	43.7-39.5
Temp. range of cooling		Indoor	W.B.	59~75°F (15~24°C)	
		Circulating water	°F	50~113°F (10~45°C)	
Heating capacity (Nominal)		*2	BTU/h	215,000	
			kW	63.0	
(208-230)	Power input		kW	11.90	
	Current input		A	36.7-33.1	
(Rated)			BTU/h	205,000	
			kW	60.1	
(208-230)	Power input		kW	10.97	11.56
	Current input		A	33.8-30.5	35.6-32.2
Temp. range of heating		Indoor	D.B.	59~81°F (15~27°C)	
		Circulating water	°F	50~113°F (10~45°C)	
Indoor unit connectable		Total capacity	50~130% of heatsource unit capacity		
		Model/Quantity	P06~P96/1~41		
Sound pressure level (measured in anechoic room)			dB <A>	58.0	
Refrigerant piping diameter		Liquid pipe	in. (mm)	5/8 (15.88) Brazed	
		Gas pipe	in. (mm)	1-1/8 (28.58) Brazed	
Minimum Circuit Ampacity			A	54-49	
Maximum Overcurrent Protection			A	90-80	
Circulating water		Water flow rate	G/h	1,902	
			G/min	31.7	
			m³/h	7.20	
			L/min	120	
			cfm	4.2	
			Pressure drop	psi	6.38
		kPa		44	
		Operating volume range	G/h	1,189 ~ 3,054	
			G/min	19.8 ~ 50.9	
			m³/h	4.5 ~ 11.6	
Compressor		Type x Quantity		Inverter scroll hermetic compressor x 1	
		Manufacture		AC&R Works, MITSUBISHI ELECTRIC CORPORATION	
		Starting method		Inverter	
		Motor output	kW	12.4	
		Case heater	kW	-	
		Lubricant		MEL32	
External finish			Galvanized steel sheets		
External dimension H x W x D		in.	57-1/8 x 34-11/16 x 21-11/16		
		mm	1,450 x 880 x 550		
Protection devices		High pressure protection		High pressure sensor, High pressure switch at 4.15 MPa (601 psi)	
		Inverter circuit		Over-heat protection, Over-current protection	
		Compressor		Over-heat protection	
Refrigerant		Type x original charge		R410A x 13 lbs + 4 oz (6.0 kg)	
		Control		LEV and HIC circuit	
Net weight		lbs (kg)	481 (218)		
Heat exchanger		Water volume in plate		G	1.32
				l	5.0
		Water pressure Max.	psi	290	
			MPa	2.0	
			HIC circuit (HIC: Heat Inter-Changer)		
Drawing		External		KJ94T132	
		Wiring		KE94C968	
Standard attachment		Document		Installation Manual	
		Accessory		Details refer to External Drw	
Optional parts			joint: CMY-Y102SS-G2, CMY-Y102LS-G2, CMY-Y202S-G2, CMY-Y302S-G2 Header: CMY-Y104/108/1010C-G		
Remarks			Details on foundation work, duct work, insulation work, electrical wiring, power source switch, and other items shall be referred to the Installation Manual. Due to continuing improvement, above specifications may be subject to change without notice. The ambient temperature of the Heat Source Unit needs to be kept below 104°F D.B. (40°C D.B.) The ambient relative humidity of the Heat Source Unit needs to be kept below 80%. The Heat Source Unit should not be installed at outdoor. Be sure to mount a strainer (more than 50 meshes) at the water inlet piping of the unit. Be sure to provide interlocking for the unit operation and water circuit. Install the supplied insulation material to the unused drain-socket. When installing insulation material around both water and refrigerant piping, follow the installation manual.		

Notes:		Unit converter
1.Nominal cooling conditions (Test conditions are based on AHRI 1230) Indoor: 81°F D.B./66°F W.B. (27°C D.B./19°C W.B.), Water temperature: 86°F (30°C)		BTU/h =kW x 3,412
2.Nominal heating conditions (Test conditions are based on AHRI 1230) Indoor: 68°F D.B. (20°C D.B.), Water temperature: 68°F (20°C)		cfm =m³/min x 35.31
		lbs =kg/0.4536
		*Above specification data is subject to rounding variation.

1. SPECIFICATIONS

U11 2nd

Heat Source Model			PQHY-P216TLMU-A	
Indoor Model			Non-Ducted	Ducted
Power source			3-phase 3-wire 208-230 V ±10% 60 Hz	
Cooling capacity (Nominal)		*1	BTU/h	216,000
			kW	63.3
(208-230) (Rated)	Power input		kW	19.23
	Current input		A	59.3-53.6
			BTU/h	206,000
			kW	60.4
	Power input		kW	17.72
	Current input		A	54.6-49.4
Temp. range of cooling		Indoor	W.B.	59~75°F (15~24°C)
		Circulating water	°F	50~113°F (10~45°C)
Heating capacity (Nominal)		*2	BTU/h	243,000
			kW	71.2
(208-230) (Rated)	Power input		kW	13.04
	Current input		A	40.2-36.3
			BTU/h	232,000
			kW	68.0
	Power input		kW	12.01
	Current input		A	37.0-33.4
Temp. range of heating		Indoor	D.B.	59~81°F (15~27°C)
		Circulating water	°F	50~113°F (10~45°C)
Indoor unit connectable		Total capacity		50~130% of heatsource unit capacity
		Model/Quantity		P06~P96/2~46
Sound pressure level (measured in anechoic room)		dB <A>	58.0	
Refrigerant piping diameter		Liquid pipe	in. (mm)	5/8 (15.88) Brazed
		Gas pipe	in. (mm)	1-1/8 (28.58) Brazed
Minimum Circuit Ampacity		A	69-63	
Maximum Overcurrent Protection		A	110-110	
Circulating water		Water flow rate	G/h	3,044
			G/min	50.7
			m³/h	11.52
			L/min	192
			cfm	6.8
		Pressure drop	psi	6.53
			kPa	45
		Operating volume range	G/h	1,585 ~ 3,804
			G/min	26.4 ~ 63.4
			m³/h	6.0 ~ 14.4
Compressor		Type x Quantity		Inverter scroll hermetic compressor x 1
		Manufacture		AC&R Works, MITSUBISHI ELECTRIC CORPORATION
		Starting method		Inverter
		Motor output	kW	14.5
		Case heater	kW	0.045 (240 V)
		Lubricant	MEL32	
External finish		Galvanized steel sheets		
External dimension H x W x D		in.	57-1/8 x 34-11/16 x 21-11/16	
		mm	1,450 x 880 x 550	
Protection devices		High pressure protection		High pressure sensor, High pressure switch at 4.15 MPa (601 psi)
		Inverter circuit		Over-heat protection, Over-current protection
		Compressor		Over-heat protection
Refrigerant		Type x original charge		R410A x 25 lbs + 13 oz (11.7 kg)
		Control		LEV and HIC circuit
Net weight		lbs (kg)	558 (253)	
Heat exchanger		Water volume in plate		plate type
				G
		I	10.0	
		Water pressure Max.	psi	290
			MPa	2.0
HIC circuit (HIC: Heat Inter-Changer)		Copper pipe, tube-in-tube structure		
Drawing		External		KJ94T132
		Wiring		KE94G037
Standard attachment		Document		Installation Manual
Optional parts		Accessory		Details refer to External Drw
		joint: CMY-Y102SS-G2, CMY-Y102LS-G2, CMY-Y202S-G2, CMY-Y302S-G2 Header: CMY-Y104/108/1010C-G		
Remarks		Details on foundation work, duct work, insulation work, electrical wiring, power source switch, and other items shall be referred to the Installation Manual. Due to continuing improvement, above specifications may be subject to change without notice. The ambient temperature of the Heat Source Unit needs to be kept below 104°F.D.B. (40°C.D.B.) The ambient relative humidity of the Heat Source Unit needs to be kept below 80%. The Heat Source Unit should not be installed at outdoor. Be sure to mount a strainer (more than 50 meshes) at the water inlet piping of the unit. Be sure to provide interlocking for the unit operation and water circuit. Install the supplied insulation material to the unused drain-socket. When installing insulation material around both water and refrigerant piping, follow the installation manual.		

Notes:		Unit converter
1.Nominal cooling conditions (Test conditions are based on AHRI 1230) Indoor: 81°F.D.B./66°F.W.B. (27°C.D.B./19°C.W.B.), Water temperature: 86°F (30°C)		BTU/h =kW x 3.412
2.Nominal heating conditions (Test conditions are based on AHRI 1230) Indoor: 68°F.D.B. (20°C.D.B.), Water temperature: 68°F (20°C)		cfm =m³/min x 35.31
		lbs =kg/0.4536
		*Above specification data is subject to rounding variation.

1. SPECIFICATIONS

U11 2nd

Heat Source Model			PQHY-P240TLMU-A			
Indoor Model			Non-Ducted		Ducted	
Power source			3-phase 3-wire 208-230 V ±10% 60 Hz			
Cooling capacity (Nominal)		*1	BTU/h	240,000		
			kW	70.3		
(208-230)	Power input		kW	21.14		
	Current input		A	65.1-58.9		
(Rated)			BTU/h	228,000		
			kW	66.8		
(208-230)	Power input		kW	19.49	18.74	
	Current input		A	60.1-54.3	57.7-52.2	
Temp. range of cooling		Indoor	W.B.	59~75°F (15~24°C)		
		Circulating water	°F	50~113°F (10~45°C)		
Heating capacity (Nominal)		*2	BTU/h	270,000		
			kW	79.1		
(208-230)	Power input		kW	15.12		
	Current input		A	46.6-42.1		
(Rated)			BTU/h	258,000		
			kW	75.6		
(208-230)	Power input		kW	13.93	14.62	
	Current input		A	42.9-38.8	45.0-40.7	
Temp. range of heating		Indoor	D.B.	59~81°F (15~27°C)		
		Circulating water	°F	50~113°F (10~45°C)		
Indoor unit connectable		Total capacity	50~130% of heatsource unit capacity			
		Model/Quantity	P06~P96/2~50			
Sound pressure level (measured in anechoic room)			dB <A>	58.0		
Refrigerant piping diameter		Liquid pipe	in. (mm)	5/8 (15.88) Brazed		
		Gas pipe	in. (mm)	1-1/8 (28.58) Brazed		
Minimum Circuit Ampacity			A	79-71		
Maximum Overcurrent Protection			A	125-125		
Circulating water		Water flow rate	G/h	3,044		
			G/min	50.7		
			m³/h	11.52		
			L/min	192		
			cfm	6.8		
		Pressure drop	psi	6.53		
			kPa	45		
		Operating volume range	G/h	1,585 ~ 3,804		
			G/min	26.4 ~ 63.4		
m³/h	6.0 ~ 14.4					
Compressor		Type x Quantity		Inverter scroll hermetic compressor x 1		
		Manufacture		AC&R Works, MITSUBISHI ELECTRIC CORPORATION		
		Starting method		Inverter		
		Motor output	kW	16.1		
		Case heater	kW	0.045 (240 V)		
		Lubricant		MEL32		
External finish			Galvanized steel sheets			
External dimension H x W x D			in.	57-1/8 x 34-11/16 x 21-11/16		
			mm	1,450 x 880 x 550		
Protection devices		High pressure protection		High pressure sensor, High pressure switch at 4.15 MPa (601 psi)		
		Inverter circuit		Over-heat protection, Over-current protection		
		Compressor		Over-heat protection		
Refrigerant		Type x original charge		R410A x 25 lbs + 13 oz (11.7 kg)		
		Control		LEV and HIC circuit		
Net weight		lbs (kg)	558 (253)			
Heat exchanger			plate type			
			Water volume in plate	G	2.64	
				l	10.0	
			Water pressure Max.	psi	290	
				MPa	2.0	
HIC circuit (HIC: Heat Inter-Changer)			Copper pipe, tube-in-tube structure			
Drawing		External		KJ94T132		
		Wiring		KE94G037		
Standard attachment		Document		Installation Manual		
		Accessory		Details refer to External Drw		
Optional parts			joint: CMY-Y102SS-G2, CMY-Y102LS-G2, CMY-Y202S-G2, CMY-Y302S-G2 Header: CMY-Y104/108/1010C-G			
Remarks			Details on foundation work, duct work, insulation work, electrical wiring, power source switch, and other items shall be referred to the Installation Manual. Due to continuing improvement, above specifications may be subject to change without notice. The ambient temperature of the Heat Source Unit needs to be kept below 104°F.D.B. (40°C.D.B.) The ambient relative humidity of the Heat Source Unit needs to be kept below 80%. The Heat Source Unit should not be installed at outdoor. Be sure to mount a strainer (more than 50 meshes) at the water inlet piping of the unit. Be sure to provide interlocking for the unit operation and water circuit. Install the supplied insulation material to the unused drain-socket. When installing insulation material around both water and refrigerant piping, follow the installation manual.			

Notes:		Unit converter
1.Nominal cooling conditions (Test conditions are based on AHRI 1230) Indoor: 81°F.D.B./66°F.W.B. (27°C.D.B./19°C.W.B.), Water temperature: 86°F (30°C)		BTU/h =kW x 3,412
2.Nominal heating conditions (Test conditions are based on AHRI 1230) Indoor: 68°F.D.B. (20°C.D.B.), Water temperature: 68°F (20°C)		cfm =m³/min x 35.31
		lbs =kg/0.4536
		*Above specification data is subject to rounding variation.

1. SPECIFICATIONS

U11 2nd

Heat Source Model			PQHY-P144TSLMU-A			
Indoor Model			Non-Ducted		Ducted	
Power source			3-phase 3-wire 208-230 V ±10% 60 Hz			
Cooling capacity (Nominal)	*1	BTU/h	144,000			
		kW	42.2			
	(208-230)	Power input	7.11			
		Current input	21.9-19.8			
	(Rated)	BTU/h	137,000			
		kW	40.2			
	(208-230)	Power input	6.53		7.72	
		Current input	20.1-18.2		23.8-21.5	
	Temp. range of cooling	Indoor	W.B.	59~75°F (15~24°C)		
		Circulating water	°F	50~113°F (10~45°C)		
Heating capacity (Nominal)	*2	BTU/h	160,000			
		kW	46.9			
	(208-230)	Power input	7.45			
		Current input	22.9-20.7			
	(Rated)	BTU/h	152,000			
		kW	44.5			
	(208-230)	Power input	6.86		7.22	
		Current input	21.1-19.1		22.2-20.1	
	Temp. range of heating	Indoor	D.B.	59~81°F (15~27°C)		
		Circulating water	°F	50~113°F (10~45°C)		
Indoor unit connectable	Total capacity		50~130% of heatsource unit capacity			
	Model/Quantity		P06~P96/1~31			
Sound pressure level (measured in anechoic room)		dB <A>	49.0			
Refrigerant piping diameter	Liquid pipe	in. (mm)	1/2 (12.7) Brazed			
	Gas pipe	in. (mm)	1-1/8 (28.58) Brazed			

Set Model			PQHY-P72TLMU-A		PQHY-P72TLMU-A	
Model			13-12		13-12	
Minimum Circuit Ampacity			A		A	
Maximum Overcurrent Protection			A		A	
Circulating water	Water flow rate	G/h	1,522 + 1,522			
		G/min	25.4 + 25.4			
		m³/h	5.76 + 5.76			
		L/min	96 + 96			
		cfm	3.4 + 3.4			
	Pressure drop	psi	3.48		3.48	
		kPa	24		24	
	Operating volume range	G/h	793 + 793 ~ 1,902 + 1,902			
		G/min	13.2 + 13.2 ~ 31.7 + 31.7			
m³/h		3.0 + 3.0 ~ 7.2 + 7.2				
Compressor	Type x Quantity		Inverter scroll hermetic compressor x 1		Inverter scroll hermetic compressor x 1	
	Manufacture		AC&R Works, MITSUBISHI ELECTRIC CORPORATION		AC&R Works, MITSUBISHI ELECTRIC CORPORATION	
	Starting method		Inverter		Inverter	
	Motor output	kW	4.3		4.3	
	Case heater	kW	-		-	
	Lubricant		MEL32		MEL32	
External finish			Galvanized steel sheets		Galvanized steel sheets	
External dimension H x W x D		in.	43-5/16 x 34-11/16 x 21-11/16		43-5/16 x 34-11/16 x 21-11/16	
		mm	1,100 x 880 x 550		1,100 x 880 x 550	
Protection devices	High pressure protection		High pressure sensor, High pressure switch at 4.15 MPa (601 psi)		High pressure sensor, High pressure switch at 4.15 MPa (601 psi)	
	Inverter circuit		Over-heat protection, Over-current protection		Over-heat protection, Over-current protection	
	Compressor		Over-heat protection		Over-heat protection	
Refrigerant	Type x original charge		R410A x 11 lbs + 1 oz (5.0 kg)		R410A x 11 lbs + 1 oz (5.0 kg)	
	Control		LEV and HIC circuit			
Net weight		lbs (kg)	384 (174)		384 (174)	
Heat exchanger	Water volume in plate		plate type		plate type	
			G	1.32	1.32	
	I	5.0	5.0			
	Water pressure Max.	psi	290		290	
		MPa	2.0		2.0	
HIC circuit (HIC: Heat Inter-Changer)			Copper pipe, tube-in-tube structure		Copper pipe, tube-in-tube structure	
Pipe between unit and distributor	Liquid pipe	in. (mm)	3/8 (9.52) Brazed		3/8 (9.52) Brazed	
	Gas pipe	in. (mm)	3/4 (19.05) Brazed		3/4 (19.05) Brazed	
Drawing	External		KJ94T155			
	Wiring		KE94C966		KE94C966	
Standard attachment	Document		Installation Manual			
	Accessory		Details refer to External Drw			
Optional parts			Heat Source Twinning kit: CMY-Y100CBK3 joint: CMY-Y102SS-G2, CMY-Y102LS-G2, CMY-Y202S-G2 Header: CMY-Y104/108/1010C-G			
Remarks			Details on foundation work, duct work, insulation work, electrical wiring, power source switch, and other items shall be referred to the Installation Manual. Due to continuing improvement, above specifications may be subject to change without notice. The ambient temperature of the Heat Source Unit needs to be kept below 104°F.D.B. (40°C.D.B.) The ambient relative humidity of the Heat Source Unit needs to be kept below 80%. The Heat Source Unit should not be installed at outdoor. Be sure to mount a strainer (more than 50 meshes) at the water inlet piping of the unit. Be sure to provide interlocking for the unit operation and water circuit. Install the supplied insulation material to the unused drain-socket. When installing insulation material around both water and refrigerant piping, follow the installation manual.			

Notes:		Unit converter
1.Nominal cooling conditions (Test conditions are based on AHRI 1230) Indoor: 81°F.D.B./66°F.W.B. (27°C.D.B./19°C.W.B.), Water temperature: 86°F (30°C)		BTU/h =kW x 3.412
2.Nominal heating conditions (Test conditions are based on AHRI 1230) Indoor: 68°F.D.B. (20°C.D.B.), Water temperature: 68°F (20°C)		cfm =m³/min x 35.31
		lbs =kg/0.4536
		*Above specification data is subject to rounding variation.

1. SPECIFICATIONS

U11 2nd

Heat Source Model			PQHY-P168TSLMU-A	
Indoor Model			Non-Ducted	Ducted
Power source			3-phase 3-wire 208-230 V ±10% 60 Hz	
Cooling capacity (Nominal)	*1	BTU/h	168,000	
		kW	49.2	
		Power input	9.33	
		Current input	28.7-26.0	
	(208-230) (Rated)	BTU/h	161,000	
		kW	47.2	
		Power input	8.58	
		Current input	26.4-23.9	
Temp. range of cooling	Indoor	W.B.	59~75°F (15~24°C)	
	Circulating water	°F	50~113°F (10~45°C)	
Heating capacity (Nominal)	*2	BTU/h	188,000	
		kW	55.1	
		Power input	9.34	
		Current input	28.8-26.0	
	(208-230) (Rated)	BTU/h	179,000	
		kW	52.5	
		Power input	8.60	
		Current input	26.5-23.9	
Temp. range of heating	Indoor	D.B.	59~81°F (15~27°C)	
	Circulating water	°F	50~113°F (10~45°C)	
Indoor unit connectable	Total capacity		50~130% of heatsource unit capacity	
	Model/Quantity		P06~P96/1~36	
Sound pressure level (measured in anechoic room)		dB <A>	50.0	
Refrigerant piping diameter	Liquid pipe	in. (mm)	5/8 (15.88) Brazed	
	Gas pipe	in. (mm)	1-1/8 (28.58) Brazed	

Set Model				
Model			PQHY-P96TLMU-A	PQHY-P72TLMU-A
Minimum Circuit Ampacity		A	19-17	13-12
Maximum Overcurrent Protection		A	30-25	20-20
Circulating water	Water flow rate	G/h	1,522 + 1,522	
		G/min	25.4 + 25.4	
		m ³ /h	5.76 + 5.76	
		L/min	96 + 96	
		cfm	3.4 + 3.4	
	Pressure drop	psi	3.48	3.48
		kPa	24	24
	Operating volume range	G/h	793 + 793 ~ 1,902 + 1,902	
G/min		13.2 + 13.2 ~ 31.7 + 31.7		
m ³ /h		3.0 + 3.0 ~ 7.2 + 7.2		
Compressor	Type x Quantity		Inverter scroll hermetic compressor x 1	Inverter scroll hermetic compressor x 1
	Manufacture		AC&R Works, MITSUBISHI ELECTRIC CORPORATION	AC&R Works, MITSUBISHI ELECTRIC CORPORATION
	Starting method		Inverter	Inverter
	Motor output	kW	6.0	4.3
	Case heater	kW	-	-
	Lubricant		MEL32	MEL32
External finish		Galvanized steel sheets		Galvanized steel sheets
External dimension H x W x D		in.	43-5/16 x 34-11/16 x 21-11/16	43-5/16 x 34-11/16 x 21-11/16
		mm	1,100 x 880 x 550	1,100 x 880 x 550
Protection devices	High pressure protection		High pressure sensor, High pressure switch at 4.15 MPa (601 psi)	High pressure sensor, High pressure switch at 4.15 MPa (601 psi)
	Inverter circuit		Over-heat protection, Over-current protection	Over-heat protection, Over-current protection
	Compressor		Over-heat protection	Over-heat protection
Refrigerant	Type x original charge		R410A x 11 lbs + 1 oz (5.0 kg)	R410A x 11 lbs + 1 oz (5.0 kg)
	Control		LEV and HIC circuit	
Net weight		lbs (kg)	384 (174)	384 (174)
Heat exchanger	Water volume in plate		plate type	plate type
			G	1.32
	I	5.0	5.0	
	Water pressure Max.	psi	290	290
		MPa	2.0	2.0
HIC circuit (HIC: Heat Inter-Changer)			Copper pipe, tube-in-tube structure	Copper pipe, tube-in-tube structure
Pipe between unit and distributor	Liquid pipe	in. (mm)	3/8 (9.52) Brazed	3/8 (9.52) Brazed
	Gas pipe	in. (mm)	7/8 (22.2) Brazed	7/8 (22.2) Brazed
Drawing	External		KJ94T155	
	Wiring		KE94C966	KE94C966
Standard attachment	Document		Installation Manual	
	Accessory		Details refer to External Drw	
Optional parts			Heat Source Twinning kit: CMY-Y100CBK3 joint: CMY-Y102SS-G2, CMY-Y102LS-G2, CMY-Y202S-G2 Header: CMY-Y104/108/1010C-G	
Remarks			Details on foundation work, duct work, insulation work, electrical wiring, power source switch, and other items shall be referred to the Installation Manual. Due to continuing improvement, above specifications may be subject to change without notice. The ambient temperature of the Heat Source Unit needs to be kept below 104°F D.B. (40°C D.B.) The ambient relative humidity of the Heat Source Unit needs to be kept below 80%. The Heat Source Unit should not be installed at outdoor. Be sure to mount a strainer (more than 50 meshes) at the water inlet piping of the unit. Be sure to provide interlocking for the unit operation and water circuit. Install the supplied insulation material to the unused drain-socket. When installing insulation material around both water and refrigerant piping, follow the installation manual.	

Notes:		Unit converter
1.Nominal cooling conditions (Test conditions are based on AHRI 1230) Indoor: 81°F D.B./66°F W.B. (27°C D.B./19°C W.B.), Water temperature: 86°F (30°C)		BTU/h =kW x 3.412
2.Nominal heating conditions (Test conditions are based on AHRI 1230) Indoor: 68°F D.B. (20°C D.B.), Water temperature: 68°F (20°C)		cfm =m ³ /min x 35.31
		lbs =kg/0.4536
		*Above specification data is subject to rounding variation.

1. SPECIFICATIONS

U11 2nd

Heat Source Model			PQHY-P192TSLMU-A	
Indoor Model			Non-Ducted	
Power source			Ducted	
Cooling capacity (Nominal)			3-phase 3-wire 208-230 V ±10% 60 Hz	
*1			192,000	
BTU/h			56.3	
kW			11.30	
Power input			34.8-31.5	
(208-230) Current input			183,000	
(Rated)			53.6	
BTU/h			10.40	
kW			10.98	
Power input			32.0-29.0	
(208-230) Current input			33.8-30.6	
A				
Temp. range of cooling			Indoor	
W.B.			59~75°F (15~24°C)	
Circulating water			°F	
°F			50~113°F (10~45°C)	
Heating capacity (Nominal)			*2	
BTU/h			215,000	
kW			63.0	
Power input			11.02	
(208-230) Current input			33.9-30.7	
(Rated)			205,000	
BTU/h			60.1	
kW			10.16	
Power input			31.3-28.3	
(208-230) Current input			27.4-24.8	
A				
Temp. range of heating			Indoor	
D.B.			59~81°F (15~27°C)	
Circulating water			°F	
°F			50~113°F (10~45°C)	
Indoor unit connectable			Total capacity	
Model/Quantity			50~130% of heatsource unit capacity	
P06~P96/1~41				
Sound pressure level (measured in anechoic room)			dB <A>	
51.0				
Refrigerant piping diameter			Liquid pipe	
in. (mm)			5/8 (15.88) Brazed	
Gas pipe			in. (mm)	
1-1/8 (28.58) Brazed				
Set Model				
Model			PQHY-P96TLMU-A	
Minimum Circuit Ampacity			19-17	
Maximum Overcurrent Protection			30-25	
Circulating water			Water flow rate	
G/h			1,522 + 1,522	
G/min			25.4 + 25.4	
m³/h			5.76 + 5.76	
L/min			96 + 96	
cfm			3.4 + 3.4	
Pressure drop			psi	
3.48			3.48	
kPa			24	
Operating volume range			G/h	
793 + 793 ~ 1,902 + 1,902			G/min	
13.2 + 13.2 ~ 31.7 + 31.7			m³/h	
3.0 + 3.0 ~ 7.2 + 7.2				
Compressor			Type x Quantity	
Inverter scroll hermetic compressor x 1			AC&R Works, MITSUBISHI ELECTRIC CORPORATION	
AC&R Works, MITSUBISHI ELECTRIC CORPORATION			Inverter	
Starting method			6.0	
Motor output			kW	
Case heater			kW	
Lubricant			MEL32	
External finish			Galvanized steel sheets	
Galvanized steel sheets			43-5/16 x 34-11/16 x 21-11/16	
External dimension H x W x D			in.	
43-5/16 x 34-11/16 x 21-11/16			mm	
1,100 x 880 x 550			1,100 x 880 x 550	
Protection devices			High pressure protection	
High pressure sensor, High pressure switch at 4.15 MPa (601 psi)			High pressure sensor, High pressure switch at 4.15 MPa (601 psi)	
Inverter circuit			Over-heat protection, Over-current protection	
Over-heat protection, Over-current protection			Compressor	
Over-heat protection			R410A x 11 lbs + 1 oz (5.0 kg)	
Refrigerant			Type x original charge	
R410A x 11 lbs + 1 oz (5.0 kg)			Control	
LEV and HIC circuit			Net weight	
384 (174)			lbs (kg)	
384 (174)			Heat exchanger	
plate type			Water volume in plate	
1.32			G	
5.0			I	
290			Water pressure Max.	
2.0			psi	
2.0			MPa	
HIC circuit (HIC: Heat Inter-Changer)			Copper pipe, tube-in-tube structure	
Copper pipe, tube-in-tube structure			Pipe between unit and distributor	
3/8 (9.52) Brazed			Liquid pipe	
3/8 (9.52) Brazed			in. (mm)	
7/8 (22.2) Brazed			Gas pipe	
7/8 (22.2) Brazed			in. (mm)	
Drawing			External	
KJ94T155			Wiring	
KE94C966			Document	
Installation Manual			Accessory	
Details refer to External Drw			Optional parts	
Heat Source Twinning kit: CMY-Y100CBK3			Remarks	
joint: CMY-Y102SS-G2, CMY-Y102LS-G2, CMY-Y202S-G2, CMY-Y302S-G2			Details on foundation work, duct work, insulation work, electrical wiring, power source switch, and other items shall be referred to the Installation Manual.	
Header: CMY-Y104/108/1010C-G			Due to continuing improvement, above specifications may be subject to change without notice.	
			The ambient temperature of the Heat Source Unit needs to be kept below 104°F.D.B. (40°C.D.B.)	
			The ambient relative humidity of the Heat Source Unit needs to be kept below 80%.	
			The Heat Source Unit should not be installed at outdoor.	
			Be sure to mount a strainer (more than 50 meshes) at the water inlet piping of the unit.	
			Be sure to provide interlocking for the unit operation and water circuit.	
			Install the supplied insulation material to the unused drain-socket.	
			When installing insulation material around both water and refrigerant piping, follow the installation manual.	

Notes:	Unit converter
1.Nominal cooling conditions (Test conditions are based on AHRI 1230) Indoor: 81°F.D.B./66°F.W.B. (27°C.D.B./19°C.W.B.), Water temperature: 86°F (30°C)	BTU/h =kW x 3.412
2.Nominal heating conditions (Test conditions are based on AHRI 1230) Indoor: 68°F.D.B. (20°C.D.B.), Water temperature: 68°F (20°C)	cfm =m³/min x 35.31
	lbs =kg/0.4536
	*Above specification data is subject to rounding variation.

1. SPECIFICATIONS

U11 2nd

Heat Source Model			PQHY-P216TSLMU-A	
Indoor Model			Non-Ducted	Ducted
Power source			3-phase 3-wire 208-230 V ±10% 60 Hz	
Cooling capacity (Nominal)	*1	BTU/h	216,000	
		kW	63.3	
	(208-230)	Power input	14.03	
		Current input	43.2-39.1	
	(Rated)	BTU/h	206,000	
		kW	60.4	
Temp. range of cooling	(208-230)	Power input	12.93	13.24
	(208-230)	Current input	39.8-36.0	40.8-36.9
Temp. range of cooling	Indoor	W.B.	59~75°F (15~24°C)	
	Circulating water	°F	50~113°F (10~45°C)	
Heating capacity (Nominal)	*2	BTU/h	243,000	
		kW	71.2	
	(208-230)	Power input	12.88	
		Current input	39.7-35.9	
	(Rated)	BTU/h	232,000	
		kW	68.0	
Temp. range of heating	(208-230)	Power input	11.88	10.35
	(208-230)	Current input	36.6-33.1	31.9-28.8
Temp. range of heating	Indoor	D.B.	59~81°F (15~27°C)	
	Circulating water	°F	50~113°F (10~45°C)	
Indoor unit connectable	Total capacity		50~130% of heatsource unit capacity	
	Model/Quantity		P06~P96/2~46	
Sound pressure level (measured in anechoic room)			55.0	
Refrigerant piping diameter	Liquid pipe	in. (mm)	5/8 (15.88) Brazed	
	Gas pipe	in. (mm)	1-1/8 (28.58) Brazed	

Set Model				
Model			PQHY-P120TLMU-A	PQHY-P96TLMU-A
Minimum Circuit Ampacity		A	29-26	19-17
Maximum Overcurrent Protection		A	50-45	30-25
Circulating water	Water flow rate	G/h	1,522 + 1,522	
		G/min	25.4 + 25.4	
		m ³ /h	5.76 + 5.76	
		L/min	96 + 96	
		cfm	3.4 + 3.4	
	Pressure drop	psi	3.48	3.48
		kPa	24	24
	Operating volume range	G/h	793 + 793 ~ 1,902 + 1,902	
G/min		13.2 + 13.2 ~ 31.7 + 31.7		
m ³ /h		3.0 + 3.0 ~ 7.2 + 7.2		
Compressor	Type x Quantity		Inverter scroll hermetic compressor x 1	Inverter scroll hermetic compressor x 1
	Manufacture		AC&R Works, MITSUBISHI ELECTRIC CORPORATION	AC&R Works, MITSUBISHI ELECTRIC CORPORATION
	Starting method		Inverter	Inverter
	Motor output	kW	7.7	6.0
	Case heater	kW	-	-
	Lubricant		MEL32	MEL32
External finish		Galvanized steel sheets		Galvanized steel sheets
External dimension H x W x D		in.	43-5/16 x 34-11/16 x 21-11/16	43-5/16 x 34-11/16 x 21-11/16
		mm	1,100 x 880 x 550	1,100 x 880 x 550
Protection devices	High pressure protection		High pressure sensor, High pressure switch at 4.15 MPa (601 psi)	High pressure sensor, High pressure switch at 4.15 MPa (601 psi)
	Inverter circuit		Over-heat protection, Over-current protection	Over-heat protection, Over-current protection
	Compressor		Over-heat protection	Over-heat protection
Refrigerant	Type x original charge		R410A x 11 lbs + 1 oz (5.0 kg)	R410A x 11 lbs + 1 oz (5.0 kg)
	Control		LEV and HIC circuit	
Net weight		lbs (kg)	384 (174)	384 (174)
Heat exchanger	plate type		plate type	plate type
	Water volume in plate	G	1.32	1.32
		l	5.0	5.0
	Water pressure Max.	psi	290	290
		MPa	2.0	2.0
HIC circuit (HIC: Heat Inter-Changer)		Copper pipe, tube-in-tube structure		Copper pipe, tube-in-tube structure
Pipe between unit and distributor	Liquid pipe	in. (mm)	1/2 (12.7) Brazed	1/2 (12.7) Brazed
	Gas pipe	in. (mm)	7/8 (22.2) Brazed	7/8 (22.2) Brazed
Drawing	External		KJ94T155	
	Wiring		KE94C966	KE94C966
Standard attachment	Document		Installation Manual	
	Accessory		Details refer to External Drw	
Optional parts		Heat Source Twinning kit: CMY-Y100CBK3 joint: CMY-Y102SS-G2, CMY-Y102LS-G2, CMY-Y202S-G2, CMY-Y302S-G2 Header: CMY-Y104/108/1010C-G		
Remarks		Details on foundation work, duct work, insulation work, electrical wiring, power source switch, and other items shall be referred to the Installation Manual. Due to continuing improvement, above specifications may be subject to change without notice. The ambient temperature of the Heat Source Unit needs to be kept below 104°F D.B. (40°C D.B.) The ambient relative humidity of the Heat Source Unit needs to be kept below 80%. The Heat Source Unit should not be installed at outdoor. Be sure to mount a strainer (more than 50 meshes) at the water inlet piping of the unit. Be sure to provide interlocking for the unit operation and water circuit. Install the supplied insulation material to the unused drain-socket. When installing insulation material around both water and refrigerant piping, follow the installation manual.		

Notes:		Unit converter
1.Nominal cooling conditions (Test conditions are based on AHRI 1230) Indoor: 81°F D.B./66°F W.B. (27°C D.B./19°C W.B.), Water temperature: 86°F (30°C)		BTU/h =kW x 3.412
2.Nominal heating conditions (Test conditions are based on AHRI 1230) Indoor: 68°F D.B. (20°C D.B.), Water temperature: 68°F (20°C)		cfm =m³/min x 35.31
		lbs =kg/0.4536
		*Above specification data is subject to rounding variation.

1. SPECIFICATIONS

U11 2nd

Heat Source Model			PQHY-P240TSLMU-A	
Indoor Model			Non-Ducted	Ducted
Power source			3-phase 3-wire 208-230 V ±10% 60 Hz	
Cooling capacity (Nominal)	*1	BTU/h	240,000	
		kW	70.3	
		Power input kW	16.89	
		(208-230) Current input A	52.0-47.1	
	(Rated)	BTU/h	228,000	
		kW	66.8	
		Power input kW	15.57	16.15
		(208-230) Current input A	48.0-43.4	49.8-45.0
Temp. range of cooling	Indoor	W.B.	59~75°F (15~24°C)	
	Circulating water	°F	50~113°F (10~45°C)	
Heating capacity (Nominal)	*2	BTU/h	270,000	
		kW	79.1	
		Power input kW	14.58	
		(208-230) Current input A	44.9-40.6	
	(Rated)	BTU/h	258,000	
		kW	75.6	
		Power input kW	13.45	12.02
		(208-230) Current input A	41.4-37.5	37.0-33.5
Temp. range of heating	Indoor	D.B.	59~81°F (15~27°C)	
	Circulating water	°F	50~113°F (10~45°C)	
Indoor unit connectable	Total capacity		50~130% of heatsource unit capacity	
	Model/Quantity		P06-P96/2-50	
Sound pressure level (measured in anechoic room)		dB <A>	57.0	
Refrigerant piping diameter	Liquid pipe	in. (mm)	5/8 (15.88) Brazed	
	Gas pipe	in. (mm)	1-1/8 (28.58) Brazed	

Set Model			PQHY-P120TLMU-A		PQHY-P120TLMU-A	
Model			29-26		29-26	
Minimum Circuit Ampacity			A		29-26	
Maximum Overcurrent Protection			A		50-45	
Circulating water	Water flow rate	G/h	1,522 + 1,522			
		G/min	25.4 + 25.4			
		m³/h	5.76 + 5.76			
		L/min	96 + 96			
		cfm	3.4 + 3.4			
	Pressure drop	psi	3.48		3.48	
		kPa	24		24	
	Operating volume range	G/h	793 + 793 ~ 1,902 + 1,902			
		G/min	13.2 + 13.2 ~ 31.7 + 31.7			
m³/h		3.0 + 3.0 ~ 7.2 + 7.2				
Compressor	Type x Quantity		Inverter scroll hermetic compressor x 1		Inverter scroll hermetic compressor x 1	
	Manufacture		AC&R Works, MITSUBISHI ELECTRIC CORPORATION		AC&R Works, MITSUBISHI ELECTRIC CORPORATION	
	Starting method		Inverter		Inverter	
	Motor output	kW	7.7		7.7	
	Case heater	kW	-		-	
	Lubricant		MEL32		MEL32	
External finish			Galvanized steel sheets		Galvanized steel sheets	
External dimension H x W x D		in.	43-5/16 x 34-11/16 x 21-11/16		43-5/16 x 34-11/16 x 21-11/16	
		mm	1,100 x 880 x 550		1,100 x 880 x 550	
Protection devices	High pressure protection		High pressure sensor, High pressure switch at 4.15 MPa (601 psi)		High pressure sensor, High pressure switch at 4.15 MPa (601 psi)	
	Inverter circuit		Over-heat protection, Over-current protection		Over-heat protection, Over-current protection	
	Compressor		Over-heat protection		Over-heat protection	
Refrigerant	Type x original charge		R410A x 11 lbs + 1 oz (5.0 kg)		R410A x 11 lbs + 1 oz (5.0 kg)	
	Control		LEV and HIC circuit			
Net weight		lbs (kg)	384 (174)		384 (174)	
Heat exchanger	Water volume in plate	G	plate type		plate type	
		l	1.32		1.32	
			5.0		5.0	
	Water pressure Max.	psi	290		290	
		MPa	2.0		2.0	
HIC circuit (HIC: Heat Inter-Changer)			Copper pipe, tube-in-tube structure		Copper pipe, tube-in-tube structure	
Pipe between unit and distributor	Liquid pipe	in. (mm)	1/2 (12.7) Brazed		1/2 (12.7) Brazed	
	Gas pipe	in. (mm)	7/8 (22.2) Brazed		7/8 (22.2) Brazed	
Drawing	External		KJ94T155			
	Wiring		KE94C966		KE94C966	
Standard attachment	Document		Installation Manual			
	Accessory		Details refer to External Drw			
Optional parts			Heat Source Twinning kit: CMY-Y100CBK3 joint: CMY-Y102SS-G2, CMY-Y102LS-G2, CMY-Y202S-G2, CMY-Y302S-G2 Header: CMY-Y104/108/1010C-G			
Remarks			Details on foundation work, duct work, insulation work, electrical wiring, power source switch, and other items shall be referred to the Installation Manual. Due to continuing improvement, above specifications may be subject to change without notice. The ambient temperature of the Heat Source Unit needs to be kept below 104°F.D.B. (40°C.D.B.) The ambient relative humidity of the Heat Source Unit needs to be kept below 80%. The Heat Source Unit should not be installed at outdoor. Be sure to mount a strainer (more than 50 meshes) at the water inlet piping of the unit. Be sure to provide interlocking for the unit operation and water circuit. Install the supplied insulation material to the unused drain-socket. When installing insulation material around both water and refrigerant piping, follow the installation manual.			

Notes:	Unit converter
1.Nominal cooling conditions (Test conditions are based on AHRI 1230) Indoor: 81°F.D.B./66°F.W.B. (27°C.D.B./19°C.W.B.), Water temperature: 86°F (30°C)	BTU/h =kW x 3.412
2.Nominal heating conditions (Test conditions are based on AHRI 1230) Indoor: 68°F.D.B. (20°C.D.B.), Water temperature: 68°F (20°C)	cfm =m³/min x 35.31
	lbs =kg/0.4536
	*Above specification data is subject to rounding variation.

1. SPECIFICATIONS

U11 2nd

Heat Source Model			PQHY-P288TSLMU-A			
Indoor Model			Non-Ducted	Ducted		
Power source			3-phase 3-wire 208-230 V ±10% 60 Hz			
Cooling capacity (Nominal)		*1	BTU/h	288,000		
			kW	84.4		
		(208-230)	Power input	kW	20.42	
			Current input	A	62.9-56.9	
		(Rated)		BTU/h	275,000	
				kW	80.6	
		(208-230)	Power input	kW	18.82	21.43
			Current input	A	58.0-52.4	66.1-59.7
Temp. range of cooling		Indoor	W.B.	59~75°F (15~24°C)		
		Circulating water	°F	50~113°F (10~45°C)		
Heating capacity (Nominal)		*2	BTU/h	323,000		
			kW	94.7		
		(208-230)	Power input	kW	17.50	
			Current input	A	53.9-48.8	
		(Rated)		BTU/h	308,000	
				kW	90.3	
		(208-230)	Power input	kW	16.13	16.05
			Current input	A	49.7-44.9	49.5-44.7
Temp. range of heating		Indoor	D.B.	59~81°F (15~27°C)		
		Circulating water	°F	50~113°F (10~45°C)		
Indoor unit connectable		Total capacity		50~130% of heatsource unit capacity		
		Model/Quantity		P06~P96/2~50		
Sound pressure level (measured in anechoic room)			dB <A>	57.0		
Refrigerant piping diameter	Liquid pipe	in. (mm)	3/4 (19.05) Brazed			
	Gas pipe	in. (mm)	1-3/8 (34.93) Brazed			

Set Model			PQHY-P144TLMU-A		PQHY-P144TLMU-A	
Model			35-32		35-32	
Minimum Circuit Ampacity			A		35-32	
Maximum Overcurrent Protection			A		60-50	
Circulating water	Water flow rate	G/h	1,902 + 1,902			
		G/min	31.7 + 31.7			
		m³/h	7.20 + 7.20			
		L/min	120 + 120			
		cfm	4.2 + 4.2			
	Pressure drop	psi	6.38		6.38	
		kPa	44		44	
	Operating volume range	G/h	1,189 + 1,189 ~ 3,054 + 3,054			
G/min		19.8 + 19.8 ~ 50.9 + 50.9				
m³/h		4.5 + 4.5 ~ 11.6 + 11.6				
Compressor	Type x Quantity		Inverter scroll hermetic compressor x 1		Inverter scroll hermetic compressor x 1	
	Manufacture		AC&R Works, MITSUBISHI ELECTRIC CORPORATION		AC&R Works, MITSUBISHI ELECTRIC CORPORATION	
	Starting method		Inverter		Inverter	
	Motor output	kW	9.5		9.5	
	Case heater	kW	-		-	
	Lubricant		MEL32		MEL32	
External finish			Galvanized steel sheets		Galvanized steel sheets	
External dimension H x W x D		in.	57-1/8 x 34-11/16 x 21-11/16		57-1/8 x 34-11/16 x 21-11/16	
		mm	1,450 x 880 x 550		1,450 x 880 x 550	
Protection devices	High pressure protection		High pressure sensor, High pressure switch at 4.15 MPa (601 psi)		High pressure sensor, High pressure switch at 4.15 MPa (601 psi)	
	Inverter circuit		Over-heat protection, Over-current protection		Over-heat protection, Over-current protection	
	Compressor		Over-heat protection		Over-heat protection	
Refrigerant	Type x original charge		R410A x 13 lbs + 4 oz (6.0 kg)		R410A x 13 lbs + 4 oz (6.0 kg)	
	Control		LEV and HIC circuit			
Net weight		lbs (kg)	481 (218)		481 (218)	
Heat exchanger	Water volume in plate		plate type		plate type	
			G	1.32		1.32
	I	5.0		5.0		
	Water pressure Max.	psi	290		290	
		MPa	2.0		2.0	
HIC circuit (HIC: Heat Inter-Changer)			Copper pipe, tube-in-tube structure		Copper pipe, tube-in-tube structure	
Pipe between unit and distributor	Liquid pipe	in. (mm)	1/2 (12.7) Brazed		1/2 (12.7) Brazed	
	Gas pipe	in. (mm)	1-1/8 (28.58) Brazed		1-1/8 (28.58) Brazed	
Drawing	External		KJ94T157			
	Wiring		KE94C968		KE94C968	
Standard attachment	Document		Installation Manual			
	Accessory		Details refer to External Drw			
Optional parts			Heat Source Twinning kit: CMY-Y200CBK2 joint: CMY-Y102SS-G2, CMY-Y102LS-G2, CMY-Y202S-G2, CMY-Y302S-G2 Header: CMY-Y104/108/1010C-G			
Remarks			Details on foundation work, duct work, insulation work, electrical wiring, power source switch, and other items shall be referred to the Installation Manual. Due to continuing improvement, above specifications may be subject to change without notice. The ambient temperature of the Heat Source Unit needs to be kept below 104°F D.B. (40°C D.B.) The ambient relative humidity of the Heat Source Unit needs to be kept below 80%. The Heat Source Unit should not be installed at outdoor. Be sure to mount a strainer (more than 50 meshes) at the water inlet piping of the unit. Be sure to provide interlocking for the unit operation and water circuit. Install the supplied insulation material to the unused drain-socket. When installing insulation material around both water and refrigerant piping, follow the installation manual.			

Notes:	Unit converter
1. Nominal cooling conditions (Test conditions are based on AHRI 1230) Indoor: 81°F D.B./66°F W.B. (27°C D.B./19°C W.B.), Water temperature: 86°F (30°C)	BTU/h = kW x 3.412
2. Nominal heating conditions (Test conditions are based on AHRI 1230) Indoor: 68°F D.B. (20°C D.B.), Water temperature: 68°F (20°C)	cfm = m³/min x 35.31
	lbs = kg/0.4536
	*Above specification data is subject to rounding variation.

1. SPECIFICATIONS

U11 2nd

Heat Source Model			PQHY-P312TSLMU-A	
Indoor Model			Non-Ducted	Ducted
Power source			3-phase 3-wire 208-230 V ±10% 60 Hz	
Cooling capacity (Nominal)	*1	BTU/h	312,000	
		kW	91.4	
		Power input	kW	23.41
		(208-230) Current input	A	72.1-65.2
	(Rated)	BTU/h	297,000	
		kW	87.0	
		Power input	kW	21.59
		(208-230) Current input	A	66.5-60.2
Temp. range of cooling	Indoor	W.B.	59~75°F (15~24°C)	
	Circulating water	°F	50~113°F (10~45°C)	
Heating capacity (Nominal)	*2	BTU/h	350,000	
		kW	102.6	
		Power input	kW	19.11
		(208-230) Current input	A	58.9-53.3
	(Rated)	BTU/h	334,000	
		kW	97.9	
		Power input	kW	17.62
		(208-230) Current input	A	54.3-49.1
Temp. range of heating	Indoor	D.B.	59~81°F (15~27°C)	
	Circulating water	°F	50~113°F (10~45°C)	
Indoor unit connectable	Total capacity	50~130% of heatsource unit capacity		
	Model/Quantity	P06~P96/2~50		
Sound pressure level (measured in anechoic room)		dB <A>	58.0	
Refrigerant	Liquid pipe	in. (mm)	3/4 (19.05) Brazed	
piping diameter	Gas pipe	in. (mm)	1-3/8 (34.93) Brazed	
Set Model				
Model			PQHY-P168TLMU-A	PQHY-P144TLMU-A
Minimum Circuit Ampacity		A	44-39	35-32
Maximum Overcurrent Protection		A	70-70	60-50
Circulating water	Water flow rate	G/h	1,902 + 1,902	
		G/min	31.7 + 31.7	
		m³/h	7.20 + 7.20	
		L/min	120 + 120	
		cfm	4.2 + 4.2	
	Pressure drop	psi	6.38	6.38
		kPa	44	44
	Operating volume range	G/h	1,189 + 1,189 ~ 3,054 + 3,054	
G/min		19.8 + 19.8 ~ 50.9 + 50.9		
m³/h		4.5 + 4.5 ~ 11.6 + 11.6		
Compressor	Type x Quantity		Inverter scroll hermetic compressor x 1	Inverter scroll hermetic compressor x 1
	Manufacture		AC&R Works, MITSUBISHI ELECTRIC CORPORATION	AC&R Works, MITSUBISHI ELECTRIC CORPORATION
	Starting method		Inverter	Inverter
	Motor output	kW	11.0	9.5
	Case heater	kW	-	-
	Lubricant		MEL32	MEL32
External finish			Galvanized steel sheets	Galvanized steel sheets
External dimension H x W x D		in.	57-1/8 x 34-11/16 x 21-11/16	57-1/8 x 34-11/16 x 21-11/16
		mm	1,450 x 880 x 550	1,450 x 880 x 550
Protection devices	High pressure protection		High pressure sensor, High pressure switch at 4.15 MPa (601 psi)	High pressure sensor, High pressure switch at 4.15 MPa (601 psi)
	Inverter circuit		Over-heat protection, Over-current protection	Over-heat protection, Over-current protection
	Compressor		Over-heat protection	Over-heat protection
Refrigerant	Type x original charge		R410A x 13 lbs + 4 oz (6.0 kg)	R410A x 13 lbs + 4 oz (6.0 kg)
	Control		LEV and HIC circuit	
Net weight		lbs (kg)	481 (218)	481 (218)
Heat exchanger			plate type	plate type
	Water volume in plate	G	1.32	1.32
		l	5.0	5.0
	Water pressure Max.	psi	290	290
		MPa	2.0	2.0
HIC circuit (HIC: Heat Inter-Changer)			Copper pipe, tube-in-tube structure	Copper pipe, tube-in-tube structure
Pipe between unit and distributor	Liquid pipe	in. (mm)	5/8 (15.88) Brazed	5/8 (15.88) Brazed
	Gas pipe	in. (mm)	1-1/8 (28.58) Brazed	1-1/8 (28.58) Brazed
Drawing	External		KJ94T157	
	Wiring		KE94C968	KE94C968
Standard attachment	Document		Installation Manual	
	Accessory		Details refer to External Drw	
Optional parts			Heat Source Twinning kit: CMY-Y200CBK2 joint: CMY-Y102SS-G2, CMY-Y102LS-G2, CMY-Y202S-G2, CMY-Y302S-G2 Header: CMY-Y104/108/1010C-G	
Remarks			Details on foundation work, duct work, insulation work, electrical wiring, power source switch, and other items shall be referred to the Installation Manual. Due to continuing improvement, above specifications may be subject to change without notice. The ambient temperature of the Heat Source Unit needs to be kept below 104°F.D.B. (40°C.D.B.) The ambient relative humidity of the Heat Source Unit needs to be kept below 80%. The Heat Source Unit should not be installed at outdoor. Be sure to mount a strainer (more than 50 meshes) at the water inlet piping of the unit. Be sure to provide interlocking for the unit operation and water circuit. Install the supplied insulation material to the unused drain-socket. When installing insulation material around both water and refrigerant piping, follow the installation manual.	

Notes:	Unit converter
1.Nominal cooling conditions (Test conditions are based on AHRI 1230) Indoor: 81°F.D.B./66°F.W.B. (27°C.D.B./19°C.W.B.), Water temperature: 86°F (30°C)	BTU/h =kW x 3.412
2.Nominal heating conditions (Test conditions are based on AHRI 1230) Indoor: 68°F.D.B. (20°C.D.B.), Water temperature: 68°F (20°C)	cfm =m³/min x 35.31 lbs =kg/0.4536
	*Above specification data is subject to rounding variation.

1. SPECIFICATIONS

U11 2nd

Heat Source Model			PQHY-P336TSLMU-A	
Indoor Model			Non-Ducted	Ducted
Power source			3-phase 3-wire 208-230 V ±10% 60 Hz	
Cooling capacity (Nominal)	*1	BTU/h	336,000	
		kW	98.5	
		Power input	26.84	
		Current input	82.7-74.8	
	(208-230) (Rated)	BTU/h	320,000	
		kW	93.8	
		Power input	24.76	
		Current input	76.3-69.0	
Temp. range of cooling	Indoor	W.B.	59~75°F (15~24°C)	
	Circulating water	°F	50~113°F (10~45°C)	
Heating capacity (Nominal)	*2	BTU/h	378,000	
		kW	110.8	
		Power input	20.77	
		Current input	64.0-57.9	
	(208-230) (Rated)	BTU/h	361,000	
		kW	105.8	
		Power input	19.16	
		Current input	59.0-53.4	
Temp. range of heating	Indoor	D.B.	59~81°F (15~27°C)	
	Circulating water	°F	50~113°F (10~45°C)	
Indoor unit connectable	Total capacity		50~130% of heatsource unit capacity	
	Model/Quantity		P06~P96/2~50	
Sound pressure level (measured in anechoic room)		dB <A>	59.0	
Refrigerant piping diameter	Liquid pipe	in. (mm)	3/4 (19.05) Brazed	
	Gas pipe	in. (mm)	1-5/8 (41.28) Brazed	

Set Model				
Model			PQHY-P168TLMU-A	PQHY-P168TLMU-A
Minimum Circuit Ampacity		A	44-39	44-39
Maximum Overcurrent Protection		A	70-70	70-70
Circulating water	Water flow rate	G/h	1,902 + 1,902	
		G/min	31.7 + 31.7	
		m³/h	7.20 + 7.20	
		L/min	120 + 120	
		cfm	4.2 + 4.2	
	Pressure drop	psi	6.38	6.38
		kPa	44	44
	Operating volume range	G/h	1,189 + 1,189 ~ 3,054 + 3,054	
		G/min	19.8 + 19.8 ~ 50.9 + 50.9	
m³/h		4.5 + 4.5 ~ 11.6 + 11.6		
Compressor	Type x Quantity		Inverter scroll hermetic compressor x 1	Inverter scroll hermetic compressor x 1
	Manufacture		AC&R Works, MITSUBISHI ELECTRIC CORPORATION	AC&R Works, MITSUBISHI ELECTRIC CORPORATION
	Starting method		Inverter	Inverter
	Motor output	kW	11.0	11.0
	Case heater	kW	-	-
	Lubricant		MEL32	MEL32
External finish		Galvanized steel sheets		Galvanized steel sheets
External dimension H x W x D		in.	57-1/8 x 34-11/16 x 21-11/16	57-1/8 x 34-11/16 x 21-11/16
		mm	1,450 x 880 x 550	1,450 x 880 x 550
Protection devices	High pressure protection		High pressure sensor, High pressure switch at 4.15 MPa (601 psi)	High pressure sensor, High pressure switch at 4.15 MPa (601 psi)
	Inverter circuit		Over-heat protection, Over-current protection	Over-heat protection, Over-current protection
	Compressor		Over-heat protection	Over-heat protection
Refrigerant	Type x original charge		R410A x 13 lbs + 4 oz (6.0 kg)	R410A x 13 lbs + 4 oz (6.0 kg)
	Control		LEV and HIC circuit	
Net weight		lbs (kg)	481 (218)	481 (218)
Heat exchanger			plate type	plate type
	Water volume in plate	G	1.32	1.32
		l	5.0	5.0
	Water pressure Max.	psi	290	290
		MPa	2.0	2.0
HIC circuit (HIC: Heat Inter-Changer)			Copper pipe, tube-in-tube structure	Copper pipe, tube-in-tube structure
Pipe between unit and distributor	Liquid pipe	in. (mm)	5/8 (15.88) Brazed	5/8 (15.88) Brazed
	Gas pipe	in. (mm)	1-1/8 (28.58) Brazed	1-1/8 (28.58) Brazed
Drawing	External		KJ94T157	
	Wiring		KE94C968	KE94C968
Standard attachment	Document		Installation Manual	
	Accessory		Details refer to External Drw	
Optional parts			Heat Source Twinning kit: CMY-Y200CBK2 joint: CMY-Y102SS-G2, CMY-Y102LS-G2, CMY-Y202S-G2, CMY-Y302S-G2 Header: CMY-Y104/108/1010C-G	
Remarks			Details on foundation work, duct work, insulation work, electrical wiring, power source switch, and other items shall be referred to the Installation Manual. Due to continuing improvement, above specifications may be subject to change without notice. The ambient temperature of the Heat Source Unit needs to be kept below 104°F.D.B. (40°C.D.B.) The ambient relative humidity of the Heat Source Unit needs to be kept below 80%. The Heat Source Unit should not be installed at outdoor. Be sure to mount a strainer (more than 50 meshes) at the water inlet piping of the unit. Be sure to provide interlocking for the unit operation and water circuit. Install the supplied insulation material to the unused drain-socket. When installing insulation material around both water and refrigerant piping, follow the installation manual.	

Notes:	Unit converter
1.Nominal cooling conditions (Test conditions are based on AHRI 1230) Indoor: 81°F.D.B./66°F.W.B. (27°C.D.B./19°C.W.B.), Water temperature: 86°F (30°C)	BTU/h =kW x 3.412
2.Nominal heating conditions (Test conditions are based on AHRI 1230) Indoor: 68°F.D.B. (20°C.D.B.), Water temperature: 68°F (20°C)	cfm =m³/min x 35.31
	lbs =kg/0.4536
	*Above specification data is subject to rounding variation.

1. SPECIFICATIONS

U11 2nd

Heat Source Model			PQHY-P360TSLMU-A	
Indoor Model			Non-Ducted	
Power source			Ducted	
			3-phase 3-wire 208-230 V ±10% 60 Hz	
Cooling capacity (Nominal)	*1	BTU/h	360,000	
		kW	105.5	
		Power input	kW	29.43
		(208-230) Current input	A	90.7-82.0
	(Rated)	BTU/h	342,000	
		kW	100.2	
		Power input	kW	27.17
		(208-230) Current input	A	83.7-75.7
Temp. range of cooling	Indoor	W.B.	59~75°F (15~24°C)	
	Circulating water	°F	50~113°F (10~45°C)	
Heating capacity (Nominal)	*2	BTU/h	405,000	
		kW	118.7	
		Power input	kW	22.85
		(208-230) Current input	A	70.4-63.7
	(Rated)	BTU/h	387,000	
		kW	113.4	
		Power input	kW	21.09
		(208-230) Current input	A	65.0-58.8
Temp. range of heating	Indoor	D.B.	59~81°F (15~27°C)	
	Circulating water	°F	50~113°F (10~45°C)	
Indoor unit connectable	Total capacity	50~130% of heatsource unit capacity		
	Model/Quantity	P06~P96/2~50		
Sound pressure level (measured in anechoic room)		dB <A>	60.0	
Refrigerant piping diameter	Liquid pipe	in. (mm)	3/4 (19.05) Brazed	
	Gas pipe	in. (mm)	1-5/8 (41.28) Brazed	
Set Model				
Model			PQHY-P192TLMU-A	
Minimum Circuit Ampacity			54-49	
Maximum Overcurrent Protection			90-80	
Circulating water	Water flow rate	G/h	1,902 + 1,902	
		G/min	31.7 + 31.7	
		m³/h	7.20 + 7.20	
		L/min	120 + 120	
		cfm	4.2 + 4.2	
	Pressure drop	psi	6.38	
		kPa	44	
	Operating volume range	G/h	1,189 + 1,189 ~ 3,054 + 3,054	
G/min		19.8 + 19.8 ~ 50.9 + 50.9		
m³/h		4.5 + 4.5 ~ 11.6 + 11.6		
Compressor	Type x Quantity		Inverter scroll hermetic compressor x 1	
	Manufacture		AC&R Works, MITSUBISHI ELECTRIC CORPORATION	
	Starting method		Inverter	
	Motor output	kW	12.4	
	Case heater	kW	-	
	Lubricant		MEL32	
External finish			Galvanized steel sheets	
External dimension H x W x D	in.	57-1/8 x 34-11/16 x 21-11/16		
	mm	1,450 x 880 x 550		
Protection devices	High pressure protection		High pressure sensor, High pressure switch at 4.15 MPa (601 psi)	
	Inverter circuit		Over-heat protection, Over-current protection	
	Compressor		Over-heat protection	
Refrigerant	Type x original charge		R410A x 13 lbs + 4 oz (6.0 kg)	
	Control		LEV and HIC circuit	
Net weight		lbs (kg)	481 (218)	
Heat exchanger			plate type	
	Water volume in plate	G	1.32	
		l	5.0	
	Water pressure Max.	psi	290	
		MPa	2.0	
HIC circuit (HIC: Heat Inter-Changer)			Copper pipe, tube-in-tube structure	
Pipe between unit and distributor	Liquid pipe	in. (mm)	5/8 (15.88) Brazed	
	Gas pipe	in. (mm)	1-1/8 (28.58) Brazed	
Drawing	External	KJ94T157		
	Wiring	KE94C968		
Standard attachment	Document	Installation Manual		
	Accessory	Details refer to External Drw		
Optional parts			Heat Source Twinning kit: CMY-Y200CBK2 joint: CMY-Y102SS-G2, CMY-Y102LS-G2, CMY-Y202S-G2, CMY-Y302S-G2 Header: CMY-Y104/108/1010C-G	
Remarks			Details on foundation work, duct work, insulation work, electrical wiring, power source switch, and other items shall be referred to the Installation Manual. Due to continuing improvement, above specifications may be subject to change without notice. The ambient temperature of the Heat Source Unit needs to be kept below 104°F.D.B. (40°C.D.B.) The ambient relative humidity of the Heat Source Unit needs to be kept below 80%. The Heat Source Unit should not be installed at outdoor. Be sure to mount a strainer (more than 50 meshes) at the water inlet piping of the unit. Be sure to provide interlocking for the unit operation and water circuit. Install the supplied insulation material to the unused drain-socket. When installing insulation material around both water and refrigerant piping, follow the installation manual.	

Notes:	Unit converter
1.Nominal cooling conditions (Test conditions are based on AHRI 1230) Indoor: 81°F.D.B./66°F.W.B. (27°C.D.B./19°C.W.B.), Water temperature: 86°F (30°C)	BTU/h =kW x 3.412
2.Nominal heating conditions (Test conditions are based on AHRI 1230) Indoor: 68°F.D.B. (20°C.D.B.), Water temperature: 68°F (20°C)	cfm =m³/min x 35.31 lbs =kg/0.4536
	*Above specification data is subject to rounding variation.

1. SPECIFICATIONS

U11 2nd

Heat Source Model			PQHY-P72YLMU-A			
Indoor Model			Non-Ducted		Ducted	
Power source			3-phase 3-wire 460 V ±10% 60 Hz			
Cooling capacity (Nominal)	*1	BTU/h	72,000			
		kW	21.1			
	(460)	Power input	3.23			
		Current input	4.5			
	(Rated)	BTU/h	69,000			
		kW	20.2			
	(460)	Power input	2.96	3.12		
		Current input	4.1	4.3		
	Temp. range of cooling	Indoor	W.B.	59~75°F (15~24°C)		
		Circulating water	°F	50~113°F (10~45°C)		
Heating capacity (Nominal)	*2	BTU/h	80,000			
		kW	23.4			
	(460)	Power input	3.63			
		Current input	5.0			
	(Rated)	BTU/h	76,000			
		kW	22.3			
	(460)	Power input	3.34	3.36		
		Current input	4.6	4.6		
	Temp. range of heating	Indoor	D.B.	59~81°F (15~27°C)		
		Circulating water	°F	50~113°F (10~45°C)		
Indoor unit connectable	Total capacity		50~130% of heatsource unit capacity			
	Model/Quantity		P06~P96/1~15			
Sound pressure level (measured in anechoic room)		dB <A>	46.0			
Refrigerant piping diameter	Liquid pipe	in. (mm)	3/8 (9.52) Brazed			
	Gas pipe	in. (mm)	3/4 (19.05) Brazed			
Minimum Circuit Ampacity		A	6			
Maximum Overcurrent Protection		A	15			
Circulating water	Water flow rate	G/h	1,522			
		G/min	25.4			
		m³/h	5.76			
		L/min	96			
		cfm	3.4			
		Pressure drop	psi	3.48		
	kPa		24			
	Operating volume range	G/h	793 ~ 1,902			
		G/min	13.2 ~ 31.7			
		m³/h	3.0 ~ 7.2			
Compressor	Type x Quantity		Inverter scroll hermetic compressor x 1			
	Manufacture		AC&R Works, MITSUBISHI ELECTRIC CORPORATION			
	Starting method		Inverter			
	Motor output	kW	4.3			
	Case heater	kW	-			
	Lubricant		MEL32			
External finish			Galvanized steel sheets			
External dimension H x W x D		in.	43-5/16 x 34-11/16 x 21-11/16			
		mm	1,100 x 880 x 550			
Protection devices	High pressure protection		High pressure sensor, High pressure switch at 4.15 MPa (601 psi)			
	Inverter circuit		Over-heat protection, Over-current protection			
	Compressor		Over-heat protection			
Refrigerant	Type x original charge		R410A x 11 lbs + 1 oz (5.0 kg)			
	Control		LEV and HIC circuit			
Net weight		lbs (kg)	408 (185)			
Heat exchanger			plate type			
	Water volume in plate	G	1.32			
		l	5.0			
	Water pressure Max.	psi	290			
		MPa	2.0			
HIC circuit (HIC: Heat Inter-Changer)			Copper pipe, tube-in-tube structure			
Drawing	External		KJ94T133			
	Wiring		KE94C952			
Standard attachment	Document		Installation Manual			
	Accessory		Details refer to External Drw			
Optional parts			joint: CMY-Y102SS-G2, CMY-Y102LS-G2 Header: CMY-Y104/108/1010C-G			
Remarks			Details on foundation work, duct work, insulation work, electrical wiring, power source switch, and other items shall be referred to the Installation Manual. Due to continuing improvement, above specifications may be subject to change without notice. The ambient temperature of the Heat Source Unit needs to be kept below 104°F D.B. (40°C D.B.) The ambient relative humidity of the Heat Source Unit needs to be kept below 80%. The Heat Source Unit should not be installed at outdoor. Be sure to mount a strainer (more than 50 meshes) at the water inlet piping of the unit. Be sure to provide interlocking for the unit operation and water circuit. Install the supplied insulation material to the unused drain-socket. When installing insulation material around both water and refrigerant piping, follow the installation manual.			

Notes:	Unit converter	
	BTU/h	=kW x 3.412
	cfm	=m³/min x 35.31
	lbs	=kg/0.4536
*Above specification data is subject to rounding variation.		

1. SPECIFICATIONS

U11 2nd

Heat Source Model			PQHY-P96YLMU-A		
Indoor Model			Non-Ducted	Ducted	
Power source			3-phase 3-wire 460 V ±10% 60 Hz		
Cooling capacity (Nominal)		*1 BTU/h	96,000		
		kW	28.1		
		(460) Power input kW	4.65		
		(460) Current input A	6.4		
(Rated)		BTU/h	92,000		
		kW	27.0		
		(460) Power input kW	4.26	5.19	
		(460) Current input A	5.9	7.2	
Temp. range of cooling		Indoor	59~75°F (15~24°C)		
		Circulating water	50~113°F (10~45°C)		
Heating capacity (Nominal)		*2 BTU/h	108,000		
		kW	31.7		
		(460) Power input kW	5.05		
		(460) Current input A	7.0		
(Rated)		BTU/h	103,000		
		kW	30.2		
		(460) Power input kW	4.65	4.48	
		(460) Current input A	6.4	6.2	
Temp. range of heating		Indoor	59~81°F (15~27°C)		
		Circulating water	50~113°F (10~45°C)		
Indoor unit connectable		Total capacity	50~130% of heatsource unit capacity		
		Model/Quantity	P06~P96/1~20		
Sound pressure level (measured in anechoic room)			dB <A>		
			48.0		
Refrigerant piping diameter		Liquid pipe	in. (mm)		
		Gas pipe	in. (mm)		
			3/8 (9.52) Brazed (1/2 (12.7) Brazed, total length >= 90 m)		
			7/8 (22.2) Brazed		
Minimum Circuit Ampacity			A		
			9		
Maximum Overcurrent Protection			A		
			15		
Circulating water		Water flow rate	G/h	1,522	
			G/min	25.4	
			m³/h	5.76	
			L/min	96	
			cfm	3.4	
		Pressure drop	psi	3.48	
			kPa	24	
		Operating volume range	G/h	793 ~ 1,902	
			G/min	13.2 ~ 31.7	
			m³/h	3.0 ~ 7.2	
Compressor		Type x Quantity		Inverter scroll hermetic compressor x 1	
		Manufacture		AC&R Works, MITSUBISHI ELECTRIC CORPORATION	
		Starting method		Inverter	
		Motor output	kW	6.0	
		Case heater	kW	-	
		Lubricant		MEL32	
External finish			Galvanized steel sheets		
External dimension H x W x D		in.	43-5/16 x 34-11/16 x 21-11/16		
		mm	1,100 x 880 x 550		
Protection devices		High pressure protection		High pressure sensor, High pressure switch at 4.15 MPa (601 psi)	
		Inverter circuit		Over-heat protection, Over-current protection	
		Compressor		Over-heat protection	
Refrigerant		Type x original charge		R410A x 11 lbs + 1 oz (5.0 kg)	
		Control		LEV and HIC circuit	
Net weight		lbs (kg)	408 (185)		
Heat exchanger			plate type		
			Water volume in plate	G	1.32
				l	5.0
			Water pressure Max.	psi	290
MPa	2.0				
HIC circuit (HIC: Heat Inter-Changer)			Copper pipe, tube-in-tube structure		
Drawing		External		KJ94T133	
		Wiring		KE94C952	
Standard attachment		Document		Installation Manual	
		Accessory		Details refer to External Drw	
Optional parts			joint: CMY-Y102SS-G2, CMY-Y102LS-G2 Header: CMY-Y104/108/1010C-G		
Remarks			Details on foundation work, duct work, insulation work, electrical wiring, power source switch, and other items shall be referred to the Installation Manual. Due to continuing improvement, above specifications may be subject to change without notice. The ambient temperature of the Heat Source Unit needs to be kept below 104°F.D.B. (40°C.D.B.) The ambient relative humidity of the Heat Source Unit needs to be kept below 80%. The Heat Source Unit should not be installed at outdoor. Be sure to mount a strainer (more than 50 meshes) at the water inlet piping of the unit. Be sure to provide interlocking for the unit operation and water circuit. Install the supplied insulation material to the unused drain-socket. When installing insulation material around both water and refrigerant piping, follow the installation manual.		

Notes:		Unit converter
1.Nominal cooling conditions (Test conditions are based on AHRI 1230) Indoor: 81°F.D.B./66°F.W.B. (27°C.D.B./19°C.W.B.), Water temperature: 86°F (30°C)		BTU/h =kW x 3,412
2.Nominal heating conditions (Test conditions are based on AHRI 1230) Indoor: 68°F.D.B. (20°C.D.B.), Water temperature: 68°F (20°C)		cfm =m³/min x 35.31
		lbs =kg/0.4536
		*Above specification data is subject to rounding variation.

1. SPECIFICATIONS

U11 2nd

Heat Source Model			PQHY-P120YLMU-A			
Indoor Model			Non-Ducted		Ducted	
Power source			3-phase 3-wire 460 V ±10% 60 Hz			
Cooling capacity (Nominal)		*1	BTU/h	120,000		
			kW	35.2		
			kW	7.24		
		(460)	Current input	A	10.0	
(Rated)			BTU/h	114,000		
			kW	33.4		
			Power input	kW	6.66	7.35
		(460)	Current input	A	9.2	10.2
Temp. range of cooling		Indoor	W.B.	59~75°F (15~24°C)		
		Circulating water	°F	50~113°F (10~45°C)		
Heating capacity (Nominal)		*2	BTU/h	135,000		
			kW	39.6		
			Power input	kW	6.83	
		(460)	Current input	A	9.5	
(Rated)			BTU/h	129,000		
			kW	37.8		
			Power input	kW	6.29	5.92
		(460)	Current input	A	8.7	8.2
Temp. range of heating		Indoor	D.B.	59~81°F (15~27°C)		
		Circulating water	°F	50~113°F (10~45°C)		
Indoor unit connectable		Total capacity		50~130% of heatsource unit capacity		
		Model/Quantity		P06~P96/1~26		
Sound pressure level (measured in anechoic room)			dB <A>	54.0		
Refrigerant piping diameter		Liquid pipe	in. (mm)	3/8 (9.52) Brazed (1/2 (12.7) Brazed, total length >= 40 m)		
		Gas pipe	in. (mm)	7/8 (22.2) Brazed		
Minimum Circuit Ampacity			A	13		
Maximum Overcurrent Protection			A	20		
Circulating water		Water flow rate	G/h	1,522		
			G/min	25.4		
			m³/h	5.76		
			L/min	96		
			cfm	3.4		
		Pressure drop	psi	3.48		
			kPa	24		
		Operating volume range	G/h	793 ~ 1,902		
G/min	13.2 ~ 31.7					
m³/h	3.0 ~ 7.2					
Compressor		Type x Quantity		Inverter scroll hermetic compressor x 1		
		Manufacture		AC&R Works, MITSUBISHI ELECTRIC CORPORATION		
		Starting method		Inverter		
		Motor output	kW	7.7		
		Case heater	kW	-		
		Lubricant		MEL32		
External finish			Galvanized steel sheets			
External dimension H x W x D		in.	43-5/16 x 34-11/16 x 21-11/16			
		mm	1,100 x 880 x 550			
Protection devices		High pressure protection		High pressure sensor, High pressure switch at 4.15 MPa (601 psi)		
		Inverter circuit		Over-heat protection, Over-current protection		
		Compressor		Over-heat protection		
Refrigerant		Type x original charge		R410A x 11 lbs + 1 oz (5.0 kg)		
		Control		LEV and HIC circuit		
Net weight		lbs (kg)	408 (185)			
Heat exchanger				plate type		
		Water volume in plate	G	1.32		
			l	5.0		
		Water pressure Max.	psi	290		
			MPa	2.0		
HIC circuit (HIC: Heat Inter-Changer)			Copper pipe, tube-in-tube structure			
Drawing		External		KJ94T133		
		Wiring		KE94C952		
Standard attachment		Document		Installation Manual		
		Accessory		Details refer to External Drw		
Optional parts			joint: CMY-Y102SS-G2, CMY-Y102LS-G2, CMY-Y202S-G2 Header: CMY-Y104/108/1010C-G			
Remarks			Details on foundation work, duct work, insulation work, electrical wiring, power source switch, and other items shall be referred to the Installation Manual. Due to continuing improvement, above specifications may be subject to change without notice. The ambient temperature of the Heat Source Unit needs to be kept below 104°F.D.B. (40°C.D.B.) The ambient relative humidity of the Heat Source Unit needs to be kept below 80%. The Heat Source Unit should not be installed at outdoor. Be sure to mount a strainer (more than 50 meshes) at the water inlet piping of the unit. Be sure to provide interlocking for the unit operation and water circuit. Install the supplied insulation material to the unused drain-socket. When installing insulation material around both water and refrigerant piping, follow the installation manual.			

Notes:		Unit converter
1.Nominal cooling conditions (Test conditions are based on AHRI 1230) Indoor: 81°F.D.B./66°F.W.B. (27°C.D.B./19°C.W.B.), Water temperature: 86°F (30°C)		BTU/h =kW x 3,412
2.Nominal heating conditions (Test conditions are based on AHRI 1230) Indoor: 68°F.D.B. (20°C.D.B.), Water temperature: 68°F (20°C)		cfm =m³/min x 35.31
		lbs =kg/0.4536
		*Above specification data is subject to rounding variation.

1. SPECIFICATIONS

U11 2nd

Heat Source Model			PQHY-P144YLMU-A	
Indoor Model			Non-Ducted	Ducted
Power source			3-phase 3-wire 460 V ±10% 60 Hz	
Cooling capacity (Nominal)	*1	BTU/h	144,000	
		kW	42.2	
	(460)	Power input	8.78	
		Current input	12.2	
	(Rated)	BTU/h	137,000	
		kW	40.2	
	(460)	Power input	8.07	9.98
		Current input	11.2	13.9
Temp. range of cooling		Indoor	W.B. 59~75°F (15~24°C)	
		Circulating water	°F 50~113°F (10~45°C)	
Heating capacity (Nominal)	*2	BTU/h	160,000	
		kW	46.9	
	(460)	Power input	8.11	
		Current input	11.3	
	(Rated)	BTU/h	152,000	
		kW	44.5	
	(460)	Power input	7.47	7.90
		Current input	10.4	11.0
Temp. range of heating		Indoor	D.B. 59~81°F (15~27°C)	
		Circulating water	°F 50~113°F (10~45°C)	
Indoor unit connectable		Total capacity	50~130% of heatsource unit capacity	
		Model/Quantity	P06~P96/1~31	
Sound pressure level (measured in anechoic room)		dB <A>	54.0	
Refrigerant piping diameter		Liquid pipe	in. (mm) 1/2 (12.7) Brazed	
		Gas pipe	in. (mm) 1-1/8 (28.58) Brazed	
Minimum Circuit Ampacity		A	16	
Maximum Overcurrent Protection		A	25	
Circulating water	Water flow rate	G/h	1,902	
		G/min	31.7	
		m³/h	7.20	
		L/min	120	
		cfm	4.2	
		Pressure drop	psi	6.38
	kPa		44	
	Operating volume range	G/h	1,189 ~ 3,054	
		G/min	19.8 ~ 50.9	
		m³/h	4.5 ~ 11.6	
Compressor	Type x Quantity		Inverter scroll hermetic compressor x 1	
	Manufacture		AC&R Works, MITSUBISHI ELECTRIC CORPORATION	
	Starting method		Inverter	
	Motor output	kW	9.5	
	Case heater	kW	-	
	Lubricant		MEL32	
External finish		Galvanized steel sheets		
External dimension H x W x D		in.	57-1/8 x 34-11/16 x 21-11/16	
		mm	1,450 x 880 x 550	
Protection devices	High pressure protection		High pressure sensor, High pressure switch at 4.15 MPa (601 psi)	
	Inverter circuit		Over-heat protection, Over-current protection	
	Compressor		Over-heat protection	
Refrigerant	Type x original charge		R410A x 13 lbs + 4 oz (6.0 kg)	
	Control		LEV and HIC circuit	
Net weight		lbs (kg)	508 (230)	
Heat exchanger	Water volume in plate		plate type	
			1.32	
	I		5.0	
	Water pressure Max.	psi	290	
		MPa	2.0	
HIC circuit (HIC: Heat Inter-Changer)			Copper pipe, tube-in-tube structure	
Drawing	External		KJ94T134	
	Wiring		KE94C952	
Standard attachment	Document		Installation Manual	
	Accessory		Details refer to External Drw	
Optional parts			joint: CMY-Y102SS-G2, CMY-Y102LS-G2, CMY-Y202S-G2 Header: CMY-Y104/108/1010C-G	
Remarks			Details on foundation work, duct work, insulation work, electrical wiring, power source switch, and other items shall be referred to the Installation Manual. Due to continuing improvement, above specifications may be subject to change without notice. The ambient temperature of the Heat Source Unit needs to be kept below 104°F.D.B. (40°C.D.B.) The ambient relative humidity of the Heat Source Unit needs to be kept below 80%. The Heat Source Unit should not be installed at outdoor. Be sure to mount a strainer (more than 50 meshes) at the water inlet piping of the unit. Be sure to provide interlocking for the unit operation and water circuit. Install the supplied insulation material to the unused drain-socket. When installing insulation material around both water and refrigerant piping, follow the installation manual.	

Notes:		Unit converter
1.Nominal cooling conditions (Test conditions are based on AHRI 1230) Indoor: 81°F.D.B./66°F.W.B. (27°C.D.B./19°C.W.B.), Water temperature: 86°F (30°C)		BTU/h =kW x 3,412
2.Nominal heating conditions (Test conditions are based on AHRI 1230) Indoor: 68°F.D.B. (20°C.D.B.), Water temperature: 68°F (20°C)		cfm =m³/min x 35.31
		lbs =kg/0.4536
		*Above specification data is subject to rounding variation.

1. SPECIFICATIONS

U11 2nd

Heat Source Model			PQHY-P168YLMU-A		
Indoor Model			Non-Ducted		Ducted
Power source			3-phase 3-wire 460 V ±10% 60 Hz		
Cooling capacity (Nominal)	*1	BTU/h	168,000		
		kW	49.2		
		Power input	12.05		
		(460) Current input	16.8		
	(Rated)	BTU/h	161,000		
		kW	47.2		
		Power input	11.10	11.88	
		(460) Current input	15.4	16.5	
Temp. range of cooling	Indoor	W.B.	59~75°F (15~24°C)		
	Circulating water	°F	50~113°F (10~45°C)		
Heating capacity (Nominal)	*2	BTU/h	188,000		
		kW	55.1		
		Power input	9.86		
		(460) Current input	13.7		
	(Rated)	BTU/h	179,000		
		kW	52.5		
		Power input	9.09	9.72	
		(460) Current input	12.6	13.5	
Temp. range of heating	Indoor	D.B.	59~81°F (15~27°C)		
	Circulating water	°F	50~113°F (10~45°C)		
Indoor unit connectable	Total capacity	50~130% of heatsource unit capacity			
	Model/Quantity	P06~P96/1~36			
Sound pressure level (measured in anechoic room)		dB <A>	56.0		
Refrigerant piping diameter	Liquid pipe	in. (mm)	5/8 (15.88) Brazed		
	Gas pipe	in. (mm)	1-1/8 (28.58) Brazed		
Minimum Circuit Ampacity		A	20		
Maximum Overcurrent Protection		A	35		
Circulating water	Water flow rate	G/h	1,902		
		G/min	31.7		
		m³/h	7.20		
		L/min	120		
		cfm	4.2		
		Pressure drop	6.38		
	Operating volume range	kPa	44		
		G/h	1,189 ~ 3,054		
		G/min	19.8 ~ 50.9		
		m³/h	4.5 ~ 11.6		
Compressor	Type x Quantity		Inverter scroll hermetic compressor x 1		
	Manufacture		AC&R Works, MITSUBISHI ELECTRIC CORPORATION		
	Starting method		Inverter		
	Motor output	kW	11.0		
	Case heater	kW	-		
	Lubricant		MEL32		
External finish		Galvanized steel sheets			
External dimension H x W x D		in.	57-1/8 x 34-11/16 x 21-11/16		
		mm	1,450 x 880 x 550		
Protection devices	High pressure protection		High pressure sensor, High pressure switch at 4.15 MPa (601 psi)		
	Inverter circuit		Over-heat protection, Over-current protection		
	Compressor		Over-heat protection		
Refrigerant	Type x original charge		R410A x 13 lbs + 4 oz (6.0 kg)		
	Control		LEV and HIC circuit		
Net weight		lbs (kg)	508 (230)		
Heat exchanger	Water volume in plate		plate type		
			G	1.32	
	l	5.0			
	Water pressure Max.	psi	290		
		MPa	2.0		
HIC circuit (HIC: Heat Inter-Changer)			Copper pipe, tube-in-tube structure		
Drawing	External		KJ94T134		
	Wiring		KE94C952		
Standard attachment	Document		Installation Manual		
	Accessory		Details refer to External Drw		
Optional parts			joint: CMY-Y102SS-G2, CMY-Y102LS-G2, CMY-Y202S-G2 Header: CMY-Y104/108/1010C-G		
Remarks			Details on foundation work, duct work, insulation work, electrical wiring, power source switch, and other items shall be referred to the Installation Manual. Due to continuing improvement, above specifications may be subject to change without notice. The ambient temperature of the Heat Source Unit needs to be kept below 104°F D.B. (40°C D.B.) The ambient relative humidity of the Heat Source Unit needs to be kept below 80%. The Heat Source Unit should not be installed at outdoor. Be sure to mount a strainer (more than 50 meshes) at the water inlet piping of the unit. Be sure to provide interlocking for the unit operation and water circuit. Install the supplied insulation material to the unused drain-socket. When installing insulation material around both water and refrigerant piping, follow the installation manual.		

Notes:		Unit converter
1.Nominal cooling conditions (Test conditions are based on AHRI 1230) Indoor: 81°F D.B./66°F W.B. (27°C D.B./19°C W.B.), Water temperature: 86°F (30°C)		BTU/h =kW x 3,412
2.Nominal heating conditions (Test conditions are based on AHRI 1230) Indoor: 68°F D.B. (20°C D.B.), Water temperature: 68°F (20°C)		cfm =m³/min x 35.31
		lbs =kg/0.4536
		*Above specification data is subject to rounding variation.

1. SPECIFICATIONS

U11 2nd

Heat Source Model			PQHY-P192YLMU-A		
Indoor Model			Non-Ducted		Ducted
Power source			3-phase 3-wire 460 V ±10% 60 Hz		
Cooling capacity (Nominal)	*1	BTU/h	192,000		
		kW	56.3		
	(460)	Power input	15.05		
		Current input	20.9		
	(Rated)	BTU/h	183,000		
		kW	53.6		
	(460)	Power input	13.87	14.19	
		Current input	19.3	19.7	
Temp. range of cooling		Indoor	W.B. 59~75°F (15~24°C)		
		Circulating water	°F 50~113°F (10~45°C)		
Heating capacity (Nominal)	*2	BTU/h	215,000		
		kW	63.0		
	(460)	Power input	11.90		
		Current input	16.5		
	(Rated)	BTU/h	205,000		
		kW	60.1		
	(460)	Power input	10.97	11.56	
		Current input	15.2	16.1	
Temp. range of heating		Indoor	D.B. 59~81°F (15~27°C)		
		Circulating water	°F 50~113°F (10~45°C)		
Indoor unit connectable		Total capacity	50~130% of heatsource unit capacity		
		Model/Quantity	P06~P96/1~41		
Sound pressure level (measured in anechoic room)		dB <A>	58.0		
Refrigerant piping diameter		Liquid pipe	in. (mm) 5/8 (15.88) Brazed		
		Gas pipe	in. (mm) 1-1/8 (28.58) Brazed		
Minimum Circuit Ampacity		A	25		
Maximum Overcurrent Protection		A	40		
Circulating water	Water flow rate	G/h	1,902		
		G/min	31.7		
		m³/h	7.20		
		L/min	120		
		cfm	4.2		
	Pressure drop	psi	6.38		
		kPa	44		
	Operating volume range	G/h	1,189 ~ 3,054		
		G/min	19.8 ~ 50.9		
		m³/h	4.5 ~ 11.6		
Compressor	Type x Quantity		Inverter scroll hermetic compressor x 1		
	Manufacture		AC&R Works, MITSUBISHI ELECTRIC CORPORATION		
	Starting method		Inverter		
	Motor output	kW	12.4		
	Case heater	kW	-		
	Lubricant		MEL32		
External finish		Galvanized steel sheets			
External dimension H x W x D		in.	57-1/8 x 34-11/16 x 21-11/16		
		mm	1,450 x 880 x 550		
Protection devices	High pressure protection		High pressure sensor, High pressure switch at 4.15 MPa (601 psi)		
	Inverter circuit		Over-heat protection, Over-current protection		
	Compressor		Over-heat protection		
Refrigerant	Type x original charge		R410A x 13 lbs + 4 oz (6.0 kg)		
	Control		LEV and HIC circuit		
Net weight		lbs (kg)	508 (230)		
Heat exchanger	Water volume in plate		plate type		
			G	1.32	
	I	5.0			
	Water pressure Max.	psi	290		
		MPa	2.0		
HIC circuit (HIC: Heat Inter-Changer)			Copper pipe, tube-in-tube structure		
Drawing	External		KJ94T134		
	Wiring		KE94C952		
Standard attachment	Document		Installation Manual		
	Accessory		Details refer to External Drw		
Optional parts			joint: CMY-Y102SS-G2, CMY-Y102LS-G2, CMY-Y202S-G2, CMY-Y302S-G2 Header: CMY-Y104/108/1010C-G		
Remarks			Details on foundation work, duct work, insulation work, electrical wiring, power source switch, and other items shall be referred to the Installation Manual. Due to continuing improvement, above specifications may be subject to change without notice. The ambient temperature of the Heat Source Unit needs to be kept below 104°F.D.B. (40°C.D.B.) The ambient relative humidity of the Heat Source Unit needs to be kept below 80%. The Heat Source Unit should not be installed at outdoor. Be sure to mount a strainer (more than 50 meshes) at the water inlet piping of the unit. Be sure to provide interlocking for the unit operation and water circuit. Install the supplied insulation material to the unused drain-socket. When installing insulation material around both water and refrigerant piping, follow the installation manual.		

Notes:		Unit converter
1.Nominal cooling conditions (Test conditions are based on AHRI 1230) Indoor: 81°F.D.B./66°F.W.B. (27°C.D.B./19°C.W.B.), Water temperature: 86°F (30°C)		BTU/h =kW x 3,412
2.Nominal heating conditions (Test conditions are based on AHRI 1230) Indoor: 68°F.D.B. (20°C.D.B.), Water temperature: 68°F (20°C)		cfm =m³/min x 35.31
		lbs =kg/0.4536
		*Above specification data is subject to rounding variation.

1. SPECIFICATIONS

U11 2nd

Heat Source Model			PQHY-P216YLMU-A		
Indoor Model			Non-Ducted		Ducted
Power source			3-phase 3-wire 460 V ±10% 60 Hz		
Cooling capacity (Nominal)	*1	BTU/h	216,000		
		kW	63.3		
	(460)	Power input	kW	19.23	
		Current input	A	26.8	
	(Rated)	BTU/h	206,000		
		kW	60.4		
	(460)	Power input	kW	17.72	16.10
		Current input	A	24.7	22.4
Temp. range of cooling	Indoor	W.B.	59~75°F (15~24°C)		
	Circulating water	°F	50~113°F (10~45°C)		
Heating capacity (Nominal)	*2	BTU/h	243,000		
		kW	71.2		
	(460)	Power input	kW	13.04	
		Current input	A	18.1	
	(Rated)	BTU/h	232,000		
		kW	68.0		
	(460)	Power input	kW	12.01	12.34
		Current input	A	16.7	17.2
Temp. range of heating	Indoor	D.B.	59~81°F (15~27°C)		
	Circulating water	°F	50~113°F (10~45°C)		
Indoor unit connectable	Total capacity	50~130% of heatsource unit capacity			
	Model/Quantity	P06~P96/2~46			
Sound pressure level (measured in anechoic room)		dB <A>	58.0		
Refrigerant piping diameter	Liquid pipe	in. (mm)	5/8 (15.88) Brazed		
	Gas pipe	in. (mm)	1-1/8 (28.58) Brazed		
Minimum Circuit Ampacity		A	31		
Maximum Overcurrent Protection		A	50		
Circulating water	Water flow rate	G/h	3,044		
		G/min	50.7		
		m³/h	11.52		
		L/min	192		
		cfm	6.8		
	Pressure drop	psi	6.53		
		kPa	45		
	Operating volume range	G/h	1,585 ~ 3,804		
		G/min	26.4 ~ 63.4		
		m³/h	6.0 ~ 14.4		
Compressor	Type x Quantity		Inverter scroll hermetic compressor x 1		
	Manufacture		AC&R Works, MITSUBISHI ELECTRIC CORPORATION		
	Starting method		Inverter		
	Motor output	kW	14.5		
	Case heater	kW	0.045 (240 V)		
	Lubricant		MEL32		
External finish		Galvanized steel sheets			
External dimension H x W x D		in.	57-1/8 x 34-11/16 x 21-11/16		
		mm	1,450 x 880 x 550		
Protection devices	High pressure protection		High pressure sensor, High pressure switch at 4.15 MPa (601 psi)		
	Inverter circuit		Over-heat protection, Over-current protection		
	Compressor		Over-heat protection		
Refrigerant	Type x original charge		R410A x 25 lbs + 13 oz (11.7 kg)		
	Control		LEV and HIC circuit		
Net weight		lbs (kg)	574 (260)		
Heat exchanger			plate type		
	Water volume in plate	G	2.64		
		l	10.0		
	Water pressure Max.	psi	290		
		MPa	2.0		
HIC circuit (HIC: Heat Inter-Changer)			Copper pipe, tube-in-tube structure		
Drawing	External		KJ94T134		
	Wiring		KE94C952		
Standard attachment	Document		Installation Manual		
	Accessory		Details refer to External Drw		
Optional parts			joint: CMY-Y102SS-G2, CMY-Y102LS-G2, CMY-Y202S-G2, CMY-Y302S-G2 Header: CMY-Y104/108/1010C-G		
Remarks			Details on foundation work, duct work, insulation work, electrical wiring, power source switch, and other items shall be referred to the Installation Manual. Due to continuing improvement, above specifications may be subject to change without notice. The ambient temperature of the Heat Source Unit needs to be kept below 104°F D.B. (40°C D.B.) The ambient relative humidity of the Heat Source Unit needs to be kept below 80%. The Heat Source Unit should not be installed at outdoor. Be sure to mount a strainer (more than 50 meshes) at the water inlet piping of the unit. Be sure to provide interlocking for the unit operation and water circuit. Install the supplied insulation material to the unused drain-socket. When installing insulation material around both water and refrigerant piping, follow the installation manual.		

Notes:		Unit converter
1.Nominal cooling conditions (Test conditions are based on AHRI 1230) Indoor: 81°F D.B./66°F W.B. (27°C D.B./19°C W.B.), Water temperature: 86°F (30°C)		BTU/h =kW x 3.412
2.Nominal heating conditions (Test conditions are based on AHRI 1230) Indoor: 68°F D.B. (20°C D.B.), Water temperature: 68°F (20°C)		cfm =m³/min x 35.31
		lbs =kg/0.4536
		*Above specification data is subject to rounding variation.

1. SPECIFICATIONS

U11 2nd

Heat Source Model			PQHY-P240YLMU-A		
Indoor Model			Non-Ducted	Ducted	
Power source			3-phase 3-wire 460 V ±10% 60 Hz		
Cooling capacity (Nominal)	*1	BTU/h	240,000		
		kW	70.3		
	(460)	Power input	21.14		
		Current input	29.4		
	(Rated)	BTU/h	228,000		
		kW	66.8		
	(460)	Power input	19.49	18.74	
		Current input	27.1	26.1	
Temp. range of cooling		Indoor	W.B. 59~75°F (15~24°C)		
		Circulating water	°F 50~113°F (10~45°C)		
Heating capacity (Nominal)	*2	BTU/h	270,000		
		kW	79.1		
	(460)	Power input	15.12		
		Current input	21.0		
	(Rated)	BTU/h	258,000		
		kW	75.6		
	(460)	Power input	13.93	14.62	
		Current input	19.4	20.3	
Temp. range of heating		Indoor	D.B. 59~81°F (15~27°C)		
		Circulating water	°F 50~113°F (10~45°C)		
Indoor unit connectable		Total capacity	50~130% of heatsource unit capacity		
		Model/Quantity	P06~P96/2~50		
Sound pressure level (measured in anechoic room)		dB <A>	58.0		
Refrigerant piping diameter		Liquid pipe	in. (mm) 5/8 (15.88) Brazed		
		Gas pipe	in. (mm) 1-1/8 (28.58) Brazed		
Minimum Circuit Ampacity		A	36		
Maximum Overcurrent Protection		A	60		
Circulating water	Water flow rate	G/h	3,044		
		G/min	50.7		
		m³/h	11.52		
		L/min	192		
		cfm	6.8		
	Pressure drop	psi	6.53		
		kPa	45		
	Operating volume range	G/h	1,585 ~ 3,804		
		G/min	26.4 ~ 63.4		
		m³/h	6.0 ~ 14.4		
Compressor	Type x Quantity		Inverter scroll hermetic compressor x 1		
	Manufacture		AC&R Works, MITSUBISHI ELECTRIC CORPORATION		
	Starting method		Inverter		
	Motor output	kW	16.1		
	Case heater	kW	0.045 (240 V)		
	Lubricant	MEL32			
External finish		Galvanized steel sheets			
External dimension H x W x D		in.	57-1/8 x 34-11/16 x 21-11/16		
		mm	1,450 x 880 x 550		
Protection devices	High pressure protection		High pressure sensor, High pressure switch at 4.15 MPa (601 psi)		
	Inverter circuit		Over-heat protection, Over-current protection		
	Compressor		Over-heat protection		
Refrigerant	Type x original charge		R410A x 25 lbs + 13 oz (11.7 kg)		
	Control		LEV and HIC circuit		
Net weight		lbs (kg)	574 (260)		
Heat exchanger			plate type		
			Water volume in plate	G	2.64
				l	10.0
			Water pressure Max.	psi	290
MPa	2.0				
HIC circuit (HIC: Heat Inter-Changer)			Copper pipe, tube-in-tube structure		
Drawing	External		KJ94T134		
	Wiring		KE94C952		
Standard attachment	Document		Installation Manual		
	Accessory		Details refer to External Drw		
Optional parts			joint: CMY-Y102SS-G2, CMY-Y102LS-G2, CMY-Y202S-G2, CMY-Y302S-G2 Header: CMY-Y104/108/1010C-G		
Remarks			Details on foundation work, duct work, insulation work, electrical wiring, power source switch, and other items shall be referred to the Installation Manual. Due to continuing improvement, above specifications may be subject to change without notice. The ambient temperature of the Heat Source Unit needs to be kept below 104°F.D.B. (40°C.D.B.) The ambient relative humidity of the Heat Source Unit needs to be kept below 80%. The Heat Source Unit should not be installed at outdoor. Be sure to mount a strainer (more than 50 meshes) at the water inlet piping of the unit. Be sure to provide interlocking for the unit operation and water circuit. Install the supplied insulation material to the unused drain-socket. When installing insulation material around both water and refrigerant piping, follow the installation manual.		

Notes:		Unit converter
1.Nominal cooling conditions (Test conditions are based on AHRI 1230) Indoor: 81°F.D.B./66°F.W.B. (27°C.D.B./19°C.W.B.), Water temperature: 86°F (30°C)		BTU/h =kW x 3,412
2.Nominal heating conditions (Test conditions are based on AHRI 1230) Indoor: 68°F.D.B. (20°C.D.B.), Water temperature: 68°F (20°C)		cfm =m³/min x 35.31
		lbs =kg/0.4536
		*Above specification data is subject to rounding variation.

1. SPECIFICATIONS

U11 2nd

Heat Source Model			PQHY-P144YSLMU-A		
Indoor Model			Non-Ducted		Ducted
Power source			3-phase 3-wire 460 V ±10% 60 Hz		
Cooling capacity (Nominal)		*1	BTU/h	144,000	
			kW	42.2	
(460)	(Rated)	Power input	kW	7.11	
		Current input	A	9.9	
(460)	(Rated)		BTU/h	137,000	
			kW	40.2	
(460)	(Rated)	Power input	kW	6.53	7.72
		Current input	A	9.1	10.7
Temp. range of cooling		Indoor	W.B.	59~75°F (15~24°C)	
		Circulating water	°F	50~113°F (10~45°C)	
Heating capacity (Nominal)		*2	BTU/h	160,000	
			kW	46.9	
(460)	(Rated)	Power input	kW	7.45	
		Current input	A	10.3	
(460)	(Rated)		BTU/h	152,000	
			kW	44.5	
(460)	(Rated)	Power input	kW	6.86	7.22
		Current input	A	9.5	10.0
Temp. range of heating		Indoor	D.B.	59~81°F (15~27°C)	
		Circulating water	°F	50~113°F (10~45°C)	
Indoor unit connectable		Total capacity		50~130% of heatsource unit capacity	
		Model/Quantity		P06~P96/1~31	
Sound pressure level (measured in anechoic room)			dB <A>	49.0	
Refrigerant piping diameter		Liquid pipe	in. (mm)	1/2 (12.7) Brazed	
		Gas pipe	in. (mm)	1-1/8 (28.58) Brazed	

Set Model				
Model			PQHY-P72YLMU-A	PQHY-P72YLMU-A
Minimum Circuit Ampacity		A	6	6
Maximum Overcurrent Protection		A	15	15
Circulating water	Water flow rate	G/h	1,522 + 1,522	
		G/min	25.4 + 25.4	
		m³/h	5.76 + 5.76	
		L/min	96 + 96	
		cfm	3.4 + 3.4	
	Pressure drop	psi	3.48	3.48
		kPa	24	24
	Operating volume range	G/h	793 + 793 ~ 1,902 + 1,902	
G/min		13.2 + 13.2 ~ 31.7 + 31.7		
m³/h		3.0 + 3.0 ~ 7.2 + 7.2		
Compressor	Type x Quantity		Inverter scroll hermetic compressor x 1	Inverter scroll hermetic compressor x 1
	Manufacture		AC&R Works, MITSUBISHI ELECTRIC CORPORATION	AC&R Works, MITSUBISHI ELECTRIC CORPORATION
	Starting method		Inverter	Inverter
	Motor output	kW	4.3	4.3
	Case heater	kW	-	-
	Lubricant		MEL32	MEL32
External finish		Galvanized steel sheets		Galvanized steel sheets
External dimension H x W x D		in.	43-5/16 x 34-11/16 x 21-11/16	43-5/16 x 34-11/16 x 21-11/16
		mm	1,100 x 880 x 550	1,100 x 880 x 550
Protection devices	High pressure protection		High pressure sensor, High pressure switch at 4.15 MPa (601 psi)	High pressure sensor, High pressure switch at 4.15 MPa (601 psi)
	Inverter circuit		Over-heat protection, Over-current protection	Over-heat protection, Over-current protection
	Compressor		Over-heat protection	Over-heat protection
Refrigerant	Type x original charge		R410A x 11 lbs + 1 oz (5.0 kg)	R410A x 11 lbs + 1 oz (5.0 kg)
	Control		LEV and HIC circuit	
Net weight		lbs (kg)	408 (185)	408 (185)
Heat exchanger			plate type	plate type
	Water volume in plate	G	1.32	1.32
		l	5.0	5.0
	Water pressure Max.	psi	290	290
		MPa	2.0	2.0
HIC circuit (HIC: Heat Inter-Changer)			Copper pipe, tube-in-tube structure	Copper pipe, tube-in-tube structure
Pipe between unit and distributor	Liquid pipe	in. (mm)	3/8 (9.52) Brazed	3/8 (9.52) Brazed
	Gas pipe	in. (mm)	3/4 (19.05) Brazed	3/4 (19.05) Brazed
Drawing	External		KJ94T158	
	Wiring		KE94C952	KE94C952
Standard attachment	Document		Installation Manual	
	Accessory		Details refer to External Drw	
Optional parts			Heat Source Twinning kit: CMY-Y100CBK3 joint: CMY-Y102SS-G2, CMY-Y102LS-G2, CMY-Y202S-G2 Header: CMY-Y104/108/1010C-G	
Remarks			Details on foundation work, duct work, insulation work, electrical wiring, power source switch, and other items shall be referred to the Installation Manual. Due to continuing improvement, above specifications may be subject to change without notice. The ambient temperature of the Heat Source Unit needs to be kept below 104°F.D.B. (40°C.D.B.) The ambient relative humidity of the Heat Source Unit needs to be kept below 80%. The Heat Source Unit should not be installed at outdoor. Be sure to mount a strainer (more than 50 meshes) at the water inlet piping of the unit. Be sure to provide interlocking for the unit operation and water circuit. Install the supplied insulation material to the unused drain-socket. When installing insulation material around both water and refrigerant piping, follow the installation manual.	

Notes:		Unit converter
1.Nominal cooling conditions (Test conditions are based on AHRI 1230) Indoor: 81°F.D.B./66°F.W.B. (27°C.D.B./19°C.W.B.), Water temperature: 86°F (30°C)		BTU/h =kW x 3,412
2.Nominal heating conditions (Test conditions are based on AHRI 1230) Indoor: 68°F.D.B. (20°C.D.B.), Water temperature: 68°F (20°C)		cfm =m³/min x 35.31
		lbs =kg/0.4536
		*Above specification data is subject to rounding variation.

1. SPECIFICATIONS

U11 2nd

Heat Source Model			PQHY-P168YSLMU-A	
Indoor Model			Non-Ducted	Ducted
Power source			3-phase 3-wire 460 V ±10% 60 Hz	
Cooling capacity (Nominal)	*1	BTU/h	168,000	
		kW	49.2	
		Power input kW	9.33	
		Current input A	13.0	
	(Rated)	BTU/h	161,000	
		kW	47.2	
		Power input kW	8.58	9.22
		Current input A	11.9	12.8
Temp. range of cooling	Indoor	W.B.	59~75°F (15~24°C)	
	Circulating water	°F	50~113°F (10~45°C)	
Heating capacity (Nominal)	*2	BTU/h	188,000	
		kW	55.1	
		Power input kW	9.34	
		Current input A	13.0	
	(Rated)	BTU/h	179,000	
		kW	52.5	
		Power input kW	8.60	8.03
		Current input A	11.9	11.1
Temp. range of heating	Indoor	D.B.	59~81°F (15~27°C)	
	Circulating water	°F	50~113°F (10~45°C)	
Indoor unit connectable	Total capacity		50~130% of heatsource unit capacity	
	Model/Quantity		P06~P96/1~36	
Sound pressure level (measured in anechoic room)		dB <A>	50.0	
Refrigerant piping diameter	Liquid pipe	in. (mm)	5/8 (15.88) Braze	
	Gas pipe	in. (mm)	1-1/8 (28.58) Braze	

Set Model				
Model			PQHY-P96YLMU-A	
Minimum Circuit Ampacity			9	
Maximum Overcurrent Protection			15	
Circulating water	Water flow rate	G/h	1,522 + 1,522	
		G/min	25.4 + 25.4	
		m³/h	5.76 + 5.76	
		L/min	96 + 96	
		cfm	3.4 + 3.4	
	Pressure drop	psi	3.48	
		kPa	24	
	Operating volume range	G/h	793 + 793 ~ 1,902 + 1,902	
		G/min	13.2 + 13.2 ~ 31.7 + 31.7	
m³/h		3.0 + 3.0 ~ 7.2 + 7.2		
Compressor	Type x Quantity		Inverter scroll hermetic compressor x 1	
	Manufacture		AC&R Works, MITSUBISHI ELECTRIC CORPORATION	
	Starting method		Inverter	
	Motor output	kW	6.0	
	Case heater	kW	-	
	Lubricant		MEL32	
External finish			Galvanized steel sheets	
External dimension H x W x D		in.	43-5/16 x 34-11/16 x 21-11/16	
		mm	1,100 x 880 x 550	
Protection devices	High pressure protection		High pressure sensor, High pressure switch at 4.15 MPa (601 psi)	
	Inverter circuit		Over-heat protection, Over-current protection	
	Compressor		Over-heat protection	
Refrigerant	Type x original charge		R410A x 11 lbs + 1 oz (5.0 kg)	
	Control		LEV and HIC circuit	
Net weight		lbs (kg)	408 (185)	
Heat exchanger			plate type	
	Water volume in plate	G	1.32	
		l	5.0	
	Water pressure Max.	psi	290	
		MPa	2.0	
HIC circuit (HIC: Heat Inter-Changer)			Copper pipe, tube-in-tube structure	
Pipe between unit and distributor	Liquid pipe	in. (mm)	3/8 (9.52) Brazed	
	Gas pipe	in. (mm)	7/8 (22.2) Brazed	
Drawing	External		KJ94T158	
	Wiring		KE94C952	
Standard attachment	Document		Installation Manual	
	Accessory		Details refer to External Drw	
Optional parts			Heat Source Twinning kit: CMY-Y100CBK3 joint: CMY-Y102SS-G2, CMY-Y102LS-G2, CMY-Y202S-G2 Header: CMY-Y104/108/1010C-G	
Remarks			Details on foundation work, duct work, insulation work, electrical wiring, power source switch, and other items shall be referred to the Installation Manual. Due to continuing improvement, above specifications may be subject to change without notice. The ambient temperature of the Heat Source Unit needs to be kept below 104°F.D.B. (40°C.D.B.) The ambient relative humidity of the Heat Source Unit needs to be kept below 80%. The Heat Source Unit should not be installed at outdoor. Be sure to mount a strainer (more than 50 meshes) at the water inlet piping of the unit. Be sure to provide interlocking for the unit operation and water circuit. Install the supplied insulation material to the unused drain-socket. When installing insulation material around both water and refrigerant piping, follow the installation manual.	

Notes:		Unit converter
1.Nominal cooling conditions (Test conditions are based on AHRI 1230) Indoor: 81°F.D.B./66°F.W.B. (27°C.D.B./19°C.W.B.), Water temperature: 86°F (30°C)		BTU/h =kW x 3.412
2.Nominal heating conditions (Test conditions are based on AHRI 1230) Indoor: 68°F.D.B. (20°C.D.B.), Water temperature: 68°F (20°C)		cfm =m³/min x 35.31
		lbs =kg/0.4536
		*Above specification data is subject to rounding variation.

1. SPECIFICATIONS

U11 2nd

Heat Source Model			PQHY-P192YSLMU-A	
Indoor Model			Non-Ducted	Ducted
Power source			3-phase 3-wire 460 V ±10% 60 Hz	
Cooling capacity (Nominal)	*1	BTU/h	192,000	
		kW	56.3	
		Power input	11.30	
		Current input	15.7	
	(Rated)	BTU/h	183,000	
		kW	53.6	
		Power input	10.40	10.98
		Current input	14.5	15.3
Temp. range of cooling	Indoor	W.B.	59~75°F (15~24°C)	
	Circulating water	°F	50~113°F (10~45°C)	
Heating capacity (Nominal)	*2	BTU/h	215,000	
		kW	63.0	
		Power input	11.02	
		Current input	15.3	
	(Rated)	BTU/h	205,000	
		kW	60.1	
		Power input	10.16	8.90
		Current input	14.1	12.4
Temp. range of heating	Indoor	D.B.	59~81°F (15~27°C)	
	Circulating water	°F	50~113°F (10~45°C)	
Indoor unit connectable	Total capacity		50~130% of heatsource unit capacity	
	Model/Quantity		P06~P96/1~41	
Sound pressure level (measured in anechoic room)		dB <A>	51.0	
Refrigerant piping diameter	Liquid pipe	in. (mm)	5/8 (15.88) Brazed	
	Gas pipe	in. (mm)	1-1/8 (28.58) Brazed	

Set Model				
Model			PQHY-P96YLMU-A	PQHY-P96YLMU-A
Minimum Circuit Ampacity		A	9	9
Maximum Overcurrent Protection		A	15	15
Circulating water	Water flow rate	G/h	1,522 + 1,522	
		G/min	25.4 + 25.4	
		m³/h	5.76 + 5.76	
		L/min	96 + 96	
		cfm	3.4 + 3.4	
	Pressure drop	psi	3.48	3.48
		kPa	24	24
	Operating volume range	G/h	793 + 793 ~ 1,902 + 1,902	
		G/min	13.2 + 13.2 ~ 31.7 + 31.7	
m³/h		3.0 + 3.0 ~ 7.2 + 7.2		
Compressor	Type x Quantity		Inverter scroll hermetic compressor x 1	Inverter scroll hermetic compressor x 1
	Manufacture		AC&R Works, MITSUBISHI ELECTRIC CORPORATION	AC&R Works, MITSUBISHI ELECTRIC CORPORATION
	Starting method		Inverter	Inverter
	Motor output	kW	6.0	6.0
	Case heater	kW	-	-
	Lubricant		MEL32	MEL32
External finish		Galvanized steel sheets		Galvanized steel sheets
External dimension H x W x D		in.	43-5/16 x 34-11/16 x 21-11/16	43-5/16 x 34-11/16 x 21-11/16
		mm	1,100 x 880 x 550	1,100 x 880 x 550
Protection devices	High pressure protection		High pressure sensor, High pressure switch at 4.15 MPa (601 psi)	High pressure sensor, High pressure switch at 4.15 MPa (601 psi)
	Inverter circuit		Over-heat protection, Over-current protection	Over-heat protection, Over-current protection
	Compressor		Over-heat protection	Over-heat protection
Refrigerant	Type x original charge		R410A x 11 lbs + 1 oz (5.0 kg)	R410A x 11 lbs + 1 oz (5.0 kg)
	Control		LEV and HIC circuit	
Net weight		lbs (kg)	408 (185)	408 (185)
Heat exchanger	Water volume in plate		plate type	plate type
			G	1.32
	I	5.0	5.0	
	Water pressure Max.	psi	290	290
		MPa	2.0	2.0
HIC circuit (HIC: Heat Inter-Changer)			Copper pipe, tube-in-tube structure	Copper pipe, tube-in-tube structure
Pipe between unit and distributor	Liquid pipe	in. (mm)	3/8 (9.52) Brazed	3/8 (9.52) Brazed
	Gas pipe	in. (mm)	7/8 (22.2) Brazed	7/8 (22.2) Brazed
Drawing	External		KJ94T158	
	Wiring		KE94C952	KE94C952
Standard attachment	Document		Installation Manual	
	Accessory		Details refer to External Drw	
Optional parts			Heat Source Twinning kit: CMY-Y100CBK3 joint: CMY-Y102SS-G2, CMY-Y102LS-G2, CMY-Y202S-G2, CMY-Y302S-G2 Header: CMY-Y104/108/1010C-G	
Remarks			Details on foundation work, duct work, insulation work, electrical wiring, power source switch, and other items shall be referred to the Installation Manual. Due to continuing improvement, above specifications may be subject to change without notice. The ambient temperature of the Heat Source Unit needs to be kept below 104°F.D.B. (40°C.D.B.) The ambient relative humidity of the Heat Source Unit needs to be kept below 80%. The Heat Source Unit should not be installed at outdoor. Be sure to mount a strainer (more than 50 meshes) at the water inlet piping of the unit. Be sure to provide interlocking for the unit operation and water circuit. Install the supplied insulation material to the unused drain-socket. When installing insulation material around both water and refrigerant piping, follow the installation manual.	

Notes:		Unit converter
1.Nominal cooling conditions (Test conditions are based on AHRI 1230) Indoor: 81°F.D.B./66°F.W.B. (27°C.D.B./19°C.W.B.), Water temperature: 86°F (30°C)		BTU/h =kW x 3.412
2.Nominal heating conditions (Test conditions are based on AHRI 1230) Indoor: 68°F.D.B. (20°C.D.B.), Water temperature: 68°F (20°C)		cfm =m³/min x 35.31
		lbs =kg/0.4536
		*Above specification data is subject to rounding variation.

1. SPECIFICATIONS

U11 2nd

Heat Source Model			PQHY-P216YSLMU-A			
Indoor Model			Non-Ducted		Ducted	
Power source			3-phase 3-wire 460 V ±10% 60 Hz			
Cooling capacity (Nominal)	*1	BTU/h	216,000			
		kW	63.3			
		Power input	kW	14.03		
		(460) Current input	A	19.5		
	(Rated)	BTU/h	206,000			
		kW	60.4			
		Power input	kW	12.93	13.24	
		(460) Current input	A	18.0	18.4	
Temp. range of cooling	Indoor	W.B.	59~75°F (15~24°C)			
	Circulating water	°F	50~113°F (10~45°C)			
Heating capacity (Nominal)	*2	BTU/h	243,000			
		kW	71.2			
		Power input	kW	12.88		
		(460) Current input	A	17.9		
	(Rated)	BTU/h	232,000			
		kW	68.0			
		Power input	kW	11.88	10.35	
		(460) Current input	A	16.5	14.4	
Temp. range of heating	Indoor	D.B.	59~81°F (15~27°C)			
	Circulating water	°F	50~113°F (10~45°C)			
Indoor unit connectable	Total capacity		50~130% of heatsource unit capacity			
	Model/Quantity		P06~P96/2~46			
Sound pressure level (measured in anechoic room)			dB <A>	55.0		
Refrigerant piping diameter	Liquid pipe	in. (mm)	5/8 (15.88) Brazed			
	Gas pipe	in. (mm)	1-1/8 (28.58) Brazed			
Set Model						
Model			PQHY-P120YLMU-A		PQHY-P96YLMU-A	
Minimum Circuit Ampacity			A	13	9	
Maximum Overcurrent Protection			A	20	15	
Circulating water	Water flow rate	G/h	1,522 + 1,522			
		G/min	25.4 + 25.4			
		m³/h	5.76 + 5.76			
		L/min	96 + 96			
		cfm	3.4 + 3.4			
	Pressure drop	psi	3.48	3.48		
		kPa	24	24		
	Operating volume range	G/h	793 + 793 ~ 1,902 + 1,902			
		G/min	13.2 + 13.2 ~ 31.7 + 31.7			
		m³/h	3.0 + 3.0 ~ 7.2 + 7.2			
Compressor	Type x Quantity		Inverter scroll hermetic compressor x 1		Inverter scroll hermetic compressor x 1	
	Manufacture		AC&R Works, MITSUBISHI ELECTRIC CORPORATION		AC&R Works, MITSUBISHI ELECTRIC CORPORATION	
	Starting method		Inverter		Inverter	
	Motor output	kW	7.7		6.0	
	Case heater	kW	-		-	
	Lubricant		MEL32		MEL32	
External finish			Galvanized steel sheets		Galvanized steel sheets	
External dimension H x W x D		in.	43-5/16 x 34-11/16 x 21-11/16		43-5/16 x 34-11/16 x 21-11/16	
		mm	1,100 x 880 x 550		1,100 x 880 x 550	
Protection devices	High pressure protection		High pressure sensor, High pressure switch at 4.15 MPa (601 psi)		High pressure sensor, High pressure switch at 4.15 MPa (601 psi)	
	Inverter circuit		Over-heat protection, Over-current protection		Over-heat protection, Over-current protection	
	Compressor		Over-heat protection		Over-heat protection	
Refrigerant	Type x original charge		R410A x 11 lbs + 1 oz (5.0 kg)		R410A x 11 lbs + 1 oz (5.0 kg)	
	Control		LEV and HIC circuit			
Net weight		lbs (kg)	408 (185)		408 (185)	
Heat exchanger	Water volume in plate		plate type	plate type		
			G	1.32		
	I	5.0				
	Water pressure Max.	psi	290			
		MPa	2.0			
HIC circuit (HIC: Heat Inter-Changer)			Copper pipe, tube-in-tube structure		Copper pipe, tube-in-tube structure	
Pipe between unit and distributor	Liquid pipe	in. (mm)	1/2 (12.7) Brazed		1/2 (12.7) Brazed	
	Gas pipe	in. (mm)	7/8 (22.2) Brazed		7/8 (22.2) Brazed	
Drawing	External		KJ94T158			
	Wiring		KE94C952		KE94C952	
Standard attachment	Document		Installation Manual			
	Accessory		Details refer to External Drw			
Optional parts			Heat Source Twinning kit: CMY-Y100CBK3 joint: CMY-Y102SS-G2, CMY-Y102LS-G2, CMY-Y202S-G2, CMY-Y302S-G2 Header: CMY-Y104/108/1010C-G			
Remarks			Details on foundation work, duct work, insulation work, electrical wiring, power source switch, and other items shall be referred to the Installation Manual. Due to continuing improvement, above specifications may be subject to change without notice. The ambient temperature of the Heat Source Unit needs to be kept below 104°F.D.B. (40°C.D.B.) The ambient relative humidity of the Heat Source Unit needs to be kept below 80%. The Heat Source Unit should not be installed at outdoor. Be sure to mount a strainer (more than 50 meshes) at the water inlet piping of the unit. Be sure to provide interlocking for the unit operation and water circuit. Install the supplied insulation material to the unused drain-socket. When installing insulation material around both water and refrigerant piping, follow the installation manual.			

Notes:	Unit converter
1.Nominal cooling conditions (Test conditions are based on AHRI 1230) Indoor: 81°F.D.B./66°F.W.B. (27°C.D.B./19°C.W.B.), Water temperature: 86°F (30°C)	BTU/h =kW x 3,412
2.Nominal heating conditions (Test conditions are based on AHRI 1230) Indoor: 68°F.D.B. (20°C.D.B.), Water temperature: 68°F (20°C)	cfm =m³/min x 35.31
	lbs =kg/0.4536
	*Above specification data is subject to rounding variation.

1. SPECIFICATIONS

U11 2nd

Heat Source Model			PQHY-P240YSLMU-A	
Indoor Model			Non-Ducted	Ducted
Power source			3-phase 3-wire 460 V ±10% 60 Hz	
Cooling capacity (Nominal)	*1	BTU/h	240,000	
		kW	70.3	
		Power input	16.89	
		(460) Current input	23.5	
	(Rated)	BTU/h	228,000	
		kW	66.8	
		Power input	15.57	16.15
		(460) Current input	21.7	22.5
Temp. range of cooling	Indoor	W.B.	59~75°F (15~24°C)	
	Circulating water	°F	50~113°F (10~45°C)	
Heating capacity (Nominal)	*2	BTU/h	270,000	
		kW	79.1	
		Power input	14.58	
		(460) Current input	20.3	
	(Rated)	BTU/h	258,000	
		kW	75.6	
		Power input	13.45	12.02
		(460) Current input	18.7	16.7
Temp. range of heating	Indoor	D.B.	59~81°F (15~27°C)	
	Circulating water	°F	50~113°F (10~45°C)	
Indoor unit connectable	Total capacity		50~130% of heatsource unit capacity	
	Model/Quantity		P06~P96/2~50	
Sound pressure level (measured in anechoic room)		dB <A>	57.0	
Refrigerant piping diameter	Liquid pipe	in. (mm)	5/8 (15.88) Brazed	
	Gas pipe	in. (mm)	1-1/8 (28.58) Brazed	

Set Model				
Model			PQHY-P120YLMU-A	
Minimum Circuit Ampacity		A	13	13
Maximum Overcurrent Protection		A	20	20
Circulating water	Water flow rate	G/h	1,522 + 1,522	
		G/min	25.4 + 25.4	
		m³/h	5.76 + 5.76	
		L/min	96 + 96	
		cfm	3.4 + 3.4	
	Pressure drop	psi	3.48	3.48
		kPa	24	24
	Operating volume range	G/h	793 + 793 ~ 1,902 + 1,902	
		G/min	13.2 + 13.2 ~ 31.7 + 31.7	
m³/h		3.0 + 3.0 ~ 7.2 + 7.2		
Compressor	Type x Quantity		Inverter scroll hermetic compressor x 1	Inverter scroll hermetic compressor x 1
	Manufacture		AC&R Works, MITSUBISHI ELECTRIC CORPORATION	AC&R Works, MITSUBISHI ELECTRIC CORPORATION
	Starting method		Inverter	Inverter
	Motor output	kW	7.7	7.7
	Case heater	kW	-	-
	Lubricant		MEL32	MEL32
External finish		Galvanized steel sheets		
External dimension H x W x D		in.	43-5/16 x 34-11/16 x 21-11/16	43-5/16 x 34-11/16 x 21-11/16
		mm	1,100 x 880 x 550	1,100 x 880 x 550
Protection devices	High pressure protection		High pressure sensor, High pressure switch at 4.15 MPa (601 psi)	High pressure sensor, High pressure switch at 4.15 MPa (601 psi)
	Inverter circuit		Over-heat protection, Over-current protection	Over-heat protection, Over-current protection
	Compressor		Over-heat protection	Over-heat protection
Refrigerant	Type x original charge		R410A x 11 lbs + 1 oz (5.0 kg)	R410A x 11 lbs + 1 oz (5.0 kg)
	Control		LEV and HIC circuit	
Net weight		lbs (kg)	408 (185)	408 (185)
Heat exchanger			plate type	plate type
	Water volume in plate	G	1.32	1.32
		l	5.0	5.0
	Water pressure Max.	psi	290	290
		MPa	2.0	2.0
HIC circuit (HIC: Heat Inter-Changer)		Copper pipe, tube-in-tube structure		
Pipe between unit and distributor	Liquid pipe	in. (mm)	1/2 (12.7) Brazed	1/2 (12.7) Brazed
	Gas pipe	in. (mm)	7/8 (22.2) Brazed	7/8 (22.2) Brazed
Drawing	External		KJ94T158	
	Wiring		KE94C952	KE94C952
Standard attachment	Document		Installation Manual	
	Accessory		Details refer to External Drw	
Optional parts		Heat Source Twinning kit: CMY-Y100CBK3 joint: CMY-Y102SS-G2, CMY-Y102LS-G2, CMY-Y202S-G2, CMY-Y302S-G2 Header: CMY-Y104/108/1010C-G		
Remarks		Details on foundation work, duct work, insulation work, electrical wiring, power source switch, and other items shall be referred to the Installation Manual. Due to continuing improvement, above specifications may be subject to change without notice. The ambient temperature of the Heat Source Unit needs to be kept below 104°F D.B. (40°C D.B.) The ambient relative humidity of the Heat Source Unit needs to be kept below 80%. The Heat Source Unit should not be installed at outdoor. Be sure to mount a strainer (more than 50 meshes) at the water inlet piping of the unit. Be sure to provide interlocking for the unit operation and water circuit. Install the supplied insulation material to the unused drain-socket. When installing insulation material around both water and refrigerant piping, follow the installation manual.		

Notes:	Unit converter
1.Nominal cooling conditions (Test conditions are based on AHRI 1230) Indoor: 81°F D.B./66°F W.B. (27°C D.B./19°C W.B.), Water temperature: 86°F (30°C)	BTU/h =kW x 3.412
2.Nominal heating conditions (Test conditions are based on AHRI 1230) Indoor: 68°F D.B. (20°C D.B.), Water temperature: 68°F (20°C)	cfm =m ³ /min x 35.31
	lbs =kg/0.4536
	*Above specification data is subject to rounding variation.

1. SPECIFICATIONS

U11 2nd

Heat Source Model			PQHY-P288YSLMU-A	
Indoor Model			Non-Ducted	Ducted
Power source			3-phase 3-wire 460 V ±10% 60 Hz	
Cooling capacity (Nominal)	(460)	*1 BTU/h	288,000	
		kW	84.4	
		Power input kW	20.42	
		Current input A	28.4	
	(Rated)	BTU/h	275,000	
		kW	80.6	
		Power input kW	18.82	21.43
		Current input A	26.2	29.8
Temp. range of cooling	Indoor	W.B.		
	Circulating water	°F		
Heating capacity (Nominal)	(460)	*2 BTU/h	323,000	
		kW	94.7	
		Power input kW	17.50	
		Current input A	24.4	
	(Rated)	BTU/h	308,000	
		kW	90.3	
		Power input kW	16.13	16.05
		Current input A	22.4	22.3
Temp. range of heating	Indoor	D.B.		
	Circulating water	°F		
Indoor unit connectable	Total capacity		50~130% of heatsource unit capacity	
	Model/Quantity		P06~P96/2~50	
Sound pressure level (measured in anechoic room)			dB <A>	
			57.0	
Refrigerant piping diameter	Liquid pipe	in. (mm)	3/4 (19.05) Brazed	
	Gas pipe	in. (mm)	1-3/8 (34.93) Brazed	

Set Model			PQHY-P144YLMU-A	PQHY-P144YLMU-A
Model			PQHY-P144YLMU-A	PQHY-P144YLMU-A
Minimum Circuit Ampacity		A	16	16
Maximum Overcurrent Protection		A	25	25
Circulating water	Water flow rate	G/h	1,902 + 1,902	
		G/min	31.7 + 31.7	
		m³/h	7.20 + 7.20	
		L/min	120 + 120	
		cfm	4.2 + 4.2	
	Pressure drop	psi	6.38	6.38
		kPa	44	44
	Operating volume range	G/h	1,189 + 1,189 ~ 3,054 + 3,054	
G/min		19.8 + 19.8 ~ 50.9 + 50.9		
m³/h		4.5 + 4.5 ~ 11.6 + 11.6		
Compressor	Type x Quantity		Inverter scroll hermetic compressor x 1	Inverter scroll hermetic compressor x 1
	Manufacture		AC&R Works, MITSUBISHI ELECTRIC CORPORATION	AC&R Works, MITSUBISHI ELECTRIC CORPORATION
	Starting method		Inverter	Inverter
	Motor output	kW	9.5	9.5
	Case heater	kW	-	-
	Lubricant		MEL32	MEL32
External finish			Galvanized steel sheets	Galvanized steel sheets
External dimension H x W x D		in.	57-1/8 x 34-11/16 x 21-11/16	57-1/8 x 34-11/16 x 21-11/16
		mm	1,450 x 880 x 550	1,450 x 880 x 550
Protection devices	High pressure protection		High pressure sensor, High pressure switch at 4.15 MPa (601 psi)	High pressure sensor, High pressure switch at 4.15 MPa (601 psi)
	Inverter circuit		Over-heat protection, Over-current protection	Over-heat protection, Over-current protection
	Compressor		Over-heat protection	Over-heat protection
Refrigerant	Type x original charge		R410A x 13 lbs + 4 oz (6.0 kg)	R410A x 13 lbs + 4 oz (6.0 kg)
	Control		LEV and HIC circuit	
Net weight		lbs (kg)	508 (230)	508 (230)
Heat exchanger			plate type	plate type
			G	1.32
	I	5.0		
	Water pressure Max.	psi	290	
		MPa	2.0	
HIC circuit (HIC: Heat Inter-Changer)			Copper pipe, tube-in-tube structure	Copper pipe, tube-in-tube structure
Pipe between unit and distributor	Liquid pipe	in. (mm)	1/2 (12.7) Brazed	1/2 (12.7) Brazed
	Gas pipe	in. (mm)	1-1/8 (28.58) Brazed	1-1/8 (28.58) Brazed
Drawing	External		KJ94T160	
	Wiring		KE94C952	KE94C952
Standard attachment	Document		Installation Manual	
	Accessory		Details refer to External Drw	
Optional parts			Heat Source Twinning kit: CMY-Y200CBK2 joint: CMY-Y102SS-G2, CMY-Y102LS-G2, CMY-Y202S-G2, CMY-Y302S-G2 Header: CMY-Y104/108/1010C-G	
Remarks			Details on foundation work, duct work, insulation work, electrical wiring, power source switch, and other items shall be referred to the Installation Manual. Due to continuing improvement, above specifications may be subject to change without notice. The ambient temperature of the Heat Source Unit needs to be kept below 104°F.D.B. (40°C.D.B.) The ambient relative humidity of the Heat Source Unit needs to be kept below 80%. The Heat Source Unit should not be installed at outdoor. Be sure to mount a strainer (more than 50 meshes) at the water inlet piping of the unit. Be sure to provide interlocking for the unit operation and water circuit. Install the supplied insulation material to the unused drain-socket. When installing insulation material around both water and refrigerant piping, follow the installation manual.	

Notes:		Unit converter
1.Nominal cooling conditions (Test conditions are based on AHRI 1230) Indoor: 81°F.D.B./66°F.W.B. (27°C.D.B./19°C.W.B.), Water temperature: 86°F (30°C)		BTU/h =kW x 3.412
2.Nominal heating conditions (Test conditions are based on AHRI 1230) Indoor: 68°F.D.B. (20°C.D.B.), Water temperature: 68°F (20°C)		cfm =m³/min x 35.31
		lbs =kg/0.4536
		*Above specification data is subject to rounding variation.

1. SPECIFICATIONS

U11 2nd

Heat Source Model			PQHY-P312YSLMU-A	
Indoor Model			Non-Ducted	Ducted
Power source			3-phase 3-wire 460 V ±10% 60 Hz	
Cooling capacity (Nominal)	*1	BTU/h	312,000	
		kW	91.4	
		Power input	23.41	
		Current input	32.6	
	(460)	BTU/h	297,000	
		kW	87.0	
		Power input	21.59	23.67
		Current input	30.1	33.0
Temp. range of cooling	Indoor	W.B.	59~75°F (15~24°C)	
	Circulating water	°F	50~113°F (10~45°C)	
Heating capacity (Nominal)	*2	BTU/h	350,000	
		kW	102.6	
		Power input	19.11	
		Current input	26.6	
	(460)	BTU/h	334,000	
		kW	97.9	
		Power input	17.62	17.96
		Current input	24.5	25.0
Temp. range of heating	Indoor	D.B.	59~81°F (15~27°C)	
	Circulating water	°F	50~113°F (10~45°C)	
Indoor unit connectable	Total capacity		50~130% of heatsource unit capacity	
	Model/Quantity		P06~P96/2~50	
Sound pressure level (measured in anechoic room)		dB <A>	58.0	
Refrigerant piping diameter	Liquid pipe	in. (mm)	3/4 (19.05) Brazed	
	Gas pipe	in. (mm)	1-3/8 (34.93) Brazed	

Set Model				
Model			PQHY-P168YLMU-A	PQHY-P144YLMU-A
Minimum Circuit Ampacity		A	20	16
Maximum Overcurrent Protection		A	35	25
Circulating water	Water flow rate	G/h	1,902 + 1,902	
		G/min	31.7 + 31.7	
		m³/h	7.20 + 7.20	
		L/min	120 + 120	
		cfm	4.2 + 4.2	
	Pressure drop	psi	6.38	6.38
		kPa	44	44
	Operating volume range	G/h	1,189 + 1,189 ~ 3,054 + 3,054	
		G/min	19.8 + 19.8 ~ 50.9 + 50.9	
		m³/h	4.5 + 4.5 ~ 11.6 + 11.6	
Compressor	Type x Quantity		Inverter scroll hermetic compressor x 1	Inverter scroll hermetic compressor x 1
	Manufacture		AC&R Works, MITSUBISHI ELECTRIC CORPORATION	AC&R Works, MITSUBISHI ELECTRIC CORPORATION
	Starting method		Inverter	Inverter
	Motor output	kW	11.0	9.5
	Case heater	kW	-	-
	Lubricant		MEL32	MEL32
External finish		Galvanized steel sheets		Galvanized steel sheets
External dimension H x W x D		in.	57-1/8 x 34-11/16 x 21-11/16	57-1/8 x 34-11/16 x 21-11/16
		mm	1,450 x 880 x 550	1,450 x 880 x 550
Protection devices	High pressure protection		High pressure sensor, High pressure switch at 4.15 MPa (601 psi)	High pressure sensor, High pressure switch at 4.15 MPa (601 psi)
	Inverter circuit		Over-heat protection, Over-current protection	Over-heat protection, Over-current protection
	Compressor		Over-heat protection	Over-heat protection
Refrigerant	Type x original charge		R410A x 13 lbs + 4 oz (6.0 kg)	R410A x 13 lbs + 4 oz (6.0 kg)
	Control		LEV and HIC circuit	
Net weight		lbs (kg)	508 (230)	508 (230)
Heat exchanger	Water volume in plate		plate type	plate type
			G	1.32
	I	5.0	5.0	
	Water pressure Max.	psi	290	290
		MPa	2.0	2.0
HIC circuit (HIC: Heat Inter-Changer)			Copper pipe, tube-in-tube structure	Copper pipe, tube-in-tube structure
Pipe between unit and distributor	Liquid pipe	in. (mm)	5/8 (15.88) Brazed	5/8 (15.88) Brazed
	Gas pipe	in. (mm)	1-1/8 (28.58) Brazed	1-1/8 (28.58) Brazed
Drawing	External		KJ94T160	
	Wiring		KE94C952	KE94C952
Standard attachment	Document		Installation Manual	
	Accessory		Details refer to External Drw	
Optional parts			Heat Source Twinning kit: CMY-Y200CBK2 joint: CMY-Y102SS-G2, CMY-Y102LS-G2, CMY-Y202S-G2, CMY-Y302S-G2 Header: CMY-Y104/108/1010C-G	
Remarks			Details on foundation work, duct work, insulation work, electrical wiring, power source switch, and other items shall be referred to the Installation Manual. Due to continuing improvement, above specifications may be subject to change without notice. The ambient temperature of the Heat Source Unit needs to be kept below 104°F.D.B. (40°C.D.B.) The ambient relative humidity of the Heat Source Unit needs to be kept below 80%. The Heat Source Unit should not be installed at outdoor. Be sure to mount a strainer (more than 50 meshes) at the water inlet piping of the unit. Be sure to provide interlocking for the unit operation and water circuit. Install the supplied insulation material to the unused drain-socket. When installing insulation material around both water and refrigerant piping, follow the installation manual.	

Notes:	Unit converter
1.Nominal cooling conditions (Test conditions are based on AHRI 1230) Indoor: 81°F.D.B./66°F.W.B. (27°C.D.B./19°C.W.B.), Water temperature: 86°F (30°C)	BTU/h =kW x 3.412
2.Nominal heating conditions (Test conditions are based on AHRI 1230) Indoor: 68°F.D.B. (20°C.D.B.), Water temperature: 68°F (20°C)	cfm =m³/min x 35.31
	lbs =kg/0.4536
	*Above specification data is subject to rounding variation.

1. SPECIFICATIONS

U11 2nd

Heat Source Model			PQHY-P336YSLMU-A				
Indoor Model			Non-Ducted	Ducted			
Power source			3-phase 3-wire 460 V ±10% 60 Hz				
Cooling capacity (Nominal)		*1	BTU/h	336,000			
			kW	98.5			
		(460)	Power input	kW	26.84		
			Current input	A	37.4		
			(Rated)		BTU/h	320,000	
					kW	93.8	
		(460)		Power input	kW	24.76	25.85
				Current input	A	34.5	36.0
Temp. range of cooling			Indoor	W.B.	59~75°F (15~24°C)		
			Circulating water	°F	50~113°F (10~45°C)		
Heating capacity (Nominal)		*2	BTU/h	378,000			
			kW	110.8			
		(460)	Power input	kW	20.77		
			Current input	A	28.9		
			(Rated)		BTU/h	361,000	
					kW	105.8	
		(460)		Power input	kW	19.16	20.05
				Current input	A	26.7	27.9
Temp. range of heating			Indoor	D.B.	59~81°F (15~27°C)		
			Circulating water	°F	50~113°F (10~45°C)		
Indoor unit connectable		Total capacity		50~130% of heatsource unit capacity			
		Model/Quantity		P06~P96/2~50			
Sound pressure level (measured in anechoic room)			dB <A>		59.0		
Refrigerant piping diameter		Liquid pipe	in. (mm)	3/4 (19.05) Brazed			
		Gas pipe	in. (mm)	1-5/8 (41.28) Brazed			
Set Model							
Model			PQHY-P168YLMU-A	PQHY-P168YLMU-A			
Minimum Circuit Ampacity		A	20	20			
Maximum Overcurrent Protection		A	35	35			
Circulating water	Water flow rate	G/h	1,902 + 1,902				
		G/min	31.7 + 31.7				
		m³/h	7.20 + 7.20				
		L/min	120 + 120				
		cfm	4.2 + 4.2				
	Pressure drop	psi	6.38	6.38			
		kPa	44	44			
	Operating volume range	G/h	1,189 + 1,189 ~ 3,054 + 3,054				
		G/min	19.8 + 19.8 ~ 50.9 + 50.9				
		m³/h	4.5 + 4.5 ~ 11.6 + 11.6				
Compressor	Type x Quantity		Inverter scroll hermetic compressor x 1	Inverter scroll hermetic compressor x 1			
	Manufacture		AC&R Works, MITSUBISHI ELECTRIC CORPORATION	AC&R Works, MITSUBISHI ELECTRIC CORPORATION			
	Starting method		Inverter	Inverter			
	Motor output	kW	11.0	11.0			
	Case heater	kW	-	-			
	Lubricant		MEL32	MEL32			
External finish			Galvanized steel sheets	Galvanized steel sheets			
External dimension H x W x D		in.	57-1/8 x 34-11/16 x 21-11/16	57-1/8 x 34-11/16 x 21-11/16			
		mm	1,450 x 880 x 550	1,450 x 880 x 550			
Protection devices	High pressure protection		High pressure sensor, High pressure switch at 4.15 MPa (601 psi)	High pressure sensor, High pressure switch at 4.15 MPa (601 psi)			
	Inverter circuit		Over-heat protection, Over-current protection	Over-heat protection, Over-current protection			
	Compressor		Over-heat protection	Over-heat protection			
Refrigerant	Type x original charge		R410A x 13 lbs + 4 oz (6.0 kg)	R410A x 13 lbs + 4 oz (6.0 kg)			
	Control		LEV and HIC circuit				
Net weight		lbs (kg)	508 (230)	508 (230)			
Heat exchanger			plate type	plate type			
	Water volume in plate	G	1.32	1.32			
		l	5.0	5.0			
	Water pressure Max.	psi	290	290			
		MPa	2.0	2.0			
HIC circuit (HIC: Heat Inter-Changer)			Copper pipe, tube-in-tube structure	Copper pipe, tube-in-tube structure			
Pipe between unit and distributor	Liquid pipe	in. (mm)	5/8 (15.88) Brazed	5/8 (15.88) Brazed			
	Gas pipe	in. (mm)	1-1/8 (28.58) Brazed	1-1/8 (28.58) Brazed			
Drawing	External		KJ94T160				
	Wiring		KE94C952	KE94C952			
Standard attachment	Document		Installation Manual				
	Accessory		Details refer to External Drw				
Optional parts			Heat Source Twinning kit: CMY-Y200CBK2 joint: CMY-Y102SS-G2, CMY-Y102LS-G2, CMY-Y202S-G2, CMY-Y302S-G2 Header: CMY-Y104/108/1010C-G				
Remarks			Details on foundation work, duct work, insulation work, electrical wiring, power source switch, and other items shall be referred to the Installation Manual. Due to continuing improvement, above specifications may be subject to change without notice. The ambient temperature of the Heat Source Unit needs to be kept below 104°F.D.B. (40°C.D.B.) The ambient relative humidity of the Heat Source Unit needs to be kept below 80%. The Heat Source Unit should not be installed at outdoor. Be sure to mount a strainer (more than 50 meshes) at the water inlet piping of the unit. Be sure to provide interlocking for the unit operation and water circuit. Install the supplied insulation material to the unused drain-socket. When installing insulation material around both water and refrigerant piping, follow the installation manual.				

Notes:	Unit converter
1.Nominal cooling conditions (Test conditions are based on AHRI 1230) Indoor: 81°F.D.B./66°F.W.B. (27°C.D.B./19°C.W.B.), Water temperature: 86°F (30°C)	BTU/h =kW x 3.412
2.Nominal heating conditions (Test conditions are based on AHRI 1230) Indoor: 68°F.D.B. (20°C.D.B.), Water temperature: 68°F (20°C)	cfm =m³/min x 35.31
	lbs =kg/0.4536
	*Above specification data is subject to rounding variation.

1. SPECIFICATIONS

U11 2nd

Heat Source Model			PQHY-P360YSLMU-A	
Indoor Model			Non-Ducted	Ducted
Power source			3-phase 3-wire 460 V ±10% 60 Hz	
Cooling capacity (Nominal)	*1	BTU/h	360,000	
		kW	105.5	
		Power input	29.43	
		(460) Current input	41.0	
	(Rated)	BTU/h	342,000	
		kW	100.2	
		Power input	27.17	27.41
		(460) Current input	37.8	38.2
Temp. range of cooling	Indoor	W.B.	59~75°F (15~24°C)	
	Circulating water	°F	50~113°F (10~45°C)	
Heating capacity (Nominal)	*2	BTU/h	405,000	
		kW	118.7	
		Power input	22.85	
		(460) Current input	31.8	
	(Rated)	BTU/h	387,000	
		kW	113.4	
		Power input	21.09	21.70
		(460) Current input	29.4	30.2
Temp. range of heating	Indoor	D.B.	59~81°F (15~27°C)	
	Circulating water	°F	50~113°F (10~45°C)	
Indoor unit connectable	Total capacity		50~130% of heatsource unit capacity	
	Model/Quantity		P06~P96/2~50	
Sound pressure level (measured in anechoic room)		dB <A>	60.0	
Refrigerant piping diameter	Liquid pipe	in. (mm)	3/4 (19.05) Brazed	
	Gas pipe	in. (mm)	1-5/8 (41.28) Brazed	


Set Model				
Model			PQHY-P192YLMU-A	PQHY-P168YLMU-A
Minimum Circuit Ampacity		A	25	20
Maximum Overcurrent Protection		A	40	35
Circulating water	Water flow rate	G/h	1,902 + 1,902	
		G/min	31.7 + 31.7	
		m ³ /h	7.20 + 7.20	
		L/min	120 + 120	
		cfm	4.2 + 4.2	
	Pressure drop	psi	6.38	6.38
		kPa	44	44
	Operating volume range	G/h	1,189 + 1,189 ~ 3,054 + 3,054	
		G/min	19.8 + 19.8 ~ 50.9 + 50.9	
m ³ /h		4.5 + 4.5 ~ 11.6 + 11.6		
Compressor	Type x Quantity		Inverter scroll hermetic compressor x 1	Inverter scroll hermetic compressor x 1
	Manufacture		AC&R Works, MITSUBISHI ELECTRIC CORPORATION	AC&R Works, MITSUBISHI ELECTRIC CORPORATION
	Starting method		Inverter	Inverter
	Motor output	kW	12.4	11.0
	Case heater	kW	-	-
	Lubricant		MEL32	MEL32
External finish		Galvanized steel sheets		Galvanized steel sheets
External dimension H x W x D		in.	57-1/8 x 34-11/16 x 21-11/16	57-1/8 x 34-11/16 x 21-11/16
		mm	1,450 x 880 x 550	1,450 x 880 x 550
Protection devices	High pressure protection		High pressure sensor, High pressure switch at 4.15 MPa (601 psi)	High pressure sensor, High pressure switch at 4.15 MPa (601 psi)
	Inverter circuit		Over-heat protection, Over-current protection	Over-heat protection, Over-current protection
	Compressor		Over-heat protection	Over-heat protection
Refrigerant	Type x original charge		R410A x 13 lbs + 4 oz (6.0 kg)	R410A x 13 lbs + 4 oz (6.0 kg)
	Control		LEV and HIC circuit	
Net weight		lbs (kg)	508 (230)	508 (230)
Heat exchanger	Water volume in plate		plate type	plate type
			G	1.32
	I	5.0	5.0	
	Water pressure Max.	psi	290	290
		MPa	2.0	2.0
HIC circuit (HIC: Heat Inter-Changer)			Copper pipe, tube-in-tube structure	Copper pipe, tube-in-tube structure
Pipe between unit and distributor	Liquid pipe	in. (mm)	5/8 (15.88) Brazed	5/8 (15.88) Brazed
	Gas pipe	in. (mm)	1-1/8 (28.58) Brazed	1-1/8 (28.58) Brazed
Drawing	External		KJ94T160	
	Wiring		KE94C952	KE94C952
Standard attachment	Document		Installation Manual	
	Accessory		Details refer to External Drw	
Optional parts			Heat Source Twinning kit: CMY-Y200CBK2 joint: CMY-Y102SS-G2, CMY-Y102LS-G2, CMY-Y202S-G2, CMY-Y302S-G2 Header: CMY-Y104/108/1010C-G	
Remarks			Details on foundation work, duct work, insulation work, electrical wiring, power source switch, and other items shall be referred to the Installation Manual. Due to continuing improvement, above specifications may be subject to change without notice. The ambient temperature of the Heat Source Unit needs to be kept below 104°F.D.B. (40°C.D.B.) The ambient relative humidity of the Heat Source Unit needs to be kept below 80%. The Heat Source Unit should not be installed at outdoor. Be sure to mount a strainer (more than 50 meshes) at the water inlet piping of the unit. Be sure to provide interlocking for the unit operation and water circuit. Install the supplied insulation material to the unused drain-socket. When installing insulation material around both water and refrigerant piping, follow the installation manual.	

Notes:	Unit converter
1.Nominal cooling conditions (Test conditions are based on AHRI 1230) Indoor: 81°F.D.B./66°F.W.B. (27°C.D.B./19°C.W.B.), Water temperature: 86°F (30°C)	BTU/h =kW x 3.412
2.Nominal heating conditions (Test conditions are based on AHRI 1230) Indoor: 68°F.D.B. (20°C.D.B.), Water temperature: 68°F (20°C)	cfm =m ³ /min x 35.31
	lbs =kg/0.4536
	*Above specification data is subject to rounding variation.

Unit : mm(in)

<Accessories>

- Refrigerant (Liquid) conn. pipe 1pc.
(P72/P96/P120 ; Packaged in the accessory kit)
- Refrigerant (Gas) conn. elbow 1pc.
(P72/P96/P120 ; Packaged in the accessory kit)
- Water stopper(Liquid,Gas).....1pc. each
(P72/P96/P120 ; Packaged in the accessory kit)
- Sealing material for water stopper (Liquid,Gas)..... 1pc. each
(P72/P96/P120 ; Packaged in the accessory kit)
- Sealing material for field piping (Liquid,Gas)..... 1pc. each
(P72/P96/P120 ; Packaged in the accessory kit)
- Sealing material for drain socket..... 1pc.
(P72/P96/P120 ; Packaged in the accessory kit)
- Pipe cover for gas.....1pc.
(P72/P96/P120 ; Packaged in the accessory kit)

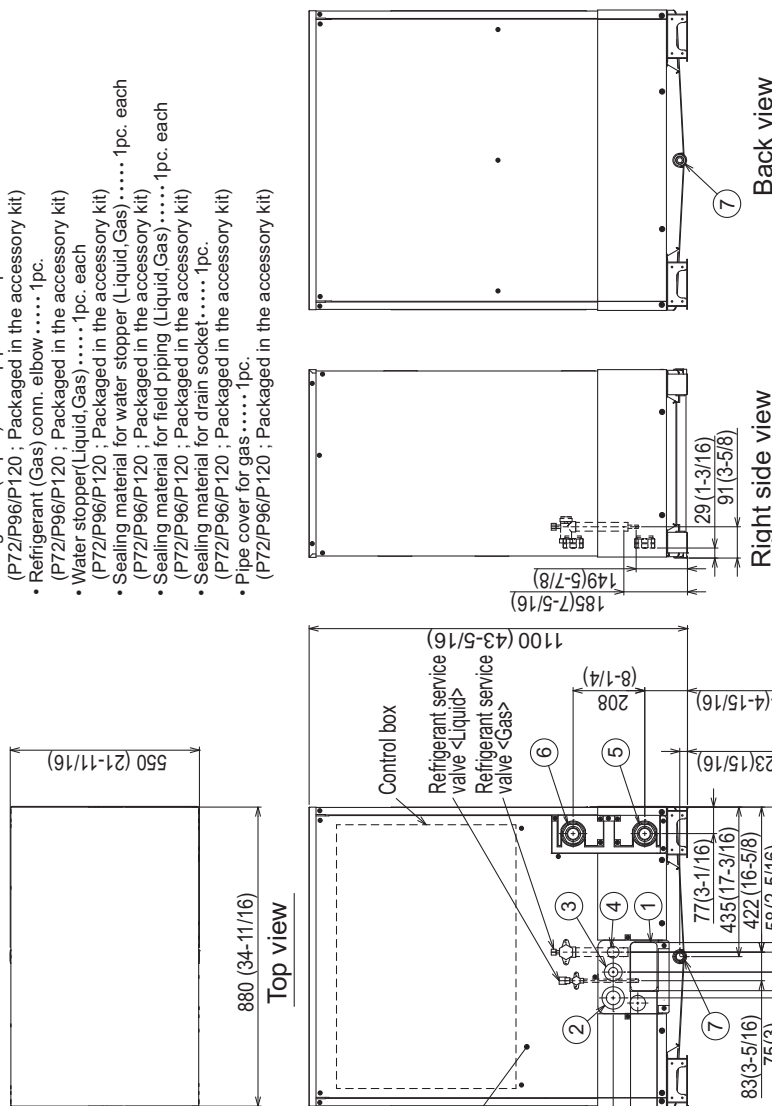

No.		Usage	Specifications
①	For pipes	Front through hole	140 × 77 Knockout hole (5-9/16) (3-1/16)
②	For wires	Front through hole	ø62.7 or ø34.5 Knockout hole (2-1/2) (1-3/8)
③		Front through hole	ø43.7 or ø22.2 Knockout hole (1-3/4) (7/8)
④	For transmission cables	Front through hole	ø34 Knockout hole (1-3/8)
⑤	Water pipe	inlet	NPT1-1/2 Screw
⑥		outlet	NPT1-1/2 Screw
⑦	Drain pipe		B-2/4 Screw

Note 1. Close a hole of the water piping, the refrigerant piping, the power supply, and the control wiring and unused knockout holes with the putty etc. so as not to infiltrate rain water etc. (field erection work)

Note2.At the time of product shipment, the front side piping specification serves as the local drainage connection. When connecting on the rear side, please remove the rear side plug sealing corks, and attach a front side.

Ensure there is no leak after the attachment has been fitted.

Note3. Take notice of service space as Fig.A. (In case of single

installation, 600mm(23-5/8) or more of back space as front space makes easier access when servicing the unit from rear side.)

Note 4. If water pipes or refrigerant pipes stretch upward, required space for service and maintenance due to

Note5.Environmental condition for installation; -20~40°C(DB) (-4~104°F) as indoor installation.

Note6. In case the temperature around the heat source unit has possibility to drop under 0°C(32°F), be careful for the following point to prevent the pipe burst by the water pipe freeze-up.

- Circulate the water all the time even if the heat source unit is not in operation.

- Drain the water from inside of the heat source unit when the heat source unit will not operate for a long term.

Note 7. Ensure that the drain piping is downward with a pitch of more than 1/100.

Note 8. At brazing of pipes, wrap the refrigerant service valve with wet cloth and keep the temperature of refrigerant service valve under 120°C (248°F).

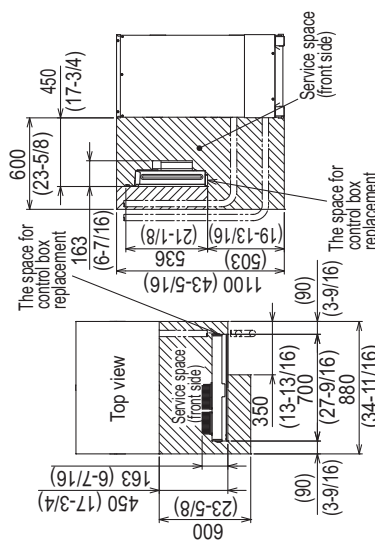


Fig.B

Fig. A

Connecting pipe specifications			
Model	Refrigerant pipe		Diameter
	Liquid	Gas	
QHPH472TUMUA	ø 9.52 Braze (3/8)" 1/4"	ø 19.05 Braze (3/4)" 1/4"	ø 25.4 (1)
QHPH496TUMUA	ø 9.52 Braze (3/8)" 1/4"	ø 22.2 Braze (7/8)" 1/4"	
QHPH472TUMUA	ø 9.52 Braze (3/8)" 1/4"		

	(1/2)	3/4	
1. Connect by using the connecting rings and a bolt that are supplied			

1. Connect by using the connecting pipes and elbow that are supplied.


2. Total length $\geq 90\text{m}$ (295ft)

3. Total length $\geq 40\text{m}(131\text{ft})$



PQHY-P144, 168, 192TLMU-A

Unit : mm(in)

- <Accessories>
- Refrigerant (Liquid) conn. pipe 1pc.
(P144/P168/P192 ; Packaged in the accessory kit)
 - Refrigerant (Gas) conn. elbow 1pc.
(P144/P168/P192 ; Packaged in the accessory kit)
 - Water stopper(Liquid Gas) 1pc. each
(P144/P168/P192 ; Packaged in the accessory kit)
 - Sealing material for water stopper (Liquid, Gas) 1pc. each
(P144/P168/P192 ; Packaged in the accessory kit)
 - Sealing material for field piping (Liquid, Gas) 1pc. each
(P144/P168/P192 ; Packaged in the accessory kit)
 - Sealing material for drain socket 1pc.
(P144/P168/P192 ; Packaged in the accessory kit)
 - Pipe cover for gas 1pc.
(P144/P168/P192 ; Packaged in the accessory kit)
 - Sealing material for base leg (two types) 4pc. each
(P144/P168/P192 ; Packaged in the accessory kit)
 - Sealing material for panel 1pc.
(P144/P168/P192 ; Packaged in the accessory kit)



Top view

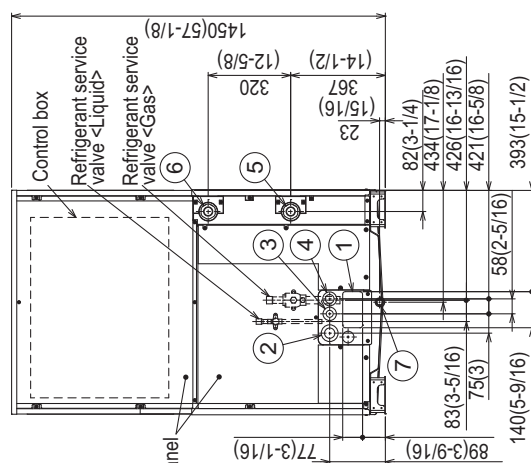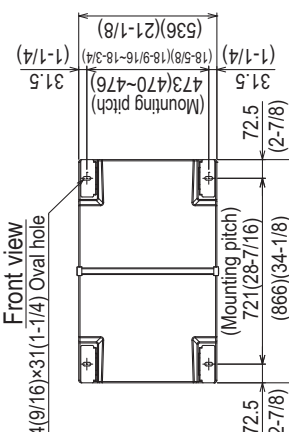Front view
2x2-14(9/16)x31(1-1/4) Oval hole

Bottom view

Back view

Right side view

No.	For pipes	Usage	Specifications
①	For pipes	Front through hole	140 x 77 Knockout hole (5-9/16) (3-1/16)
②	For wires	Front through hole	ø62.7 or ø34.5 Knockout hole (2-1/2) (1-3/8)
③	For transmission cables	Front through hole	ø43.7 or ø22.2 Knockout hole (1-3/4) (7/8)
④	For transmission cables	Front through hole	ø34 Knockout hole (1-3/8)
⑤	Water pipe inlet	inlet	NPT1-1/2 Screw
⑥	Water pipe outlet	outlet	NPT1-1/2 Screw
⑦	Drain pipe		Rc3/4 Screw

Note1. Close a hole of the water piping, the refrigerant piping, the power supply, and the control wiring and unused knockout holes with the putty etc. so as not to infiltrate rain water etc.(field erection work)

Note2. At the time of product shipment, the front side piping specification serves as the local drainage connection. When connecting on the rear side, please remove the rear side plug sealing corks, and attach a front side.

Note3. Ensure there is no leak after the attachment has been fitted. Take notice of service space as Fig.A. (In case of single installation, 600mm(23-5/8) or more of back space as front space makes easier access when servicing the unit from rear side.)

Note4. If water pipes or refrigerant pipes stretch upward, required space for service and maintenance due to replacement of control box is shown in Fig.B.

Note5. Environmental condition for installation: -20~40°C(DB) (-4~104°F) as indoor installation.

Note6. In case the temperature around the heat source unit has possibility to drop under 0°C(32°F), be careful for the following point to prevent the pipe burst by the water pipe freeze-up.

• Circulate the water all the time even if the heat source unit is not in operation.

• Drain the water from inside of the heat source unit when the heat source unit will not operate for a long term.

Note7. Ensure that the drain piping is downward with a pitch of more than 1/100.

Note8. At brazing of pipes, wrap the refrigerant service valve with wet cloth and keep the temperature of refrigerant service valve under 120°C(248°F).

The space for control box replacement

The space for control box replacement

The space for control box replacement

The space for control box replacement

The space for control box replacement

The space for control box replacement

The space for control box replacement

Connecting pipe specifications

Model	Diameter		Service valve
	Refrigerant pipe	Service valve	
PQHY-P144TLMU-A	Liquid ø12.7 Braze (1/2) *1, *2	Liquid ø15.88 (5/8)	Gas ø28.58 (1-1/8)
PQHY-P168TLMU-A	Liquid ø15.88 Braze (5/8) *1	Liquid ø15.88 (5/8)	Gas ø28.58 (1-1/8)
PQHY-P192TLMU-A	Liquid ø15.88 Braze (5/8) *1	Liquid ø15.88 (5/8)	Gas ø28.58 (1-1/8)


*1. Connect by using the connecting pipes and elbow that are supplied.

*2. Use the pipe joint(field supply) and connect to the refrigerant service valve piping.


PQHY-P216, 240TLMU-A

Unit : mm(in)


- <Accessories>
- Refrigerant (Liquid) conn. pipe 1pc.
(P216/P240 ; Packaged in the accessory kit)
 - Refrigerant (Gas) conn. elbow 1pc.
(P216/P240 ; Packaged in the accessory kit)
 - Water stopper(Liquid,Gas) 1pc. each
(P216/P240 ; Packaged in the accessory kit)
 - Sealing material for water stopper (Liquid,Gas) 1pc. each
(P216/P240 ; Packaged in the accessory kit)
 - Sealing material for field piping (Liquid,Gas) 1pc. each
(P216/P240 ; Packaged in the accessory kit)
 - Sealing material for drain socket 1pc.
(P216/P240 ; Packaged in the accessory kit)
 - Pipe cover for gas 1pc.
(P216/P240 ; Packaged in the accessory kit)
 - Sealing material for base leg (two types) 4pc. each
(P216/P240 ; Packaged in the accessory kit)
 - Sealing material for panel 1pc.
(P216/P240 ; Packaged in the accessory kit)




Top view

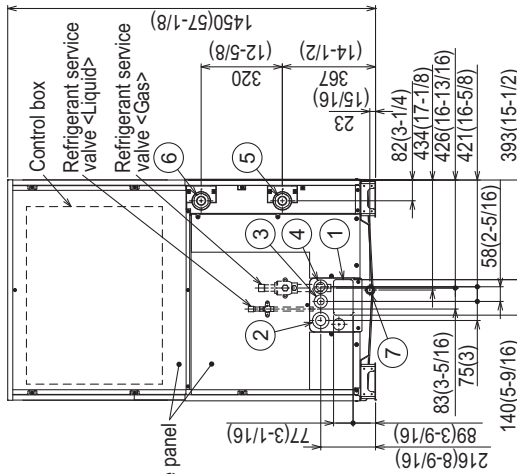

Front view

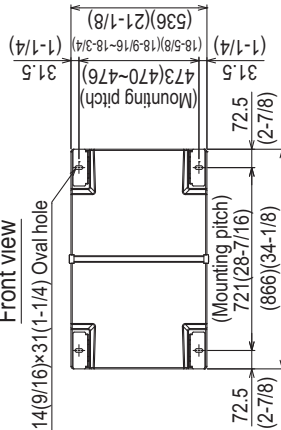

Bottom view

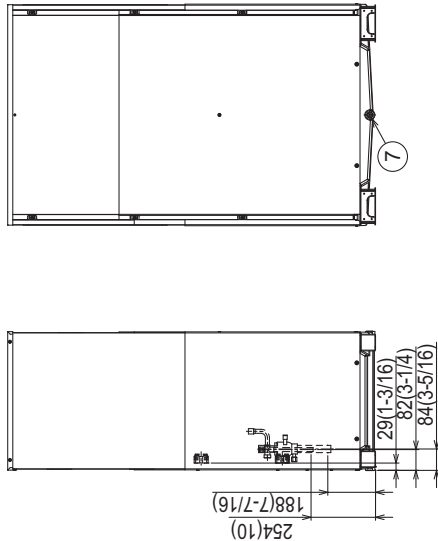

Right side view

Back view

NO.	Usage	Specifications
①	For pipes	Front through hole 140 x 77 Knockout hole (5-9/16) (3-1/16)
②	For wires	Front through hole ø62.7 or ø34.5 Knockout hole (2-1/2) (1-3/8)
③	For transmission cables	Front through hole ø43.7 or ø22.2 Knockout hole (1-3/4) (7/8)
④	Water pipe inlet	Front through hole ø34 Knockout hole (1-3/8)
⑤	Water pipe outlet	Front through hole ø34 Knockout hole (1-3/8)
⑥	Drain pipe	Front through hole ø34 Knockout hole (1-3/8)
⑦		Rc3/4 Screw

Note1. Close a hole of the water piping, the refrigerant piping, the power supply, and the control wiring and unused knockout holes with the putty etc. so as not to infiltrate rain water etc.(field erection work)

Note2. At the time of product shipment, the front side piping specification serves as the local drainage connection. When connecting on the rear side, please remove the rear side plug sealing corks, and attach a front side.

Note3. Ensure there is no leak after the attachment has been fitted. Take notice of service space as Fig.A. (In case of single installation, 600mm(23-5/8) or more of back space as front space makes easier access when servicing the unit from rear side.)

Note4. If water pipes or refrigerant pipes stretch upward, required space for service and maintenance due to replacement of control box is shown in Fig.B.

Note5. Environmental condition for installation; -20~40°C(DB) (-4~104°F) as indoor installation.


Note6. In case the temperature around the heat source unit has possibility to drop under 0°C(32°F), be careful for the following point to prevent the pipe burst by the water pipe freeze-up.

• Circulate the water all the time even if the heat source unit is not in operation.

• Drain the water from inside of the heat source unit when the heat source unit will not operate for a long term.

Note7. Ensure that the drain piping is downward with a pitch of more than 1/100.


Note8. At brazing of pipes, wrap the refrigerant service valve with wet cloth and keep the temperature of refrigerant service valve under 120°C(248°F).

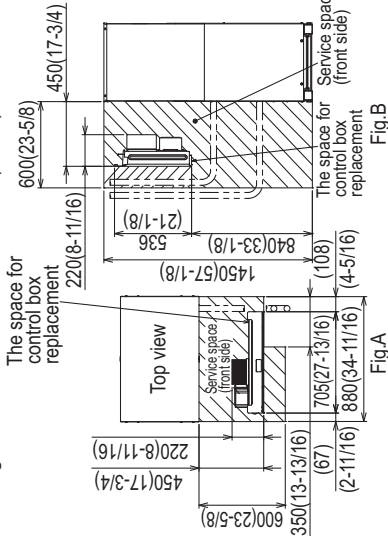

Connecting pipe specifications


Model	Diameter		
	Refrigerant pipe	Service valve	
PQHY-P216TLMU-A	Liquid	Liquid	Gas
	ø15.88 Brazed (5/8) *1	ø15.88 (5/8)	ø28.58 (1-1/8)
PQHY-P240TLMU-A			

*1. Connect by using the connecting pipes and elbow that are supplied.

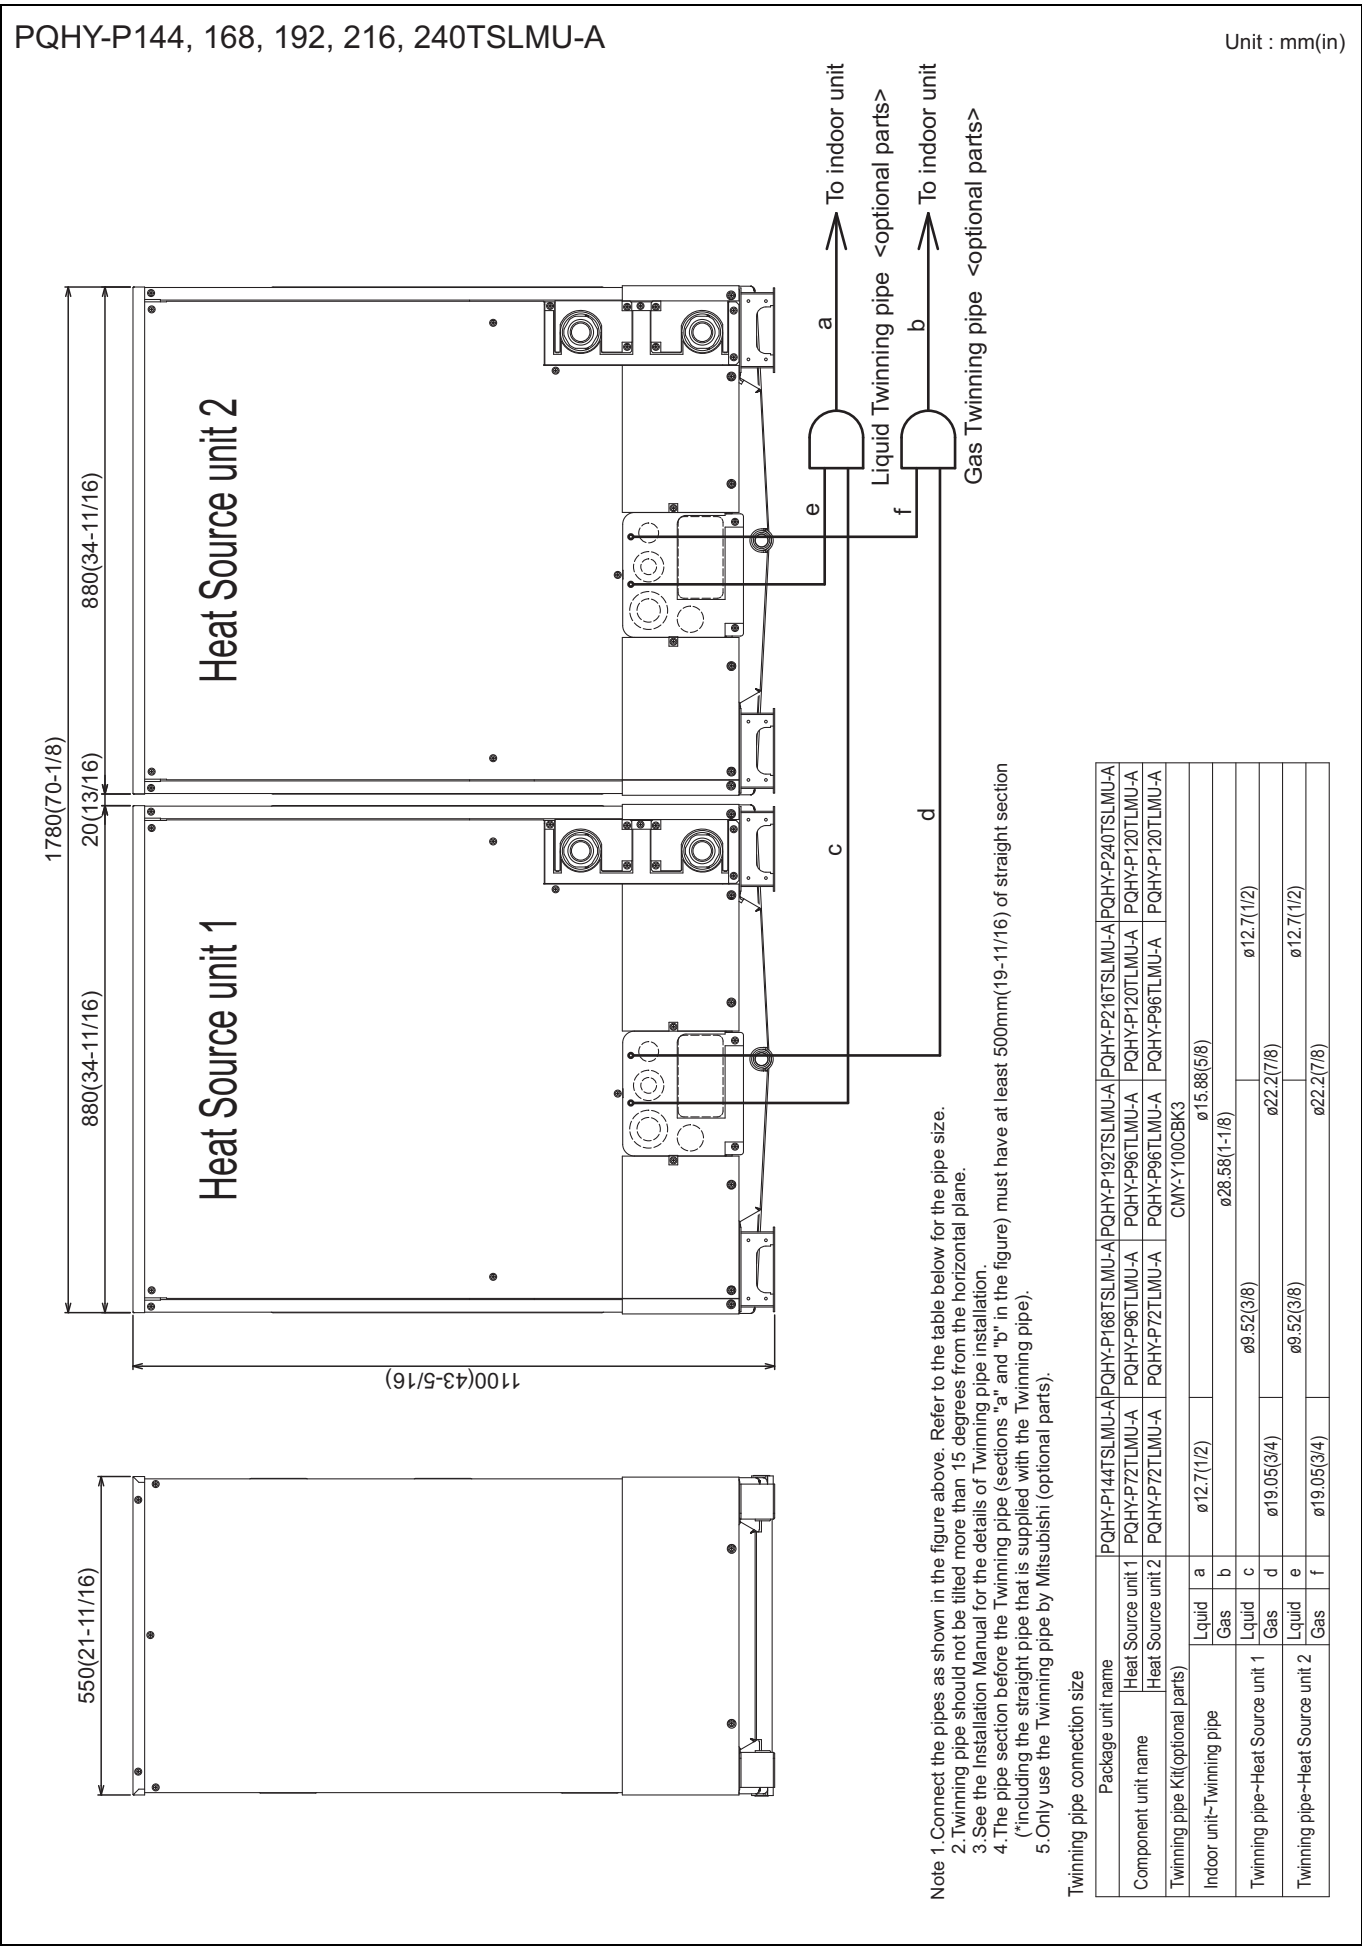

PQHY-P288, 312, 336, 360TSLMU-A

Unit : mm(in)

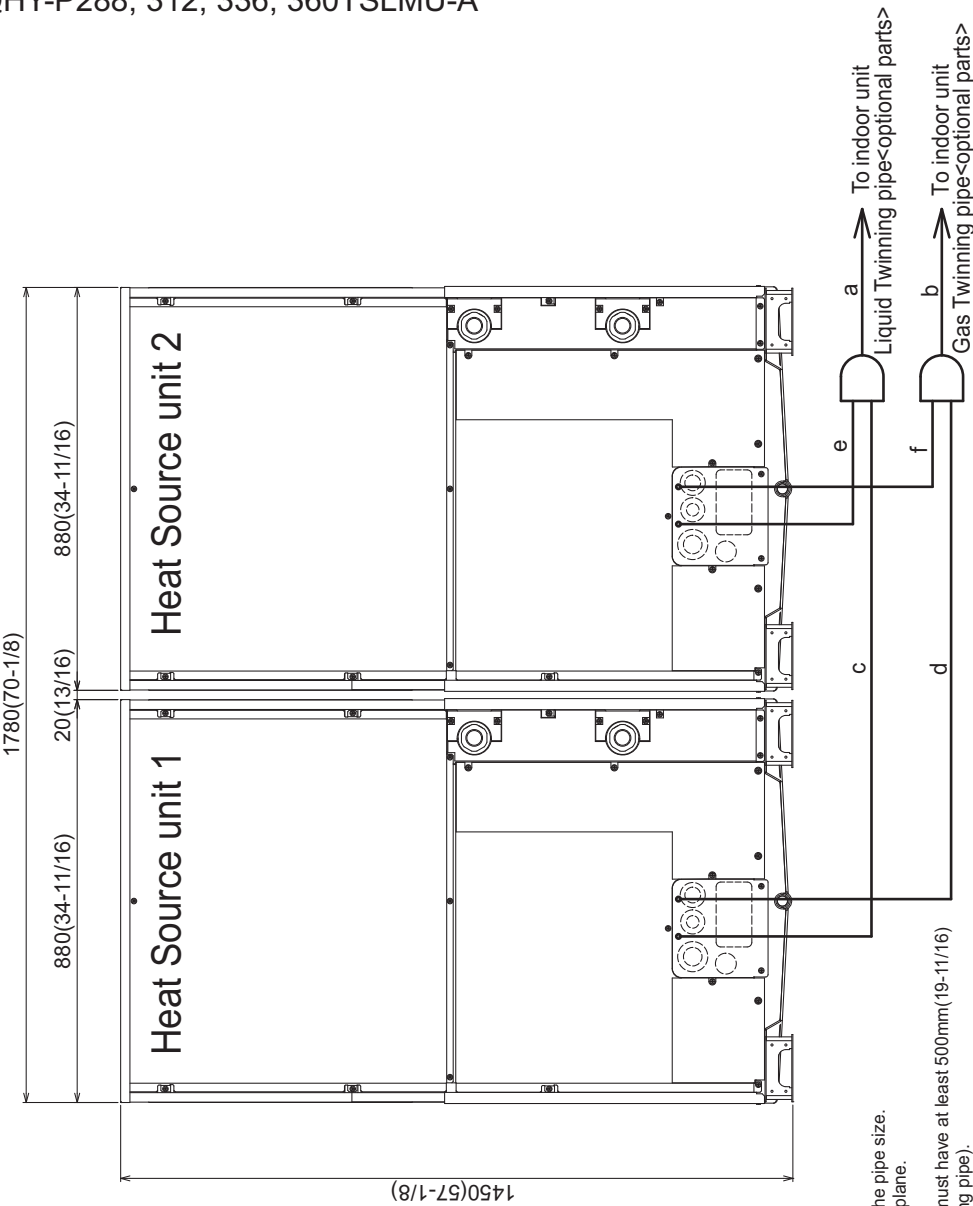

- Note 1. Connect the pipes as shown in the figure above. Refer to the table above for the pipe size.
2. Twinning pipes should not be tilted more than 15 degrees from the horizontal plane.
3. See the Installation Manual for the details of Twinning pipe installation.
4. The pipe section before the Twinning pipe (sections "a" and "b" in the figure) must have at least 500mm(19-11/16) of straight section (*including the straight pipe that is supplied with the Twinning pipe).
5. Only use the Twinning pipe by Mitsubishi (optional parts).


Twining pipe connection size

Package unit name		PQHY-P288TSLMU-A	PQHY-P312TSLMU-A	PQHY-P336TSLMU-A	PQHY-P360TSLMU-A
Component unit name	Heat Source unit 1	PQHY-P144TLMU-A	PQHY-P168TLMU-A	PQHY-P168TLMU-A	PQHY-P192TLMU-A
	Heat Source unit 2	PQHY-P144TLMU-A	PQHY-P144TLMU-A	PQHY-P168TLMU-A	PQHY-P168TLMU-A
Twining Kit(optional parts)		CMY-Y200CBK2			
Indoor unit~Twining pipe	Liquid	a	ø34.93(1-3/8)		ø41.28(1-5/8)
	Gas	b	ø12.7(1/2)		ø15.88(5/8)
Twining pipe~Heat Source unit 1	Liquid	c	ø28.58(1-1/8)		ø15.88(5/8)
	Gas	d	ø12.7(1/2)		ø15.88(5/8)
Twining pipe~Heat Source unit 2	Liquid	e	ø28.58(1-1/8)		ø15.88(5/8)
	Gas	f	ø12.7(1/2)		ø15.88(5/8)

PQHY-P72, 96, 120YLMU-A

Unit : mm(in)


- <Accessories>
- Refrigerant (Liquid) conn. pipe 1pc.
 - (P72/P96/P120) : Packaged in the accessory kit)
 - Refrigerant (Gas) conn. elbow 1pc.
 - (P72/P96/P120) : Packaged in the accessory kit)
 - Water stopper (Liquid, Gas) 1pc. each
 - (P72/P96/P120) : Packaged in the accessory kit)
 - Sealing material for water stopper (Liquid, Gas) 1pc. each
 - (P72/P96/P120) : Packaged in the accessory kit)
 - Sealing material for field piping (Liquid, Gas) 1pc. each
 - (P72/P96/P120) : Packaged in the accessory kit)
 - Sealing material for drain socket 1pc.
 - (P72/P96/P120) : Packaged in the accessory kit)
 - Pipe cover for gas 1pc.
 - (P72/P96/P120) : Packaged in the accessory kit)

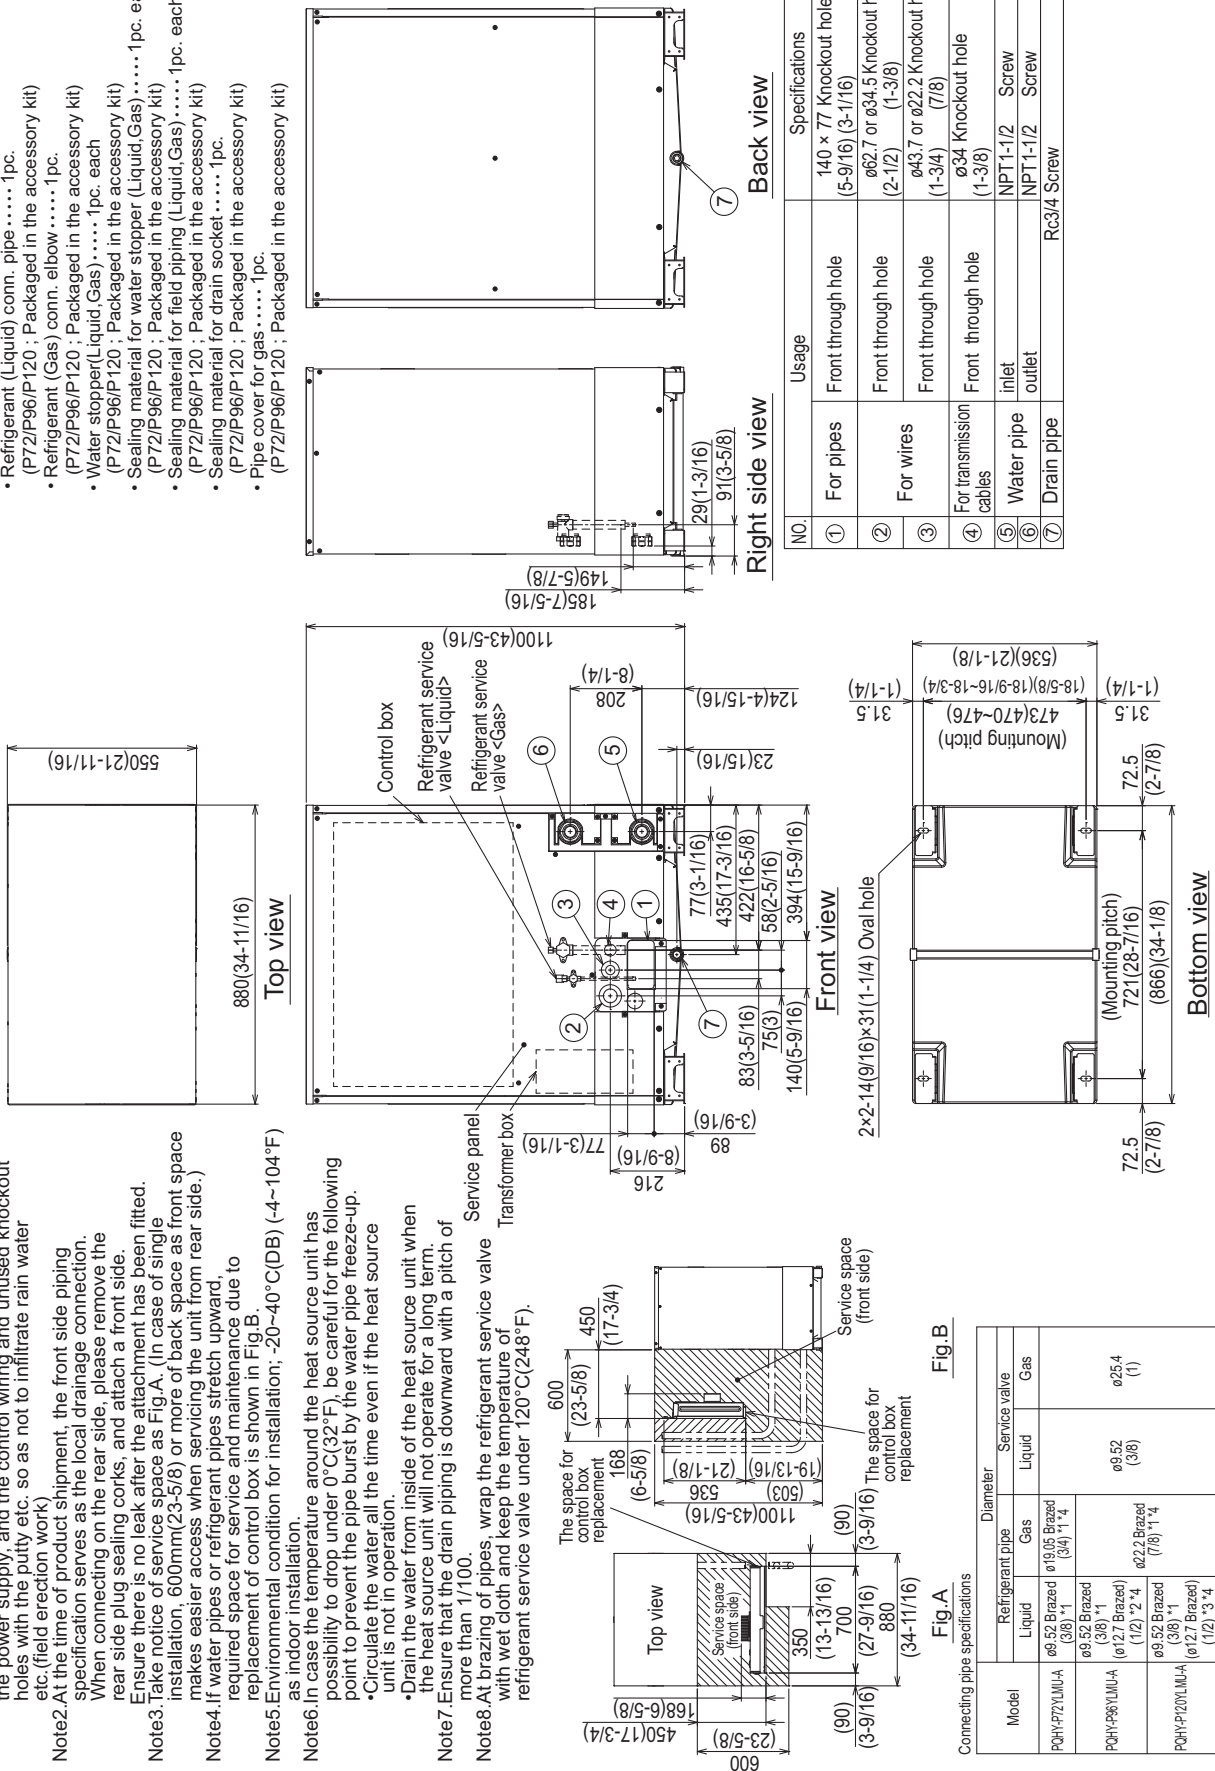


PQHY-P144, 168, 192YLMU-A

Unit : mm(in)

- <Accessories>
- Refrigerant (Liquid) conn. pipe 1pc.
(P144/P168/P192; Packaged in the accessory kit)
 - Refrigerant (Gas) conn. elbow 1pc.
(P144/P168/P192; Packaged in the accessory kit)
 - Water stopper (Liquid, Gas) 1pc. each
(P144/P168/P192; Packaged in the accessory kit)
 - Sealing material for water stopper (Liquid, Gas) 1pc. each
(P144/P168/P192; Packaged in the accessory kit)
 - Sealing material for field piping (Liquid, Gas) 1pc. each
(P144/P168/P192; Packaged in the accessory kit)
 - Sealing material for drain socket 1pc.
(P144/P168/P192; Packaged in the accessory kit)
 - Pipe cover for gas 1pc.
(P144/P168/P192; Packaged in the accessory kit)
 - Sealing material for base leg (two types) 4pc. each
(P144/P168/P192; Packaged in the accessory kit)
 - Sealing material for panel 1pc.
(P144/P168/P192; Packaged in the accessory kit)

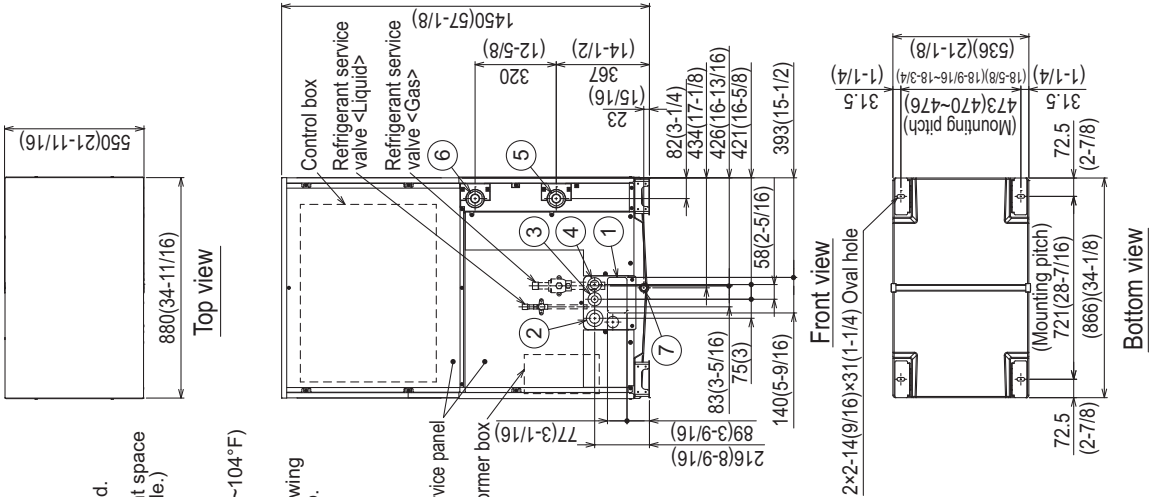

- Note1. Close a hole of the water piping, the refrigerant piping, the power supply, and the control wiring and unused knockout holes with the putty etc. so as not to infiltrate rain water etc. (field erection work)
- Note2. At the time of product shipment, the front side piping specification serves as the local drainage connection. When connecting on the rear side, please remove the rear side plug sealing corks, and attach a front side. Ensure there is no leak after the attachment has been fitted.
- Note3. Take notice of service space as Fig.A. (In case of single installation, 600mm(23-5/8) or more of back space as front space makes easier access when servicing the unit from rear side.)
- Note4. If water pipes or refrigerant pipes stretch upward, required space for service and maintenance due to replacement of control box is shown in Fig.B.
- Note5. Environmental condition for installation; -20~40°C(DB) (-4~104°F) as indoor installation.
- Note6. In case the temperature around the heat source unit has possibility to drop under 0°C(32°F), be careful for the following point to prevent the pipe burst by the water pipe freeze-up.
- Circulate the water all the time even if the heat source unit is not in operation.
 - Drain the water from inside of the heat source unit when the heat source unit will not operate for a long term.
- Note7. Ensure that the drain piping is downward with a pitch of more than 1/100.
- Note8. At brazing of pipes, wrap the refrigerant service valve with wet cloth and keep the temperature of refrigerant service valve under 120°C(248°F).

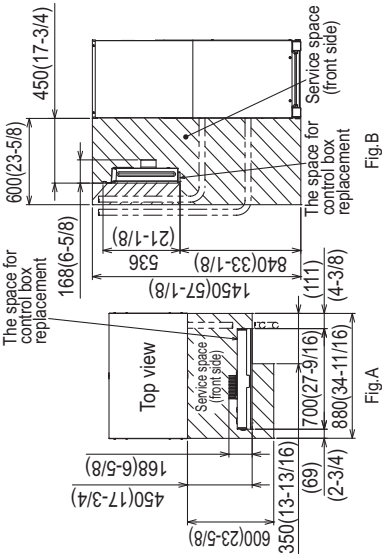

Model	Diameter		
	Refrigerant pipe	Service valve	
	Liquid	Gas	Gas
PQHY-P144YLMU-A	ø12.7 Braze (12) *1 *2	ø15.88 (58)	ø28.58 (1-1/8)
PQHY-P168YLMU-A	ø15.88 Braze (58) *1		
PQHY-P192YLMU-A			

*1. Connect by using the connecting pipes and elbow that are supplied.
*2. Use the pipe joint (field supply) and connect to the refrigerant service valve piping.

Unit : mm(in)

Note1.Close a hole of the water piping, the refrigerant piping, the power supply, and the control wiring and unused knockout holes with the putty etc. so as not to infiltrate rain water etc. (field erection work)

Note2.At the time of product shipment, the front side piping specification serves as the local drainage connection. When connecting on the rear side, please remove the rear side plug sealing corks, and attach a front side. Ensure there is no leak after the attachment has been fitted.

Note3.Take notice of service space as Fig.A. (In case of single installation, 600mm(23-5/8) or more of back space as front space makes easier access when servicing the unit from rear side.)

Note4.If water pipes or refrigerant pipes stretch upward, required space for service and maintenance due to replacement of control box is shown in Fig.B.


Note5.Environmental condition for installation; $-20\sim 40^{\circ}\text{C}(\text{DB})$ ($-4\sim 104^{\circ}\text{F}$) as indoor installation.

Note6.In case the temperature around the heat source unit has possibility to drop under $0^{\circ}\text{C}(32^{\circ}\text{F})$, be careful for the following point to prevent the pipe burst by the water pipe freeze-up.

- Circulate the water all the time even if the heat source unit is not in operation.
- Drain the water from inside of the heat source unit when the heat source unit will not operate for a long term.

Note7.Ensure that the drain piping is downward with a pitch of more than 1/100.


Note8.At brazing of pipes, wrap the refrigerant service valve with wet cloth and keep the temperature of refrigerant service valve under $120^{\circ}\text{C}(248^{\circ}\text{F})$.

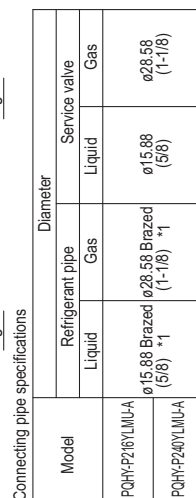

NO.	Usage		Specifications
①	For pipes	Front through hole	140 x 77 Knockout hole (5-9/16) (3-1/16)
②	For wires	Front through hole	ø62.7 or ø34.5 Knockout hole (2-1/2) (1-3/8)
③		Front through hole	ø43.7 or ø22.2 Knockout hole (1-3/4) (7/8)
④	For transmission cables	Front through hole	ø34 Knockout hole (1-3/8)
⑤	Water pipe	inlet	NPT1-1/2 Screw
⑥		outlet	NPT1-1/2 Screw
⑦	Drain pipe		R2-3/4 Screw

PQHY-P144, 168, 192, 216, 240YSLMU-A

Unit : mm(in)

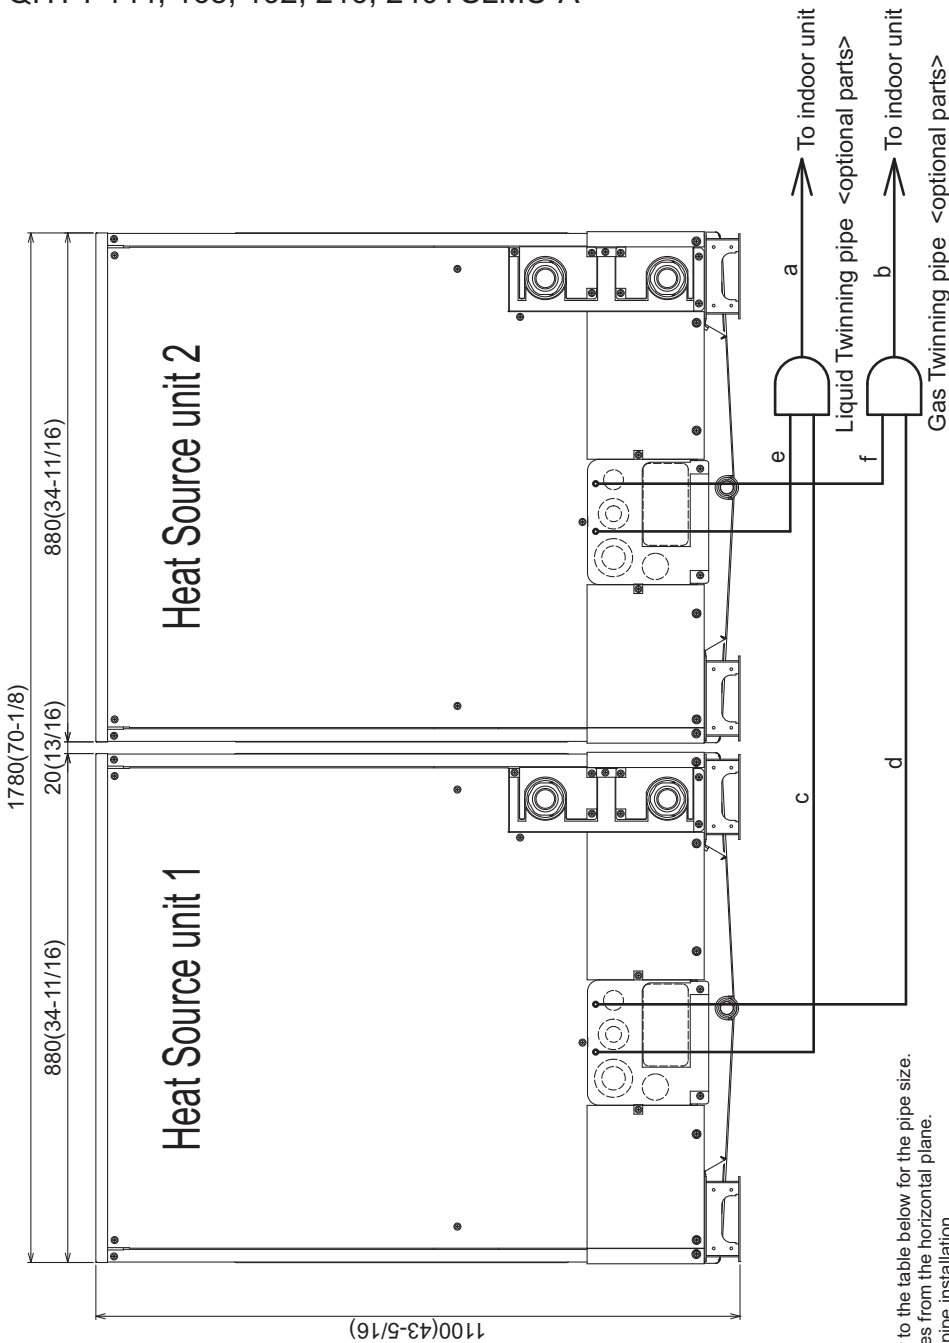


- Note 1. Connect the pipes as shown in the figure above. Refer to the table below for the pipe size.
2. Twinning pipe should not be tilted more than 15 degrees from the horizontal plane.
3. See the Installation Manual for the details of Twinning pipe installation.
4. The pipe section before the Twinning pipe (sections "a" and "b" in the figure) must have at least 500mm(19-11/16) of straight section (*including the straight pipe that is supplied with the Twinning pipe).
5. Only use the Twinning pipe by Mitsubishi (optional parts).

Twining pipe connection size

Package unit name		PQHY-P144YSLMU-A	PQHY-P168YSLMU-A	PQHY-P192YSLMU-A	PQHY-P216YSLMU-A	PQHY-P240YSLMU-A
Component unit name		PQHY-P72YLMU-A	PQHY-P96YLMU-A	PQHY-P120YLMU-A	PQHY-P144YLMU-A	PQHY-P168YLMU-A
Twining pipe Kit(optional parts)		PQHY-P72YLMU-A	PQHY-P96YLMU-A	PQHY-P120YLMU-A	PQHY-P144YLMU-A	PQHY-P168YLMU-A
Indoor unit-Twining pipe		CMY-Y100CBK3				
Liquid		a	ø12.7(1/2)	ø15.88(5/8)		
Gas		b	ø28.58(1-1/8)			
Twining pipe-Heat Source unit 1		c	ø9.52(3/8)	ø12.7(1/2)		
Liquid		d	ø19.05(3/4)	ø22.2(7/8)		
Gas		e	ø9.52(3/8)	ø12.7(1/2)		
Twining pipe-Heat Source unit 2		f	ø19.05(3/4)	ø22.2(7/8)		
Liquid						
Gas						

PQHY-P288, 312, 336, 360YSLMU-A

Unit : mm(in)

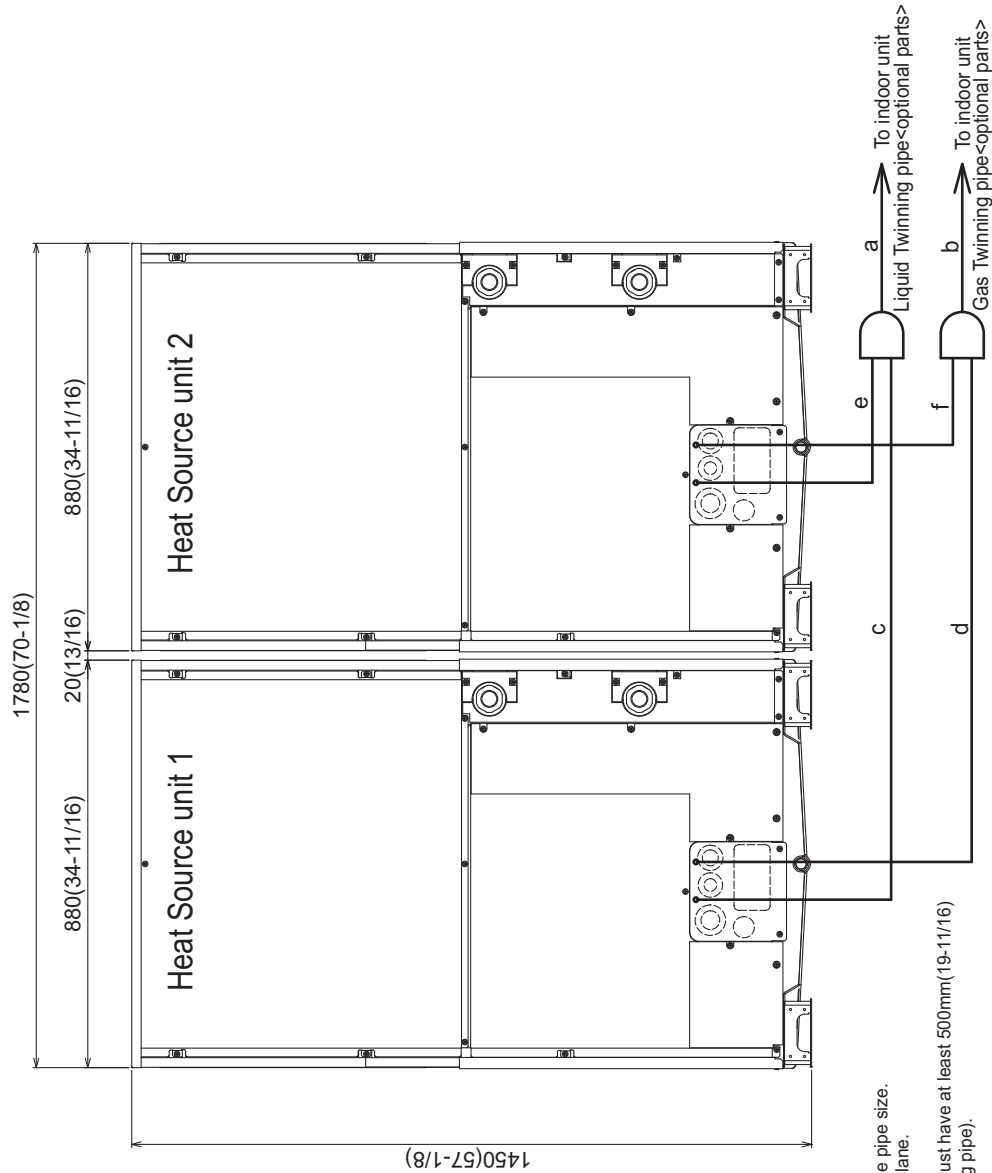


- Note 1. Connect the pipes as shown in the figure above. Refer to the table above for the pipe size.
 2. Twinning pipes should not be tilted more than 15 degrees from the horizontal plane.
 3. See the Installation Manual for the details of Twinning pipe installation.
 4. The pipe section before the Twinning pipe (sections "a" and "b" in the figure) must have at least 500mm (19-11/16) of straight section (*including the straight pipe that is supplied with the Twinning pipe).
 5. Only use the Twinning pipe by Mitsubishi (optional parts).

Twinning pipe connection size

Package unit name		PQHY-P288YSLMU-A	PQHY-P312YSLMU-A	PQHY-P336YSLMU-A	PQHY-P360YSLMU-A
Component unit name	Heat Source unit 1	PQHY-P144YLMU-A	PQHY-P168YLMU-A	PQHY-P168YLMU-A	PQHY-P192YLMU-A
	Heat Source unit 2	PQHY-P144YLMU-A	PQHY-P144YLMU-A	PQHY-P168YLMU-A	PQHY-P168YLMU-A
Twinning Kit(optional parts)		CMY-Y200CBK2			
Indoor unit-Twinning pipe	Liquid	a	ø19.05(3/4)		
		b	ø41.28(1-5/8)		
Twinning pipe-Heat Source unit 1	Liquid	c	ø15.88(5/8)		
		d	ø28.58(1-1/8)		
Twinning pipe-Heat Source unit 2	Liquid	e	ø15.88(5/8)		
		f	ø28.58(1-1/8)		

PQHY-P72, 96, 120TLMU-A/YLMU-A

Unit: mm [in.]

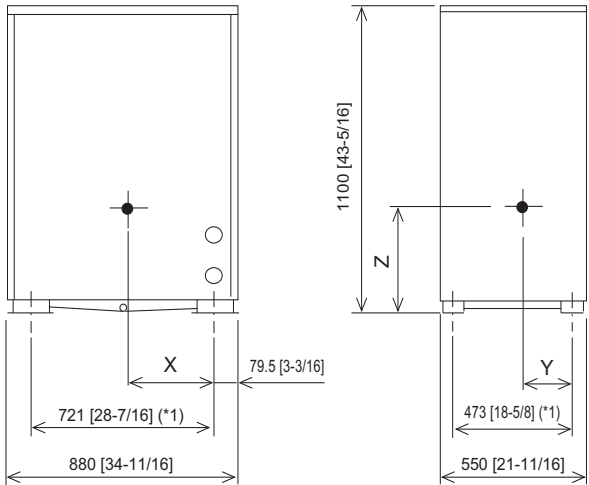


Model	X	Y	Z
PQHY-P72TLMU-A	358 [14-1/8]	233 [9-3/16]	448 [17-11/16]
PQHY-P96TLMU-A	358 [14-1/8]	233 [9-3/16]	448 [17-11/16]
PQHY-P120TLMU-A	358 [14-1/8]	233 [9-3/16]	448 [17-11/16]
PQHY-P72YLMU-A	376 [14-13/16]	223 [8-13/16]	438 [17-1/4]
PQHY-P96YLMU-A	376 [14-13/16]	223 [8-13/16]	438 [17-1/4]
PQHY-P120YLMU-A	376 [14-13/16]	223 [8-13/16]	438 [17-1/4]

*1 Mounting Pitch

PQHY-P144, 168, 192, 216, 240TLMU-A/YLMU-A


Unit: mm [in.]

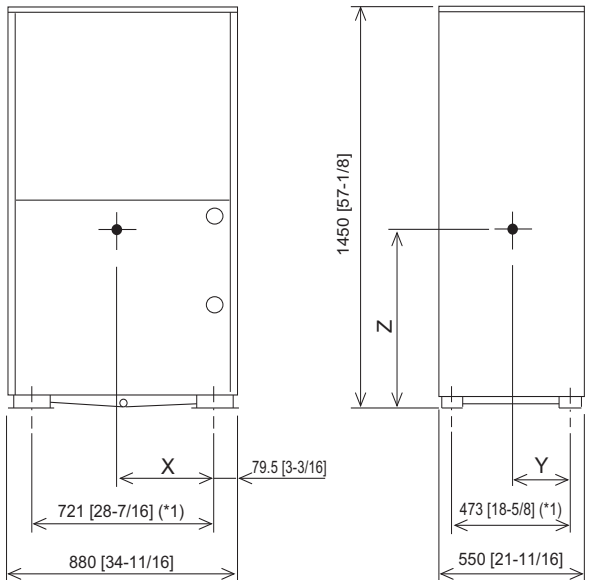

Model	X	Y	Z
PQHY-P144TLMU-A	386 [15-1/4]	231 [9-1/8]	624 [24-5/8]
PQHY-P168TLMU-A	386 [15-1/4]	231 [9-1/8]	624 [24-5/8]
PQHY-P192TLMU-A	386 [15-1/4]	231 [9-1/8]	624 [24-5/8]
PQHY-P216TLMU-A	373 [14-11/16]	230 [9-1/16]	687 [27-1/16]
PQHY-P240TLMU-A	373 [14-11/16]	230 [9-1/16]	687 [27-1/16]
PQHY-P144YLMU-A	402 [15-7/8]	226 [8-15/16]	614 [24-3/16]
PQHY-P168YLMU-A	402 [15-7/8]	226 [8-15/16]	614 [24-3/16]
PQHY-P192YLMU-A	402 [15-7/8]	226 [8-15/16]	614 [24-3/16]
PQHY-P216YLMU-A	383 [15-1/8]	219 [8-5/8]	634 [25]
PQHY-P240YLMU-A	383 [15-1/8]	219 [8-5/8]	634 [25]

*1 Mounting Pitch

PQHY-P72, 96, 120TLMU-A

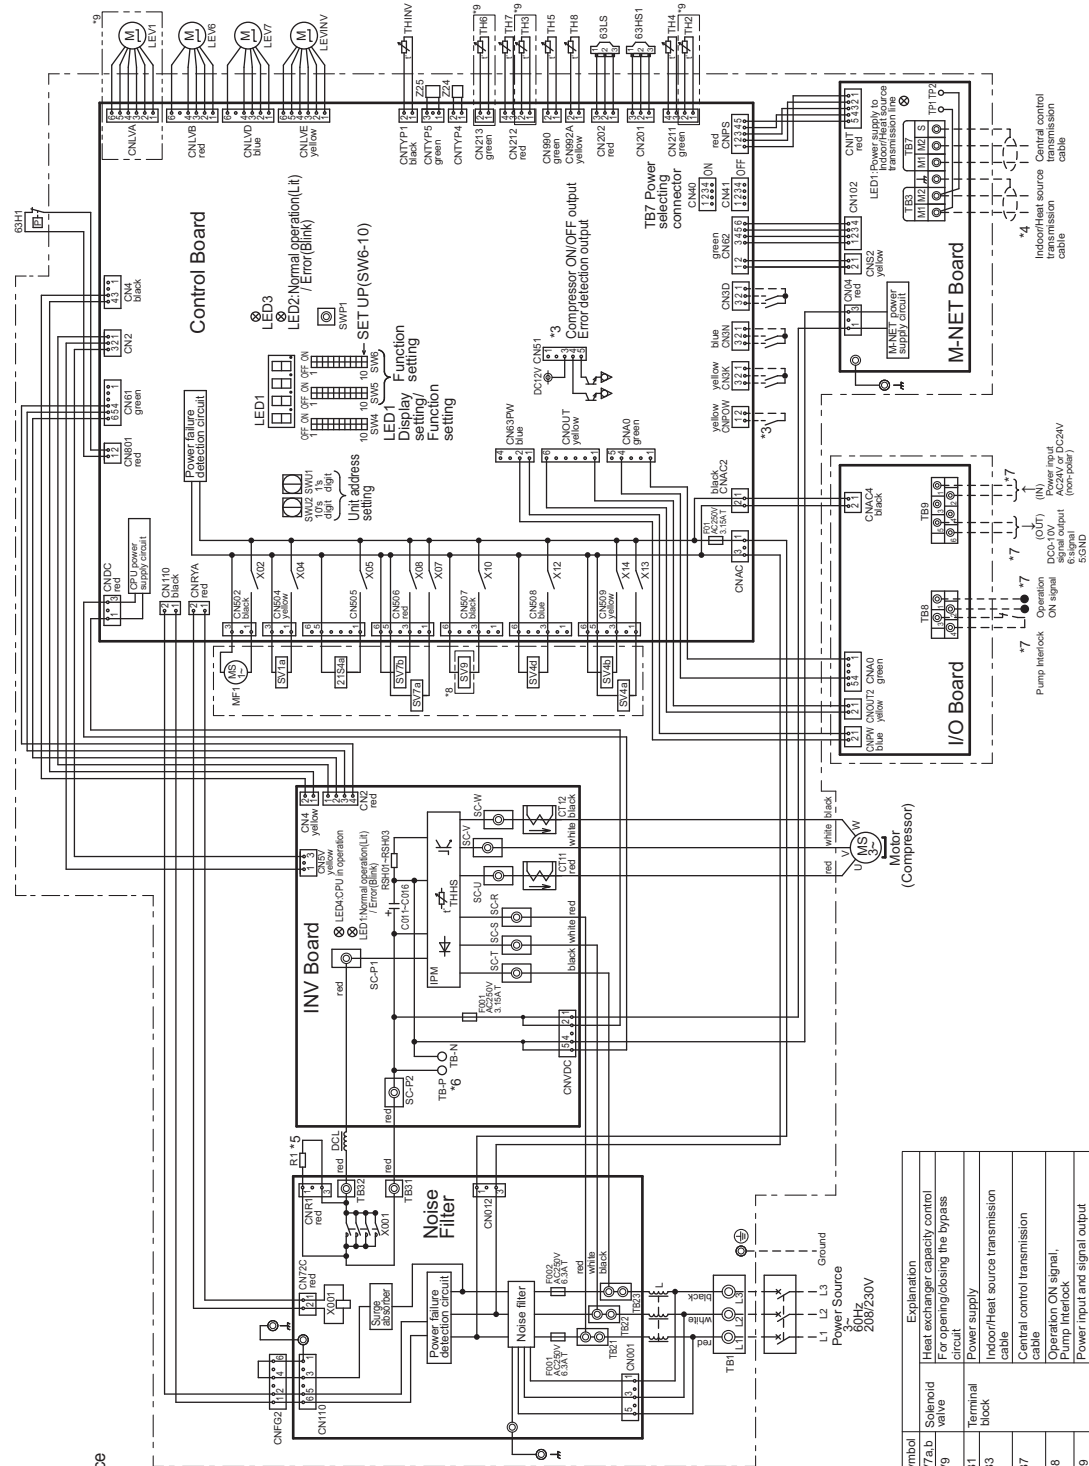

- *1 Single-dotted lines indicate wiring not supplied with the unit.
- *2 Dot-dash lines indicate the control box boundaries.
- *3 Refer to the Data book for connecting input/output signal connectors.
- *4 Daisy-chain terminals (TB3) on the heat source units in the same refrigerant system together.
- *5 Faston terminals have a locking function. Make sure the terminals are securely locked in place after insertion. Press the tab on the terminals to removed them.
- *6 Control box houses high-voltage parts. Before inspecting the inside of the control box turn off the power keep the unit off for at least 10 minutes, and confirm that the voltage between TB-P and TB-N on INV Board has dropped to DC20V or less.
- *7 Refer to the Data book for wiring terminal block for Pump Interlock, Operation ON signal,DC0-10V signal output and Power input(24V).
- *8 Difference of appliance.
- *9 Difference of appliance.


Model name	Appliance
PQHY	* 8 do not exist
PQRY	* 8 exist

Model name	Appliance
PQHY	* 9 exist
PQRY	* 9 do not exist

<Symbol explanation>

Symbol	Symbol	Explanation
2/1S4a	SV7a/b	Heat exchanger capacity control
63H1	SV9	Solenoid valve
63HS1	TB1	For opening/closing the bypass circuit
X001	TB3	Power supply
C011-C016	TB7	Indoor/Heat source transmission cable
CT11,12	TB7	Central control transmission cable
DC	TB8	Operation ON signal, Pump interlock
LEV1	TB9	Power input and signal output for variable water flow valve
LEV6	TH2	Thermistor
LEV6	TH3	Subcool bypass outlet temperature
LEV6	TH4	Pipe temperature
LEV6	TH5	Heat exchanger capacity control
LEV6	TH6	Heat exchanger for inverter
LEV6	TH7	Heat exchanger for inverter
LEV6	TH8	Water inlet temperature
LEV6	TH9	Water outlet temperature
LEV6	TH10	Outlet temp detect of heat exchanger for inverter
LEV6	TH11	IPM temperature
LEV6	TH12	Function setting connector

WY

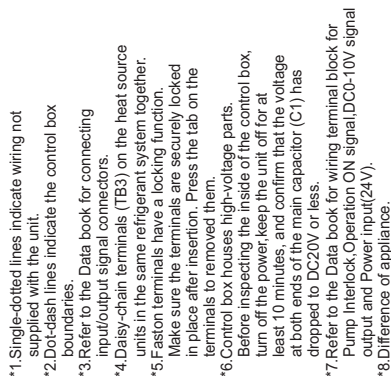


Model name	Appliance
PQHY	*8 do not exist
PQRY	*8 exist

ifference of appliance.

Model name	Appliance
PQHY	*9 exist
PQRY	*9 do not exist

Symbol	Expansion
21S4a	Cooling/heating switching
21S4b	Heat exchanger capacity control
63H1	High pressure protection for the heat source unit
63H2	High pressure
63S1	High pressure
63S2	High pressure
63S3	Magnetic relay (inverter main circuit)
C1	Capacitor (inverter main circuit)
ACCT1.1	Current sensor (AC)
DCCT1	Current sensor (DC)
DC reactor	
D	Choke coil (for high frequency noise reduction)
L	Inductor
LEV1	HFC bypass Controls (refrigerant flow in HFC circuit)
LEV6	Heat exchanger capacity control
LEV7	Heat exchanger capacity control
LEVINV	Heat exchanger for inverter
MF1	Fan motor (Radial panel)
RT1	For rush current prevention
SV1a	For opening/closing the bypass
Solenoid valve	For opening the O/S capacity control
SV4a,b,d	Heat exchanger capacity control
SV7a,b,g	Heat exchanger capacity control
SV9	For opening/closing the bypass circuit
Terminal block	Power supply
TB1	Indoor/Heat source transmission cable
TB3	
TB7	Central control transmission
TB8	Operation ON signal
TB9	Pump Interlock
TE9	Power input and signal output for variable water flow valve
TH2	Subcool bypass outlet temperature
TH3	Pipe temperature
TH4	Discharge pipe temperature
TH5	Discharge pipe temperature
TH6	Subcool bypass inlet temperature
TH7	Water inlet temperature
TH8	Water outlet temperature
TH9	Outlet temp. detect of heat source unit for inverter
TH10	RPI temperature
TH15	Function setting connector
TH25	
TH26	
TH27	
TH28	

PQHY-P216, 240TLMU-A

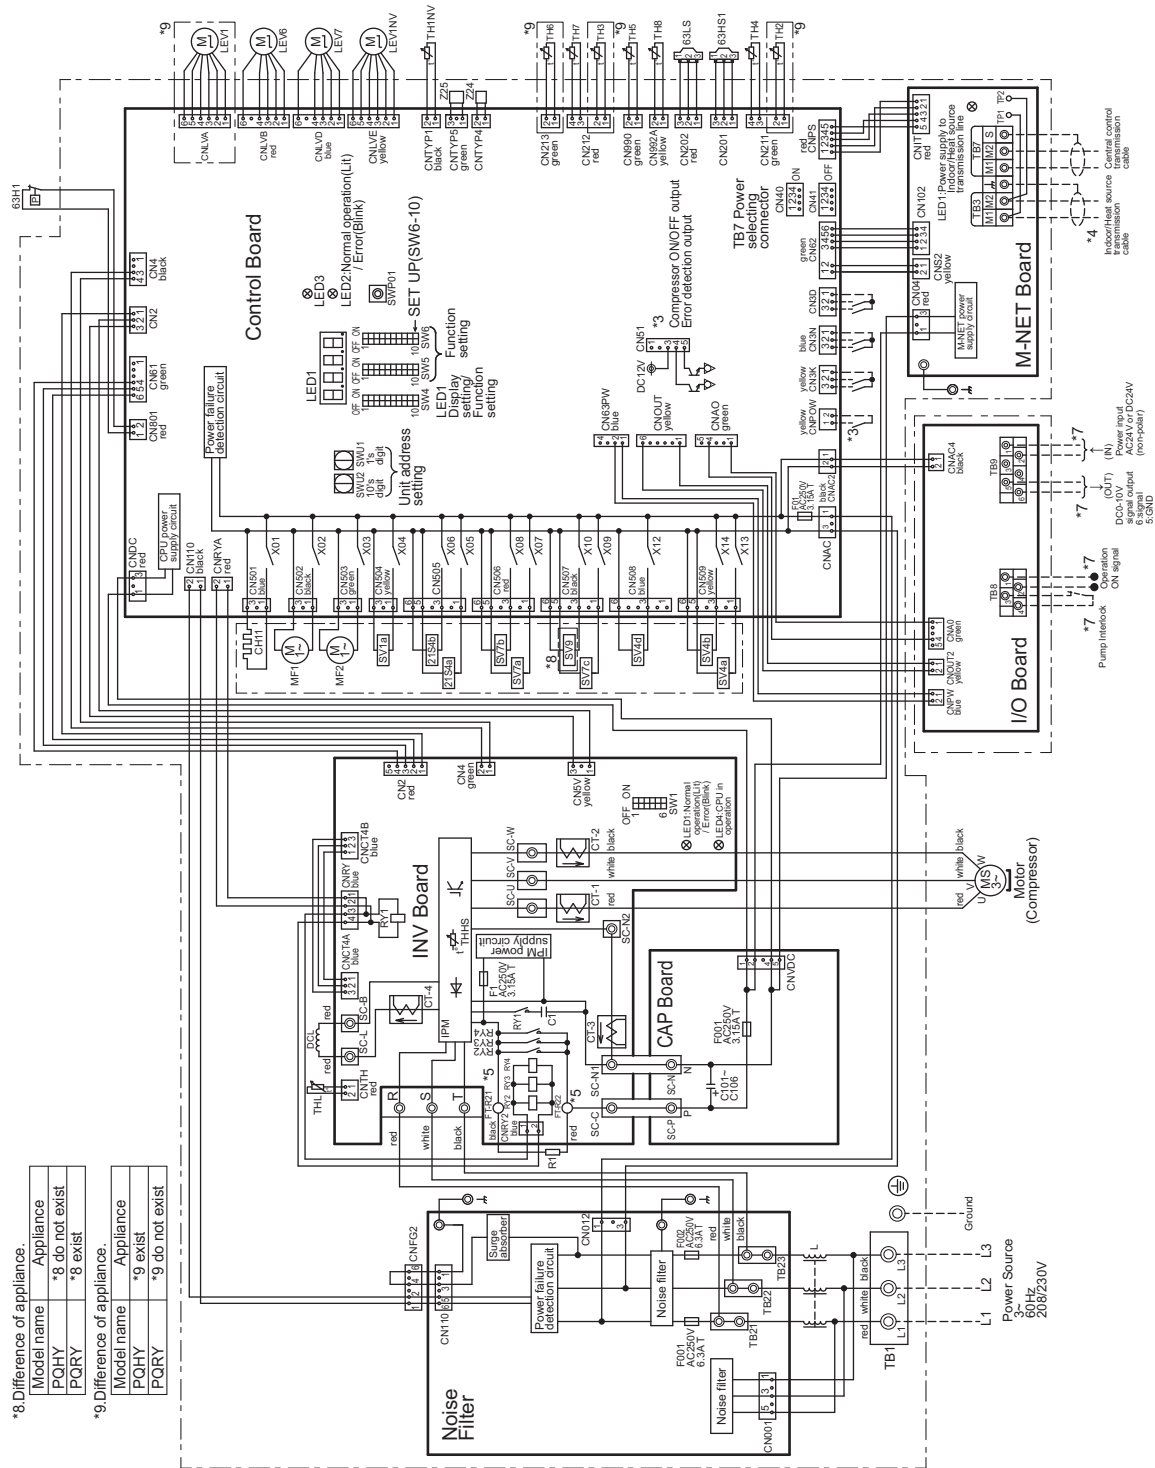


- *1. Single-dotted lines indicate wiring not supplied with the unit.
- *2. Dot-dash lines indicate the control box boundaries.
- *3. Refer to the Data book for connecting input/output signal connectors.
- *4. Daisy-chain terminals (TB3) on the heat source units in the same refrigerant system together.
- *5. Faston terminals have a locking function. Make sure the terminals are securely locked in place after insertion. Press the tab on the terminals to removed them.
- *6. Control box houses high-voltage parts. Before inspecting the inside of the control box turn off the power, keep the unit off for at least 10 minutes, and confirm that the voltage between SC-P and SC-N on CAP Board has dropped to DC20V or less.
- *7. Refer to the Data book for wiring terminal block for Pump Interlock Operation ON signal DC0-10V signal output and Power input(24V).

<Symbol explanation>

Symbol	Explanation
21S4a	4-way valve
21S4b	Cooling/heating switching
63H1	Heat exchanger capacity control
R3HS1	Pressure switch
R3LS	High pressure protection for the heat source unit
C1	Pressure sensor
C101-CT06	Low pressure sensor
CT1	Capacitor filter circuit
CT101-CT06	Inverter main circuit
CT101-CT06	Crankcase heater(for heating the compressor)
CT101-CT06	Current sensor(AC)
CT101-CT06	Current sensor(DC)
DLL	Choke coil(for high frequency noise reduction)
LEV1	Linear
LEV6	HIC bypass Controls refrigerant flow in HIC circuit
LEV7	Heat exchanger capacity control
LEV/V	Heat exchanger capacity control
MF1,MF2	Heat exchanger for inverter
RT	Fan motor(Radiator panel)
RY1	Resistor(for inrush current prevention)
RY2,R3,R4	Magnetic
SV1a	Inverter main circuit (ZCC)
SV4a,b,d	Overload protection for the bypass circuit under the DC bus
SV7a,b,c	Heat exchanger capacity control
SV9	For opening/closing the bypass circuit
TB1	Terminal block
TB3	Power supply
TB7	Indoor/Heat source transmission cable
TB8	Central control transmission cable
TB9	Operation ON signal, Pump interlock
TH2	Pump interlock signal output for variable water flow valve
TH3	Thermistor
TH4	Subcool bypass outlet temperature
TH5	Pipe temperature
TH6	Discharge pipe temperature
TH7	ACC inlet pipe temperature
TH8	Subcooled liquid refrigerant temperature
TH9	Water inlet temperature
TH10	Water outlet temperature
TH11	Outlet temp. detect of heat exchanger for inverter
TH12	High temperature
TH13	Low temperature
Z24, 25	Function setting connector

PQHY-P72, 96, 120, 144, 168, 192, 216, 240YLMU-A

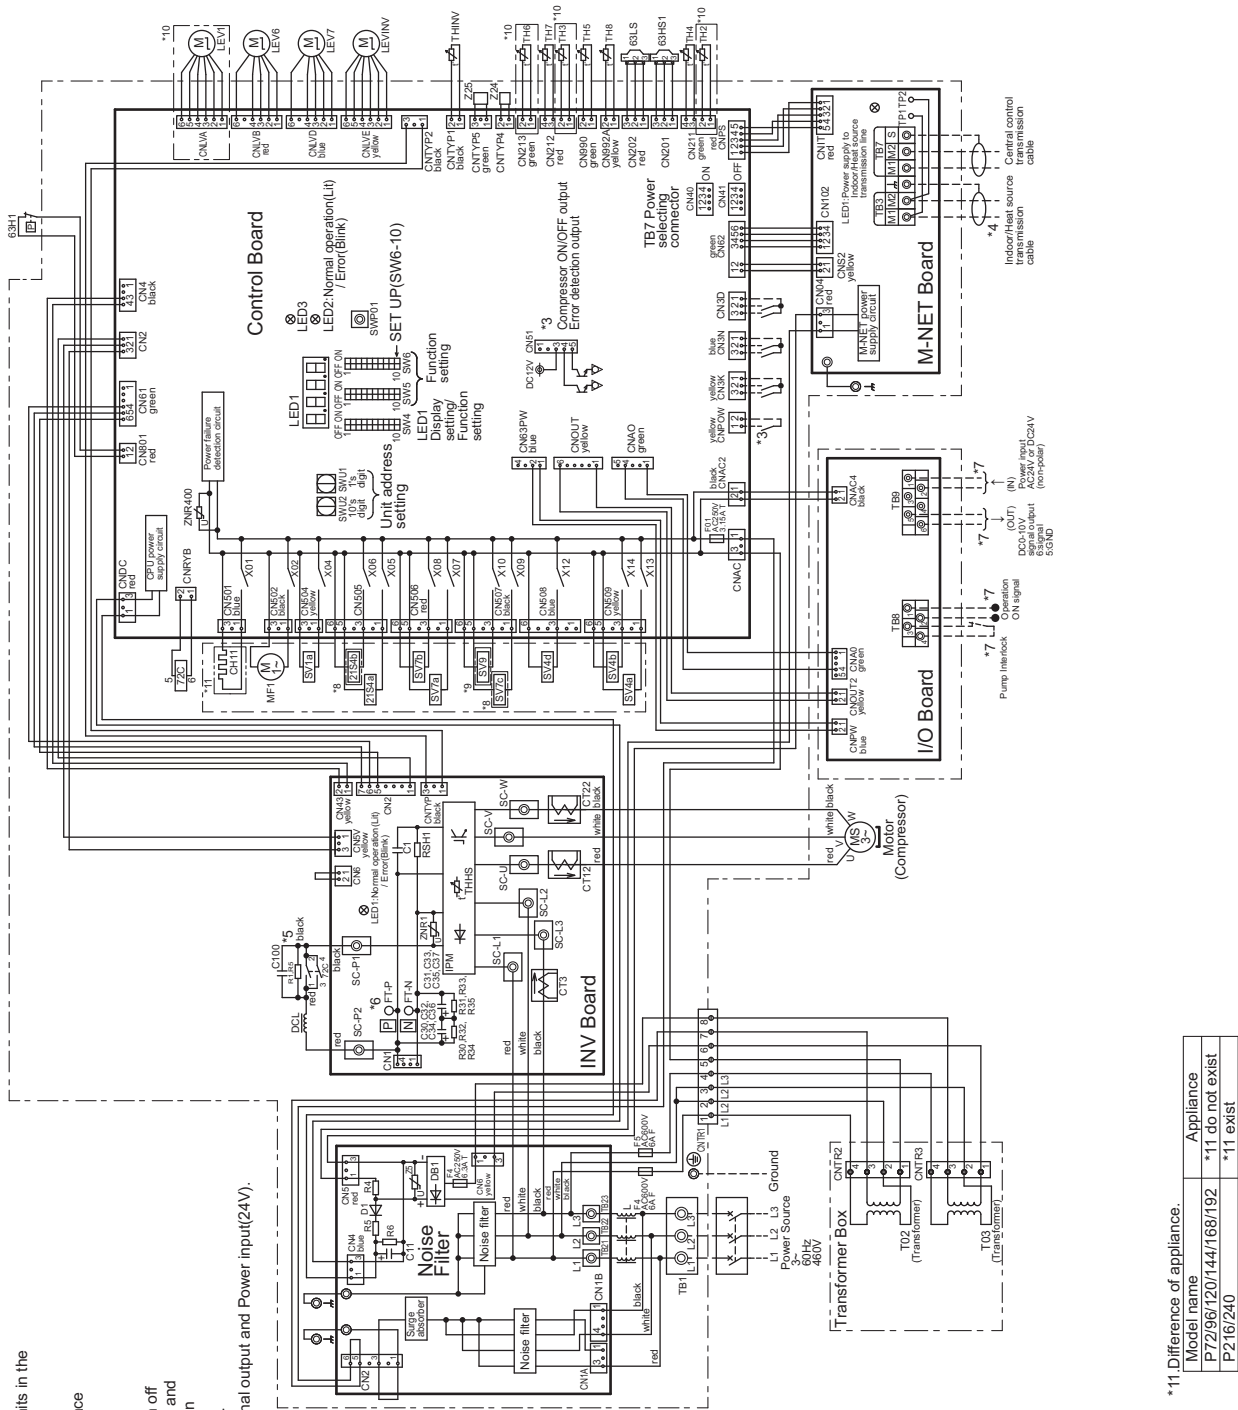

- *1. Single-dotted lines indicate wiring not supplied with the unit.
- *2. Dot-dash lines indicate the control box boundaries.
- *3. Refer to the Data book for connecting input/output signal connectors.
- *4. Daisy-chain terminals (TB3) on the heat source units in the same refrigerant system together.
- *5. Faston terminals have a locking function. Make sure the terminals are securely locked in place after insertion. Press the tab on the terminals to removed them.
- *6. Control box houses high-voltage parts. Before inspecting the inside of the control box turn off the power, keep the unit off for at least 10 minutes, and confirm that the voltage between F1-P and F1-N on INV Board has dropped to DC20V or less.
- *7. Refer to the Data book for wiring terminal block for Pump Interlock Operation ON signal; DC0-10V signal output and Power input(24V).
- *8. Difference of appliance.

Model name	Appliance
P72/96/120	*8 do not exist
P144/168/192/216/240	*8 exist

Model name	Appliance
POHY	*9 do not exist
PORY	*9 exist

Model name	Appliance
POHY	*10 exist
PORY	*10 do not exist

<Symbol explanation>


Symbol	Explanation
Z1S4a	4-way valve
Z1S4b	Heat exchanger capacity control
6SH1	Pressure switch
6SHS1	Pressure switch
63LS	Pressure sensor
72C	Magnetic relay (inverter main circuit)
C30-C37	Capacitor (inverter main circuit)
CH11	Crankcase heater (for heating the compressor)
CT12.22.3	Current sensor (AC)
DC reactor	Choke coil (for high frequency noise)
LEV1	Linear expansion valve
LEV6	HIC bypass Controls refrigerant flow in HIC circuit
LEV/V	Heat exchanger capacity control valve
LEV/V	Heat exchanger capacity control valve
MF1.5	Fan motor (Radiator panel)
RSH1	For current detection
SV1a	For opening/closing the bypass circuit under the O/S
SV4a.b.d	Heat exchanger capacity control
SV7a.b.c	Heat exchanger capacity control
SV9	For opening/closing the bypass circuit
TB1	Power supply
TB3	Indoor/Heat source transmission cable
TB7	Central control transmission cable
TB8	Operation ON signal, Pump Interlock
TB9	Operation ON signal, Pump Interlock
TH2	Thermistor
TH3	Subcool bypass outlet temperature
TH4	Pipe temperature
TH5	Discharge pipe temperature
TH6	ACC inlet pipe temperature
TH7	Subcooled liquid refrigerant temperature
TH8	Water inlet temperature
TH8	Water outlet temperature
TH8	Outlet temp. detect of heat exchanger
THHS	Water inlet temperature
Z24.25	Function setting connector

*11. Difference of appliance.


Model name	Appliance
P72/96/120/144/168/192	*11 do not exist
P216/240	*11 exist

U11 2nd

2 - 827

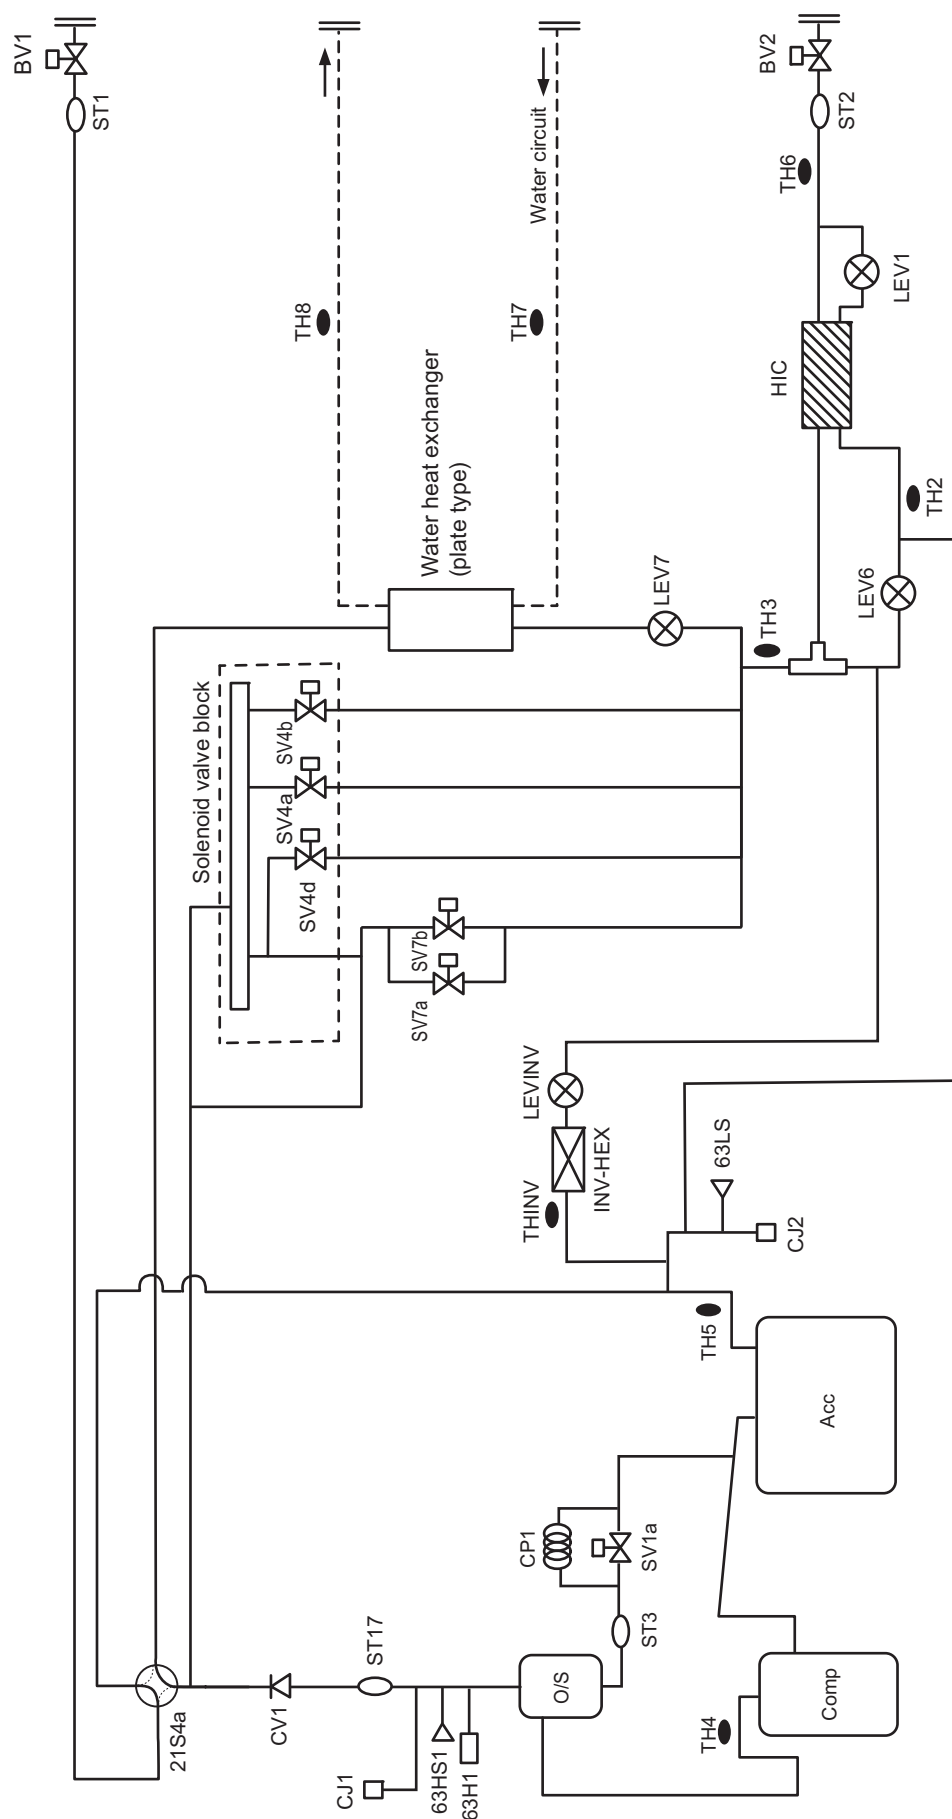


PQHY-P144, 168, 192TLMU-A/YLMU-A

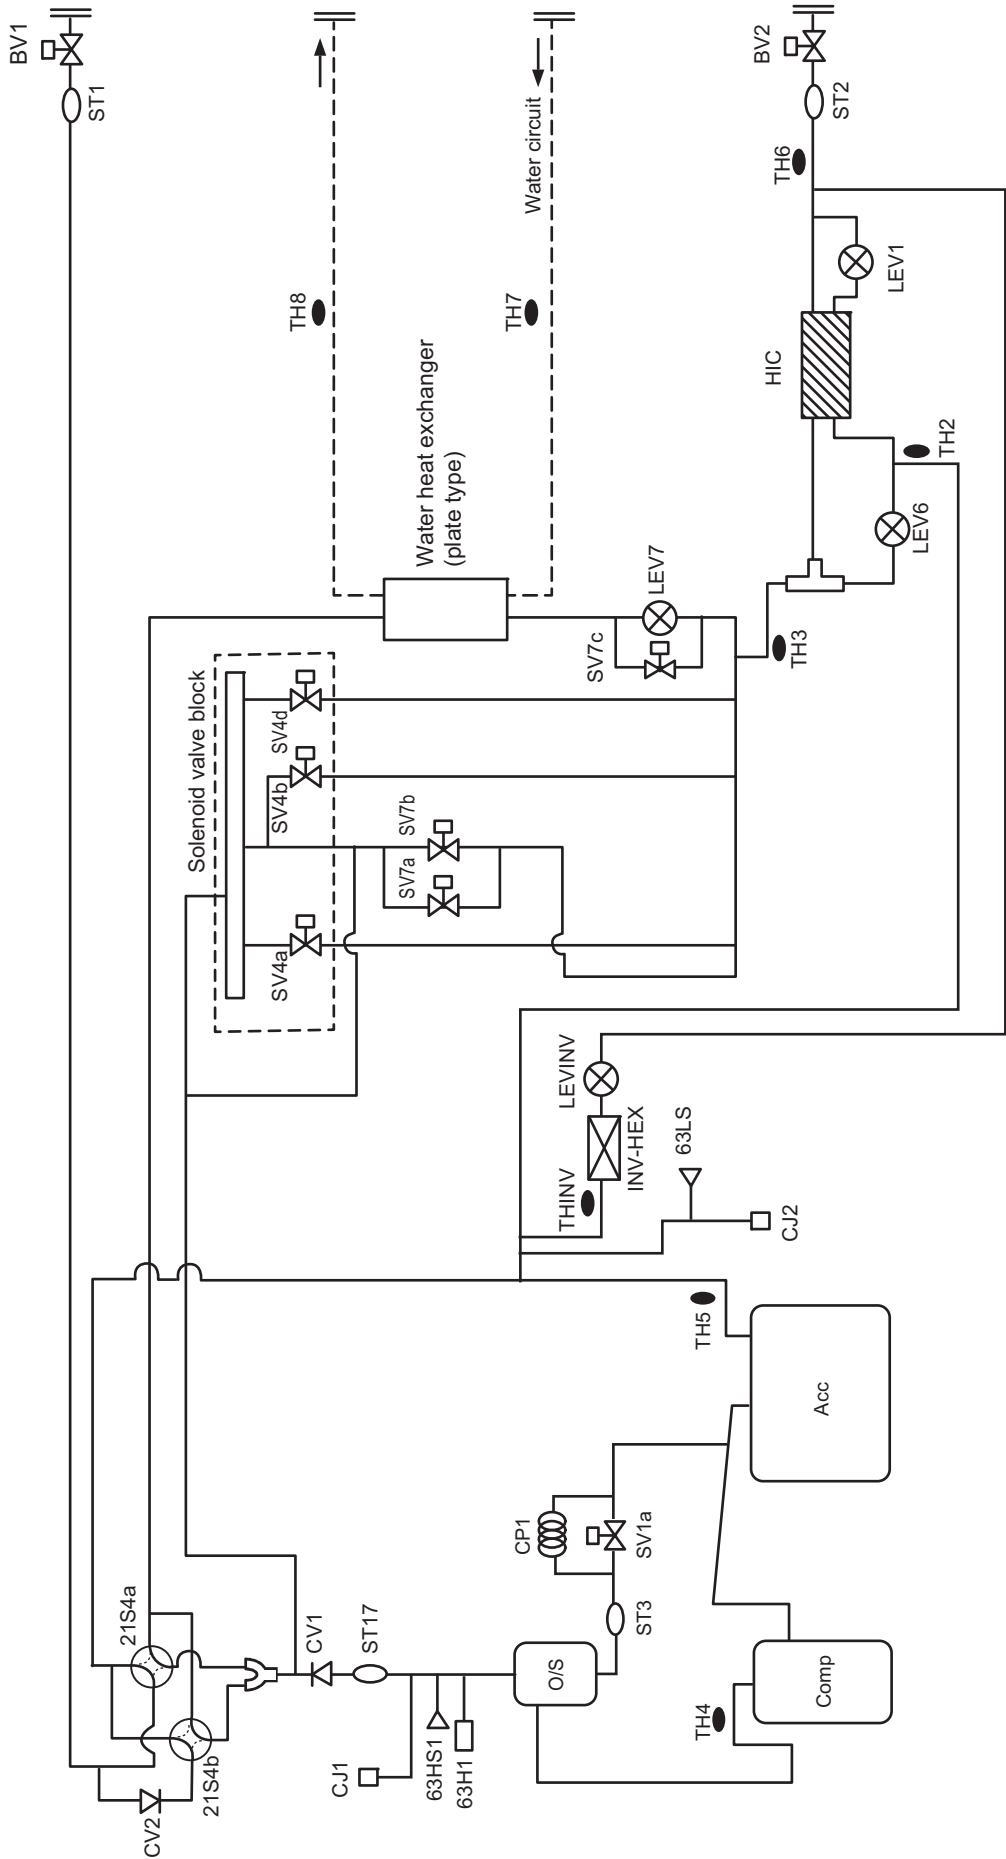


WY

U11 2nd


2 - 829

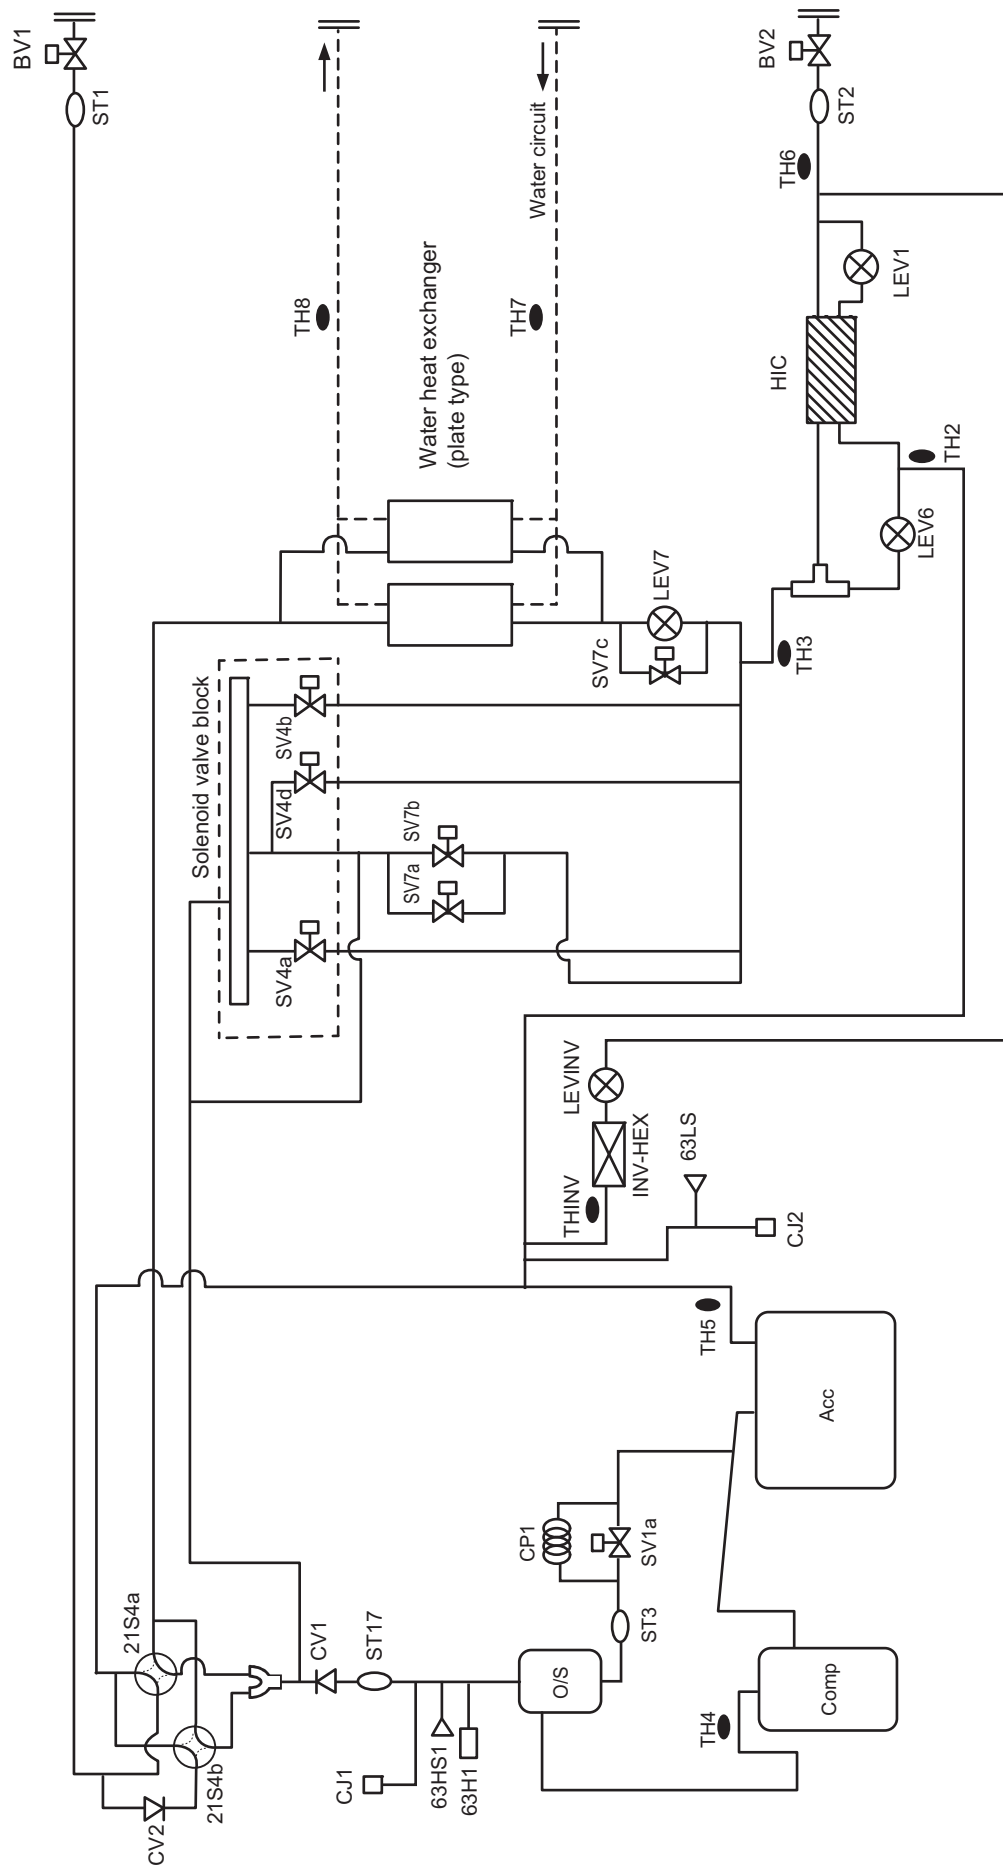

Measurement condition
PQHY-P72, 96, 120TLMU-A/YLMU-A

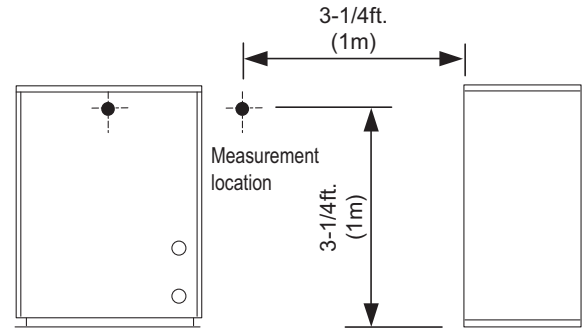


Sound level of PQHY-P120TLMU-A/YLMU-A

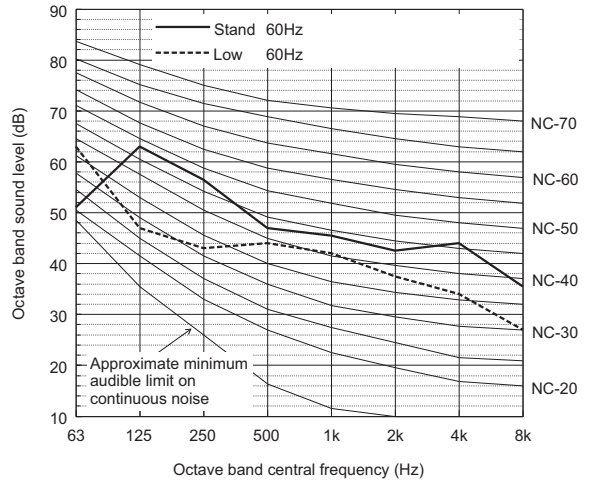

		63	125	250	500	1k	2k	4k	8k	dB(A)
Standard	60Hz	51.0	63.0	56.5	47.0	45.5	42.5	44.0	35.5	54.0
Low noise mode	60Hz	63.0	47.0	43.0	44.0	42.0	37.5	34.0	27.0	47.0

When Low noise mode is set, the A/C system's capacity is limited. The system could return to normal operation from Low noise mode automatically in the case that the operation condition is severe.


Sound level of PQHY-P72TLMU-A/YLMU-A

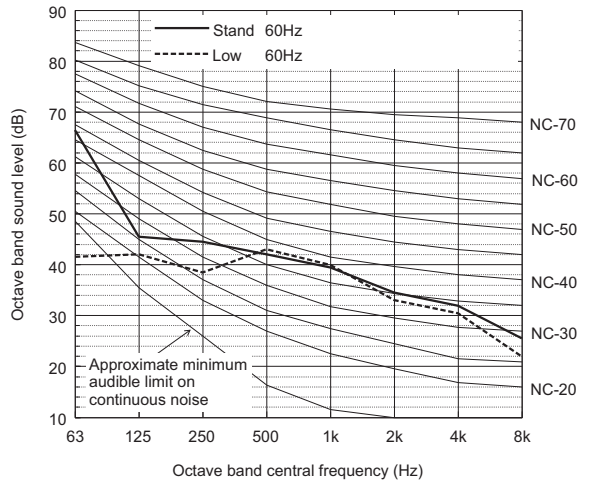

		63	125	250	500	1k	2k	4k	8k	dB(A)
Standard	60Hz	66.5	45.5	44.5	42.0	39.5	34.5	32.0	25.5	46.0
Low noise mode	60Hz	41.5	42.0	38.5	43.0	40.0	33.0	30.5	22.0	44.0

When Low noise mode is set, the A/C system's capacity is limited. The system could return to normal operation from Low noise mode automatically in the case that the operation condition is severe.



Sound level of PQHY-P96TLMU-A/YLMU-A

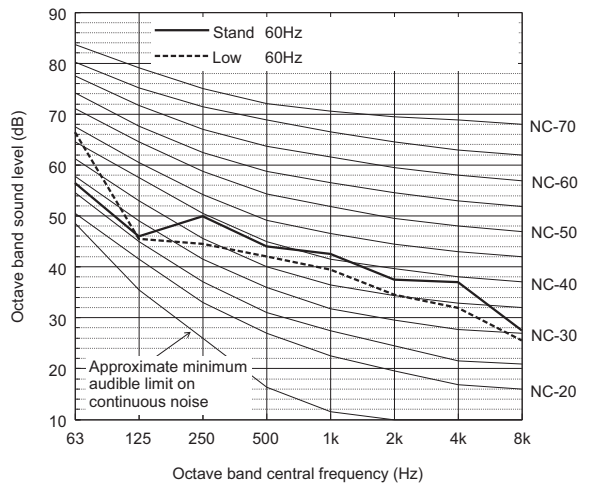

		63	125	250	500	1k	2k	4k	8k	dB(A)
Standard	60Hz	56.5	46.0	50.0	44.0	42.5	37.5	37.0	27.5	48.0
Low noise mode	60Hz	66.5	45.5	44.5	42.0	39.5	34.5	32.0	25.5	46.0


When Low noise mode is set, the A/C system's capacity is limited. The system could return to normal operation from Low noise mode automatically in the case that the operation condition is severe.

• Depending on the operation conditions, the unit generates noise caused by valve actuation, refrigerant flow, and pressure changes when operating normally. Please consider to avoid location where quietness is required.

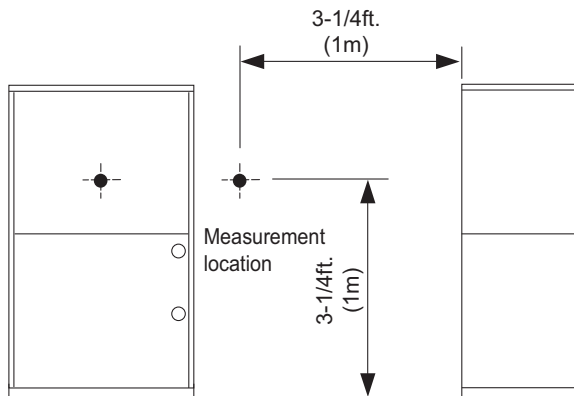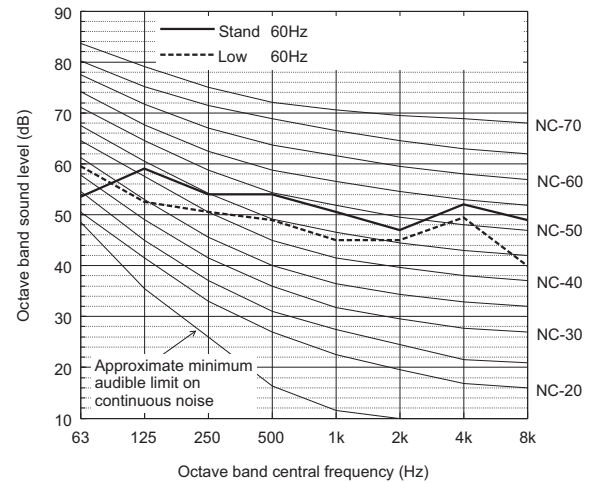Measurement condition
PQHY-P144, 168, 192, 216, 240TLMU-A/YLMU-A

Sound level of PQHY-P192TLMU-A/YLMU-A


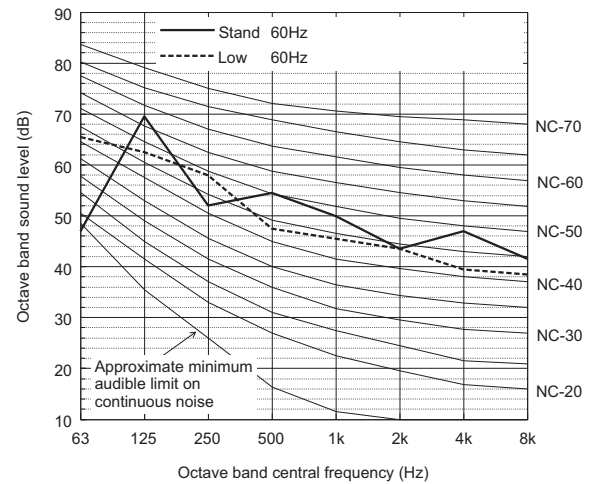
		63	125	250	500	1k	2k	4k	8k	dB(A)
Standard	60Hz	53.5	59.0	54.0	54.0	50.5	47.0	52.0	49.0	58.0
Low noise mode	60Hz	59.5	52.5	50.5	49.0	45.0	45.0	49.5	40.0	54.0

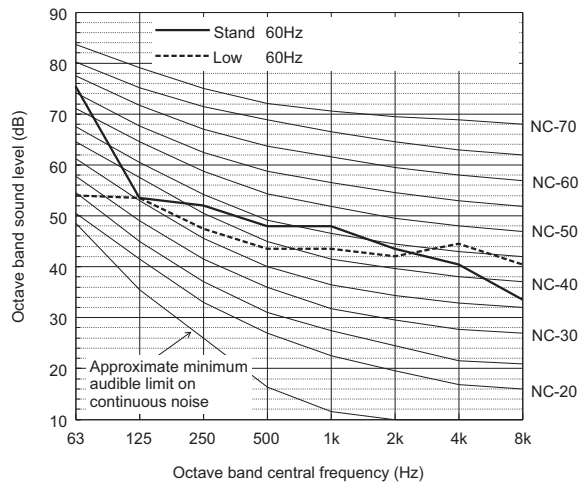When Low noise mode is set, the A/C system's capacity is limited. The system could return to normal operation from Low noise mode automatically in the case that the operation condition is severe.

Sound level of PQHY-P144TLMU-A/YLMU-A


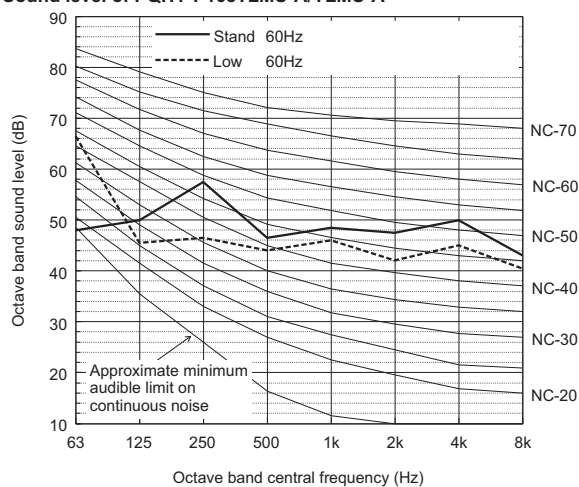
		63	125	250	500	1k	2k	4k	8k	dB(A)
Standard	60Hz	75.5	53.5	52.0	48.0	43.5	40.5	33.5	54.0	
Low noise mode	60Hz	54.0	53.5	47.5	43.5	43.5	42.0	44.5	40.5	50.5

When Low noise mode is set, the A/C system's capacity is limited. The system could return to normal operation from Low noise mode automatically in the case that the operation condition is severe.

Sound level of PQHY-P216TLMU-A/YLMU-A


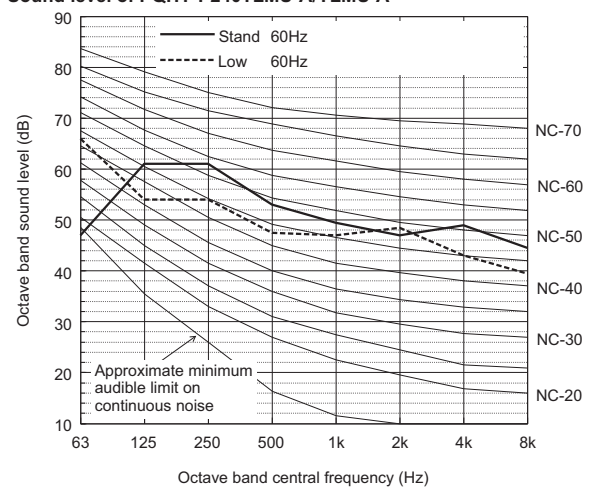
		63	125	250	500	1k	2k	4k	8k	dB(A)
Standard	60Hz	47.0	69.5	52.0	54.5	50.0	43.5	47.0	41.5	58.0
Low noise mode	60Hz	65.5	62.5	58.0	47.5	45.5	43.5	39.5	38.5	54.0

When Low noise mode is set, the A/C system's capacity is limited. The system could return to normal operation from Low noise mode automatically in the case that the operation condition is severe.

Sound level of PQHY-P168TLMU-A/YLMU-A


		63	125	250	500	1k	2k	4k	8k	dB(A)
Standard	60Hz	48.0	50.0	57.5	46.5	48.5	47.5	50.0	43.0	56.0
Low noise mode	60Hz	66.5	45.5	46.5	44.0	46.0	42.0	45.0	40.5	51.5



When Low noise mode is set, the A/C system's capacity is limited. The system could return to normal operation from Low noise mode automatically in the case that the operation condition is severe.

Sound level of PQHY-P240TLMU-A/YLMU-A


		63	125	250	500	1k	2k	4k	8k	dB(A)
Standard	60Hz	47.0	61.0	61.0	53.0	49.5	47.0	49.0	44.5	58.0
Low noise mode	60Hz	66.0	54.0	54.0	47.5	47.0	48.5	43.0	39.5	54.0


When Low noise mode is set, the A/C system's capacity is limited. The system could return to normal operation from Low noise mode automatically in the case that the operation condition is severe.

♦ Depending on the operation conditions, the unit generates noise caused by valve actuation, refrigerant flow, and pressure changes when operating normally. Please consider to avoid location where quietness is required.

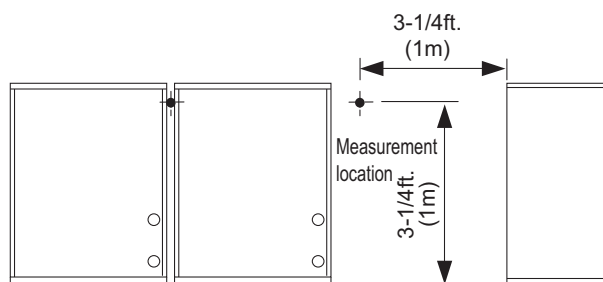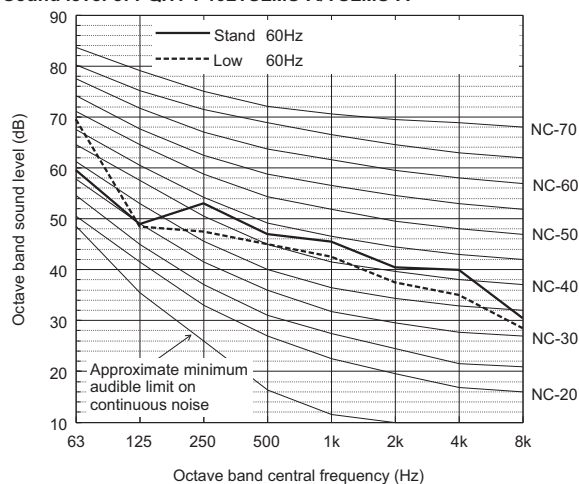Measurement condition
PQHY-P144, 168, 192, 216, 240TSLMU-A/YSLMU-A

Sound level of PQHY-P192TSLMU-A/YSLMU-A


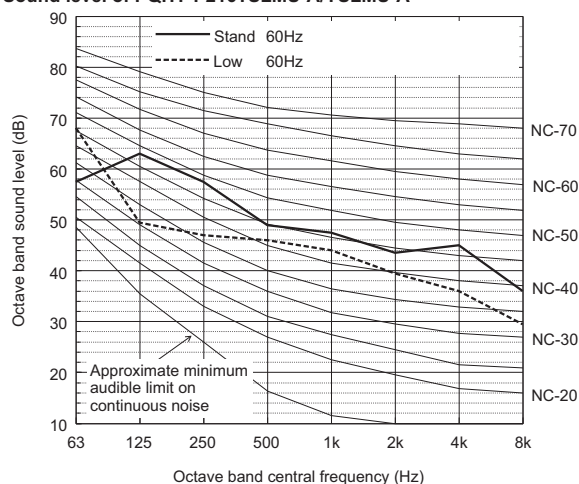
		63	125	250	500	1k	2k	4k	8k	dB(A)
Standard	60Hz	59.5	49.0	53.0	47.0	45.5	40.5	40.0	30.5	51.0
Low noise mode	60Hz	69.5	48.5	47.5	45.0	42.5	37.5	35.0	28.5	49.0

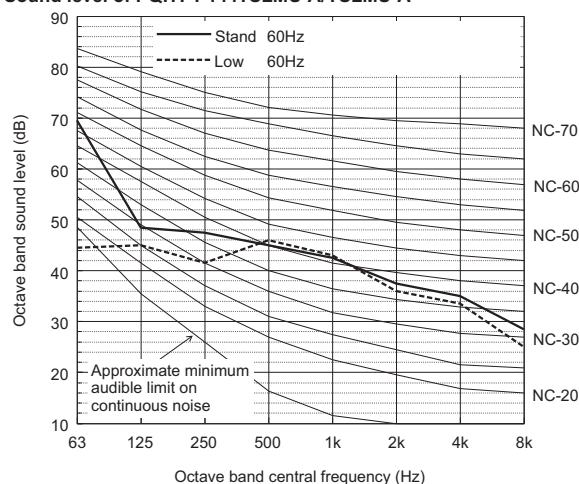When Low noise mode is set, the A/C system's capacity is limited. The system could return to normal operation from Low noise mode automatically in the case that the operation condition is severe.

Sound level of PQHY-P144TSLMU-A/YSLMU-A


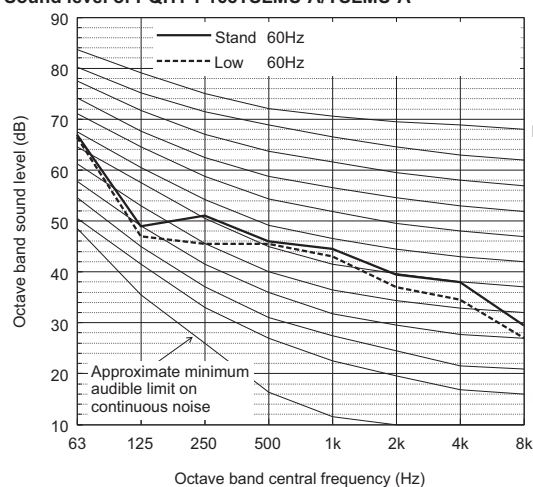
		63	125	250	500	1k	2k	4k	8k	dB(A)
Standard	60Hz	69.5	48.5	47.5	45.0	42.5	37.5	35.0	28.5	49.0
Low noise mode	60Hz	44.5	45.0	41.5	46.0	43.0	36.0	33.5	25.0	47.0

When Low noise mode is set, the A/C system's capacity is limited. The system could return to normal operation from Low noise mode automatically in the case that the operation condition is severe.

Sound level of PQHY-P216TSLMU-A/YSLMU-A


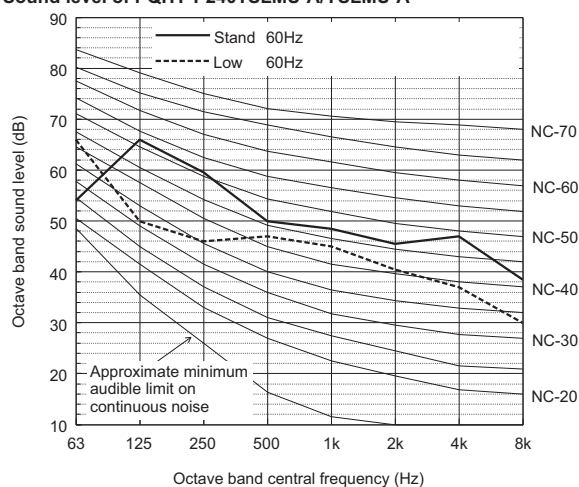
		63	125	250	500	1k	2k	4k	8k	dB(A)
Standard	60Hz	57.5	63.0	57.5	49.0	47.5	43.5	45.0	36.0	55.0
Low noise mode	60Hz	68.0	49.5	47.0	46.0	44.0	39.5	36.0	29.5	49.5

When Low noise mode is set, the A/C system's capacity is limited. The system could return to normal operation from Low noise mode automatically in the case that the operation condition is severe.

Sound level of PQHY-P168TSLMU-A/YSLMU-A


		63	125	250	500	1k	2k	4k	8k	dB(A)
Standard	60Hz	67.0	49.0	51.0	46.0	44.5	39.5	38.0	29.5	50.0
Low noise mode	60Hz	66.5	47.0	45.5	45.5	43.0	37.0	34.5	27.0	48.0



When Low noise mode is set, the A/C system's capacity is limited. The system could return to normal operation from Low noise mode automatically in the case that the operation condition is severe.

Sound level of PQHY-P240TSLMU-A/YSLMU-A


		63	125	250	500	1k	2k	4k	8k	dB(A)
Standard	60Hz	54.0	66.0	59.5	50.0	48.5	45.5	47.0	38.5	57.0
Low noise mode	60Hz	66.0	50.0	46.0	47.0	45.0	40.5	37.0	30.0	50.0


When Low noise mode is set, the A/C system's capacity is limited. The system could return to normal operation from Low noise mode automatically in the case that the operation condition is severe.

• Depending on the operation conditions, the unit generates noise caused by valve actuation, refrigerant flow, and pressure changes when operating normally. Please consider to avoid location where quietness is required.

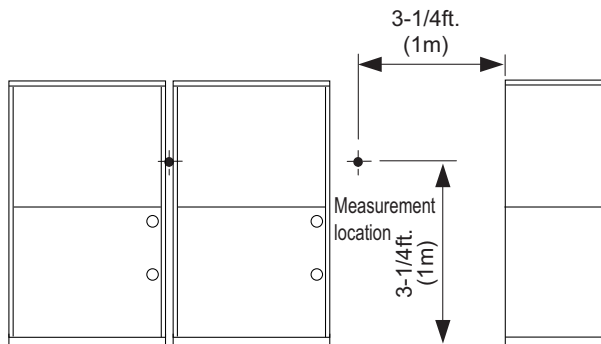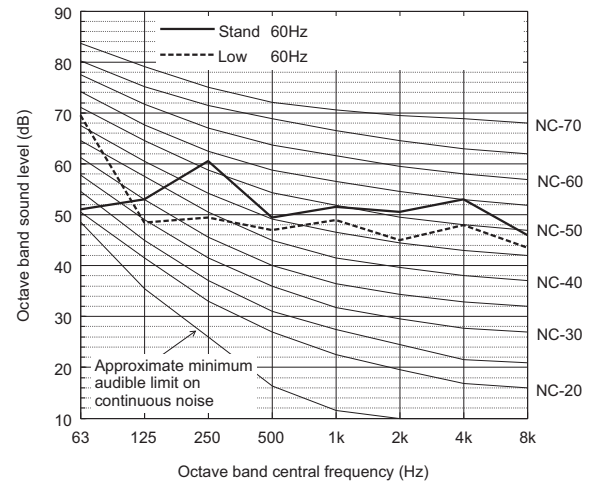Measurement condition
PQHY-P288, 312, 336, 360TSLMU-A/YSLMU-A

Sound level of PQHY-P336TSLMU-A/YSLMU-A


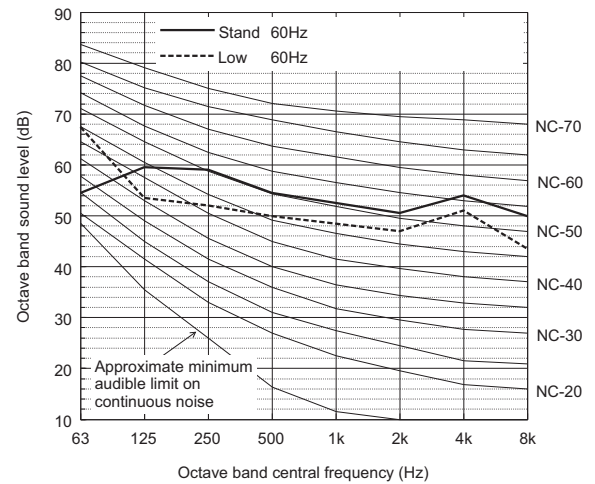
		63	125	250	500	1k	2k	4k	8k	dB(A)
Standard	60Hz	51.0	53.0	60.5	49.5	51.5	50.5	53.0	46.0	59.0
Low noise mode	60Hz	69.5	48.5	49.5	47.0	49.0	45.0	48.0	43.5	54.5

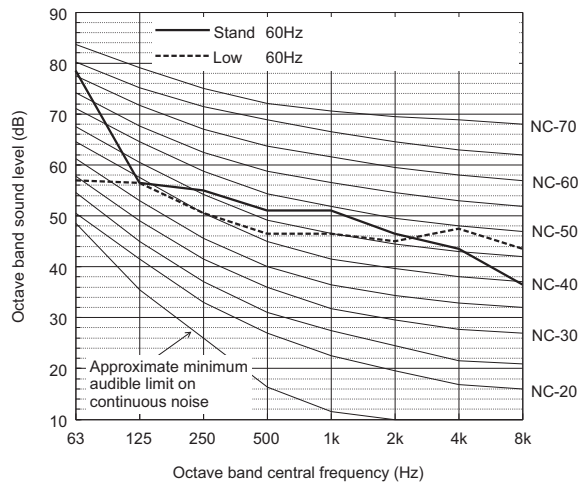When Low noise mode is set, the A/C system's capacity is limited. The system could return to normal operation from Low noise mode automatically in the case that the operation condition is severe.

Sound level of PQHY-P288TSLMU-A/YSLMU-A


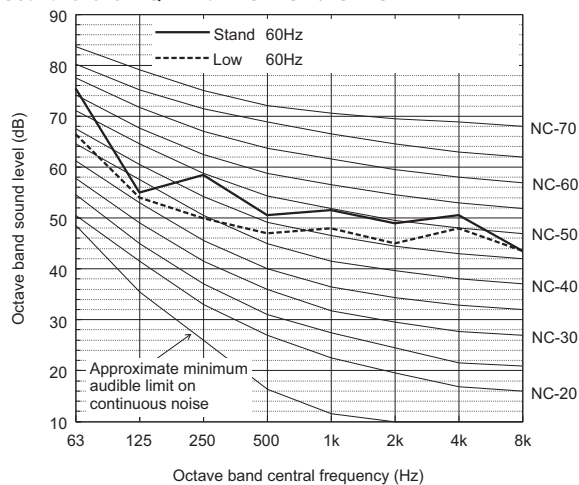
		63	125	250	500	1k	2k	4k	8k	dB(A)
Standard	60Hz	78.5	56.5	55.0	51.0	51.0	46.5	43.5	36.5	57.0
Low noise mode	60Hz	57.0	56.5	50.5	46.5	46.5	45.0	47.5	43.5	53.5

When Low noise mode is set, the A/C system's capacity is limited. The system could return to normal operation from Low noise mode automatically in the case that the operation condition is severe.

Sound level of PQHY-P360TSLMU-A/YSLMU-A


		63	125	250	500	1k	2k	4k	8k	dB(A)
Standard	60Hz	54.5	59.5	59.0	54.5	52.5	50.5	54.0	50.0	60.0
Low noise mode	60Hz	67.5	53.5	52.0	50.0	48.5	47.0	51.0	43.5	56.0

When Low noise mode is set, the A/C system's capacity is limited. The system could return to normal operation from Low noise mode automatically in the case that the operation condition is severe.


Sound level of PQHY-P312TSLMU-A/YSLMU-A


		63	125	250	500	1k	2k	4k	8k	dB(A)
Standard	60Hz	75.5	55.0	58.5	50.5	51.5	49.0	50.5	43.5	58.0
Low noise mode	60Hz	66.5	54.0	50.0	47.0	48.0	45.0	48.0	43.5	54.0


When Low noise mode is set, the A/C system's capacity is limited. The system could return to normal operation from Low noise mode automatically in the case that the operation condition is severe.

- Depending on the operation conditions, the unit generates noise caused by valve actuation, refrigerant flow, and pressure changes when operating normally. Please consider to avoid location where quietness is required.

• Cooling

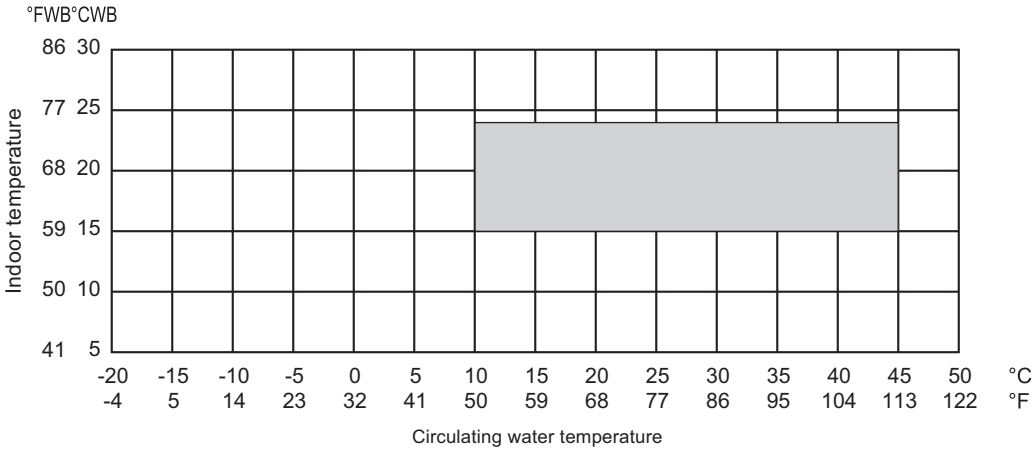





• Heating

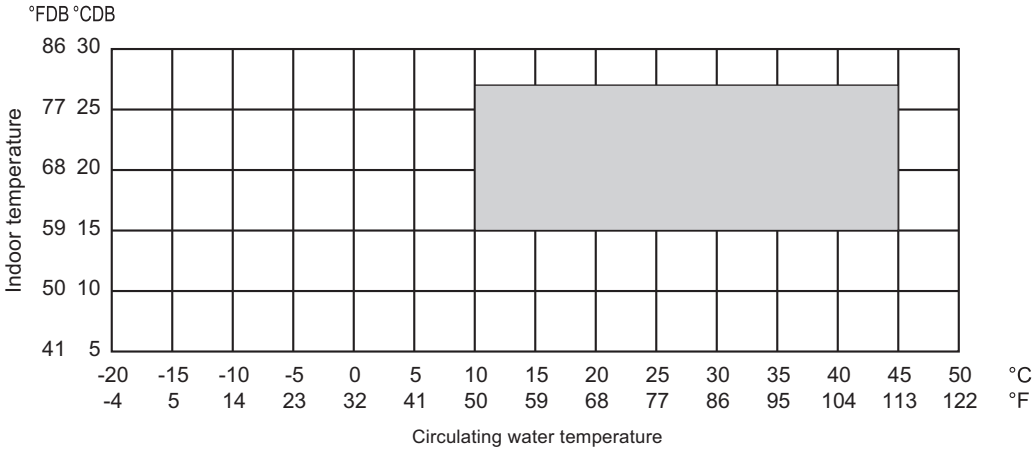





8-1. Correction by temperature

CITY MULTI could have varied capacity at different designing temperature. Using the nominal cooling/heating capacity value and the ratio below, the capacity can be observed at various temperature.



PQHY-			P72TLMU/YLMU		
Nominal Cooling Capacity	kW	21.1	Rated Cooling Capacity	kW	20.2
	BTU/h	72,000		BTU/h	69,000
Input	kW	3.23	Input	kW	(Non-Ducted) 2.96 (Ducted) 3.12

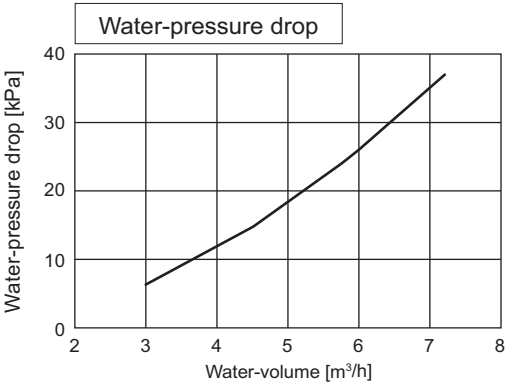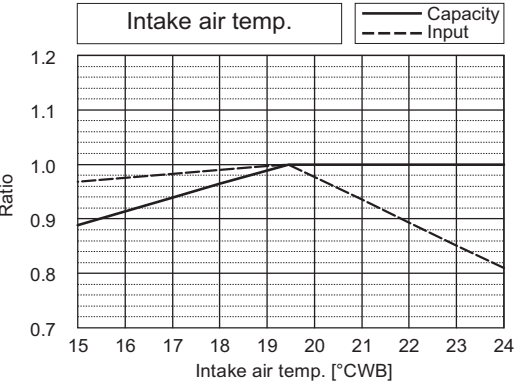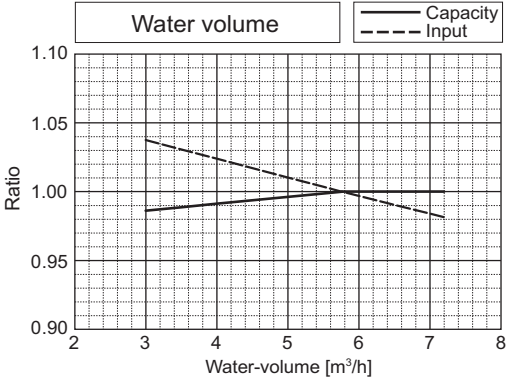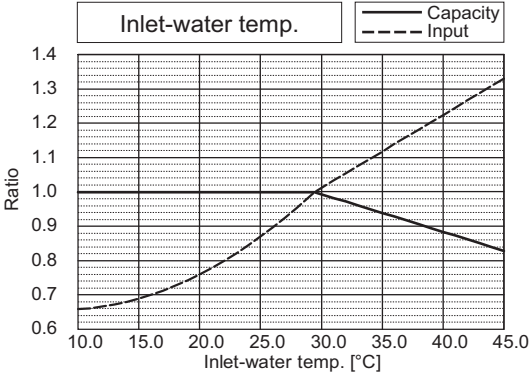







PQHY-			P72TLMU/YLMU		
Nominal Heating Capacity	kW	23.4	Rated Heating Capacity	kW	22.3
	BTU/h	80,000		BTU/h	76,000
Input	kW	3.63	Input	kW	(Non-Ducted) 3.34 (Ducted) 3.36

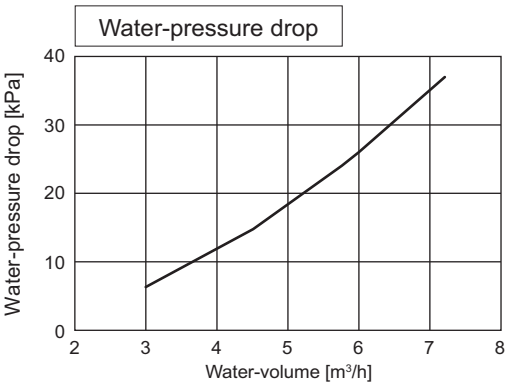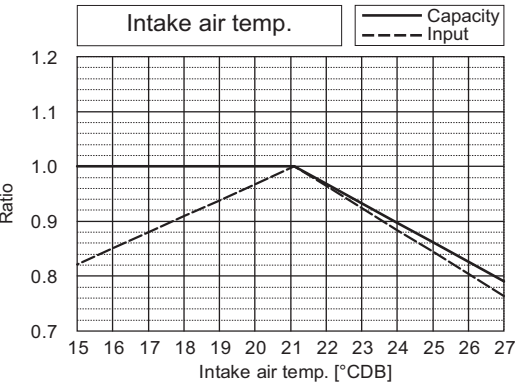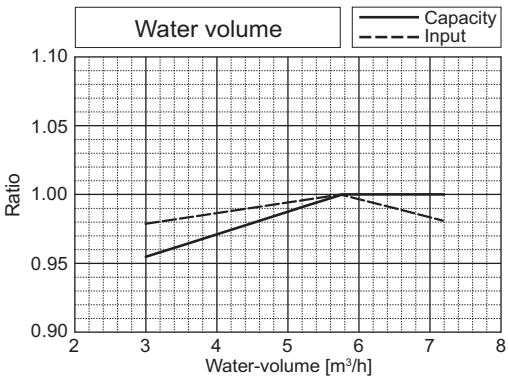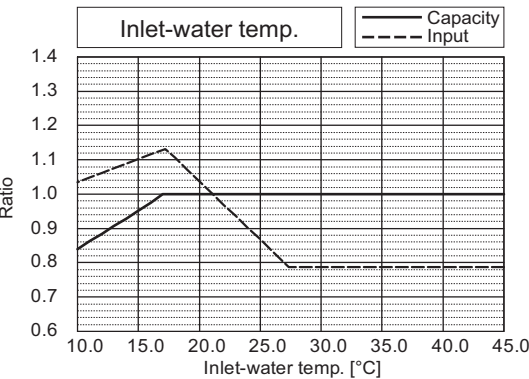



PQHY-			P96TLMU/YLMU		
Nominal Cooling Capacity	kW	28.1	Rated Cooling Capacity	kW	27.0
	BTU/h	96,000		BTU/h	92,000
Input	kW	4.65	Input	kW	(Non-Ducted) 4.26 (Ducted) 5.19

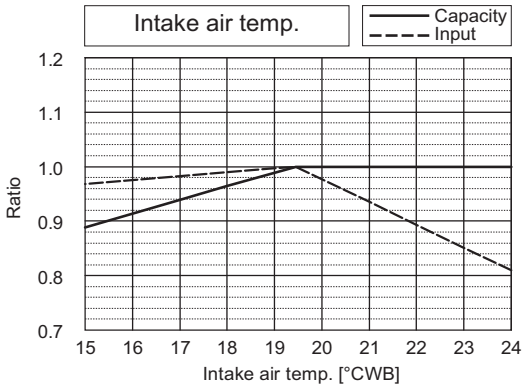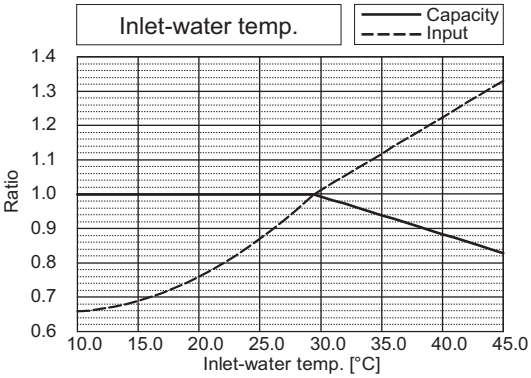







PQHY-			P96TLMU/YLMU		
Nominal Heating Capacity	kW	31.7	Rated Heating Capacity	kW	30.2
	BTU/h	108,000		BTU/h	103,000
Input	kW	5.05	Input	kW	(Non-Ducted) 4.65 (Ducted) 4.48

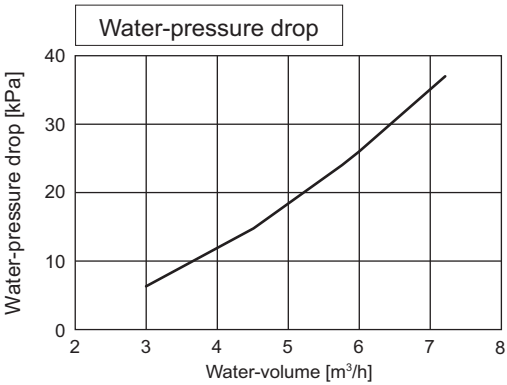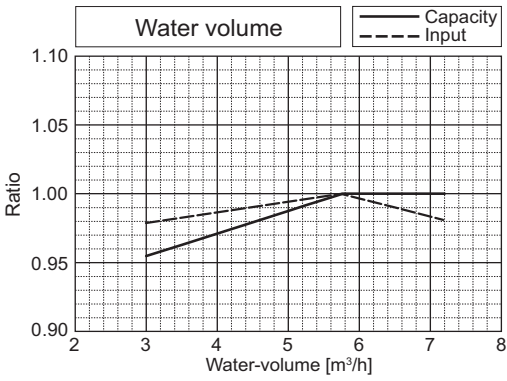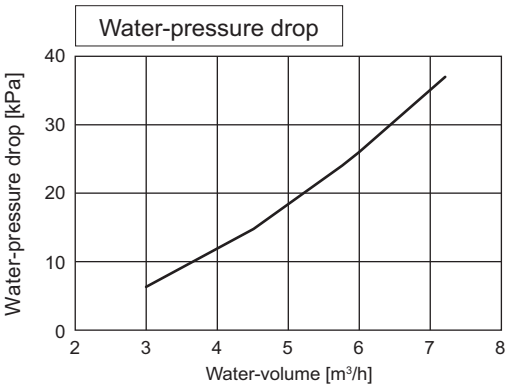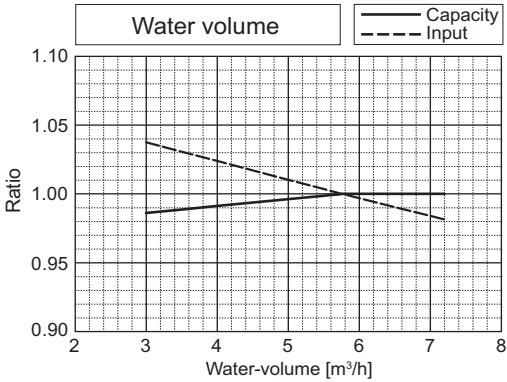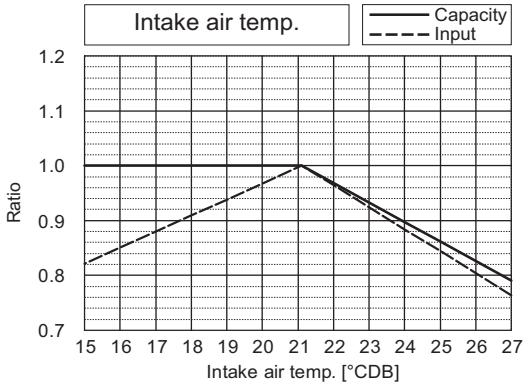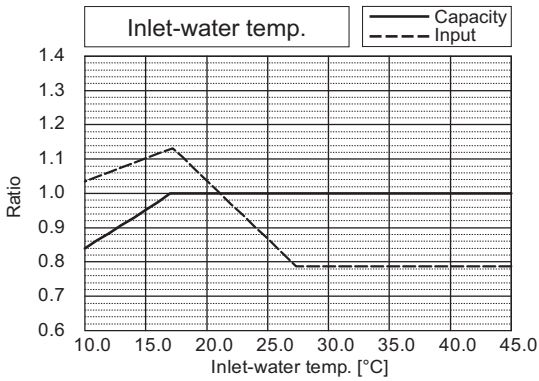





PQHY-		P120TLMU/YLMU			
Nominal Cooling Capacity	kW	35.2	Rated Cooling Capacity	kW	33.4
	BTU/h	120,000		BTU/h	114,000
Input	kW	7.24	Input	kW	(Non-Ducted) 6.66 (Ducted) 7.35

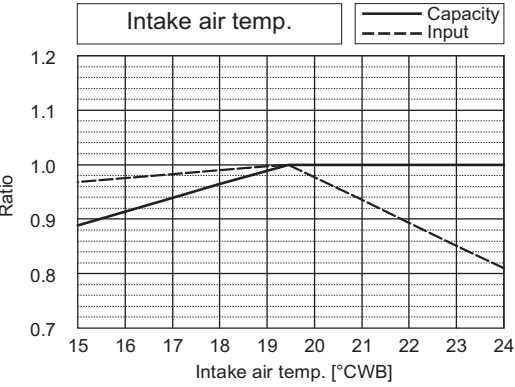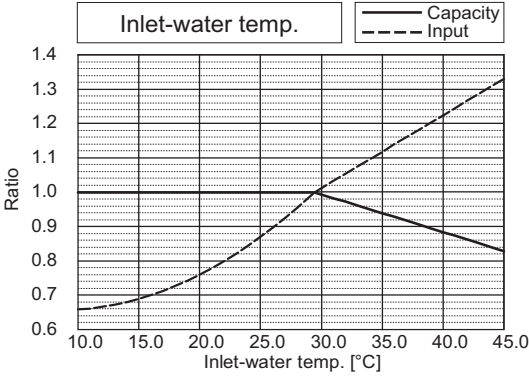





PQHY-		P120TLMU/YLMU			
Nominal Heating Capacity	kW	39.6	Rated Heating Capacity	kW	37.8
	BTU/h	135,000		BTU/h	129,000
Input	kW	6.83	Input	kW	(Non-Ducted) 6.29 (Ducted) 5.92

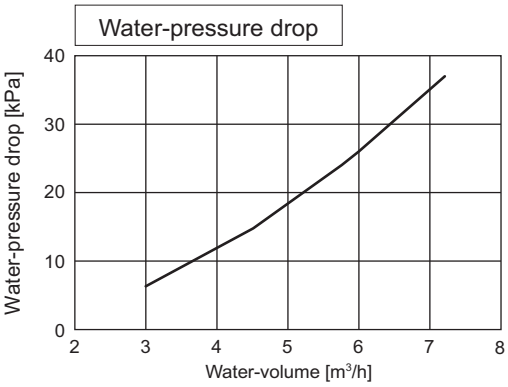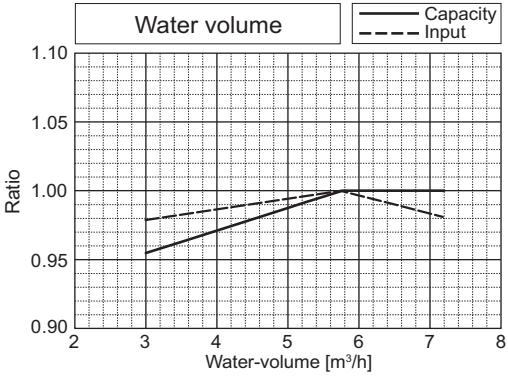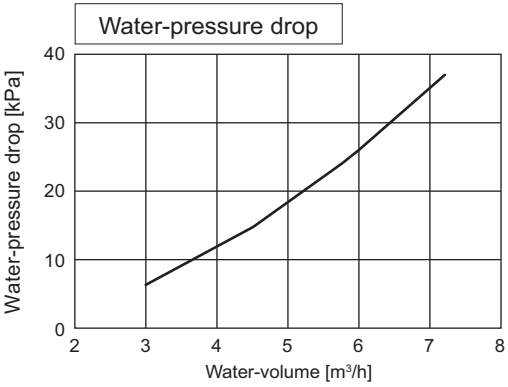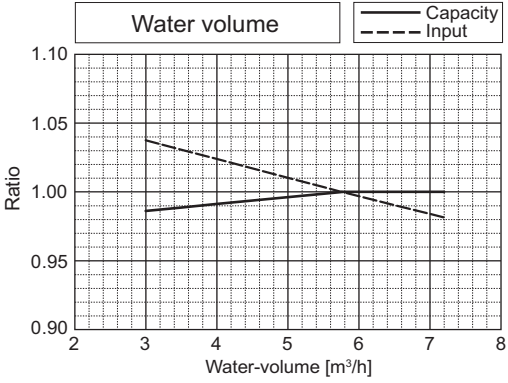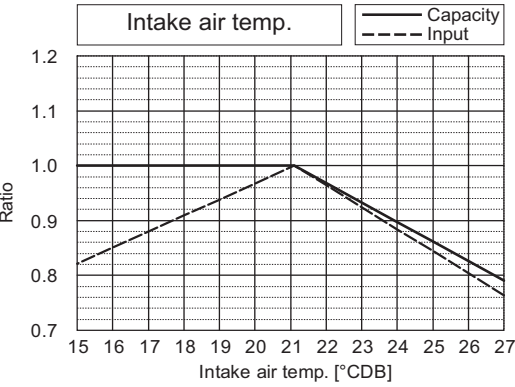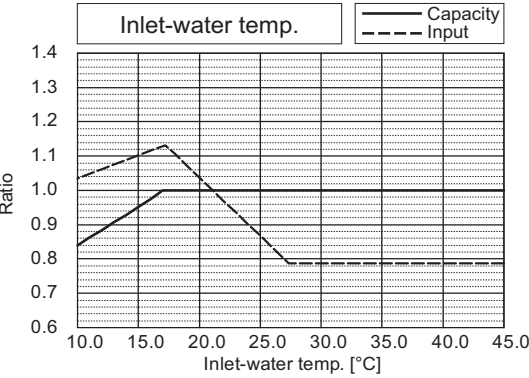





PQHY-			P144TLMU/YLMU		
Nominal Cooling Capacity	kW	42.2	Rated Cooling Capacity	kW	40.2
	BTU/h	144,000		BTU/h	137,000
Input	kW	8.78	Input	kW	(Non-Ducted) 8.07 (Ducted) 9.98

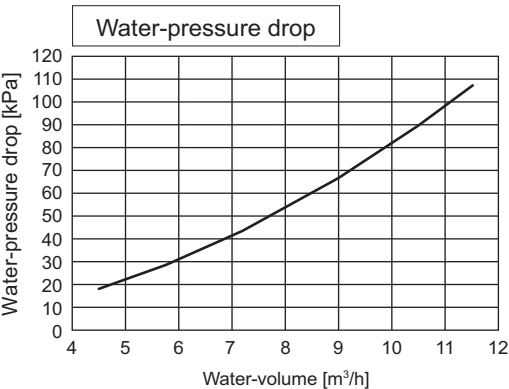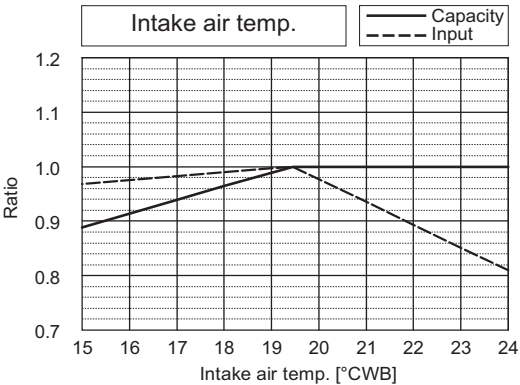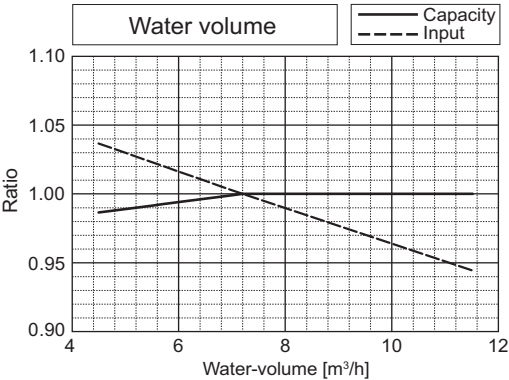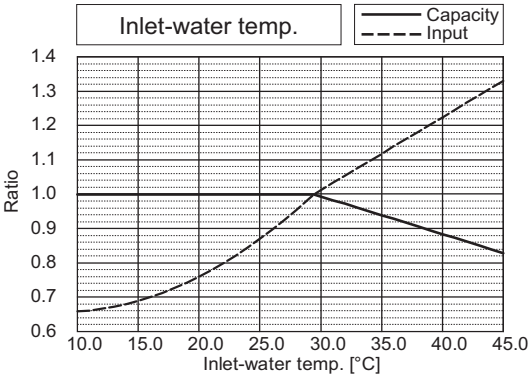





PQHY-			P144TLMU/YLMU		
Nominal Heating Capacity	kW	46.9	Rated Heating Capacity	kW	44.5
	BTU/h	160,000		BTU/h	152,000
Input	kW	8.11	Input	kW	(Non-Ducted) 7.47 (Ducted) 7.90

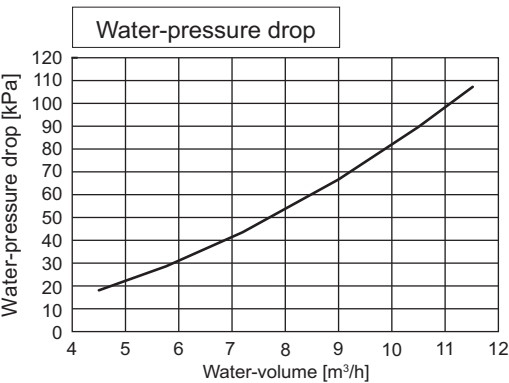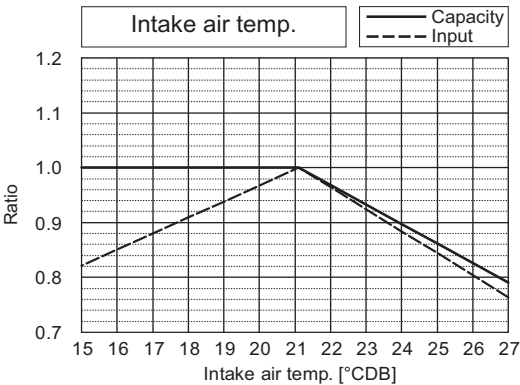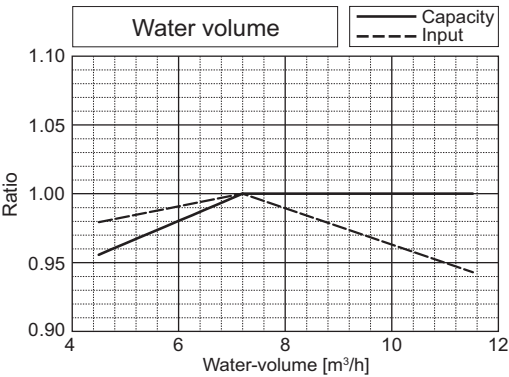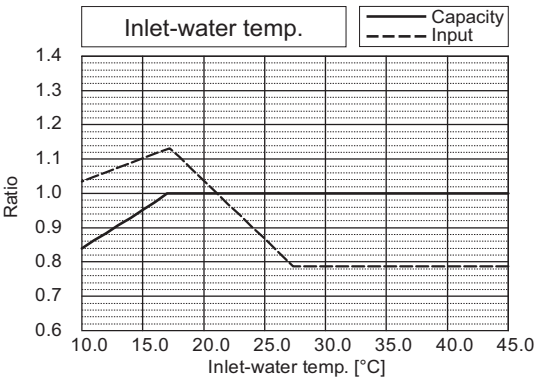



PQHY-		P168TLMU/YLMU			
Nominal Cooling Capacity	kW	49.2	Rated Cooling Capacity	kW	47.2
	BTU/h	168,000		BTU/h	161,000
Input	kW	12.05	Input	kW	(Non-Ducted) 11.10 (Ducted) 11.88

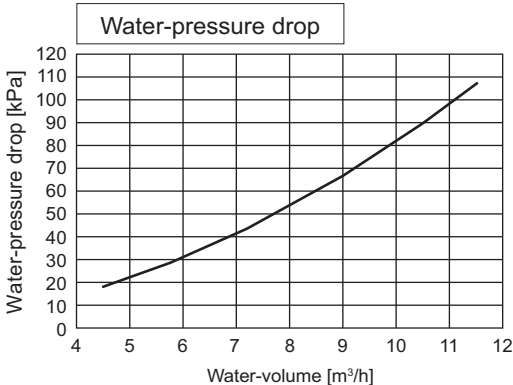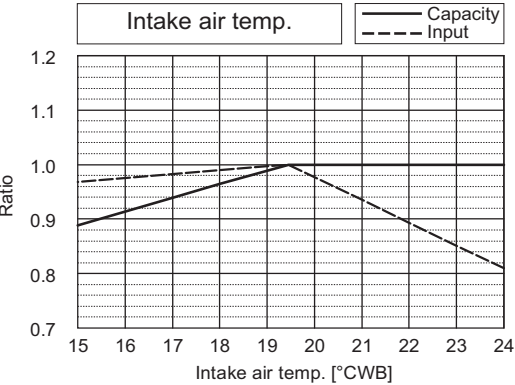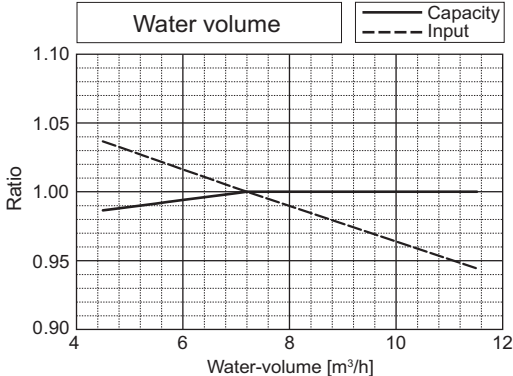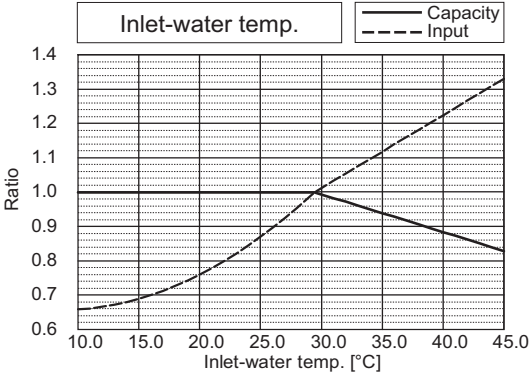







PQHY-		P168TLMU/YLMU			
Nominal Heating Capacity	kW	55.1	Rated Heating Capacity	kW	52.5
	BTU/h	188,000		BTU/h	179,000
Input	kW	9.86	Input	kW	(Non-Ducted) 9.09 (Ducted) 9.72

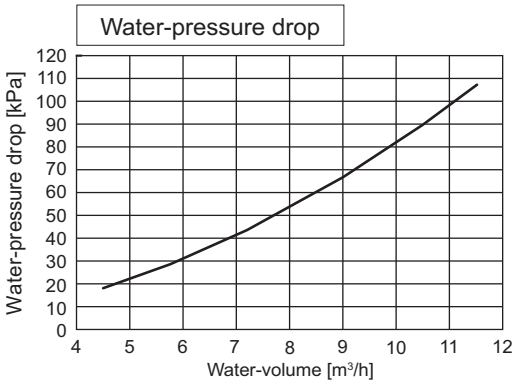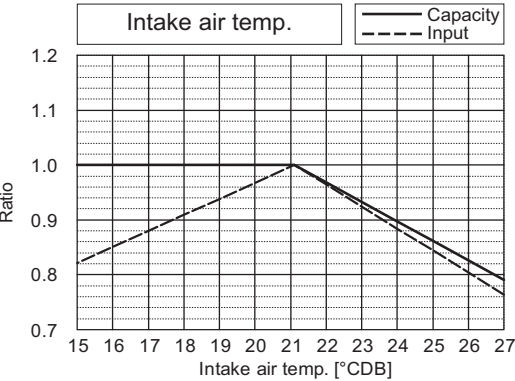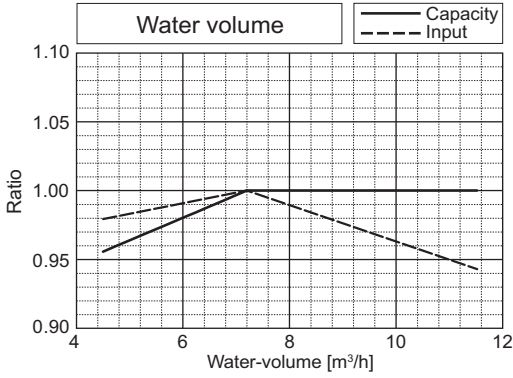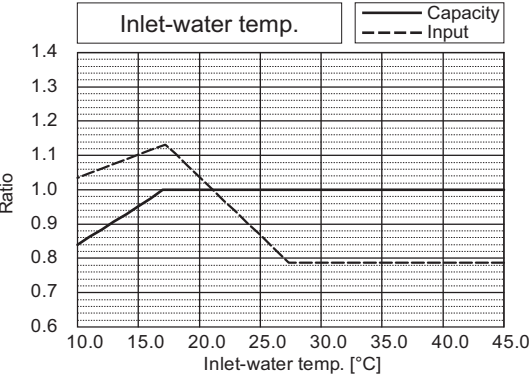





PQHY-			P192TLMU/YLMU		
Nominal Cooling Capacity	kW	56.3	Rated Cooling Capacity	kW	53.6
	BTU/h	192,000		BTU/h	183,000
Input	kW	15.05	Input	kW	(Non-Ducted) 13.87 (Ducted) 14.19

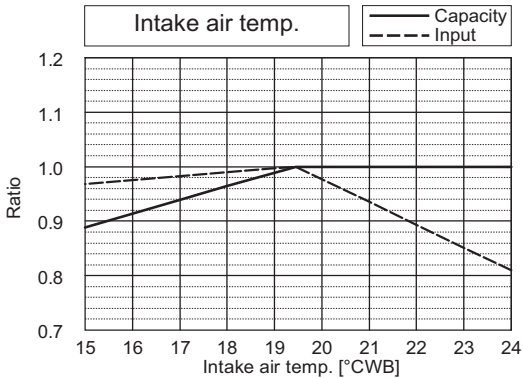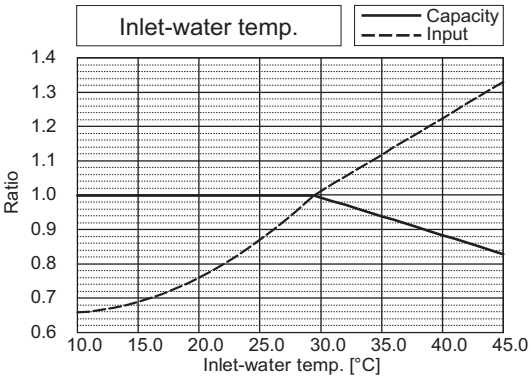





PQHY-			P192TLMU/YLMU		
Nominal Heating Capacity	kW	63.0	Rated Heating Capacity	kW	60.1
	BTU/h	215,000		BTU/h	205,000
Input	kW	11.90	Input	kW	(Non-Ducted) 10.97 (Ducted) 11.56

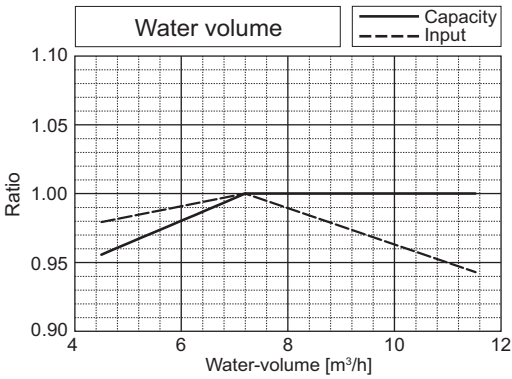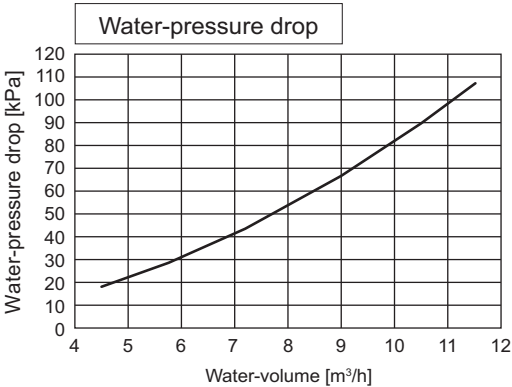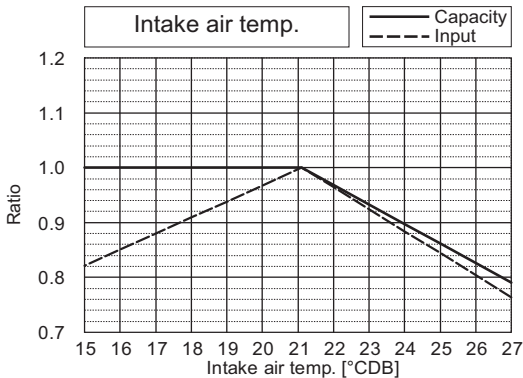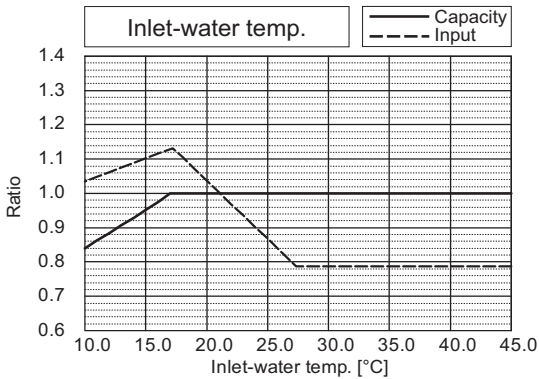



PQHY-		P216TLMU/YLMU			
Nominal Cooling Capacity	kW	63.3	Rated Cooling Capacity	kW	60.4
	BTU/h	216,000		BTU/h	206,000
Input	kW	19.23	Input	kW	(Non-Ducted) 17.72 (Ducted) 16.10

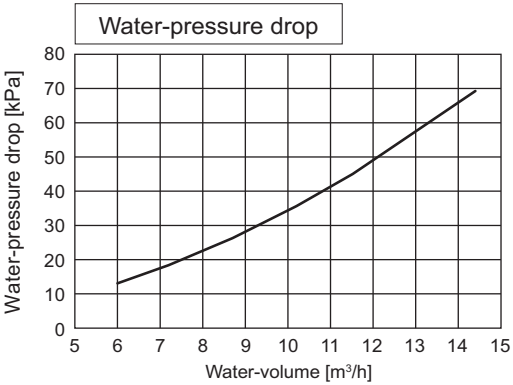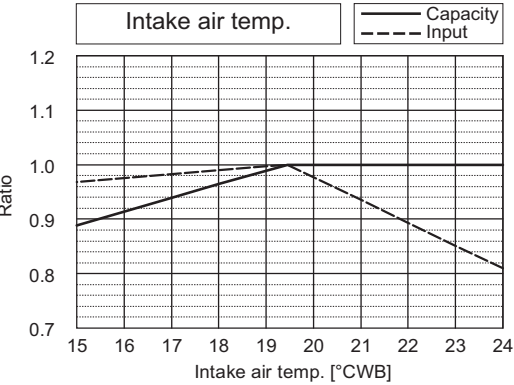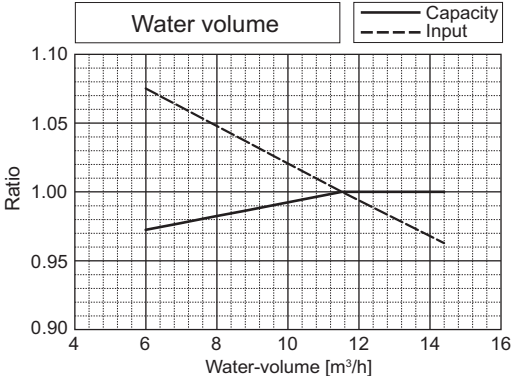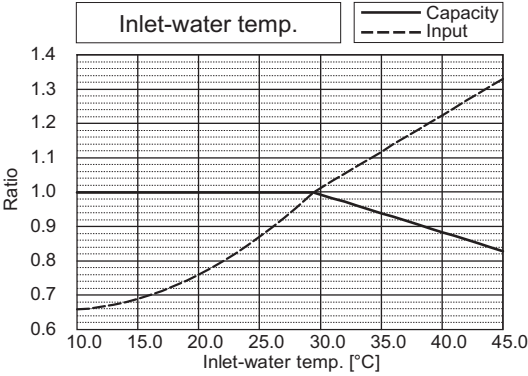







PQHY-		P216TLMU/YLMU			
Nominal Heating Capacity	kW	71.2	Rated Heating Capacity	kW	68.0
	BTU/h	243,000		BTU/h	232,000
Input	kW	13.04	Input	kW	(Non-Ducted) 12.01 (Ducted) 12.34

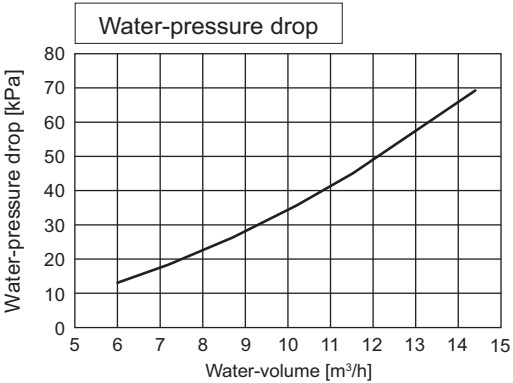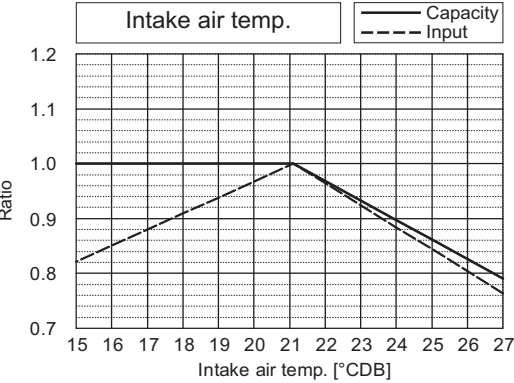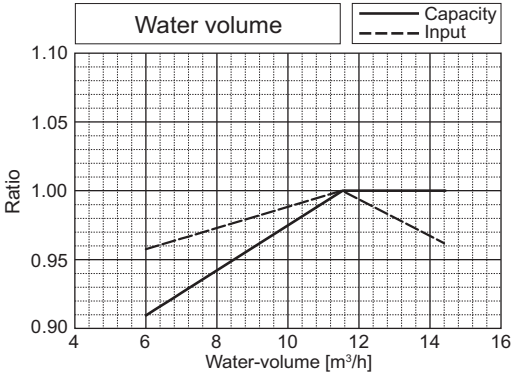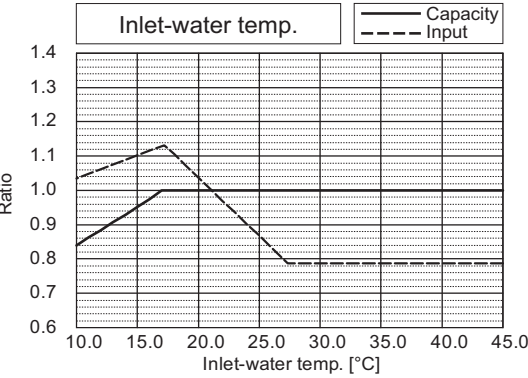



PQHY-			P240TLMU/YLMU		
Nominal Cooling Capacity	kW	70.3	Rated Cooling Capacity	kW	66.8
	BTU/h	240,000		BTU/h	228,000
Input	kW	21.14	Input	kW	(Non-Ducted) 19.49 (Ducted) 18.74

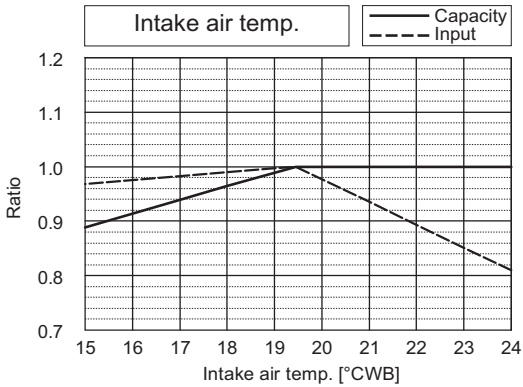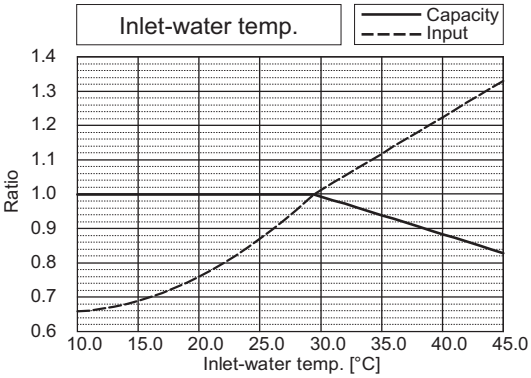



PQHY-			P240TLMU/YLMU		
Nominal Heating Capacity	kW	79.1	Rated Heating Capacity	kW	75.6
	BTU/h	270,000		BTU/h	258,000
Input	kW	15.12	Input	kW	(Non-Ducted) 13.93 (Ducted) 14.62

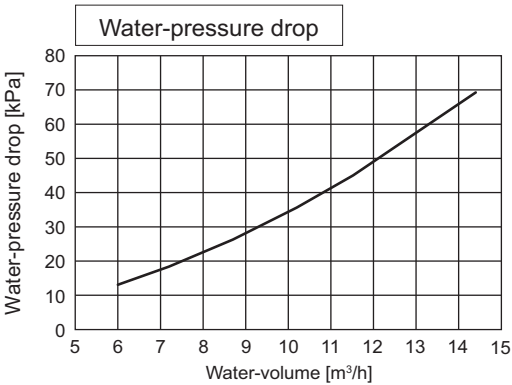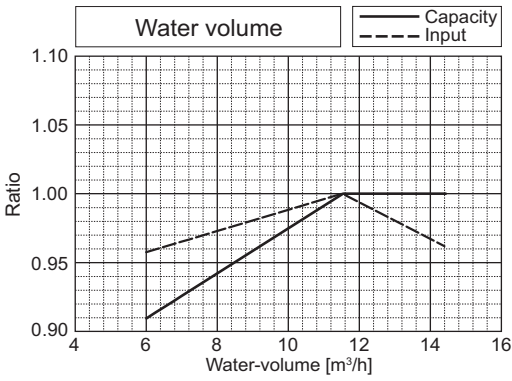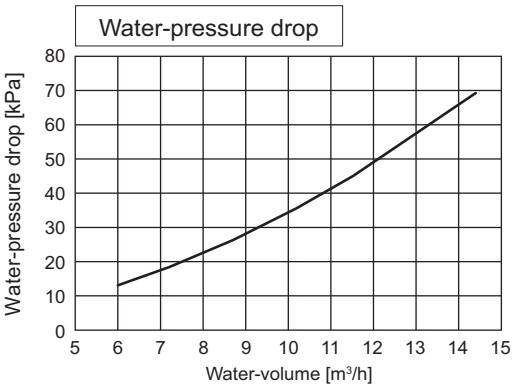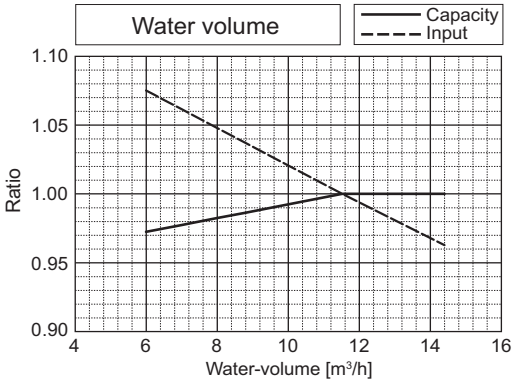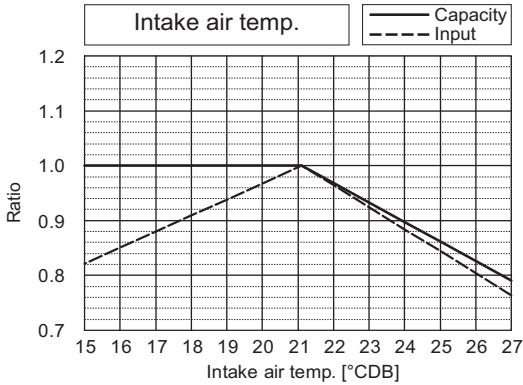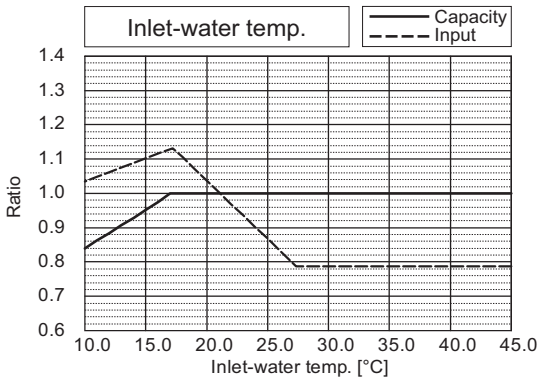





PQHY-			P144TSLMU/YSLMU		
Nominal Cooling Capacity	kW	42.2	Rated Cooling Capacity	kW	40.2
	BTU/h	144,000		BTU/h	137,000
Input	kW	7.11	Input	kW	(Non-Ducted) 6.53 (Ducted) 7.72

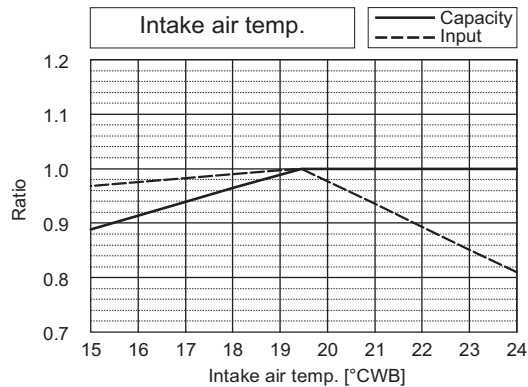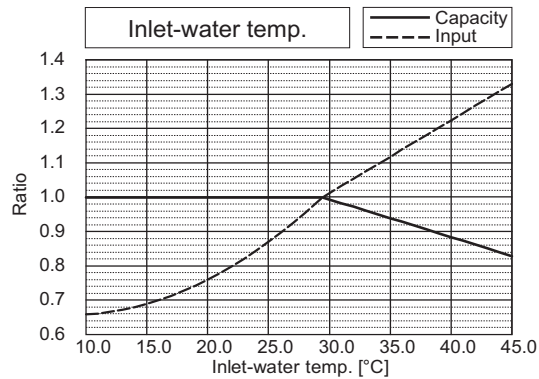



PQHY-			P144TSLMU/YSLMU		
Nominal Heating Capacity	kW	46.9	Rated Heating Capacity	kW	44.5
	BTU/h	160,000		BTU/h	152,000
Input	kW	7.45	Input	kW	(Non-Ducted) 6.86 (Ducted) 7.22

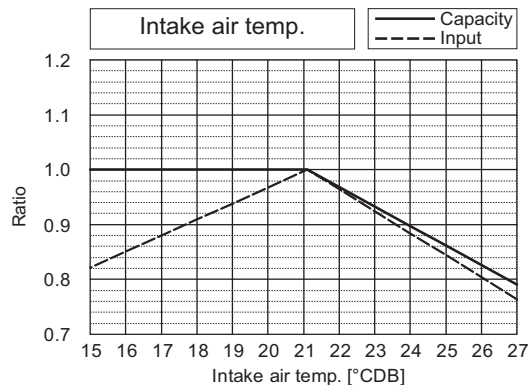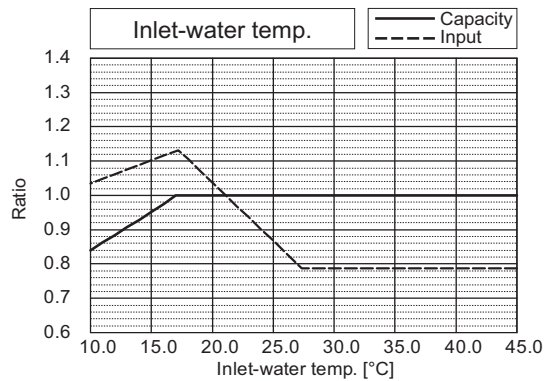



*The drawing indicates characteristic per unit.

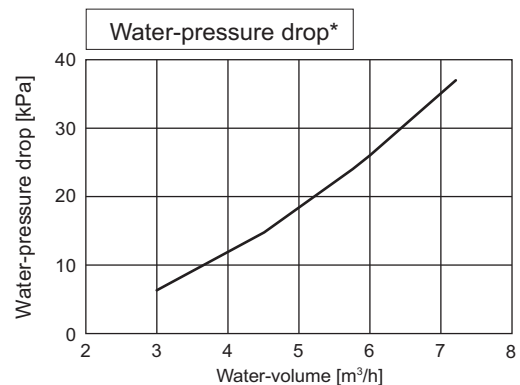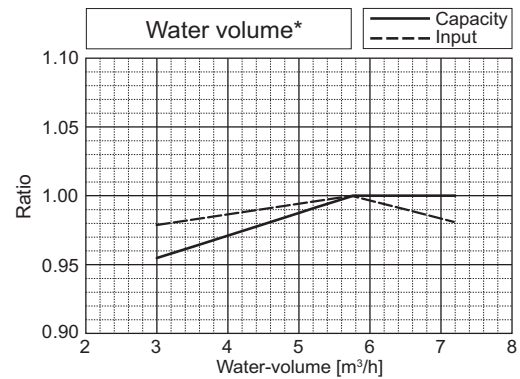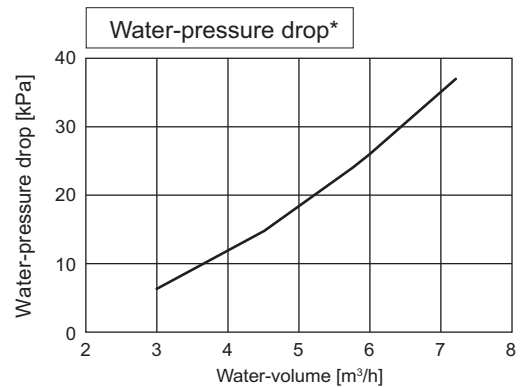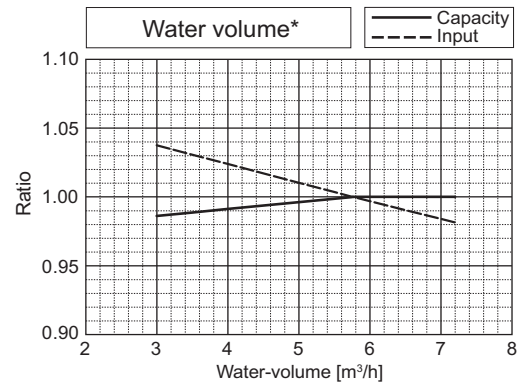





PQHY-			P168TSLMU/YSLMU		
Nominal Cooling Capacity	kW	49.2	Rated Cooling Capacity	kW	47.2
	BTU/h	168,000		BTU/h	161,000
Input	kW	9.33	Input	kW	(Non-Ducted) 8.58 (Ducted) 9.22

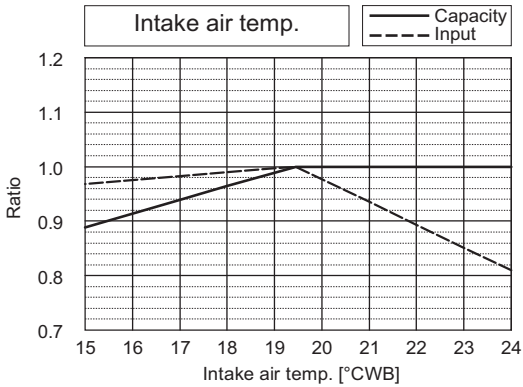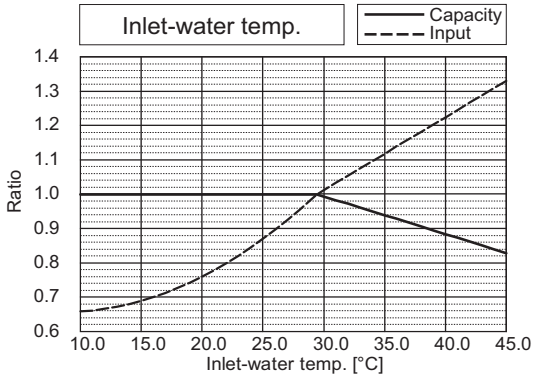



PQHY-			P168TSLMU/YSLMU		
Nominal Heating Capacity	kW	55.1	Rated Heating Capacity	kW	52.5
	BTU/h	188,000		BTU/h	179,000
Input	kW	9.34	Input	kW	(Non-Ducted) 8.60 (Ducted) 8.03

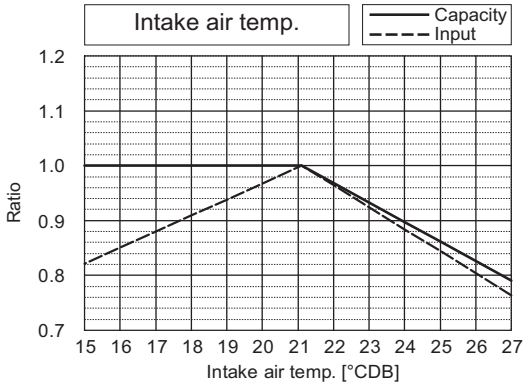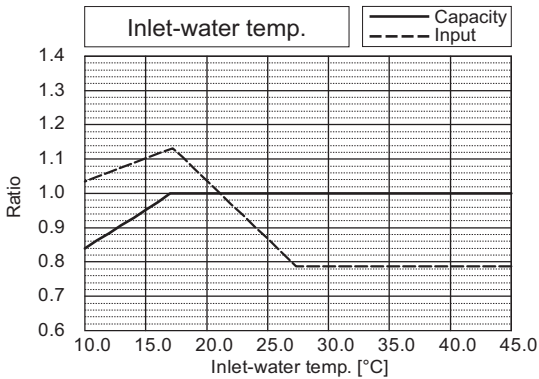



*The drawing indicates characteristic per unit.

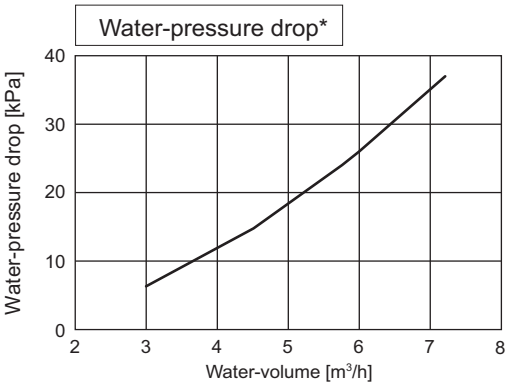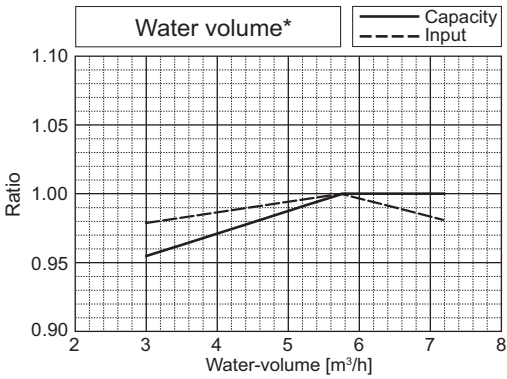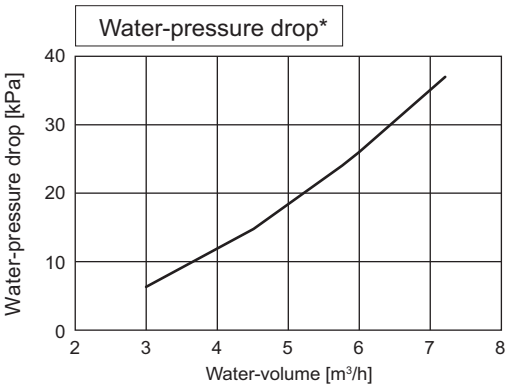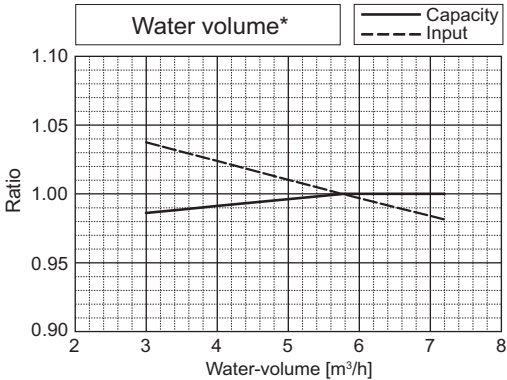





PQHY-		P192TSLMU/YSLMU			
Nominal Cooling Capacity	kW	56.3	Rated Cooling Capacity	kW	53.6
	BTU/h	192,000		BTU/h	183,000
Input	kW	11.30	Input	kW	(Non-Ducted) 10.40 (Ducted) 10.98

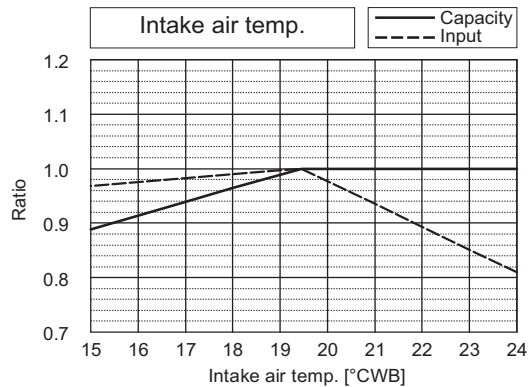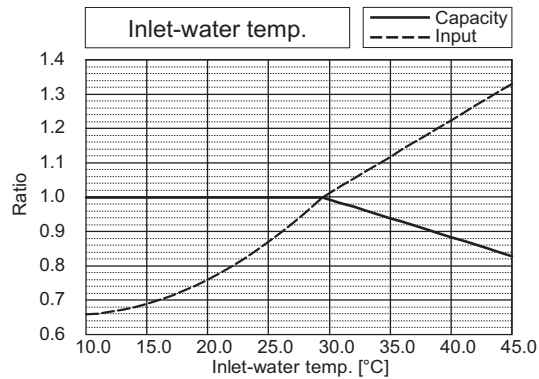

PQHY-		P192TSLMU/YSLMU			
Nominal Heating Capacity	kW	63.0	Rated Heating Capacity	kW	60.1
	BTU/h	215,000		BTU/h	205,000
Input	kW	11.02	Input	kW	(Non-Ducted) 10.16 (Ducted) 8.90

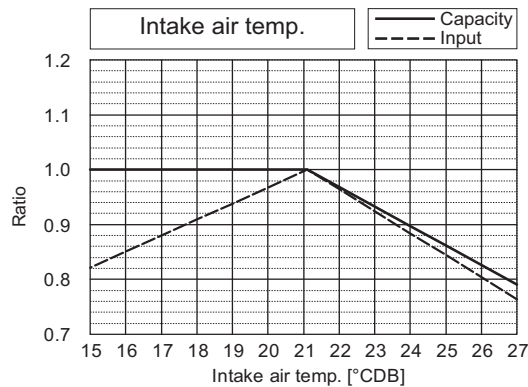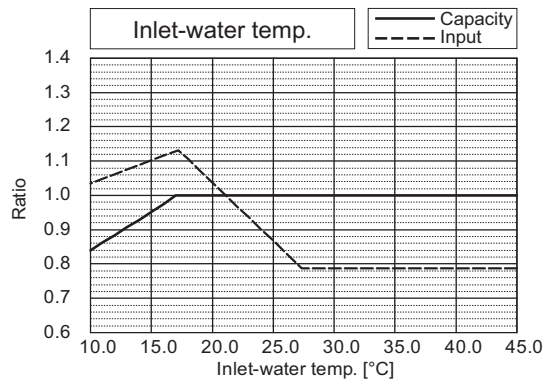



*The drawing indicates characteristic per unit.

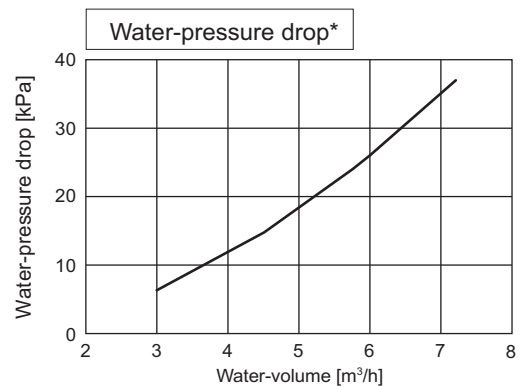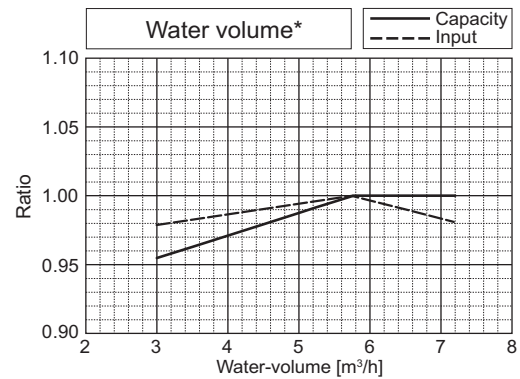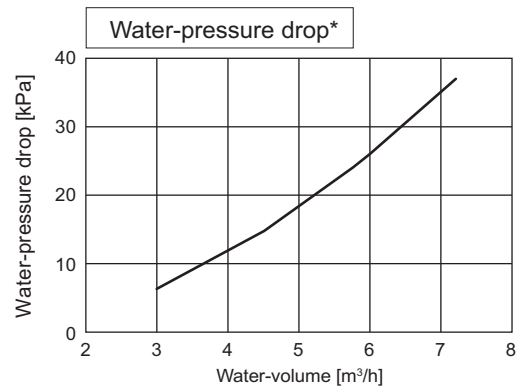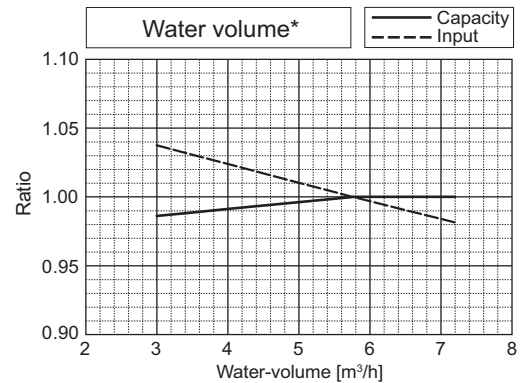



8. CAPACITY TABLES

U11 2nd





PQHY-			P216TSLMU/YSLMU		
Nominal Cooling Capacity	kW	63.3	Rated Cooling Capacity	kW	60.4
	BTU/h	216,000		BTU/h	206,000
Input	kW	14.03	Input	kW	(Non-Ducted) 12.93 (Ducted) 13.24

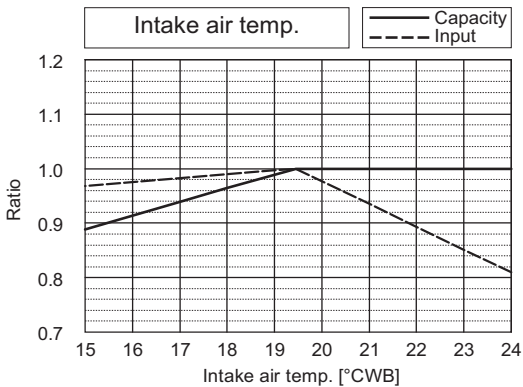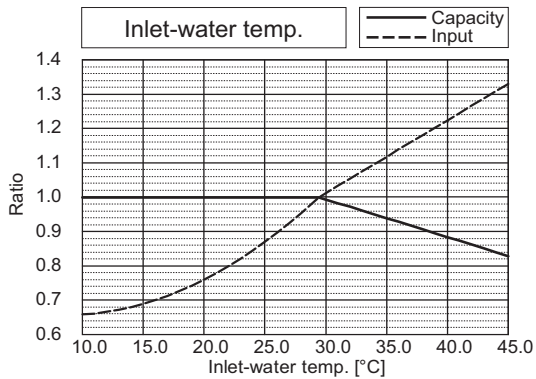



PQHY-			P216TSLMU/YSLMU		
Nominal Heating Capacity	kW	71.2	Rated Heating Capacity	kW	68.0
	BTU/h	243,000		BTU/h	232,000
Input	kW	12.88	Input	kW	(Non-Ducted) 11.88 (Ducted) 10.35

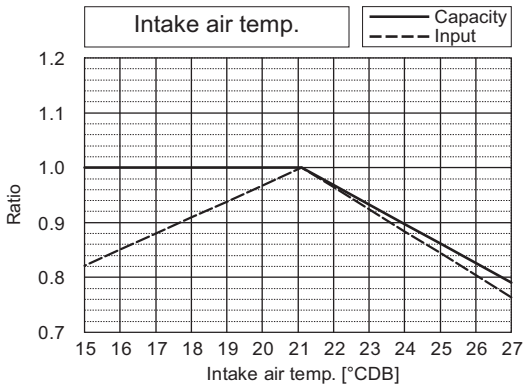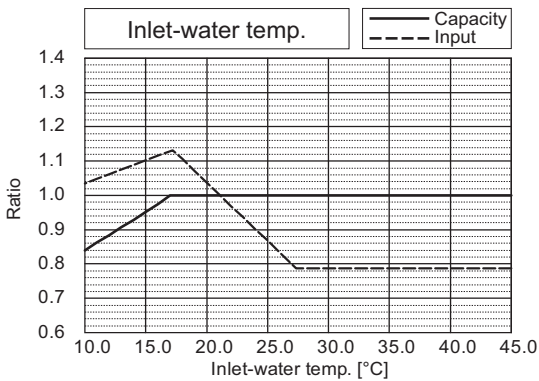



*The drawing indicates characteristic per unit.

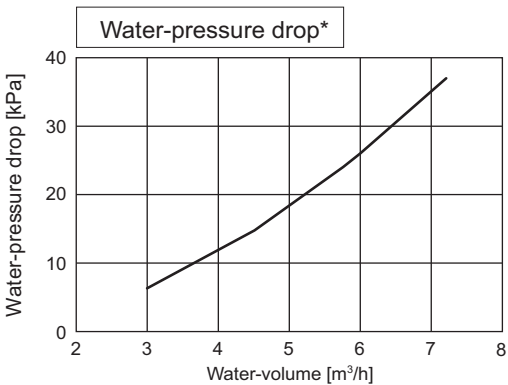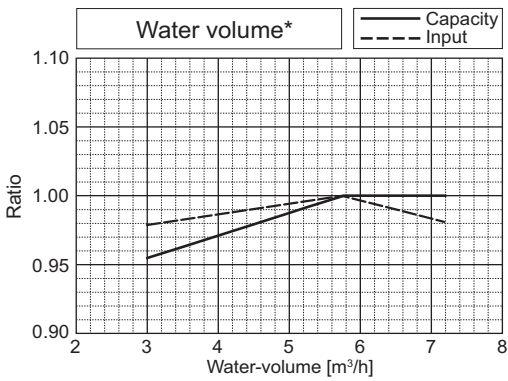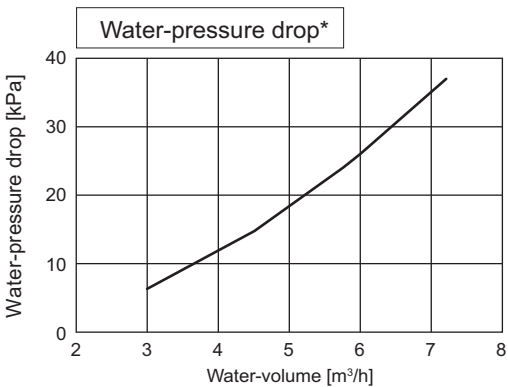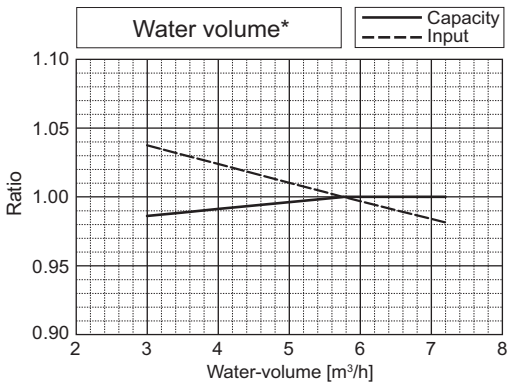





PQHY-			P240TSLMU/YSLMU		
Nominal Cooling Capacity	kW	70.3	Rated Cooling Capacity	kW	66.8
	BTU/h	240,000		BTU/h	228,000
Input	kW	16.89	Input	kW	(Non-Ducted) 15.57 (Ducted) 16.15

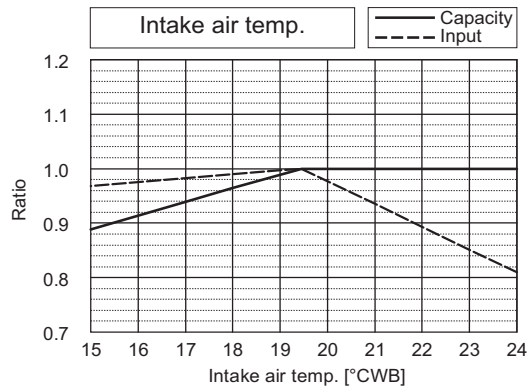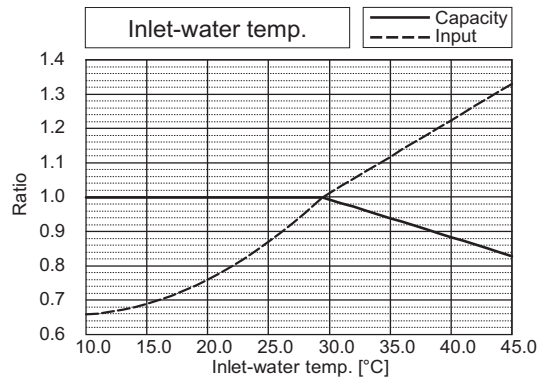

PQHY-			P240TSLMU/YSLMU		
Nominal Heating Capacity	kW	79.1	Rated Heating Capacity	kW	75.6
	BTU/h	270,000		BTU/h	258,000
Input	kW	14.58	Input	kW	(Non-Ducted) 13.45 (Ducted) 12.02

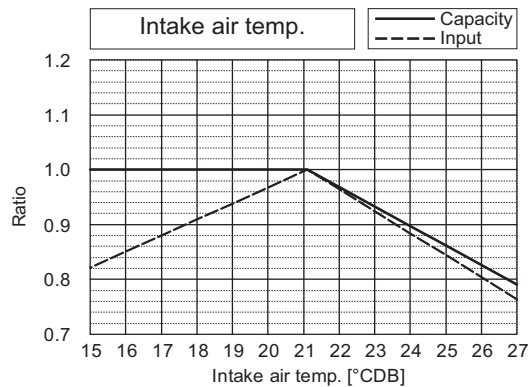
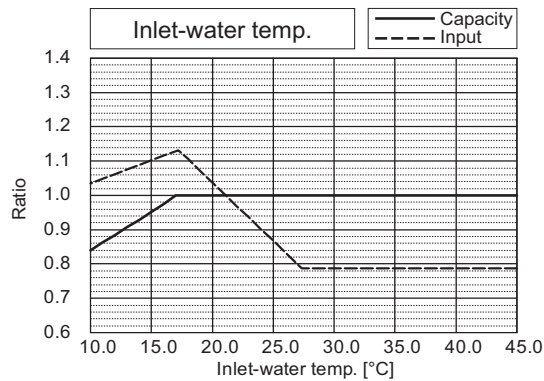


*The drawing indicates characteristic per unit.



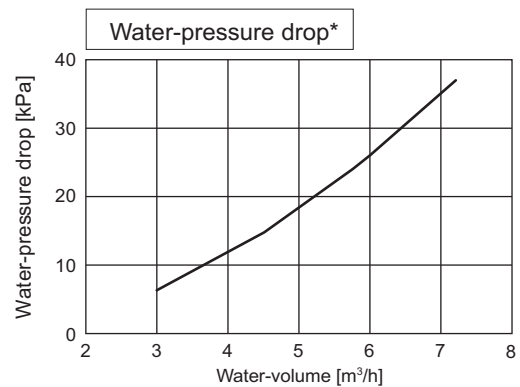
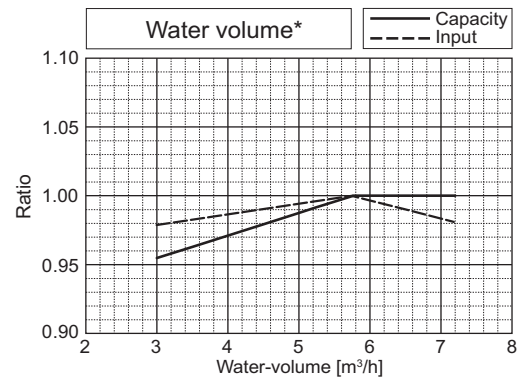
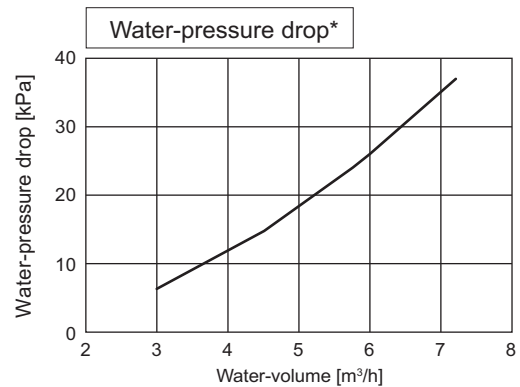
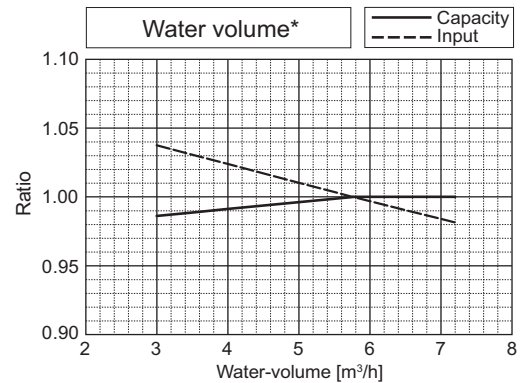


*The drawing indicates characteristic per unit.



PQHY-			P288TSLMU/YSLMU		
Nominal Cooling Capacity	kW	84.4	Rated Cooling Capacity	kW	80.6
	BTU/h	288,000		BTU/h	275,000
Input	kW	20.42	Input	kW	(Non-Ducted) 18.82 (Ducted) 21.43

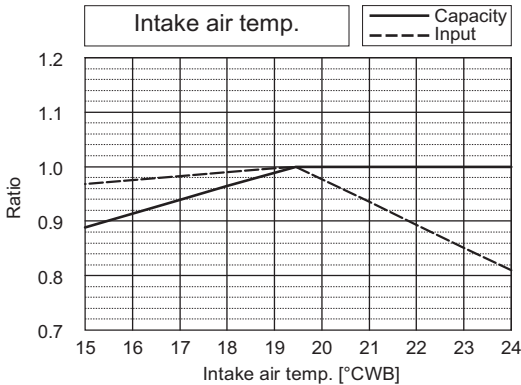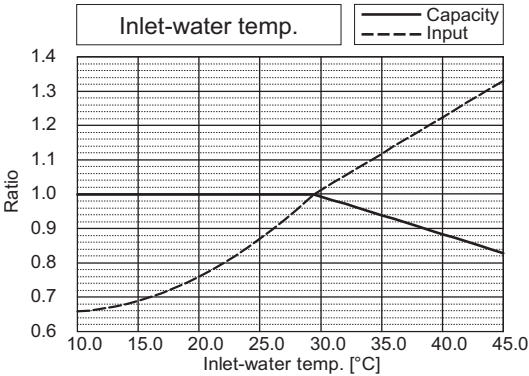



PQHY-			P288TSLMU/YSLMU		
Nominal Heating Capacity	kW	94.7	Rated Heating Capacity	kW	90.3
	BTU/h	323,000		BTU/h	308,000
Input	kW	17.50	Input	kW	(Non-Ducted) 16.13 (Ducted) 16.05

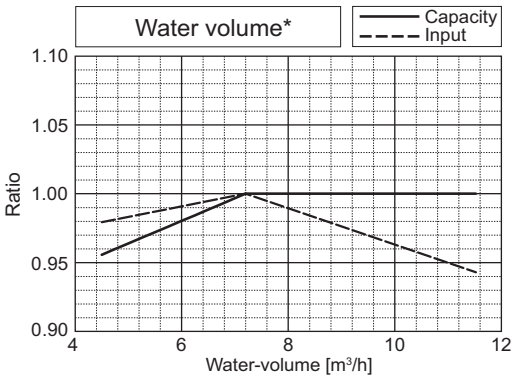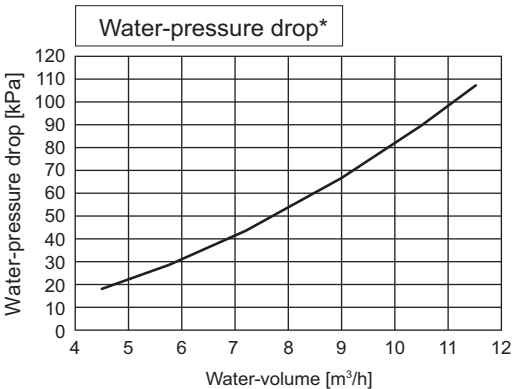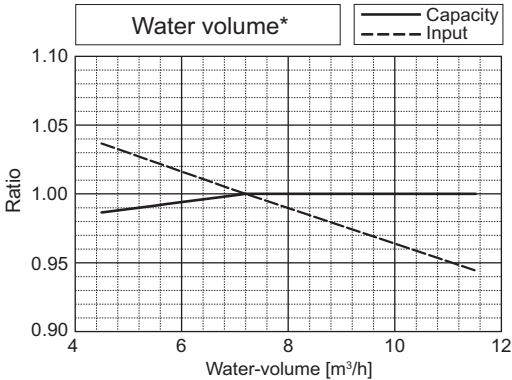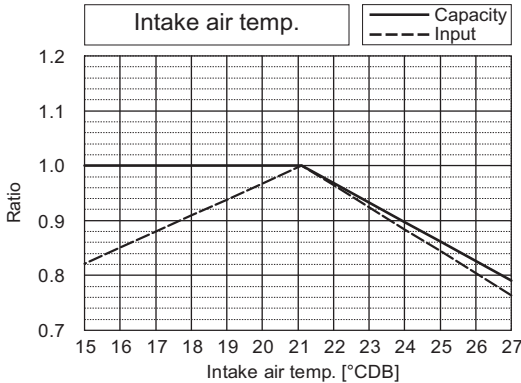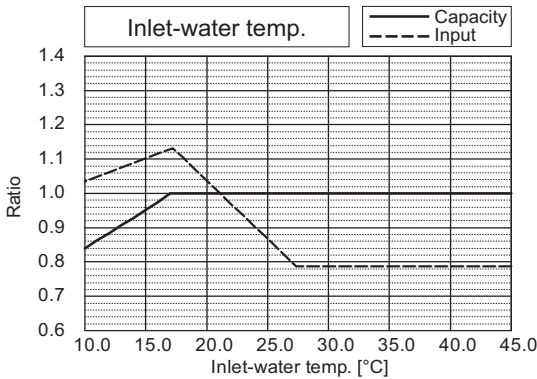





PQHY-		P312TSLMU/YSLMU			
Nominal Cooling Capacity	kW	91.4	Rated Cooling Capacity	kW	87.0
	BTU/h	312,000		BTU/h	297,000
Input	kW	23.41	Input	kW	(Non-Ducted) 21.59 (Ducted) 23.67

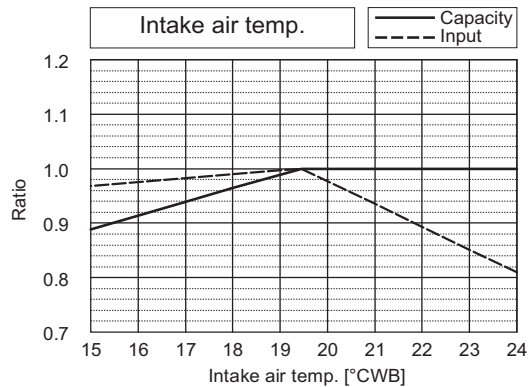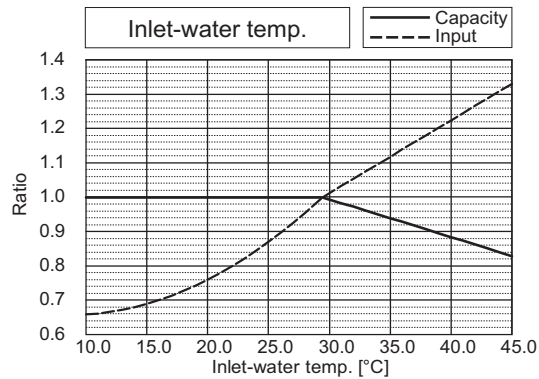

PQHY-		P312TSLMU/YSLMU			
Nominal Heating Capacity	kW	102.6	Rated Heating Capacity	kW	97.9
	BTU/h	350,000		BTU/h	334,000
Input	kW	19.11	Input	kW	(Non-Ducted) 17.62 (Ducted) 17.96

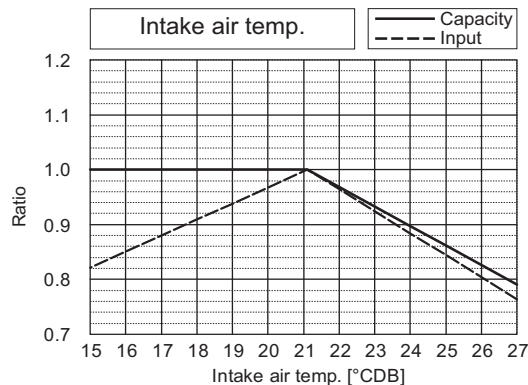
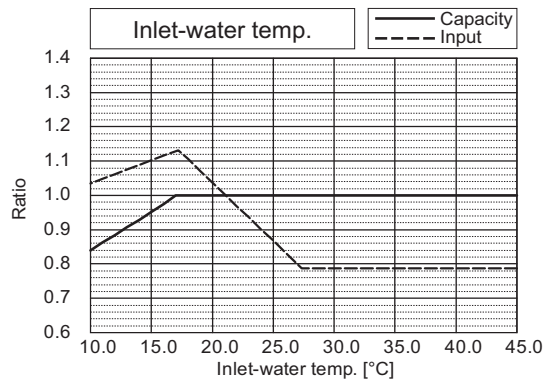


*The drawing indicates characteristic per unit.



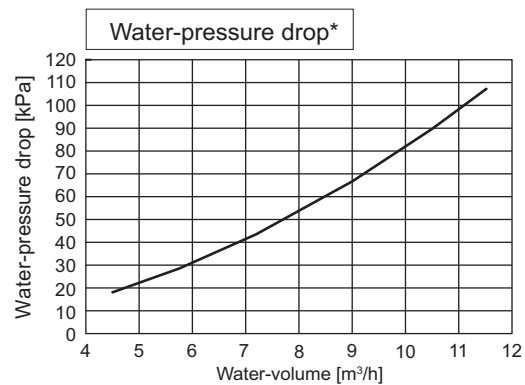
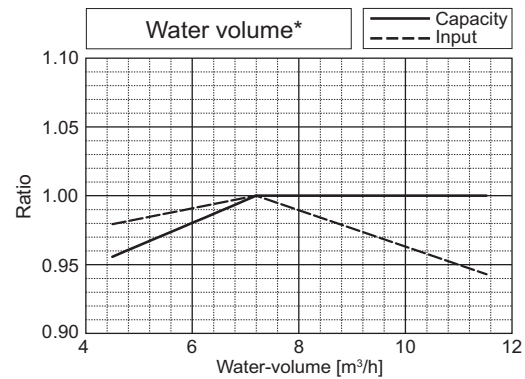
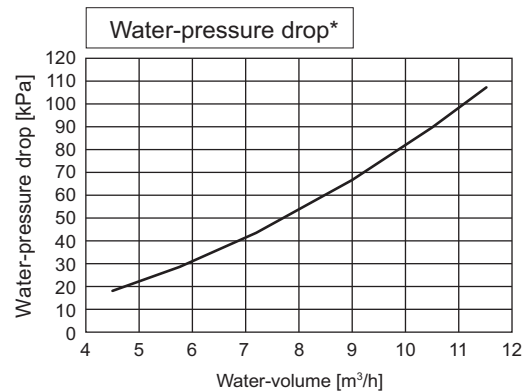
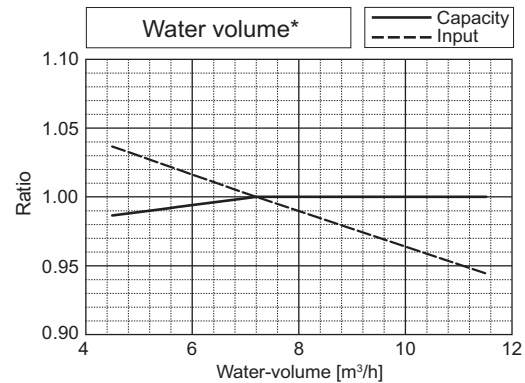


*The drawing indicates characteristic per unit.



PQHY-		P336TSLMU/YSLMU			
Nominal Cooling Capacity	kW	98.5	Rated Cooling Capacity	kW	93.8
	BTU/h	336,000		BTU/h	320,000
Input	kW	26.84	Input	kW	(Non-Ducted) 24.76 (Ducted) 25.85

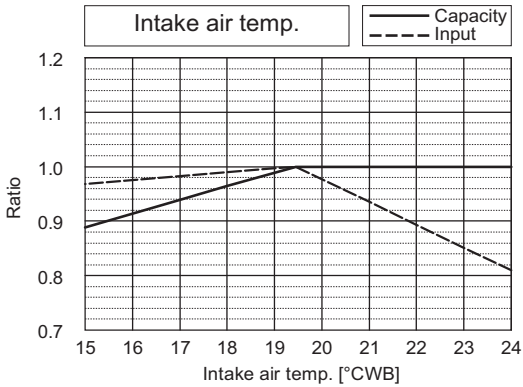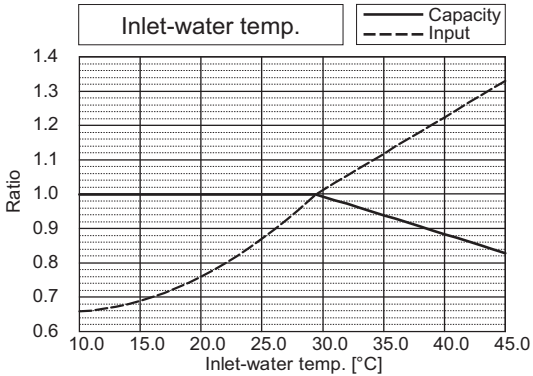



PQHY-		P336TSLMU/YSLMU			
Nominal Heating Capacity	kW	110.8	Rated Heating Capacity	kW	105.8
	BTU/h	378,000		BTU/h	361,000
Input	kW	20.77	Input	kW	(Non-Ducted) 19.16 (Ducted) 20.05

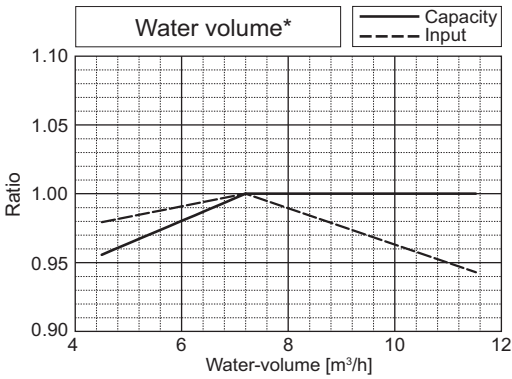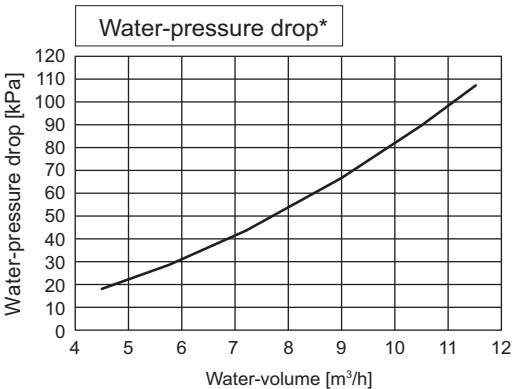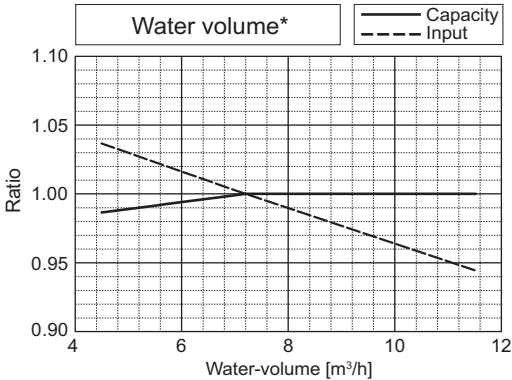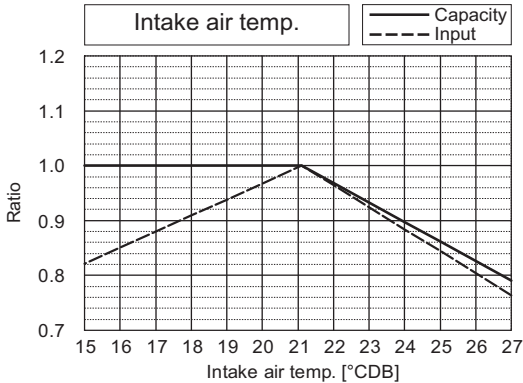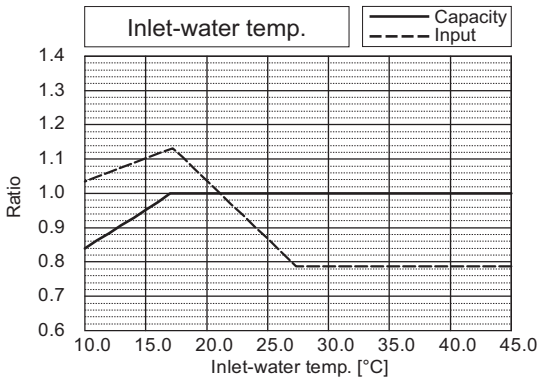





PQHY-		P360TSLMU/YSLMU			
Nominal Cooling Capacity	kW	105.5	Rated Cooling Capacity	kW	100.2
	BTU/h	360,000		BTU/h	342,000
Input	kW	29.43	Input	kW	(Non-Ducted) 27.17 (Ducted) 27.41

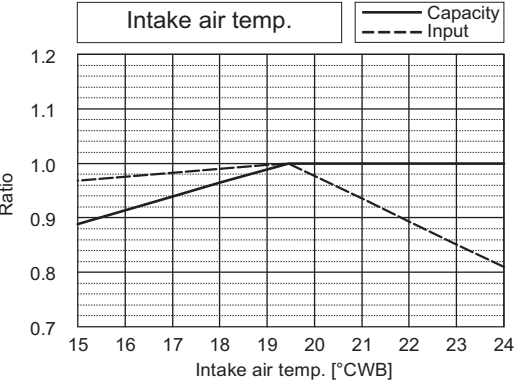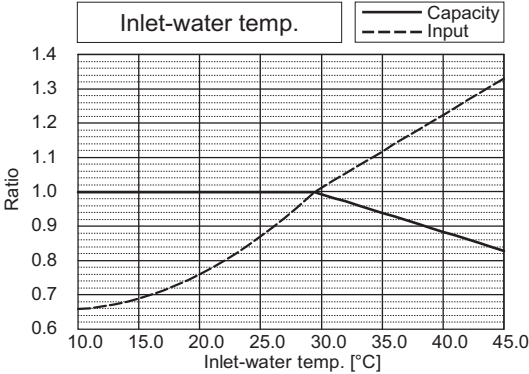





PQHY-		P360TSLMU/YSLMU			
Nominal Heating Capacity	kW	118.7	Rated Heating Capacity	kW	113.4
	BTU/h	405,000		BTU/h	387,000
Input	kW	22.85	Input	kW	(Non-Ducted) 21.09 (Ducted) 21.70

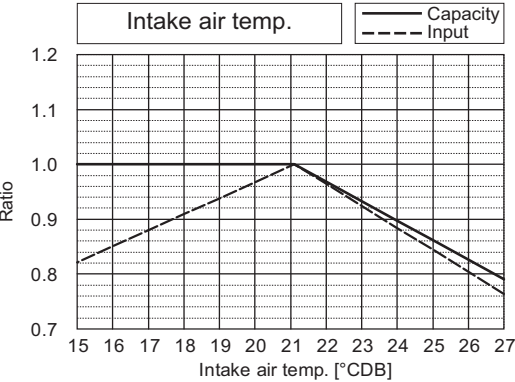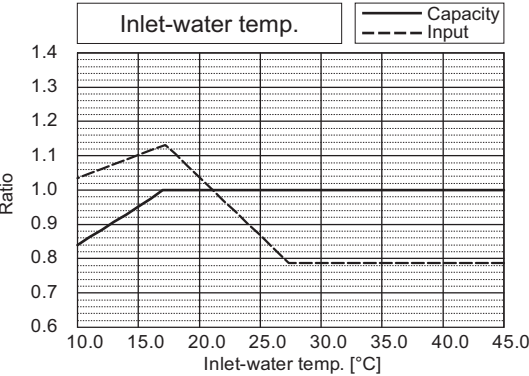





*The drawing indicates characteristic per unit.

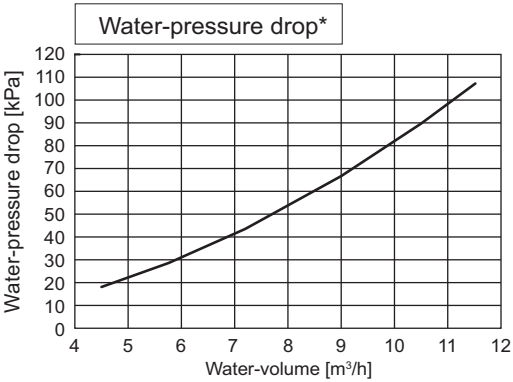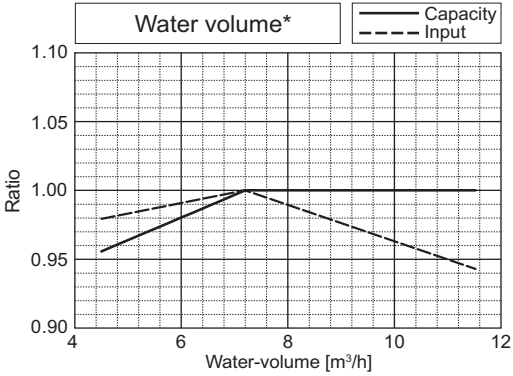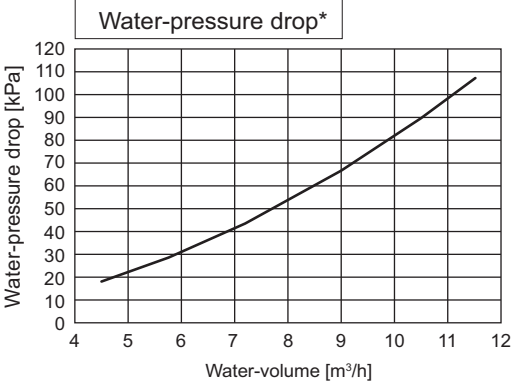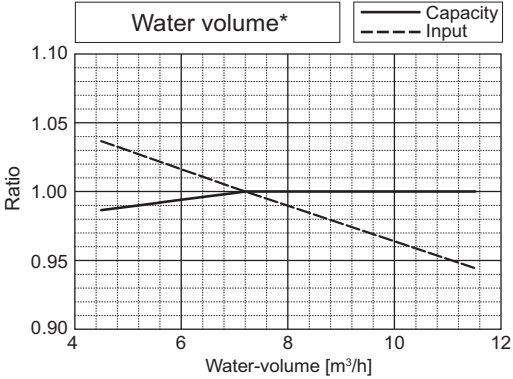





PQHY-			P72TLMU/YLMU		
Nominal Cooling Capacity	kW	21.1	Rated Cooling Capacity	kW	20.2
	BTU/h	72,000		BTU/h	69,000
Input	kW	3.23	Input	kW	(Non-Ducted) 2.96 (Ducted) 3.12

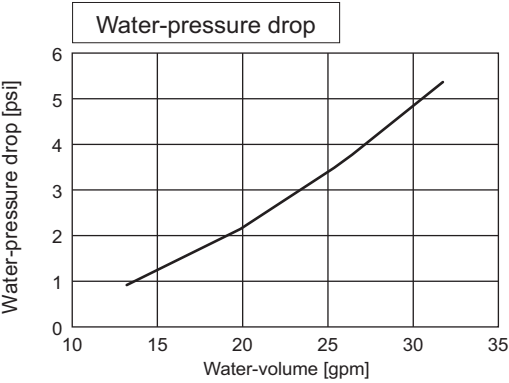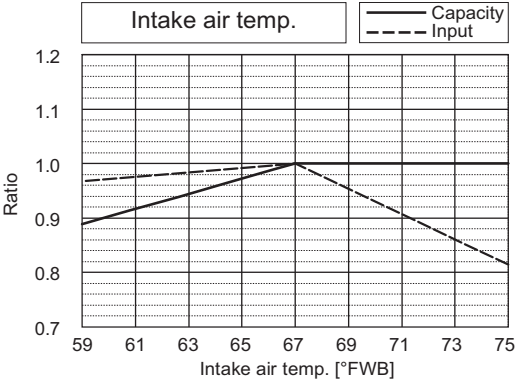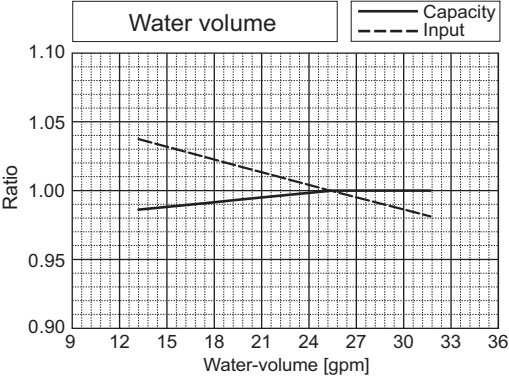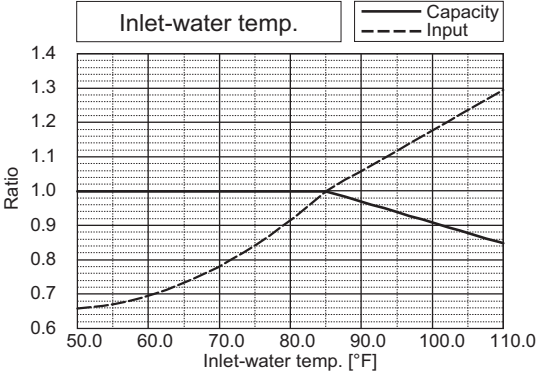





PQHY-			P72TLMU/YLMU		
Nominal Heating Capacity	kW	23.4	Rated Heating Capacity	kW	22.3
	BTU/h	80,000		BTU/h	76,000
Input	kW	3.63	Input	kW	(Non-Ducted) 3.34 (Ducted) 3.36

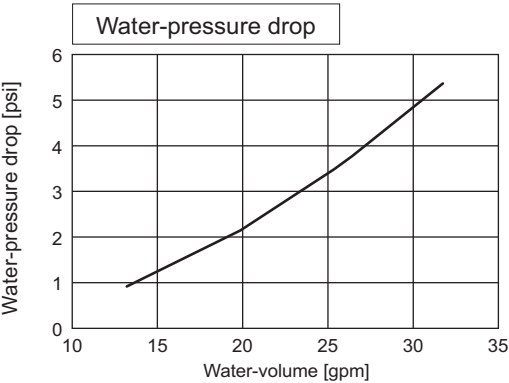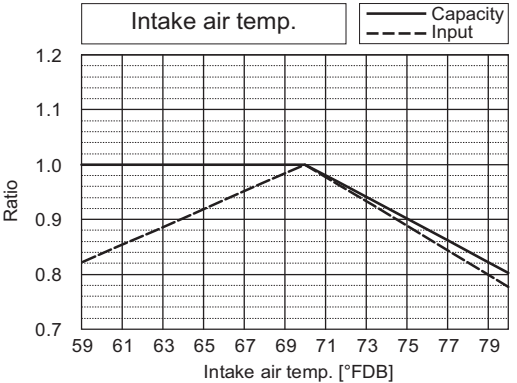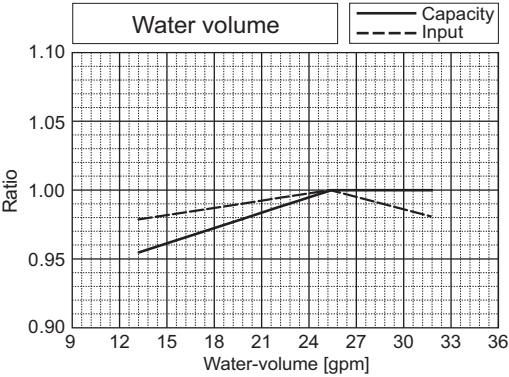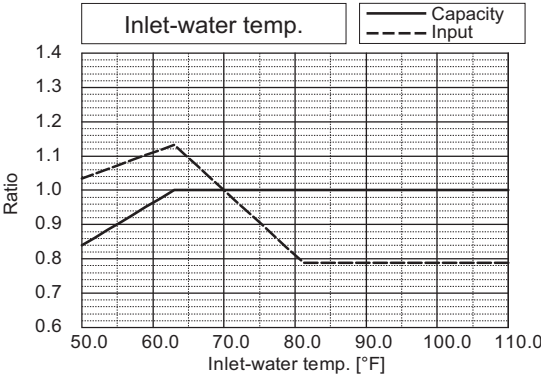



PQHY-			P96TLMU/YLMU		
Nominal Cooling Capacity	kW	28.1	Rated Cooling Capacity	kW	27.0
	BTU/h	96,000		BTU/h	92,000
Input	kW	4.65	Input	kW	(Non-Ducted) 4.26 (Ducted) 5.19

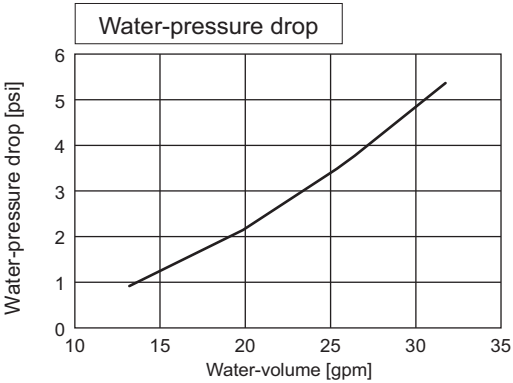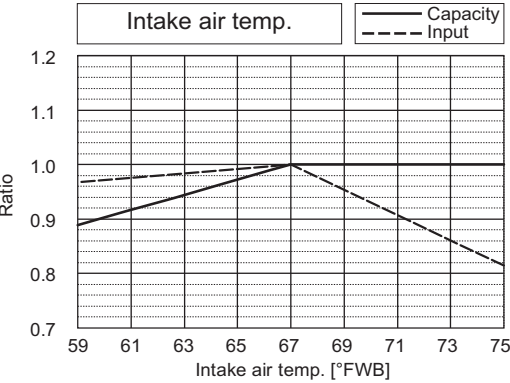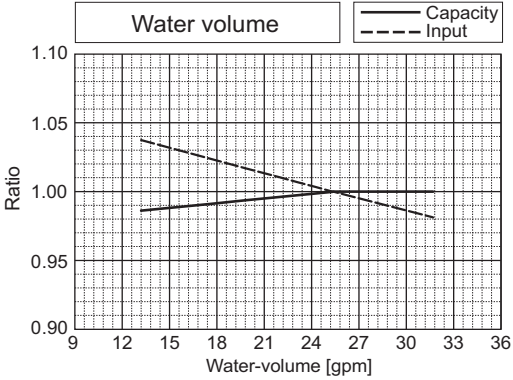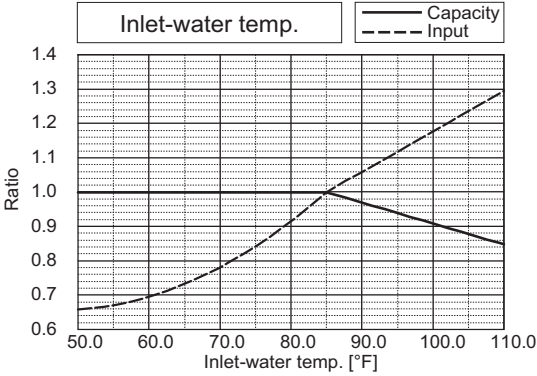







PQHY-			P96TLMU/YLMU		
Nominal Heating Capacity	kW	31.7	Rated Heating Capacity	kW	30.2
	BTU/h	108,000		BTU/h	103,000
Input	kW	5.05	Input	kW	(Non-Ducted) 4.65 (Ducted) 4.48

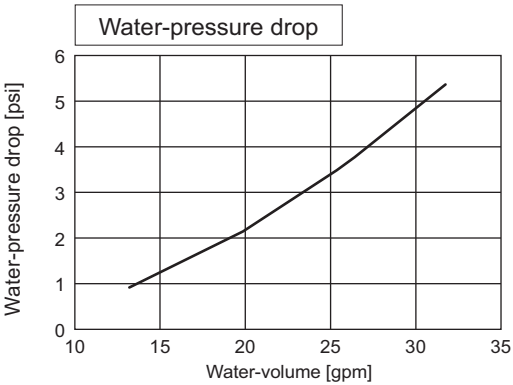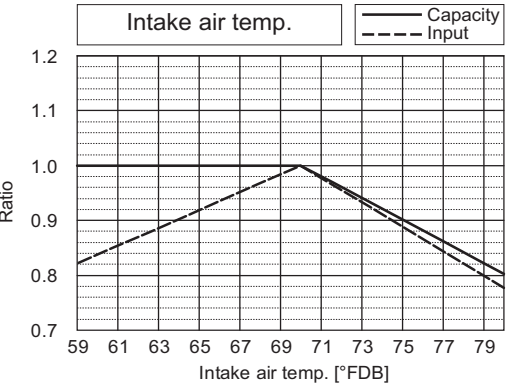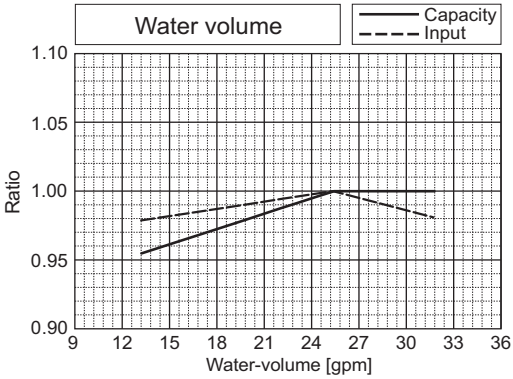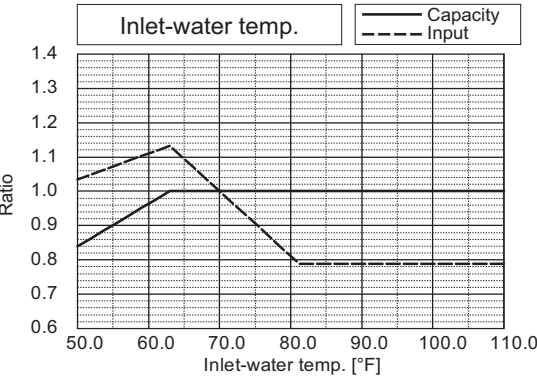





PQHY-			P120TLMU/YLMU		
Nominal Cooling Capacity	kW	35.2	Rated Cooling Capacity	kW	33.4
	BTU/h	120,000		BTU/h	114,000
Input	kW	7.24	Input	kW	(Non-Ducted) 6.66 (Ducted) 7.35

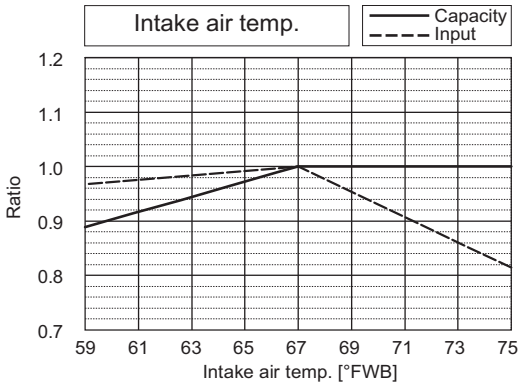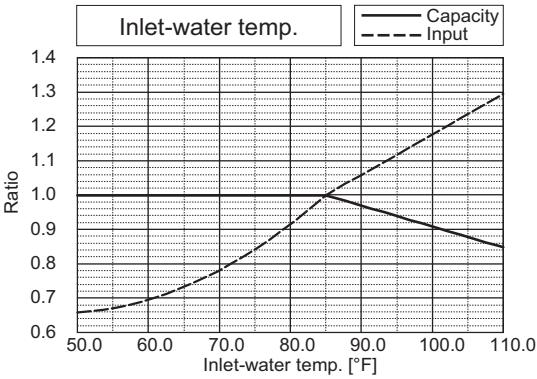





PQHY-			P120TLMU/YLMU		
Nominal Heating Capacity	kW	39.6	Rated Heating Capacity	kW	37.8
	BTU/h	135,000		BTU/h	129,000
Input	kW	6.83	Input	kW	(Non-Ducted) 6.29 (Ducted) 5.92

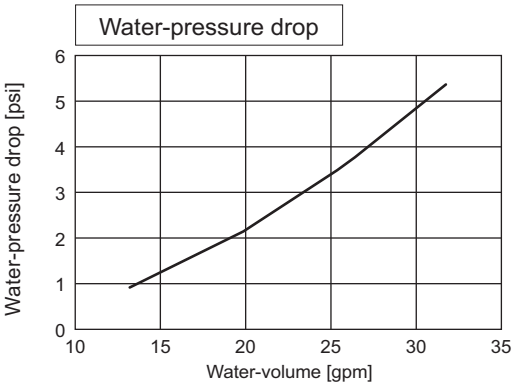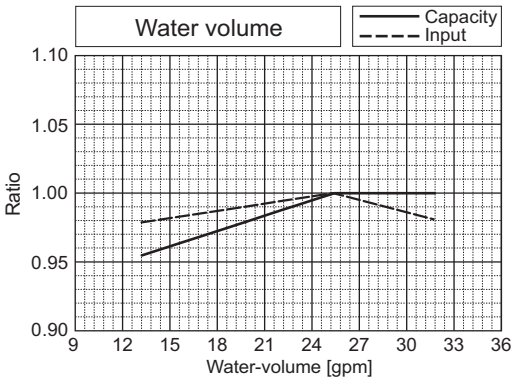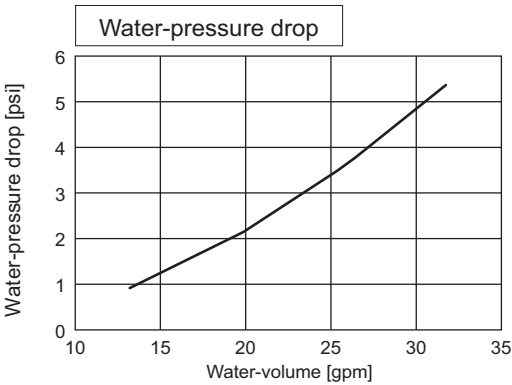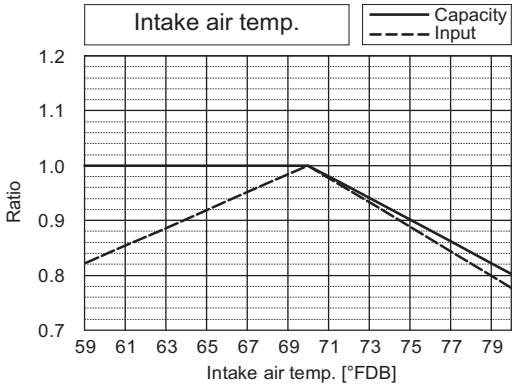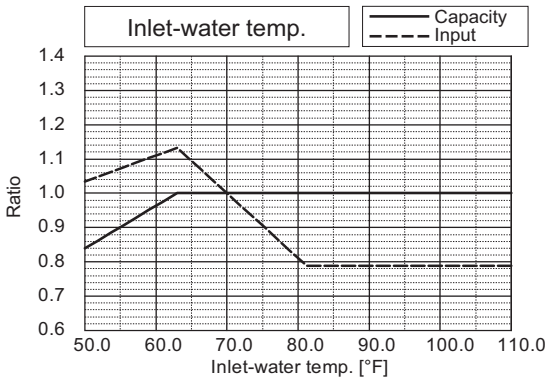





PQHY-		P144TLMU/YLMU			
Nominal Cooling Capacity	kW	42.2	Rated Cooling Capacity	kW	40.2
	BTU/h	144,000		BTU/h	137,000
Input	kW	8.78	Input	kW	(Non-Ducted) 8.07 (Ducted) 9.98

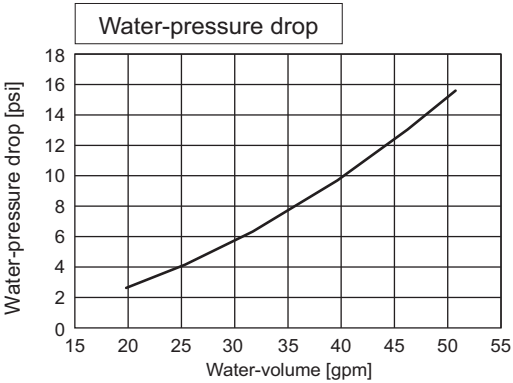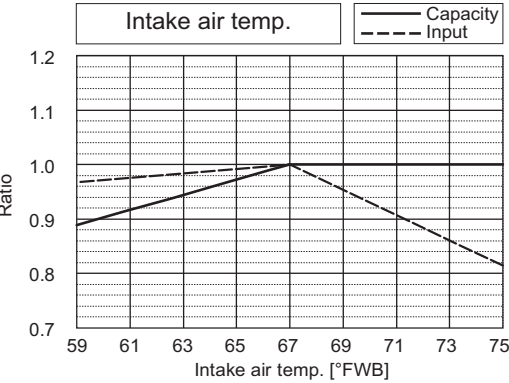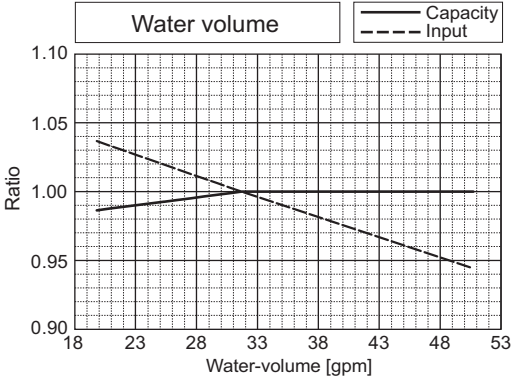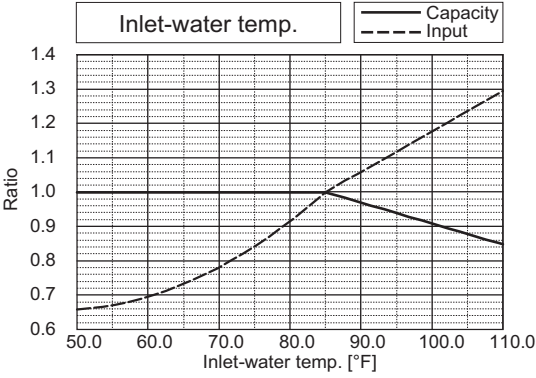





PQHY-		P144TLMU/YLMU			
Nominal Heating Capacity	kW	46.9	Rated Heating Capacity	kW	44.5
	BTU/h	160,000		BTU/h	152,000
Input	kW	8.11	Input	kW	(Non-Ducted) 7.47 (Ducted) 7.90

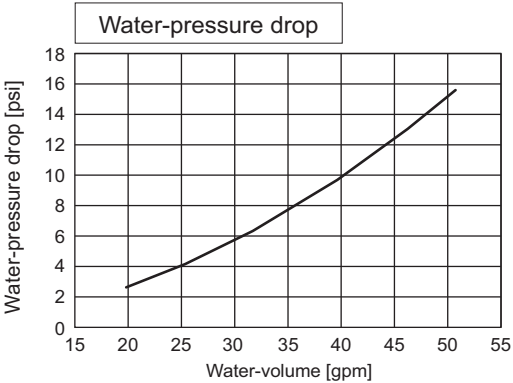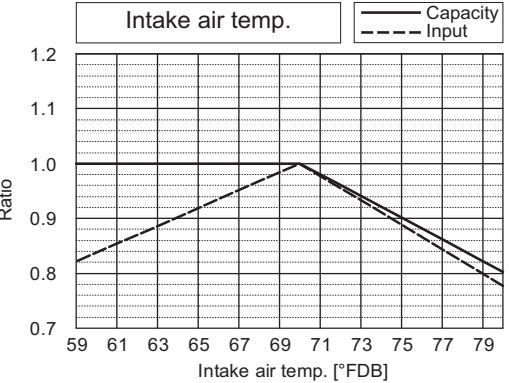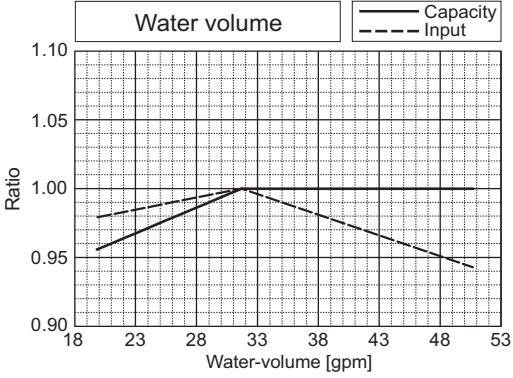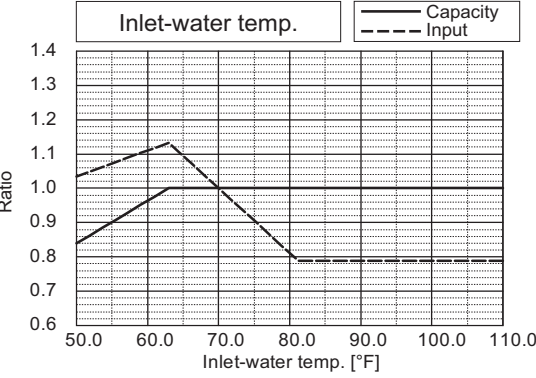





PQHY-			P168TLMU/YLMU		
Nominal Cooling Capacity	kW	49.2	Rated Cooling Capacity	kW	47.2
	BTU/h	168,000		BTU/h	161,000
Input	kW	12.05	Input	kW	(Non-Ducted) 11.10 (Ducted) 11.88

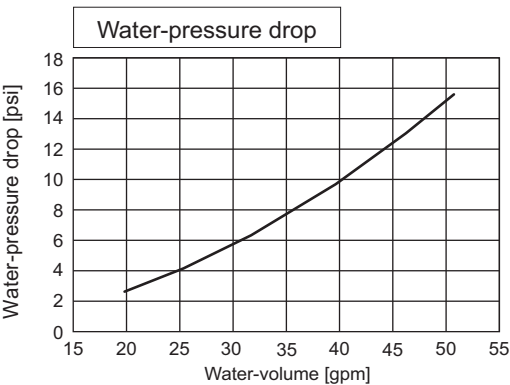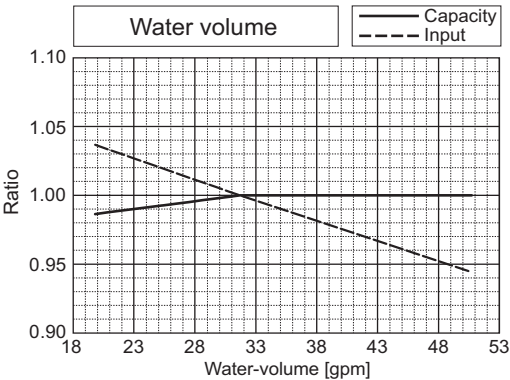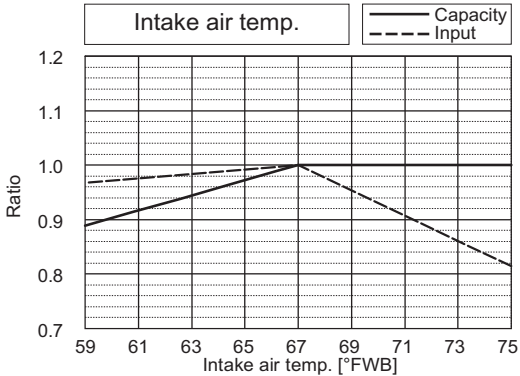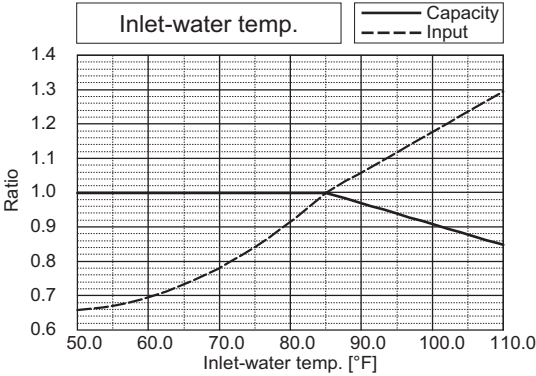





PQHY-			P168TLMU/YLMU		
Nominal Heating Capacity	kW	55.1	Rated Heating Capacity	kW	52.5
	BTU/h	188,000		BTU/h	179,000
Input	kW	9.86	Input	kW	(Non-Ducted) 9.09 (Ducted) 9.72

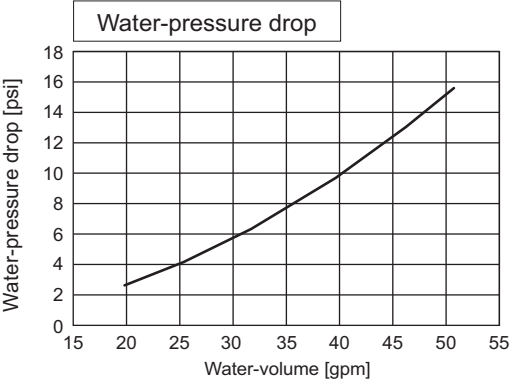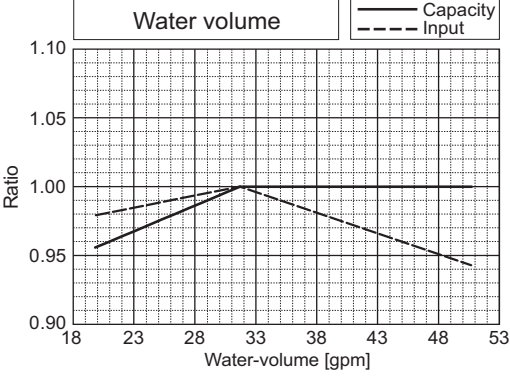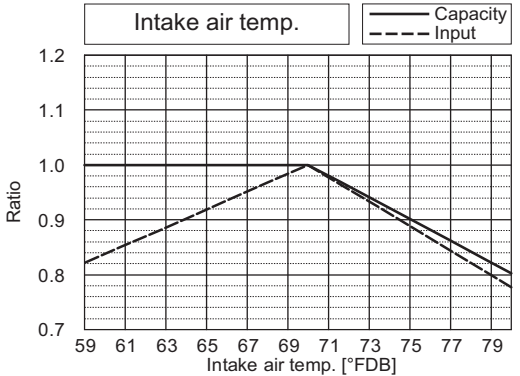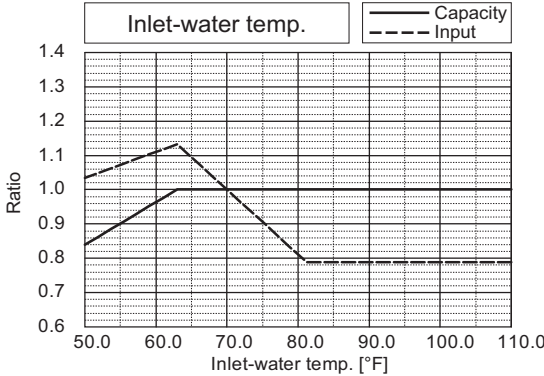



PQHY-		P192TLMU/YLMU			
Nominal Cooling Capacity	kW	56.3	Rated Cooling Capacity	kW	53.6
	BTU/h	192,000		BTU/h	183,000
Input	kW	15.05	Input	kW	(Non-Ducted) 13.87 (Ducted) 14.19

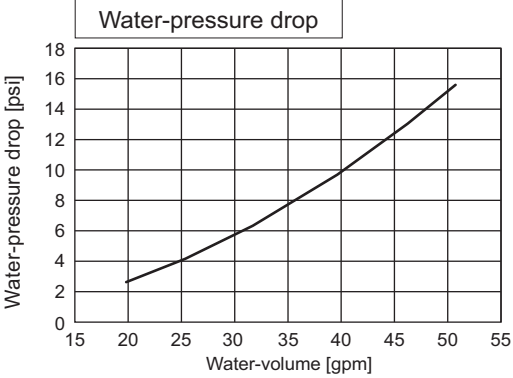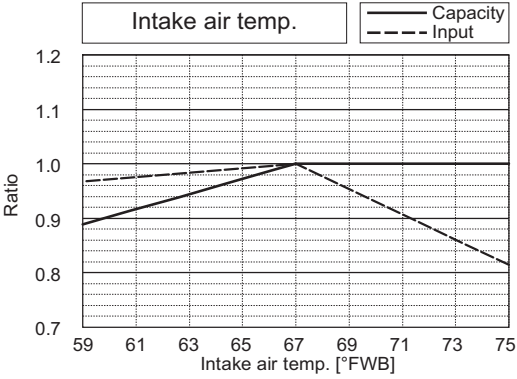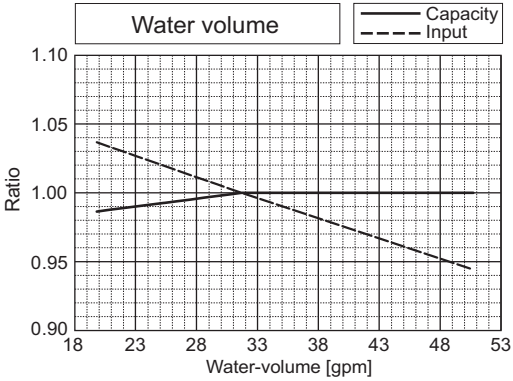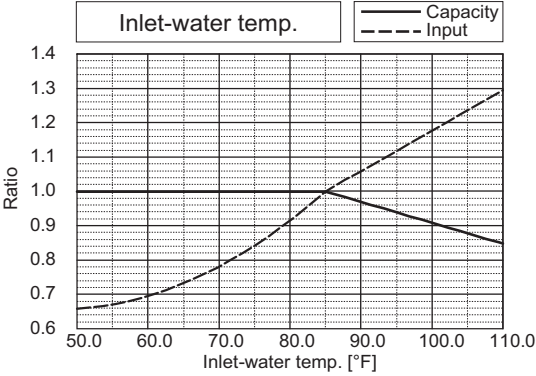







PQHY-		P192TLMU/YLMU			
Nominal Heating Capacity	kW	63.0	Rated Heating Capacity	kW	60.1
	BTU/h	215,000		BTU/h	205,000
Input	kW	11.90	Input	kW	(Non-Ducted) 10.97 (Ducted) 11.56

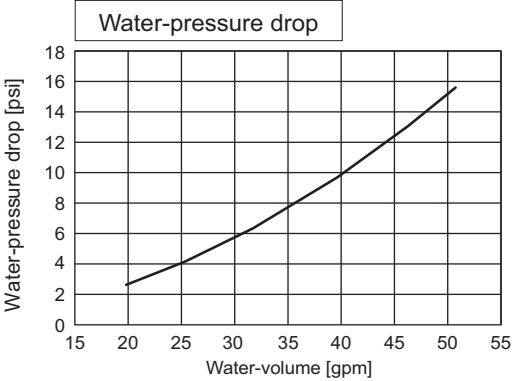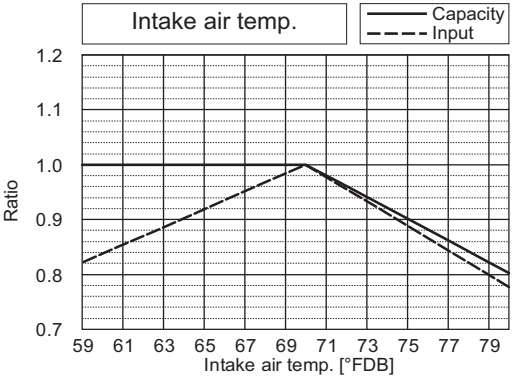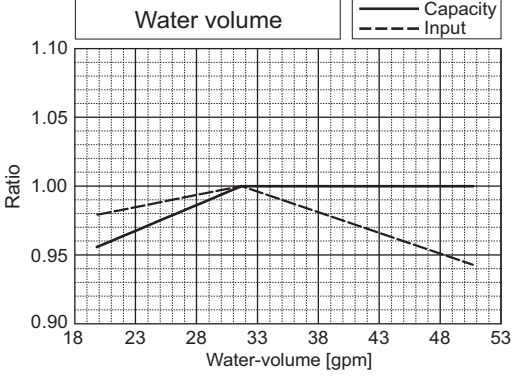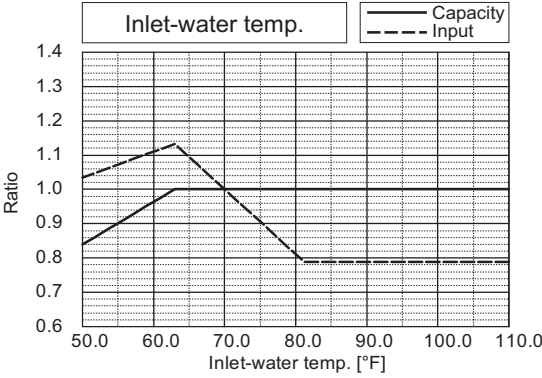





PQHY-			P216TLMU/YLMU		
Nominal Cooling Capacity	kW	63.3	Rated Cooling Capacity	kW	60.4
	BTU/h	216,000		BTU/h	206,000
Input	kW	19.23	Input	kW	(Non-Ducted) 17.72 (Ducted) 16.10

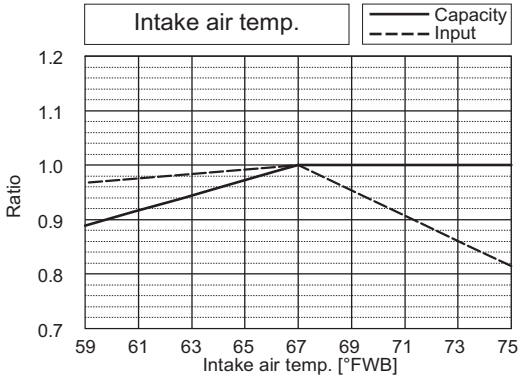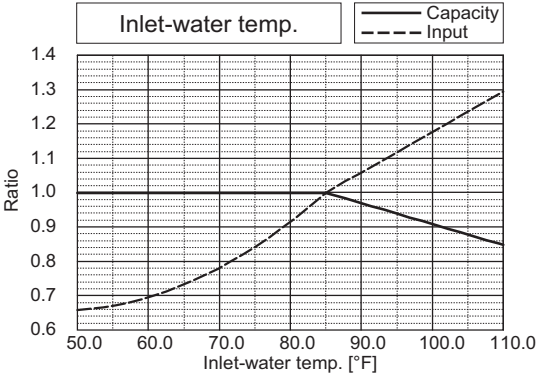





PQHY-			P216TLMU/YLMU		
Nominal Heating Capacity	kW	71.2	Rated Heating Capacity	kW	68.0
	BTU/h	243,000		BTU/h	232,000
Input	kW	13.04	Input	kW	(Non-Ducted) 12.01 (Ducted) 12.34

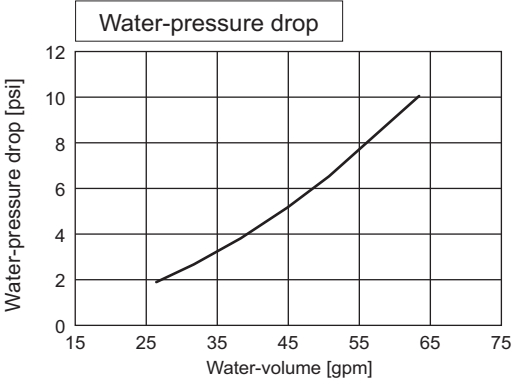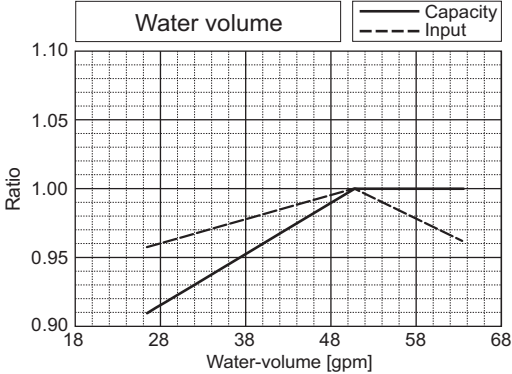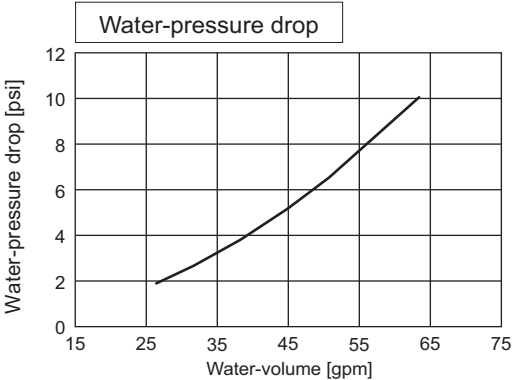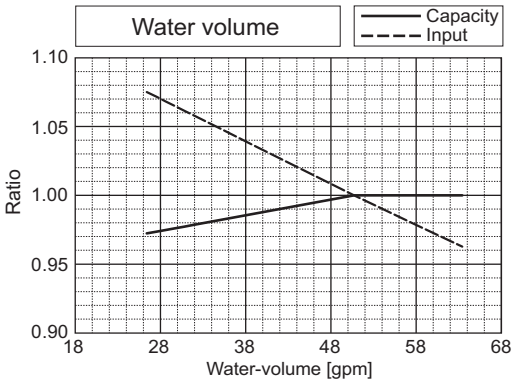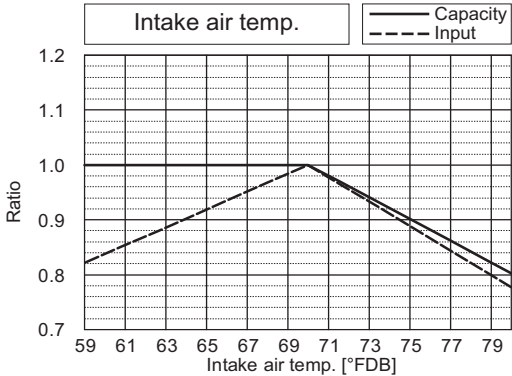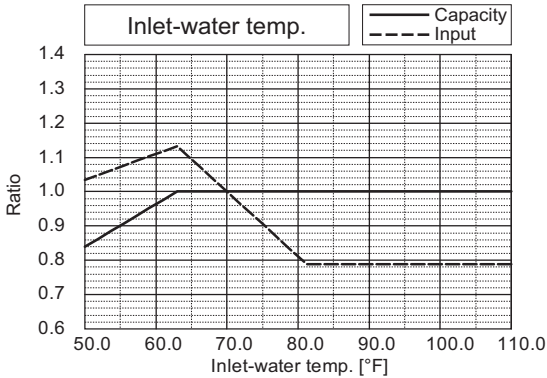

PQHY-			P240TLMU/YLMU		
Nominal Cooling Capacity	kW	70.3	Rated Cooling Capacity	kW	66.8
	BTU/h	240,000		BTU/h	228,000
Input	kW	21.14	Input	kW	(Non-Ducted) 19.49 (Ducted) 18.74

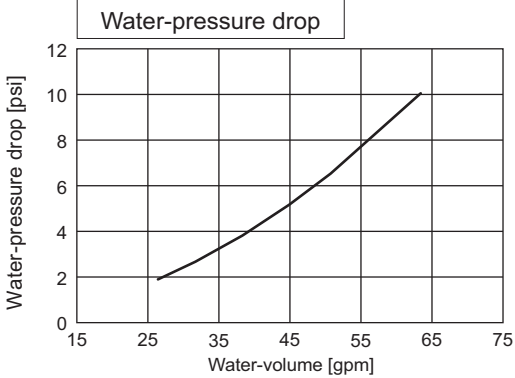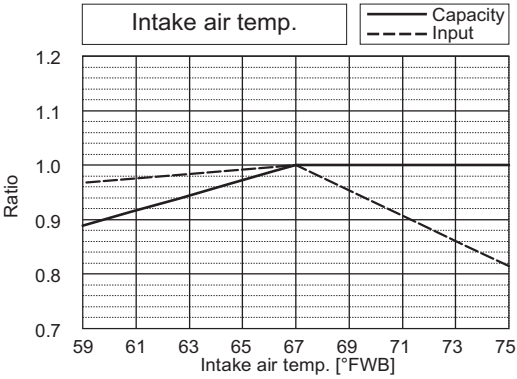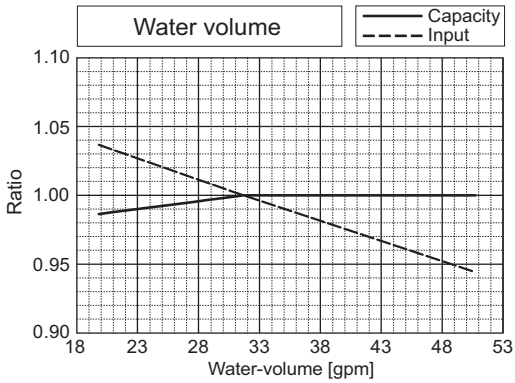
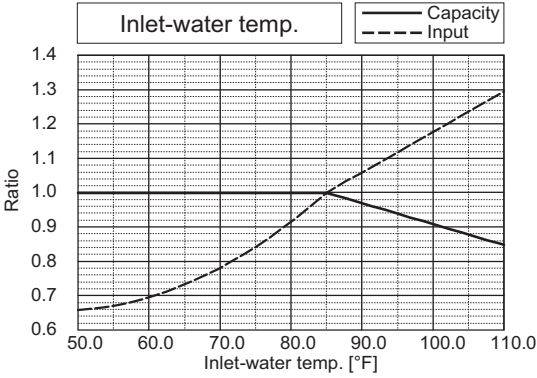


PQHY-			P240TLMU/YLMU		
Nominal Heating Capacity	kW	79.1	Rated Heating Capacity	kW	75.6
	BTU/h	270,000		BTU/h	258,000
Input	kW	15.12	Input	kW	(Non-Ducted) 13.93 (Ducted) 14.62



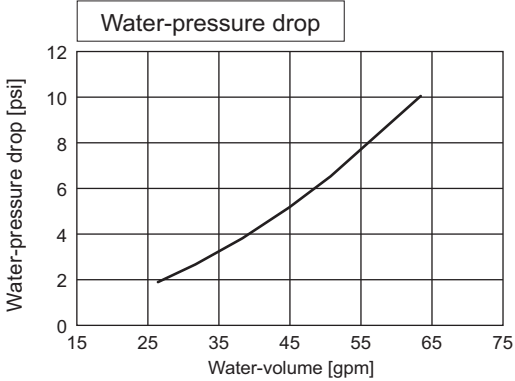
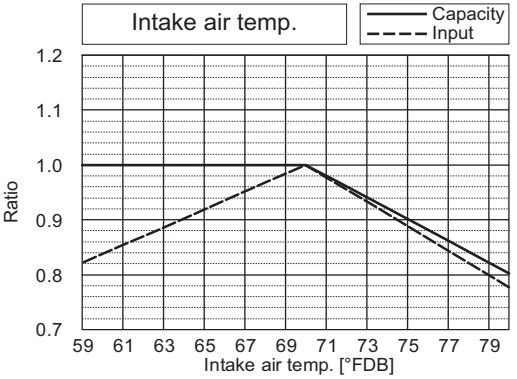
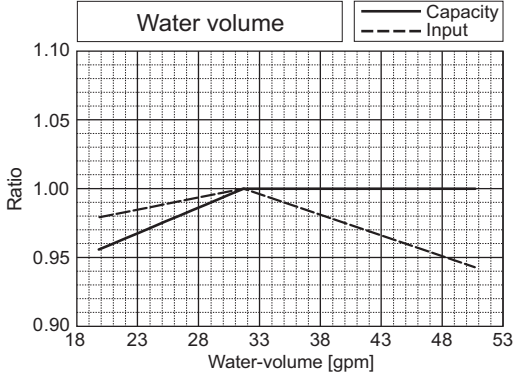
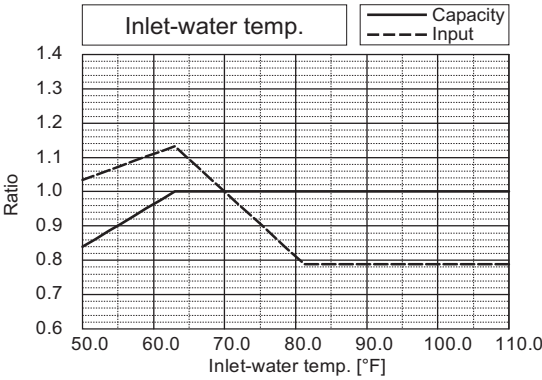


*The drawing indicates characteristic per unit.



PQHY-		P144TSLMU/YSLMU			
Nominal Cooling Capacity	kW	42.2	Rated Cooling Capacity	kW	40.2
	BTU/h	144,000		BTU/h	137,000
Input	kW	7.11	Input	kW	(Non-Ducted) 6.53 (Ducted) 7.72

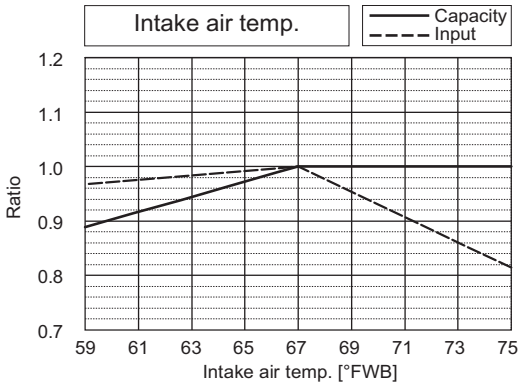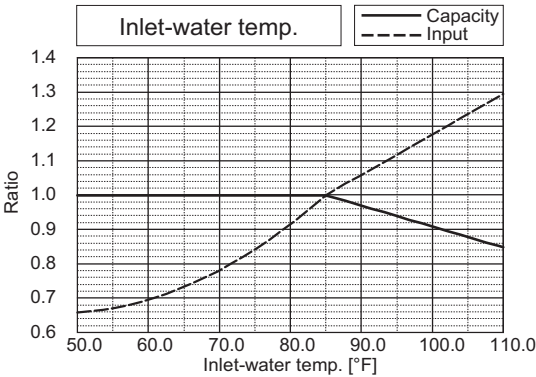



PQHY-		P144TSLMU/YSLMU			
Nominal Heating Capacity	kW	46.9	Rated Heating Capacity	kW	44.5
	BTU/h	160,000		BTU/h	152,000
Input	kW	7.45	Input	kW	(Non-Ducted) 6.86 (Ducted) 7.22

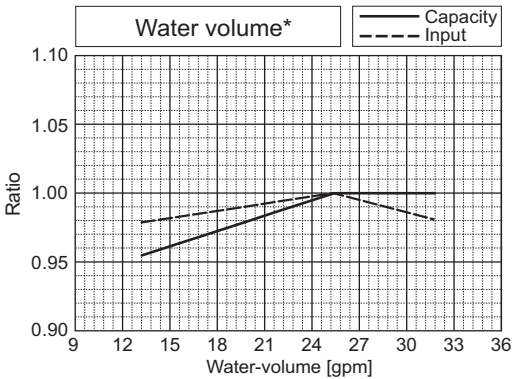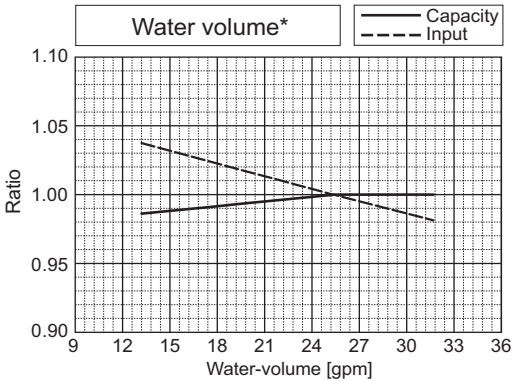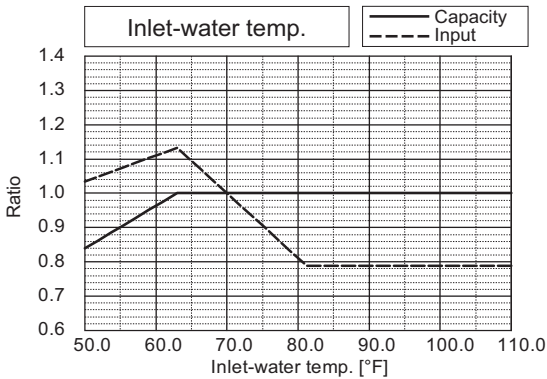





PQHY-			P168TSLMU/YSLMU		
Nominal Cooling Capacity	kW	49.2	Rated Cooling Capacity	kW	47.2
	BTU/h	168,000		BTU/h	161,000
Input	kW	9.33	Input	kW	(Non-Ducted) 8.58 (Ducted) 9.22

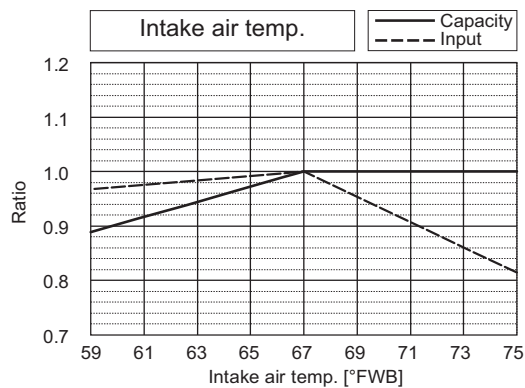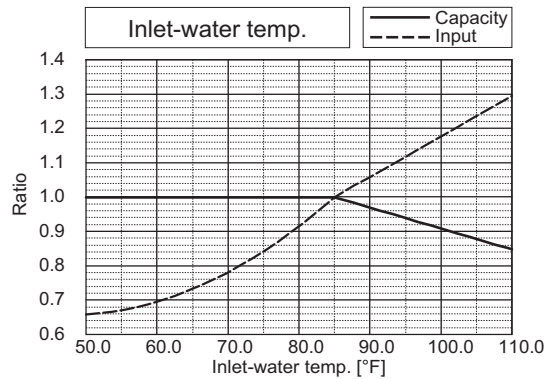

PQHY-			P168TSLMU/YSLMU		
Nominal Heating Capacity	kW	55.1	Rated Heating Capacity	kW	52.5
	BTU/h	188,000		BTU/h	179,000
Input	kW	9.34	Input	kW	(Non-Ducted) 8.60 (Ducted) 8.03

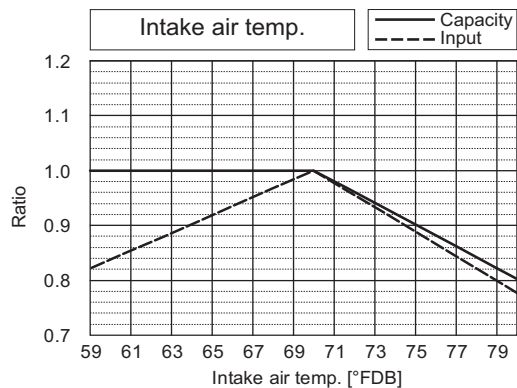
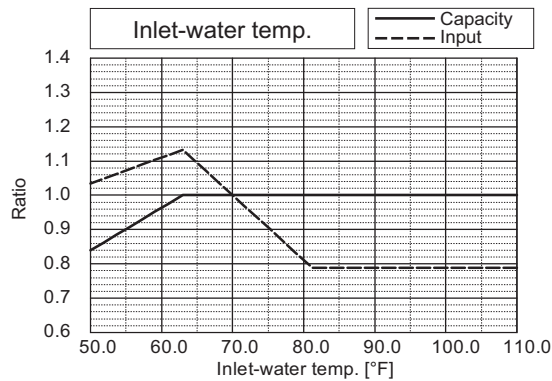


*The drawing indicates characteristic per unit.



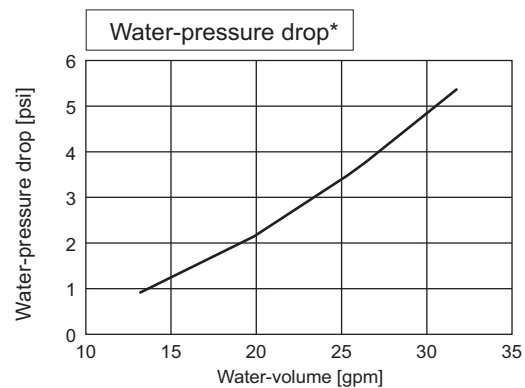
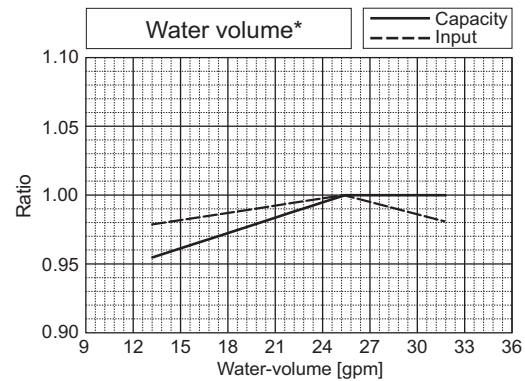
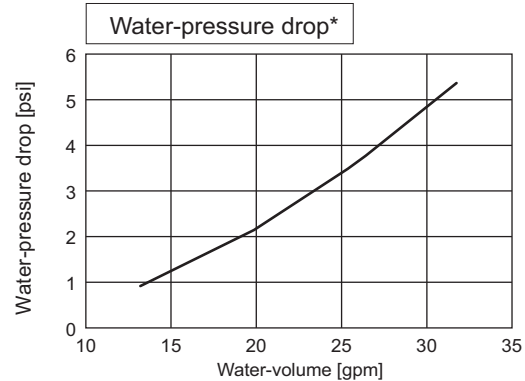
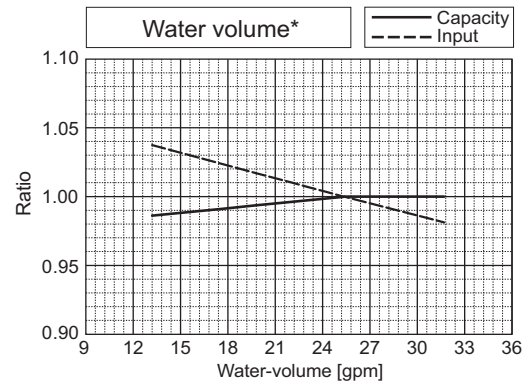


*The drawing indicates characteristic per unit.



PQHY-			P192TSLMU/YSLMU		
Nominal Cooling Capacity	kW	56.3	Rated Cooling Capacity	kW	53.6
	BTU/h	192,000		BTU/h	183,000
Input	kW	11.30	Input	kW	(Non-Ducted) 10.40 (Ducted) 10.98

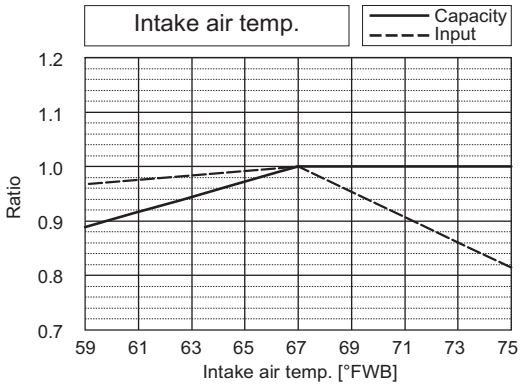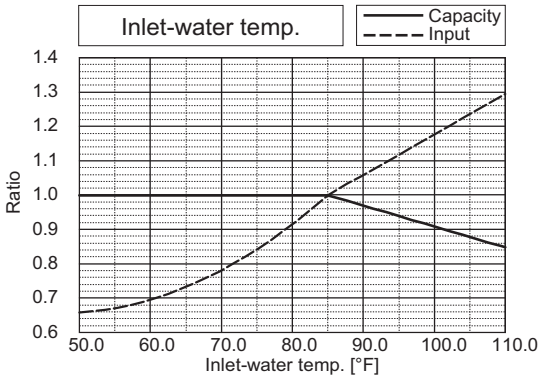



PQHY-			P192TSLMU/YSLMU		
Nominal Heating Capacity	kW	63.0	Rated Heating Capacity	kW	60.1
	BTU/h	215,000		BTU/h	205,000
Input	kW	11.02	Input	kW	(Non-Ducted) 10.16 (Ducted) 8.90

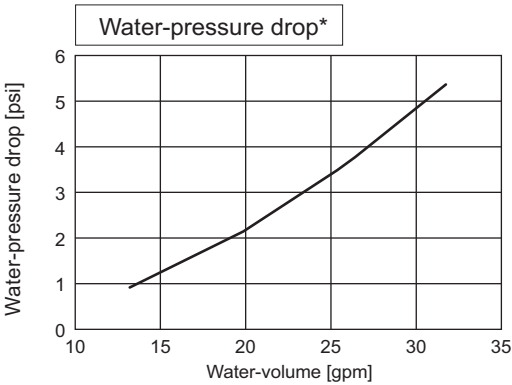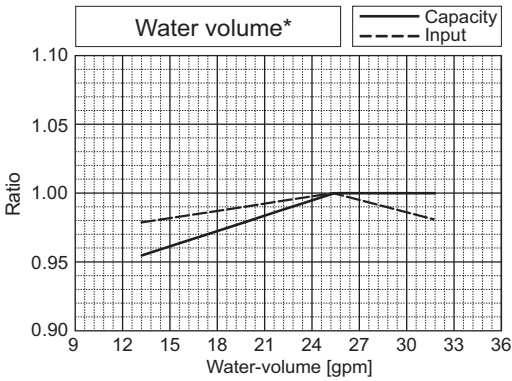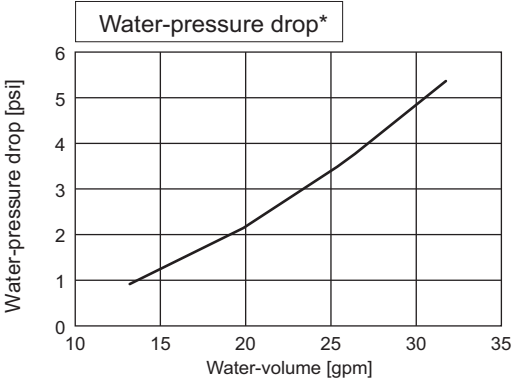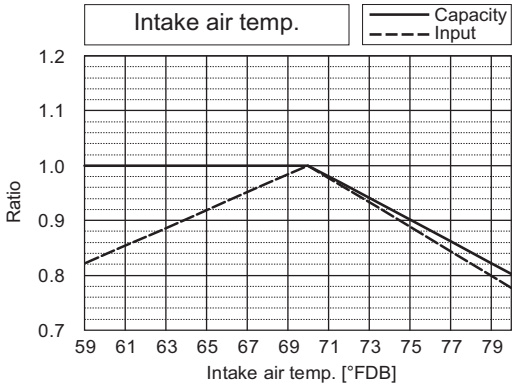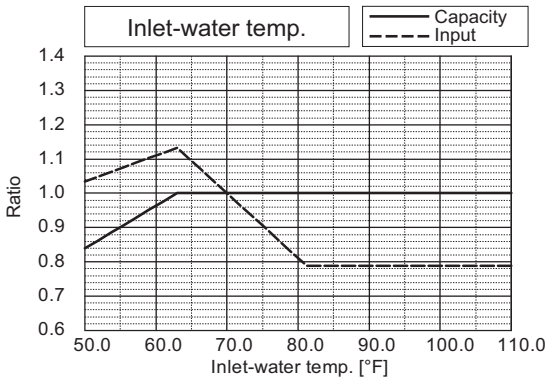





PQHY-			P216TSLMU/YSLMU		
Nominal Cooling Capacity	kW	63.3	Rated Cooling Capacity	kW	60.4
	BTU/h	216,000		BTU/h	206,000
Input	kW	14.03	Input	kW	(Non-Ducted) 12.93 (Ducted) 13.24

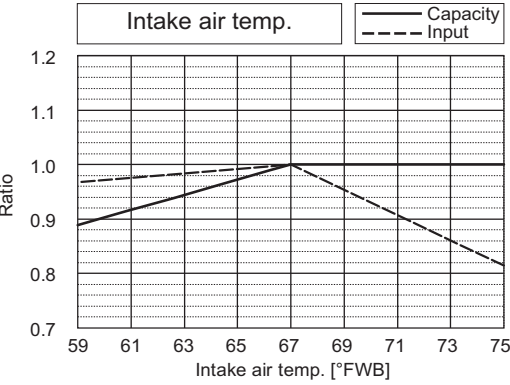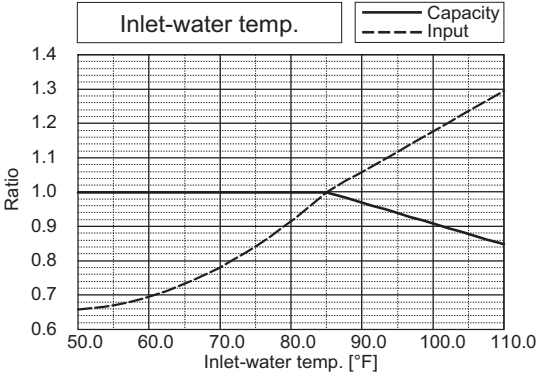

PQHY-			P216TSLMU/YSLMU		
Nominal Heating Capacity	kW	71.2	Rated Heating Capacity	kW	68.0
	BTU/h	243,000		BTU/h	232,000
Input	kW	12.88	Input	kW	(Non-Ducted) 11.88 (Ducted) 10.35

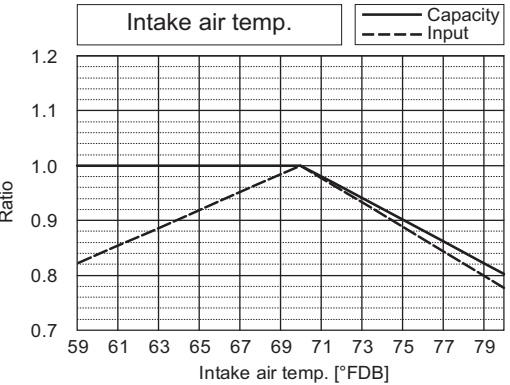
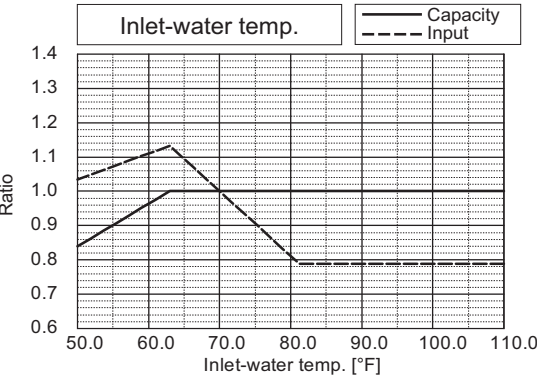


*The drawing indicates characteristic per unit.



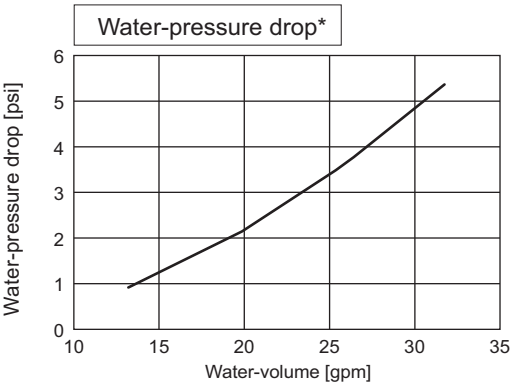
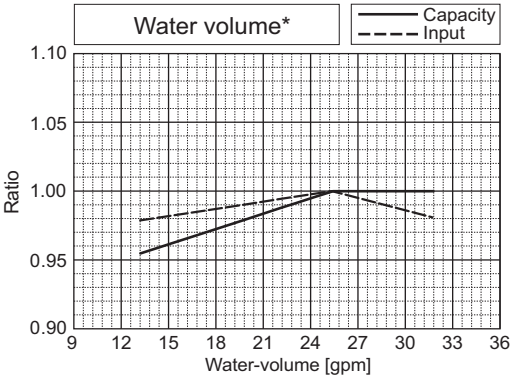
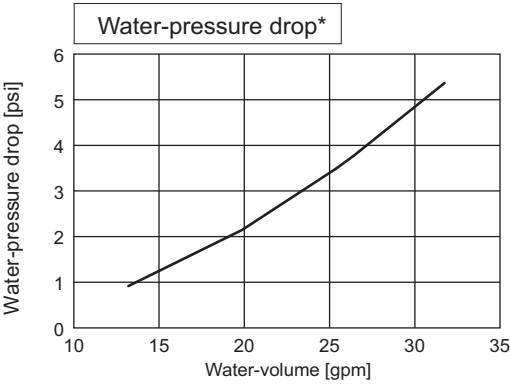
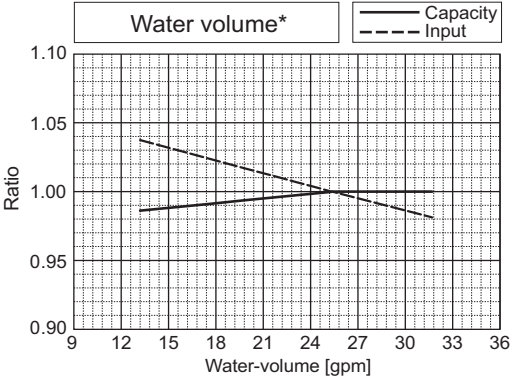


*The drawing indicates characteristic per unit.





PQHY-		P240TSLMU/YSLMU			
Nominal Cooling Capacity	kW	70.3	Rated Cooling Capacity	kW	66.8
	BTU/h	240,000		BTU/h	228,000
Input	kW	16.89	Input	kW	(Non-Ducted) 15.57 (Ducted) 16.15

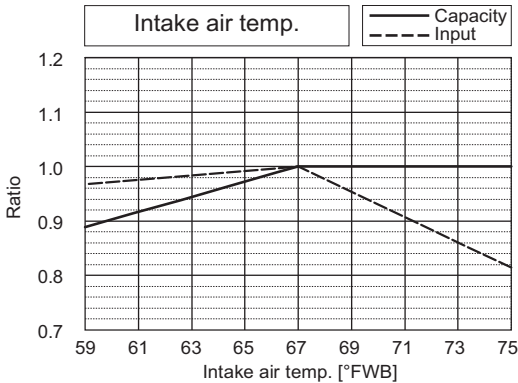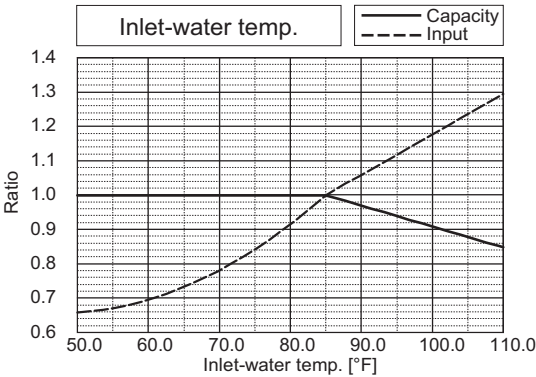





PQHY-		P240TSLMU/YSLMU			
Nominal Heating Capacity	kW	79.1	Rated Heating Capacity	kW	75.6
	BTU/h	270,000		BTU/h	258,000
Input	kW	14.58	Input	kW	(Non-Ducted) 13.45 (Ducted) 12.02

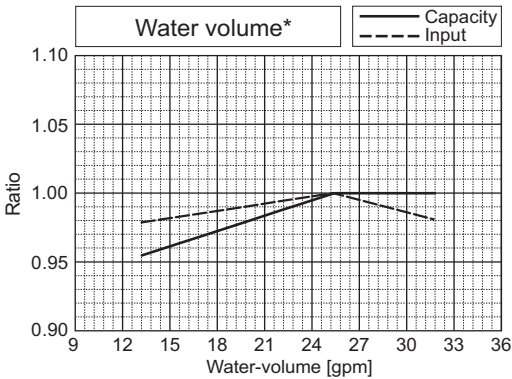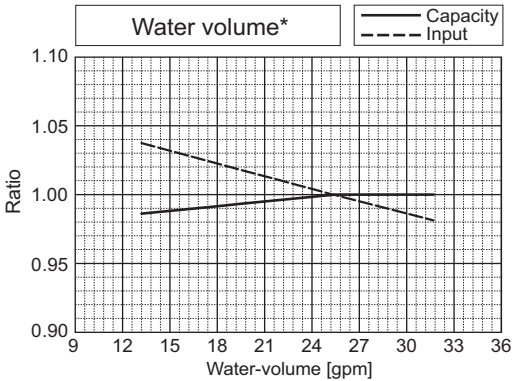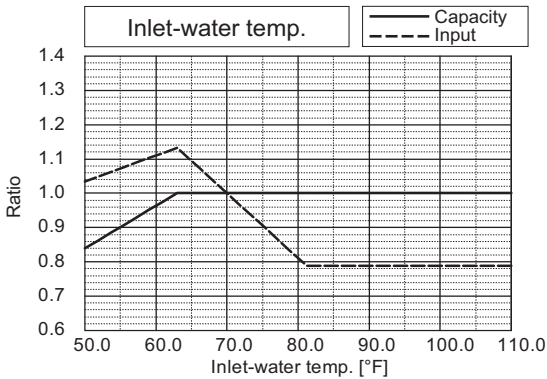

PQHY-		P288TSLMU/YSLMU			
Nominal Cooling Capacity	kW	84.4	Rated Cooling Capacity	kW	80.6
	BTU/h	288,000		BTU/h	275,000
Input	kW	20.42	Input	kW	(Non-Ducted) 18.82 (Ducted) 21.43

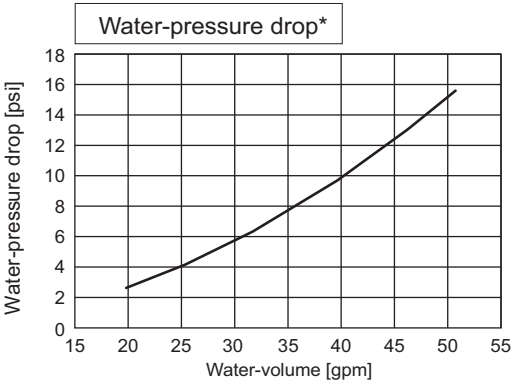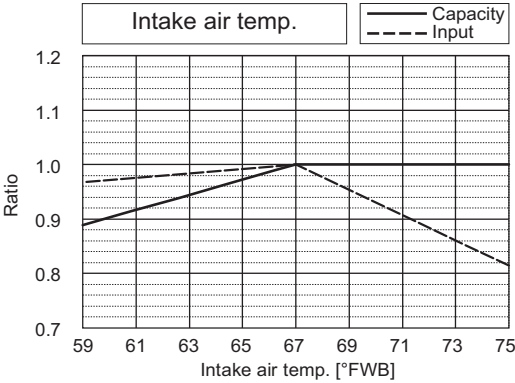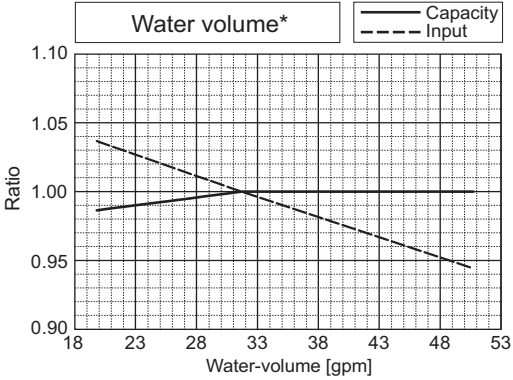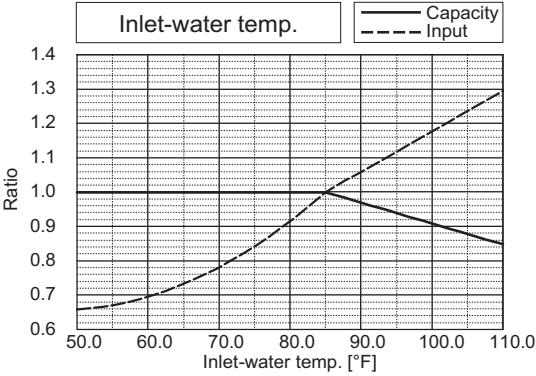



PQHY-		P288TSLMU/YSLMU			
Nominal Heating Capacity	kW	94.7	Rated Heating Capacity	kW	90.3
	BTU/h	323,000		BTU/h	308,000
Input	kW	17.50	Input	kW	(Non-Ducted) 16.13 (Ducted) 16.05

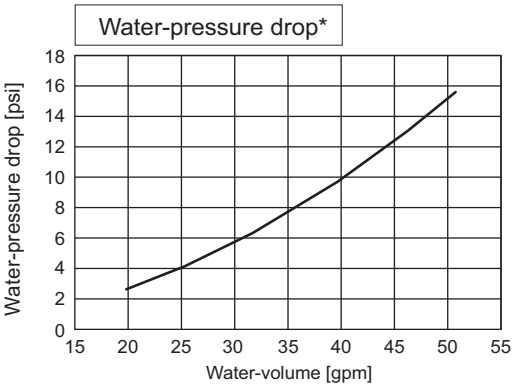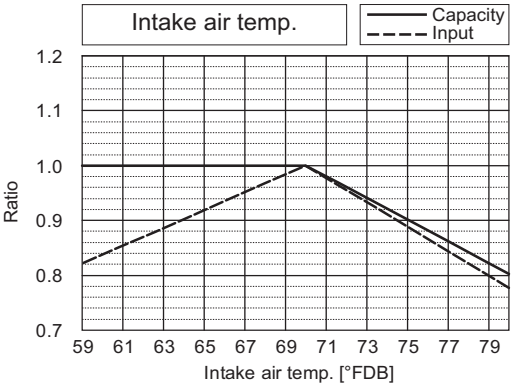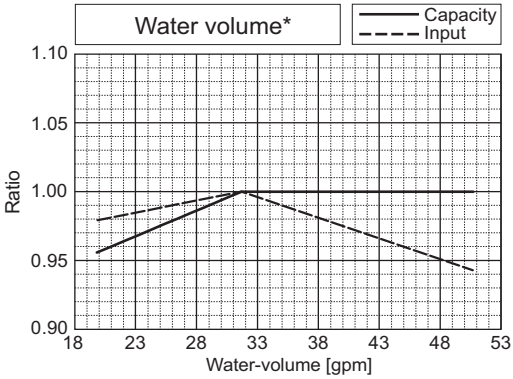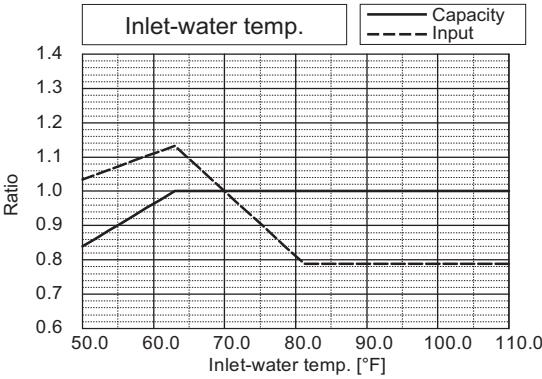







*The drawing indicates characteristic per unit.

*The drawing indicates characteristic per unit.



PQHY-		P312TSLMU/YSLMU			
Nominal Cooling Capacity	kW	91.4	Rated Cooling Capacity	kW	87.0
	BTU/h	312,000		BTU/h	297,000
Input	kW	23.41	Input	kW	(Non-Ducted) 21.59 (Ducted) 23.67

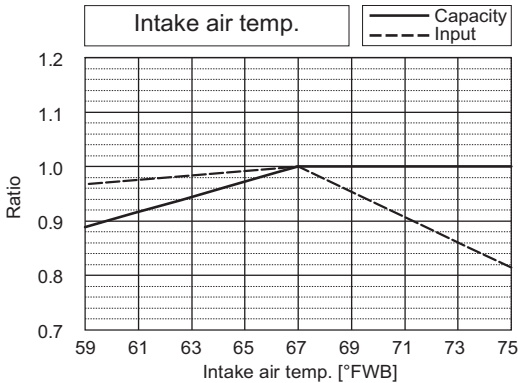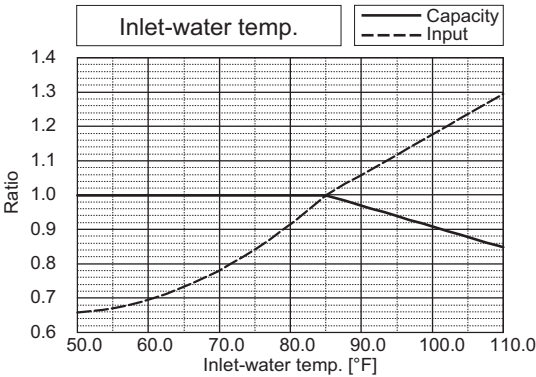



PQHY-		P312TSLMU/YSLMU			
Nominal Heating Capacity	kW	102.6	Rated Heating Capacity	kW	97.9
	BTU/h	350,000		BTU/h	334,000
Input	kW	19.11	Input	kW	(Non-Ducted) 17.62 (Ducted) 17.96

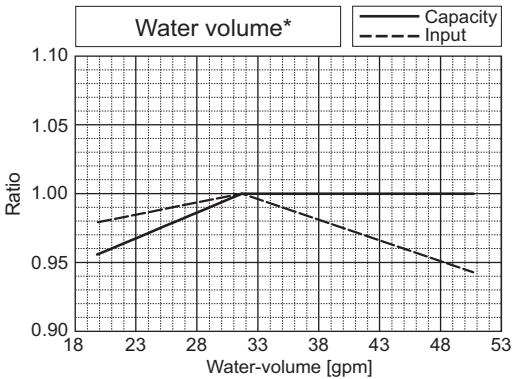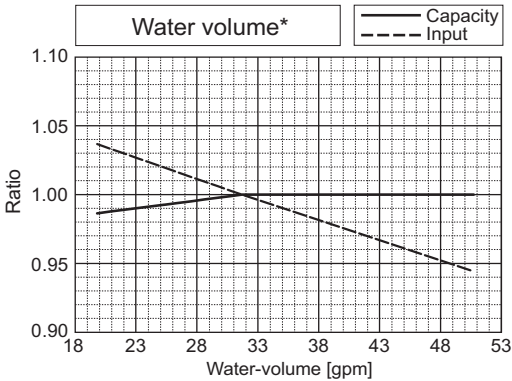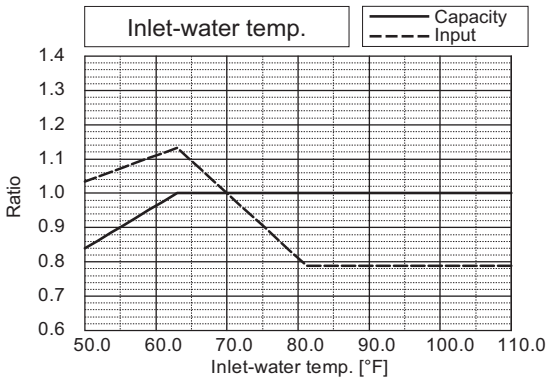





PQHY-		P336TSLMU/YSLMU			
Nominal Cooling Capacity	kW	98.5	Rated Cooling Capacity	kW	93.8
	BTU/h	336,000		BTU/h	320,000
Input	kW	26.84	Input	kW	(Non-Ducted) 24.76 (Ducted) 25.85

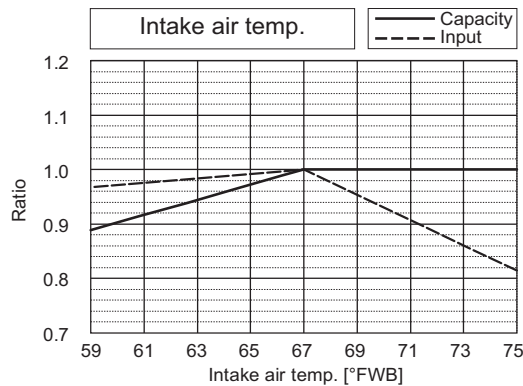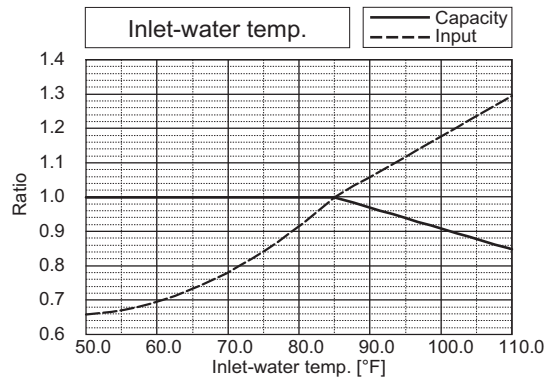

PQHY-		P336TSLMU/YSLMU			
Nominal Heating Capacity	kW	110.8	Rated Heating Capacity	kW	105.8
	BTU/h	378,000		BTU/h	361,000
Input	kW	20.77	Input	kW	(Non-Ducted) 19.16 (Ducted) 20.05



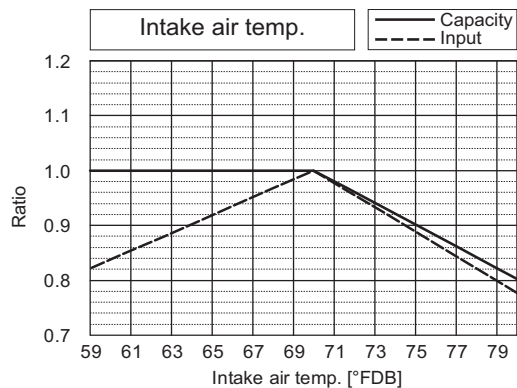
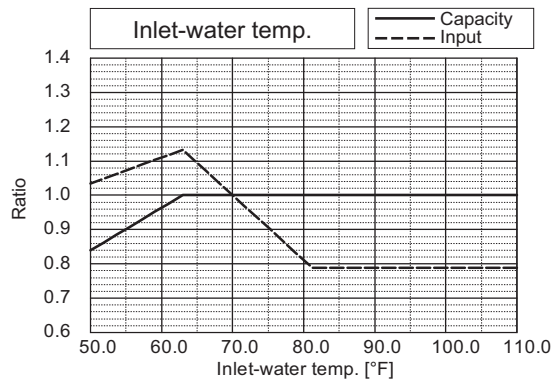


*The drawing indicates characteristic per unit.

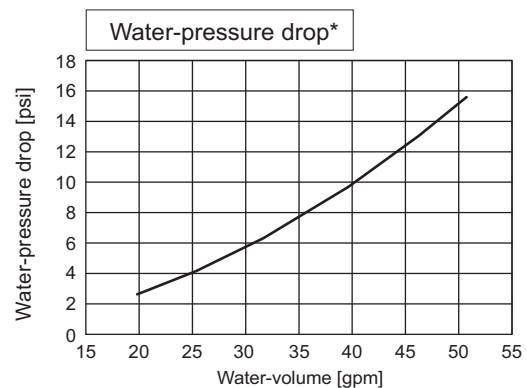
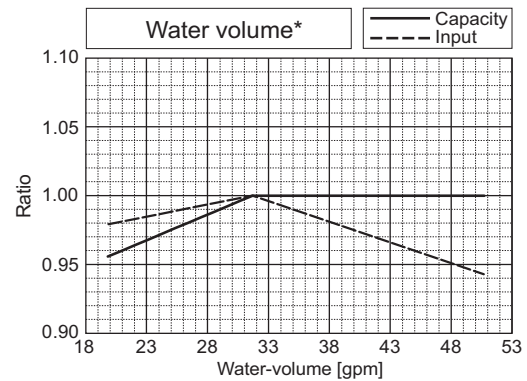
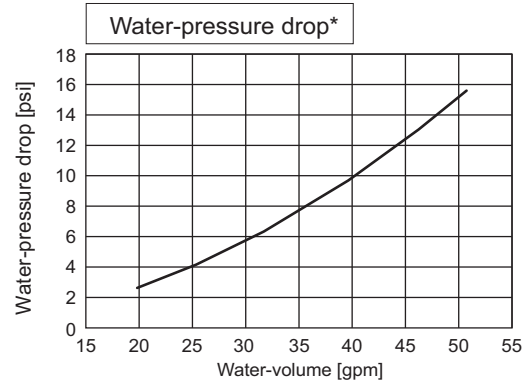
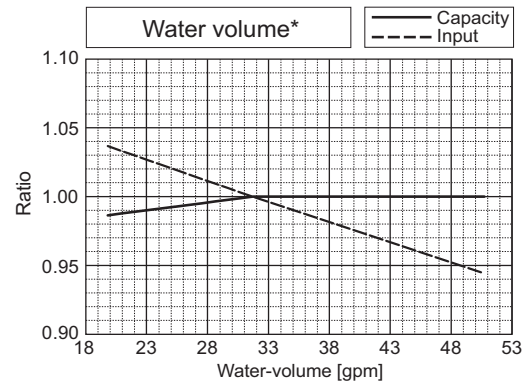


*The drawing indicates characteristic per unit.

PQHY-			P360TSLMU/YSLMU		
Nominal Cooling Capacity	kW	105.5	Rated Cooling Capacity	kW	100.2
	BTU/h	360,000		BTU/h	342,000
Input	kW	29.43	Input	kW	(Non-Ducted) 27.17 (Ducted) 27.41

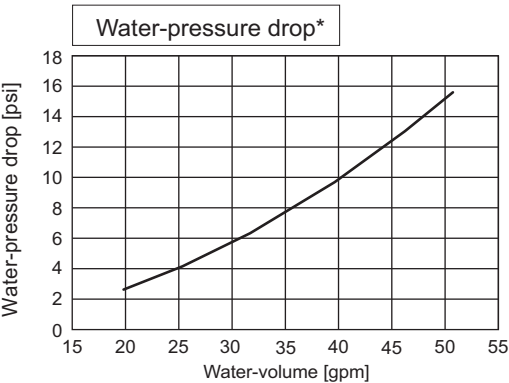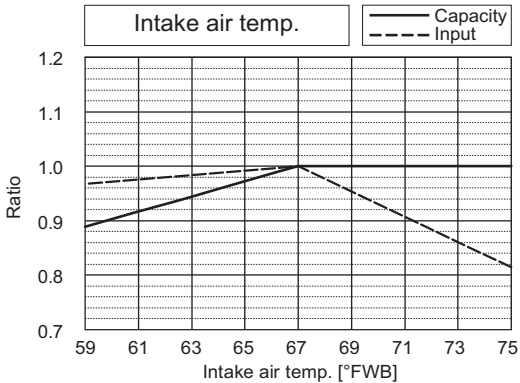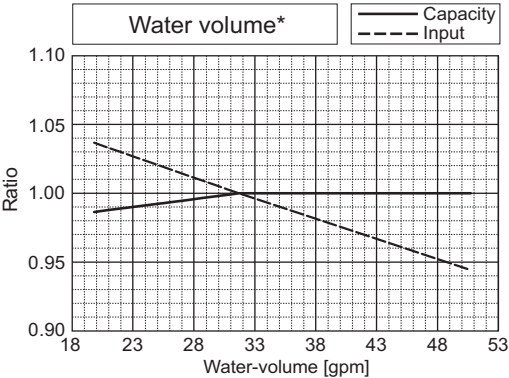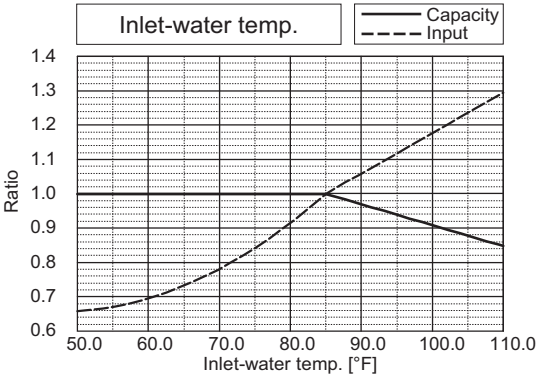

PQHY-			P360TSLMU/YSLMU		
Nominal Heating Capacity	kW	118.7	Rated Heating Capacity	kW	113.4
	BTU/h	405,000		BTU/h	387,000
Input	kW	22.85	Input	kW	(Non-Ducted) 21.09 (Ducted) 21.70

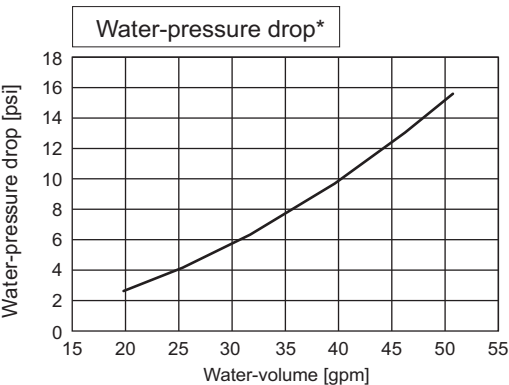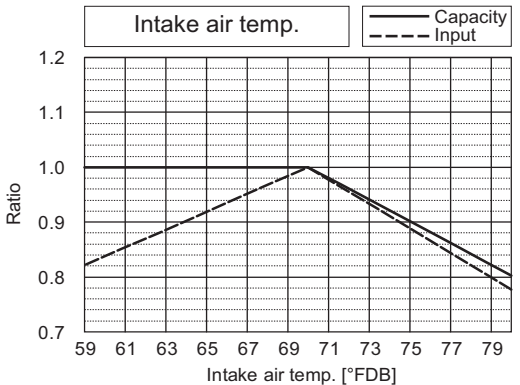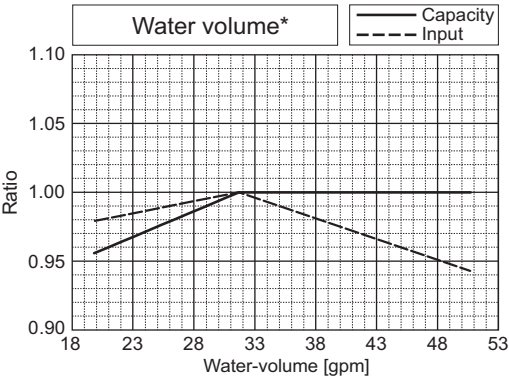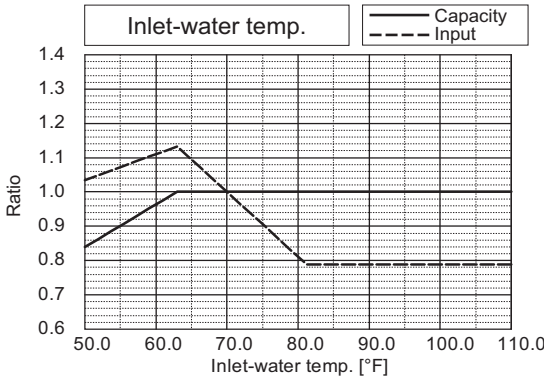

WY


8-2. Correction by total indoor

CITY MULTI system have different capacities and inputs when many combinations of indoor units with different total capacities are connected. Using following tables, the maximum capacity can be found to ensure the system is installed with enough capacity for a particular application.

PQHY-		P72TLMU/YLMU	
		Non-Ducted	Ducted
Nominal cooling capacity	BTU/h	72,000	
	kW	21.1	
Input	kW	3.23	
Rated cooling capacity	BTU/h	69,000	
	kW	20.2	
Input	kW	2.96	3.12

PQHY-		P72TLMU/YLMU	
		Non-Ducted	Ducted
Nominal Heating capacity	BTU/h	80,000	
	kW	23.4	
Input	kW	3.63	
Rated Heating capacity	BTU/h	76,000	
	kW	22.3	
Input	kW	3.34	3.36


PQHY-P72TLMU/YLMU-A

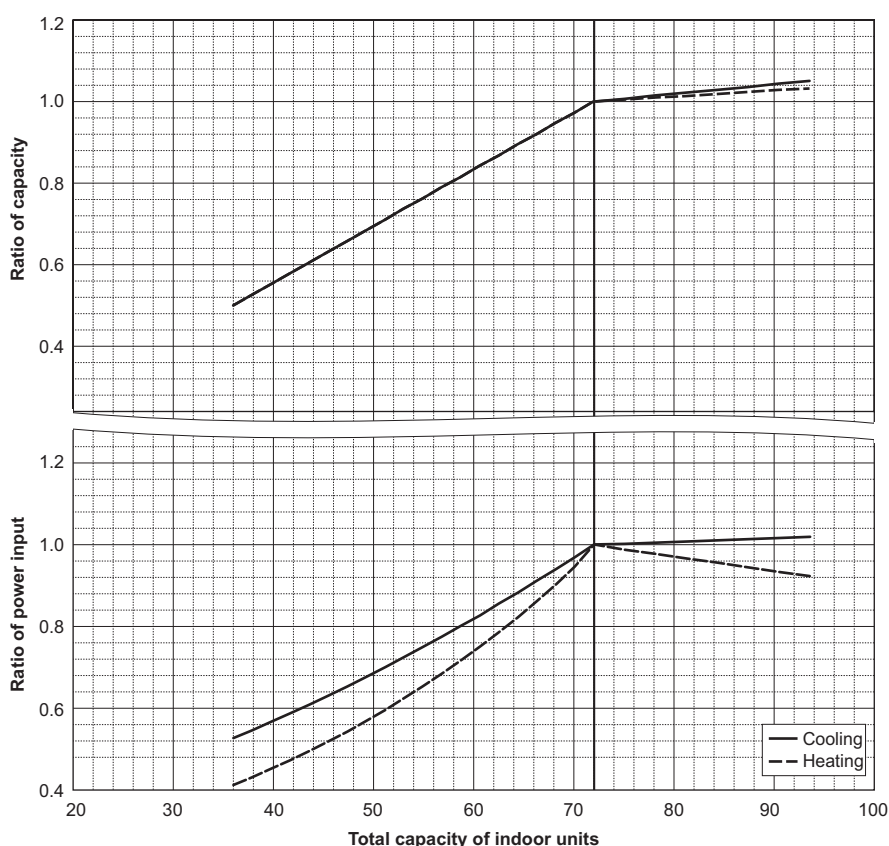

PQHY-		P96TLMU/YLMU	
		Non-Ducted	Ducted
Nominal cooling capacity	BTU/h	96,000	
	kW	28.1	
Input	kW	4.65	
Rated cooling capacity	BTU/h	92,000	
	kW	27.0	
Input	kW	4.26	5.19


PQHY-		P96TLMU/YLMU	
		Non-Ducted	Ducted
Nominal Heating capacity	BTU/h	108,000	
	kW	31.7	
Input	kW	5.05	
Rated Heating capacity	BTU/h	103,000	
	kW	30.2	
Input	kW	4.65	4.48

PQHY-P96TLMU/YLMU-A

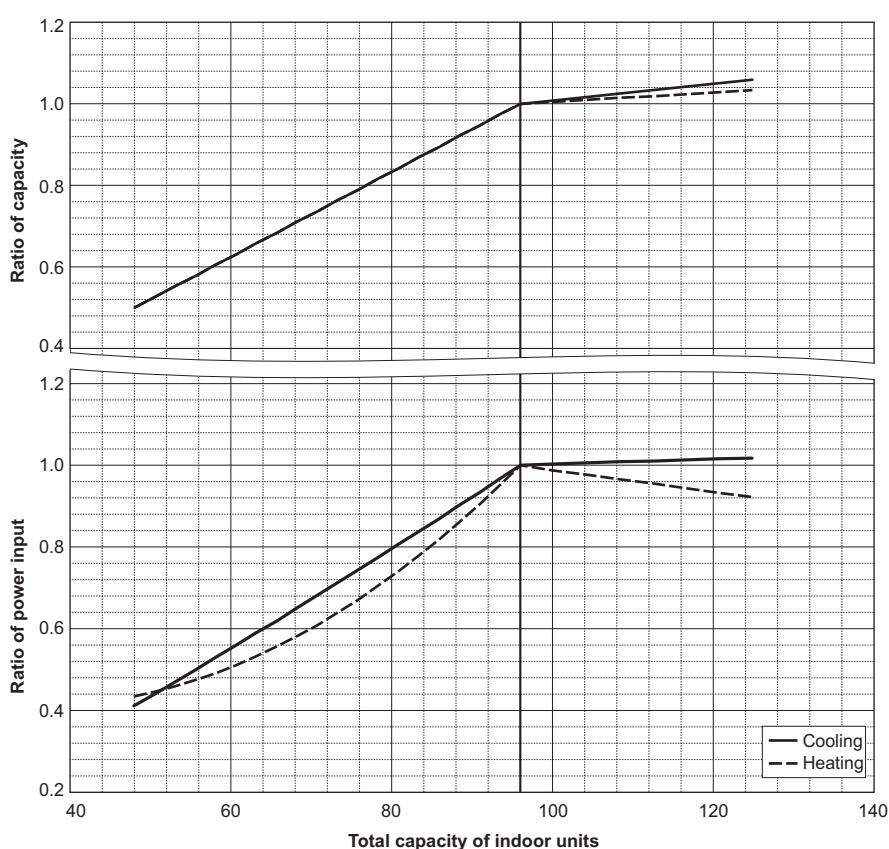

PQHY-		P120TLMU/YLMU	
		Non-Ducted	Ducted
Nominal cooling capacity	BTU/h	120,000	
	kW	35.2	
	Input kW	7.24	
Rated cooling capacity	BTU/h	114,000	
	kW	33.4	
	Input kW	6.66	7.35

PQHY-		P120TLMU/YLMU	
		Non-Ducted	Ducted
Nominal Heating capacity	BTU/h	135,000	
	kW	39.6	
	Input kW	6.83	
Rated Heating capacity	BTU/h	129,000	
	kW	37.8	
	Input kW	6.29	5.92

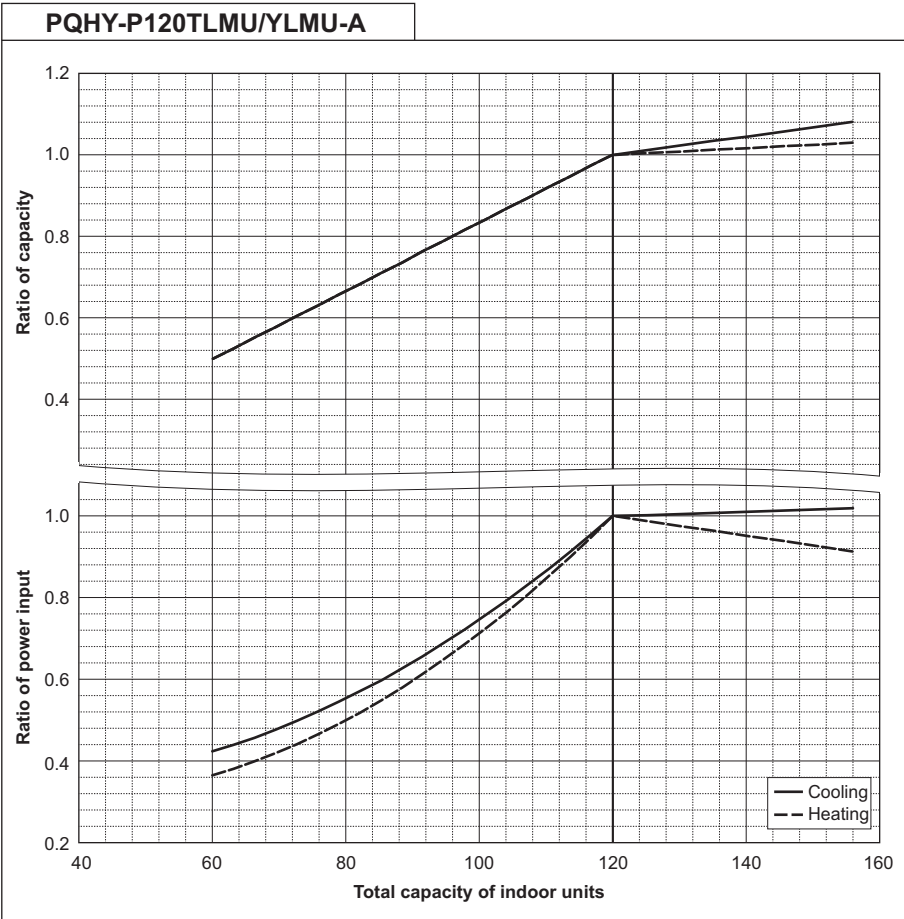


PQHY-		P144TLMU/YLMU	
		Non-Ducted	Ducted
Nominal cooling capacity	BTU/h	144,000	
	kW	42.2	
	Input kW	8.78	
Rated cooling capacity	BTU/h	137,000	
	kW	40.2	
	Input kW	8.07	9.98

PQHY-		P144TLMU/YLMU	
		Non-Ducted	Ducted
Nominal Heating capacity	BTU/h	160,000	
	kW	46.9	
	Input kW	8.11	
Rated Heating capacity	BTU/h	152,000	
	kW	44.5	
	Input kW	7.47	7.90

PQHY-		P144TSLMU/YSLMU	
		Non-Ducted	Ducted
Nominal cooling capacity	BTU/h	144,000	
	kW	42.2	
	Input kW	7.11	
Rated cooling capacity	BTU/h	137,000	
	kW	40.2	
	Input kW	6.53	7.72

PQHY-		P144TSLMU/YSLMU	
		Non-Ducted	Ducted
Nominal Heating capacity	BTU/h	160,000	
	kW	46.9	
	Input kW	7.45	
Rated Heating capacity	BTU/h	152,000	
	kW	44.5	
	Input kW	6.86	7.22

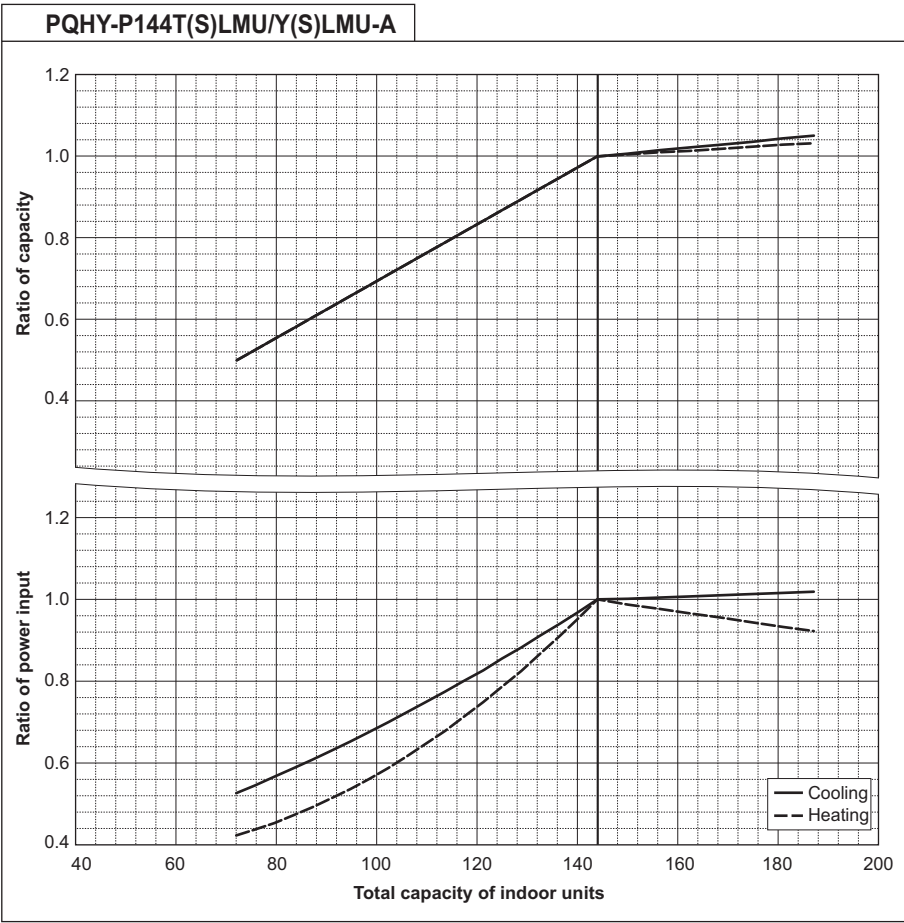

PQHY-		P168TLMU/YLMU	
		Non-Ducted	Ducted
Nominal cooling capacity	BTU/h	168,000	
	kW	49.2	
	Input kW	12.05	
Rated cooling capacity	BTU/h	161,000	
	kW	47.2	
	Input kW	11.10	11.88

PQHY-		P168TLMU/YLMU	
		Non-Ducted	Ducted
Nominal Heating capacity	BTU/h	188,000	
	kW	55.1	
	Input kW	9.86	
Rated Heating capacity	BTU/h	179,000	
	kW	52.5	
	Input kW	9.09	9.72

PQHY-		P168TSLMU/YSLMU	
		Non-Ducted	Ducted
Nominal cooling capacity	BTU/h	168,000	
	kW	49.2	
	Input kW	9.33	
Rated cooling capacity	BTU/h	161,000	
	kW	47.2	
	Input kW	8.58	9.22

PQHY-		P168TSLMU/YSLMU	
		Non-Ducted	Ducted
Nominal Heating capacity	BTU/h	188,000	
	kW	55.1	
	Input kW	9.34	
Rated Heating capacity	BTU/h	179,000	
	kW	52.5	
	Input kW	8.60	8.03


PQHY-		P192TLMU/YLMU	
		Non-Ducted	Ducted
Nominal cooling capacity	BTU/h	192,000	
	kW	56.3	
	Input kW	15.05	
Rated cooling capacity	BTU/h	183,000	
	kW	53.6	
	Input kW	13.87	14.19

PQHY-		P192TLMU/YLMU	
		Non-Ducted	Ducted
Nominal Heating capacity	BTU/h	215,000	
	kW	63.0	
	Input kW	11.90	
Rated Heating capacity	BTU/h	205,000	
	kW	60.1	
	Input kW	10.97	11.56


PQHY-		P192TSLMU/YSLMU	
		Non-Ducted	Ducted
Nominal cooling capacity	BTU/h	192,000	
	kW	56.3	
	Input kW	11.30	
Rated cooling capacity	BTU/h	183,000	
	kW	53.6	
	Input kW	10.40	10.98

PQHY-		P192TSLMU/YSLMU	
		Non-Ducted	Ducted
Nominal Heating capacity	BTU/h	215,000	
	kW	63.0	
	Input kW	11.02	
Rated Heating capacity	BTU/h	205,000	
	kW	60.1	
	Input kW	10.16	8.90

PQHY-P168T(S)LMU/Y(S)LMU-A

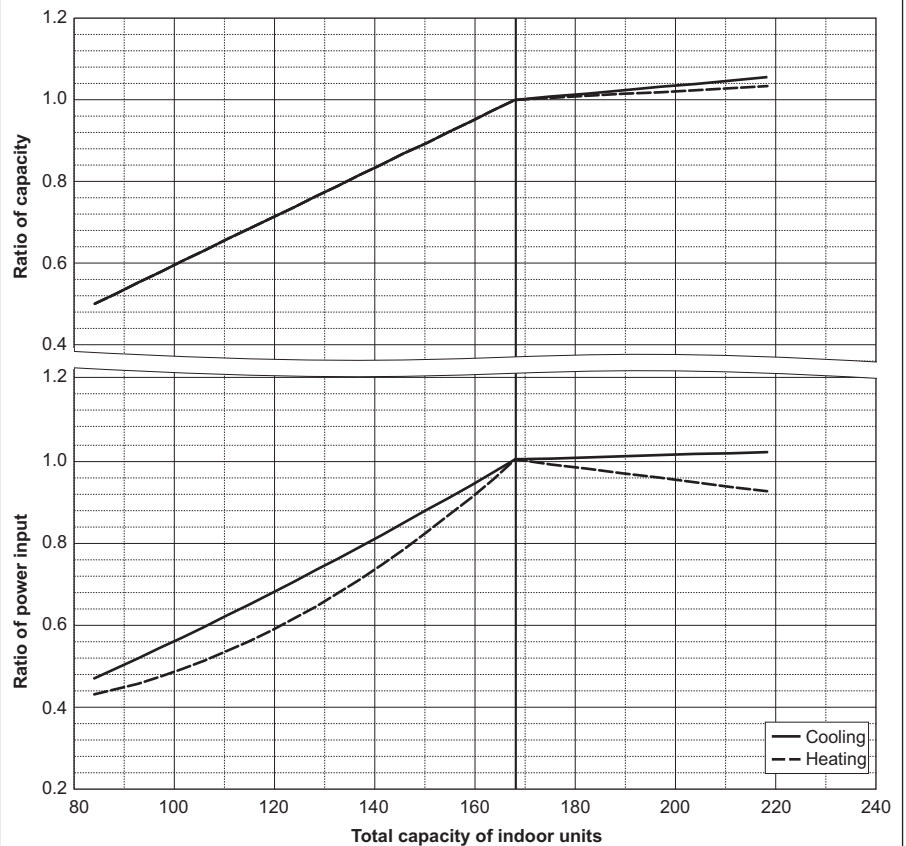

PQHY-P192T(S)LMU/Y(S)LMU-A

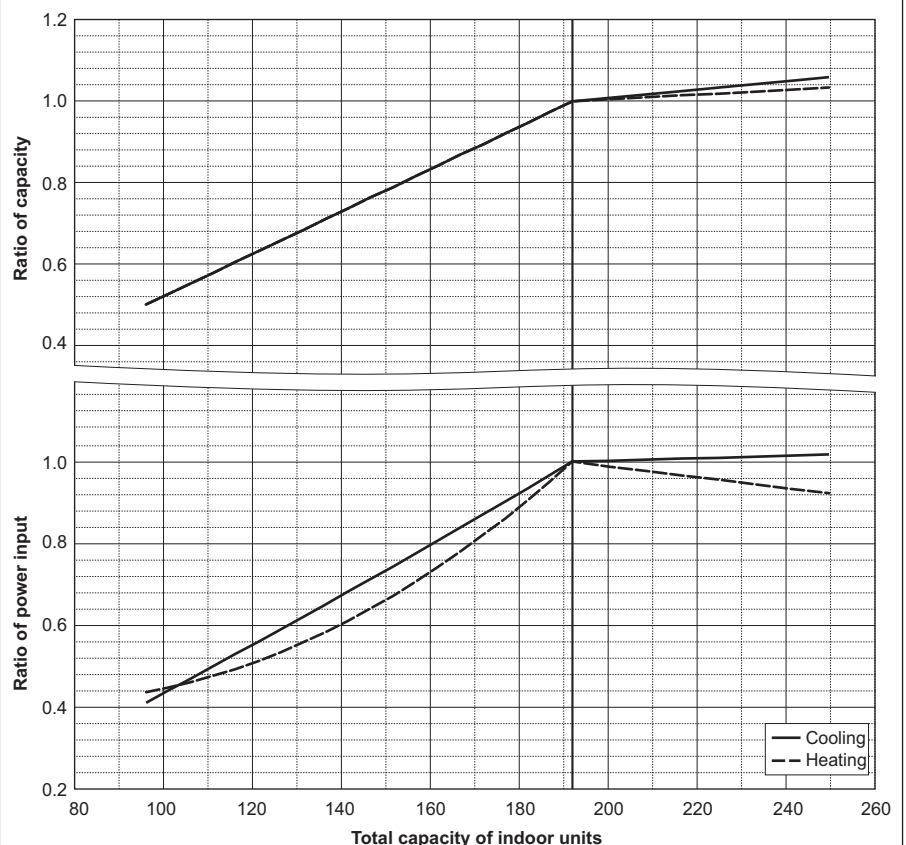

PQHY-		P216TLMU/YLMU	
		Non-Ducted	Ducted
Nominal cooling capacity	BTU/h	216,000	
	kW	63.3	
	Input kW	19.23	
Rated cooling capacity	BTU/h	206,000	
	kW	60.4	
	Input kW	17.72	16.10

PQHY-		P216TLMU/YLMU	
		Non-Ducted	Ducted
Nominal Heating capacity	BTU/h	243,000	
	kW	71.2	
	Input kW	13.04	
Rated Heating capacity	BTU/h	232,000	
	kW	68.0	
	Input kW	12.01	12.34

PQHY-		P216TSLMU/YSLMU	
		Non-Ducted	Ducted
Nominal cooling capacity	BTU/h	216,000	
	kW	63.3	
	Input kW	14.03	
Rated cooling capacity	BTU/h	206,000	
	kW	60.4	
	Input kW	12.93	13.24



PQHY-		P216TSLMU/YSLMU	
		Non-Ducted	Ducted
Nominal Heating capacity	BTU/h	243,000	
	kW	71.2	
	Input kW	12.88	
Rated Heating capacity	BTU/h	232,000	
	kW	68.0	
	Input kW	11.88	10.35

PQHY-		P240TLMU/YLMU	
		Non-Ducted	Ducted
Nominal cooling capacity	BTU/h	240,000	
	kW	70.3	
	Input kW	21.14	
Rated cooling capacity	BTU/h	228,000	
	kW	66.8	
	Input kW	19.49	18.74

PQHY-		P240TLMU/YLMU	
		Non-Ducted	Ducted
Nominal Heating capacity	BTU/h	270,000	
	kW	79.1	
	Input kW	15.12	
Rated Heating capacity	BTU/h	258,000	
	kW	75.6	
	Input kW	13.93	14.62

PQHY-		P240TSLMU/YSLMU	
		Non-Ducted	Ducted
Nominal cooling capacity	BTU/h	240,000	
	kW	70.3	
	Input kW	16.89	
Rated cooling capacity	BTU/h	228,000	
	kW	66.8	
	Input kW	15.57	16.15


PQHY-		P240TSLMU/YSLMU	
		Non-Ducted	Ducted
Nominal Heating capacity	BTU/h	270,000	
	kW	79.1	
	Input kW	14.58	
Rated Heating capacity	BTU/h	258,000	
	kW	75.6	
	Input kW	13.45	12.02

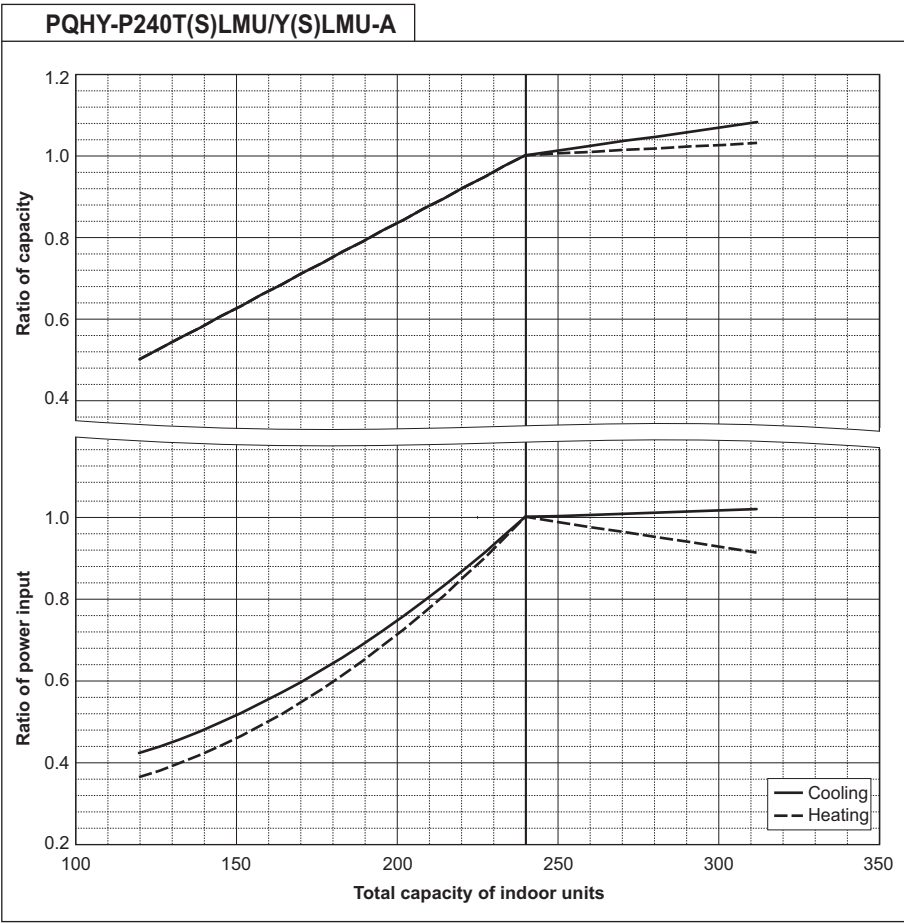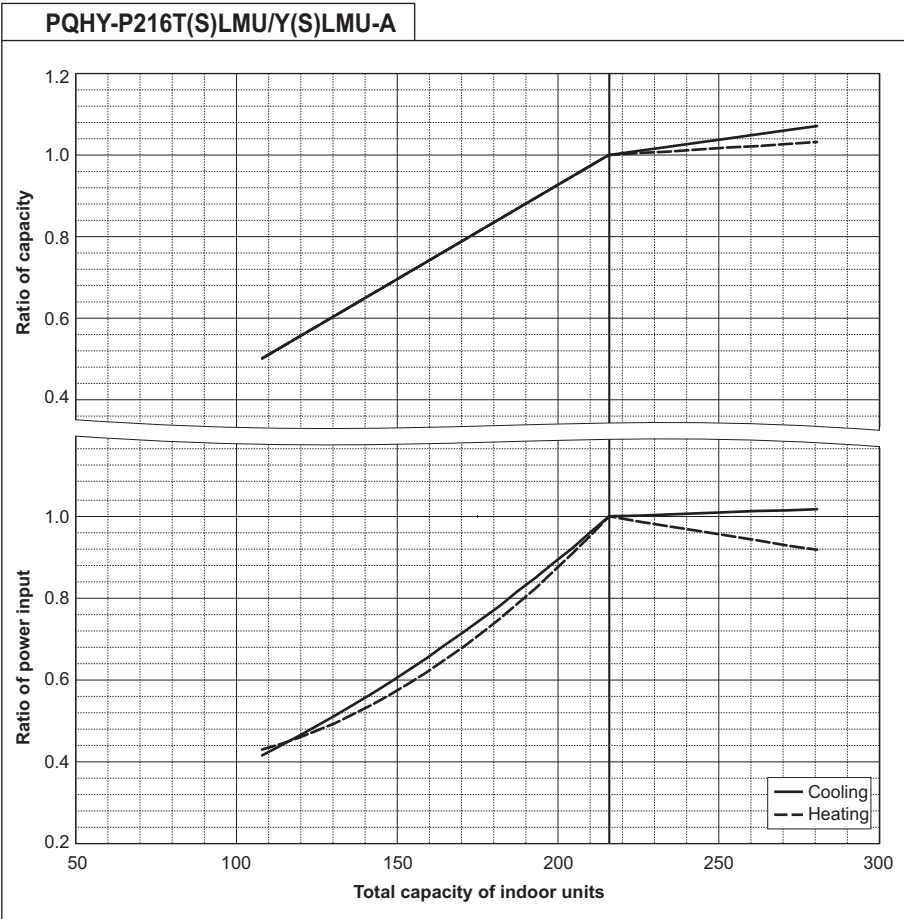

PQHY-		P288TSLMU/YSLMU	
		Non-Ducted	Ducted
Nominal cooling capacity	BTU/h	288,000	
	kW	84.4	
Input	kW	20.42	
	BTU/h	275,000	
Rated cooling capacity	kW	80.6	
	Input kW	18.82	21.43

PQHY-		P288TSLMU/YSLMU	
		Non-Ducted	Ducted
Nominal Heating capacity	BTU/h	323,000	
	kW	94.7	
Input	kW	17.50	
	BTU/h	308,000	
Rated Heating capacity	kW	90.3	
	Input kW	16.13	16.05


PQHY-P288TSLMU/YSLMU-A

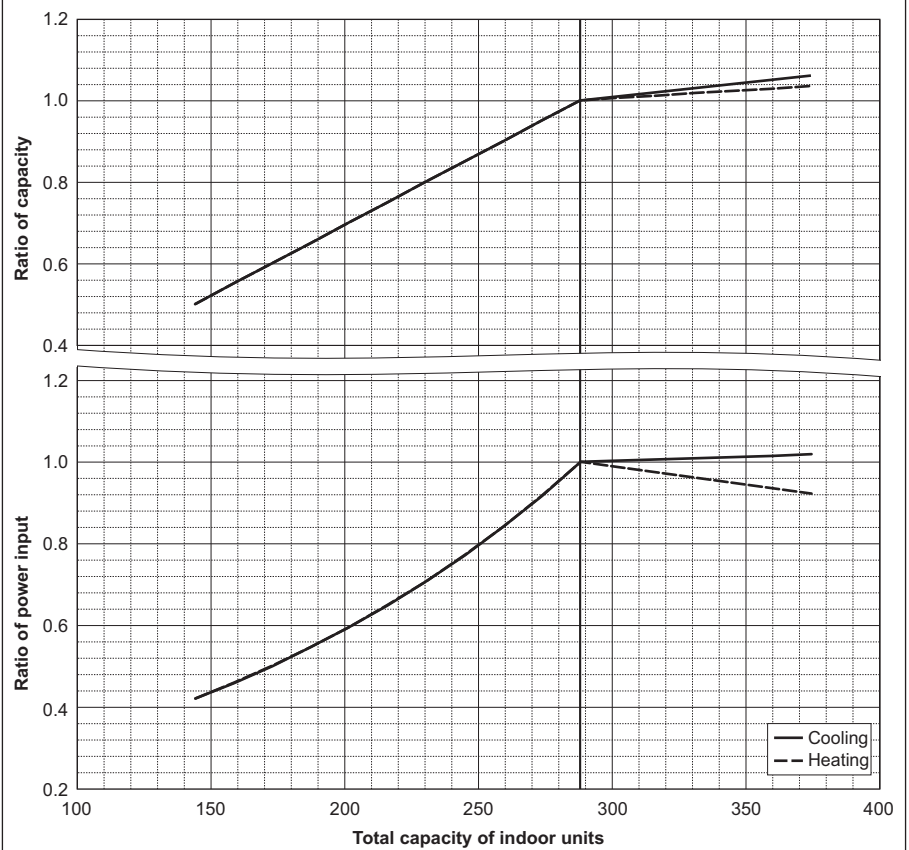

PQHY-		P312TSLMU/YSLMU	
		Non-Ducted	Ducted
Nominal cooling capacity	BTU/h	312,000	
	kW	91.4	
Input	kW	23.41	
	BTU/h	297,000	
Rated cooling capacity	kW	87.0	
	Input kW	21.59	23.67


PQHY-		P312TSLMU/YSLMU	
		Non-Ducted	Ducted
Nominal Heating capacity	BTU/h	350,000	
	kW	102.6	
Input	kW	19.11	
	BTU/h	334,000	
Rated Heating capacity	kW	97.9	
	Input kW	17.62	17.96

PQHY-P312TSLMU/YSLMU-A

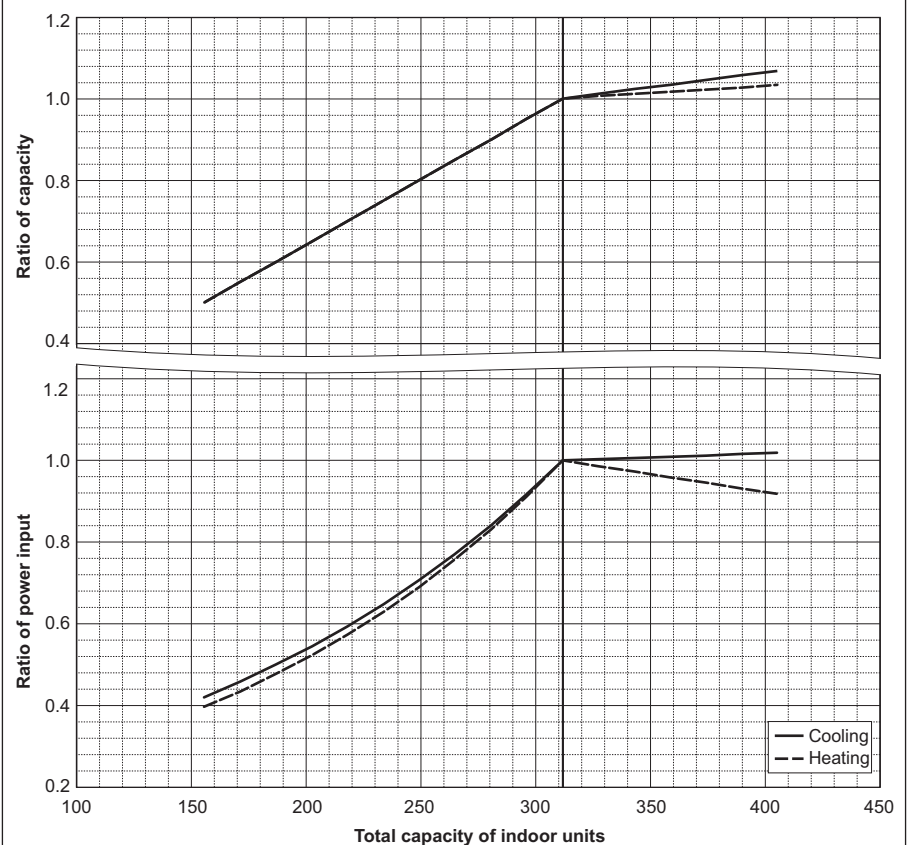


PQHY-		P336TSLMU/YSLMU	
		Non-Ducted	Ducted
Nominal cooling capacity	BTU/h	336,000	
	kW	98.5	
	Input kW	26.84	
Rated cooling capacity	BTU/h	320,000	
	kW	93.8	
	Input kW	24.76	25.85

PQHY-		P336TSLMU/YSLMU	
		Non-Ducted	Ducted
Nominal Heating capacity	BTU/h	378,000	
	kW	110.8	
	Input kW	20.77	
Rated Heating capacity	BTU/h	361,000	
	kW	105.8	
	Input kW	19.16	20.05

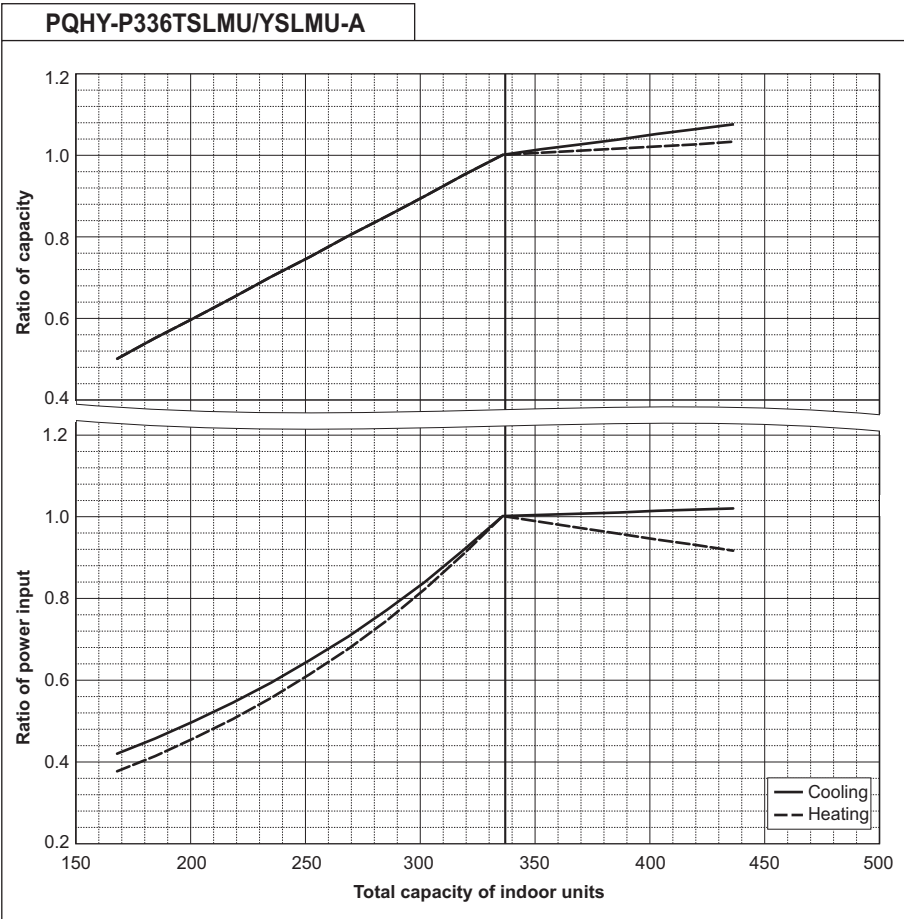

PQHY-		P360TSLMU/YSLMU	
		Non-Ducted	Ducted
Nominal cooling capacity	BTU/h	360,000	
	kW	105.5	
	Input kW	29.43	
Rated cooling capacity	BTU/h	342,000	
	kW	100.2	
	Input kW	27.17	27.41


PQHY-		P360TSLMU/YSLMU	
		Non-Ducted	Ducted
Nominal Heating capacity	BTU/h	405,000	
	kW	118.7	
	Input kW	22.85	
Rated Heating capacity	BTU/h	387,000	
	kW	113.4	
	Input kW	21.09	21.70

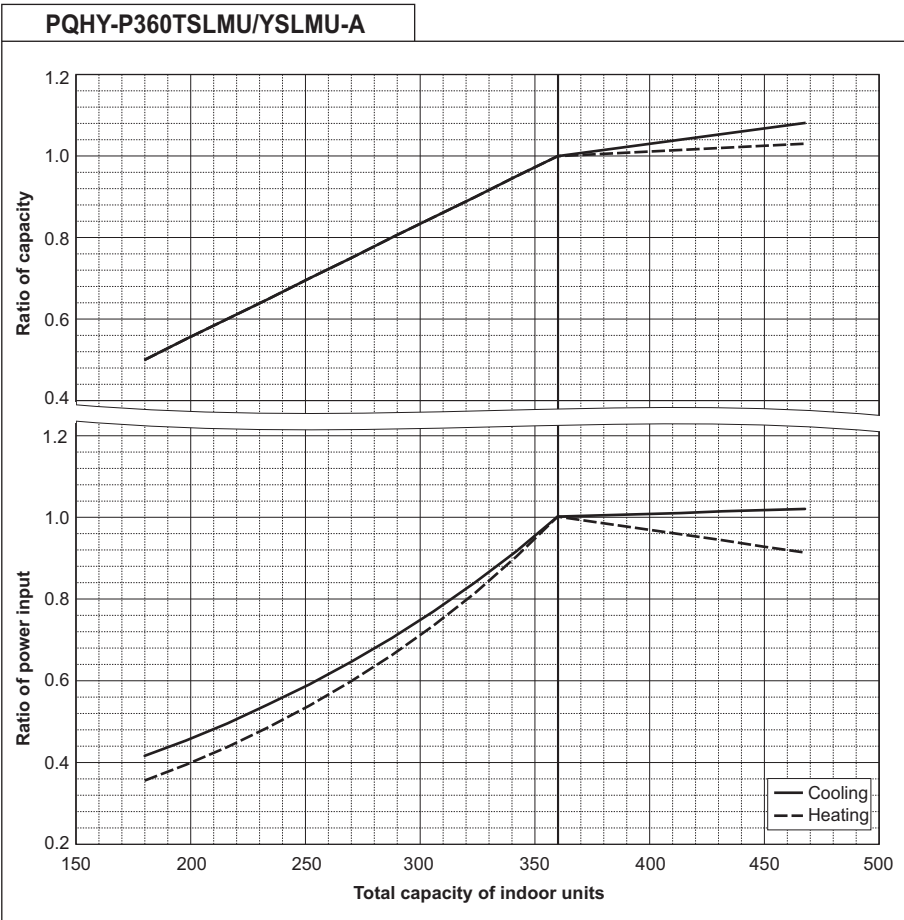


8-3. Correction by refrigerant piping length


CITY MULTI system can extend the piping flexibly within its limitation for the actual situation. However, a decrease of cooling/heating capacity could happen correspondently. Using following correction factor according to the equivalent length of the piping shown at 8-3-1 and 8-3-2, the capacity can be observed. 8-3-3 shows how to obtain the equivalent length of piping.

8-3-1. Cooling capacity correction

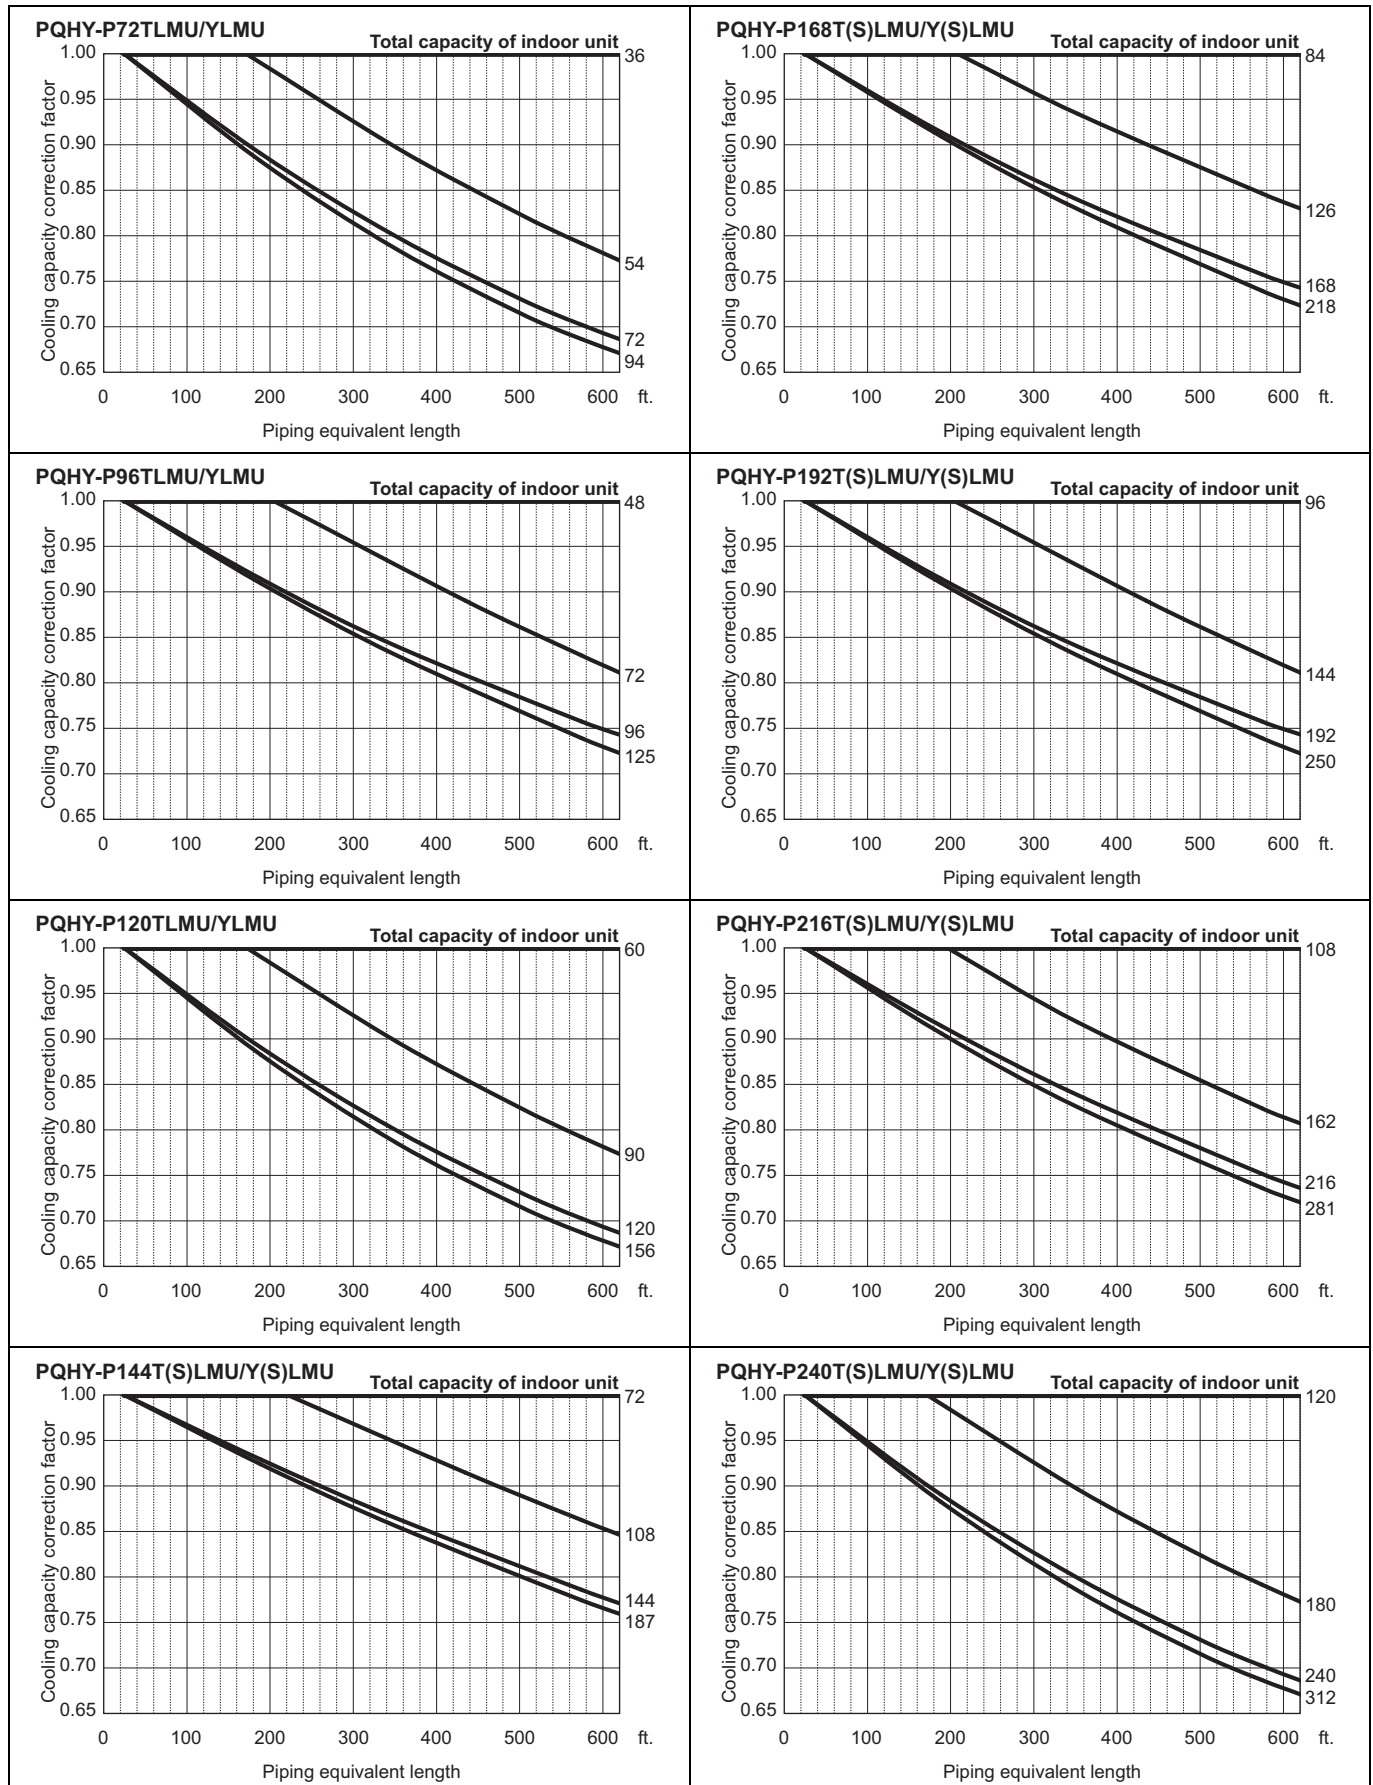

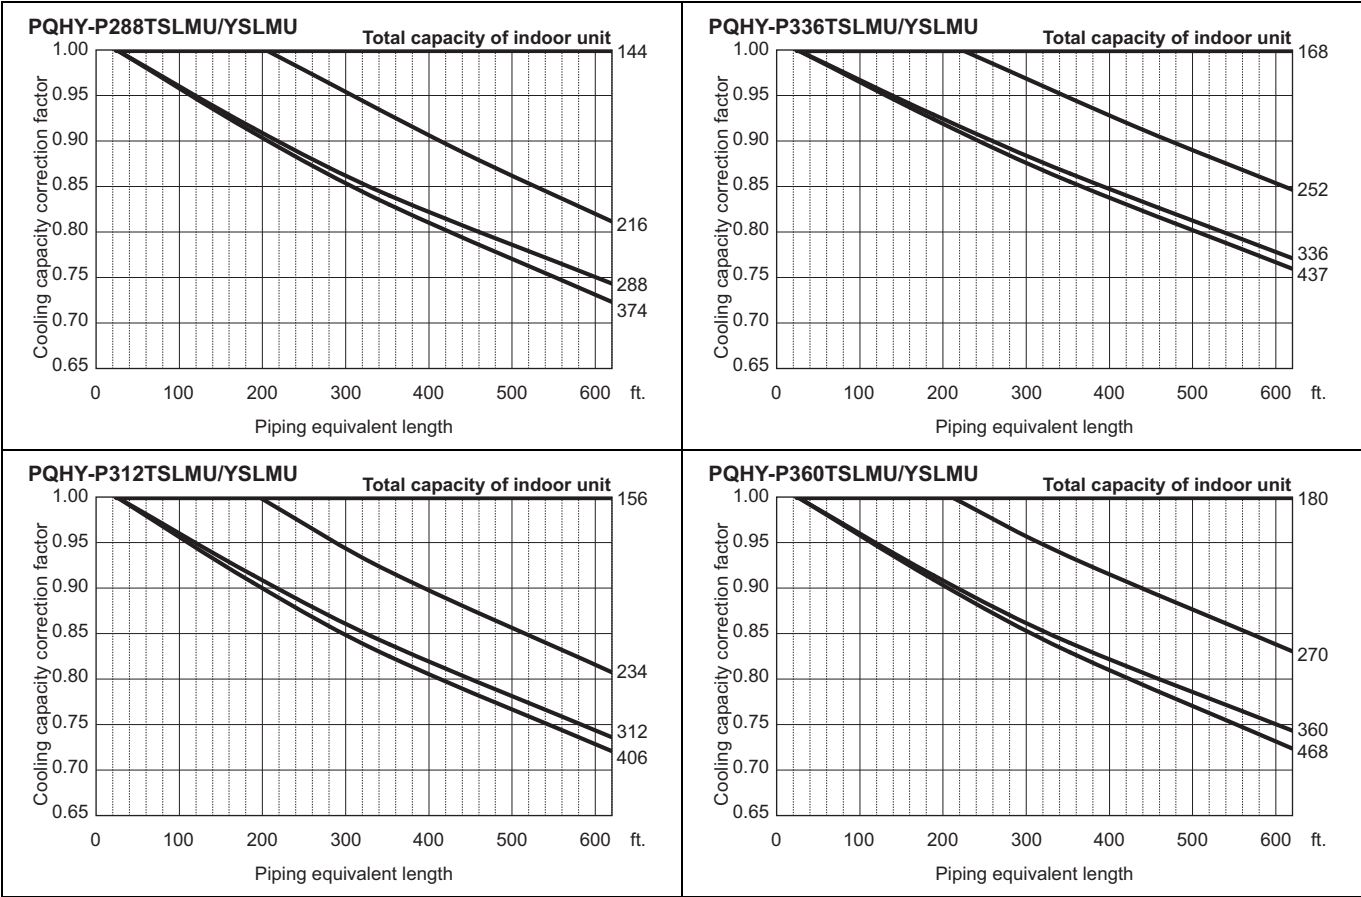

8-3-2. Heating capacity correction

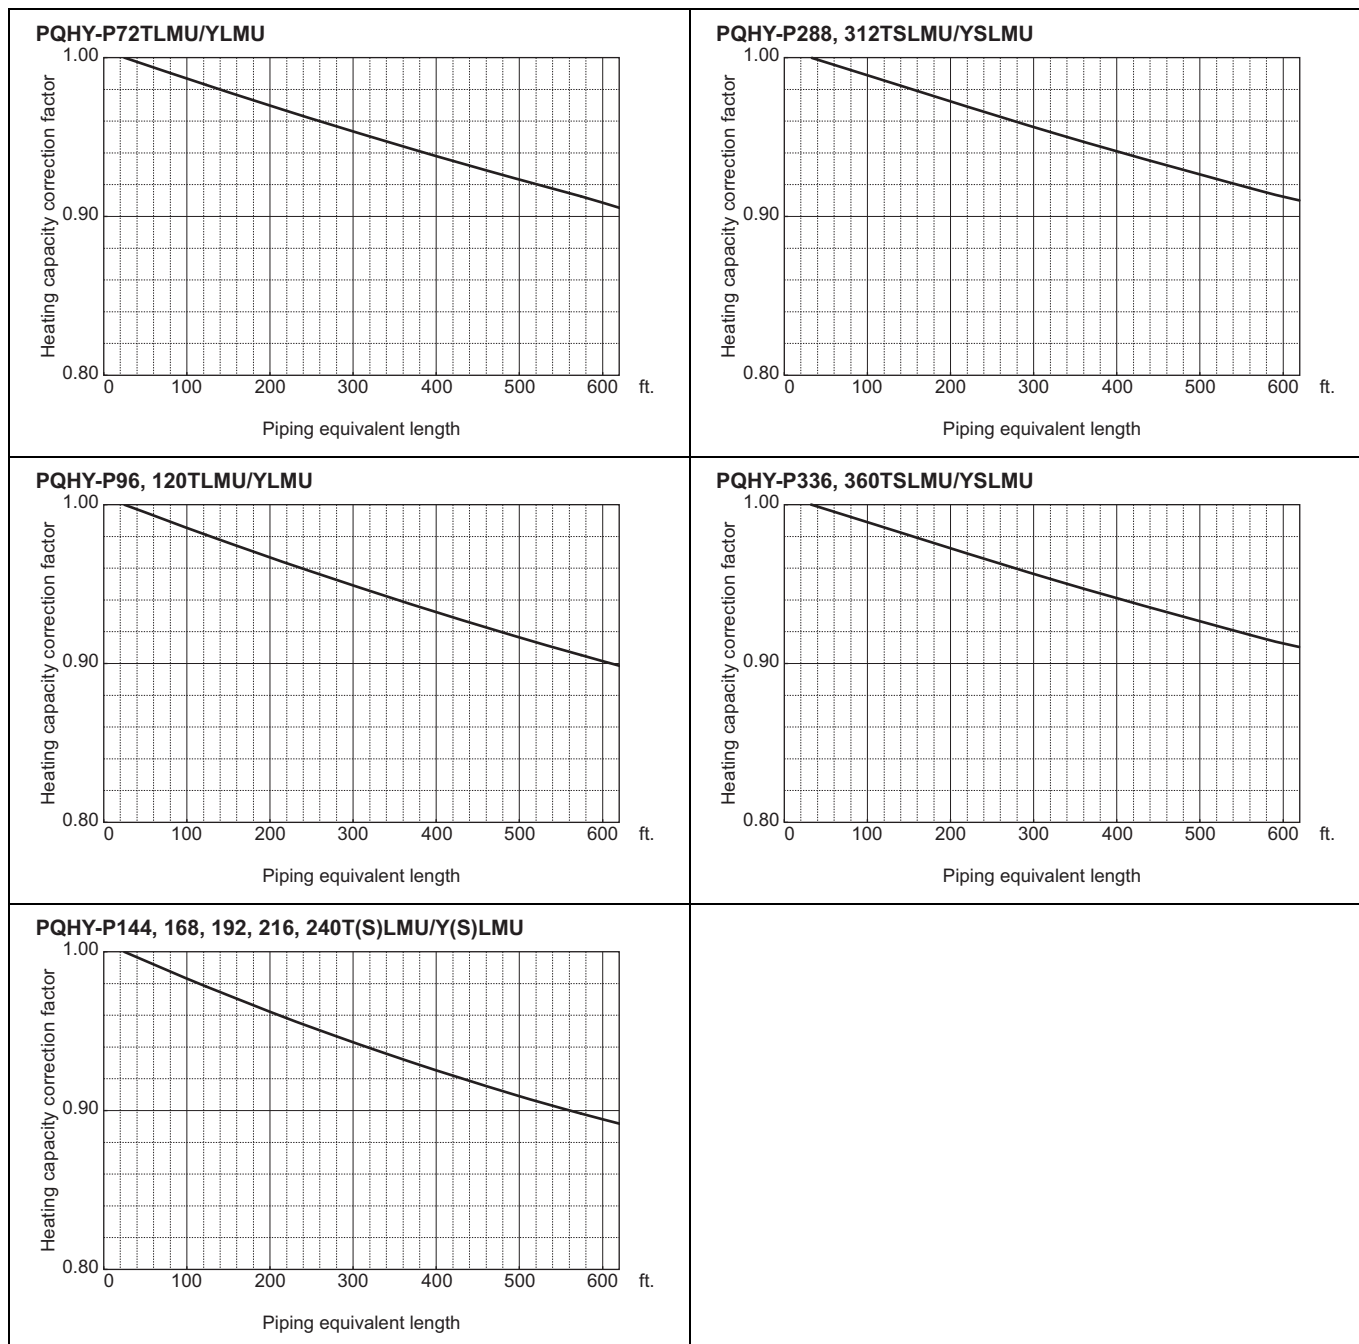

8-3-3. How to obtain the equivalent piping length

1. PQHY-P72TLMU/YLMU

Equivalent length = (Actual piping length to the farthest indoor unit) + (1.15 x number of bent on the piping) [ft.]

Equivalent length = (Actual piping length to the farthest indoor unit) + (0.35 x number of bent on the piping) [m]

2. PQHY-P96, 120TLMU/YLMU

Equivalent length = (Actual piping length to the farthest indoor unit) + (1.38 x number of bent on the piping) [ft.]

Equivalent length = (Actual piping length to the farthest indoor unit) + (0.42 x number of bent on the piping) [m]

3. PQHY-P144, 168, 192, 216, 240T(S)LMU/Y(S)LMU

Equivalent length = (Actual piping length to the farthest indoor unit) + (1.64 x number of bent on the piping) [ft.]

Equivalent length = (Actual piping length to the farthest indoor unit) + (0.50 x number of bent on the piping) [m]

4. PQHY-P288, 312TSLMU/YSLMU

Equivalent length = (Actual piping length to the farthest indoor unit) + (2.30 x number of bent on the piping) [ft.]

Equivalent length = (Actual piping length to the farthest indoor unit) + (0.70 x number of bent on the piping) [m]

5. PQHY-P336, 360TSLMU/YSLMU

Equivalent length = (Actual piping length to the farthest indoor unit) + (2.63 x number of bent on the piping) [ft.]

Equivalent length = (Actual piping length to the farthest indoor unit) + (0.80 x number of bent on the piping) [m]

9-1. Designing of water circuit system

1) Example of basic water circuit

The water circuit of the water heat source CITY MULTI connects the heat source unit with the cooling tower/auxiliary heat source/heat storage tank/circulation pump with a single system water piping as shown in the figure below. The selector valve automatically controls to circulate water toward the cooling tower in the cooling season, while toward the heat storage tank in the heating season. If the circulation water temperature is kept in a range of 10~45°C [50~113°F]* regardless of the building load, the water heat source CITY MULTI can be operated for either cooling or heating. Therefore in the summer when only cooling load exists, the temperature rise of circulation water will be suppressed by operating the cooling tower. While in the winter when heating load increases, the temperature of circulation water may be dropped below 10°C [50°F]. Under such situation, the circulation water will be heated with the auxiliary heat source if it drops below a certain temperature.


When the thermal balance between cooling and heating operation is in a correct proportion, the operation of the auxiliary heat source and cooling tower is not required.

In order to control the above thermal balance properly and use thermal energy effectively, utilizing of heat storage tanks, and night-time discounted electric power as a auxiliary heat source will be economical.

Meantime as this system uses plural sets of heat source unit equipped with water heat exchangers, water quality control is important. Therefore it is recommended to use closed type cooling towers as much as possible to prevent the circulation water from being contaminated.

When open type cooling towers are used, it is essential to provide proper maintenance control such as that to install water treatment system to prevent troubles caused by contaminated circulation water.

*10~45°C [50~113°F] : 50%~130% of indoor units can be connected

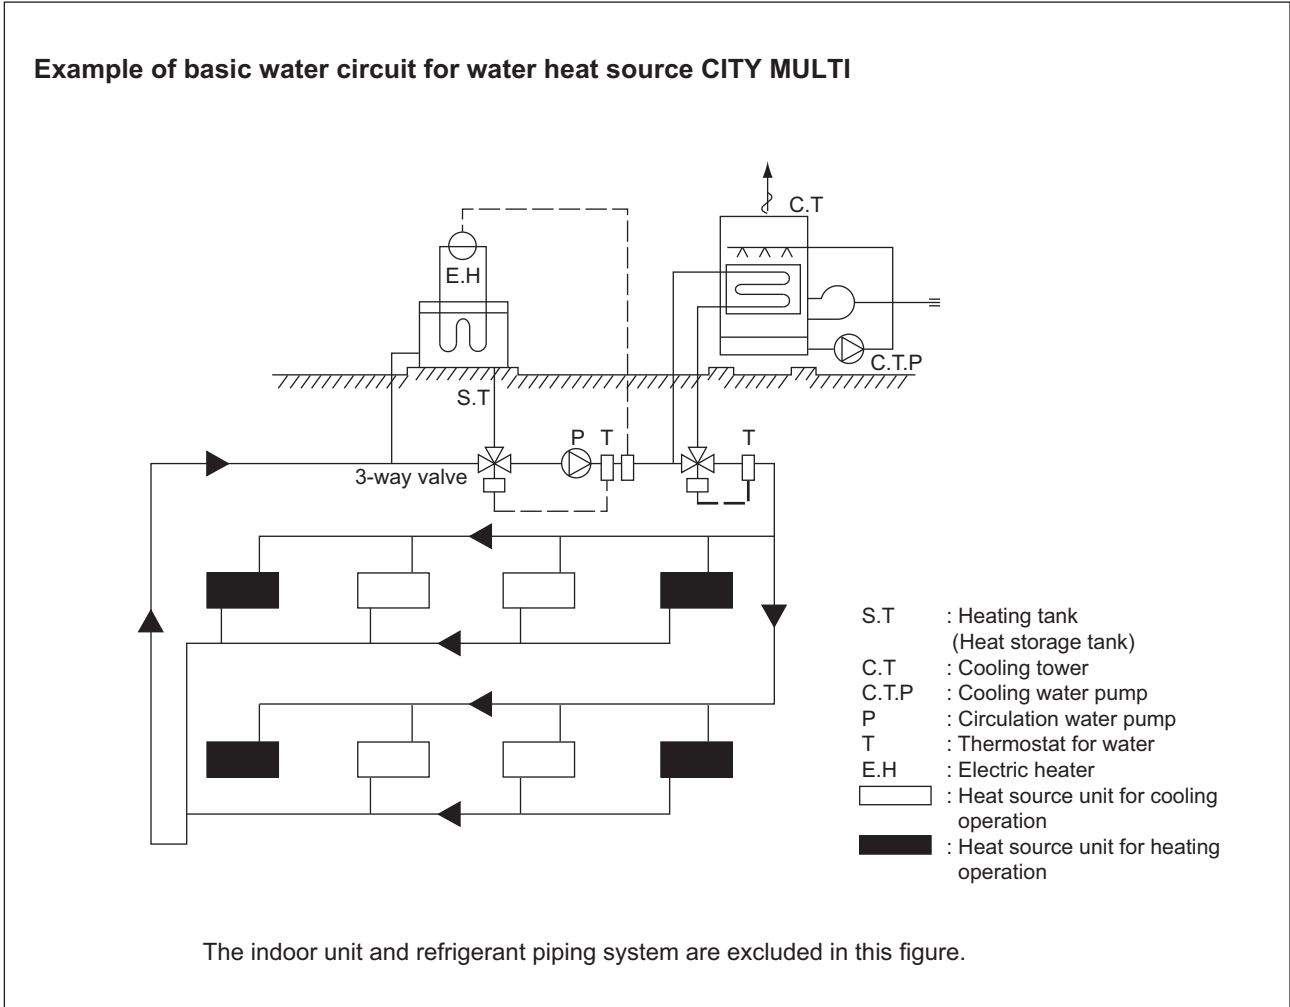

2) Cooling tower

a) Types of cooling tower


The cooling towers presently used include the open type cooling tower, open type cooling tower + heat exchanger, closed type cooling tower, and air-cooled type cooling tower. However, as the quality control of circulation water is essential when units are installed in decentralized state inside a building, the closed type cooling tower is generally employed in such case.

Although the circulation water will not be contaminated by atmospheric air, it is recommended to periodically blow water inside the system and replenish fresh water instead.

In a district where the coil may be frozen in the winter, it is necessary to apply antifreeze solution to the circulation water, or take freeze protection measures such as to automatically discharge water inside the cooling coil at the stopping of the pump.

When the open type cooling tower is used, be sure to install a water quality control device in addition to the freeze protection measures, as the water may be deteriorated by atmospheric contaminants entered into the cooling tower and dissolved into the circulation water.

Types of cooling towers

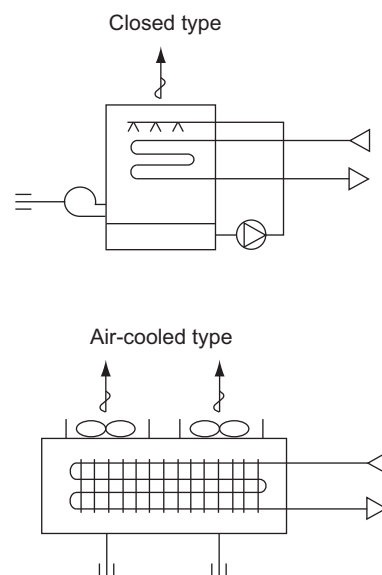

b) Calculation method of cooling tower capacity

All units of the water heat source CITY MULTI may possibly be in cooling operation temporarily (at pulling down) in the summer, however, it is not necessary to determine the capacity according to the total cooling capacity of all CITY MULTI units as this system has a wide operating water temperature range (10~45°C) [50~113°F].

It is determined in accordance with the value obtained by adding the maximum cooling load of an actual building, the input heat equivalent value of all CITY MULTI units, and the cooling load of the circulating pumps. Please check for the values of the cooling water volume and circulation water volume.

$$\text{Cooling tower capacity} = \frac{Q_c + 860 \times (\Sigma Q_w + P_w)}{3,900} \quad (\text{Refrigeration ton})$$

Q_c : Maximum cooling load under actual state (kcal/h)
 Q_w : Total input of water heat source CITY MULTI at simultaneous operation under maximum state (kW)
 P_w : Shaft power of circulation pumps (kW)

$$\text{Cooling tower capacity} = \frac{Q_c + 3,412 \times (\Sigma Q_w + P_w)}{15,500} \quad (\text{Refrigeration ton})$$

Q_c : Maximum cooling load under actual state (BTU/h)
 Q_w : Total input of water heat source CITY MULTI at simultaneous operation under maximum state (kW)
 P_w : Shaft power of circulation pumps (kW)

* 1 Refrigerant ton of cooling tower capacity $\approx$ US refrigerant ton $\times (1 + 0.3)$
 $= 3,900 \text{ kcal/h} = 15,500 \text{ BTU/h}$

3) Auxiliary heat source and heat storage tank

When the heating load is larger than the cooling load, the circulation water temperature lowers in accordance with the heat balance of the system. It should be heated by the auxiliary heat source in order to keep the inlet water temperature within the operating range (10°C [50°F] or more) of the water heat source CITY MULTI.

Further in order to operate the water heat source CITY MULTI effectively, it is recommended to utilize the heat storage tank to cover the warming up load in the morning and the insufficient heat amount.

Effective heat utilization can be expected to cover insufficient heat at the warming up in the next morning or peak load time by storing heat by installing a heat storage tank or operating a low load auxiliary heat source at the stopping of the water heat source CITY MULTI. As it can also be possible to reduce the running cost through the heat storage by using the discounted night-time electric power, using both auxiliary heat source and heat storage tank together is recommended. The effective temperature difference of an ordinary heat storage tank shows about 5°C [41°F] even with the storing temperature at 45°C [113°F].

However with the water heat source CITY MULTI, it can be utilized as heating heat source up to 15°C [59°F] with an effective temperature of a high 30°C [54°F] approximately, thus the capacity of the heat storage tank can be minimized.

a) Auxiliary heat source

The following can be used as the auxiliary heat source.

- Boiler (Heavy oil, kerosine, gas, electricity)
- Electric heat (Insertion of electric heater into heat storage tank)
- Outdoor air (Air-heat source heat pump chiller)
- Warm discharge water (Exhaust water heat from machines inside building and hot water supply)
- Utilization of night-time lighting
- Solar heat

Please note that the auxiliary heat source should be selected after studying your operating environment and economical feasibility.

Determining the auxiliary heat source capacity

For the CITY MULTI water heat source system, a heat storage tank is recommended to use. When employment of the heat storage tank is difficult, the warming up operation should be arranged to cover the starting up heating load. Since the holding water inside the piping circuit owns heat capacity and the warming up operation can be assumed for about one hour except that in a cold region, the heat storage tank capacity is required to be that at the maximum daily heating load including the warming up load at the next morning of the holiday. However the auxiliary heat source capacity should be determined by the daily heating load including warming up load on the week day. For the load at the next morning of the holiday, heat storage is required by operating the auxiliary heat source even outside of the ordinary working hour.

When heat storage tank is not used

$$QH = HCT \left(1 - \frac{1}{COP_h} \right) - 1000 \times V_w \times \Delta T - 860 \times P_w$$

QH	: Auxiliary heat source capacity	(kcal/h)
HCT	: Total heating capacity of each water heat source CITY MULTI	(kcal/h)
COP _H	: COP of water heat source CITY MULTI at heating	
V _w	: Holding water volume inside piping	(m ³)
ΔT	: Allowable water temperature drop = T _{WH} - T _{WL}	(°C)
T _{WH}	: Heat source water temperature at high temperature side	(°C)
T _{WL}	: Heat source water temperature at low temperature side	(°C)
P _w	: Heat source water pump shaft power	(kW)

$$QH = HCT \left(1 - \frac{1}{COP_h} \right) - 8.343 \times V_w \times \Delta T - 3412 \times P_w$$

QH	: Auxiliary heat source capacity	(BTU/h)
HCT	: Total heating capacity of each water heat source CITY MULTI	(BTU/h)
COP _H	: COP of water heat source CITY MULTI at heating	
V _w	: Holding water volume inside piping	(G)
ΔT	: Allowable water temperature drop = T _{WH} - T _{WL}	(°F)
T _{WH}	: Heat source water temperature at high temperature side	(°F)
T _{WL}	: Heat source water temperature at low temperature side	(°F)
P _w	: Heat source water pump shaft power	(kW)

When heat storage tank is not used

$$QH = \frac{HQ_{1T} \cdot \left(1 - \frac{1}{COP_h}\right) - 860 \times P_w \times T_2}{T_1} \times K \quad (\text{kcal})$$

QH_{1T}	: Total of heating load on weekday including warming up	(kcal/day)
T_1	: Operating hour of auxiliary heat source	(h)
T_2	: Operating hour of heat source water pump	(h)
K	: Allowance factor (Heat storage tank, piping loss, etc.)	1.05~1.10

HQ_{1T} is calculated from the result of steady state load calculation similarly by using the equation below.

$$HQ_{1T} = 1.15 \times (\Sigma Q'a + \Sigma Q'b + \Sigma Q'c + \Sigma Q'd + \Sigma Q'f) T_2 - \psi (\Sigma Qe_1 + \Sigma Qe_2 + \Sigma Qe_3) (T_2 - 1)$$

$Q'a$	: Thermal load from external wall/roof in each zone	(kcal/h)
$Q'b$	: Thermal load from glass window in each zone	(kcal/h)
$Q'c$	: Thermal load from partition/ceiling/floor in each zone	(kcal/h)
$Q'd$	: Thermal load by infiltration in each zone	(kcal/h)
$Q'f$	: Fresh outdoor air load in each zone	(kcal/h)
$Q'e_1$	: Thermal load from human body in each zone	(kcal/h)
$Q'e_2$	: Thermal load from lighting fixture in each zone	(kcal/h)
$Q'e_3$	: Thermal load from equipment in each zone	(kcal/h)
ψ	: Radiation load rate	0.6~0.8
T_2	: Air conditioning hour	

$$QH = \frac{HQ_{1T} \cdot \left(1 - \frac{1}{COP_h}\right) - 3,412 \times P_w \times T_2}{T_1} \times K \quad (\text{BTU})$$

QH_{1T}	: Total of heating load on weekday including warming up	(BTU/day)
T_1	: Operating hour of auxiliary heat source	(h)
T_2	: Operating hour of heat source water pump	(h)
K	: Allowance factor (Heat storage tank, piping loss, etc.)	1.05~1.10

HQ_{1T} is calculated from the result of steady state load calculation similarly by using the equation below.

$$HQ_{1T} = 1.15 \times (\Sigma Q'a + \Sigma Q'b + \Sigma Q'c + \Sigma Q'd + \Sigma Q'f) T_2 - \psi (\Sigma Qe_1 + \Sigma Qe_2 + \Sigma Qe_3) (T_2 - 1)$$

$Q'a$	: Thermal load from external wall/roof in each zone	(BTU/h)
$Q'b$	: Thermal load from glass window in each zone	(BTU/h)
$Q'c$	: Thermal load from partition/ceiling/floor in each zone	(BTU/h)
$Q'd$	: Thermal load by infiltration in each zone	(BTU/h)
$Q'f$	: Fresh outdoor air load in each zone	(BTU/h)
$Q'e_1$	: Thermal load from human body in each zone	(BTU/h)
$Q'e_2$	: Thermal load from lighting fixture in each zone	(BTU/h)
$Q'e_3$	: Thermal load from equipment in each zone	(BTU/h)
ψ	: Radiation load rate	0.6~0.8
T_2	: Air conditioning hour	

b) Heat storage tank

Heat storage tank can be classified by types into the open type heat storage tank exposed to atmosphere, and the closed type heat storage tank with structure separated from atmosphere. Although the size of the tank and its installation place should be taken into account, the closed type tank is being usually employed by considering corrosion problems.

The capacity of heat storage tanks is determined in accordance with the daily maximum heating load that includes warming up load to be applied for the day after the holiday.

When auxiliary heat source is operated during operation and even after stopping of water heat source CITY MULTI unit

$$V = \frac{HQ_{2T} \left(1 - \frac{1}{COP_h} \right) - 860 \times P_w \times T_2 - Q_H \times T_2}{\Delta T \times 1,000 \times \eta V} \quad (\text{ton})$$

HQ_{2T} : Maximum heating load including load required for the day after the holiday (kcal/day)

ΔT : Temperature difference utilized by heat storage tank (°C)

ηV : Heat storage tank efficiency

$$HQ_{2T} : 1.3 \times (\Sigma Q'a + \Sigma Q'c + \Sigma Q'd + \Sigma Q'f) T_2 - \psi (\Sigma Qe2 + \Sigma Qe3) (T_2 - 1)$$

$$V = \frac{HQ_{2T} \left(1 - \frac{1}{COP_h} \right) - 3,412 \times P_w \times T_2 - Q_H \times T_2}{\Delta T \times \eta V} \quad (\text{lbs})$$

HQ_{2T} : Maximum heating load including load required for the day after the holiday (BTU/day)

ΔT : Temperature difference utilized by heat storage tank (°F)

ηV : Heat storage tank efficiency

$$HQ_{2T} : 1.3 \times (\Sigma Q'a + \Sigma Q'c + \Sigma Q'd + \Sigma Q'f) T_2 - \psi (\Sigma Qe2 + \Sigma Qe3) (T_2 - 1)$$

When auxiliary heat source is operated after stopping of water heat source CITY MULTI unit

$$V = \frac{HQ_{2T} \left(1 - \frac{1}{COP_h} \right) - 860 \times P_w \times T_2}{\Delta T \times 1,000 \times \eta V} \quad (\text{ton})$$

HQ_{2T} : Maximum heating load including load required for the day after the holiday (kcal/day)

ΔT : Temperature difference utilized by heat storage tank (°C)

ηV : Heat storage tank efficiency

$$HQ_{2T} : 1.3 \times (\Sigma Q'a + \Sigma Q'c + \Sigma Q'd + \Sigma Q'f) T_2 - \psi (\Sigma Qe2 + \Sigma Qe3) (T_2 - 1)$$

$$V = \frac{HQ_{2T} \left(1 - \frac{1}{COP_h} \right) - 3,412 \times P_w \times T_2}{\Delta T \times \eta V} \quad (\text{lbs})$$

HQ_{2T} : Maximum heating load including load required for the day after the holiday (BTU/day)

ΔT : Temperature difference utilized by heat storage tank (°F)

ηV : Heat storage tank efficiency

$$HQ_{2T} : 1.3 \times (\Sigma Q'a + \Sigma Q'c + \Sigma Q'd + \Sigma Q'f) T_2 - \psi (\Sigma Qe2 + \Sigma Qe3) (T_2 - 1)$$

4) Piping system


The following items should be kept in your mind in planning / designing water circuits.

- All units should be constituted in a single circuit in principle.
- When plural numbers of the water heat source CITY MULTI unit are installed, the rated circulating water flow rate should be kept by making the piping resistance to each unit almost same value. As an example, the reverse return system as shown below may be employed.
- Depending on the structure of a building, the water circuit may be prefabricated by making the layout uniform.
- When a closed type piping circuit is constructed, install an expansion tank usable commonly for a make-up water tank to absorb the expansion/contraction of water caused by temperature fluctuation.
- If the operating temperature range of circulation water stays within the temperature near the normal temperature (summer :29.4°C [85°F], winter :21.1°C [70°F]), thermal insulation or anti-sweating work is not required for the piping inside buildings.

In case of the conditions below, however, thermal insulation is required.

- When well water is used for heat source water.
- When piped to outdoor or a place where freezing may be caused.
- When vapor condensation may be generated on piping due to an increase in dry bulb temperature caused by the entry of fresh outdoor air.

System example of water circuit

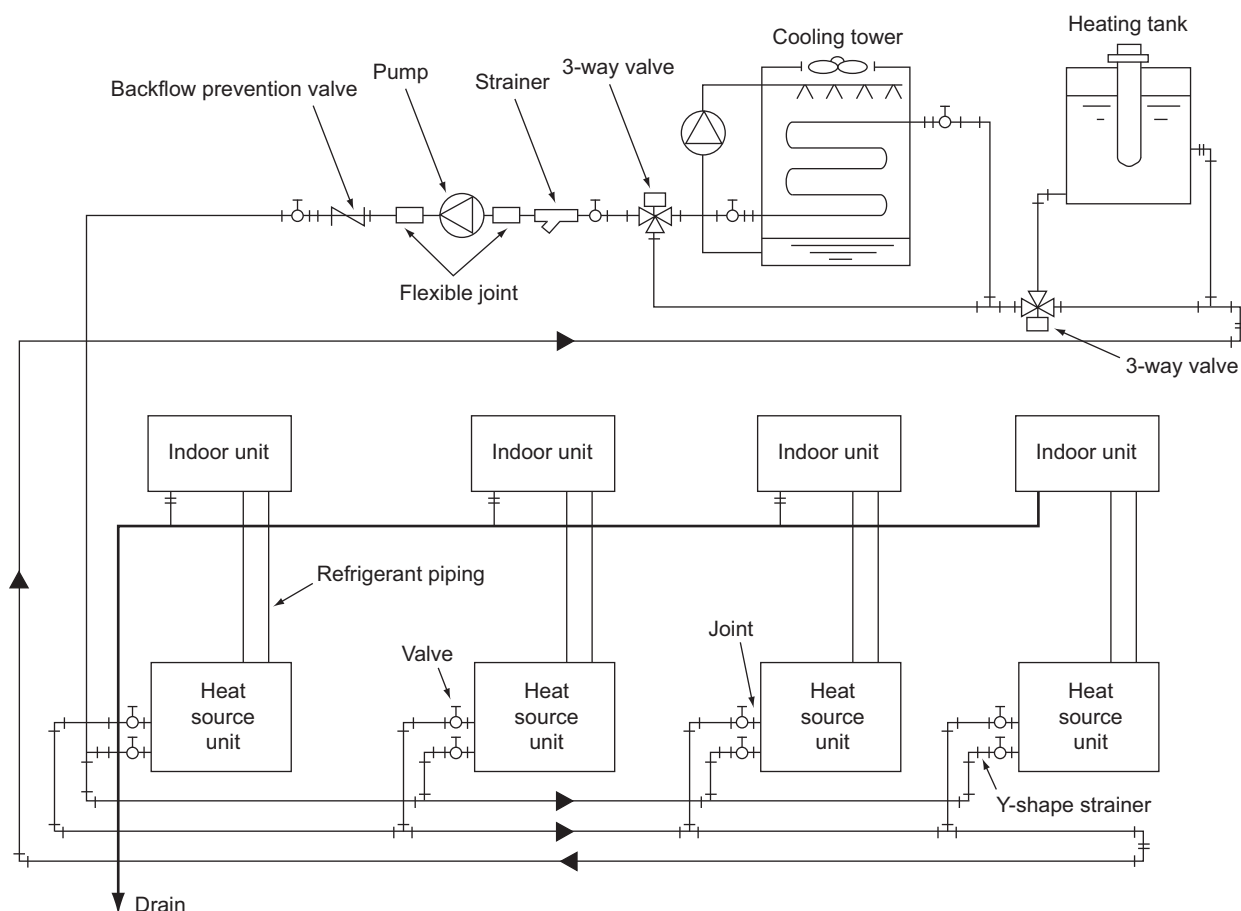


5) Practical System Examples and Circulation Water Control

Since the water heat source CITY MULTI is of water heat source system, versatile systems can be constituted by combining it with various heat sources.

The practical system examples are given below.

Either cooling or heating operation can be performed if the circulation water temperature of the water heat source CITY MULTI stays within a range of 10~45°C [50~113°F]. However, the circulation water temperature near 32°C [90°F] for cooling and 20°C [68°F] for heating is recommended by taking the life, power consumption and capacity of the air conditioning units into consideration. The detail of the control is also shown below.

Example-1 Combination of closed type cooling tower and hot water heat storage tank (using underground hollow slab)

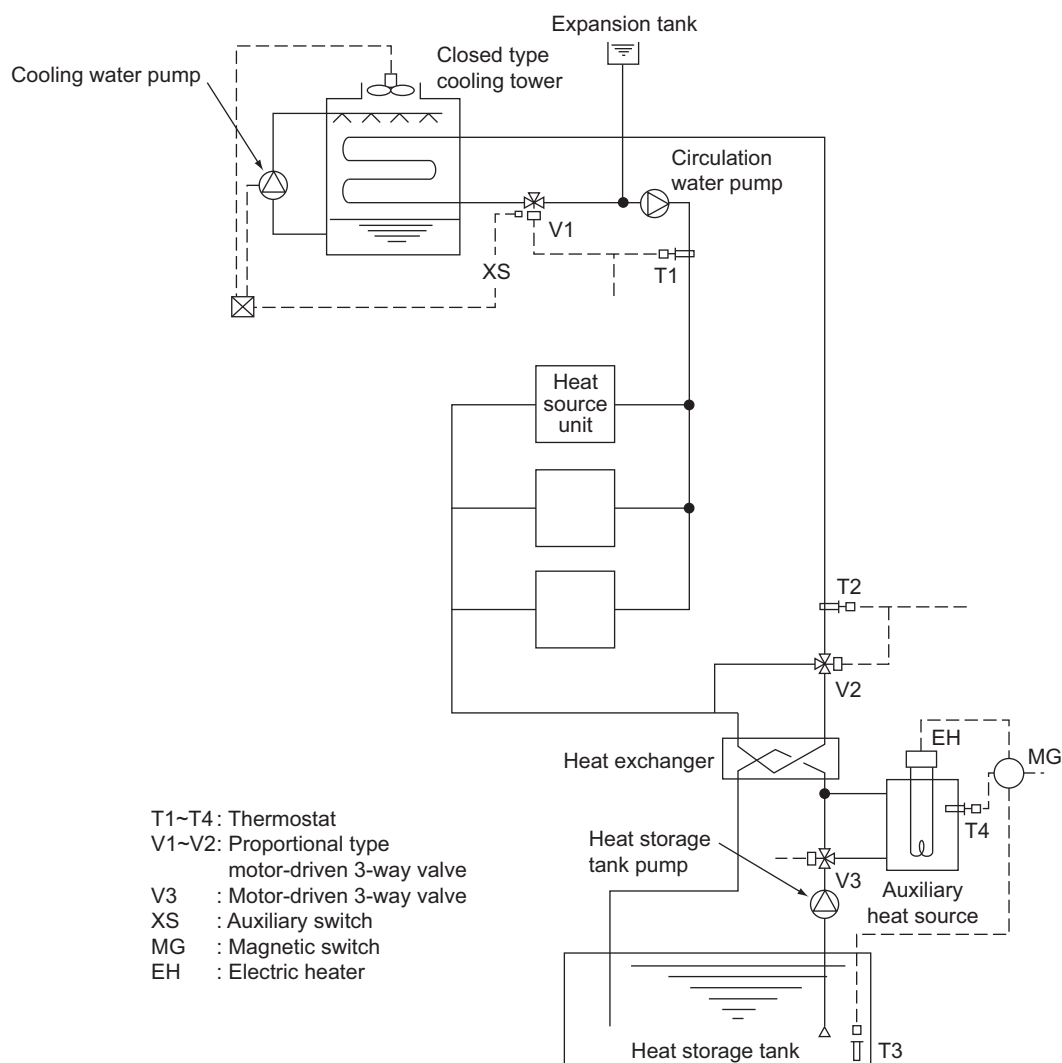

By detecting the circulation water temperature of the water heat source CITY MULTI system with T1 (around 32°C [90°F]) and T2 (around 20°C [68°F]), the temperature will be controlled by opening/closing V1 in the summer and V2 in the winter.


In the summer, as the circulation water temperature rises exceeding the set temperature of T1, the bypass port of V1 will open to lower the circulation water temperature. While in the winter, as the circulation water temperature drops, V2 will open following the command of T2 to rise the circulation water temperature.

The water inside the heat storage tank will be heated by the auxiliary heat source by V3 being opened with timer operation in the night-time. The electric heater of the auxiliary heat source will be controlled by T3 and the timer.

The start/stop control of the fan and pump of the closed type cooling tower is applied with the step control of the fan and pump following the command of the auxiliary switch XS of V1, that operates only the fan at the light load while the fan and pump at the maximum load thus controlling water temperature and saving motor power.

Example-2 Combination of closed type cooling tower and hot water heat storage tank

T1 : Proportional type, insertion system thermostat
 T2 : Proportional type, insertion system thermostat
 T3 : Proportional type, insertion system thermostat
 V1 : Proportional type, motor-driven 3-way valve
 V2 : Proportional type, motor-driven 3-way valve
 XS : Auxiliary switch (Duplex switch type)
 SC : Step controller
 R : Relay
 MG : Magnetic

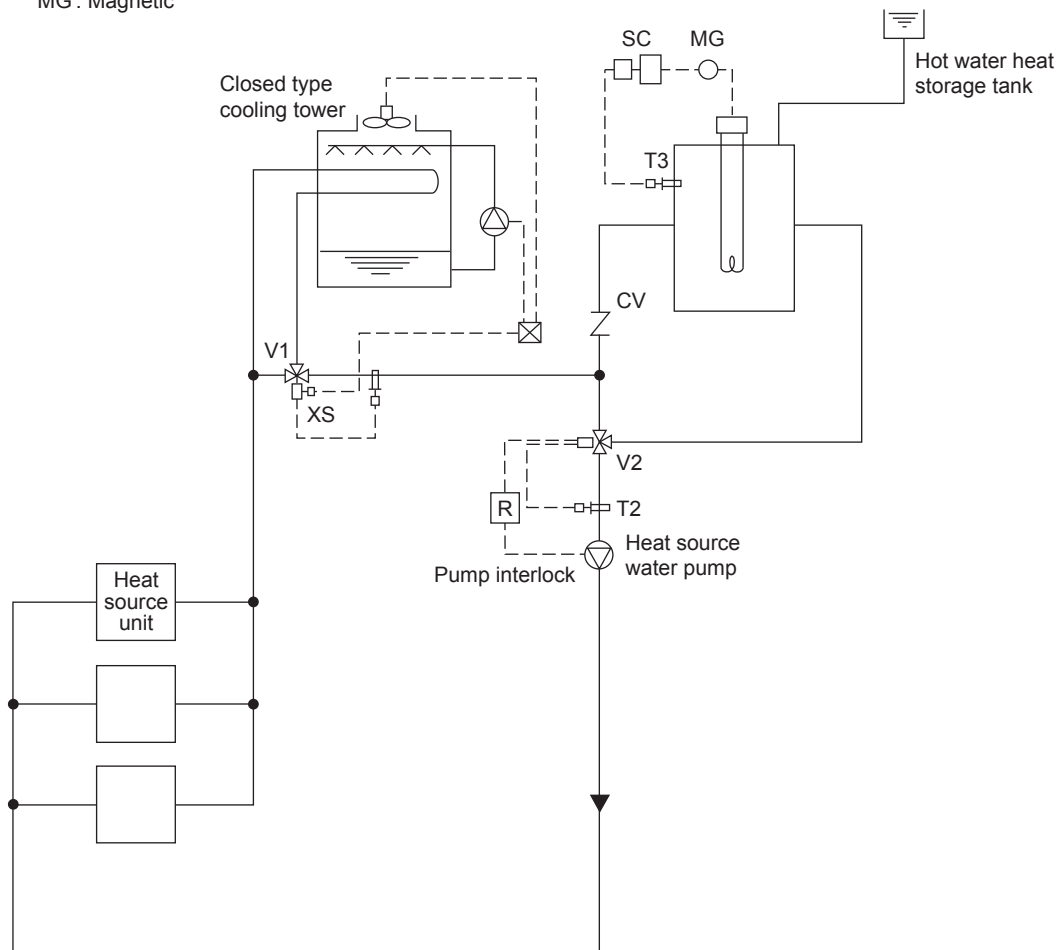

In the summer, as the circulation water temperature rises exceeding the set temperature of T1, the bypass port of V1 will open to lower the circulation water temperature. In the winter, if the circulation water temperature stays below 25°C [77°F], V2 will open/close by the command of T2 to keep the circulation water temperature constant.


The temperature of the hot water inside the heat storage tank will be controlled through the step control of the electric heater by step controller operation following the command of T3.

During the stopping of the heat source water pump, the bypass port of V2 will be closed fully by interlocking thus preventing the high temperature water from entering into the system at the starting of the pump.

The start/stop control of the fan and pump of the closed type cooling tower is applied with the step control of the fan and pump following the command of the auxiliary switch XS of V1, that operates only the fan at the light load while the fan and pump at the maximum load thus controlling water temperature and saving motor power.

Example-3 Combination of closed type cooling tower and boiler


- T1 : Proportional type, insertion system thermostat
 T2 : Proportional type, insertion system thermostat
 T3 : Proportional type, insertion system thermostat
 V1 : Proportional type, motor-driven 3-way valve
 S : Selector switch
 R : Relay
 XS : Auxiliary switch (Duplex switch type)

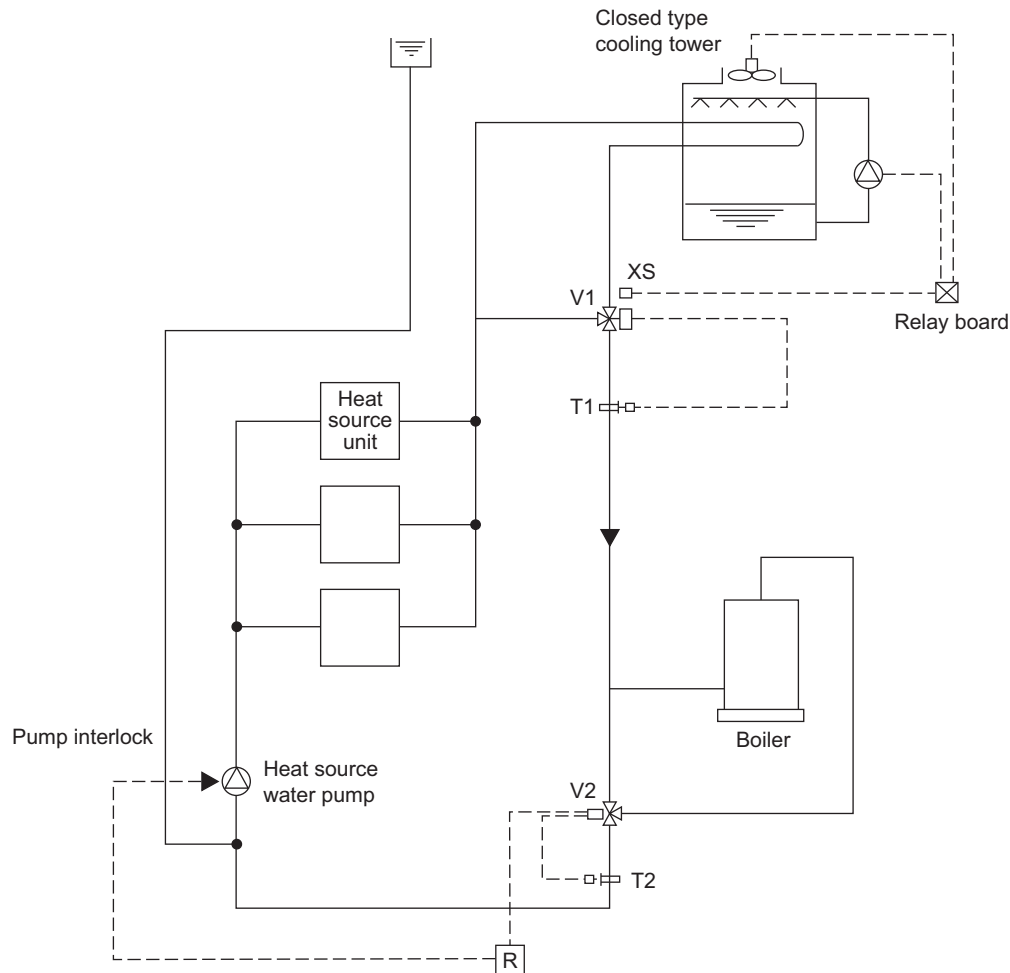

In the summer, as the circulation water temperature rises exceeding the set temperature of T1, the bypass port of V1 will close to lower the circulation water temperature. In the winter, if the circulation water temperature drops below 25°C [77°F], V2 will conduct water temperature control to keep the circulation water temperature constant. During the stopping of the heat source water pump, the bypass port of V2 will be closed fully by interlocking. The start/stop control of the fan and pump of the closed type cooling tower is applied with the step control following the command of the auxiliary switch XS of V1, thus controlling water temperature and saving motor power.


Example-4 Combination of closed type cooling tower and heat exchanger (of other heat source)

- T1 : Proportional type, insertion system thermostat
 T2 : Proportional type, insertion system thermostat
 V1 : Proportional type, motor-driven 3-way valve
 V2 : Proportional type, motor-driven 3-way valve
 S : Selector switch
 R : Relay
 XS : Auxiliary switch (Duplex switch type)

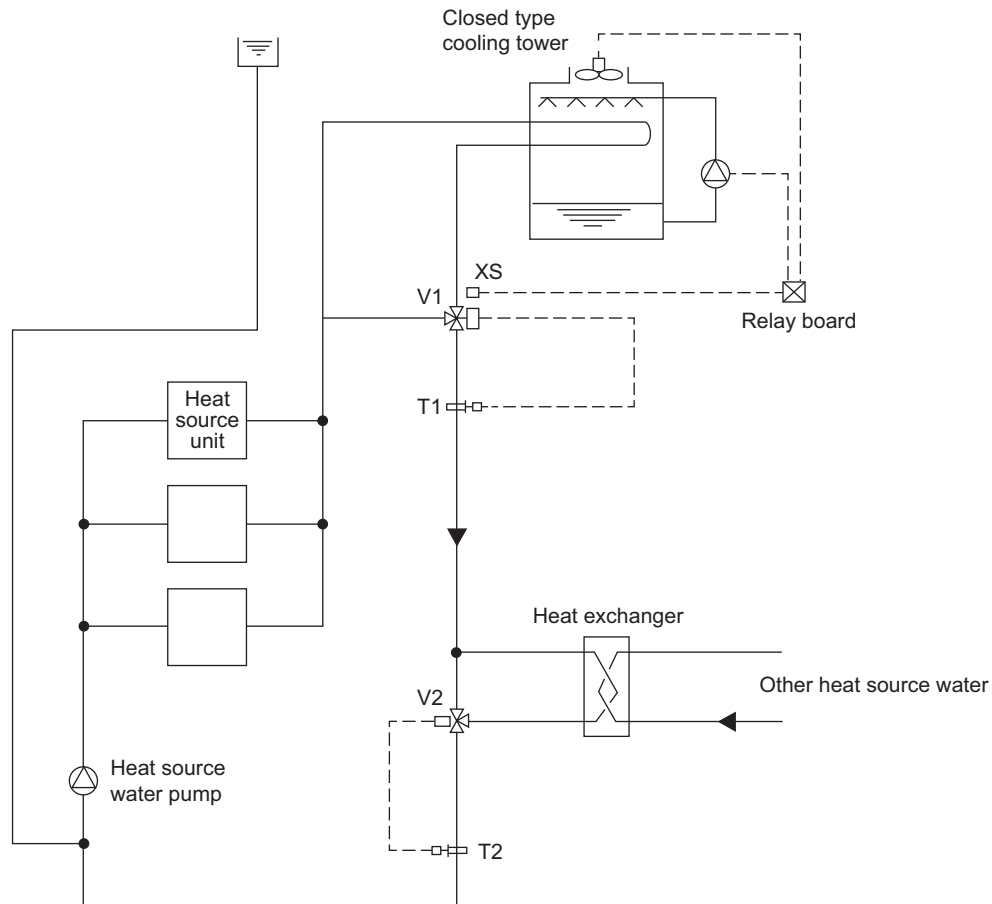


In the summer, as the circulation water temperature rises exceeding the set temperature of T1, the bypass port of V1 will close to lower the circulation water temperature. In the winter, if the circulation water temperature drops below 26°C [79°F], V2 will conduct water temperature control to keep the circulation water temperature constant. During the stopping of the heat source water pump, the bypass port of V2 will be closed fully by interlocking. The start/stop control of the fan and pump of the closed type cooling tower is applied with the step control following the command of the auxiliary switch XS of V1, thus controlling water temperature and saving motor power.

6) Pump interlock circuit

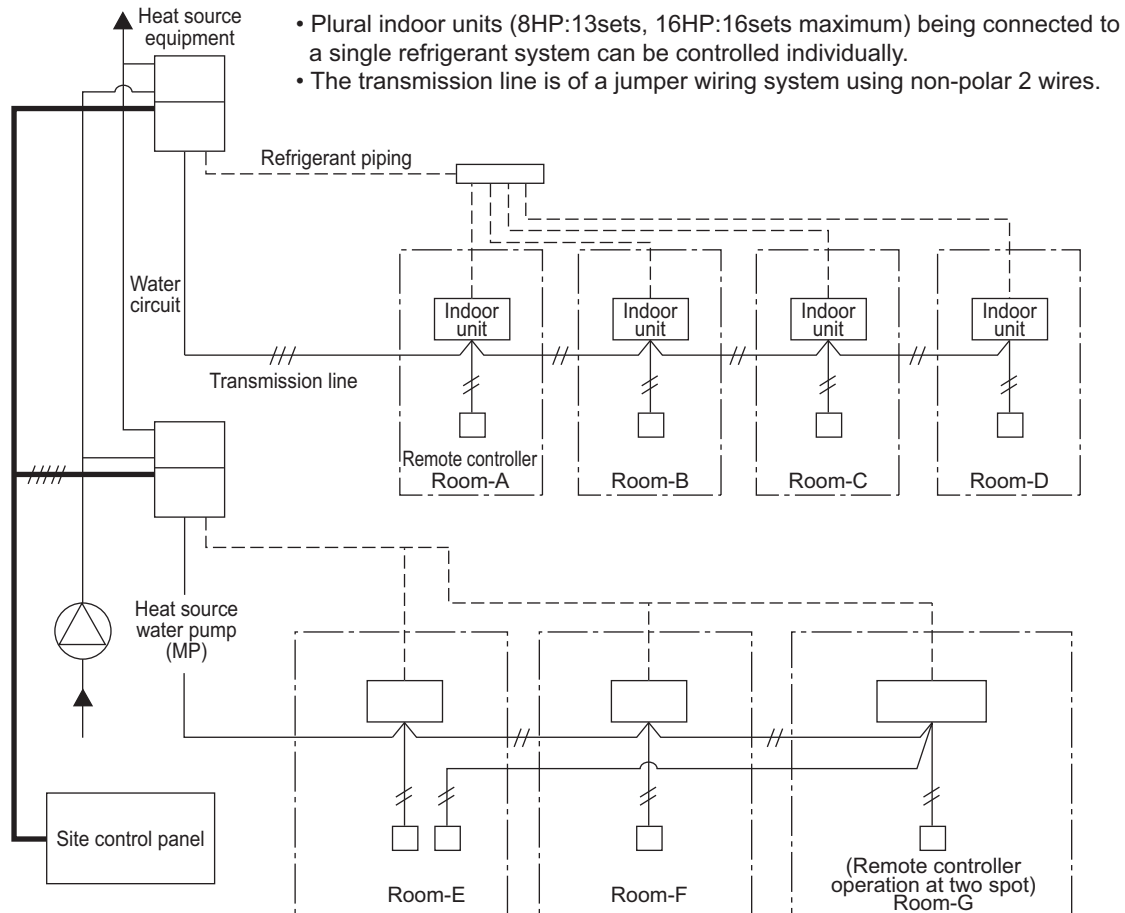

Wiring diagram

This circuit uses the "Terminal block for pump interlock (TB8)" inside the electrical parts box of the heat source equipment. This circuit is for interlocking the heat source equipment operation and the heat source water pump.

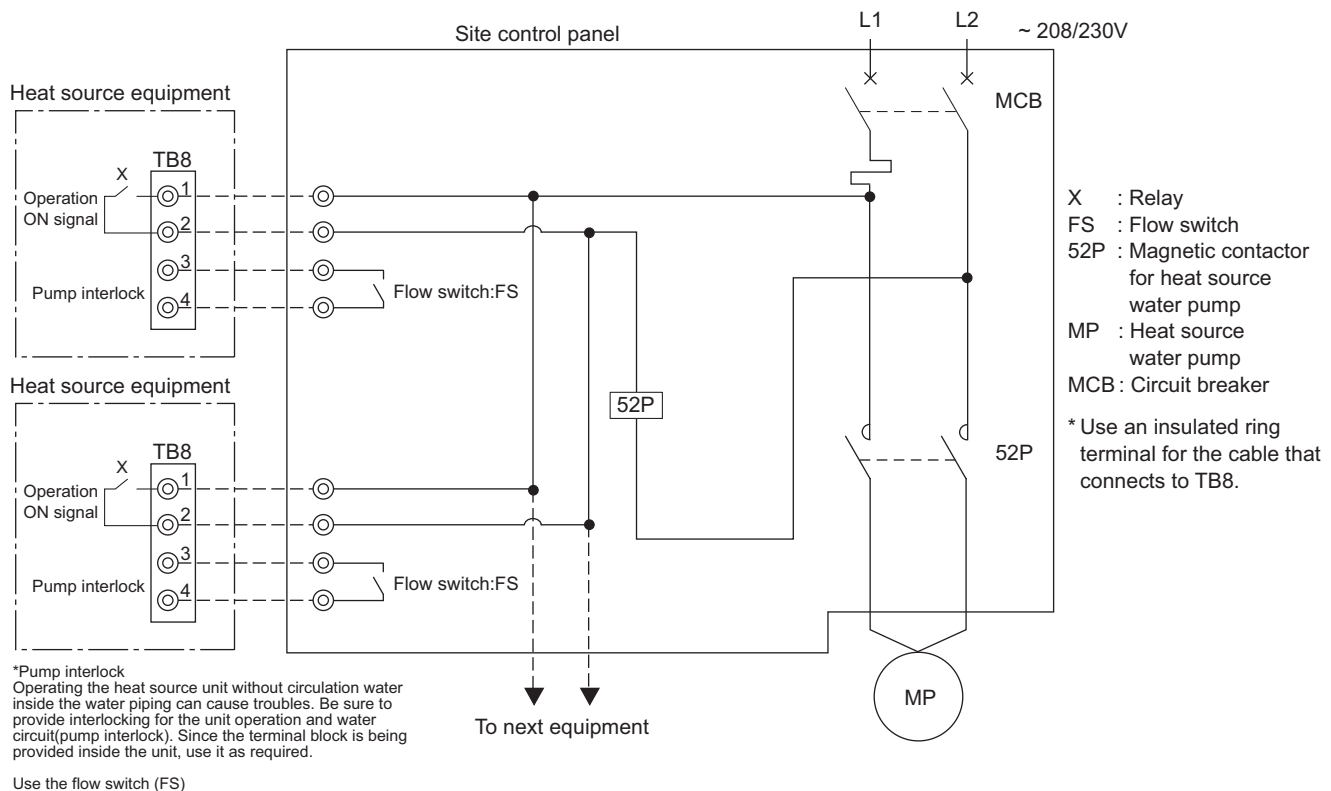


Operation ON signal

Terminal No.	TB8-1, 2																																							
Output	Relay contacts output					Rated voltage: 3~: 208/230V Rated load: 1 A																																		
Operation	- When setting No.917 for Dip switch 4 (Dip switch 6-10 is ON) is OFF. The relay closes during compressor operation. <table><tr><td colspan="10">SW4 0: OFF, 1: ON</td></tr><tr><td>1</td><td>2</td><td>3</td><td>4</td><td>5</td><td>6</td><td>7</td><td>8</td><td>9</td><td>10</td></tr><tr><td>1</td><td>0</td><td>1</td><td>0</td><td>1</td><td>0</td><td>0</td><td>1</td><td>1</td><td>1</td></tr></table> - When setting No.917 for Dip switch 4 (Dip switch 6-10 is ON) is ON. The relay closes during reception of cooling or the heating operation signal from the controller. (Note: It is output even if the thermostat is OFF (when the compressor is stopped).)										SW4 0: OFF, 1: ON										1	2	3	4	5	6	7	8	9	10	1	0	1	0	1	0	0	1	1	1
SW4 0: OFF, 1: ON																																								
1	2	3	4	5	6	7	8	9	10																															
1	0	1	0	1	0	0	1	1	1																															

Pump Interlock

Terminal No.	TB8-3, 4
Input	Level signal
Operation	If the circuit between TB8-3 and TB8-4 is open, compressor operation is prohibited.

*Remove the short circuit wire between 3 and 4 when wiring to TB8.
To prevent a false detection of error resulting from contact failure, use a flow switch with a minimum guaranteed current of 5 mA or below for FS.

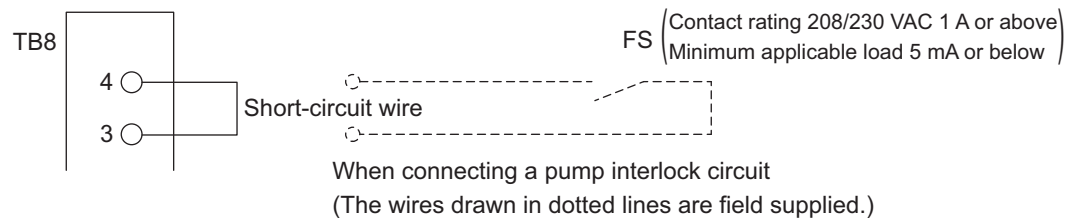

9-2. Water piping work

Although the water piping for the CITY MULTI WY system does not differ from that for ordinary air conditioning systems, pay special attention to the items below in conducting the piping work.

1) Items to be observed on installation work

- The water pressure resistance of the water pipes in the heat source unit is 2.0MPa [290psi].
 - In order to equalize piping resistance for each unit, adapt the reverse return system.
 - Mount a joint and a valve onto the water outlet/inlet of the unit to allow for maintenance, inspection and replacement work. Be sure to mount a strainer at the water inlet piping of the unit. (The strainer is required at the circulation water inlet to protect the heat source unit.)
 - * The installation example of the heat source unit is shown right.
 - Be sure to provide an air relief opening on the water piping properly, and purge air after feeding water to the piping system.
 - Condensate will generate at the low temperature part inside the heat source equipment. Connect drain piping to the drain piping connection located at the bottom of the heat source equipment to discharge it outside the equipment.
 - Mount a backflow prevention valve and a flexible joint for vibration control onto the pump.
 - Provide a sleeve to the penetrating parts of the wall to prevent the piping.
 - Fasten the piping with metal fitting, arrange the piping not to expose to cutting or bending force, and pay sufficient care for possible vibration.
 - Be careful not to erroneously judge the position of the inlet and outlet of water.
(Lower position : Inlet, Upper position : Outlet)
 - When connecting heat source unit water piping and water piping on site, apply liquid sealing material for water piping over the sealing tape before connection.
 - This unit doesn't include a heater to prevent freezing within tubes. If the water flow is stopped on low ambient, drain the water out.
 - The unused knockout holes should be closed and the refrigerant pipes, water pipes, power source and transmission wires access holes should be filled with putty.
 - The drain plug is installed on the back of the unit at factory for field-connection of the drain pipes on the front of the unit. Move the plug to the front to connect the drain pipes on the back. Verify that there are no leaks from pipe connections.
 - For installing two units, install water pipes in parallel to each other so that the water flow rate through both units will be equal.
 - Wrap the sealing tape as follows.
- ① Wrap the joint with sealing tape in the direction of the threads (clockwise), and do not let the tape run over the edge.
 - ② Overlap the sealing tape by two-thirds to three-fourths of its width on each turn. Press the tape with your fingers so that it is pressed firmly against each thread.
 - ③ Leave the 1.5th through 2nd farthest threads away from the pipe end unwrapped.
- Hold the pipe on the unit side in place with a spanner when installing the pipes or strainer. Tighten screws to a torque of 150N • m.


2) Thermal insulation work

Thermal insulation or anti sweating work is not required for the piping inside buildings in the case of the CITY MULTI WY system if the operating temperature range of circulation water stays within the temperature near the normal (summer : 30°C [86°F], winter : 20°C [68°F]).

In case of the conditions below, however, thermal insulation is required.

- Use of well water for heat source water
- Outdoor piping portions
- Indoor piping portions where freezing may be caused in winter

Installation example of heat source unit

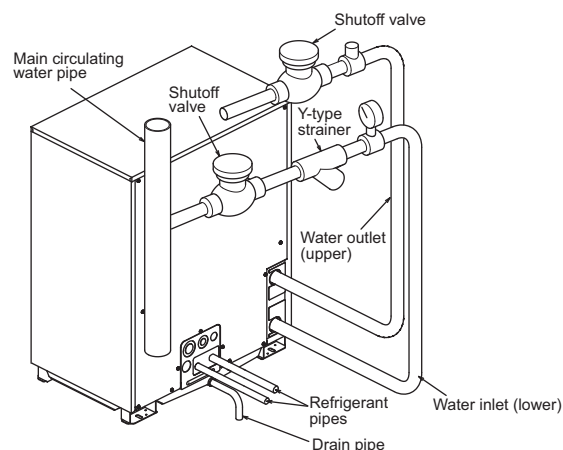

- A place where vapor condensation may be generated on piping due to an increase in dry bulb temperature inside the ceiling caused by the entry of fresh outdoor air
- Drain piping portions

3) Water treatment and water quality control

For the circulation water cooling tower of the CITY MULTI WY system, employment of the closed type is recommended to keep water quality. However, in the case that an open type cooling tower is employed or the circulating water quality is inferior, scale will adhere onto the water heat exchanger leading to the decreased heat exchange capacity or the corrosion of the heat exchanger. Be sufficiently careful for water quality control and water treatment at the installation of the circulation water system.

• Removal of impurities inside piping

Be careful not to allow impurities such as welding fragment, remaining sealing material and rust from mixing into the piping during installation work.

• Water treatment

The water quality standards have been established by the industry (Japan Refrigeration, Air Conditioning Industry Association, in case of Japan) for water treatment to be applied.

Items		Lower mid-range temperature water system		Tendency	
		Recirculating water [20<T<60°C] [68<T<140°F]	Make-up water	Corrosive	Scale-forming
Standard items	pH (25°C[77°F])	7.0 ~ 8.0	7.0 ~ 8.0	○	○
	Electric conductivity (mS/m) (25°C[77°F])	30 or less	30 or less	○	○
	(μS/cm) (25°C[77°F])	[300 or less]	[300 or less]		
	Chloride ion (mg Cl/ℓ)	50 or less	50 or less	○	
	Sulfate ion (mg SO ₄ ²⁻ /ℓ)	50 or less	50 or less	○	
	Acid consumption (pH4.8) (mg CaCO ₃ /ℓ)	50 or less	50 or less		○
	Total hardness (mg CaCO ₃ /ℓ)	70 or less	70 or less		○
	Calcium hardness (mg CaCO ₃ /ℓ)	50 or less	50 or less		○
Reference items	Ionic silica (mg SiO ₂ /ℓ)	30 or less	30 or less		○
	Iron (mg Fe/ℓ)	1.0 or less	0.3 or less	○	○
	Copper (mg Cu/ℓ)	1.0 or less	0.1 or less	○	
	Sulfide ion (mg S ²⁻ /ℓ)	not to be detected	not to be detected	○	
	Ammonium ion (mg NH ₄ ⁺ /ℓ)	0.3 or less	0.1 or less	○	
	Residual chlorine (mg Cl/ℓ)	0.25 or less	0.3 or less	○	
	Free carbon dioxide (mg CO ₂ /ℓ)	0.4 or less	4.0 or less	○	
	Ryzner stability index	—	—	○	○

Reference : Guideline of Water Quality for Refrigeration and Air Conditioning Equipment. (JRA GL02E-1994)

In order to keep the water quality within such standards, you are kindly requested to conduct bleeding-off by overflow and periodical water quality tests, and use inhibitors to suppress condensation or corrosion. Since piping may be corroded by some kinds of inhibitor, consult an appropriate water treatment expert for proper water treatment.


4) Pump interlock

Operating the heat source unit without circulation water inside the water piping can cause a trouble. Be sure to provide interlocking for the unit operation and water circuit. Since the terminal block is being provided inside the unit, use it as required.

5) Handling plate heat exchangers for heat-source units

<Designing the piping system>

- Install a strainer (50 mesh or finer recommended) near the heat-source unit on the inlet side of the hot/cold water pipe and cooling-water pipe (hereafter referred to as water pipes) to prevent an infiltration of foreign materials of solid nature, such as dirt and sand, into the plate heat exchanger.
- Depending on the water quality, scale may form inside plate heat exchangers. Plate heat exchangers must be chemically cleaned regularly to remove scale formation. Install sluice valves on the water pipes, and provide ports for connecting a pipe between the sluice valves and the heat-source unit for chemical cleaning.
- On both the inlet and outlet sides of water pipes, provide a plug to remove trapped air and water (also to be used for cleaning heat-source units and for purging water before a period of nonuse in winter or at the end of an air conditioning season). Also, provide automatic air-vent valves where air is likely to be trapped (such as a pipe that runs vertically).
- In addition to installing the above-mentioned strainers, install a cleanable strainer near the pump pipe inlet.
- Keep the pipes properly insulated and take an appropriate measure against humidity to minimize heat loss and prevent freeze damage in severe cold climate.
- If the system is stopped during winter or at night in subfreezing temperatures, take appropriate measures to protect pipes from freezing (i.e., pipe purging and use of water-circulation pump or heater) and prevent resultant damage to the plate heat exchanger.

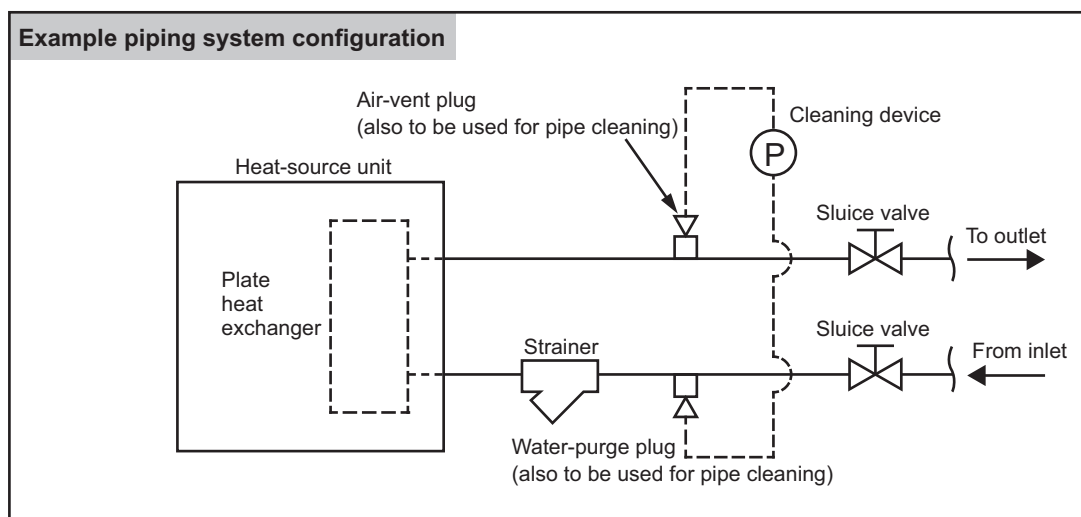

<Test run>

- Before performing a test run, check that the piping system is properly installed, especially the strainers, air-vents, automatic water-supply valves, expansion tanks, and systems.
- After the pipe system is filled with water, first, operate the pump alone to check the system for trapped air and adjust the water flow rate to prevent the plate heat exchanger from freezing. Take into consideration the water pressure loss before and after each heat-source unit, and make sure the water flow rate falls within the design water flow rate range. Stop the test run and correct any problems found, if any.
- At the completion of a test run, check the strainer at the inlet pipe of the heat-source unit and clean it as necessary.

<Daily maintenance>

- Controlling the water quality
Plate heat exchangers cannot be disassembled for cleaning and have no replaceable parts. Watch the water quality to prevent corrosion and scale formation. The quality of the water to be used for plate heat exchangers must meet the water quality guidelines JRA GL-02-1994 specified by Japan Refrigeration and Air conditioning Industry Association (JRAIA). (Refer to 3) Water treatment and water quality control.)
- Controlling the circulation water flow rate
Insufficient water rate will cause freeze damage to plate heat exchangers. Check for insufficient water flow caused by clogged strainer, trapped air in the system, or malfunction of the circulation water pump. Flow rate can also be checked by measuring the temperature or pressure difference between the inlet and outlet of plate heat exchangers. If the temperature or pressure difference goes outside of the specified range, stop the operation, remove the cause of the problem, and resume operation.
- What to do when the freeze protection trips
If the freeze protection trips during operation, be sure to remove its cause before resuming operation. Tripped freeze protection indicates that the system is partially frozen, and resuming operation without removing the cause of the problem will result in freeze damage to plate heat exchangers and/or pipes as well as resultant refrigerant leaks and infiltration of water into the refrigerant circuit.

<Maintaining plate heat exchangers>

Plate heat exchangers must be maintained in a planned and periodical manner to prevent scale formation, which may cause performance loss or decrease water flow rate that result in freeze damage to the plate heat exchanger.



- ♦ Check the following items before the operating season.
 1. Check that the water quality meets the specified water quality.
 2. Clean the strainers.
 3. Check that the water flow rate is adequate.
 4. Check for proper operation (e.g., pressure, flow rate, inlet/outlet temperatures).
- ♦ Plate heat exchangers cannot be disassembled for cleaning. Clean them in the following way.
 1. Make sure that there is a pipe connection port on the water inlet pipe.
Use formic acid, citric acid, oxalic acid, acetic acid, or phosphoric acid diluted to 5% to clean plate heat exchangers.
Do not use highly corrosive acids, such as hydrochloric acid, sulfuric acid, or nitric acid.
 2. Make sure that valves are installed before the inlet connection port and after the outlet connection port.
 3. Connect a pipe for circulating cleaning solution to the inlet/outlet pipes of the plate heat exchanger, fill the plate heat exchanger with cleaning solution at a temperature between 50 and 60°C, and circulate the cleaning solution with a pump for 2 to 5 hours. The cleaning time will depend on the temperature of the cleaning solution and the degree of scale formation. Use the color of the cleaning solution as a guide to determine how long the system needs to be cleaned.
 4. When done, discharge the cleaning solution out of the plate heat exchanger, fill it with sodium hydrate (NaOH) or sodium bicarbonate (NaHCO₃) diluted with water to 1 to 2%, and let the solution be circulated for 15 to 20 minutes until the cleaning solution is neutralized.
 5. After neutralizing the cleaning solution, thoroughly rinse the plate heat exchanger with clean water.
 6. When using a commercially available cleaning solution, make sure to use a solution not corrosive to stainless steel or copper.
 7. Consult the cleaning solution manufacture for details.
- ♦ At the completion of cleaning, check the system for proper operation.

10-1. JOINT

CITY MULTI units can be easily connected by using Joint sets and Header sets provided by Mitsubishi Electric. Four kinds of Joint sets are available for use. Refer to section 3 in "System Design" or the Installation Manual that comes with the Joint set for how to install the Joint set.



CMY-Y102SS-G2

For Gas pipe:

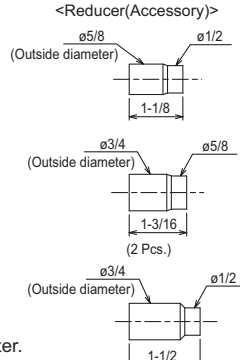

*Pipe diameter is indicated by inside diameter.



For Liquid pipe:



in.



CMY-Y102LS-G2

For Gas pipe:

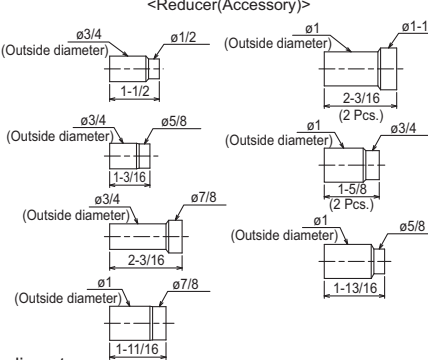

*Pipe diameter is indicated by inside diameter.



For Liquid pipe:



in.



CMY-Y202S-G2

For Gas pipe:

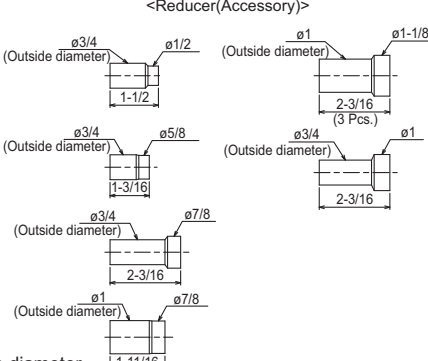

*Pipe diameter is indicated by inside diameter.



For Liquid pipe:



in.



CMY-Y302S-G2

For Gas pipe:

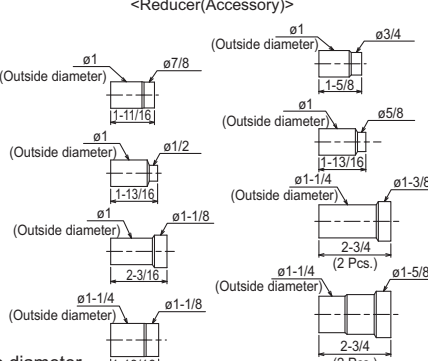

*Pipe diameter is indicated by inside diameter.

For Liquid pipe:

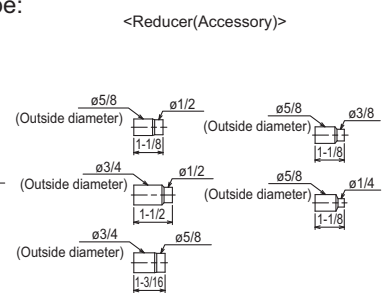


in.

10-2. HEADER


CITY MULTI units can be easily connected by using Joint sets and Header sets provided by Mitsubishi Electric. Three kinds of Header sets are available for use. Refer to section 3 in "System Design" or the Installation Manual that comes with the Header set for how to install the Header set.

CMY-Y104C-G


For gas pipe:

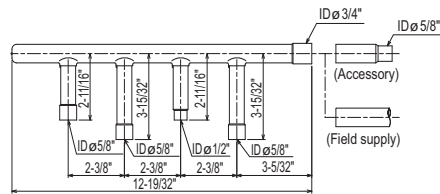


<Reducer(Accessory)>



For liquid pipe:

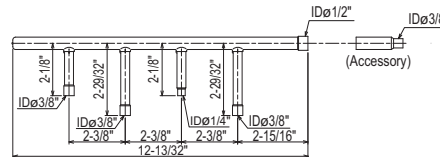

<Reducer(Accessory)>




ID: Inner Diameter OD: Outer Diameter


NOTE: Besides above mentioned accessories, caps for 1/4", 3/8", 1/2", 5/8" pipes (each diameter 1 piece) are included in the Header set.

CMY-Y108C-G


For gas pipe:

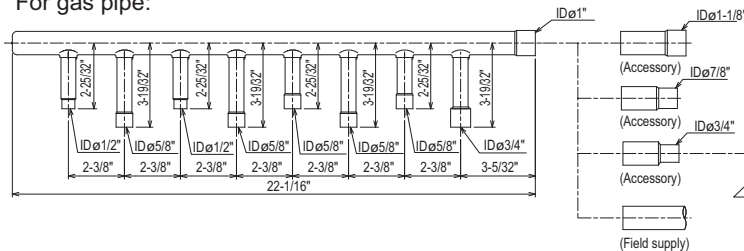


<Reducer(Accessory)>

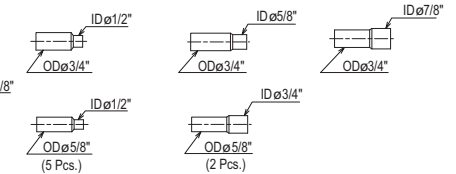

For liquid pipe:

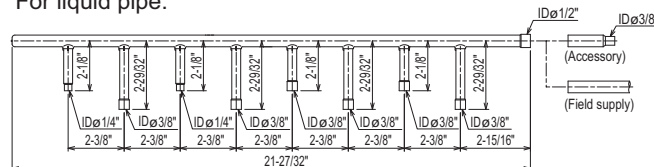

<Reducer(Accessory)>




ID: Inner Diameter OD: Outer Diameter


NOTE: Besides above mentioned accessories, caps for 1/4", 3/8", 1/2", 5/8" pipes (each diameter 2 pieces) and 1 cap for 3/4" pipe are included in the Header set.

CMY-Y1010C-G


For gas pipe:

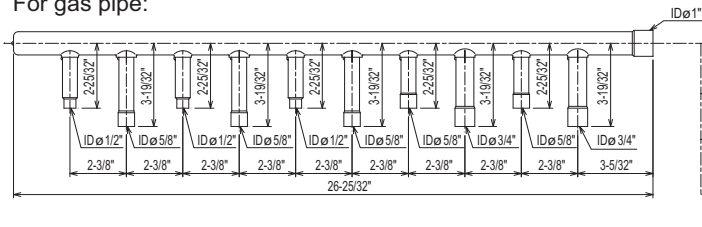


<Reducer(Accessory)>

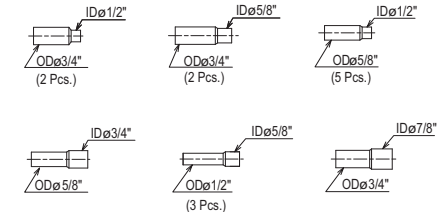

For liquid pipe:

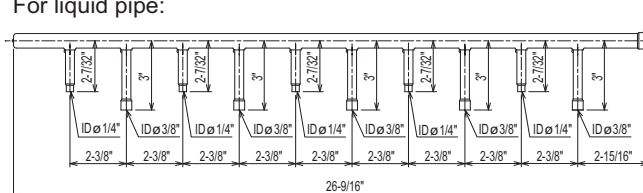

<Reducer(Accessory)>



ID: Inner Diameter OD: Outer Diameter

NOTE: Besides above mentioned accessories, caps for 1/4", 3/8", 1/2", 5/8" pipes (each diameter 2 pieces) and 1 cap for 3/4" pipe are included in the Header set.

10-3. OUTDOOR TWINNING KIT

The following optional Outdoor Twinning Kit is needed to use to combine multiple refrigerant pipes. Refer to the chapter entitled System Design Section for the details of selecting a proper twinning kit.

CMY-Y100CBK3

For Gas pipe:

19-29/32"
ID ϕ 7/8"
OD ϕ 1"
Pipe cover (Dot-dashed part)
Local brazing
OD ϕ 1-1/8"
ID ϕ 1-1/8"
Note 2 (13-15/32")
23-5/32"
Distributor
ID ϕ 7/8"
OD ϕ 1"
6-5/16"

For Liquid pipe:

7-7/32"
OD ϕ 5/8"
ID ϕ 1/2"
Local brazing
ID ϕ 5/8"
Note 2 (3-9/32")
3-7/8"
Pipe cover (Dot-dashed part)
ID ϕ 1/2"
OD ϕ 1/2"
Distributor
9-1/2"

<Reducer(Accessory)>

OD ϕ 1/2"
ID ϕ 3/8"
1-15/16"
(2 pcs.)
OD ϕ 5/8"
ID ϕ 1/2"
1-15/16"
(2 pcs.)
OD ϕ 7/8"
ID ϕ 1-1/8"
2-15/32"
(2 pcs.)
OD ϕ 7/8"
ID ϕ 3/4"
2-15/32"
(2 pcs.)

in.

ID: Inner Diameter OD: Outer Diameter

CMY-Y200CBK2

For Gas pipe:

19-13/16"
ID ϕ 1-1/18"
OD ϕ 1-1/18"
Pipe cover (Dot-dashed part)
Local brazing
OD ϕ 1-1/8"
ID ϕ 1-3/8"
Note 2 (13-5/16")
23-1/16"
Distributor
ID ϕ 1-1/18"
OD ϕ 1-1/18"
6-7/16"

For Liquid pipe:

7-9/16"
OD ϕ 3/4"
ID ϕ 5/8"
Local brazing
ID ϕ 3/4"
Note 2 (3-3/8")
1 1/5"
Pipe cover (Dot-dashed part)
ID ϕ 5/8"
OD ϕ 5/8"
Distributor
9-5/8"


<Deformed pipe(Accessory)>

OD ϕ 5/8"
ID ϕ 1/2"
1-15/16"
(2 pcs.)
OD ϕ 1-3/8"
ID ϕ 1-5/8"
2-3/4"

in.

ID: Inner Diameter OD: Outer Diameter

Note 1. Reference the attitude angle of the branch pipe below the fig.



- The angle of the branch pipe for high pressure is within $\pm 15^\circ$ against the horizontal plane.
- 2. Use the attached pipe to braze the port-opening of the distributor.
 - 3. Pipe diameter is indicated by inside diameter.
 - 4. Only use the Twinning pipe by Mitsubishi (optional parts) .