

HEAT SOURCE UNITS

1. SPECIFICATIONS.....	2 - 1016
2. EXTERNAL DIMENSIONS.....	2 - 1028
3. CENTER OF GRAVITY	2 - 1031
4. ELECTRICAL WIRING DIAGRAMS.....	2 - 1032
5. SOUND LEVELS	2 - 1033
6. CAPACITY TABLES	2 - 1036
6-1. Correction by temperature	2 - 1036
6-2. Correction by total indoor.....	2 - 1062
6-3. Correction by refrigerant piping length.....	2 - 1069
6-4. Operation temperature range	2 - 1072
7. SYSTEM DESIGN GUIDE.....	2 - 1073
7-1. Designing of water circuit system	2 - 1073
7-2. Water piping work	2 - 1085
8. OPTIONAL PARTS.....	2 - 1089
8-1. JOINT	2 - 1089
8-2. HEADER.....	2 - 1090
8-3. OUTDOOR TWINNING KIT	2 - 1091

1. SPECIFICATIONS

U11 2nd

Heat Source Model	PQHY-P72ZKMU-A			PQHY-P96ZKMU-A	
Indoor Model	Non-Ducted	Ducted	Non-Ducted	Ducted	
Power source	3-phase 3-wire 575 V ±10% 60 Hz		3-phase 3-wire 575 V ±10% 60 Hz		
Cooling capacity (Nominal)	*1 BTU/h	72,000		96,000	
	kW	21.1		28.1	
	Power input	3.75		5.93	
	(575) Current input	A	4.1	6.6	
	(Rated)	BTU/h	69,000	92,000	
		kW	20.2	27.0	
	(575)	Power input	2.96	4.26	5.52
		Current input	A	3.3	6.1
Temp. range of cooling	Indoor	W.B.	59~75°F (15~24°C)	59~75°F (15~24°C)	
	Circulating water	°F	50~113°F (10~45°C)	50~113°F (10~45°C)	
Heating capacity (Nominal)	*2 BTU/h	80,000		108,000	
	kW	23.4		31.7	
	Power input	3.93		6.17	
	(575) Current input	A	4.3	6.8	
	(Rated)	BTU/h	76,000	103,000	
		kW	22.3	30.2	
	(575)	Power input	3.48	4.87	5.74
		Current input	A	3.8	6.4
Temp. range of heating	Indoor	D.B.	59~81°F (15~27°C)	59~81°F (15~27°C)	
	Circulating water	°F	50~95°F (10~35°C)	50~95°F (10~35°C)	
Indoor unit connectable	Total capacity	50~130% of heatsource unit capacity			
	Model/Quantity	P06-P96/1~15			
Sound pressure level (measured in anechoic room)	dB <A>	46.0	48.0		
Refrigerant piping diameter	Liquid pipe	in. (mm)	3/8 (9.52) Brazed	3/8 (9.52) Brazed (1/2 (12.7) Brazed, total length >= 90 m)	
	Gas pipe	in. (mm)	3/4 (19.05) Brazed	7/8 (22.2) Brazed	
Minimum Circuit Ampacity	A		9	12	
Maximum Overcurrent Protection	A		15	20	
Circulating water	Water flow rate	G/h	1,522	1,522	
		G/min (gpm)	25.4	25.4	
		m³/h	5.76	5.76	
		L/min	96	96	
	Pressure drop	cfm	3.4	3.4	
		psi	3.48	3.48	
		kPa	24	24	
		Operating volume range	G/h	1,189 ~ 1,902	1,189 ~ 1,902
		G/min (gpm)		19.8 ~ 31.7	19.8 ~ 31.7
		m³/h		4.5 ~ 7.2	4.5 ~ 7.2
Compressor	Type x Quantity	Inverter scroll hermetic compressor x 1			Inverter scroll hermetic compressor x 1
	Manufacture	AC&R Works, MITSUBISHI ELECTRIC CORPORATION			AC&R Works, MITSUBISHI ELECTRIC CORPORATION
	Starting method	Inverter			Inverter
	Motor output	kW	4.3	6.0	
	Case heater	kW	-	-	
	Lubricant		MEL32	MEL32	
External finish		Galvanized steel sheets			Galvanized steel sheets
External dimension H x W x D	in.	43-5/16 x 34-11/16 x 21-11/16	43-5/16 x 34-11/16 x 21-11/16		
	mm	1,100 x 880 x 550	1,100 x 880 x 550		
Protection devices	High pressure protection		High pressure sensor, High pressure switch at 4.15 MPa (601 psi)	High pressure sensor, High pressure switch at 4.15 MPa (601 psi)	
	Inverter circuit		Over-heat protection, Over-current protection	Over-heat protection, Over-current protection	
Refrigerant	Compressor		Over-heat protection	Over-heat protection	
	Type x original charge	R410A x 11 lbs + 1 oz (5.0 kg)		R410A x 11 lbs + 1 oz (5.0 kg)	
Net weight	Control	LEV and HIC circuit		LEV and HIC circuit	
Heat exchanger	Heat exchanger		plate type	plate type	
	Water volume in plate	G	1.32	1.32	
		I	5.0	5.0	
	Water pressure Max.	psi	290	290	
		MPa	2.0	2.0	
	HIC circuit (HIC: Heat Inter-Changer)	Copper pipe, tube-in-tube structure			Copper pipe, tube-in-tube structure
Drawing	External	KJ94C549		KJ94C549	
	Wiring	KE94C823		KE94C823	
Standard attachment	Document	-		-	
	Accessory	Details refer to External Drw		Details refer to External Drw	
Optional parts		joint: CMY-Y102SS-G2, CMY-Y102LS-G2 Header: CMY-Y104/108/1010C-G		joint: CMY-Y102SS-G2, CMY-Y102LS-G2 Header: CMY-Y104/108/1010C-G	
	Remarks	Details on foundation work, duct work, insulation work, electrical wiring, power source switch, and other items shall be referred to the Installation Manual. Due to continuing improvement, above specifications may be subject to change without notice. The ambient temperature of the Heat Source Unit needs to be kept below 104°F.D.B. (40°C.D.B.) The ambient relative humidity of the Heat Source Unit needs to be kept below 80%. The Heat Source Unit should not be installed at outdoor. Be sure to mount a strainer (more than 50 meshes) at the water inlet piping of the unit. Be sure to provide interlocking for the unit operation and water circuit. Install the supplied insulation material to the unused drain-socket. When installing insulation material around both water and refrigerant piping, follow the installation manual.			

Notes:

- 1.Nominal cooling conditions (Test conditions are based on AHRI 1230)
Indoor: 81°F.D.B./66°F.W.B. (27°C.D.B./19°C.W.B.), Water temperature: 86°F (30°C)
- 2.Nominal heating conditions (Test conditions are based on AHRI 1230)
Indoor: 68°F.D.B. (20°C.D.B.), Water temperature: 68°F (20°C)

Unit converter

- BTU/h =kW x 3,412
- cfm =m³/min x 35.31
- lbs =kg/0.4536

*Above specification data is subject to rounding variation.

1. SPECIFICATIONS

U11 2nd

Heat Source Model			PQHY-P120ZKMU-A									
Indoor Model			Non-Ducted	Ducted								
Power source	3-phase 3-wire 575 V ±10% 60 Hz											
Cooling capacity (Nominal)	*1	BTU/h	120,000									
		kW	35.2									
		Power input	kW	7.90								
	(575)	Current input	A	8.8								
			BTU/h	114,000								
			kW	33.4								
			Power input	kW	6.72							
					7.35							
	(575)			Current input	A							
					7.4							
					8.2							
Temp. range of cooling	Indoor	W.B.	59~75°F (15~24°C)									
	Circulating water	°F	50~113°F (10~45°C)									
Heating capacity (Nominal)	*2	BTU/h	135,000									
		kW	39.6									
		Power input	kW	7.99								
	(575)	Current input	A	8.9								
			BTU/h	129,000								
			kW	37.8								
			Power input	kW	7.43							
					7.44							
	(575)			Current input	A							
					8.2							
					8.3							
Temp. range of heating	Indoor	D.B.	59~81°F (15~27°C)									
	Circulating water	°F	50~95°F (10~35°C)									
Indoor unit connectable	Total capacity	50~130% of heatsource unit capacity										
	Model/Quantity	P06~P96/1~26										
Sound pressure level (measured in anechoic room)	dB <A>	54.0										
Refrigerant piping diameter	Liquid pipe	in. (mm)	3/8 (9.52) Brazed (1/2 (12.7) Brazed, total length ≥ 40 m)									
	Gas pipe	in. (mm)	7/8 (22.2) Brazed									
Minimum Circuit Ampacity	A	13										
Maximum Overcurrent Protection	A	22										
Circulating water	Water flow rate	G/h	1,522									
		G/min (gpm)	25.4									
		m³/h	5.76									
		L/min	96									
		cfm	3.4									
	Pressure drop	psi	3.48									
		kPa	24									
	Operating volume range	G/h	1,189 ~ 1,902									
		G/min (gpm)	19.8 ~ 31.7									
		m³/h	4.5 ~ 7.2									
Compressor	Type x Quantity	Inverter scroll hermetic compressor x 1										
	Manufacture	AC&R Works, MITSUBISHI ELECTRIC CORPORATION										
	Starting method	Inverter										
	Motor output	kW	7.7									
	Case heater	kW	-									
	Lubricant	MEL32										
External finish	Galvanized steel sheets											
External dimension H x W x D	in.	43-5/16 x 34-11/16 x 21-11/16										
	mm	1,100 x 880 x 550										
Protection devices	High pressure protection	High pressure sensor, High pressure switch at 4.15 MPa (601 psi)										
	Inverter circuit	Over-heat protection, Over-current protection										
	Compressor	Over-heat protection										
Refrigerant	Type x original charge	R410A x 11 lbs + 1 oz (5.0 kg)										
	Control	LEV and HIC circuit										
Net weight	lbs (kg)	408 (185)										
Heat exchanger	plate type											
	Water volume in plate	G	1.32									
		I	5.0									
	Water pressure Max.	psi	290									
		MPa	2.0									
HIC circuit (HIC: Heat Inter-Changer)	Copper pipe, tube-in-tube structure											
Drawing	External	KJ94C549										
	Wiring	KE94C823										
Standard attachment	Document	-										
	Accessory	Details refer to External Drw										
Optional parts	joint: CMY-Y102SS-G2, CMY-Y102LS-G2, CMY-Y202S-G2 Header: CMY-Y104/108/1010C-G											
Remarks	Details on foundation work, duct work, insulation work, electrical wiring, power source switch, and other items shall be referred to the Installation Manual. Due to continuing improvement, above specifications may be subject to change without notice. The ambient temperature of the Heat Source Unit needs to be kept below 104°F.D.B. (40°C.D.B.) The ambient relative humidity of the Heat Source Unit needs to be kept below 80%. The Heat Source Unit should not be installed at outdoor. Be sure to mount a strainer (more than 50 meshes) at the water inlet piping of the unit. Be sure to provide interlocking for the unit operation and water circuit. Install the supplied insulation material to the unused drain-socket. When installing insulation material around both water and refrigerant piping, follow the installation manual.											

Notes:	Unit converter
1.Nominal cooling conditions (Test conditions are based on AHRI 1230) Indoor: 81°F.D.B./66°F.W.B. (27°C.D.B./19°C.W.B.), Water temperature: 86°F (30°C)	BTU/h = kW x 3,412
2.Nominal heating conditions (Test conditions are based on AHRI 1230) Indoor: 68°F.D.B. (20°C.D.B.), Water temperature: 68°F (20°C)	cfm = m³/min x 35.31
	lbs = kg/0.4536

*Above specification data is subject to rounding variation.

WY 575V

1. SPECIFICATIONS

U11 2nd

Heat Source Model		PQHY-P144ZSKMU-A						
Indoor Model		Non-Ducted			Ducted			
Power source		3-phase 3-wire 575 V ±10% 60 Hz						
Cooling capacity (Nominal)	*1	BTU/h		144,000				
		kW		42.2				
		Power input	kW	9.21				
	(575)	Current input	A	10.2				
	(Rated)		BTU/h	137,000				
			kW	40.2				
		Power input	kW	6.47	8.57			
	(575)	Current input	A	7.2	9.5			
Temp. range of cooling	Indoor	W.B.		59~75°F (15~24°C)				
	Circulating water	°F		50~113°F (10~45°C)				
Heating capacity (Nominal)	*2	BTU/h		160,000				
		kW		46.9				
		Power input	kW	8.78				
	(575)	Current input	A	9.7				
	(Rated)		BTU/h	152,000				
			kW	44.5				
		Power input	kW	7.51	8.17			
	(575)	Current input	A	8.3	9.1			
Temp. range of heating	Indoor	D.B.		59~81°F (15~27°C)				
	Circulating water	°F		50~95°F (10~35°C)				
Indoor unit connectable	Total capacity			50~130% of heat source unit capacity				
	Model/Quantity			P06~P96/1~31				
Sound pressure level (measured in anechoic room)	dB <A>			49.0				
Refrigerant piping diameter	Liquid pipe	in. (mm)		1/2 (12.7) Brazed				
	Gas pipe	in. (mm)		1-1/8 (28.58) Brazed				
Set Model								
Model		PQHY-P72ZKMU-A		PQHY-P72ZKMU-A				
Minimum Circuit Ampacity	A		9		9			
Maximum Overcurrent Protection	A		15		15			
Circulating water	Water flow rate	G/h		1,522 + 1,522				
		G/min (gpm)		25.4 + 25.4				
		m³/h		5.76 + 5.76				
		L/min		96 + 96				
		cfm		3.4 + 3.4				
	Pressure drop	psi	3.48		3.48			
		kPa	24		24			
	Operating volume range	G/h		1,189 + 1,189 ~ 1,902 + 1,902				
		G/min (gpm)		19.8 + 19.8 ~ 31.7 + 31.7				
		m³/h		4.5 + 4.5 ~ 7.2 + 7.2				
Compressor	Type x Quantity	Inverter scroll hermetic compressor x 1		Inverter scroll hermetic compressor x 1				
	Manufacture	AC&R Works, MITSUBISHI ELECTRIC CORPORATION		AC&R Works, MITSUBISHI ELECTRIC CORPORATION				
	Starting method	Inverter		Inverter				
	Motor output	kW	4.3		4.3			
	Case heater	kW	-		-			
	Lubricant		MEL32		MEL32			
External finish		Galvanized steel sheets		Galvanized steel sheets				
External dimension H x W x D	in.	43-5/16 x 34-11/16 x 21-11/16		43-5/16 x 34-11/16 x 21-11/16				
	mm	1,100 x 880 x 550		1,100 x 880 x 550				
Protection devices	High pressure protection	High pressure sensor, High pressure switch at 4.15 MPa (601 psi)		High pressure sensor, High pressure switch at 4.15 MPa (601 psi)				
	Inverter circuit	Over-heat protection, Over-current protection		Over-heat protection, Over-current protection				
	Compressor	Over-heat protection		Over-heat protection				
Refrigerant	Type x original charge	R410A x 11 lbs + 1 oz (5.0 kg)		R410A x 11 lbs + 1 oz (5.0 kg)				
	Control	LEV and HIC circuit						
Net weight	lbs (kg)	408 (185)		408 (185)				
Heat exchanger		plate type		plate type				
	Water volume in plate	G	1.32		1.32			
		I	5.0		5.0			
	Water pressure Max.	psi	290		290			
		MPa	2.0		2.0			
HIC circuit (HIC: Heat Inter-Changer)								
		Copper pipe, tube-in-tube structure		Copper pipe, tube-in-tube structure				
Pipe between unit and distributor	Liquid pipe	in. (mm)	3/8 (9.52) Brazed		3/8 (9.52) Brazed			
	Gas pipe	in. (mm)	3/4 (19.05) Brazed		3/4 (19.05) Brazed			
Drawing	External		KJ94G487					
	Wiring		KE94C823		KE94C823			
Standard attachment	Document		-					
	Accessory		Details refer to External Drw					
Optional parts		Heat Source Twinning kit: CMY-Y100CBK3 joint: CMY-Y102SS-G2, CMY-Y102LS-G2, CMY-Y202S-G2 Header: CMY-Y104/108/1010C-G						
Remarks		Details on foundation work, duct work, insulation work, electrical wiring, power source switch, and other items shall be referred to the Installation Manual. Due to continuing improvement, above specifications may be subject to change without notice. The ambient temperature of the Heat Source Unit needs to be kept below 104°F/D.B. (40°C/D.B.). The ambient relative humidity of the Heat Source Unit needs to be kept below 80%. The Heat Source Unit should not be installed at outdoor. Be sure to mount a strainer (more than 50 meshes) at the water inlet piping of the unit. Be sure to provide interlocking for the unit operation and water circuit. Install the supplied insulation material to the unused drain-socket. When installing insulation material around both water and refrigerant piping, follow the installation manual.						

Notes:

- 1.Nominal cooling conditions (Test conditions are based on AHRI 1230)
Indoor: 81°F/D.B./66°F/W.B. (27°C/D.B./19°C/W.B.), Water temperature: 86°F (30°C)
- 2.Nominal heating conditions (Test conditions are based on AHRI 1230)
Indoor: 68°F/D.B. (20°C/D.B.), Water temperature: 68°F (20°C)

Unit converter

BTU/h	=kW x 3,412
cfm	=m³/min x 35.31
lbs	=kg/0.4536

*Above specification data is subject to rounding variation.

1. SPECIFICATIONS

U11 2nd

Heat Source Model		PQHY-P168ZSKMU-A				
Indoor Model		Non-Ducted		Ducted		
Power source		3-phase 3-wire 575 V ±10% 60 Hz				
Cooling capacity (Nominal)	*1	BTU/h	168,000			
		kW	49.2			
	(575)	Power input	kW	10.67		
		Current input	A	11.9		
	(Rated)	BTU/h	161,000			
		kW	47.2			
		Power input	kW	8.48		
		Current input	A	9.4		
Temp. range of cooling	Indoor	W.B.	59~75°F (15~24°C)			
	Circulating water	°F	50~113°F (10~45°C)			
Heating capacity (Nominal)	*2	BTU/h	188,000			
		kW	55.1			
	(575)	Power input	kW	10.73		
		Current input	A	11.9		
	(Rated)	BTU/h	179,000			
		kW	52.5			
		Power input	kW	9.44		
		Current input	A	10.5		
Temp. range of heating	Indoor	D.B.	59~81°F (15~27°C)			
	Circulating water	°F	50~95°F (10~35°C)			
Indoor unit connectable	Total capacity		50~130% of heat source unit capacity			
	Model/Quantity		P06~P96/1~36			
Sound pressure level (measured in anechoic room)		dB <A>	50.0			
Refrigerant piping diameter	Liquid pipe	in. (mm)	5/8 (15.88) Brazed			
	Gas pipe	in. (mm)	1-1/8 (28.58) Brazed			
Set Model						
Model		PQHY-P96ZSKMU-A		PQHY-P72ZSKMU-A		
Minimum Circuit Ampacity		A	12	9		
Maximum Overcurrent Protection		A	20	15		
Circulating water	Water flow rate	G/h	1,522 + 1,522			
		G/min (gpm)	25.4 + 25.4			
		m³/h	5.76 + 5.76			
		L/min	96 + 96			
		cfm	3.4 + 3.4			
	Pressure drop	psi	3.48	3.48		
		kPa	24	24		
		G/h	1,189 + 1,189 ~ 1,902 + 1,902			
		G/min (gpm)	19.8 + 19.8 ~ 31.7 + 31.7			
		m³/h	4.5 + 4.5 ~ 7.2 + 7.2			
Compressor	Type x Quantity	Inverter scroll hermetic compressor x 1		Inverter scroll hermetic compressor x 1		
	Manufacture	AC&R Works, MITSUBISHI ELECTRIC CORPORATION		AC&R Works, MITSUBISHI ELECTRIC CORPORATION		
	Starting method	Inverter		Inverter		
	Motor output	kW	6.0	4.3		
	Case heater	kW	-	-		
	Lubricant	MEL32		MEL32		
External finish		Galvanized steel sheets		Galvanized steel sheets		
External dimension H x W x D		in.	43-5/16 x 34-11/16 x 21-11/16	43-5/16 x 34-11/16 x 21-11/16		
		mm	1,100 x 880 x 550	1,100 x 880 x 550		
Protection devices	High pressure protection		High pressure sensor, High pressure switch at 4.15 MPa (601 psi)			
	Inverter circuit		Over-heat protection, Over-current protection			
	Compressor		Over-heat protection			
Refrigerant	Type x original charge	R410A x 11 lbs + 1 oz (5.0 kg)		R410A x 11 lbs + 1 oz (5.0 kg)		
	Control	LEV and HIC circuit				
Net weight	lbs (kg)	408 (185)	408 (185)			
Heat exchanger	plate type		plate type			
	Water volume in plate	G	1.32	1.32		
		I	5.0	5.0		
	Water pressure Max.	psi	290	290		
		MPa	2.0	2.0		
HIC circuit (HIC: Heat Inter-Changer)		Copper pipe, tube-in-tube structure		Copper pipe, tube-in-tube structure		
Pipe between unit and distributor	Liquid pipe	in. (mm)	3/8 (9.52) Brazed	3/8 (9.52) Brazed		
	Gas pipe	in. (mm)	7/8 (22.2) Brazed	7/8 (22.2) Brazed		
Drawing	External	KJ94G487				
	Wiring	KE94C823		KE94C823		
Standard attachment	Document	-				
	Accessory	Details refer to External Drw				
Optional parts		Heat Source Twinning kit: CMY-Y100CBK3 joint: CMY-Y102SS-G2, CMY-Y102LS-G2, CMY-Y202S-G2 Header: CMY-Y104/108/1010C-G				
Remarks		Details on foundation work, duct work, insulation work, electrical wiring, power source switch, and other items shall be referred to the Installation Manual. Due to continuing improvement, above specifications may be subject to change without notice. The ambient temperature of the Heat Source Unit needs to be kept below 104°F.D.B. (40°C.D.B.). The ambient relative humidity of the Heat Source Unit needs to be kept below 80%. The Heat Source Unit should not be installed at outdoor. Be sure to mount a strainer (more than 50 meshes) at the water inlet piping of the unit. Be sure to provide interlocking for the unit operation and water circuit. Install the supplied insulation material to the unused drain-socket. When installing insulation material around both water and refrigerant piping, follow the installation manual.				
Notes:						
1.Nominal cooling conditions (Test conditions are based on AHRI 1230) Indoor: 81°F.D.B./66°F.W.B. (27°C.D.B./19°C.W.B.), Water temperature: 86°F (30°C)						
2.Nominal heating conditions (Test conditions are based on AHRI 1230) Indoor: 68°F.D.B. (20°C.D.B.), Water temperature: 68°F (20°C)						
Unit converter						
BTU/h = kW x 3,412						
cfm = m³/min x 35.31						
lbs = kg x 0.4536						
*Above specification data is subject to rounding variation.						

WY 575V

1. SPECIFICATIONS

U11 2nd

Heat Source Model			PQHY-P192ZSKMU-A						
Indoor Model			Non-Ducted		Ducted				
Power source	3-phase 3-wire 575 V ±10% 60 Hz								
Cooling capacity (Nominal)	*1	BTU/h	192,000						
		kW	56.3						
		Power input	kW	12.60					
	(575)	Current input	A	14.0					
	(Rated)	BTU/h	183,000						
		kW	53.6						
		Power input	kW	10.28	11.73				
	(575)	Current input	A	11.4	13.0				
Temp. range of cooling	Indoor	W.B.	59~75°F (15~24°C)						
	Circulating water	°F	50~113°F (10~45°C)						
Heating capacity (Nominal)	*2	BTU/h	215,000						
		kW	63.0						
		Power input	kW	13.01					
	(575)	Current input	A	14.5					
	(Rated)	BTU/h	205,000						
		kW	60.1						
		Power input	kW	11.19	12.11				
	(575)	Current input	A	12.4	13.5				
Temp. range of heating	Indoor	D.B.	59~81°F (15~27°C)						
	Circulating water	°F	50~95°F (10~35°C)						
Indoor unit connectable	Total capacity	50~130% of heat source unit capacity							
	Model/Quantity	P06~P96/1~41							
Sound pressure level (measured in anechoic room)	dB <A>	51.0							
Refrigerant piping diameter	Liquid pipe	in. (mm)	5/8 (15.88) Brazed						
	Gas pipe	in. (mm)	1-1/8 (28.58) Brazed						
Set Model									
Model	PQHY-P96ZKMU-A			PQHY-P96ZKMU-A					
Minimum Circuit Ampacity	A	12		12					
Maximum Overcurrent Protection	A	20		20					
Circulating water	Water flow rate	G/h	1,522 + 1,522						
		G/min (gpm)	25.4 + 25.4						
		m³/h	5.76 + 5.76						
		L/min	96 + 96						
		cfm	3.4 + 3.4						
	Pressure drop	psi	3.48	3.48					
		kPa	24	24					
	Operating volume range	G/h	1,189 + 1,189 ~ 1,902 + 1,902						
		G/min (gpm)	19.8 + 19.8 ~ 31.7 + 31.7						
		m³/h	4.5 + 4.5 ~ 7.2 + 7.2						
Compressor	Type x Quantity	Inverter scroll hermetic compressor x 1			Inverter scroll hermetic compressor x 1				
	Manufacture	AC&R Works, MITSUBISHI ELECTRIC CORPORATION			AC&R Works, MITSUBISHI ELECTRIC CORPORATION				
	Starting method	Inverter			Inverter				
	Motor output	kW	6.0	6.0					
	Case heater	kW	-	-					
	Lubricant	MEL32			MEL32				
External finish	Galvanized steel sheets			Galvanized steel sheets					
External dimension H x W x D	in.	43-5/16 x 34-11/16 x 21-11/16			43-5/16 x 34-11/16 x 21-11/16				
	mm	1,100 x 880 x 550			1,100 x 880 x 550				
Protection devices	High pressure protection	High pressure sensor, High pressure switch at 4.15 MPa (601 psi)			High pressure sensor, High pressure switch at 4.15 MPa (601 psi)				
	Inverter circuit	Over-heat protection, Over-current protection			Over-heat protection, Over-current protection				
	Compressor	Over-heat protection			Over-heat protection				
Refrigerant	Type x original charge	R410A x 11 lbs + 1 oz (5.0 kg)			R410A x 11 lbs + 1 oz (5.0 kg)				
	Control	LEV and HIC circuit							
Net weight	lbs (kg)	408 (185)		408 (185)					
Heat exchanger		plate type			plate type				
	Water volume in plate	G	1.32	1.32					
		I	5.0	5.0					
	Water pressure Max.	psi	290	290					
		MPa	2.0	2.0					
HIC circuit (HIC: Heat Inter-Changer)	Copper pipe, tube-in-tube structure			Copper pipe, tube-in-tube structure					
Pipe between unit and distributor	Liquid pipe	in. (mm)	3/8 (9.52) Brazed	3/8 (9.52) Brazed					
	Gas pipe	in. (mm)	7/8 (22.2) Brazed	7/8 (22.2) Brazed					
Drawing	External	KJ94G487							
	Wiring	KE94C823			KE94C823				
Standard attachment	Document	-							
	Accessory	Details refer to External Drw							
Optional parts	Heat Source Twinning kit: CMY-Y100CBK3 joint: CMY-Y102SS-G2, CMY-Y102LS-G2, CMY-Y202S-G2, CMY-Y302S-G2 Header: CMY-Y104/108/1010C-G								
Remarks	<p>Details on foundation work, duct work, insulation work, electrical wiring, power source switch, and other items shall be referred to the Installation Manual. Due to continuing improvement, above specifications may be subject to change without notice. The ambient temperature of the Heat Source Unit needs to be kept below 104°F.D.B. (40°C.D.B.) The ambient relative humidity of the Heat Source Unit needs to be kept below 80%. The Heat Source Unit should not be installed at outdoor. Be sure to mount a strainer (more than 50 meshes) at the water inlet piping of the unit. Be sure to provide interlocking for the unit operation and water circuit. Install the supplied insulation material to the unused drain-socket. When installing insulation material around both water and refrigerant piping, follow the installation manual.</p>								

Notes:	Unit converter
1.Nominal cooling conditions (Test conditions are based on AHRI 1230) Indoor: 81°F.D.B./66°F.W.B. (27°C.D.B./19°C.W.B.), Water temperature: 86°F (30°C)	BTU/h =kW x 3,412
2.Nominal heating conditions (Test conditions are based on AHRI 1230) Indoor: 68°F.D.B. (20°C.D.B.), Water temperature: 68°F (20°C)	cfm =m³/min x 35.31
	lbs =kg/0.4536
	*Above specification data is subject to rounding variation.

1. SPECIFICATIONS

U11 2nd

Heat Source Model		PQHY-P216ZSKMU-A		
Indoor Model		Non-Ducted	Ducted	
Power source		3-phase 3-wire 575 V ±10% 60 Hz		
Cooling capacity (Nominal)	(575)	*1 BTU/h	216,000	
		kW	63.3	
		Power input kW	14.60	
		Current input A	16.2	
	(575)	BTU/h	206,000	
		kW	60.4	
		Power input kW	12.77	
		Current input A	14.2	
			13.59	
			15.1	
Temp. range of cooling	Indoor	W.B.	59~75°F (15~24°C)	
	Circulating water	°F	50~113°F (10~45°C)	
Heating capacity (Nominal)	(575)	*2 BTU/h	243,000	
		kW	71.2	
		Power input kW	14.97	
		Current input A	16.7	
	(575)	BTU/h	232,000	
		kW	68.0	
		Power input kW	13.88	
		Current input A	15.4	
			13.93	
			15.5	
Temp. range of heating	Indoor	D.B.	59~81°F (15~27°C)	
	Circulating water	°F	50~95°F (10~35°C)	
Indoor unit connectable	Total capacity	50~130% of heat source unit capacity		
	Model/Quantity	P06~P96/2~46		
Sound pressure level (measured in anechoic room)		55.0		
Refrigerant piping diameter	Liquid pipe in. (mm)	5/8 (15.88) Brazed		
	Gas pipe in. (mm)	1-1/8 (28.58) Brazed		
Set Model				
Model	PQHY-P120ZSKMU-A		PQHY-P96ZSKMU-A	
Minimum Circuit Ampacity	A	13	12	
Maximum Overcurrent Protection	A	22	20	
Circulating water	Water flow rate	G/h	1,522 + 1,522	
		G/min (gpm)	25.4 + 25.4	
		m³/h	5.76 + 5.76	
		L/min	96 + 96	
		cfm	3.4 + 3.4	
	Pressure drop	psi	3.48	
		kPa	24	
			3.48	
			24	
		Operating volume range	1,189 + 1,189 ~ 1,902 + 1,902	
Compressor	Type x Quantity	G/h	19.8 + 19.8 ~ 31.7 + 31.7	
		G/min (gpm)	4.5 + 4.5 ~ 7.2 + 7.2	
		m³/h		
	Manufacture	Inverter scroll hermetic compressor x 1	Inverter scroll hermetic compressor x 1	
		AC&R Works, MITSUBISHI ELECTRIC CORPORATION	AC&R Works, MITSUBISHI ELECTRIC CORPORATION	
Refrigerant	Starting method	Inverter	Inverter	
		Motor output kW	7.7	
		Case heater kW	-	
	Control	MEL32	MEL32	
		Lubricant		
External finish		Galvanized steel sheets	Galvanized steel sheets	
External dimension H x W x D		in. 43-5/16 x 34-11/16 x 21-11/16	43-5/16 x 34-11/16 x 21-11/16	
		mm 1,100 x 880 x 550	1,100 x 880 x 550	
Protection devices	High pressure protection		High pressure sensor, High pressure switch at 4.15 MPa (601 psi)	
	Inverter circuit		Over-heat protection, Over-current protection	
	Compressor		Over-heat protection	
Net weight	Type x original charge	R410A x 11 lbs + 1 oz (5.0 kg)	R410A x 11 lbs + 1 oz (5.0 kg)	
	Control		LEV and HIC circuit	
Heat exchanger		plate type	plate type	
Drawing	Water volume in plate	G 1.32	1.32	
		I 5.0	5.0	
	Water pressure Max.	psi 290	290	
		MPa 2.0	2.0	
HIC circuit (HIC: Heat Inter-Changer)		Copper pipe, tube-in-tube structure	Copper pipe, tube-in-tube structure	
Standard attachment	Liquid pipe in. (mm)	1/2 (12.7) Brazed	1/2 (12.7) Brazed	
	Gas pipe in. (mm)	7/8 (22.2) Brazed	7/8 (22.2) Brazed	
Optional parts	External	KJ94G487		
	Wiring	KE94C823	KE94C823	
Remarks	Document		-	
	Accessory		Details refer to External Drw	
Notes:		Heat Source Twinning kit: CMY-Y100CBK3 joint: CMY-Y102SS-G2, CMY-Y102LS-G2, CMY-Y202S-G2, CMY-Y302S-G2 Header: CMY-Y104/108/1010C-G		
1.Nominal cooling conditions (Test conditions are based on AHRI 1230) Indoor: 81°F.D.B./66°F.W.B. (27°C.D.B./19°C.W.B.), Water temperature: 86°F (30°C)		Unit converter BTU/h = kW x 3,412 cfm = m³/min x 35.31 lbs = kg/0.4536		
2.Nominal heating conditions (Test conditions are based on AHRI 1230) Indoor: 68°F.D.B. (20°C.D.B.), Water temperature: 68°F (20°C)		*Above specification data is subject to rounding variation.		

WY 575V

1. SPECIFICATIONS

U11 2nd

Heat Source Model		PQHY-P240ZSKMU-A			
Indoor Model		Non-Ducted		Ducted	
Power source			3-phase 3-wire 575 V ±10% 60 Hz		
Cooling capacity (Nominal)	*1	BTU/h	240,000		
		kW	70.3		
		Power input	18.17		
	(575)	Current input	20.2		
	(Rated)	BTU/h	228,000		
		kW	66.8		
	(575)	Power input	15.63	16.91	
		Current input	17.4	18.8	
Temp. range of cooling	Indoor	W.B.	59~75°F (15~24°C)		
	Circulating water	°F	50~113°F (10~45°C)		
Heating capacity (Nominal)	*2	BTU/h	270,000		
		kW	79.1		
		Power input	17.14		
	(575)	Current input	19.1		
	(Rated)	BTU/h	258,000		
		kW	75.6		
	(575)	Power input	16.78	15.95	
		Current input	18.7	17.7	
Temp. range of heating	Indoor	D.B.	59~81°F (15~27°C)		
	Circulating water	°F	50~95°F (10~35°C)		
Indoor unit connectable	Total capacity	50~130% of heat source unit capacity			
	Model/Quantity	P06~P96/2~50			
Sound pressure level (measured in anechoic room)	dB <A>	57.0			
Refrigerant piping diameter	Liquid pipe in. (mm)	5/8 (15.88) Brazed			
	Gas pipe in. (mm)	1-1/8 (28.58) Brazed			

Set Model					
Model		PQHY-P120ZKMU-A		PQHY-P120ZKMU-A	
Minimum Circuit Ampacity		A		13	
Maximum Overcurrent Protection		A		22	
Circulating water	Water flow rate	G/h	1,522 + 1,522		
		G/min (gpm)	25.4 + 25.4		
		m³/h	5.76 + 5.76		
		L/min	96 + 96		
		cfm	3.4 + 3.4		
	Pressure drop	psi	3.48	3.48	
		kPa	24	24	
	Operating volume range	G/h	1,189 + 1,189 ~ 1,902 + 1,902		
		G/min (gpm)	19.8 + 19.8 ~ 31.7 + 31.7		
		m³/h	4.5 + 4.5 ~ 7.2 + 7.2		
Compressor	Type x Quantity	Inverter scroll hermetic compressor x 1		Inverter scroll hermetic compressor x 1	
	Manufacture	AC&R Works, MITSUBISHI ELECTRIC CORPORATION		AC&R Works, MITSUBISHI ELECTRIC CORPORATION	
	Starting method	Inverter		Inverter	
	Motor output	kW	7.7	7.7	
	Case heater	kW	-	-	
	Lubricant	MEL32			
External finish	Galvanized steel sheets		Galvanized steel sheets		
External dimension H x W x D	in.	43-5/16 x 34-11/16 x 21-11/16		43-5/16 x 34-11/16 x 21-11/16	
	mm	1,100 x 880 x 550		1,100 x 880 x 550	
Protection devices	High pressure protection	High pressure sensor, High pressure switch at 4.15 MPa (601 psi)		High pressure sensor, High pressure switch at 4.15 MPa (601 psi)	
	Inverter circuit	Over-heat protection, Over-current protection		Over-heat protection, Over-current protection	
	Compressor	Over-heat protection		Over-heat protection	
Refrigerant	Type x original charge	R410A x 11 lbs + 1 oz (5.0 kg)		R410A x 11 lbs + 1 oz (5.0 kg)	
	Control	LEV and HIC circuit		LEV and HIC circuit	
Net weight	lbs (kg)	408 (185)		408 (185)	
Heat exchanger		plate type		plate type	
	Water volume in plate	G	1.32	1.32	
		I	5.0	5.0	
	Water pressure Max.	psi	290	290	
		MPa	2.0	2.0	
HIC circuit (HIC: Heat Inter-Changer)	Copper pipe, tube-in-tube structure		Copper pipe, tube-in-tube structure		
Pipe between unit and distributor	Liquid pipe in. (mm)	1/2 (12.7) Brazed		1/2 (12.7) Brazed	
	Gas pipe in. (mm)	7/8 (22.2) Brazed		7/8 (22.2) Brazed	
Drawing	External	KJ94G487		KE94C823	
Standard attachment	Wiring	KE94C823		KE94C823	
Optional parts	Document	-		Details refer to External Drw	
	Accessory	Heat Source Twinning kit: CMY-Y100CBK3 joint: CMY-Y102SS-G2, CMY-Y102LS-G2, CMY-Y202S-G2, CMY-Y302S-G2 Header: CMY-Y104/108/1010C-G			
Remarks	Details on foundation work, duct work, insulation work, electrical wiring, power source switch, and other items shall be referred to the Installation Manual. Due to continuing improvement, above specifications may be subject to change without notice. The ambient temperature of the Heat Source Unit needs to be kept below 104°F.D.B. (40°C.D.B.) The ambient relative humidity of the Heat Source Unit needs to be kept below 80%. The Heat Source Unit should not be installed at outdoor. Be sure to mount a strainer (more than 50 meshes) at the water inlet piping of the unit. Be sure to provide interlocking for the unit operation and water circuit. Install the supplied insulation material to the unused drain-socket. When installing insulation material around both water and refrigerant piping, follow the installation manual.				

Notes:		Unit converter
1.Nominal cooling conditions (Test conditions are based on AHRI 1230)		BTU/h = kW x 3,412
Indoor: 81°F.D.B./66°F.W.B. (27°C.D.B./19°C.W.B.), Water temperature: 86°F (30°C)		cfm = m³/min x 35.31
2.Nominal heating conditions (Test conditions are based on AHRI 1230)		lbs = kg/0.4536
Indoor: 68°F.D.B. (20°C.D.B.), Water temperature: 68°F (20°C)	*Above specification data is subject to rounding variation.	

1. SPECIFICATIONS

U11 2nd

Heat Source Model		PQHY-P264ZSKMU-A							
Indoor Model		Non-Ducted		Ducted					
Power source		3-phase 3-wire 575 V ±10% 60 Hz							
(Nominal)	Cooling capacity	*1	BTU/h	264,000					
			kW	77.4					
		Power input	kW	17.96					
	(575)	Current input	A	20.0					
	(Rated)		BTU/h	252,000					
			kW	73.9					
		Power input	kW	14.61	16.71				
		Current input	A	16.2	18.6				
Temp. range of cooling		Indoor	W.B.	59~75°F (15~24°C)					
		Circulating water	°F	50~113°F (10~45°C)					
(Nominal)	Heating capacity	*2	BTU/h	295,000					
			kW	86.5					
		Power input	kW	17.27					
	(575)	Current input	A	19.2					
	(Rated)		BTU/h	281,000					
			kW	82.4					
		Power input	kW	15.52	16.07				
		Current input	A	17.3	17.9				
Temp. range of heating		Indoor	D.B.	59~81°F (15~27°C)					
		Circulating water	°F	50~95°F (10~35°C)					
Indoor unit connectable	Total capacity	50~130% of heat source unit capacity							
	Model/Quantity	P06~P96/2~50							
Sound pressure level (measured in anechoic room) dB <A>									
Refrigerant piping diameter	Liquid pipe	in. (mm)	3/4 (19.05) Brazed						
	Gas pipe	in. (mm)	1-3/8 (34.93) Brazed						
Set Model									
Model		PQHY-P96ZSKMU-A	PQHY-P96ZSKMU-A	PQHY-P72ZSKMU-A					
Minimum Circuit Ampacity		A	12	12	9				
Maximum Overcurrent Protection		A	20	20	15				
Circulating water	Water flow rate	G/h	1,522 + 1,522 + 1,522						
		G/min (gpm)	25.4 + 25.4 + 25.4						
		m³/h	5.76 + 5.76 + 5.76						
		L/min	96 + 96 + 96						
		cfm	3.4 + 3.4 + 3.4						
	Pressure drop	psi	3.48	3.48	3.48				
		kPa	24	24	24				
		G/h	1,189 + 1,189 + 1,189 ~ 1,902 + 1,902 + 1,902						
		G/min (gpm)	19.8 + 19.8 + 19.8 ~ 31.7 + 31.7 + 31.7						
		m³/h	4.5 + 4.5 + 4.5 ~ 7.2 + 7.2 + 7.2						
Compressor	Type x Quantity	Inverter scroll hermetic compressor x 1	Inverter scroll hermetic compressor x 1	Inverter scroll hermetic compressor x 1					
	Manufacture	AC&R Works, MITSUBISHI ELECTRIC CORPORATION	AC&R Works, MITSUBISHI ELECTRIC CORPORATION	AC&R Works, MITSUBISHI ELECTRIC CORPORATION					
	Starting method	Inverter	Inverter	Inverter					
	Motor output	kW	6.0	6.0	4.3				
	Case heater	kW	-	-	-				
	Lubricant	MEL32	MEL32	MEL32					
External finish		Galvanized steel sheets	Galvanized steel sheets	Galvanized steel sheets					
External dimension H x W x D		in.	43-5/16 x 34-11/16 x 21-11/16	43-5/16 x 34-11/16 x 21-11/16	43-5/16 x 34-11/16 x 21-11/16				
		mm	1,100 x 880 x 550	1,100 x 880 x 550	1,100 x 880 x 550				
Protection devices	High pressure protection	High pressure sensor, High pressure switch at 4.15 MPa (601 psi)	High pressure sensor, High pressure switch at 4.15 MPa (601 psi)	High pressure sensor, High pressure switch at 4.15 MPa (601 psi)					
	Inverter circuit	Over-heat protection, Over-current protection	Over-heat protection, Over-current protection	Over-heat protection, Over-current protection					
	Compressor	Over-heat protection	Over-heat protection	Over-heat protection					
Refrigerant	Type x original charge	R410A x 11 lbs + 1 oz (5.0 kg)			R410A x 11 lbs + 1 oz (5.0 kg)				
	Control	LEV and HIC circuit							
Net weight	lbs (kg)	408 (185)	408 (185)	408 (185)					
Heat exchanger	plate type		plate type	plate type					
	Water volume in plate	G	1.32	1.32	1.32				
		I	5.0	5.0	5.0				
	Water pressure Max.	psi	290	290	290				
		MPa	2.0	2.0	2.0				
HIC circuit (HIC: Heat Inter-Changer)									
Pipe between unit and distributor	Liquid pipe	in. (mm)	3/8 (9.52) Brazed	3/8 (9.52) Brazed	3/8 (9.52) Brazed				
	Gas pipe	in. (mm)	7/8 (22.2) Brazed	7/8 (22.2) Brazed	7/8 (22.2) Brazed				
Drawing	External	KJ94G488							
	Wiring	KE94C823			KE94C823				
Standard attachment	Document	-							
	Accessory	Details refer to External Drw							
Optional parts		Heat Source Twinning kit: CMY-Y300CBK2 joint: CMY-Y102SS-G2, CMY-Y102LS-G2, CMY-Y202S-G2, CMY-Y302S-G2 Header: CMY-Y104/108/1010C-G							
Remarks									
<p>Details on foundation work, duct work, insulation work, electrical wiring, power source switch, and other items shall be referred to the Installation Manual.</p> <p>Due to continuing improvement, above specifications may be subject to change without notice.</p> <p>The ambient temperature of the Heat Source Unit needs to be kept below 104°F.D.B. (40°C.D.B.).</p> <p>The ambient relative humidity of the Heat Source Unit needs to be kept below 80%.</p> <p>The Heat Source Unit should not be installed at outdoor.</p> <p>Be sure to mount a strainer (more than 50 meshes) at the water inlet piping of the unit.</p> <p>Be sure to provide interlocking for the unit operation and water circuit.</p> <p>Install the supplied insulation material to the unused drain-socket.</p> <p>When installing insulation material around both water and refrigerant piping, follow the installation manual.</p>									

Notes:

- Nominal cooling conditions (Test conditions are based on AHRI 1230)
Indoor: 81°F.D.B./66°F.W.B. (27°C.D.B./19°C.W.B.), Water temperature: 86°F (30°C)
- Nominal heating conditions (Test conditions are based on AHRI 1230)
Indoor: 68°F.D.B. (20°C.D.B.), Water temperature: 68°F (20°C)

Unit converter

BTU/h = kW x 3,412
cfm = m³/min x 35.31
lbs = kg/0.4536

*Above specification data is subject to rounding variation.

WY 575V

1. SPECIFICATIONS

U11 2nd

Heat Source Model		PQHY-P288ZSKMU-A							
Indoor Model		Non-Ducted		Ducted					
Power source		3-phase 3-wire 575 V ±10% 60 Hz							
(Nominal)	Cooling capacity *1		BTU/h	288,000					
	kW			84.4					
	Power input		kW	19.98					
	(575) Current input		A	22.2					
	(Rated)		BTU/h	275,000					
			kW	80.6					
	Power input		kW	16.42					
	(575) Current input		A	18.3					
Temp. range of cooling	Indoor		W.B.	59~75°F (15~24°C)					
	Circulating water		°F	50~113°F (10~45°C)					
	Heating capacity *2		BTU/h	323,000					
	kW			94.7					
	(Nominal)		Power input	19.55					
	(575)		Current input	21.8					
	(Rated)		BTU/h	308,000					
			kW	90.3					
(575)	Power input		kW	17.31					
	Current input		A	19.3					
	Temp. range of heating		D.B.	59~81°F (15~27°C)					
Indoor unit connectable		Circulating water		50~95°F (10~35°C)					
Total capacity		50~130% of heat source unit capacity							
Model/Quantity		P06-P96/2~50							
Sound pressure level (measured in anechoic room)		dB <A>							
Refrigerant piping diameter		53.0							
Liquid pipe	in. (mm)	3/4 (19.05) Brazed							
Gas pipe	in. (mm)	1-3/8 (34.93) Brazed							
Set Model									
Model		PQHY-P96ZSKMU-A	PQHY-P96ZSKMU-A	PQHY-P96ZSKMU-A					
Minimum Circuit Ampacity		A	12	12					
Maximum Overcurrent Protection		A	20	20					
Circulating water	Water flow rate		G/h						
			1,522 + 1,522 + 1,522						
			25.4 + 25.4 + 25.4						
			5.76 + 5.76 + 5.76						
			96 + 96 + 96						
			3.4 + 3.4 + 3.4						
	Pressure drop		psi	3.48					
			kPa	24					
Operating volume range	G/h		1,189 + 1,189 + 1,189 ~ 1,902 + 1,902 + 1,902						
	G/min (gpm)		19.8 + 19.8 + 19.8 ~ 31.7 + 31.7 + 31.7						
	m³/h		4.5 + 4.5 + 4.5 ~ 7.2 + 7.2 + 7.2						
Compressor		Inverter scroll hermetic compressor x 1							
Type x Quantity		Inverter scroll hermetic compressor x 1							
Manufacture		AC&R Works, MITSUBISHI ELECTRIC CORPORATION							
Starting method		Inverter							
Motor output	kW	6.0							
Case heater	kW	-							
Lubricant		MEL32							
External finish		Galvanized steel sheets							
External dimension H x W x D		in.	43-5/16 x 34-11/16 x 21-11/16	43-5/16 x 34-11/16 x 21-11/16					
		mm	1,100 x 880 x 550	1,100 x 880 x 550					
Protection devices	High pressure protection		High pressure sensor, High pressure switch at 4.15 MPa (601 psi)	High pressure sensor, High pressure switch at 4.15 MPa (601 psi)					
	Inverter circuit		Over-heat protection, Over-current protection	Over-heat protection, Over-current protection					
	Compressor		Over-heat protection	Over-heat protection					
Refrigerant		R410A x 11 lbs + 1 oz (5.0 kg)							
Type x original charge		R410A x 11 lbs + 1 oz (5.0 kg)							
Control		LEV and HIC circuit							
Net weight		lbs (kg)	408 (185)	408 (185)					
Heat exchanger		plate type		plate type					
	Water volume in plate		G	1.32					
			I	5.0					
	Water pressure Max.		psi	290					
			MPa	2.0					
HIC circuit (HIC: Heat Inter-Changer)		Copper pipe, tube-in-tube structure							
Pipe between unit and distributor	Liquid pipe		3/8 (9.52) Brazed	3/8 (9.52) Brazed					
	Gas pipe		7/8 (22.2) Brazed	7/8 (22.2) Brazed					
Drawing	External		KJ94G488						
	Wiring		KE94C823	KE94C823					
Standard attachment	Document		-						
	Accessory		Details refer to External Drw						
Optional parts		Heat Source Twinning kit: CMY-Y300CBK2 joint: CMY-Y102SS-G2, CMY-Y102LS-G2, CMY-Y202S-G2, CMY-Y302S-G2 Header: CMY-Y104/108/1010C-G							
Remarks		Details on foundation work, duct work, insulation work, electrical wiring, power source switch, and other items shall be referred to the Installation Manual. Due to continuing improvement, above specifications may be subject to change without notice. The ambient temperature of the Heat Source Unit needs to be kept below 104°F.D.B. (40°C.D.B.) The ambient relative humidity of the Heat Source Unit needs to be kept below 80%. The Heat Source Unit should not be installed at outdoor. Be sure to mount a strainer (more than 50 meshes) at the water inlet piping of the unit. Be sure to provide interlocking for the unit operation and water circuit. Install the supplied insulation material to the unused drain-socket. When installing insulation material around both water and refrigerant piping, follow the installation manual.							
Notes:									
1.Nominal cooling conditions (Test conditions are based on AHRI 1230) Indoor: 81°F.D.B./66°F.W.B. (27°C.D.B./19°C.W.B.), Water temperature: 86°F (30°C) 2.Nominal heating conditions (Test conditions are based on AHRI 1230) Indoor: 68°F.D.B. (20°C.D.B.), Water temperature: 68°F (20°C)									
Unit converter									
BTU/h = kW × 3,412 cfm = m³/min × 35.31 lbs = kg/0.4536									
*Above specification data is subject to rounding variation.									

1. SPECIFICATIONS

U11 2nd

Heat Source Model		PQHY-P312ZSKMU-A				
Indoor Model		Non-Ducted		Ducted		
Power source		3-phase 3-wire 575 V ±10% 60 Hz				
Cooling capacity (Nominal)	*1	BTU/h	312,000			
		kW	91.4			
	(575)	Power input	22.41			
		Current input	25.0			
	(Rated)	BTU/h	297,000			
		kW	87.0			
		Power input	19.28	20.85		
		Current input	21.5	23.2		
Temp. range of cooling	Indoor	W.B.	59~75°F (15~24°C)			
	Circulating water	°F	50~113°F (10~45°C)			
	(Nominal)	BTU/h	350,000			
		kW	102.6			
Heating capacity (Nominal)	(575)	Power input	21.52			
		Current input	24.0			
		BTU/h	334,000			
		kW	97.9			
	(575)	Power input	20.10	20.02		
		Current input	22.4	22.3		
		Indoor	59~81°F (15~27°C)			
		Circulating water	50~95°F (10~35°C)			
Indoor unit connectable	Total capacity	50~130% of heat source unit capacity				
	Model/Quantity	P06~P96/2~50				
Sound pressure level (measured in anechoic room)		dB <A>	56.0			
Refrigerant piping diameter	Liquid pipe	in. (mm)	3/4 (19.05) Brazed			
	Gas pipe	in. (mm)	1-3/8 (34.93) Brazed			
Set Model						
Model		PQHY-P120ZSKMU-A	PQHY-P96ZSKMU-A	PQHY-P96ZSKMU-A		
Minimum Circuit Ampacity		A	13	12		
Maximum Overcurrent Protection		A	22	20		
Circulating water	Water flow rate	G/h	1,522 + 1,522 + 1,522			
		G/min (gpm)	25.4 + 25.4 + 25.4			
		m³/h	5.76 + 5.76 + 5.76			
		L/min	96 + 96 + 96			
		cfm	3.4 + 3.4 + 3.4			
	Pressure drop	psi	3.48	3.48		
		kPa	24	24		
	Operating volume range	G/h	1,189 + 1,189 + 1,189 ~ 1,902 + 1,902 + 1,902			
		G/min (gpm)	19.8 + 19.8 + 19.8 ~ 31.7 + 31.7 + 31.7			
		m³/h	4.5 + 4.5 + 4.5 ~ 7.2 + 7.2 + 7.2			
Compressor	Type x Quantity	Inverter scroll hermetic compressor x 1	Inverter scroll hermetic compressor x 1	Inverter scroll hermetic compressor x 1		
	Manufacture	AC&R Works, MITSUBISHI ELECTRIC CORPORATION	AC&R Works, MITSUBISHI ELECTRIC CORPORATION	AC&R Works, MITSUBISHI ELECTRIC CORPORATION		
	Starting method	Inverter	Inverter	Inverter		
	Motor output	kW	7.7	6.0		
	Case heater	kW	-	-		
	Lubricant	MEL32	MEL32	MEL32		
External finish		Galvanized steel sheets	Galvanized steel sheets	Galvanized steel sheets		
External dimension H x W x D	in.	43-5/16 x 34-11/16 x 21-11/16	43-5/16 x 34-11/16 x 21-11/16	43-5/16 x 34-11/16 x 21-11/16		
	mm	1,100 x 880 x 550	1,100 x 880 x 550	1,100 x 880 x 550		
Protection devices	High pressure protection		High pressure sensor, High pressure switch at 4.15 MPa (601 psi)	High pressure sensor, High pressure switch at 4.15 MPa (601 psi)		
	Inverter circuit		Over-heat protection, Over-current protection	Over-heat protection, Over-current protection		
	Compressor		Over-heat protection	Over-heat protection		
Refrigerant	Type x original charge	R410A x 11 lbs + 1 oz (5.0 kg)		R410A x 11 lbs + 1 oz (5.0 kg)		
	Control	LEV and HIC circuit				
Net weight	lbs (kg)	408 (185)	408 (185)	408 (185)		
Heat exchanger	plate type		plate type	plate type		
	Water volume in plate	G	1.32	1.32		
		I	5.0	5.0		
	Water pressure Max.	psi	290	290		
		MPa	2.0	2.0		
HIC circuit (HIC: Heat Inter-Changer)		Copper pipe, tube-in-tube structure	Copper pipe, tube-in-tube structure	Copper pipe, tube-in-tube structure		
Pipe between unit and distributor	Liquid pipe	in. (mm)	1/2 (12.7) Brazed	1/2 (12.7) Brazed		
	Gas pipe	in. (mm)	7/8 (22.2) Brazed	7/8 (22.2) Brazed		
Drawing	External	KJ94G488				
	Wiring	KE94C823	KE94C823	KE94C823		
Standard attachment	Document	-				
	Accessory	Details refer to External Drw				
Optional parts		Heat Source Twinning kit: CMY-Y300CBK2 joint: CMY-Y102SS-G2, CMY-Y102LS-G2, CMY-Y202S-G2, CMY-Y302S-G2 Header: CMY-Y104/108/1010C-G				
Remarks		Details on foundation work, duct work, insulation work, electrical wiring, power source switch, and other items shall be referred to the Installation Manual. Due to continuing improvement, above specifications may be subject to change without notice. The ambient temperature of the Heat Source Unit needs to be kept below 104°F.D.B. (40°C.D.B.) The ambient relative humidity of the Heat Source Unit needs to be kept below 80%. The Heat Source Unit should not be installed at outdoor. Be sure to mount a strainer (more than 50 meshes) at the water inlet piping of the unit. Be sure to provide interlocking for the unit operation and water circuit. Install the supplied insulation material to the unused drain-socket. When installing insulation material around both water and refrigerant piping, follow the installation manual.				
Notes:						
1.Nominal cooling conditions (Test conditions are based on AHRI 1230) Indoor: 81°F.D.B./66°F.W.B. (27°C.D.B./19°C.W.B.), Water temperature: 86°F (30°C)		Unit converter				
2.Nominal heating conditions (Test conditions are based on AHRI 1230) Indoor: 68°F.D.B. (20°C.D.B.), Water temperature: 68°F (20°C)		BTU/h = kW x 3,412 cfm = m³/min x 35.31 lbs = kg/0.4536				
		*Above specification data is subject to rounding variation.				

1. SPECIFICATIONS

U11 2nd

Heat Source Model			PQHY-P336ZSKMU-A				
Indoor Model			Non-Ducted				
Power source			3-phase 3-wire 575 V ±10% 60 Hz				
Cooling capacity (Nominal)	*1	BTU/h	336,000				
		kW	98.5				
(575)	Power input	kW	24.86				
	Current input	A	27.7				
(Rated)			320,000				
		BTU/h	93.8				
(575)	Power input	kW	22.51	23.13			
	Current input	A	25.1	25.8			
Temp. range of cooling			59~75°F (15~24°C)				
Indoor			50~113°F (10~45°C)				
Circulating water							
Heating capacity (Nominal)			378,000				
	*2	BTU/h					
		kW	110.8				
(575)	Power input	kW	23.68				
	Current input	A	26.4				
(Rated)			361,000				
		BTU/h	105.8				
(575)	Power input	kW	23.32	22.03			
	Current input	A	26.0	24.5			
Temp. range of heating			59~81°F (15~27°C)				
Indoor			50~95°F (10~35°C)				
Circulating water							
Indoor unit connectable			50~130% of heat source unit capacity				
Model/Quantity			P06~P96/2~50				
Sound pressure level (measured in anechoic room)			57.5				
Refrigerant piping diameter	Liquid pipe	in. (mm)	3/4 (19.05) Brazed				
	Gas pipe	in. (mm)	1~5/8 (41.28) Brazed				
Set Model							
Model			PQHY-P120ZKMU-A	PQHY-P120ZKMU-A			
Minimum Circuit Ampacity			13	13			
Maximum Overcurrent Protection			22	22			
Circulating water	Water flow rate	G/h	1,522 + 1,522 + 1,522				
		G/min (gpm)	25.4 + 25.4 + 25.4				
		m³/h	5.76 + 5.76 + 5.76				
		L/min	96 + 96 + 96				
	Pressure drop	cfm	3.4 + 3.4 + 3.4				
		psi	3.48	3.48			
		kPa	24	24			
Operating volume range	G/h	1,189 + 1,189 + 1,189 ~ 1,902 + 1,902 + 1,902	1,189 + 1,189 + 1,189 ~ 1,902 + 1,902 + 1,902				
		G/min (gpm)	19.8 + 19.8 + 19.8 ~ 31.7 + 31.7 + 31.7				
		m³/h	4.5 + 4.5 + 4.5 ~ 7.2 + 7.2 + 7.2				
	Pressure drop	psi	3.48	3.48			
Compressor	Type x Quantity	Inverter scroll hermetic compressor x 1	Inverter scroll hermetic compressor x 1	Inverter scroll hermetic compressor x 1			
	Manufacture	AC&R Works, MITSUBISHI ELECTRIC CORPORATION	AC&R Works, MITSUBISHI ELECTRIC CORPORATION	AC&R Works, MITSUBISHI ELECTRIC CORPORATION			
	Starting method	Inverter	Inverter	Inverter			
	Motor output	kW	7.7	7.7			
	Case heater	kW	-	-			
	Lubricant	MEL32	MEL32	MEL32			
External finish							
External dimension H x W x D			Galvanized steel sheets	Galvanized steel sheets			
	in.	43.5/16 x 34.11/16 x 21-11/16	43.5/16 x 34-11/16 x 21-11/16	43.5/16 x 34-11/16 x 21-11/16			
	mm	1,100 x 880 x 550	1,100 x 880 x 550	1,100 x 880 x 550			
Protection devices	High pressure protection		High pressure sensor, High pressure switch at 4.15 MPa (601 psi)	High pressure sensor, High pressure switch at 4.15 MPa (601 psi)			
	Inverter circuit		Over-heat protection, Over-current protection	Over-heat protection, Over-current protection			
	Compressor		Over-heat protection	Over-heat protection			
Refrigerant	Type x original charge	R410A x 11 lbs + 1 oz (5.0 kg)	R410A x 11 lbs + 1 oz (5.0 kg)	R410A x 11 lbs + 1 oz (5.0 kg)			
	Control	LEV and HIC circuit					
Net weight			408 (185)	408 (185)			
Heat exchanger	lbs (kg)		plate type	plate type			
	Water volume in plate	G	1.32	1.32			
		I	5.0	5.0			
	Water pressure Max.	psi	290	290			
		MPa	2.0	2.0			
HIC circuit (HIC: Heat Inter-Changer)							
Pipe between unit and distributor	Liquid pipe	in. (mm)	Copper pipe, tube-in-tube structure	Copper pipe, tube-in-tube structure			
	Gas pipe	in. (mm)	1/2 (12.7) Brazed	1/2 (12.7) Brazed			
Drawing	External		7/8 (22.2) Brazed	7/8 (22.2) Brazed			
	Wiring		KJ94G488				
Standard attachment	Document	KE94C823	KE94C823	KE94C823			
	Accessory						
Optional parts							
Remarks							
<p>Notes:</p> <p>1. Nominal cooling conditions (Test conditions are based on AHRI 1230) Indoor: 81°F.D.B./66°F.W.B. (27°C.D.B./19°C.W.B.), Water temperature: 86°F (30°C)</p> <p>2. Nominal heating conditions (Test conditions are based on AHRI 1230) Indoor: 68°F.D.B. (20°C.D.B.), Water temperature: 68°F (20°C)</p> <p>Details on foundation work, duct work, insulation work, electrical wiring, power source switch, and other items shall be referred to the Installation Manual.</p> <p>Due to continuing improvement, above specifications may be subject to change without notice.</p> <p>The ambient temperature of the Heat Source Unit needs to be kept below 104°F.D.B. (40°C.D.B.)</p> <p>The ambient relative humidity of the Heat Source Unit needs to be kept below 80%.</p> <p>The Heat Source Unit should not be installed at outdoor.</p> <p>Be sure to mount a strainer (more than 50 meshes) at the water inlet piping of the unit.</p> <p>Be sure to provide interlocking for the unit operation and water circuit.</p> <p>Install the supplied insulation material to the unused drain-socket.</p> <p>When installing insulation material around both water and refrigerant piping, follow the installation manual.</p>							
<p>Unit converter</p> <table border="0"> <tr> <td>BTU/h = kW x 3,412</td> </tr> <tr> <td>cfm = m³/min x 35.31</td> </tr> <tr> <td>lbs = kg/0.4536</td> </tr> </table> <p>*Above specification data is subject to rounding variation.</p>					BTU/h = kW x 3,412	cfm = m³/min x 35.31	lbs = kg/0.4536
BTU/h = kW x 3,412							
cfm = m³/min x 35.31							
lbs = kg/0.4536							

1. SPECIFICATIONS

U11 2nd

Heat Source Model			PQHY-P360ZSKMU-A						
Indoor Model			Non-Ducted	Ducted					
Power source	3-phase 3-wire 575 V ±10% 60 Hz								
Cooling capacity (Nominal)	*1		BTU/h	360,000					
			kW	105.5					
	Power input		kW	27.35					
	(575)		Current input	30.5					
	(Rated)	BTU/h		342,000					
			kW	100.2					
		Power input		26.39	25.45				
Temp. range of cooling	(575)		Current input	29.4	28.3				
	Indoor	W.B.	59~75°F (15~24°C)						
Circulating water		°F	50~113°F (10~45°C)						
Heating capacity (Nominal)	*2		BTU/h	405,000					
			kW	118.7					
	Power input		kW	25.75					
	(575)		Current input	28.7					
	(Rated)	BTU/h		387,000					
			kW	113.4					
		Power input		26.85	23.96				
Temp. range of heating	(575)		Current input	29.9	26.7				
	Indoor	D.B.	59~81°F (15~27°C)						
Circulating water		°F	50~95°F (10~35°C)						
Indoor unit connectable	Total capacity	50~130% of heat source unit capacity							
Model/Quantity			P06~P96/2~50						
Sound pressure level (measured in anechoic room)	dB <A>	59.0							
Refrigerant piping diameter	Liquid pipe	in. (mm)	3/4 (19.05) Brazed						
	Gas pipe	in. (mm)	1-5/8 (41.28) Brazed						
Set Model									
Model	PQHY-P120ZKMU-A		PQHY-P120ZKMU-A	PQHY-P120ZKMU-A					
Minimum Circuit Ampacity	A	13	13	13					
Maximum Overcurrent Protection	A	22	22	22					
Circulating water	Water flow rate	G/h	1,522 + 1,522 + 1,522						
		G/min (gpm)	25.4 + 25.4 + 25.4						
		m³/h	5.76 + 5.76 + 5.76						
		L/min	96 + 96 + 96						
		cfm	3.4 + 3.4 + 3.4						
	Pressure drop	psi	3.48	3.48	3.48				
		kPa	24	24	24				
		G/h	1,189 + 1,189 + 1,189 ~ 1,902 + 1,902 + 1,902						
		G/min (gpm)	19.8 + 19.8 + 19.8 ~ 31.7 + 31.7 + 31.7						
		m³/h	4.5 + 4.5 + 4.5 ~ 7.2 + 7.2 + 7.2						
Compressor	Type x Quantity	Inverter scroll hermetic compressor x 1		Inverter scroll hermetic compressor x 1	Inverter scroll hermetic compressor x 1				
	Manufacture	AC&R Works, MITSUBISHI ELECTRIC CORPORATION		AC&R Works, MITSUBISHI ELECTRIC CORPORATION	AC&R Works, MITSUBISHI ELECTRIC CORPORATION				
	Starting method	Inverter		Inverter	Inverter				
	Motor output	KW	7.7	7.7	7.7				
	Case heater	KW	-	-	-				
Lubricant		MEL32		MEL32					
External finish	Galvanized steel sheets								
External dimension H x W x D	in.	43-5/16 x 34-11/16 x 21-11/16			43-5/16 x 34-11/16 x 21-11/16				
	mm	1,100 x 880 x 550			1,100 x 880 x 550				
Protection devices	High pressure protection		High pressure sensor, High pressure switch at 4.15 MPa (601 psi)	High pressure sensor, High pressure switch at 4.15 MPa (601 psi)	High pressure sensor, High pressure switch at 4.15 MPa (601 psi)				
	Inverter circuit		Over-heat protection, Over-current protection	Over-heat protection, Over-current protection	Over-heat protection, Over-current protection				
	Compressor		Over-heat protection						
Refrigerant	Type x original charge	R410A x 11 lbs + 1 oz (5.0 kg)		R410A x 11 lbs + 1 oz (5.0 kg)	R410A x 11 lbs + 1 oz (5.0 kg)				
	Control	LEV and HIC circuit							
Net weight	lbs (kg)	408 (185)	408 (185)	408 (185)					
Heat exchanger	plate type		plate type		plate type				
	Water volume in plate	G	1.32	1.32	1.32				
		I	5.0	5.0	5.0				
	Water pressure Max.	psi	290	290	290				
		MPa	2.0	2.0	2.0				
HIC circuit (HIC: Heat Inter-Changer)		Copper pipe, tube-in-tube structure		Copper pipe, tube-in-tube structure	Copper pipe, tube-in-tube structure				
Pipe between unit and distributor	Liquid pipe	in. (mm)	1/2 (12.7) Brazed	1/2 (12.7) Brazed	1/2 (12.7) Brazed				
	Gas pipe	in. (mm)	7/8 (22.2) Brazed	7/8 (22.2) Brazed	7/8 (22.2) Brazed				
Drawing	External	KJ94G488							
	Wiring	KE94C823		KE94C823	KE94C823				
Standard attachment	Document								
	Accessory	Details refer to External Drw							
Optional parts		Heat Source Twinning kit: CMY-Y300CBK2 joint: CMY-Y102SS-G2, CMY-Y102LS-G2, CMY-Y202S-G2, CMY-Y302S-G2 Header: CMY-Y104/108/1010C-G							
Remarks	Details on foundation work, duct work, insulation work, electrical wiring, power source switch, and other items shall be referred to the Installation Manual. Due to continuing improvement, above specifications may be subject to change without notice. The ambient temperature of the Heat Source Unit needs to be kept below 104°F.D.B. (40°C.D.B.) The ambient relative humidity of the Heat Source Unit needs to be kept below 80%. The Heat Source Unit should not be installed at outdoor. Be sure to mount a strainer (more than 50 meshes) at the water inlet piping of the unit. Be sure to provide interlocking for the unit operation and water circuit. Install the supplied insulation material to the unused drain-socket. When installing insulation material around both water and refrigerant piping, follow the installation manual.								
Notes:									
1.Nominal cooling conditions (Test conditions are based on AHRI 1230) Indoor: 81°F.D.B./66°F.W.B. (27°C.D.B./19°C.W.B.), Water temperature: 86°F (30°C)									
2.Nominal heating conditions (Test conditions are based on AHRI 1230) Indoor: 68°F.D.B. (20°C.D.B.), Water temperature: 68°F (20°C)									
			Unit converter						
			BTU/h	=kW x 3,412					
			cfm	=m³/min x 35.31					
			lbs	=kg/0.4536					
					*Above specification data is subject to rounding variation.				

2. EXTERNAL DIMENSIONS


U11 2nd

PQHY-P72, 96, 120ZKMU-A

Unit : mm(in)

<Accessories>

- Refrigerant (Liquid) conn. pipe ••••• 1pc.
(P72/P96/P120 - Packaged in the accessory kit)
- Refrigerant (Gas) conn. pipe ••••• 1pc.
(P72 : Packaged in the accessory kit)
- Refrigerant (Gas) conn. elbow ••••• 1pc.
(P72/P96/P120 - Packaged in the accessory kit)
- Water stopper(Liquid, Gas) ••••• 1pc. each
(P72/P96/P120 - Packaged in the accessory kit)
- Sealing material for water stopper (Liquid, Gas) ••••• 1pc. each
(P72/P96/P120 - Packaged in the accessory kit)
- Sealing material for field piping (Liquid Gas) ••••• 1pc. each
(P72/P96/P120 - Packaged in the accessory kit)
- Sealing material for drain socket ••••• 1pc.
(P72/P96/P120 - Packaged in the accessory kit)
- Pipe cover for gas ••••• 1pc.
(P72/P96/P120 - Packaged in the accessory kit)

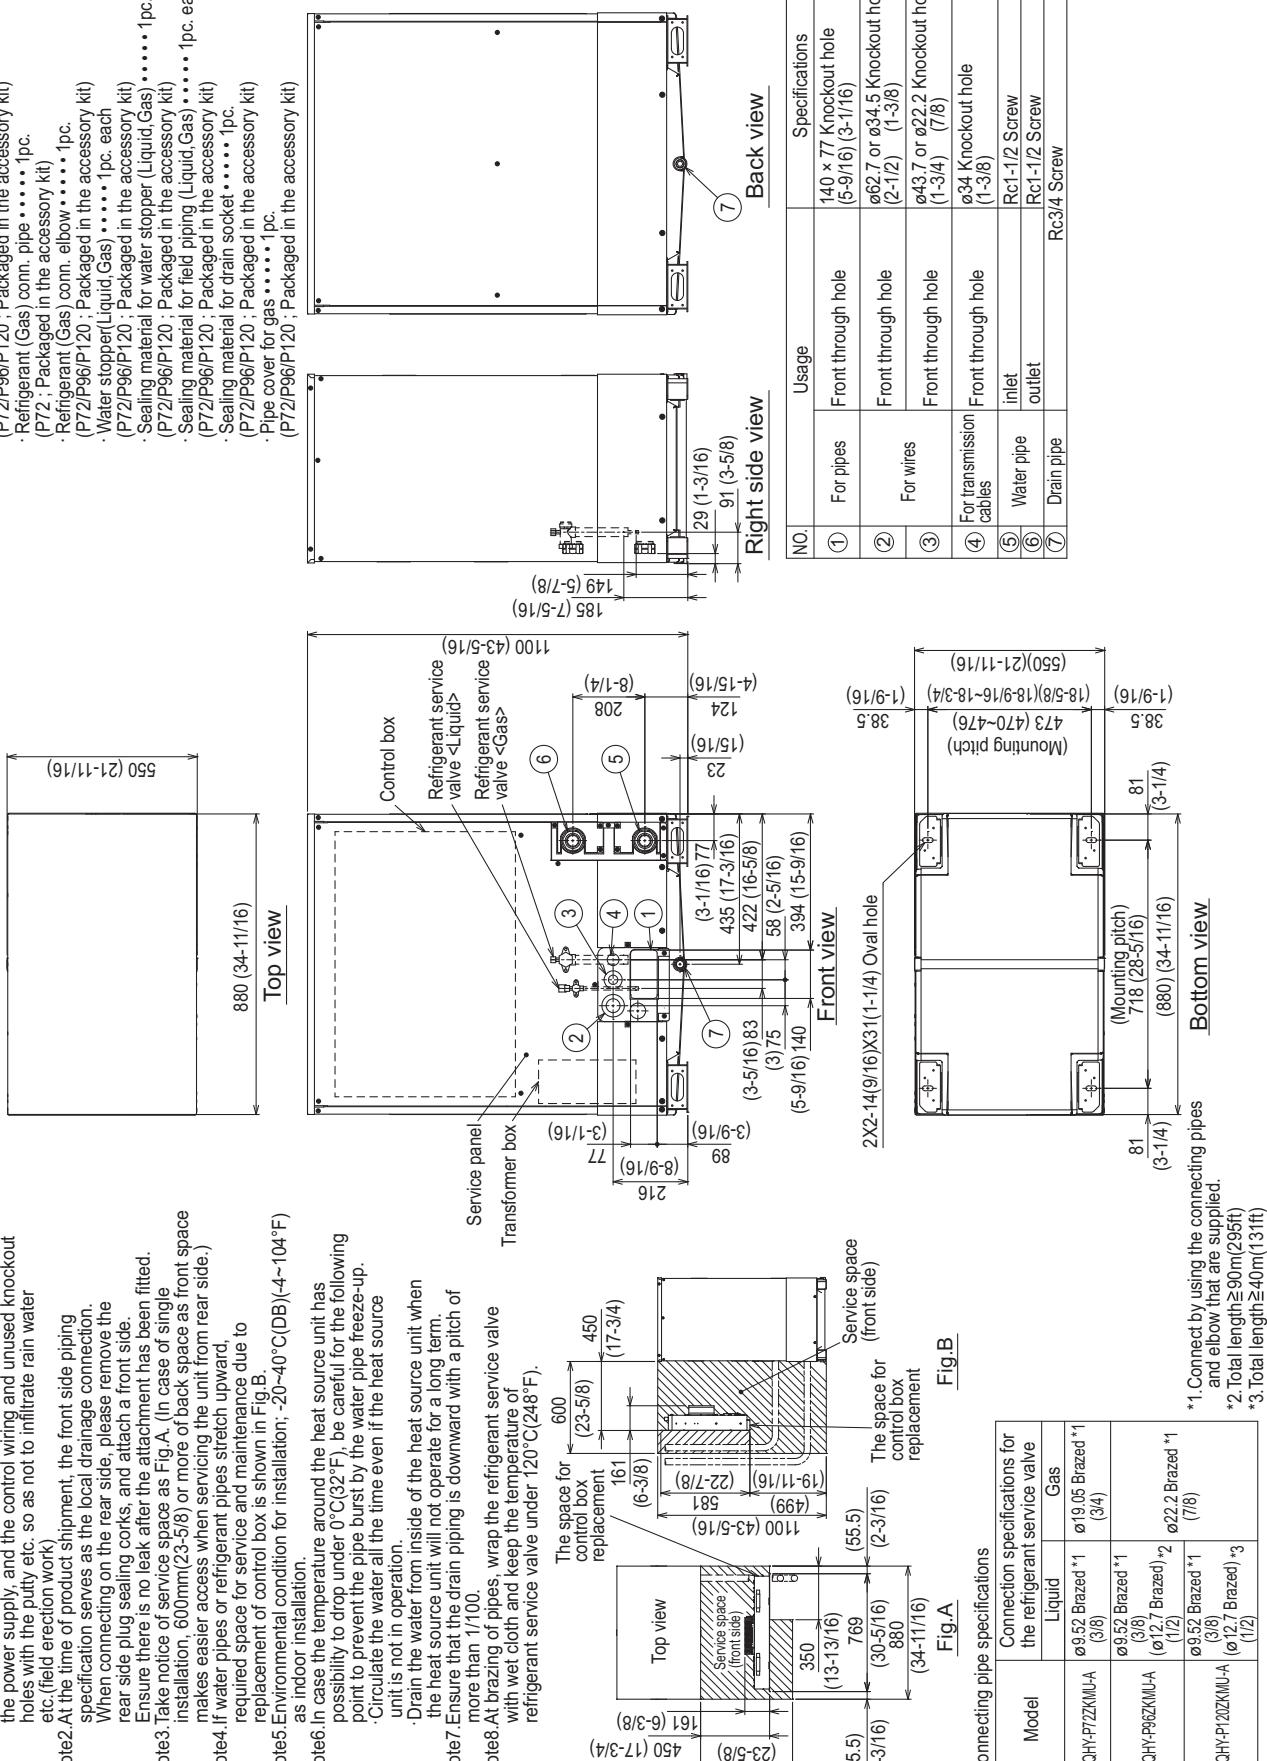


2. EXTERNAL DIMENSIONS

U11 2nd

PQHY-P144, 168, 192, 216, 240ZSKMU-A

Unit : mm(in)

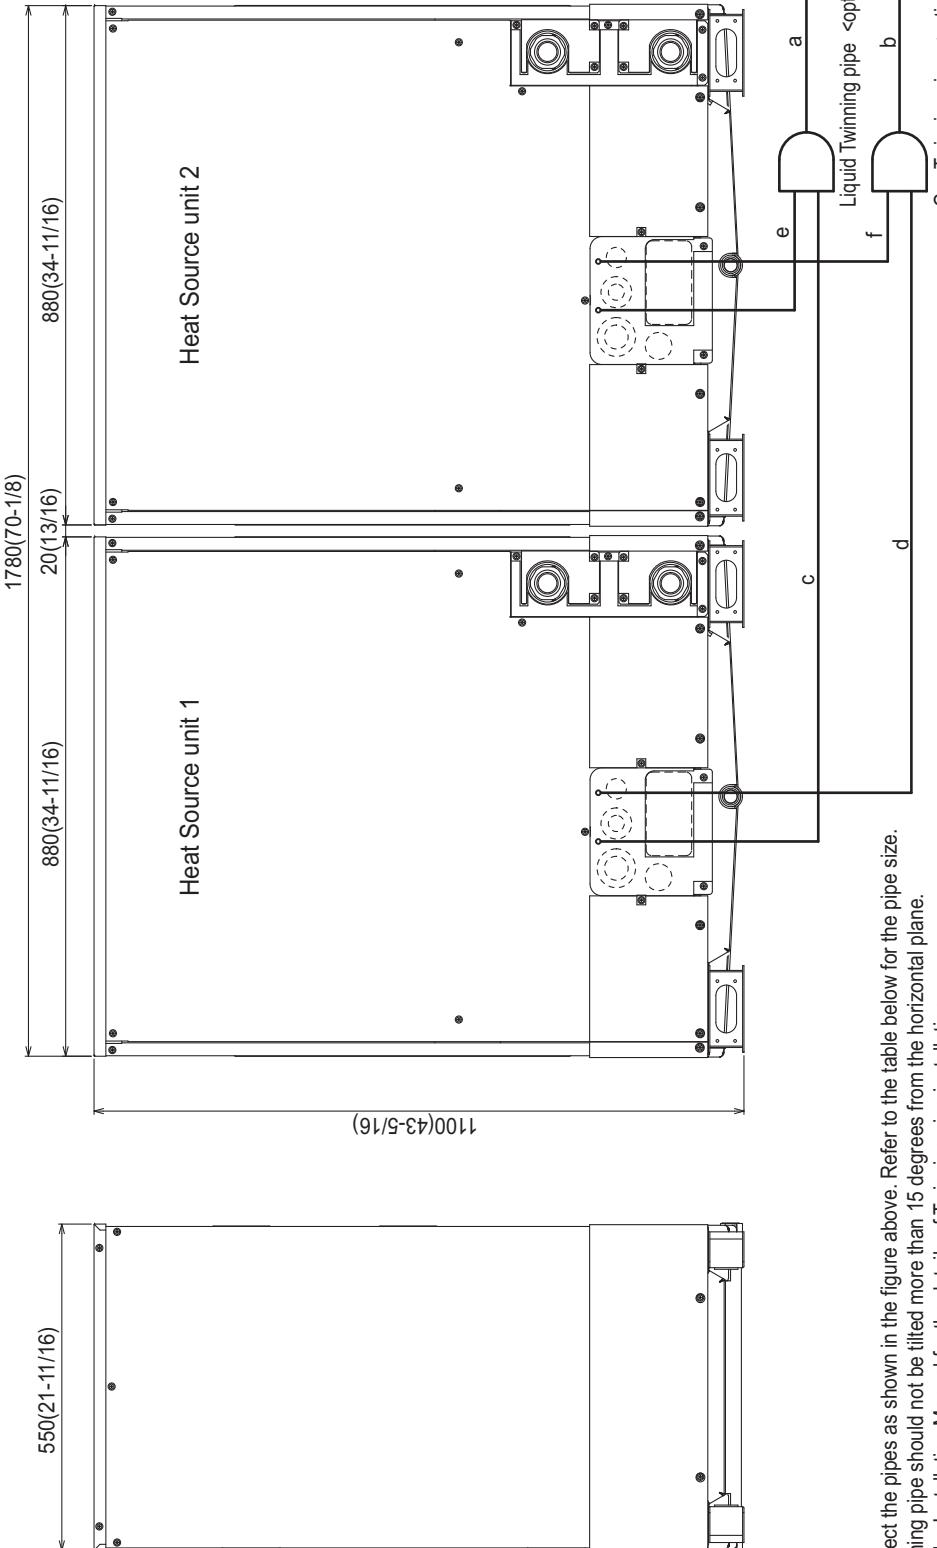

Note 1. Connect the pipes as shown in the figure above. Refer to the table below for the pipe size.

2. Twinning pipe should not be tilted more than 15 degrees from the horizontal plane.

3. See the Installation Manual for the details of Twinning pipe installation.

4. The pipe section before the Twinning pipe (sections "a" and "b" in the figure) must have at least 500mm(19-11/16) of straight section (*including the straight pipe that is supplied with the Twinning pipe).

5. Only use the Twinning pipe by Mitsubishi (optional parts).

Twinning pipe connection size


Package unit name	PQHY-P144ZSKMU-A	PQHY-P168ZSKMU-A	PQHY-P192ZSKMU-A	PQHY-P216ZSKMU-A	PQHY-P240ZSKMU-A
Component unit name	Heat Source unit 1	Heat Source unit 1	Heat Source unit 2	Heat Source unit 2	Indoor unit
Twinning pipe Kit(optional parts)					
Indoor unit~Twinning pipe	Liquid a Gas b	Ø12.7(1/2) Ø28.58(1-1/8)			
Twinning pipe~Heat Source unit 1	Liquid c Gas d	Ø19.05(3/4) Ø9.52(3/8)			Ø12.7(1/2) Ø22.27(7/8)
Twinning pipe~Heat Source unit 2	Liquid e Gas f	Ø19.05(3/4) Ø9.52(3/8)			Ø12.7(1/2) Ø22.27(7/8)

2. EXTERNAL DIMENSIONS

U11 2nd


PQHY-P264,288,312,336,360ZSKMU-A

Unit : mm(in)

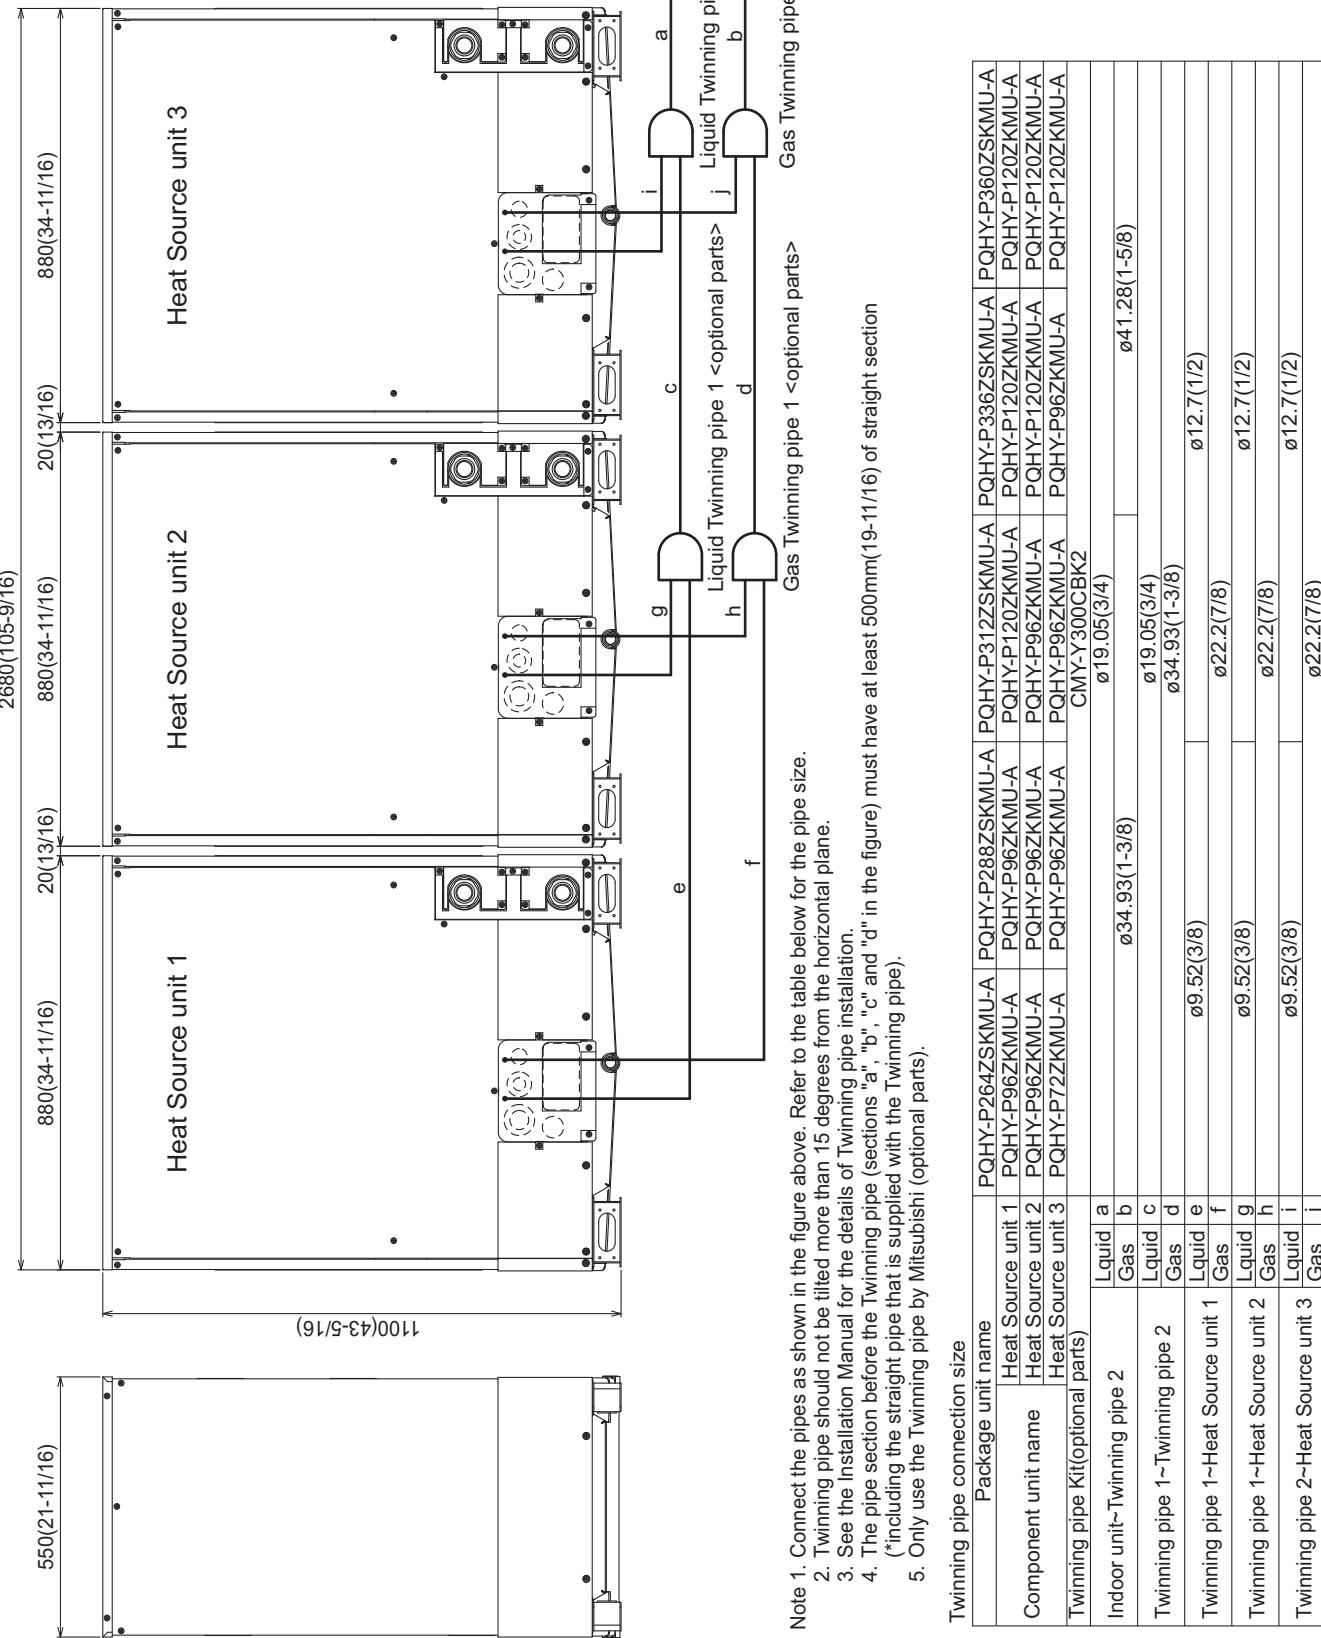

PQHY-P72, 96, 120ZKMU-A


Unit : mm[in.]



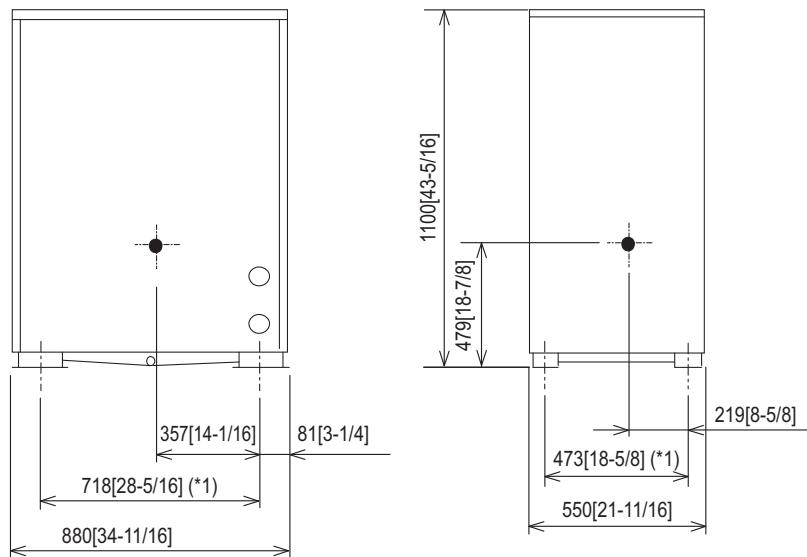


4. ELECTRICAL WIRING DIAGRAMS

U11 2nd


PQHY-P72, 96, 120ZKMU-A






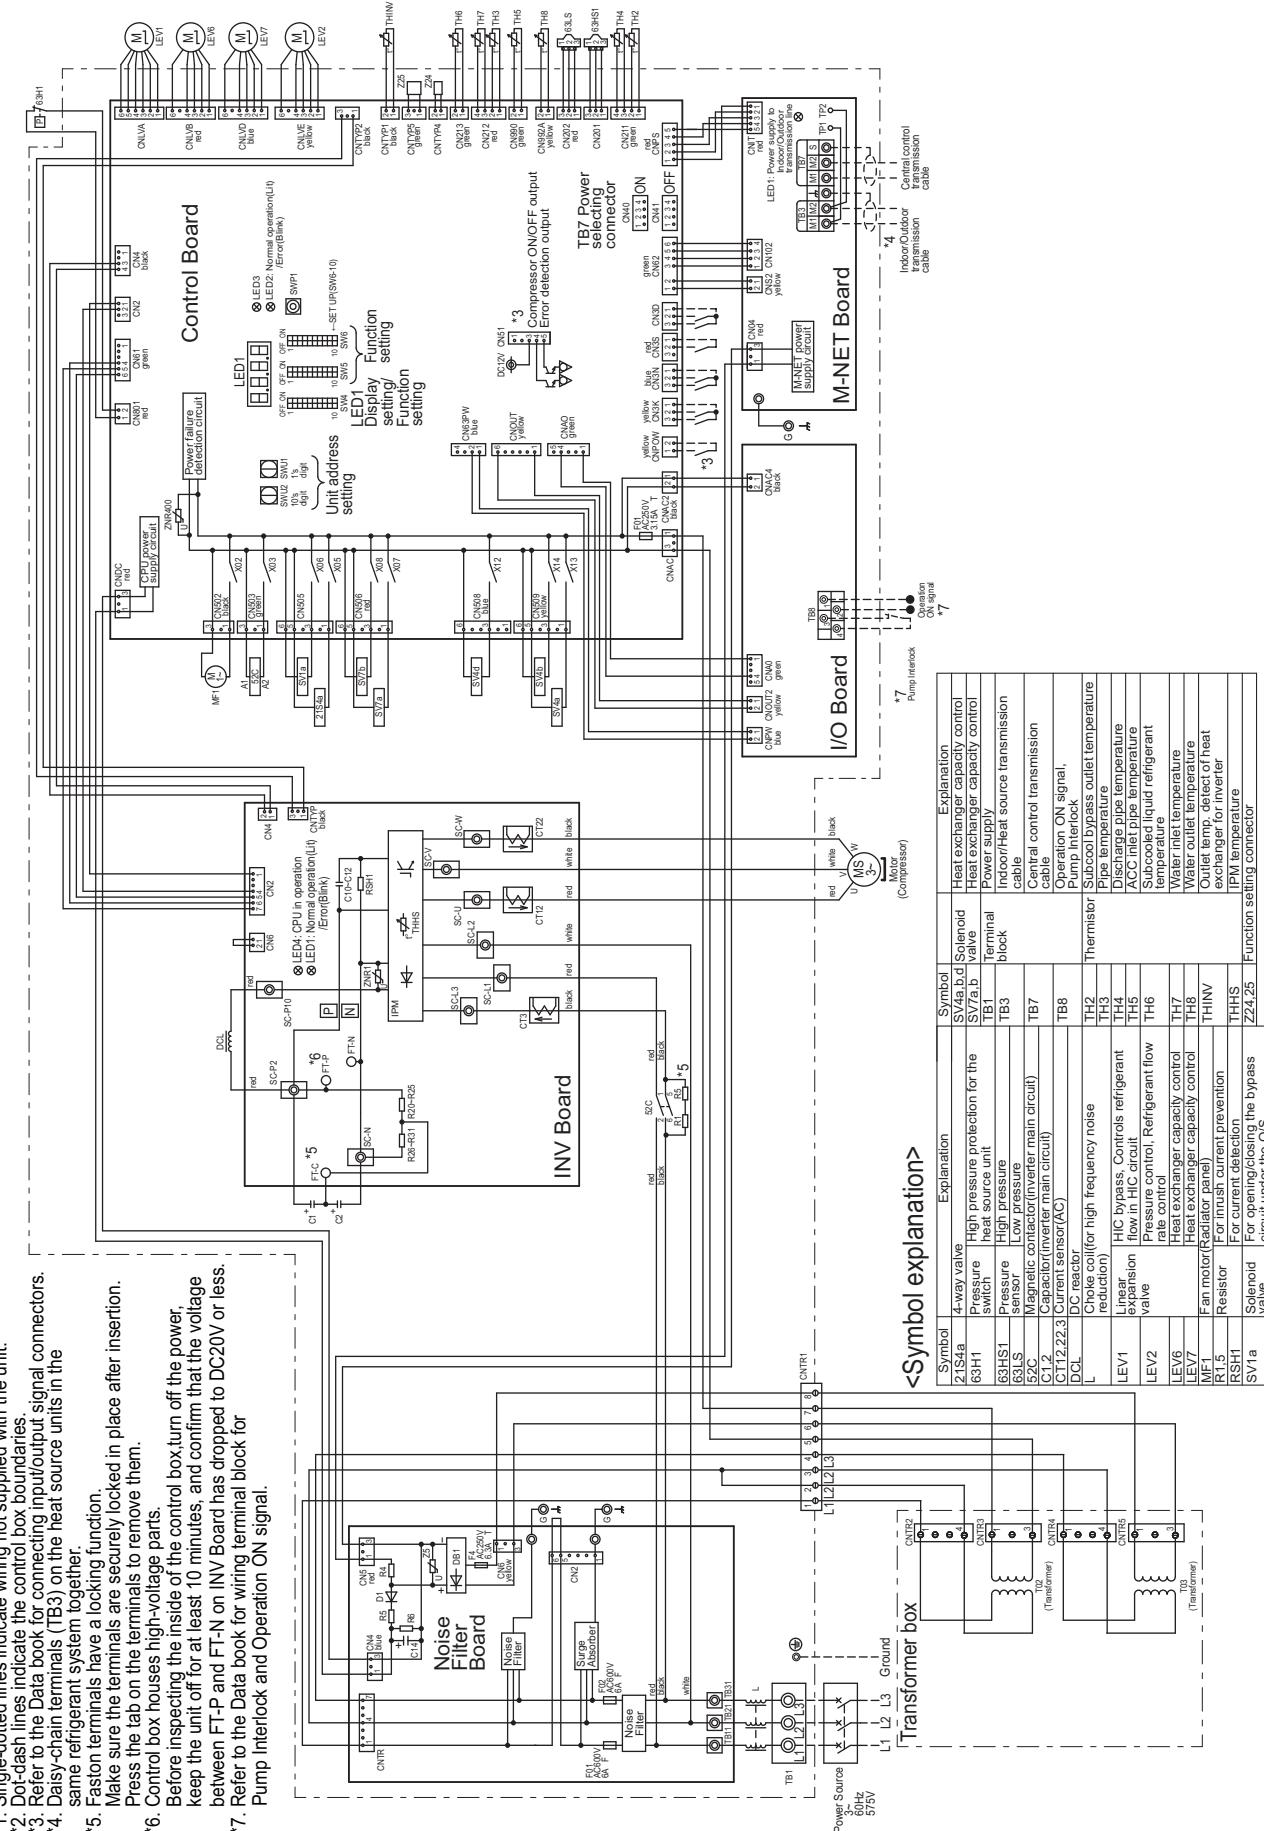


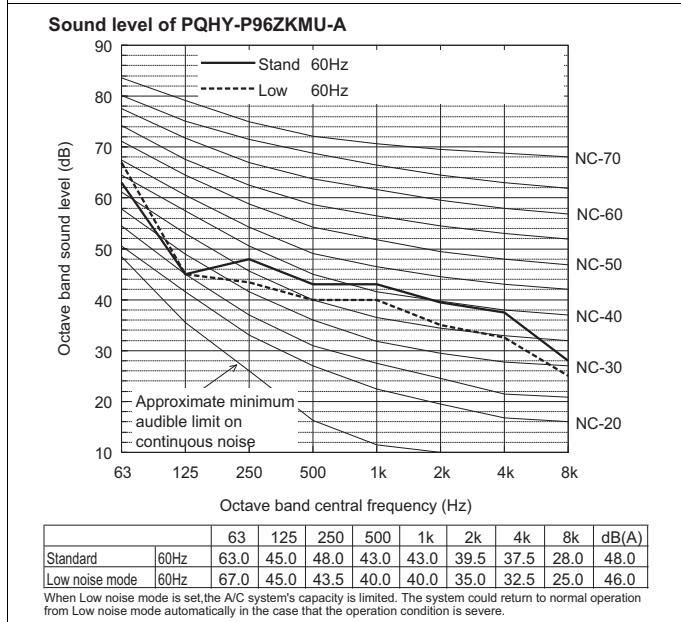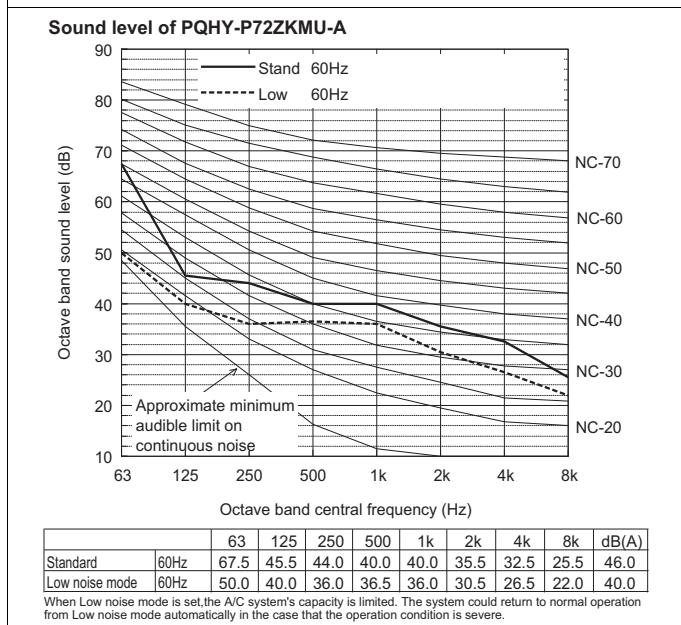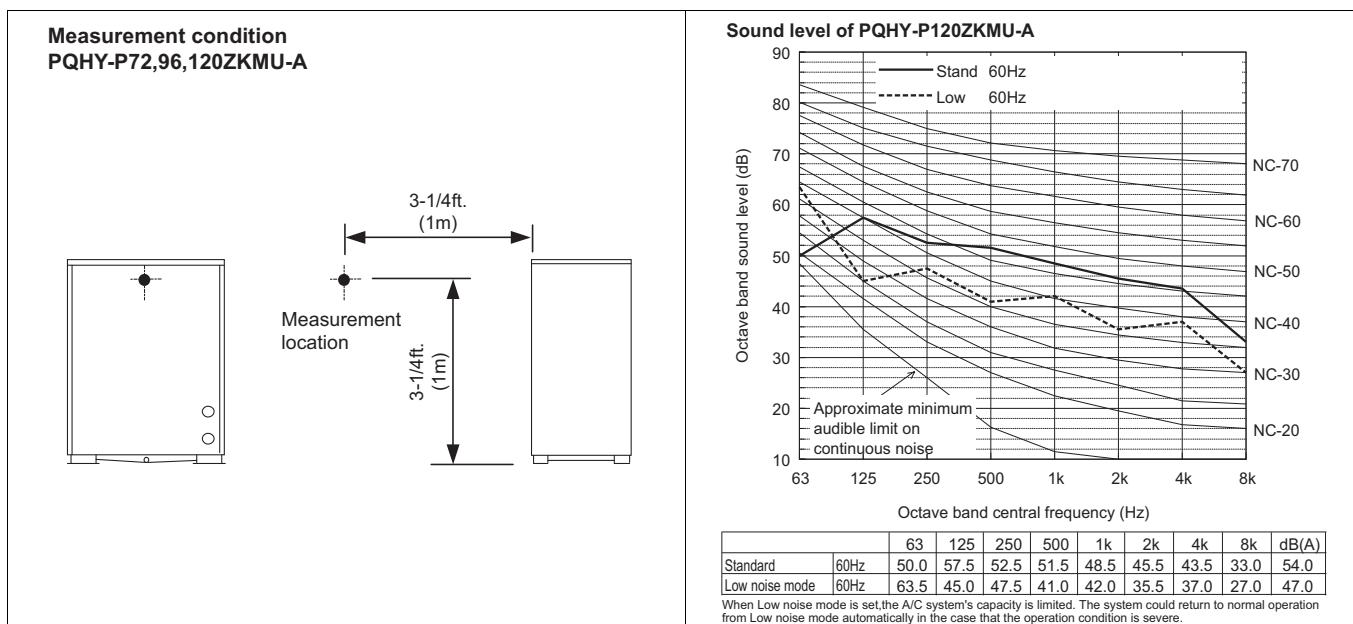

5. SOUND LEVELS

U11 2nd




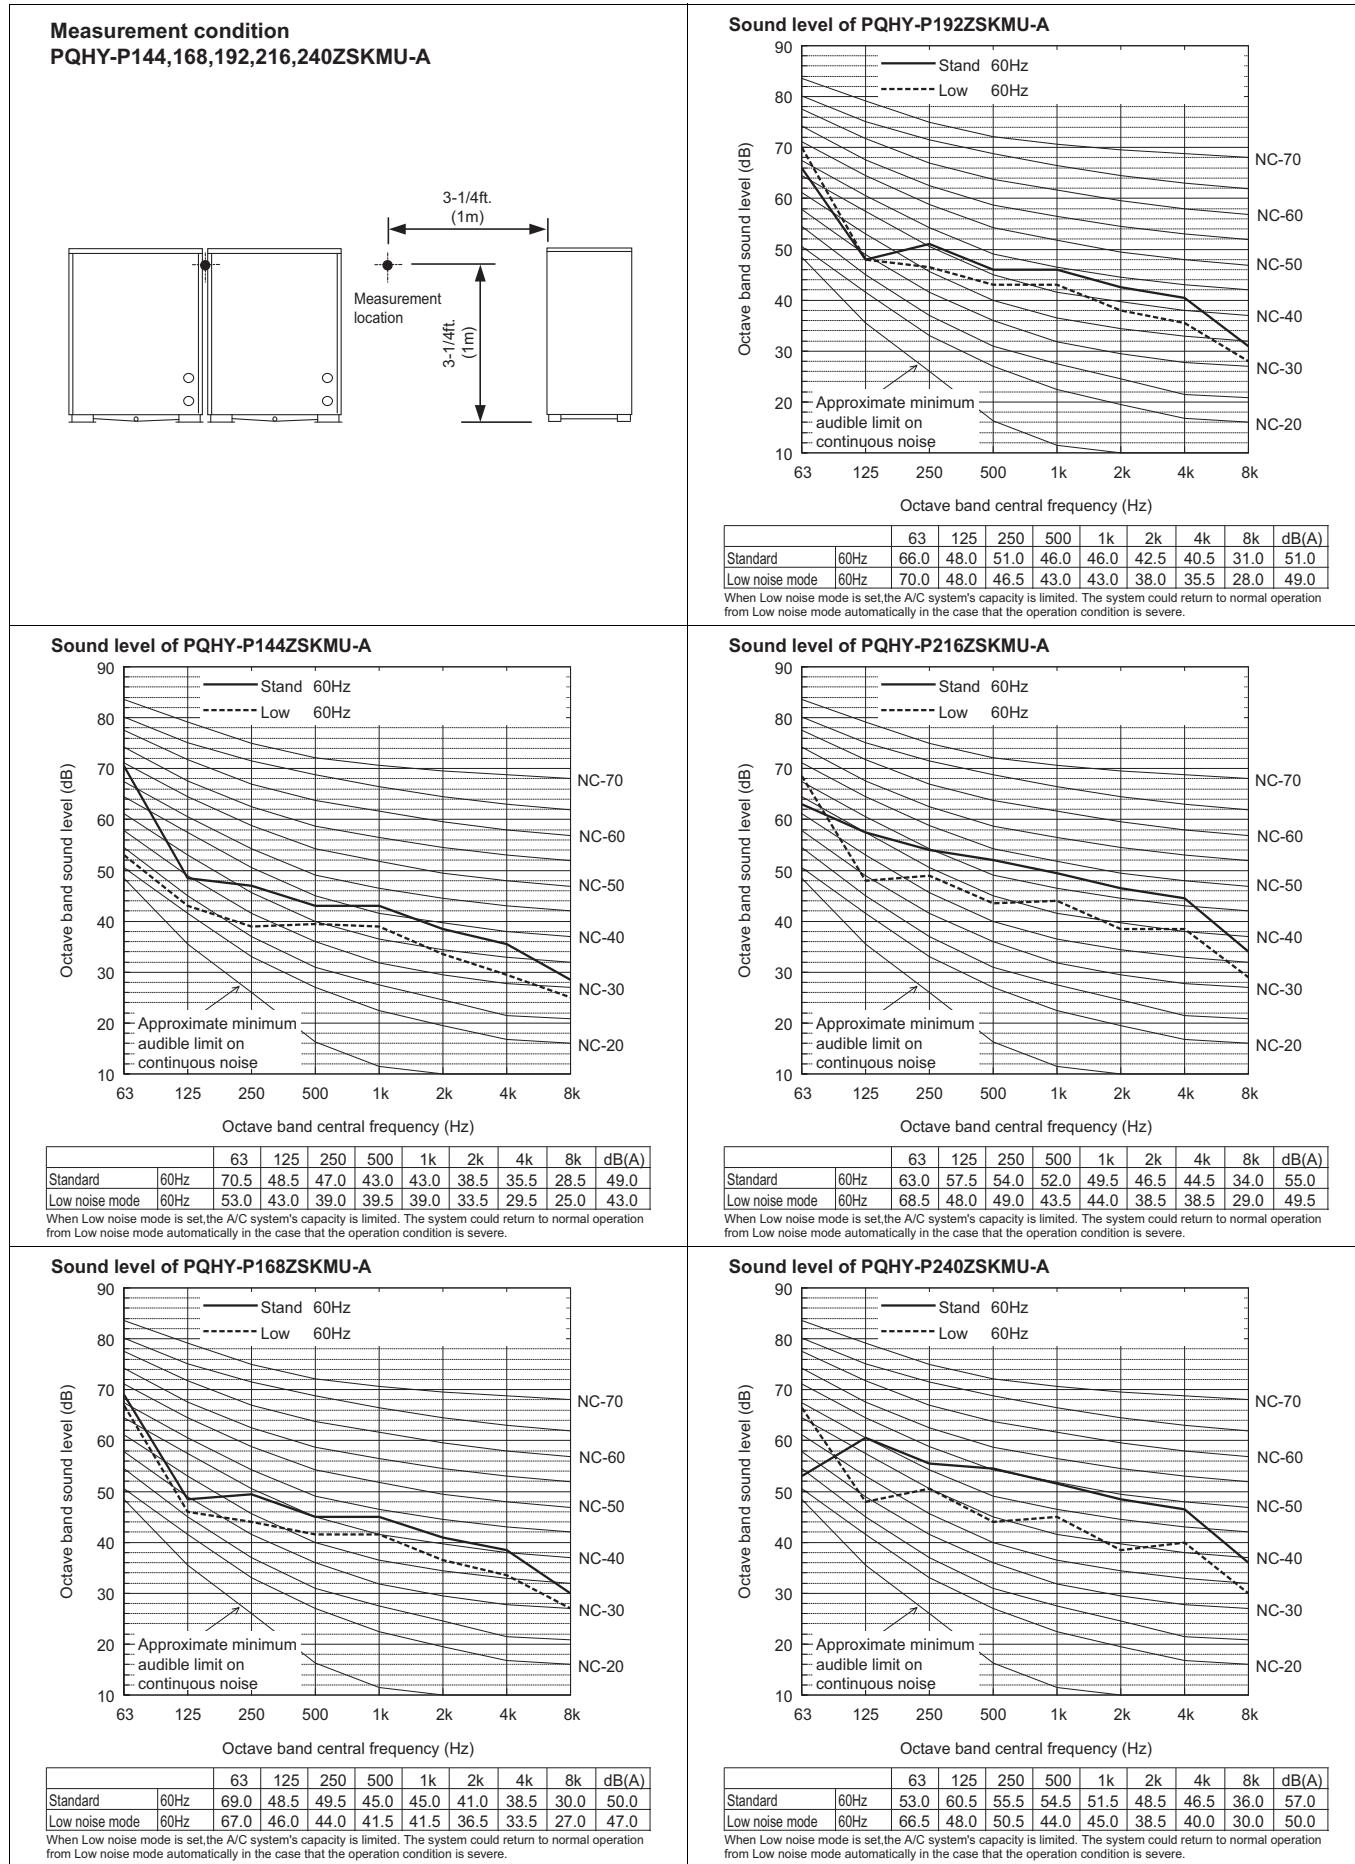


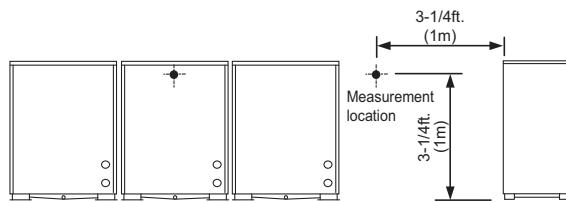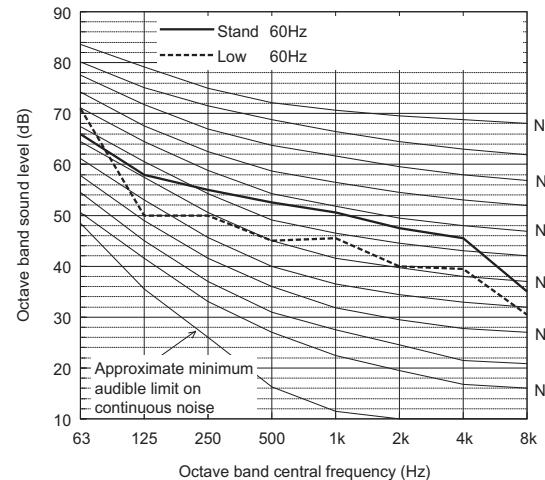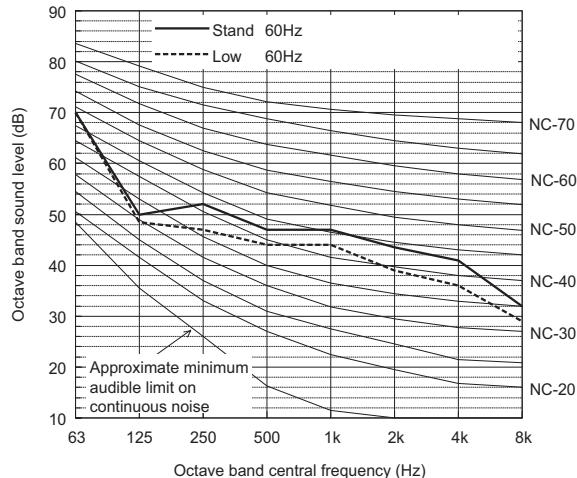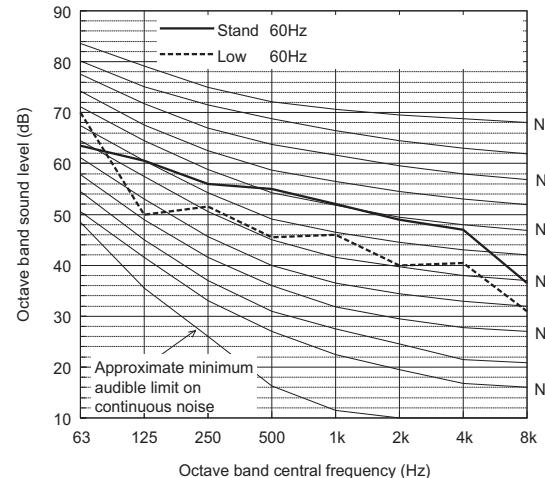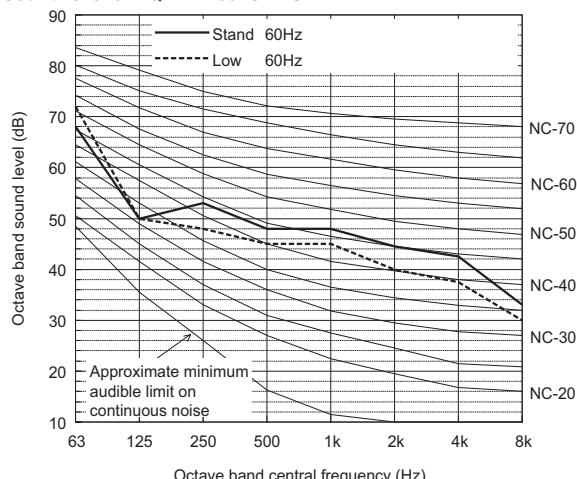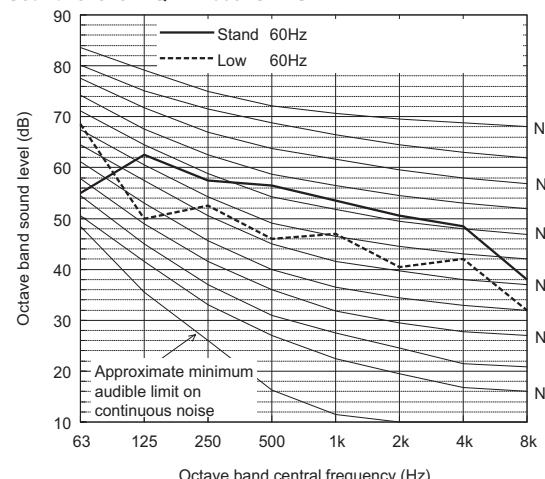Measurement condition
PQHY-P264,288,312,336,360ZSKMU-A
**Sound level of PQHY-P312ZSKMU-A****Sound level of PQHY-P264ZSKMU-A****Sound level of PQHY-P336ZSKMU-A****Sound level of PQHY-P288ZSKMU-A****Sound level of PQHY-P360ZSKMU-A**





6-1. Correction by temperature

CITY MULTI could have various capacities at different designing temperatures. Using the nominal cooling/heating capacity values and the ratios below, the capacity can be found for various temperatures.

PQHY-		P72ZKMU			
Nominal Cooling Capacity	kW	21.1	Rated Cooling Capacity	kW	20.2
BTU/h	72,000 <th>BTU/h</th> <td></td> <th>BTU/h</th> <td>69,000</td>	BTU/h		BTU/h	69,000
Input	kW	3.75	Input	kW	(Non-Ducted) 2.96 (Ducted) 3.49

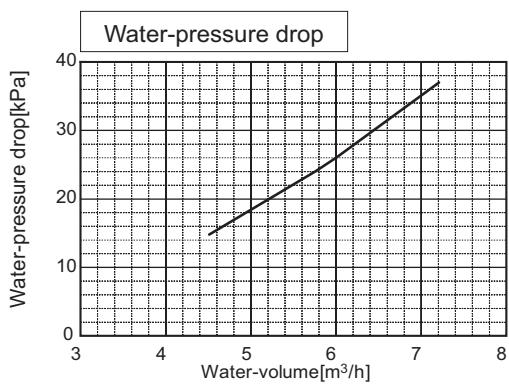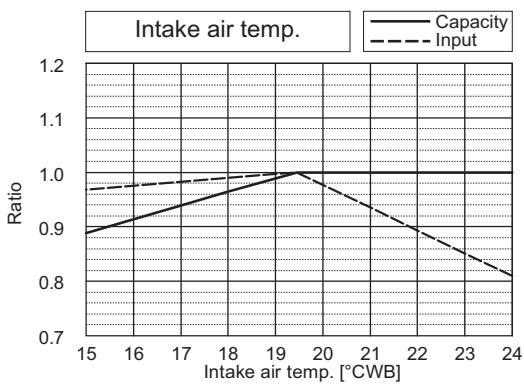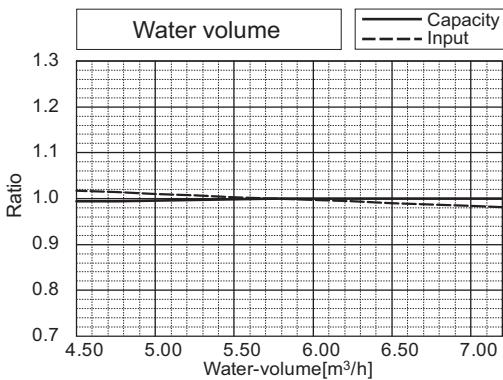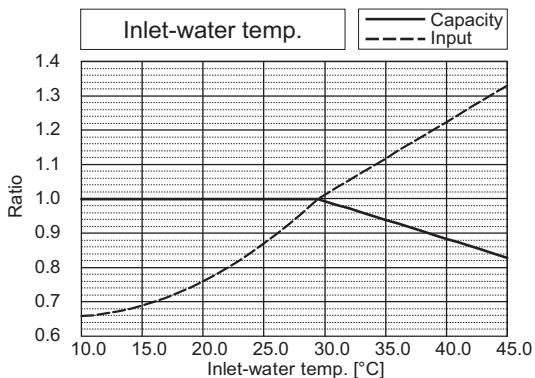



PQHY-		P72ZKMU			
Nominal Heating Capacity	kW	23.4	Rated Heating Capacity	kW	22.3
BTU/h	80,000 <th>BTU/h</th> <td></td> <th>BTU/h</th> <td>76,000</td>	BTU/h		BTU/h	76,000
Input	kW	3.93	Input	kW	(Non-Ducted) 3.48 (Ducted) 3.66

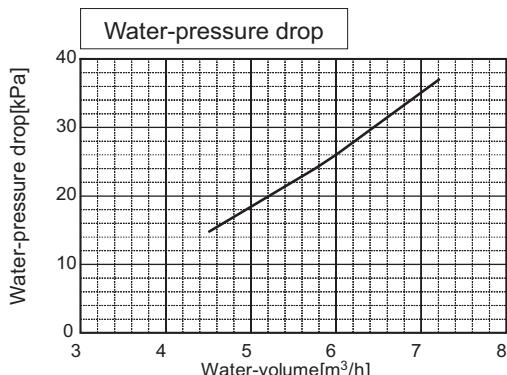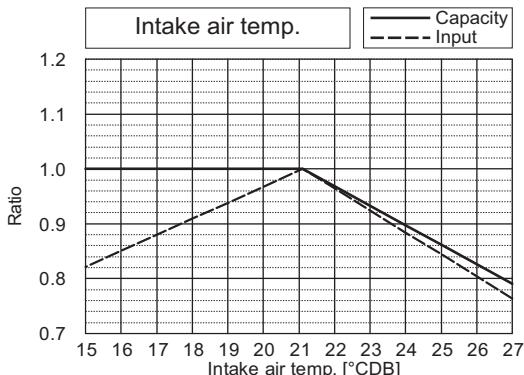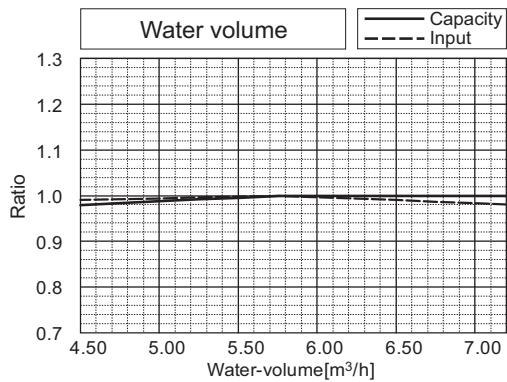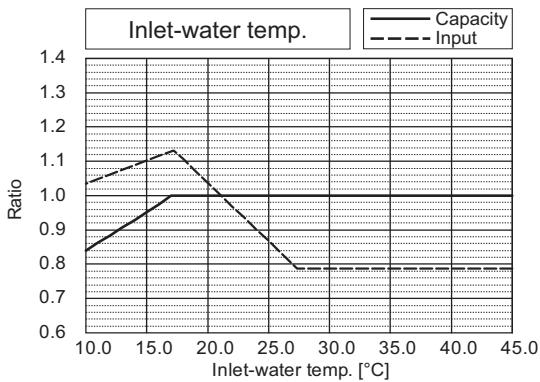





6. CAPACITY TABLES

U11 2nd

PQHY-		P96ZKMU			
Nominal Cooling Capacity	kW	28.1	Rated Cooling Capacity	kW	27.0
	BTU/h	96,000		BTU/h	92,000
Input	kW	5.93	Input	kW	(Non-Ducted) 4.26 (Ducted) 5.52

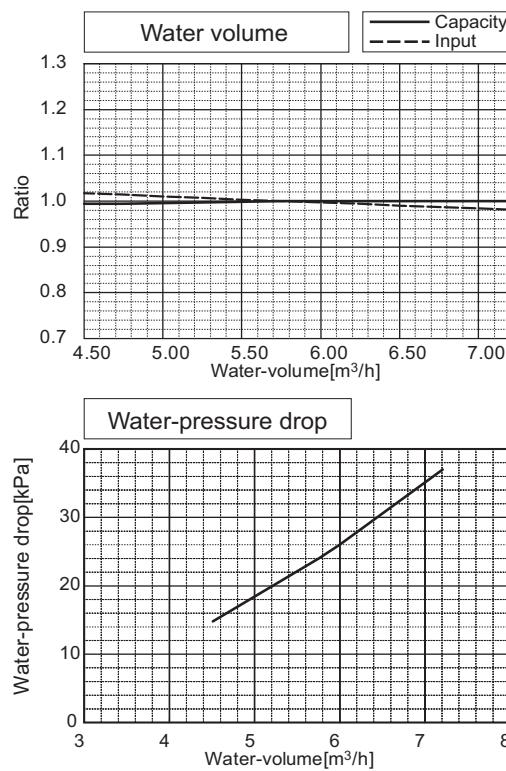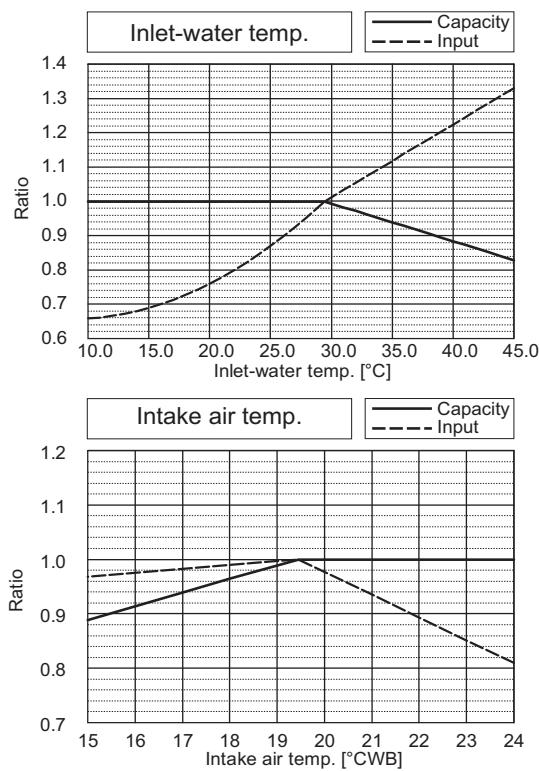



PQHY-		P96ZKMU			
Nominal Heating Capacity	kW	31.7	Rated Heating Capacity	kW	30.2
	BTU/h	108,000		BTU/h	103,000
Input	kW	6.17	Input	kW	(Non-Ducted) 4.87 (Ducted) 5.74

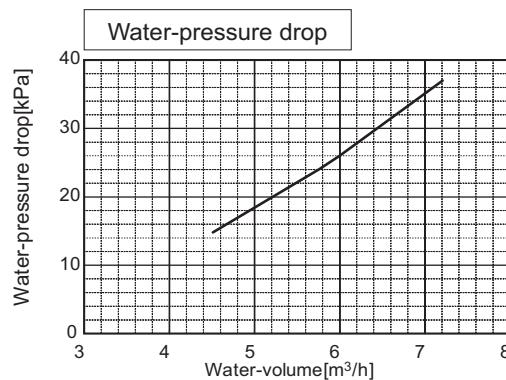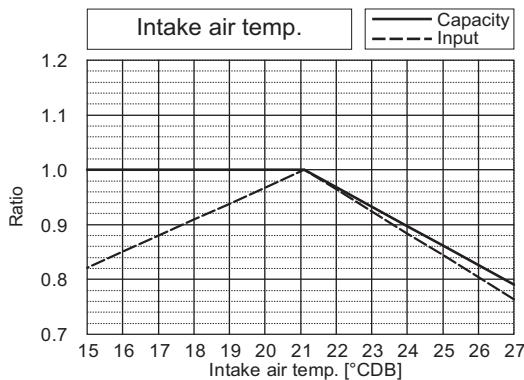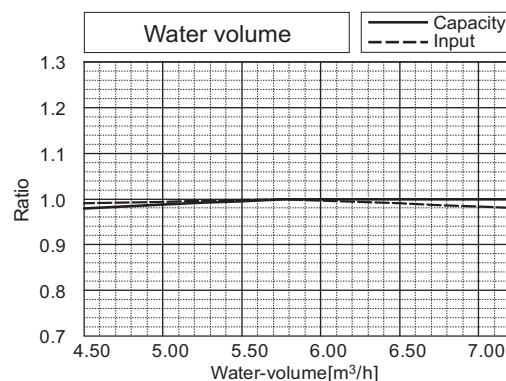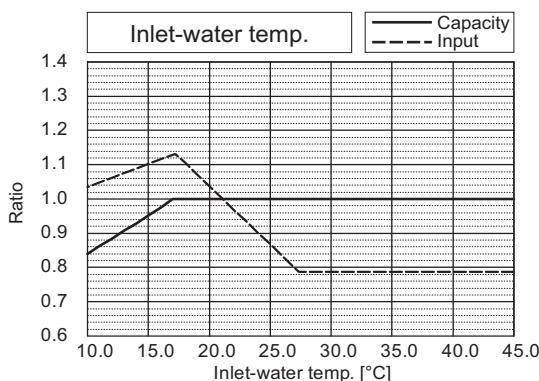





6. CAPACITY TABLES

U11 2nd

PQHY-		P120ZKMU			
Nominal Cooling Capacity	kW	35.2	Rated Cooling Capacity	kW	33.4
	BTU/h	120,000	BTU/h	114,000	
Input	kW	7.90	Input	kW	(Non-Ducted) 6.72 (Ducted) 7.35

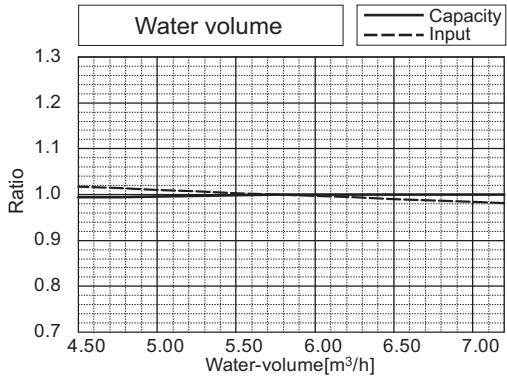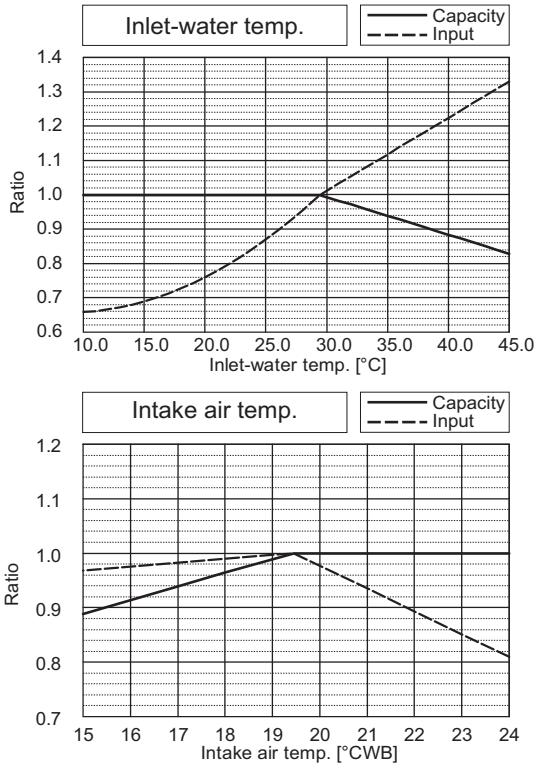


PQHY-		P120ZKMU			
Nominal Heating Capacity	kW	39.6	Rated Heating Capacity	kW	37.8
	BTU/h	135,000	BTU/h	129,000	
Input	kW	7.99	Input	kW	(Non-Ducted) 7.43 (Ducted) 7.44

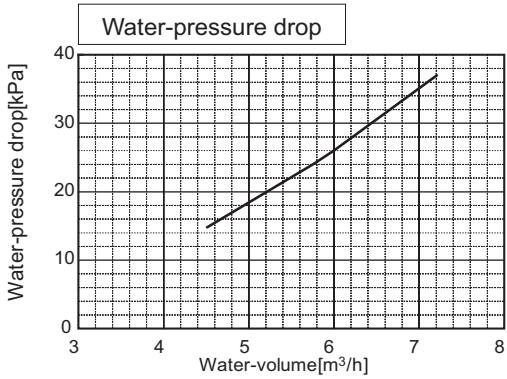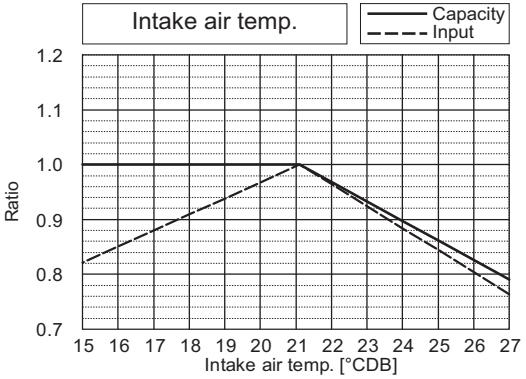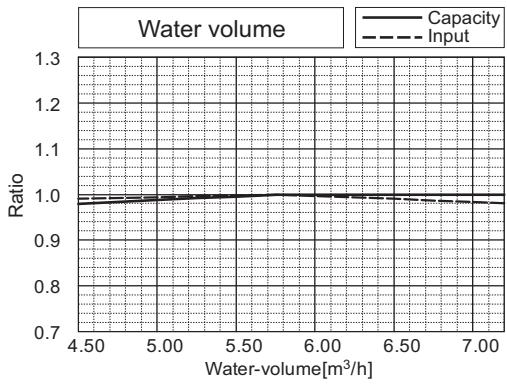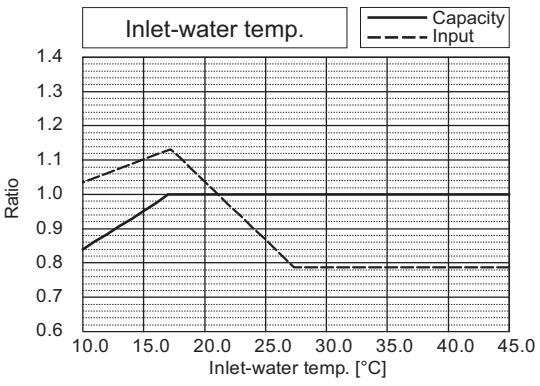




6. CAPACITY TABLES

U11 2nd



PQHY-		P144ZSKMU			
Nominal Cooling Capacity	kW	42.2	Rated Cooling Capacity	kW	40.2
BTU/h	144,000	BTU/h	137,000		
Input	kW	9.21	Input	kW	(Non-Ducted) 6.47 (Ducted) 8.57

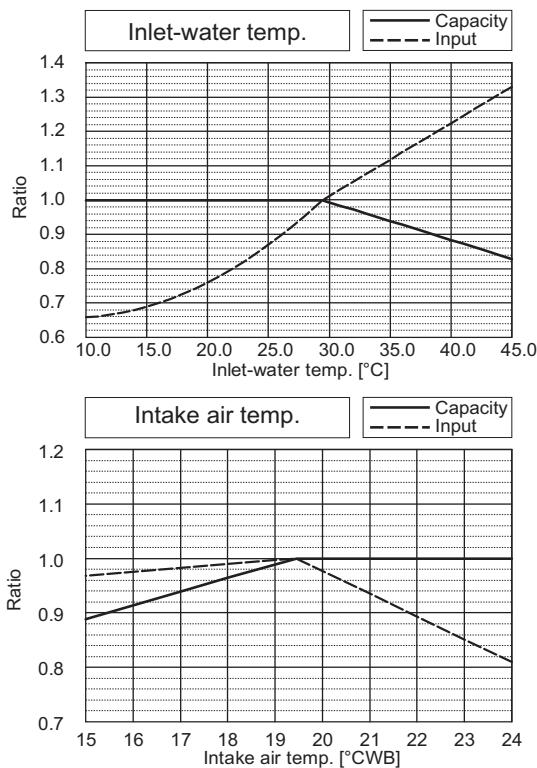

PQHY-		P144ZSKMU			
Nominal Heating Capacity	kW	46.9	Rated Heating Capacity	kW	44.5
BTU/h	160,000 <th>BTU/h</th> <td>152,000</td> <th></th> <th></th>	BTU/h	152,000		
Input	kW	8.78	Input	kW	(Non-Ducted) 7.51 (Ducted) 8.17

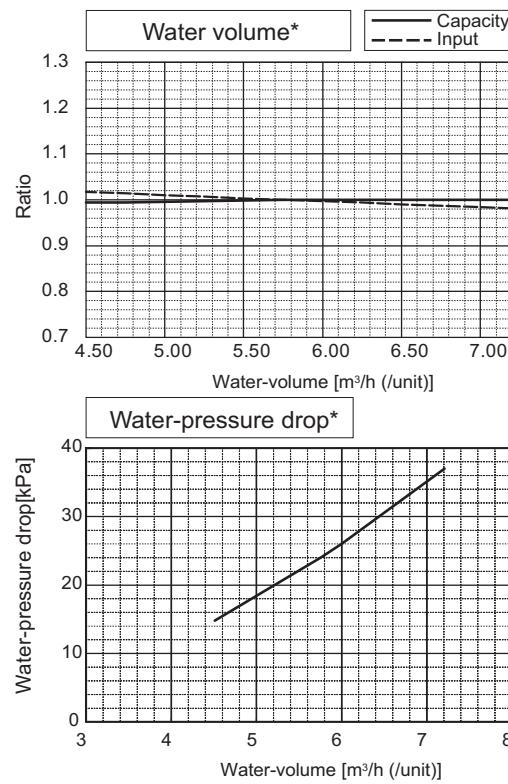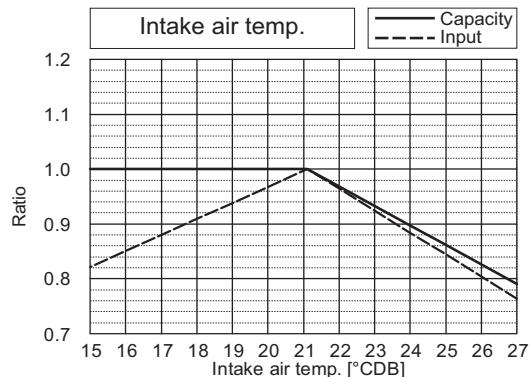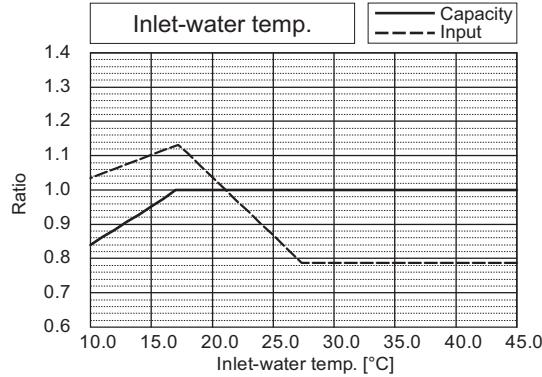

*The drawing indicates characteristic per unit.

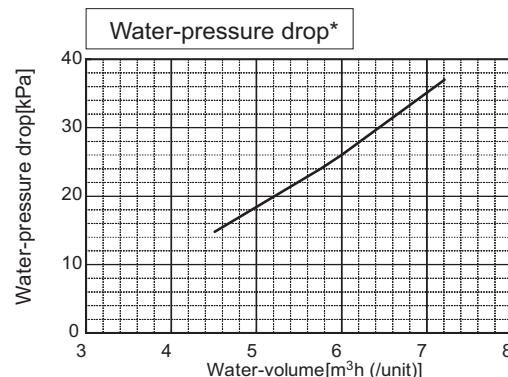
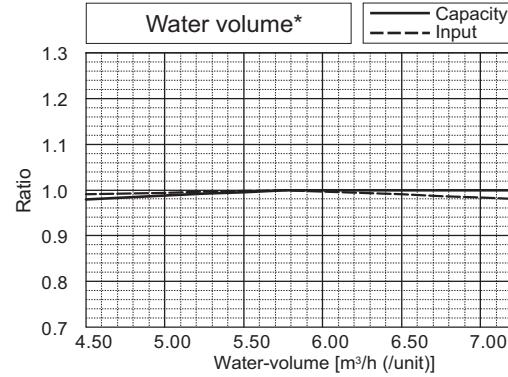


*The drawing indicates characteristic per unit.





6. CAPACITY TABLES

U11 2nd

PQHY-		P168ZSKMU			
Nominal Cooling Capacity	kW	49.2	Rated Cooling Capacity	kW	47.2
	BTU/h	168,000	BTU/h	161,000	
Input	kW	10.67	Input	kW	(Non-Ducted) 8.48 (Ducted) 9.93

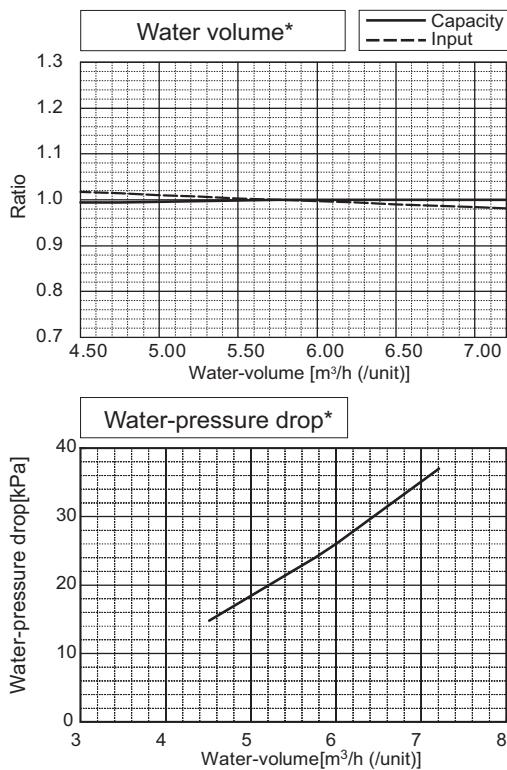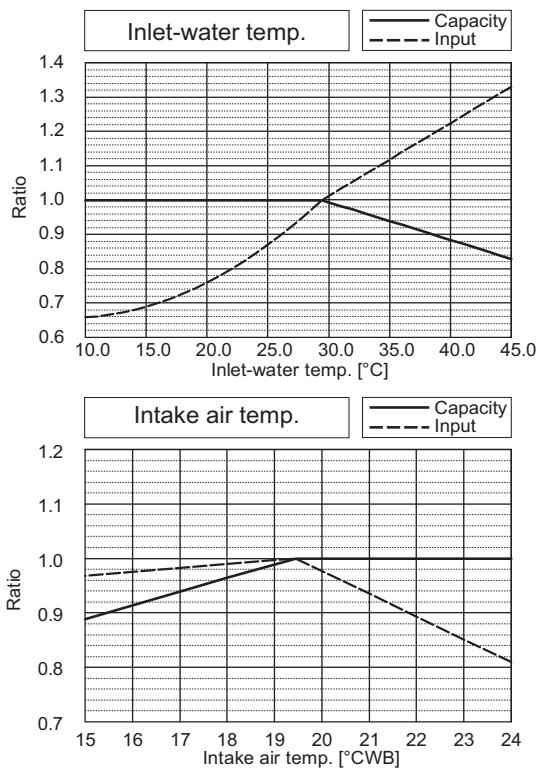

PQHY-		P168ZSKMU			
Nominal Heating Capacity	kW	55.1	Rated Heating Capacity	kW	52.5
	BTU/h	188,000	BTU/h	179,000	
Input	kW	10.73	Input	kW	(Non-Ducted) 9.44 (Ducted) 9.99

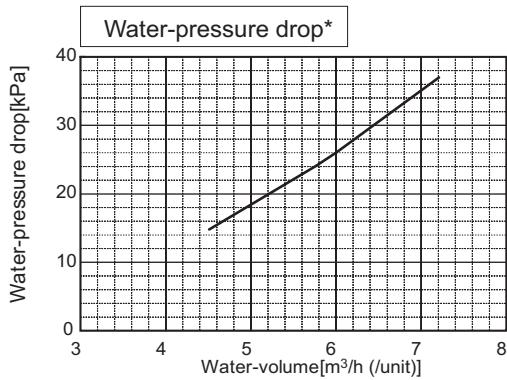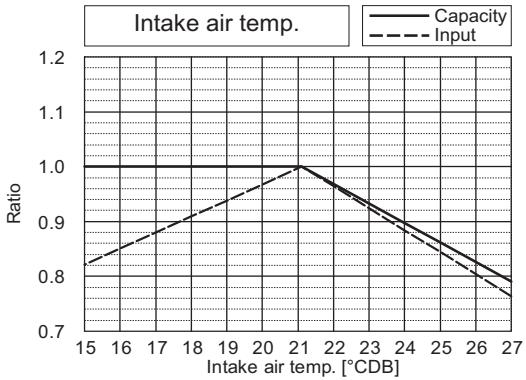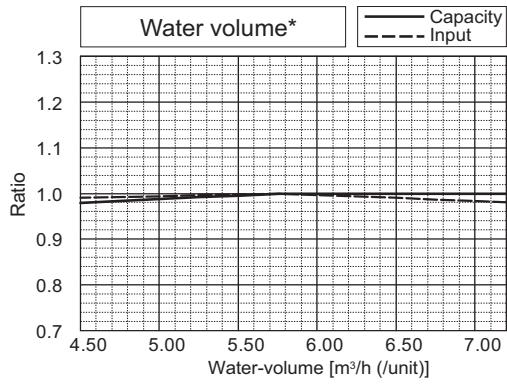
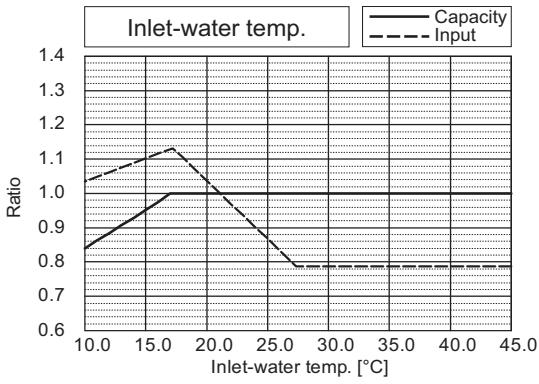


*The drawing indicates characteristic per unit.





6. CAPACITY TABLES

U11 2nd

PQHY-		P192ZSKMU			
Nominal Cooling Capacity	kW	56.3	Rated Cooling Capacity	kW	53.6
	BTU/h	192,000		BTU/h	183,000
Input	kW	12.60	Input	kW	(Non-Ducted) 10.28 (Ducted) 11.73

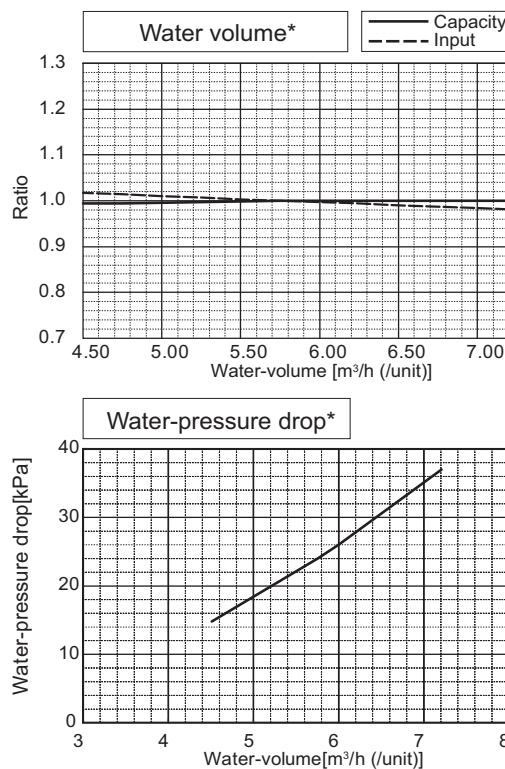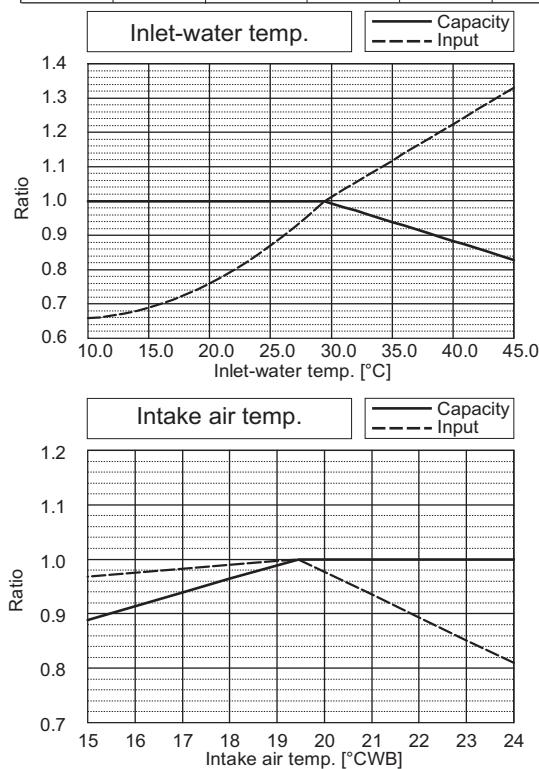

PQHY-		P192ZSKMU			
Nominal Heating Capacity	kW	63.0	Rated Heating Capacity	kW	60.1
	BTU/h	215,000		BTU/h	205,000
Input	kW	13.01	Input	kW	(Non-Ducted) 11.19 (Ducted) 12.11

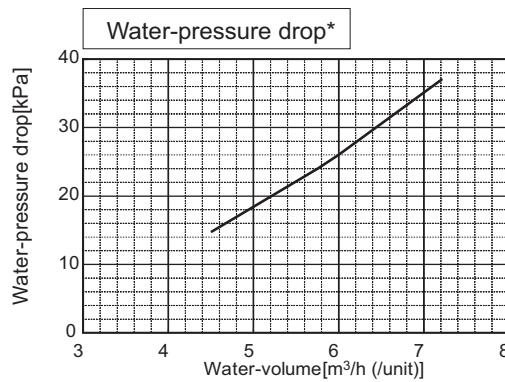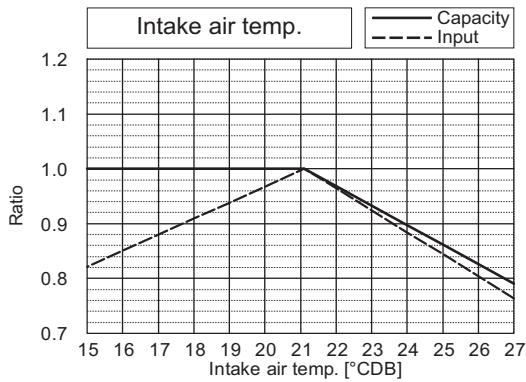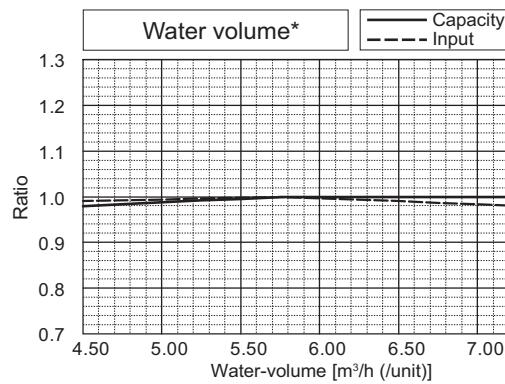
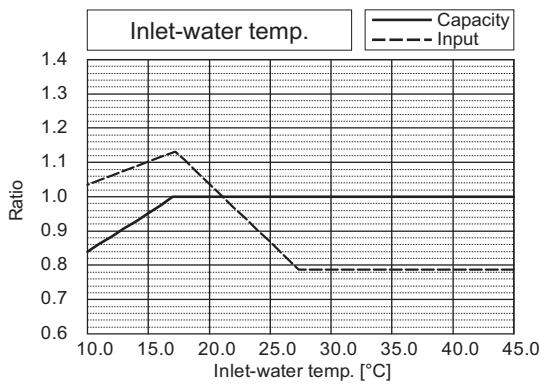


*The drawing indicates characteristic per unit.





6. CAPACITY TABLES

U11 2nd

PQHY-		P216ZSKMU			
Nominal Cooling Capacity	kW	63.3	Rated Cooling Capacity	kW	60.4
	BTU/h	216,000	BTU/h	206,000	
Input	kW	14.60	Input	kW	(Non-Ducted) 12.77 (Ducted) 13.59

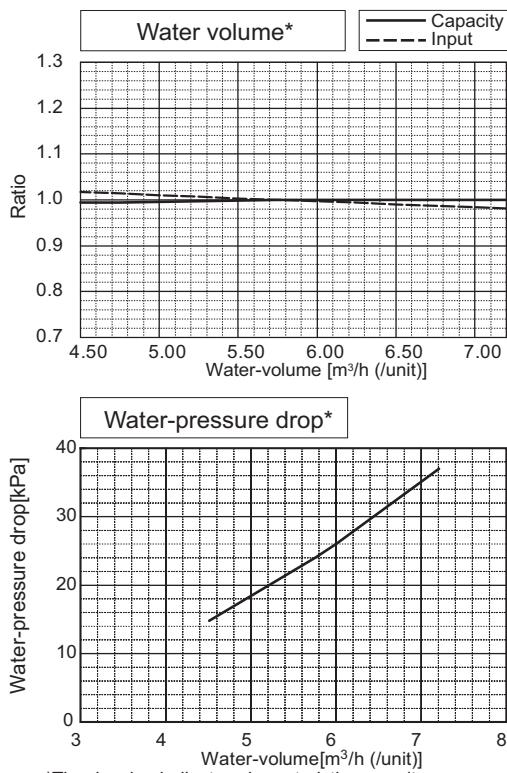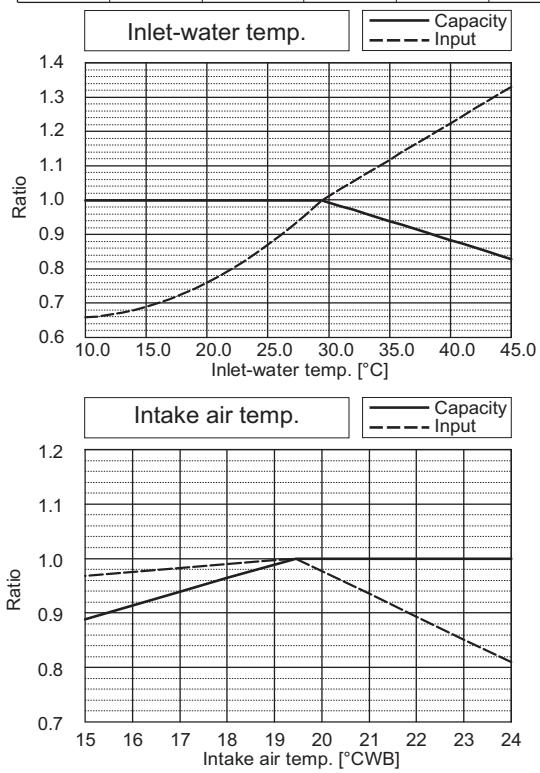

PQHY-		P216ZSKMU			
Nominal Heating Capacity	kW	71.2	Rated Heating Capacity	kW	68.0
	BTU/h	243,000	BTU/h	232,000	
Input	kW	14.97	Input	kW	(Non-Ducted) 13.88 (Ducted) 13.93

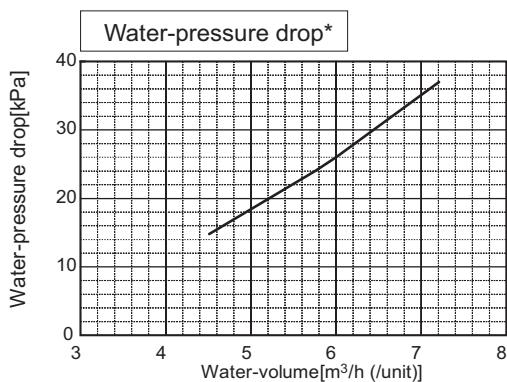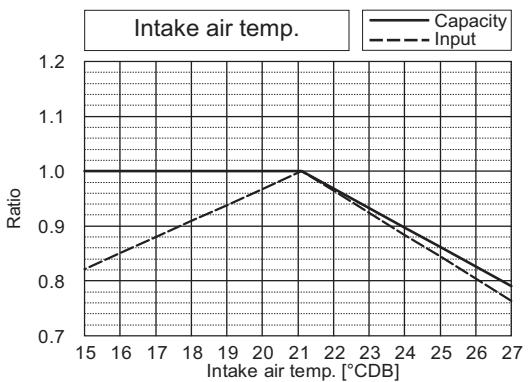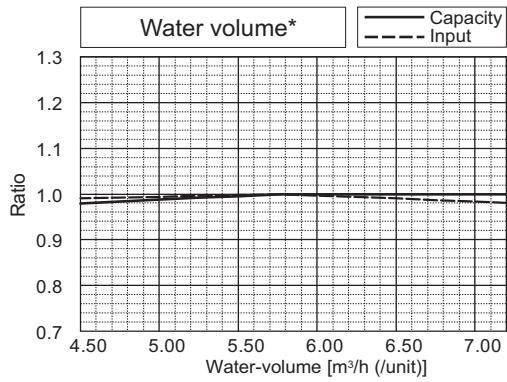
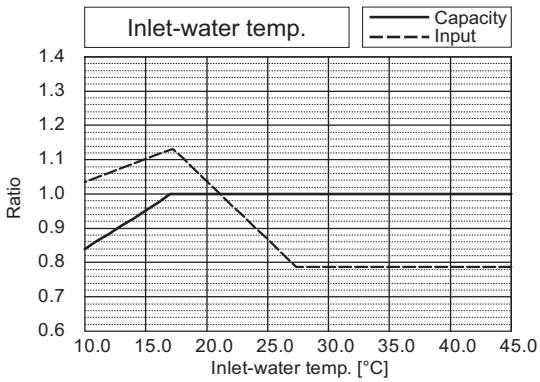


WY 575V





6. CAPACITY TABLES

U11 2nd

PQHY-		P240ZSKMU			
Nominal Cooling Capacity	kW	70.3	Rated Cooling Capacity	kW	66.8
	BTU/h	240,000		BTU/h	228,000
Input	kW	18.17	Input	kW	(Non-Ducted) 15.63 (Ducted) 16.91

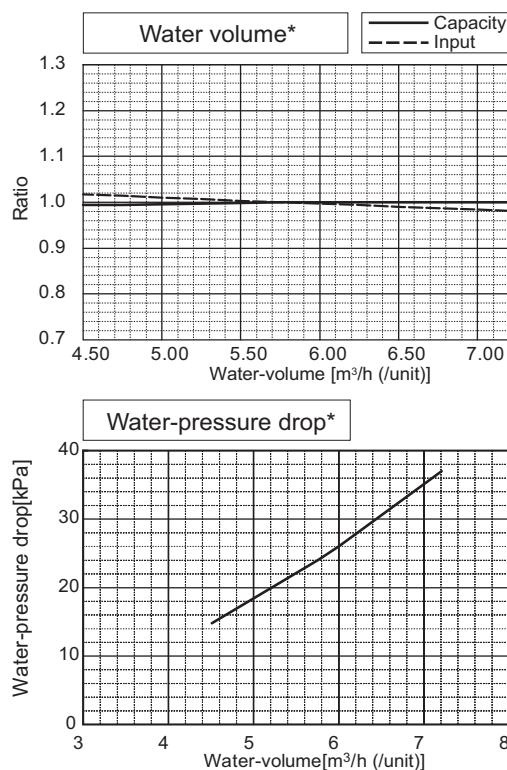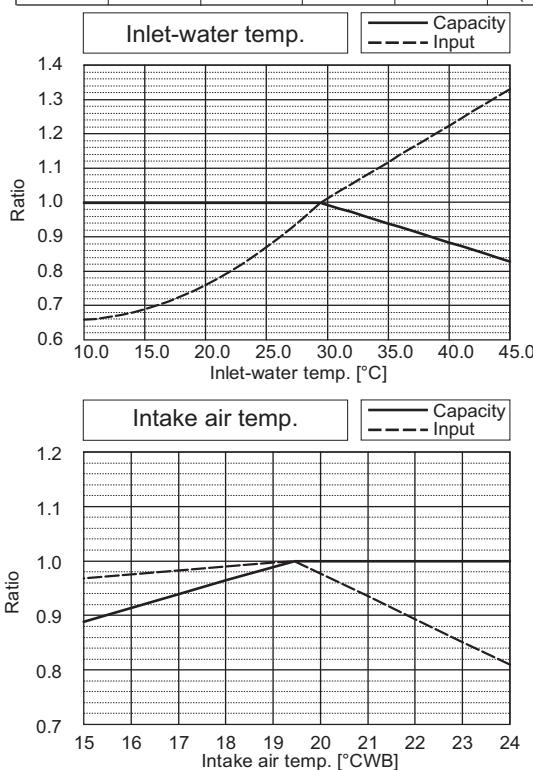

PQHY-		P240ZSKMU			
Nominal Heating Capacity	kW	79.1	Rated Heating Capacity	kW	75.6
	BTU/h	270,000		BTU/h	258,000
Input	kW	17.14	Input	kW	(Non-Ducted) 16.78 (Ducted) 15.95

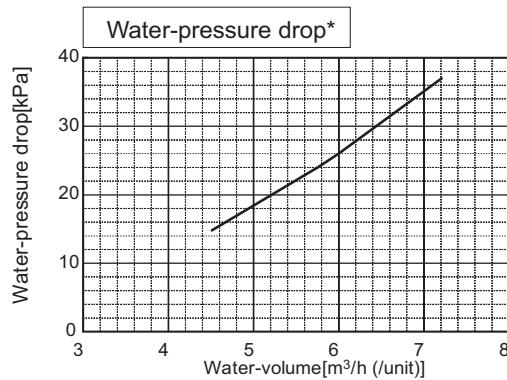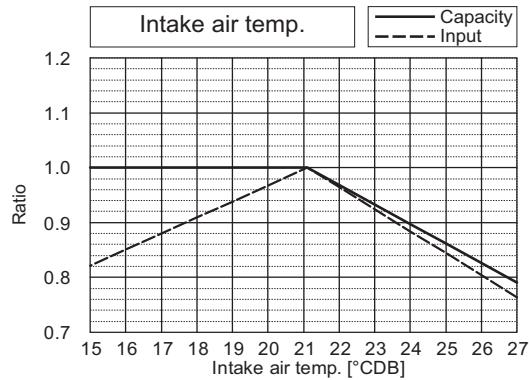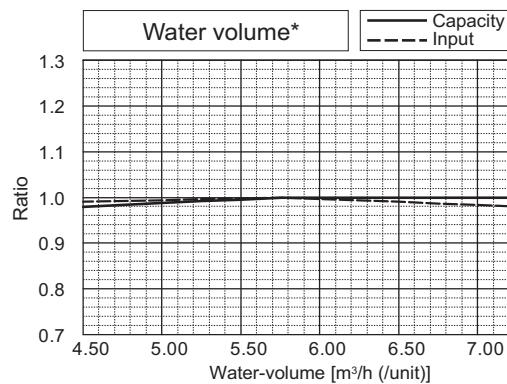
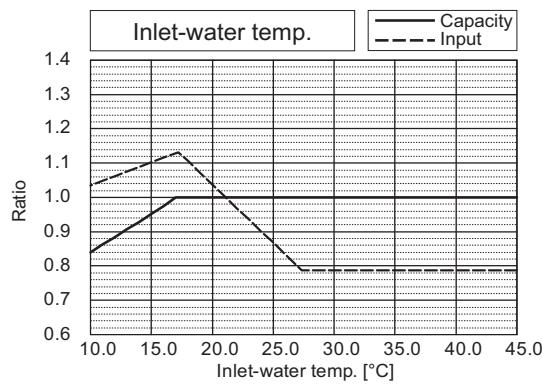


*The drawing indicates characteristic per unit.





6. CAPACITY TABLES

U11 2nd

PQHY-		P264ZSKMU			
Nominal Cooling Capacity	kW	77.4	Rated Cooling Capacity	kW	73.9
BTU/h		264,000	BTU/h		252,000
Input	kW	17.96	Input	kW	(Non-Ducted) 14.61 (Ducted) 16.71

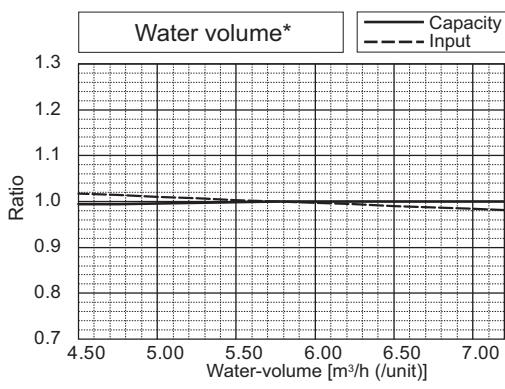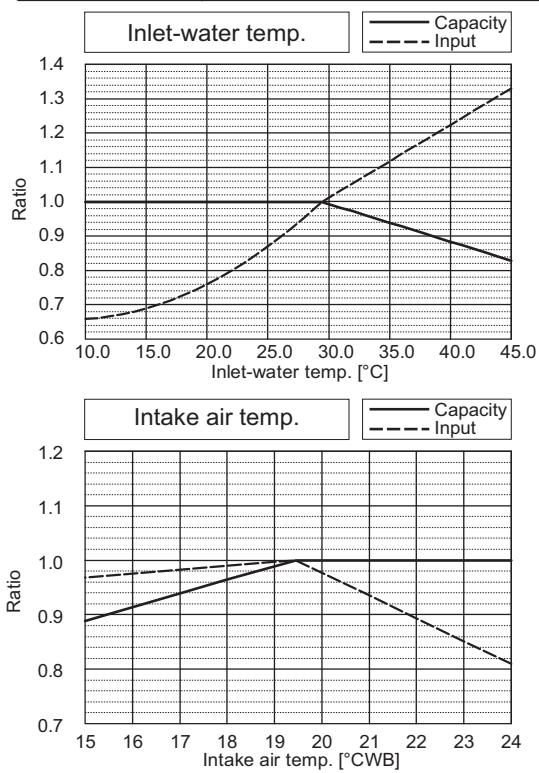

PQHY-		P264ZSKMU			
Nominal Heating Capacity	kW	86.5	Rated Heating Capacity	kW	82.4
BTU/h		295,000	BTU/h		281,000
Input	kW	17.27	Input	kW	(Non-Ducted) 15.52 (Ducted) 16.07

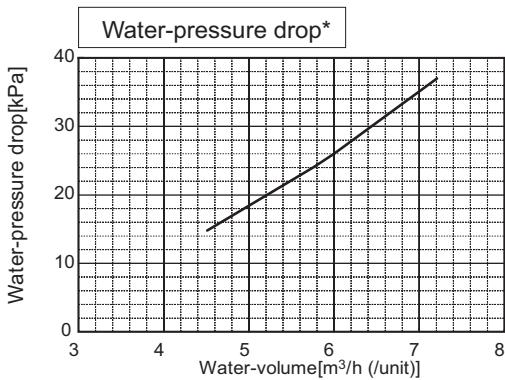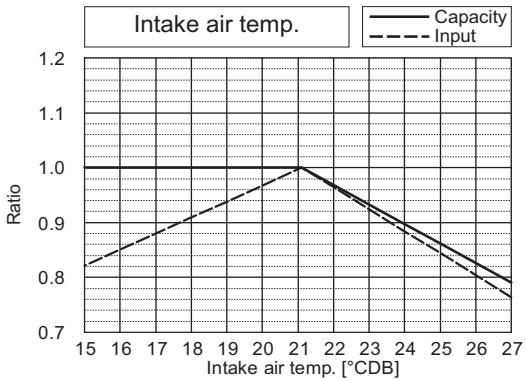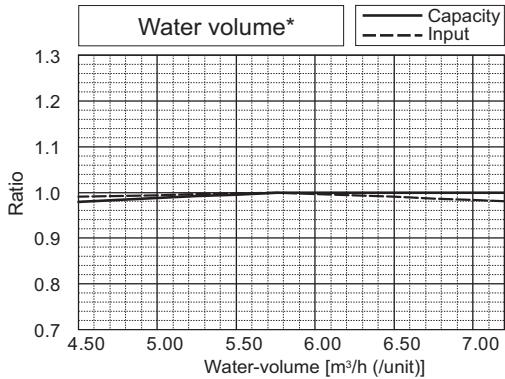
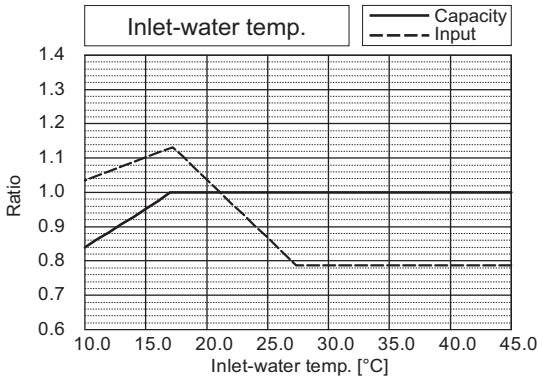


*The drawing indicates characteristic per unit.





6. CAPACITY TABLES

U11 2nd

PQHY-		P288ZSKMU			
Nominal Cooling Capacity	kW	84.4	Rated Cooling Capacity	kW	80.6
	BTU/h	288,000		BTU/h	275,000
Input	kW	19.98	Input	kW	(Non-Ducted) 16.42 (Ducted) 18.59

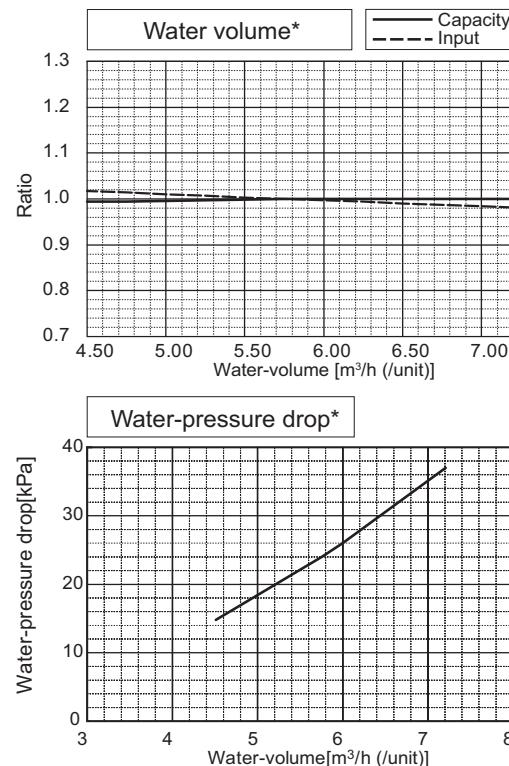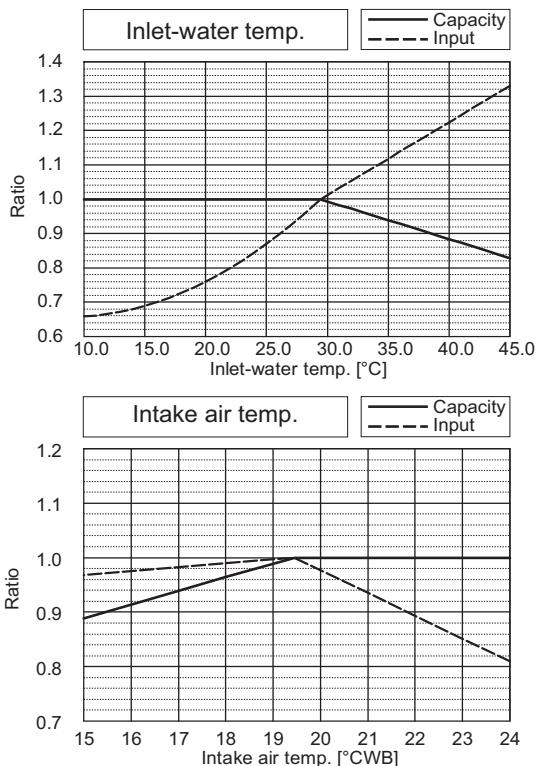

PQHY-		P288ZSKMU			
Nominal Heating Capacity	kW	94.7	Rated Heating Capacity	kW	90.3
	BTU/h	323,000		BTU/h	308,000
Input	kW	19.55	Input	kW	(Non-Ducted) 17.31 (Ducted) 18.19

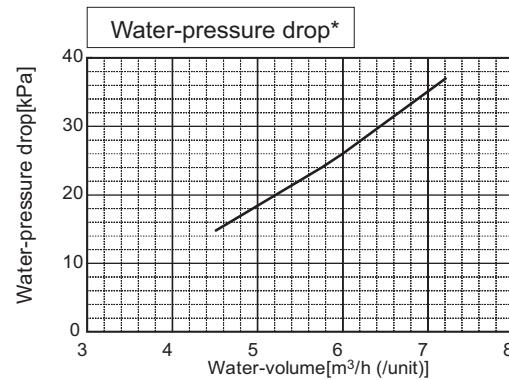
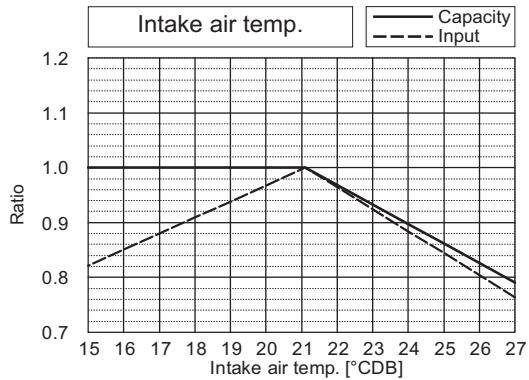
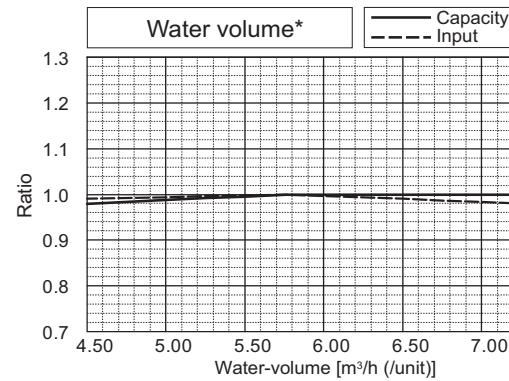
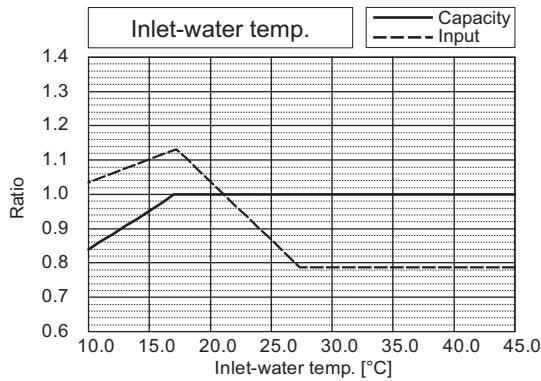


*The drawing indicates characteristic per unit.





6. CAPACITY TABLES

U11 2nd

PQHY-		P312ZSKMU			
Nominal Cooling Capacity	kW	91.4	Rated Cooling Capacity	kW	87.0
	BTU/h	312,000		BTU/h	297,000
Input	kW	22.41	Input	kW	(Non-Ducted) 19.28 (Ducted) 20.85

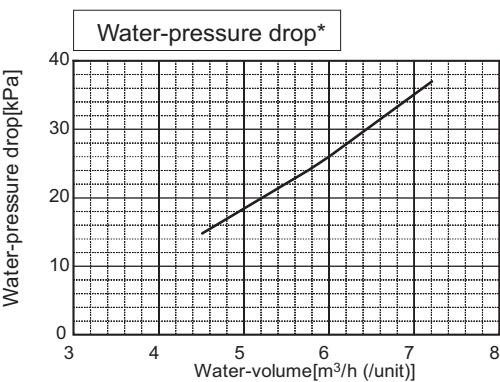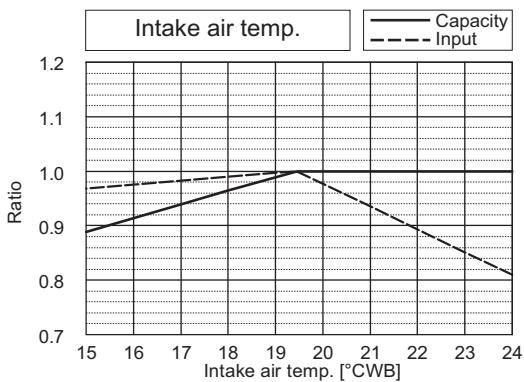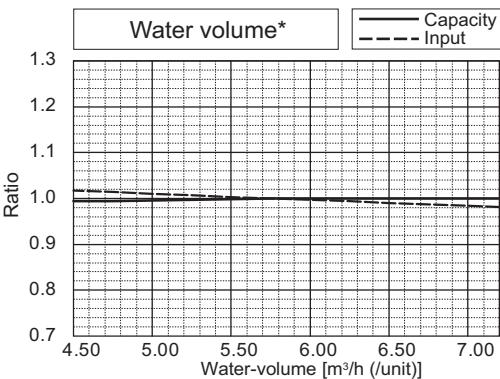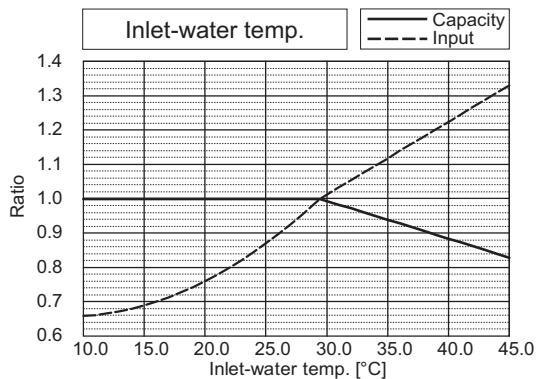

PQHY-		P312ZSKMU			
Nominal Heating Capacity	kW	102.6	Rated Heating Capacity	kW	97.9
	BTU/h	350,000		BTU/h	334,000
Input	kW	21.52	Input	kW	(Non-Ducted) 20.10 (Ducted) 20.02

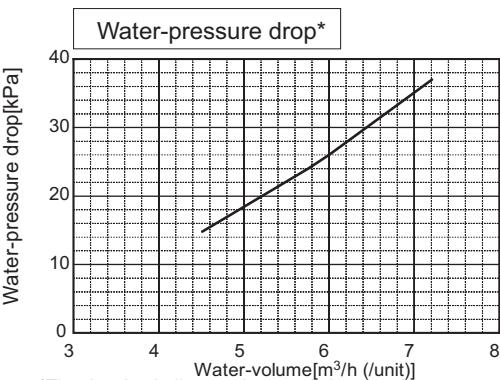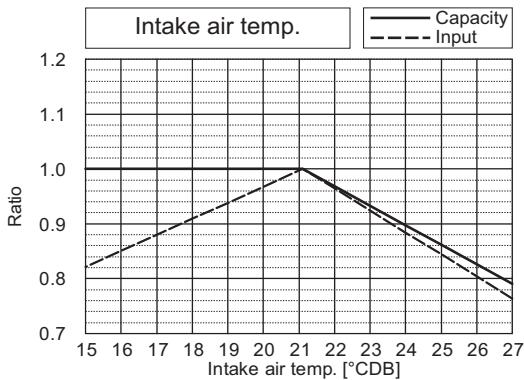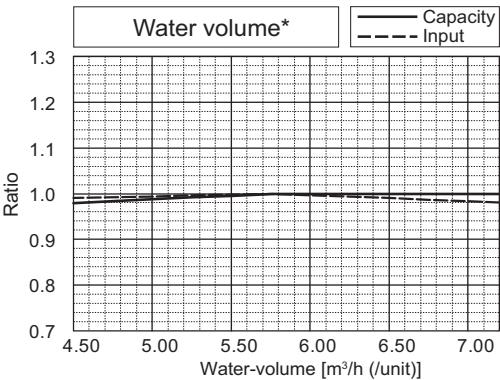
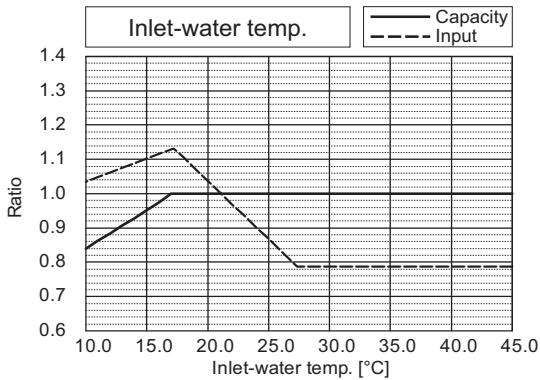


*The drawing indicates characteristic per unit.



6. CAPACITY TABLES

U11 2nd



PQHY-		P336ZSKMU			
Nominal Cooling Capacity	kW	98.5	Rated Cooling Capacity	kW	93.8
	BTU/h	336,000		BTU/h	320,000
Input	kW	24.86	Input	kW	(Non-Ducted) 22.51 (Ducted) 23.13

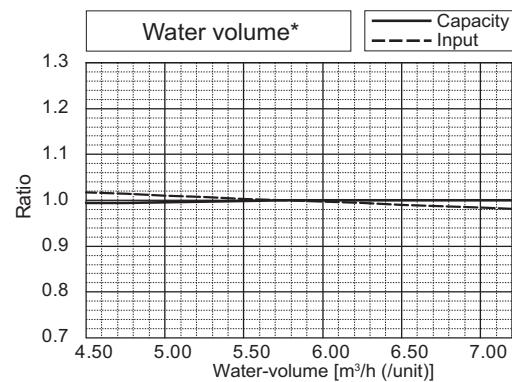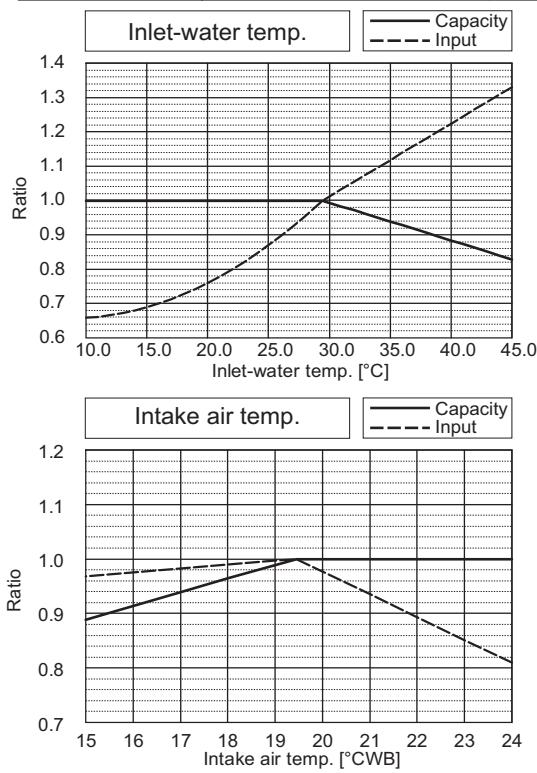

PQHY-		P336ZSKMU			
Nominal Heating Capacity	kW	110.8	Rated Heating Capacity	kW	105.8
	BTU/h	378,000		BTU/h	361,000
Input	kW	23.68	Input	kW	(Non-Ducted) 23.32 (Ducted) 22.03

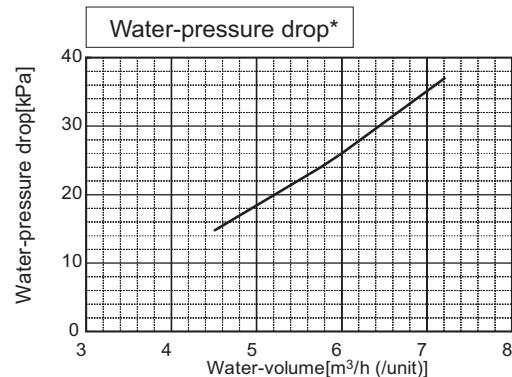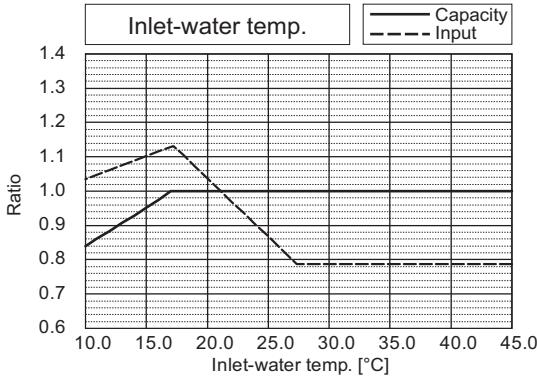

*The drawing indicates characteristic per unit.

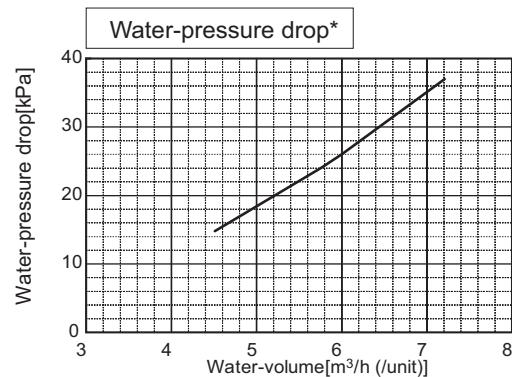
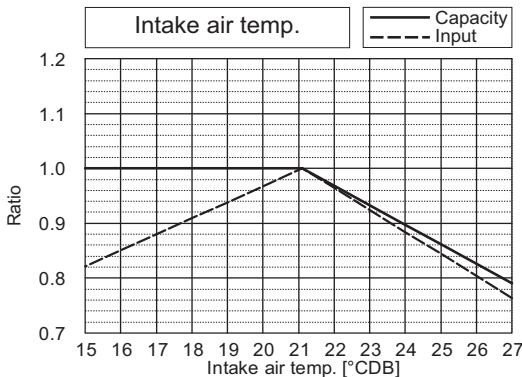


*The drawing indicates characteristic per unit.





6. CAPACITY TABLES

U11 2nd



PQHY-		P360ZSKMU			
Nominal Cooling Capacity	kW BTU/h	105.5 360,000	Rated Cooling Capacity	kW BTU/h	100.2 342,000
Input	kW	27.35	Input	kW	(Non-Ducted) 26.39 (Ducted) 25.45

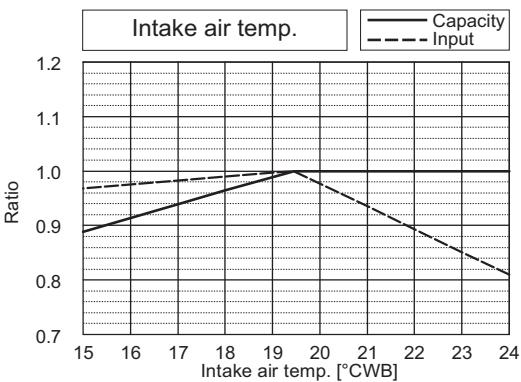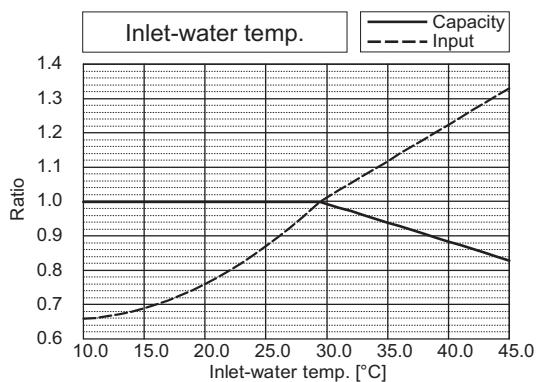

PQHY-		P360ZSKMU			
Nominal Heating Capacity	kW BTU/h	118.7 405,000	Rated Heating Capacity	kW BTU/h	113.4 387,000
Input	kW	25.75	Input	kW	(Non-Ducted) 26.85 (Ducted) 23.96

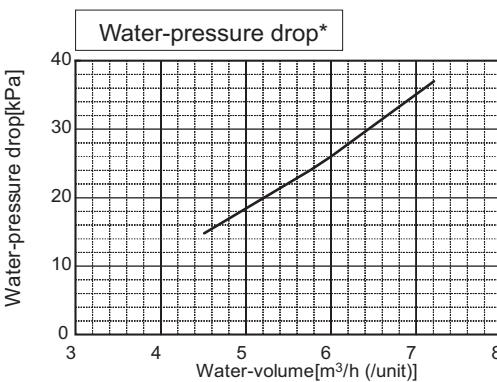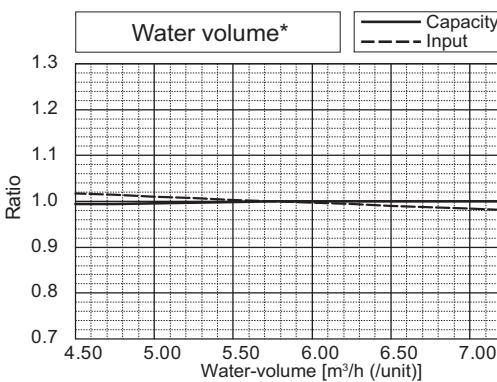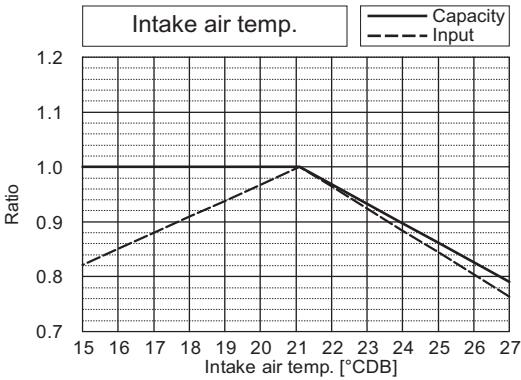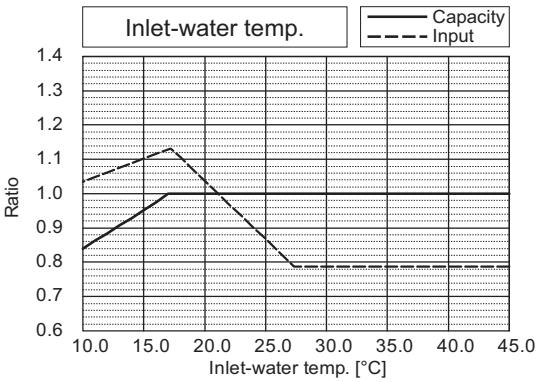

*The drawing indicates characteristic per unit.



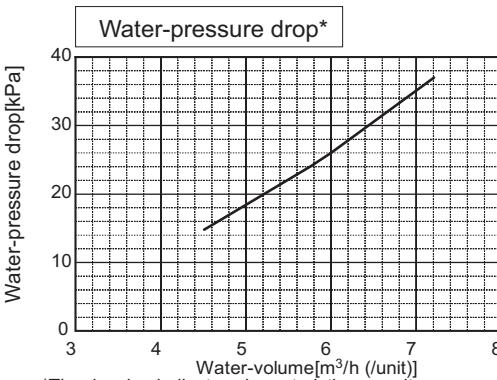
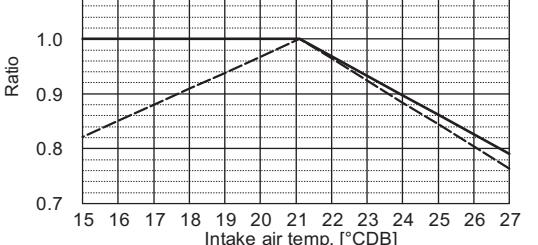


*The drawing indicates characteristic per unit.





6. CAPACITY TABLES

U11 2nd

PQHY-		P72ZKMU			
Nominal Cooling Capacity	kW	21.1	Rated Cooling Capacity	kW	20.2
	BTU/h	72,000		BTU/h	69,000
Input	kW	3.75	Input	kW	(Non-Ducted) 2.96 (Ducted) 3.49

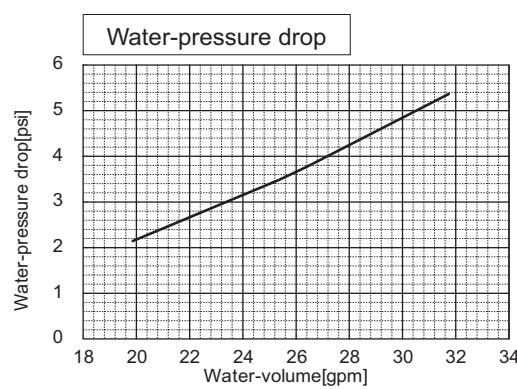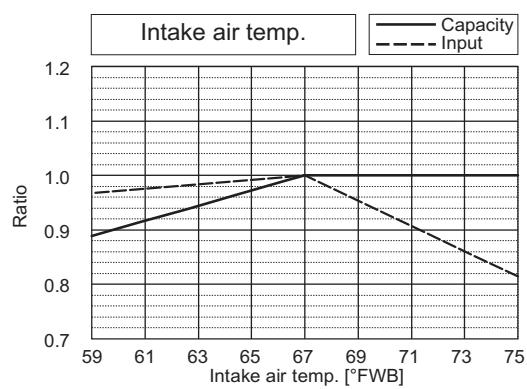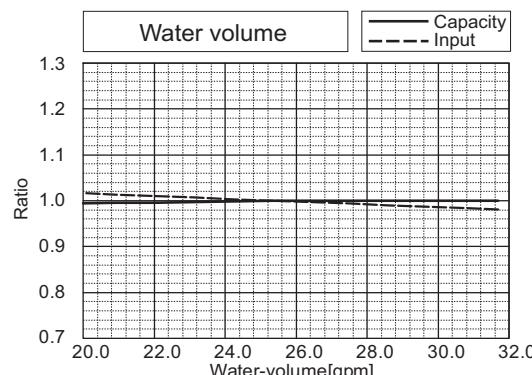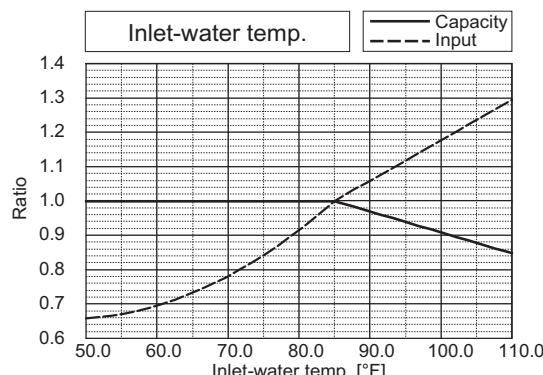





PQHY-		P72ZKMU			
Nominal Heating Capacity	kW	23.4	Rated Heating Capacity	kW	22.3
	BTU/h	80,000		BTU/h	76,000
Input	kW	3.93	Input	kW	(Non-Ducted) 3.48 (Ducted) 3.66

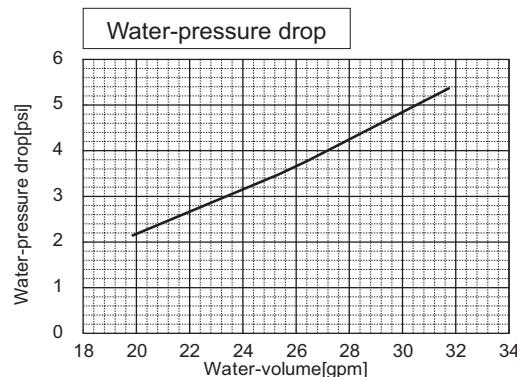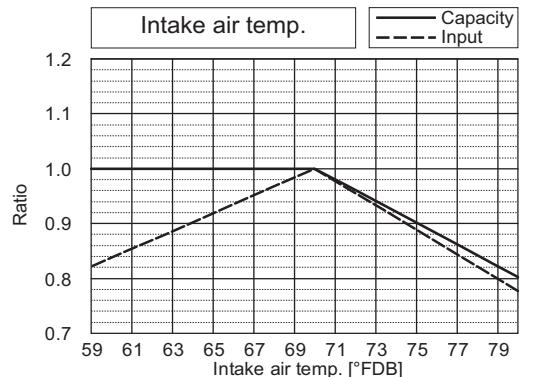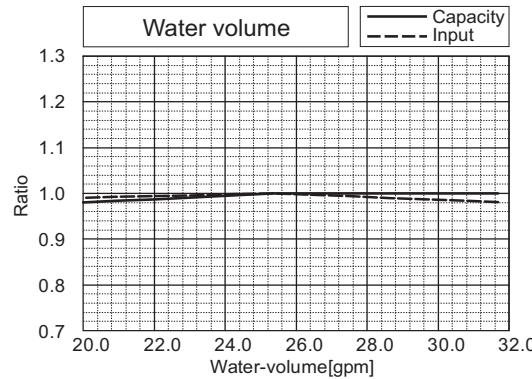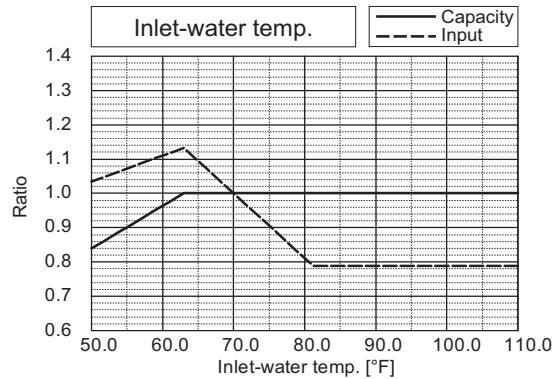





6. CAPACITY TABLES

U11 2nd

PQHY-		P96ZKMU			
Nominal Cooling Capacity	kW	28.1	Rated Cooling Capacity	kW	27.0
	BTU/h	96,000		BTU/h	92,000
Input	kW	5.93	Input	kW	(Non-Ducted) 4.26 (Ducted) 5.52

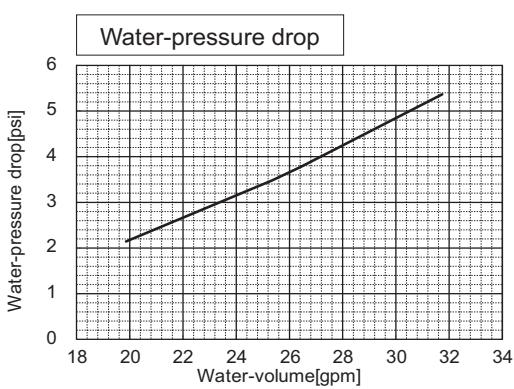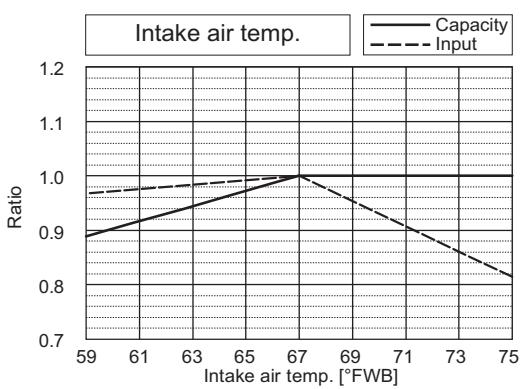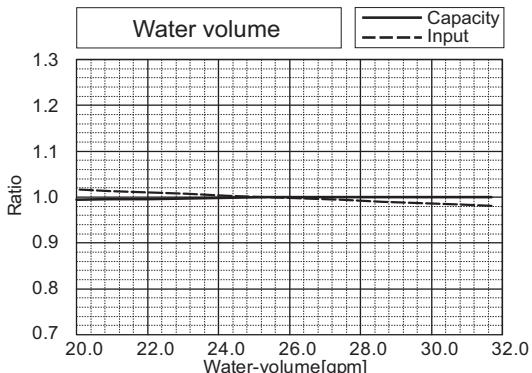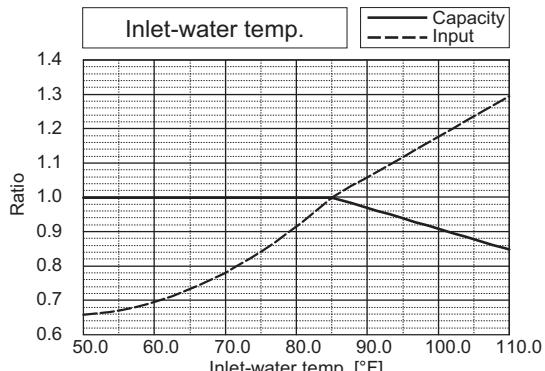





PQHY-		P96ZKMU			
Nominal Heating Capacity	kW	31.7	Rated Heating Capacity	kW	30.2
	BTU/h	108,000		BTU/h	103,000
Input	kW	6.17	Input	kW	(Non-Ducted) 4.87 (Ducted) 5.74

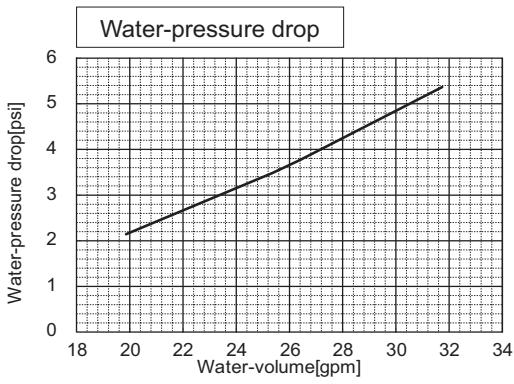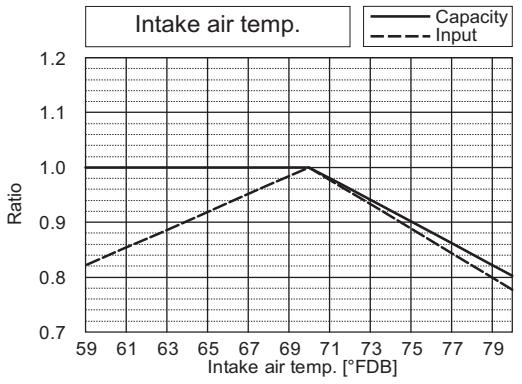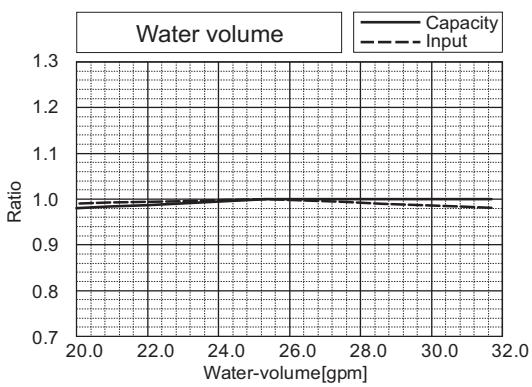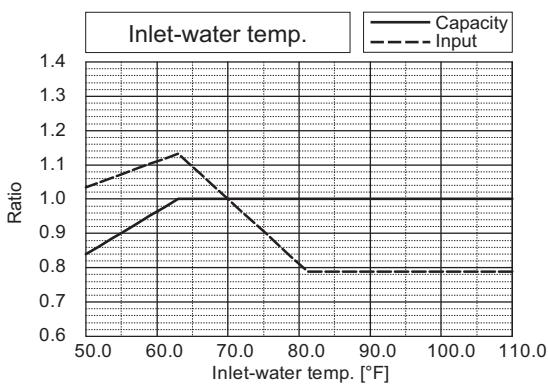





6. CAPACITY TABLES

U11 2nd

PQHY-		P120ZKMU			
Nominal Cooling Capacity	kW	35.2	Rated Cooling Capacity	kW	33.4
	BTU/h	120,000		BTU/h	114,000
Input	kW	7.90	Input	kW	(Non-Ducted) 6.72 (Ducted) 7.35

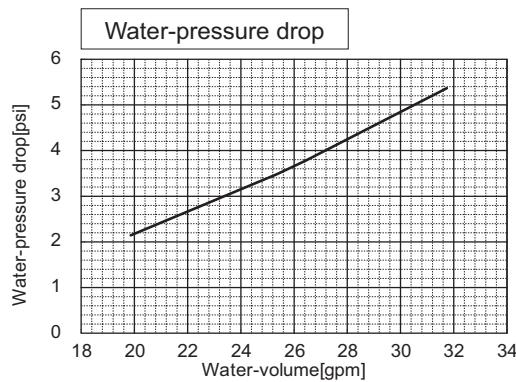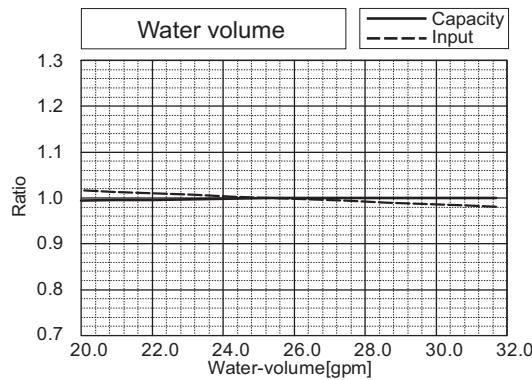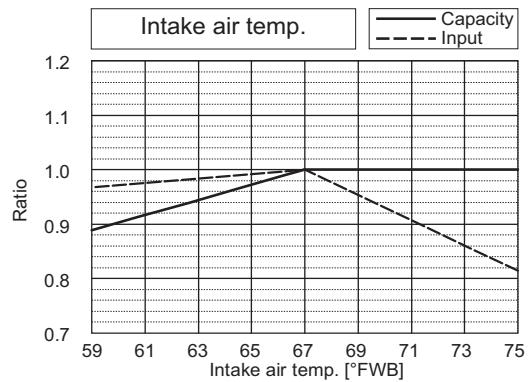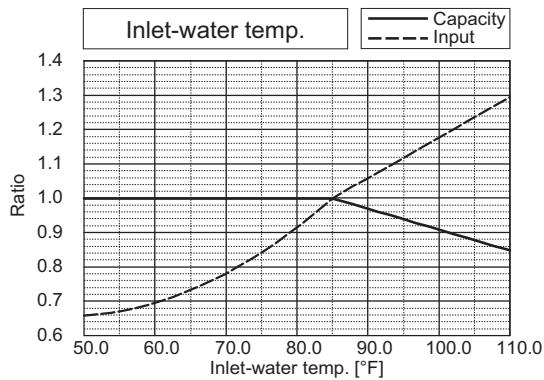



PQHY-		P120ZKMU			
Nominal Heating Capacity	kW	39.6	Rated Heating Capacity	kW	37.8
	BTU/h	135,000		BTU/h	129,000
Input	kW	7.99	Input	kW	(Non-Ducted) 7.43 (Ducted) 7.44

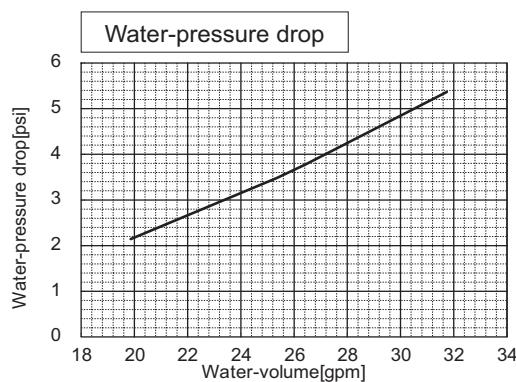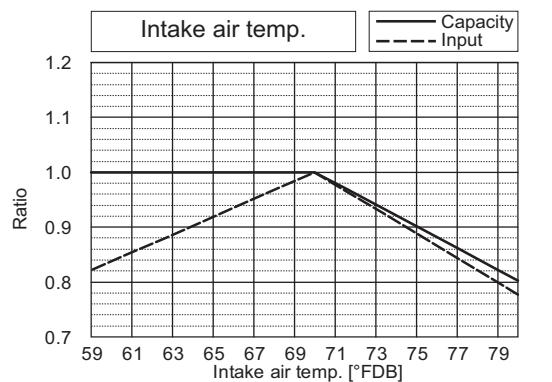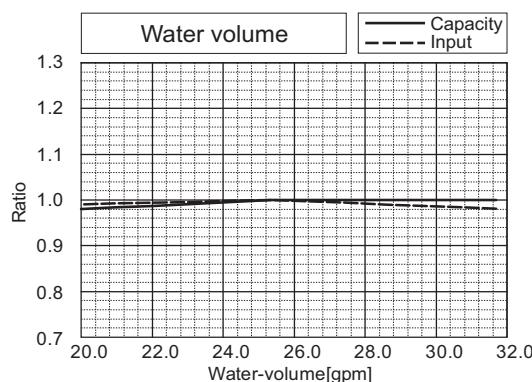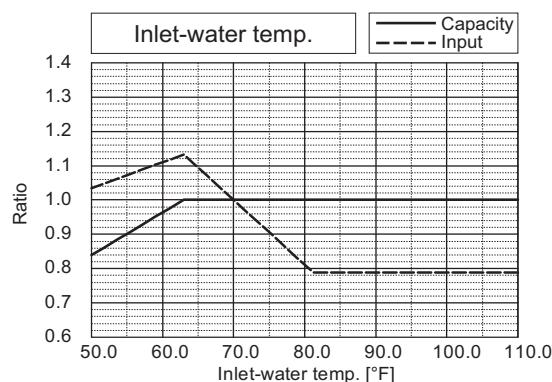





6. CAPACITY TABLES

U11 2nd



PQHY-		P144ZSKMU			
Nominal Cooling Capacity	kW	42.2	Rated Cooling Capacity	kW	40.2
	BTU/h	144,000		BTU/h	137,000
Input	kW	9.21	Input	kW	(Non-Ducted) 6.47 (Ducted) 8.57

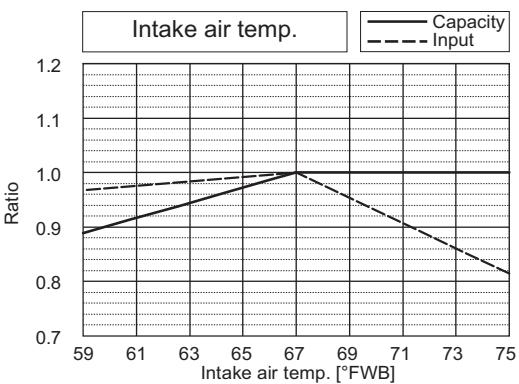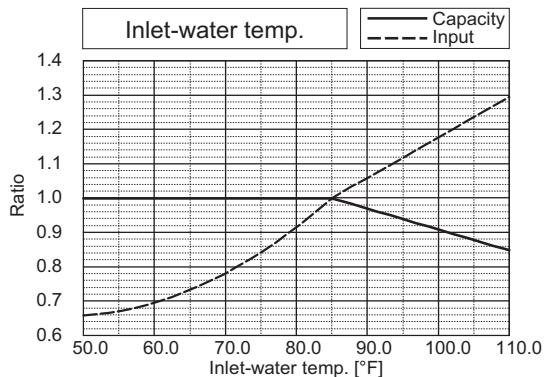

PQHY-		P144ZSKMU			
Nominal Heating Capacity	kW	46.9	Rated Heating Capacity	kW	44.5
	BTU/h	160,000		BTU/h	152,000
Input	kW	8.78	Input	kW	(Non-Ducted) 7.51 (Ducted) 8.17

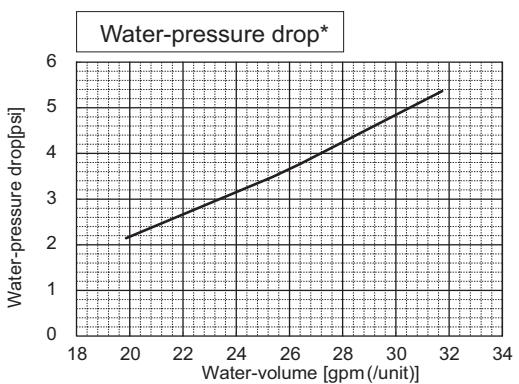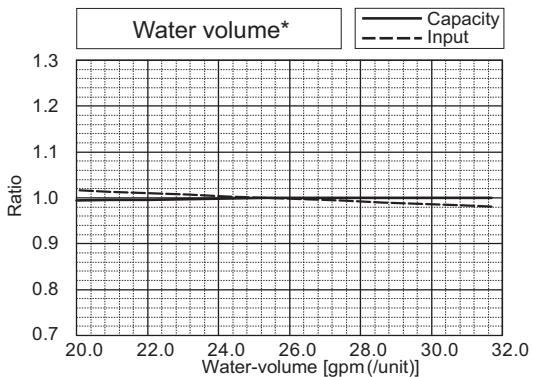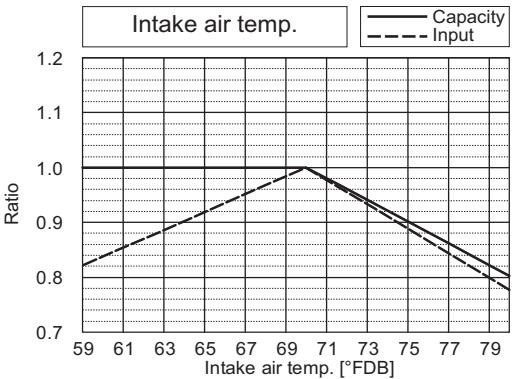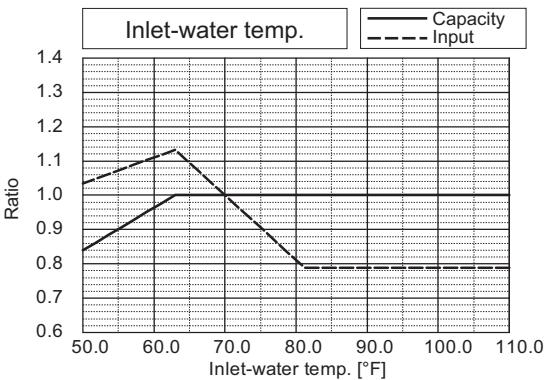

*The drawing indicates characteristic per unit.

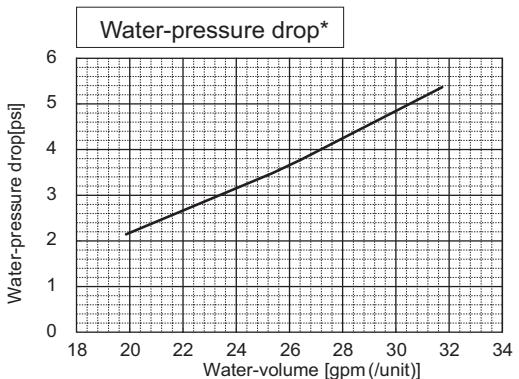
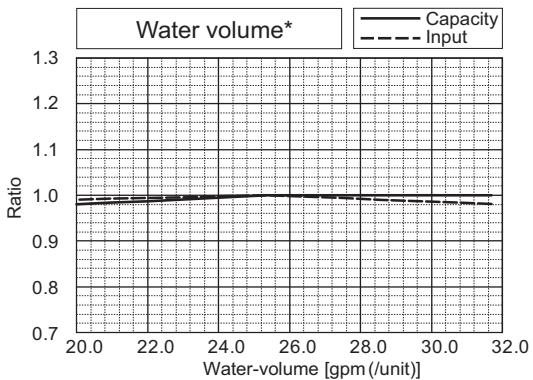


*The drawing indicates characteristic per unit.





6. CAPACITY TABLES

U11 2nd



PQHY-		P168ZSKMU			
Nominal Cooling Capacity	kW	49.2	Rated Cooling Capacity	kW	47.2
	BTU/h	168,000		BTU/h	161,000
Input	kW	10.67	Input	kW	(Non-Ducted) 8.48 (Ducted) 9.93

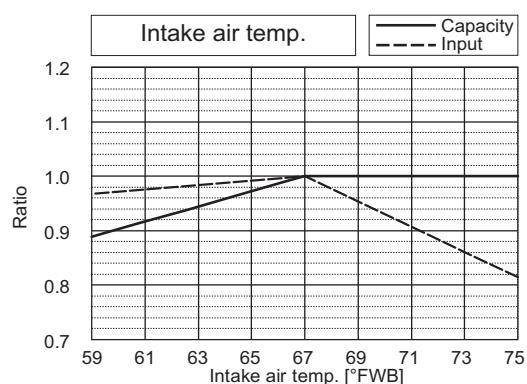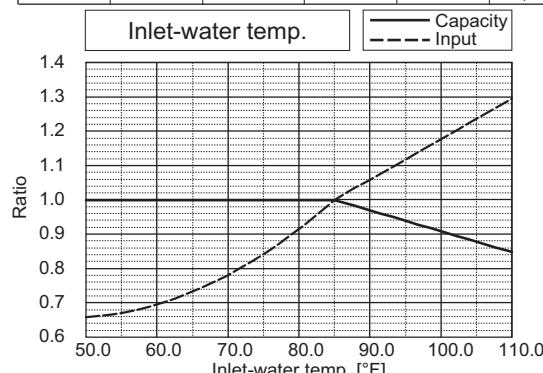

PQHY-		P168ZSKMU			
Nominal Heating Capacity	kW	55.1	Rated Heating Capacity	kW	52.5
	BTU/h	188,000		BTU/h	179,000
Input	kW	10.73	Input	kW	(Non-Ducted) 9.44 (Ducted) 9.99

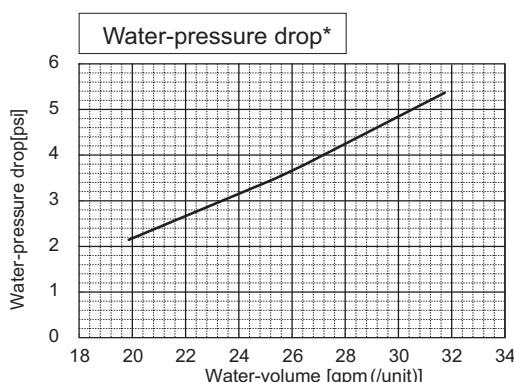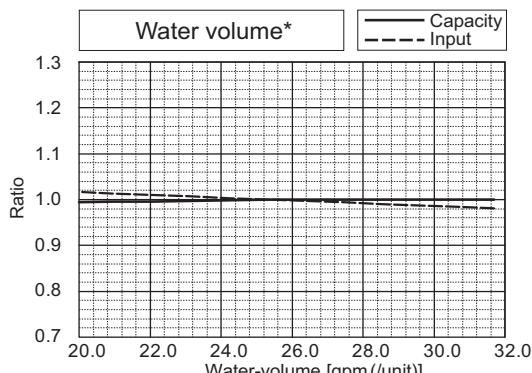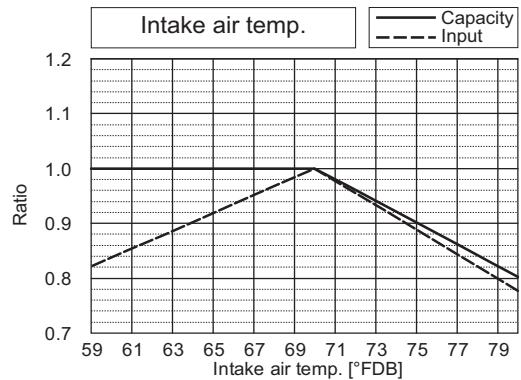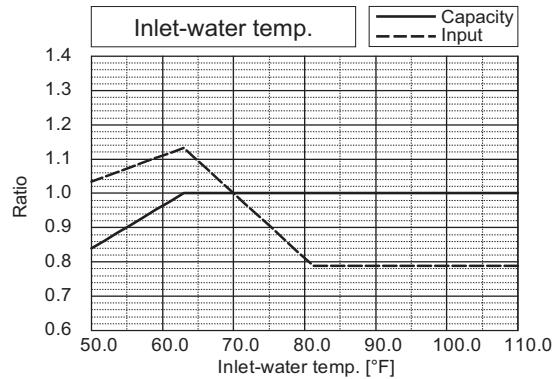

*The drawing indicates characteristic per unit.

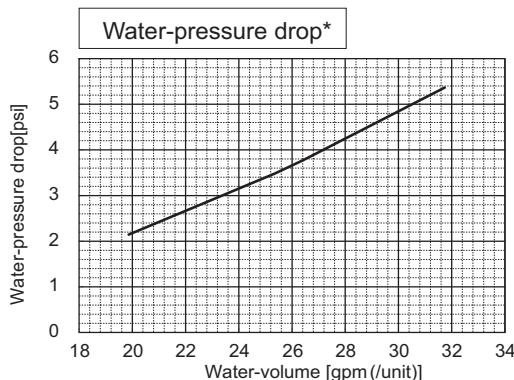
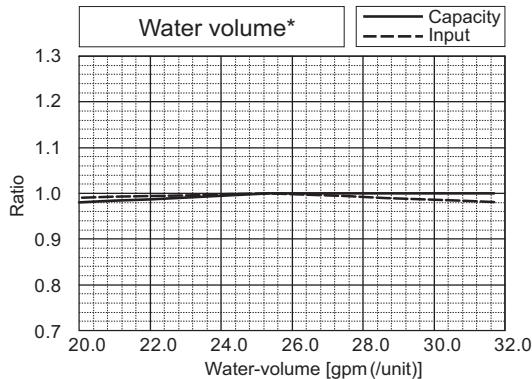


*The drawing indicates characteristic per unit.





6. CAPACITY TABLES

U11 2nd



PQHY-		P192ZSKMU			
Nominal Cooling Capacity	kW	56.3	Rated Cooling Capacity	kW	53.6
	BTU/h	192,000		BTU/h	183,000
Input	kW	12.60	Input	kW	(Non-Ducted) 10.28 (Ducted) 11.73

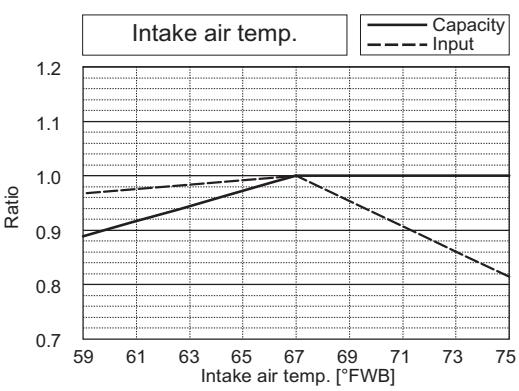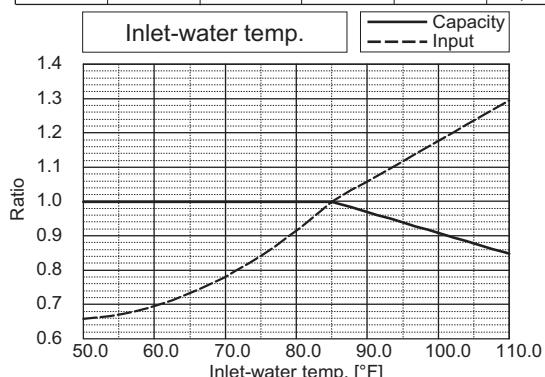

PQHY-		P192ZSKMU			
Nominal Heating Capacity	kW	63.0	Rated Heating Capacity	kW	60.1
	BTU/h	215,000		BTU/h	205,000
Input	kW	13.01	Input	kW	(Non-Ducted) 11.19 (Ducted) 12.11

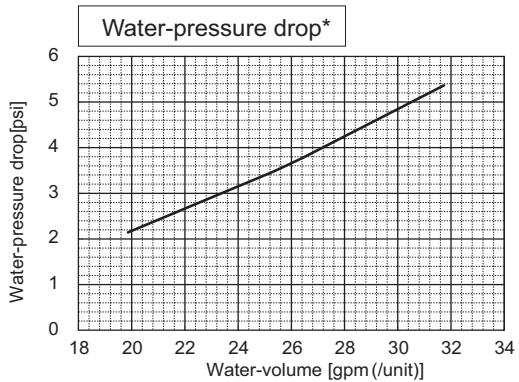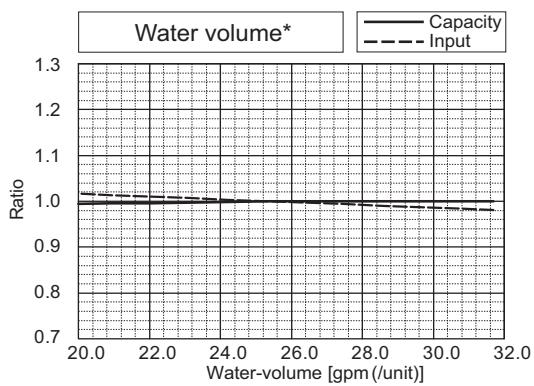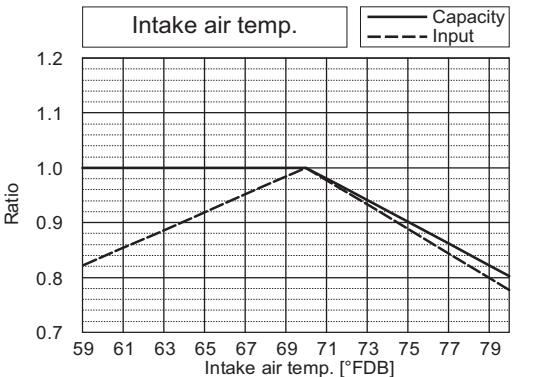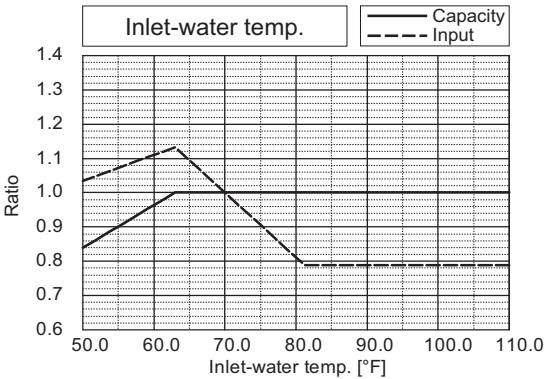

*The drawing indicates characteristic per unit.

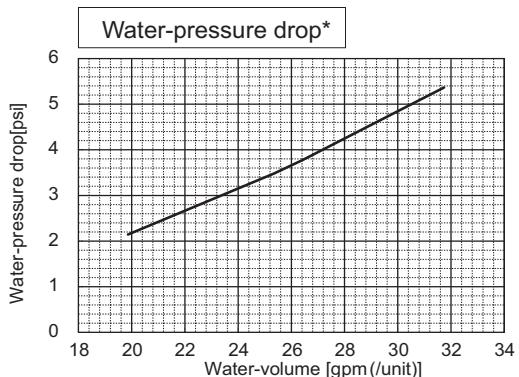
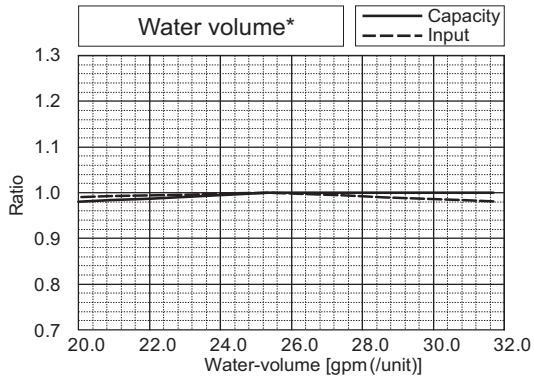


*The drawing indicates characteristic per unit.





6. CAPACITY TABLES

U11 2nd

PQHY-		P216ZSKMU			
Nominal Cooling Capacity	kW	63.3	Rated Cooling Capacity	kW	60.4
	BTU/h	216,000		BTU/h	206,000
Input	kW	14.60	Input	kW	(Non-Ducted) 12.77 (Ducted) 13.59

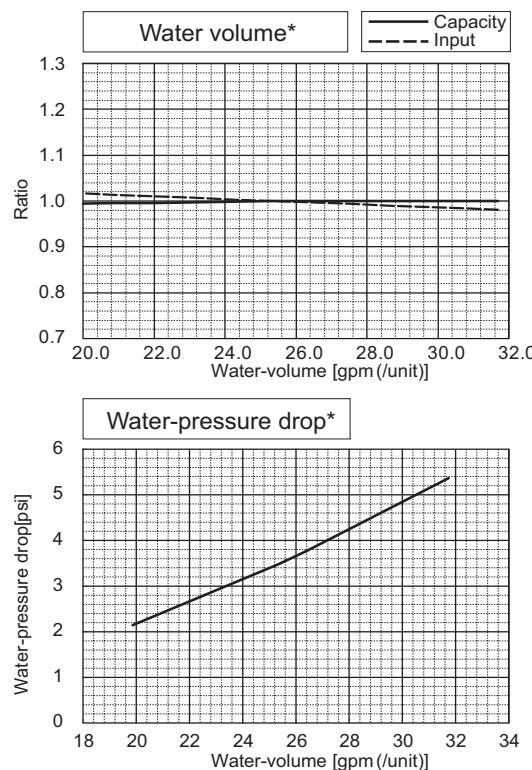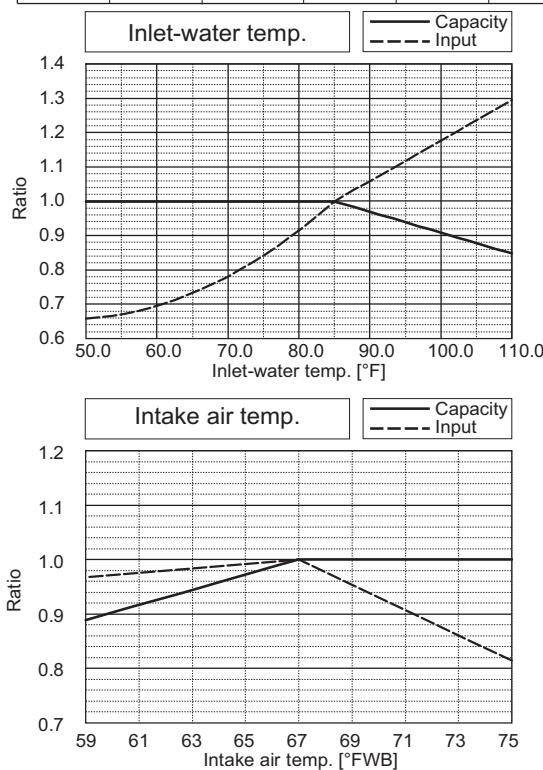

PQHY-		P216ZSKMU			
Nominal Heating Capacity	kW	71.2	Rated Heating Capacity	kW	68.0
	BTU/h	243,000		BTU/h	232,000
Input	kW	14.97	Input	kW	(Non-Ducted) 13.88 (Ducted) 13.93

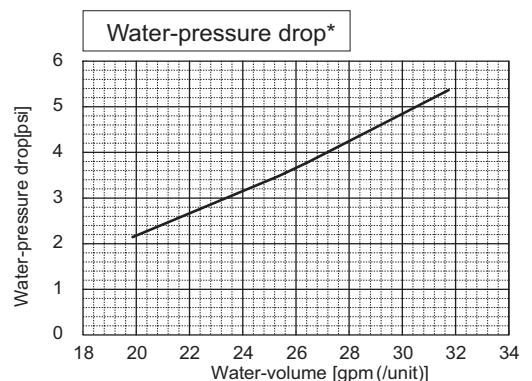
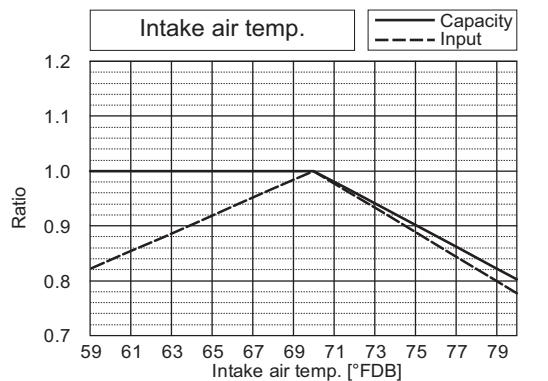
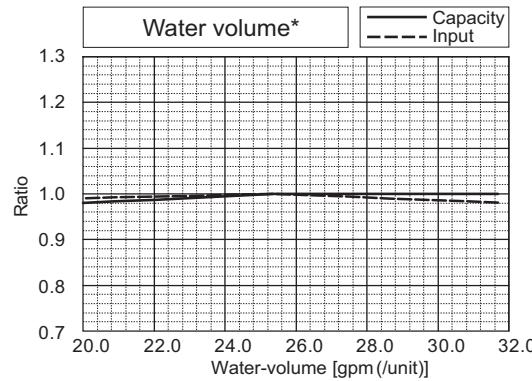
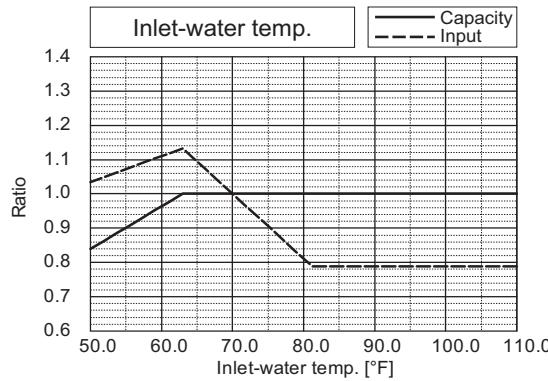


*The drawing indicates characteristic per unit.





6. CAPACITY TABLES

U11 2nd

PQHY-		P240ZSKMU			
Nominal Cooling Capacity	kW	70.3	Rated Cooling Capacity	kW	66.8
	BTU/h	240,000		BTU/h	228,000
Input	kW	18.17	Input	kW	(Non-Ducted) 15.63 (Ducted) 16.91

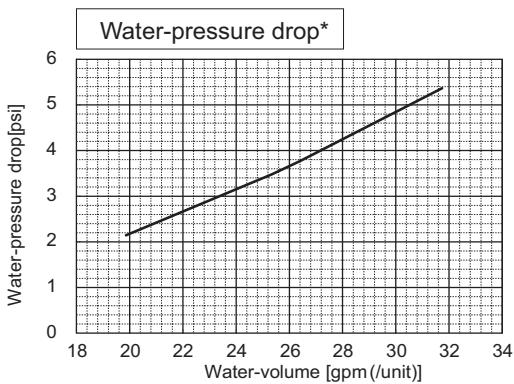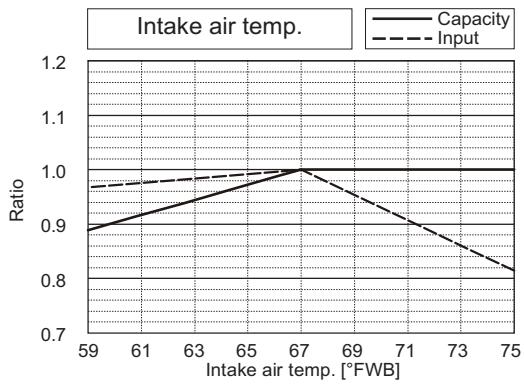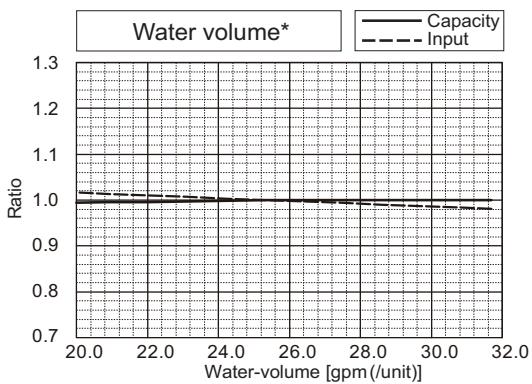
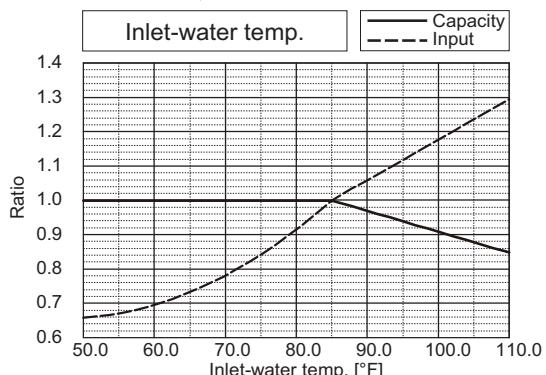


PQHY-		P240ZSKMU			
Nominal Heating Capacity	kW	79.1	Rated Heating Capacity	kW	75.6
	BTU/h	270,000		BTU/h	258,000
Input	kW	17.14	Input	kW	(Non-Ducted) 16.78 (Ducted) 15.95

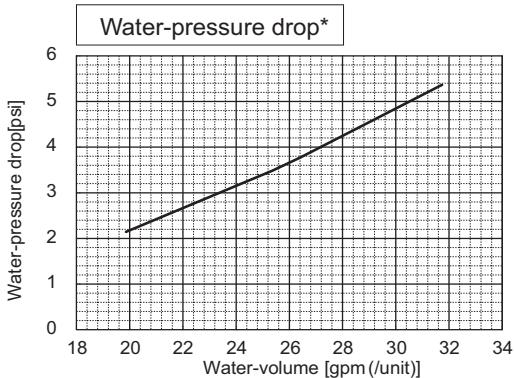
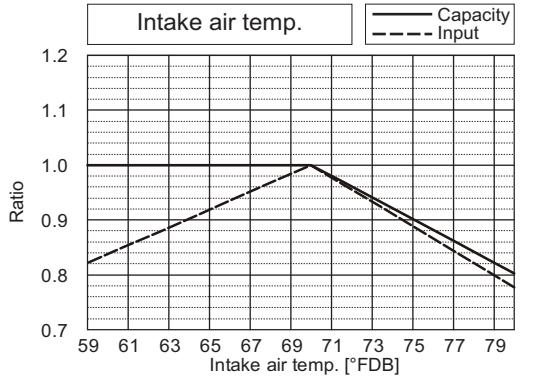
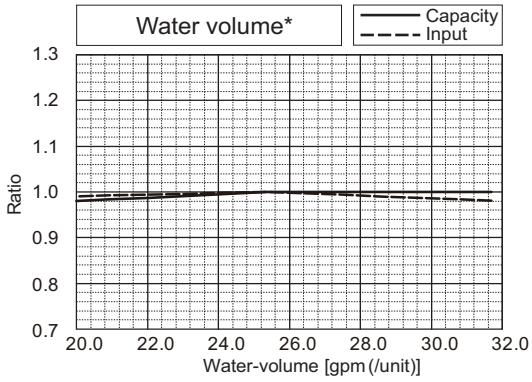
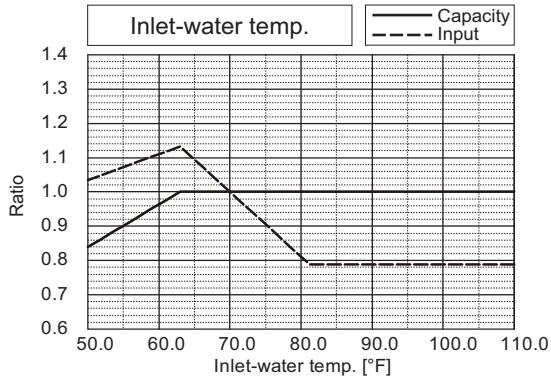


*The drawing indicates characteristic per unit.



PQHY-		P264ZSKMU			
Nominal Cooling Capacity	kW	77.4	Rated Cooling Capacity	kW	73.9
BTU/h	264,000 <th>BTU/h</th> <td>252,000</td> <th></th> <th></th>	BTU/h	252,000		
Input	kW	17.96	Input	kW	(Non-Ducted) 14.61 (Ducted) 16.71

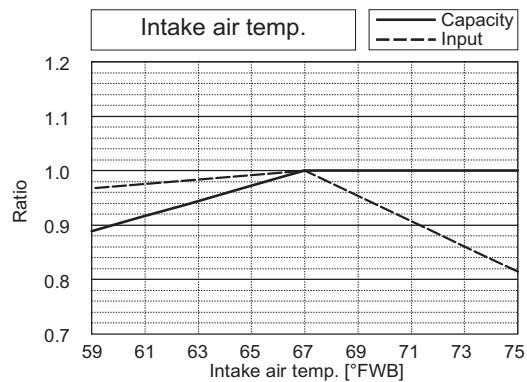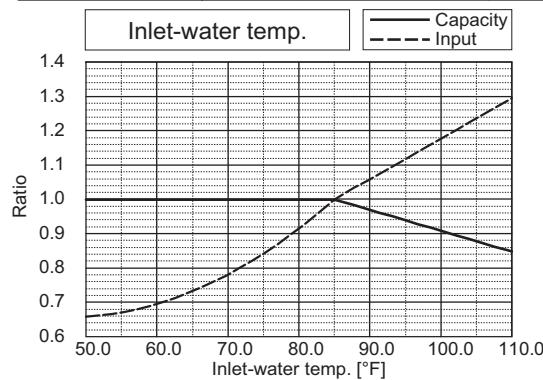

PQHY-		P264ZSKMU			
Nominal Heating Capacity	kW	86.5	Rated Heating Capacity	kW	82.4
BTU/h	295,000 <th>BTU/h</th> <td>281,000</td> <th></th> <th></th>	BTU/h	281,000		
Input	kW	17.27	Input	kW	(Non-Ducted) 15.52 (Ducted) 16.07

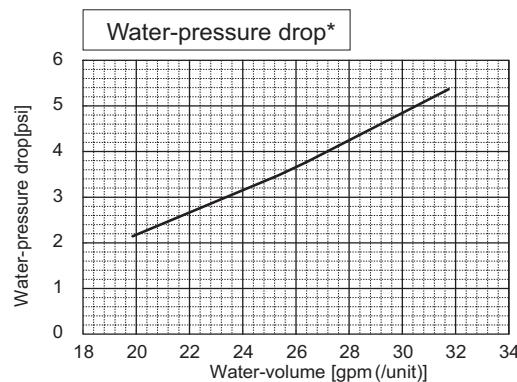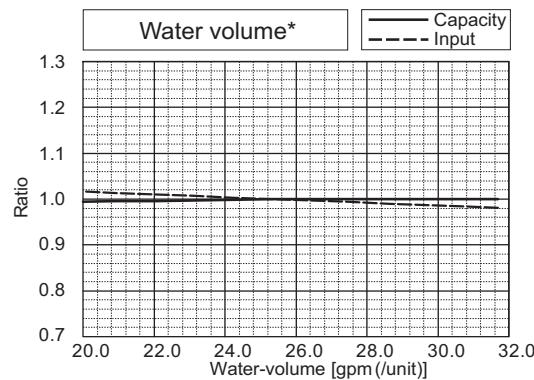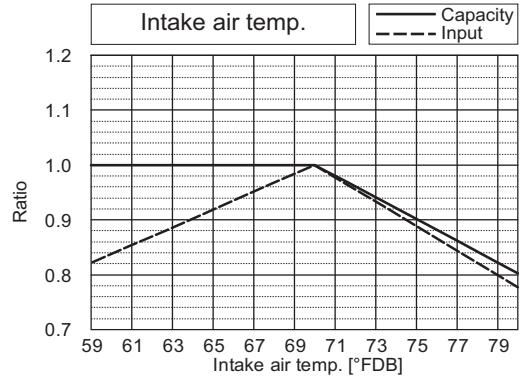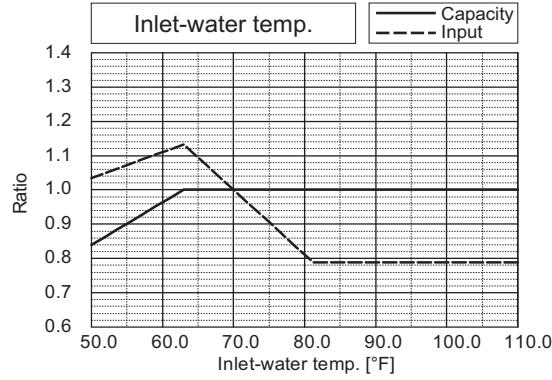

*The drawing indicates characteristic per unit.



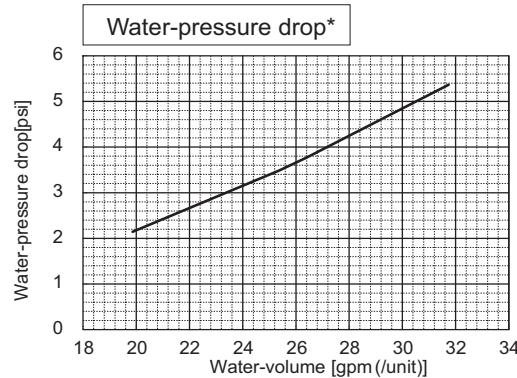
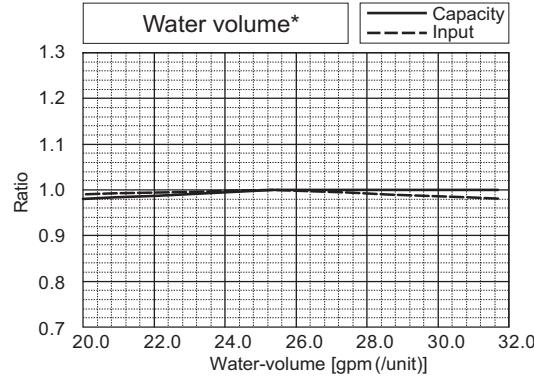


*The drawing indicates characteristic per unit.





6. CAPACITY TABLES

U11 2nd

PQHY-		P288ZSKMU			
Nominal Cooling Capacity	kW BTU/h	84.4 288,000	Rated Cooling Capacity	kW BTU/h	80.6 275,000
Input	kW	19.98	Input	kW	(Non-Ducted) 16.42 (Ducted) 18.59

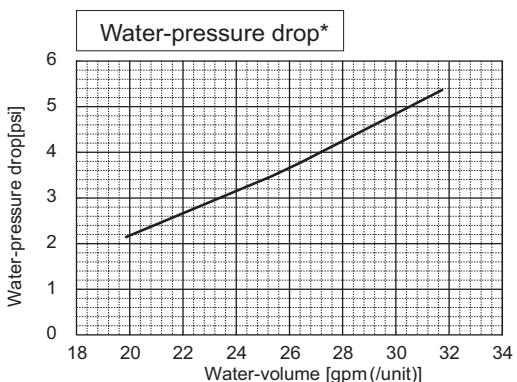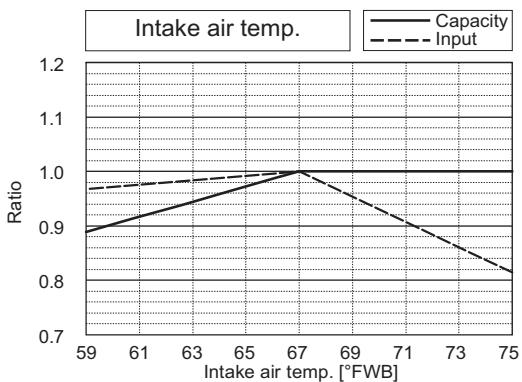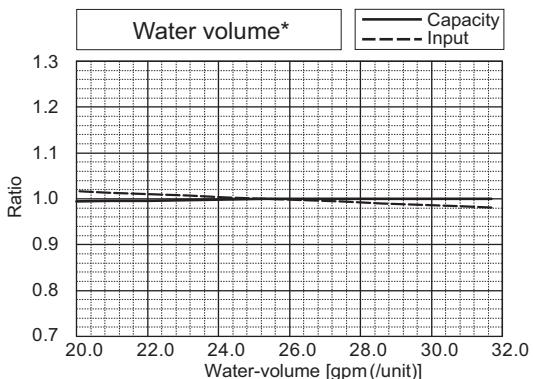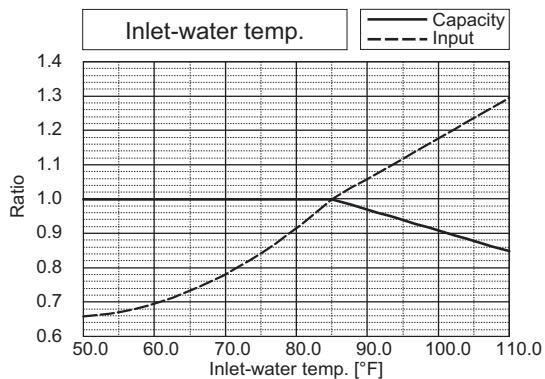

PQHY-		P288ZSKMU			
Nominal Heating Capacity	kW BTU/h	94.7 323,000	Rated Heating Capacity	kW BTU/h	90.3 308,000
Input	kW	19.55	Input	kW	(Non-Ducted) 17.31 (Ducted) 18.19

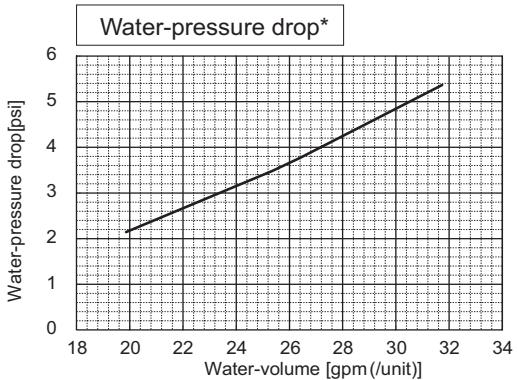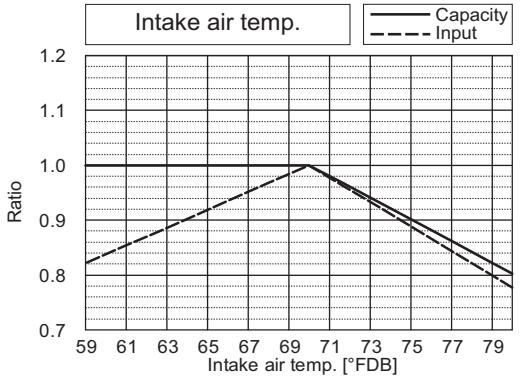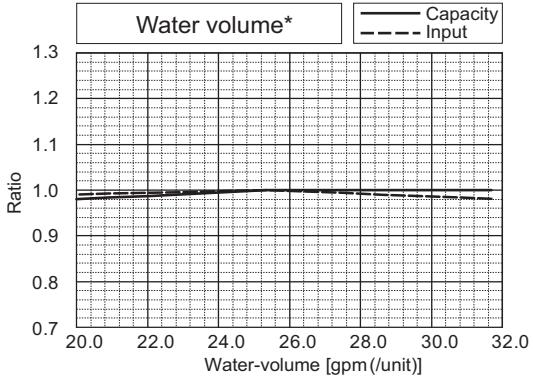
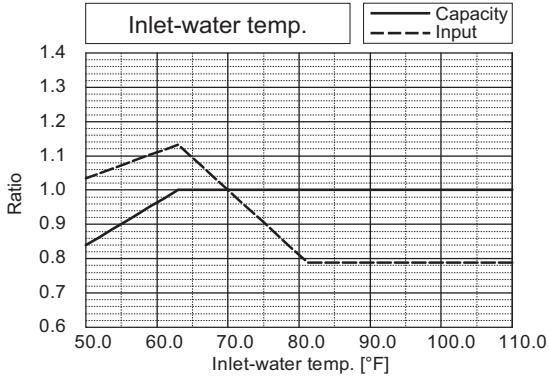


*The drawing indicates characteristic per unit.





6. CAPACITY TABLES

U11 2nd

PQHY-		P312ZSKMU			
Nominal Cooling Capacity	kW	91.4	Rated Cooling Capacity	kW	87.0
	BTU/h	312,000		BTU/h	297,000
Input	kW	22.41	Input	kW	(Non-Ducted) 19.28 (Ducted) 20.85

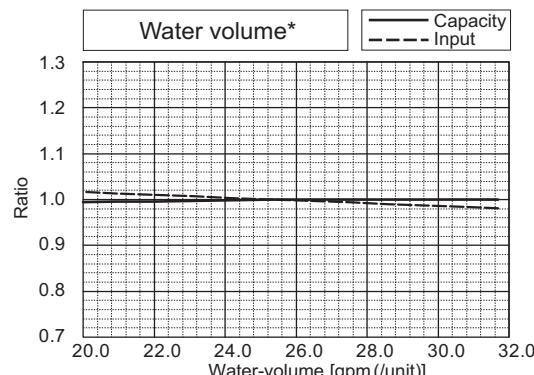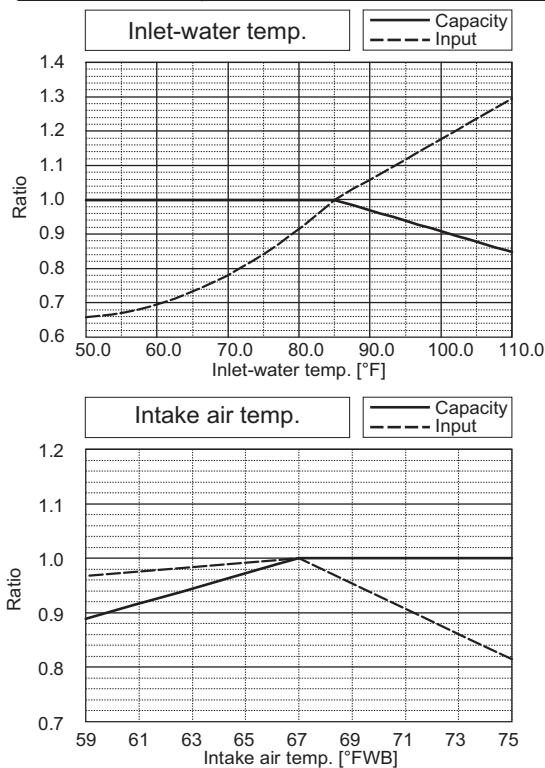

PQHY-		P312ZSKMU			
Nominal Heating Capacity	kW	102.6	Rated Heating Capacity	kW	97.9
	BTU/h	350,000		BTU/h	334,000
Input	kW	21.52	Input	kW	(Non-Ducted) 20.10 (Ducted) 20.02

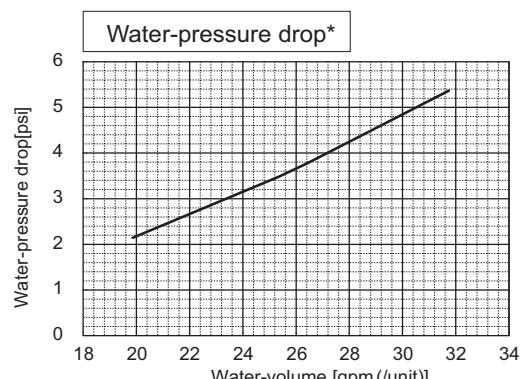
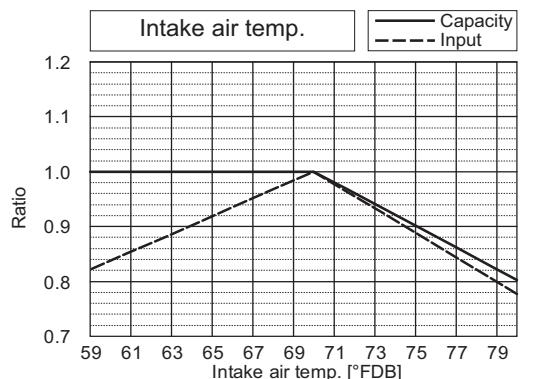
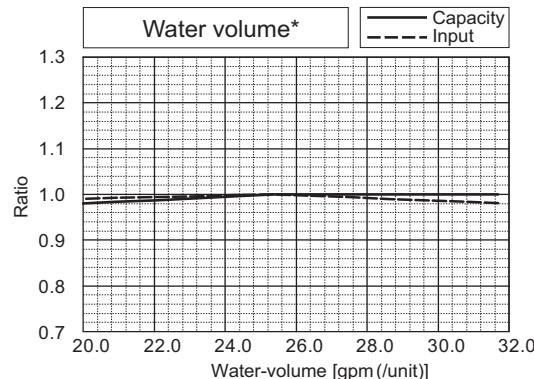
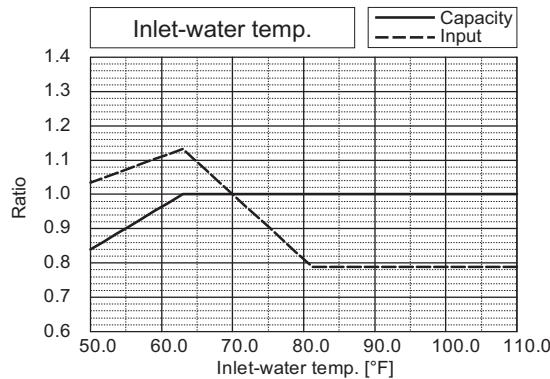


*The drawing indicates characteristic per unit.





6. CAPACITY TABLES

U11 2nd

PQHY-		P336ZSKMU			
Nominal Cooling Capacity	kW BTU/h	98.5 336,000	Rated Cooling Capacity	kW BTU/h	93.8 320,000
Input	kW	24.86	Input	kW	(Non-Ducted) 22.51 (Ducted) 23.13

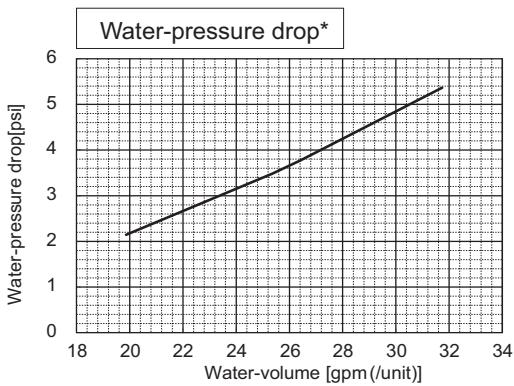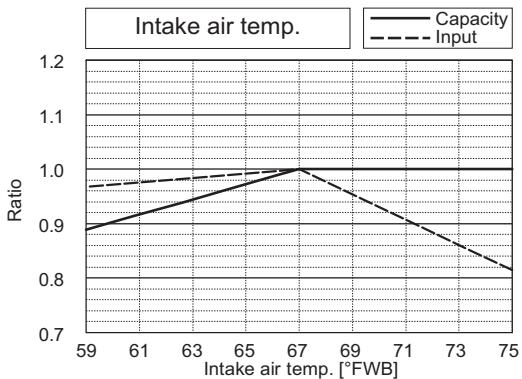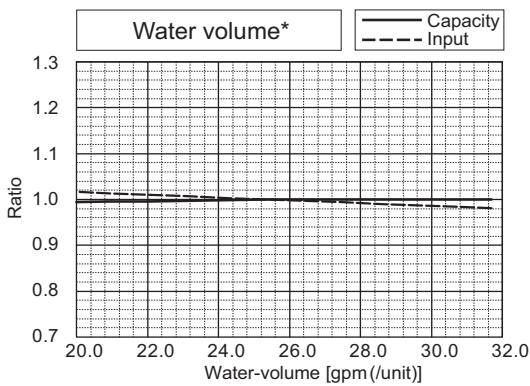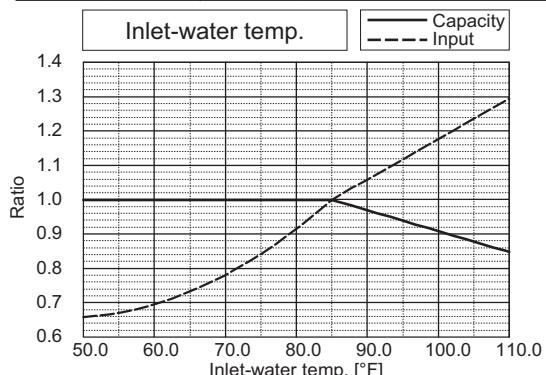

PQHY-		P336ZSKMU			
Nominal Heating Capacity	kW BTU/h	110.8 378,000	Rated Heating Capacity	kW BTU/h	105.8 361,000
Input	kW	23.68	Input	kW	(Non-Ducted) 23.32 (Ducted) 22.03

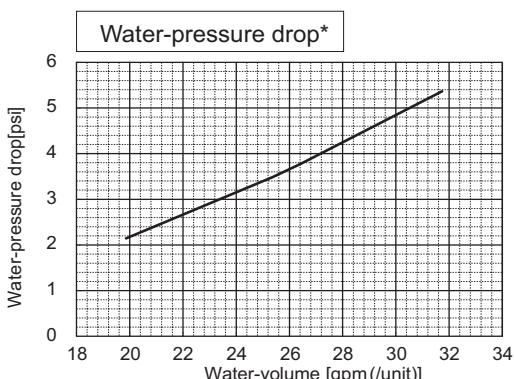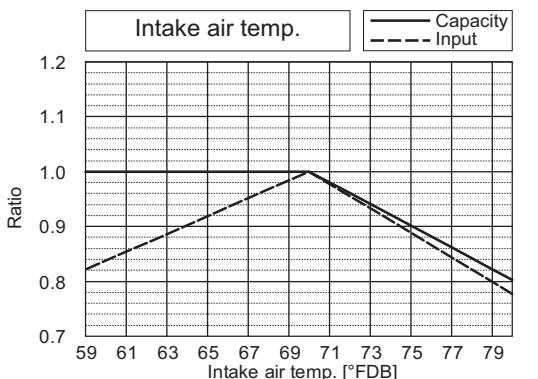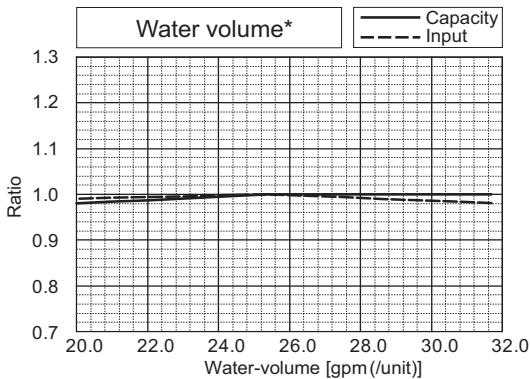
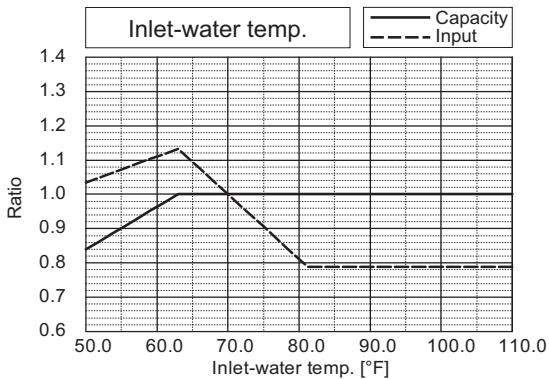


*The drawing indicates characteristic per unit.





6. CAPACITY TABLES

U11 2nd

PQHY-		P360ZSKMU			
Nominal Cooling Capacity	kW	105.5	Rated Cooling Capacity	kW	100.2
	BTU/h	360,000	BTU/h	342,000	
Input	kW	27.35	Input	kW	(Non-Ducted) 26.39 (Ducted) 25.45

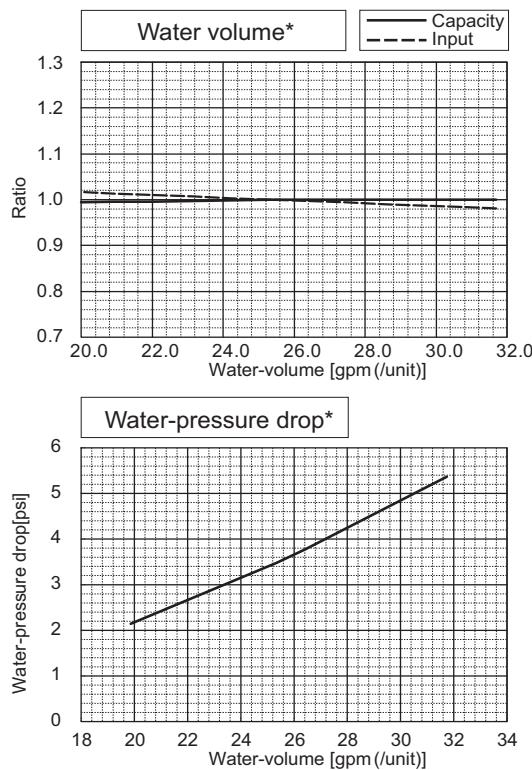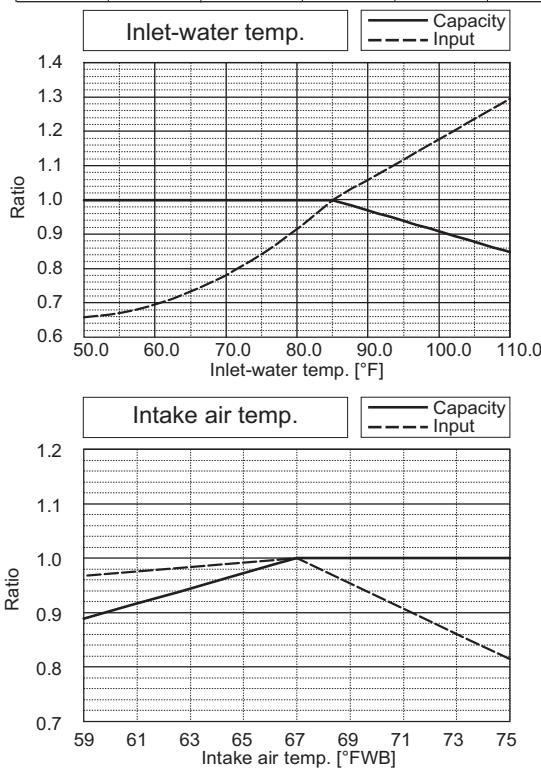


PQHY-		P360ZSKMU			
Nominal Heating Capacity	kW	118.7	Rated Heating Capacity	kW	113.4
	BTU/h	405,000	BTU/h	387,000	
Input	kW	25.75	Input	kW	(Non-Ducted) 26.85 (Ducted) 23.96

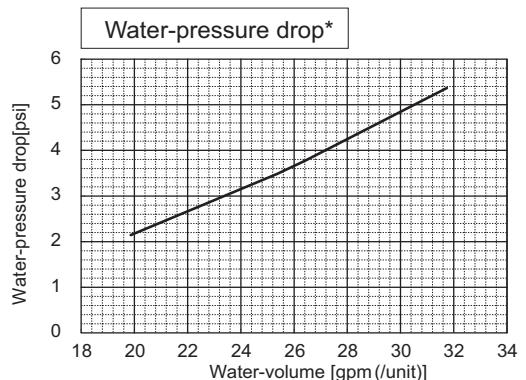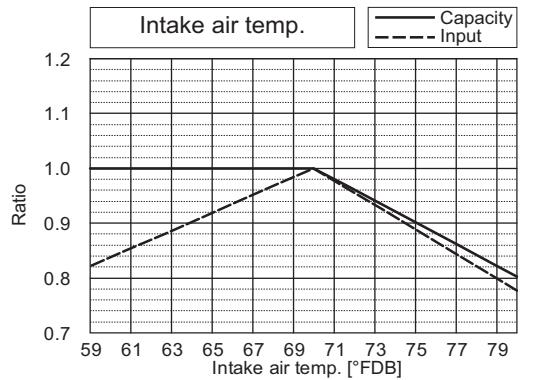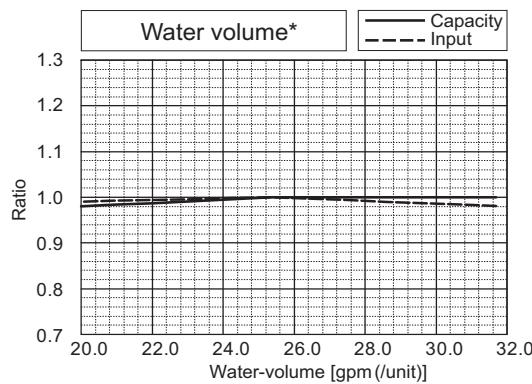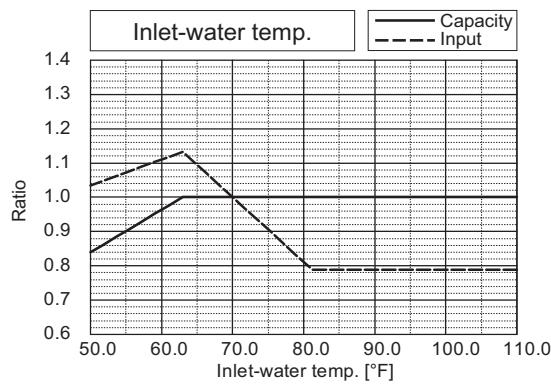

*The drawing indicates characteristic per unit.



6-2. Correction by total indoor

CITY MULTI system have different capacities and inputs when many combinations of indoor units with different total capacities are connected. Using following tables, the maximum capacity can be found to ensure the system is installed with enough capacity for a particular application.

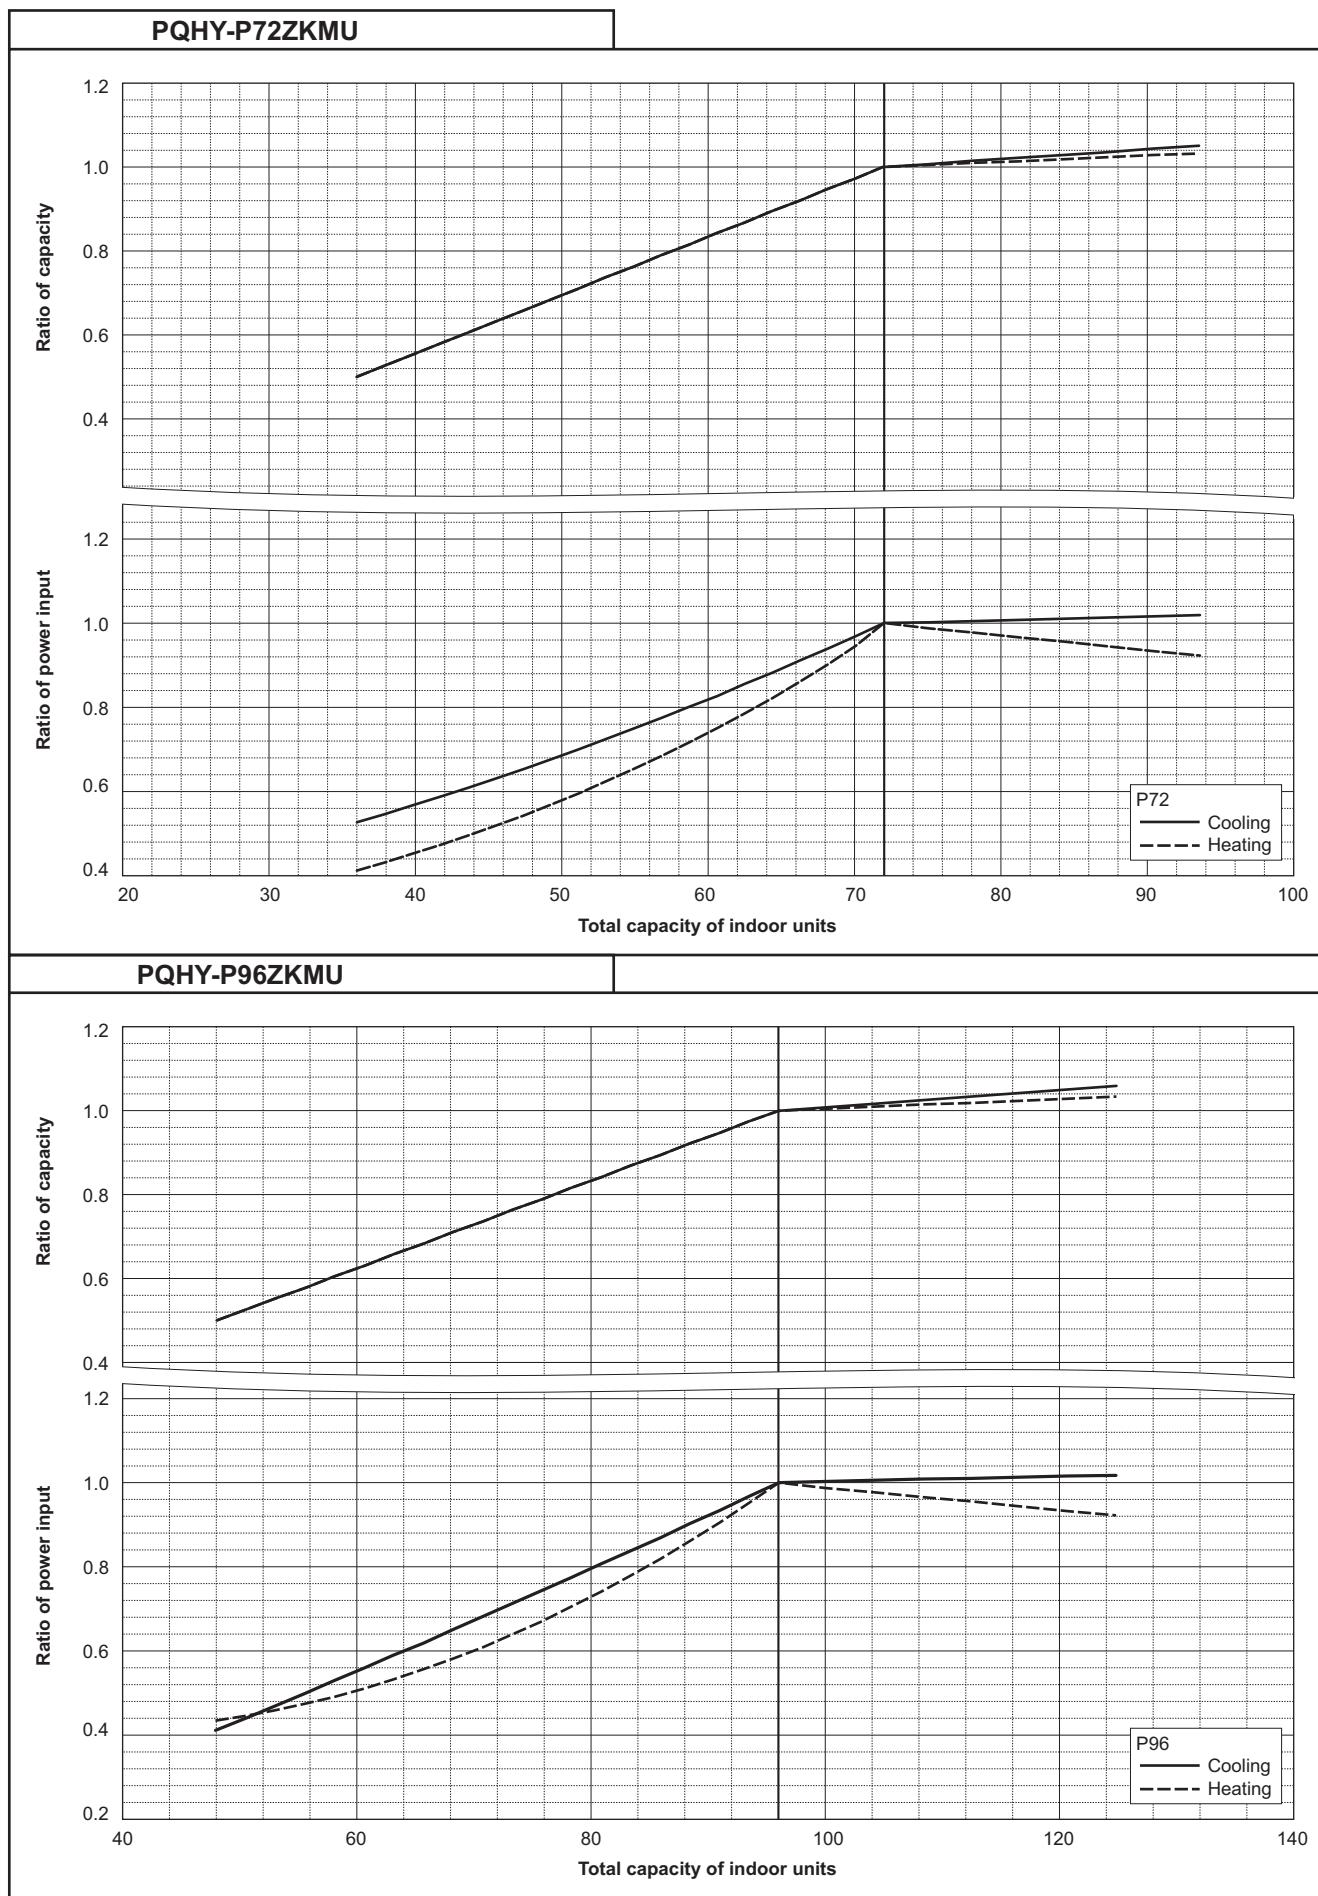

6. CAPACITY TABLES


U11 2nd

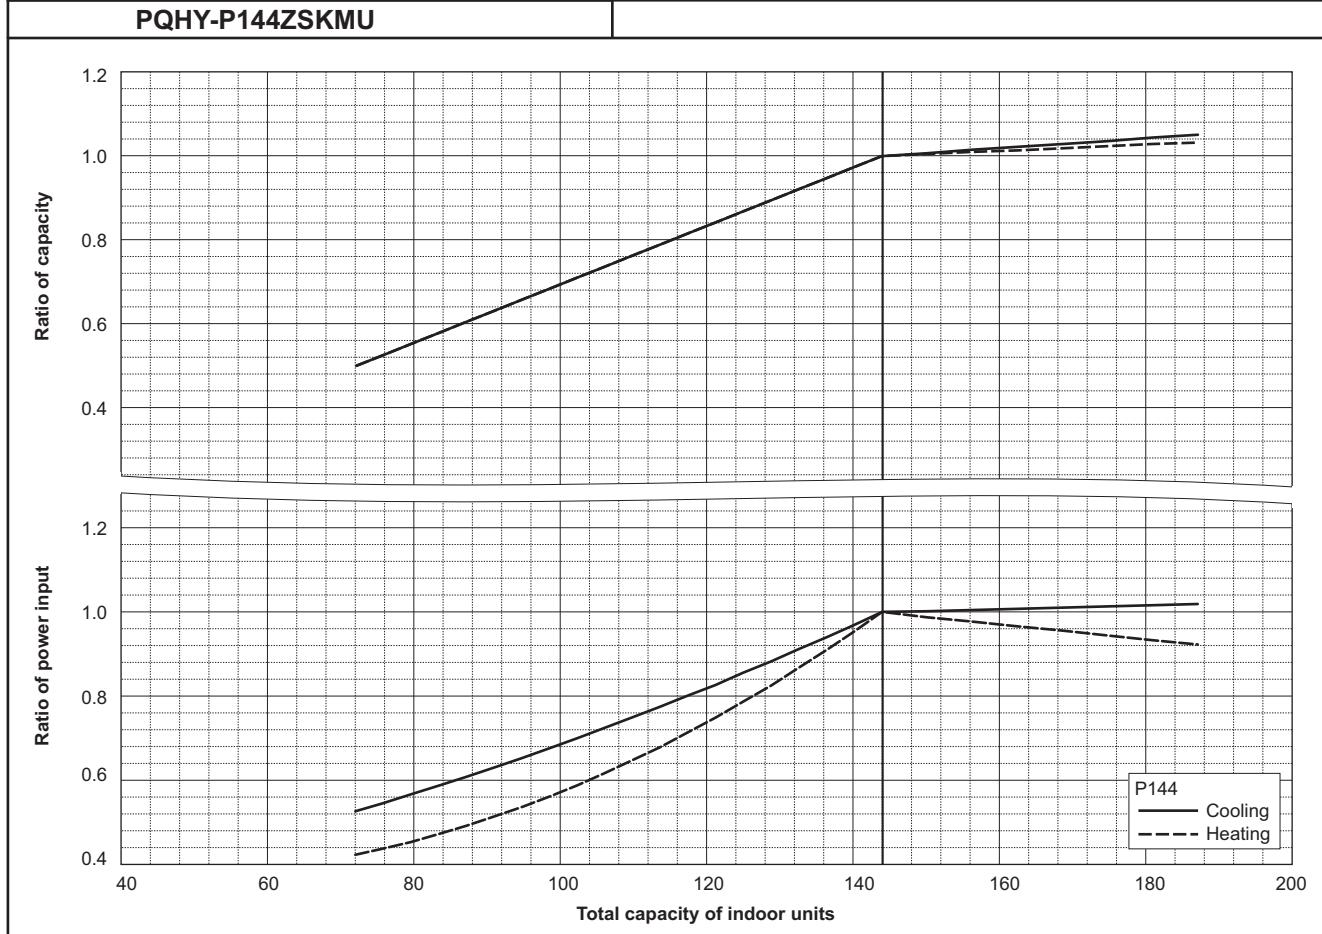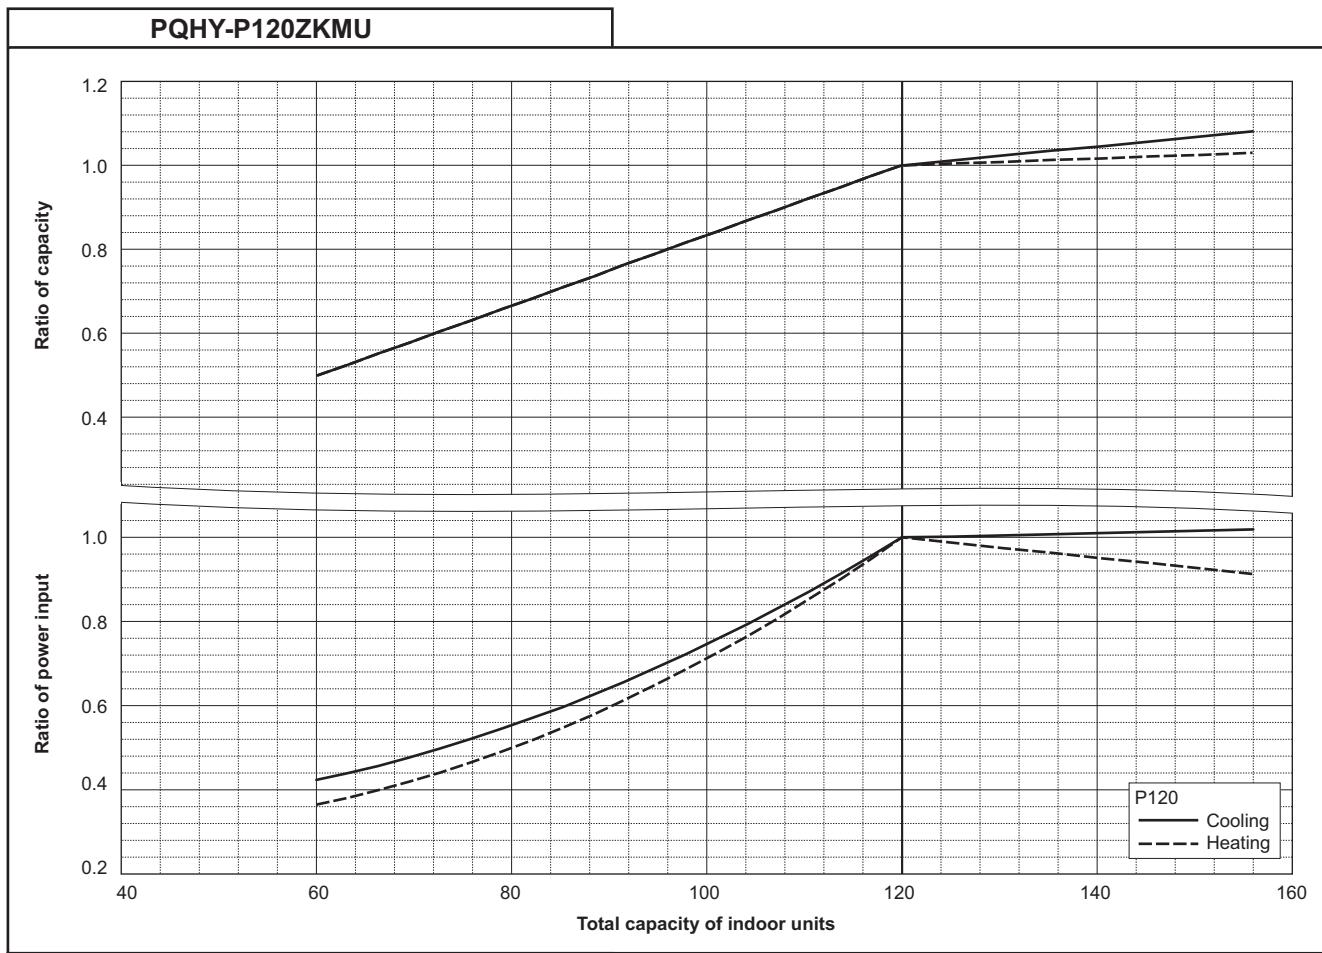


6. CAPACITY TABLES

U11 2nd

PQHY-P168ZSKMU


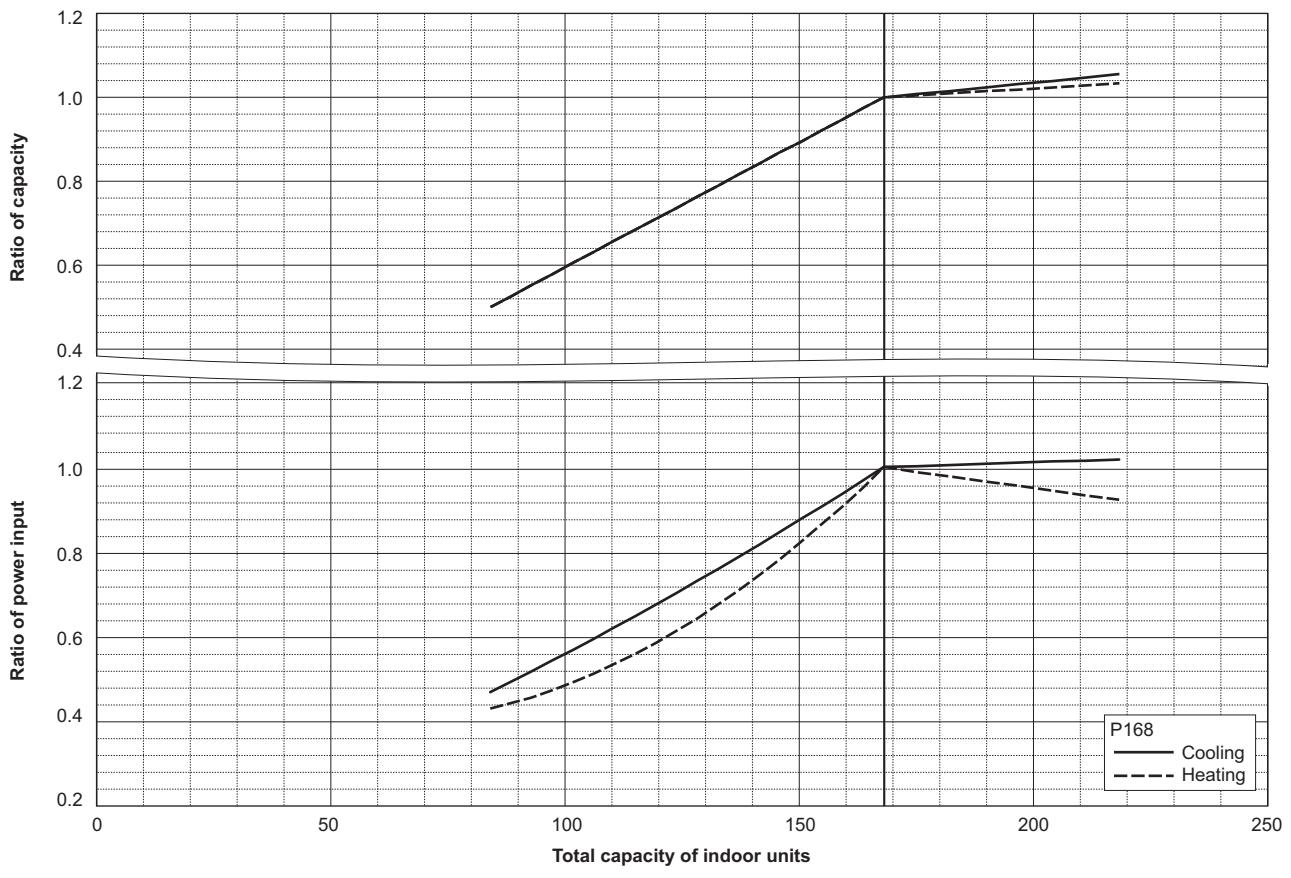


PQHY-P192ZSKMU

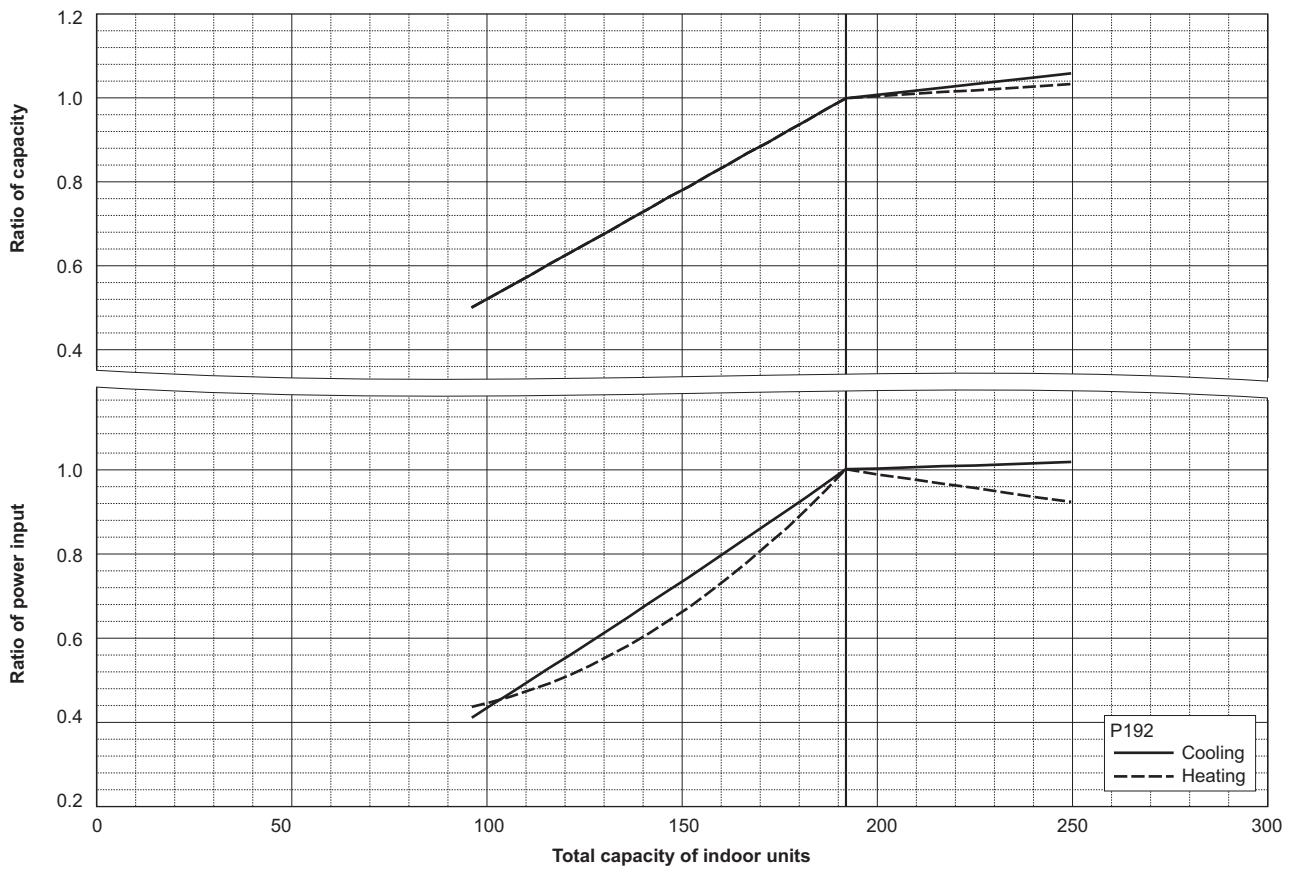

6. CAPACITY TABLES


U11 2nd

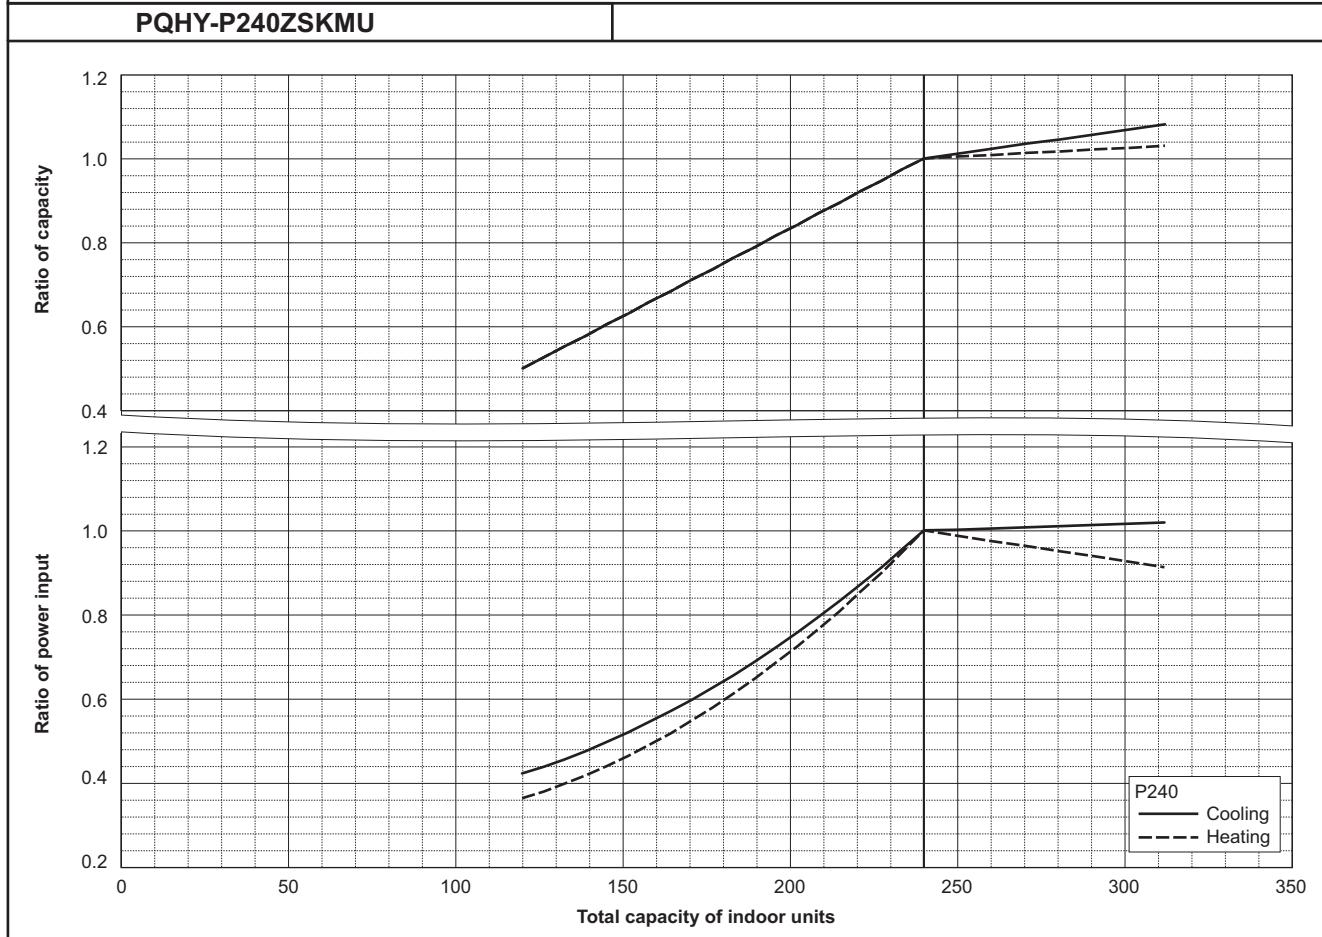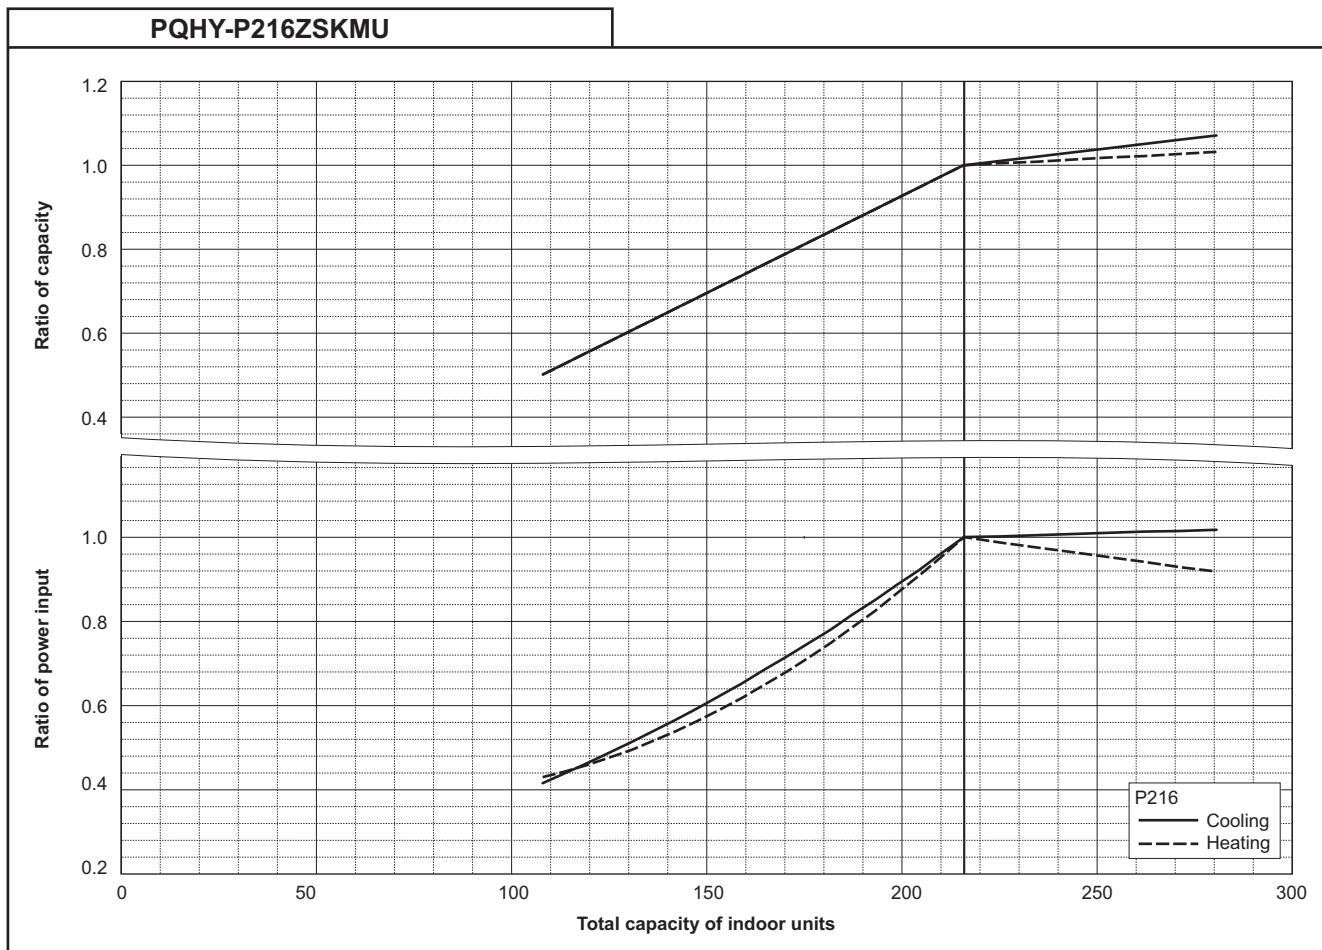


6. CAPACITY TABLES



U11 2nd

PQHY-P264ZSKMU

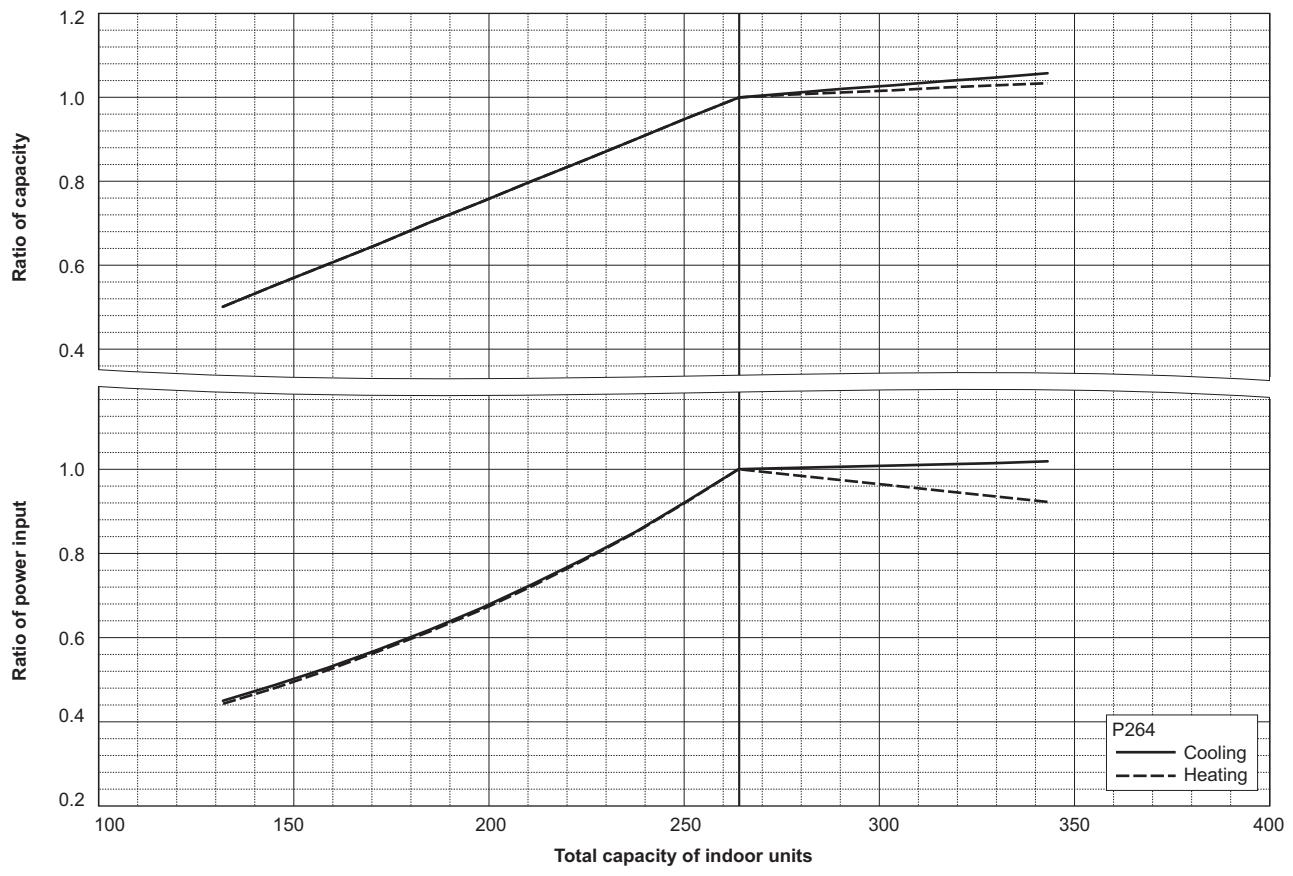


PQHY-P288ZSKMU

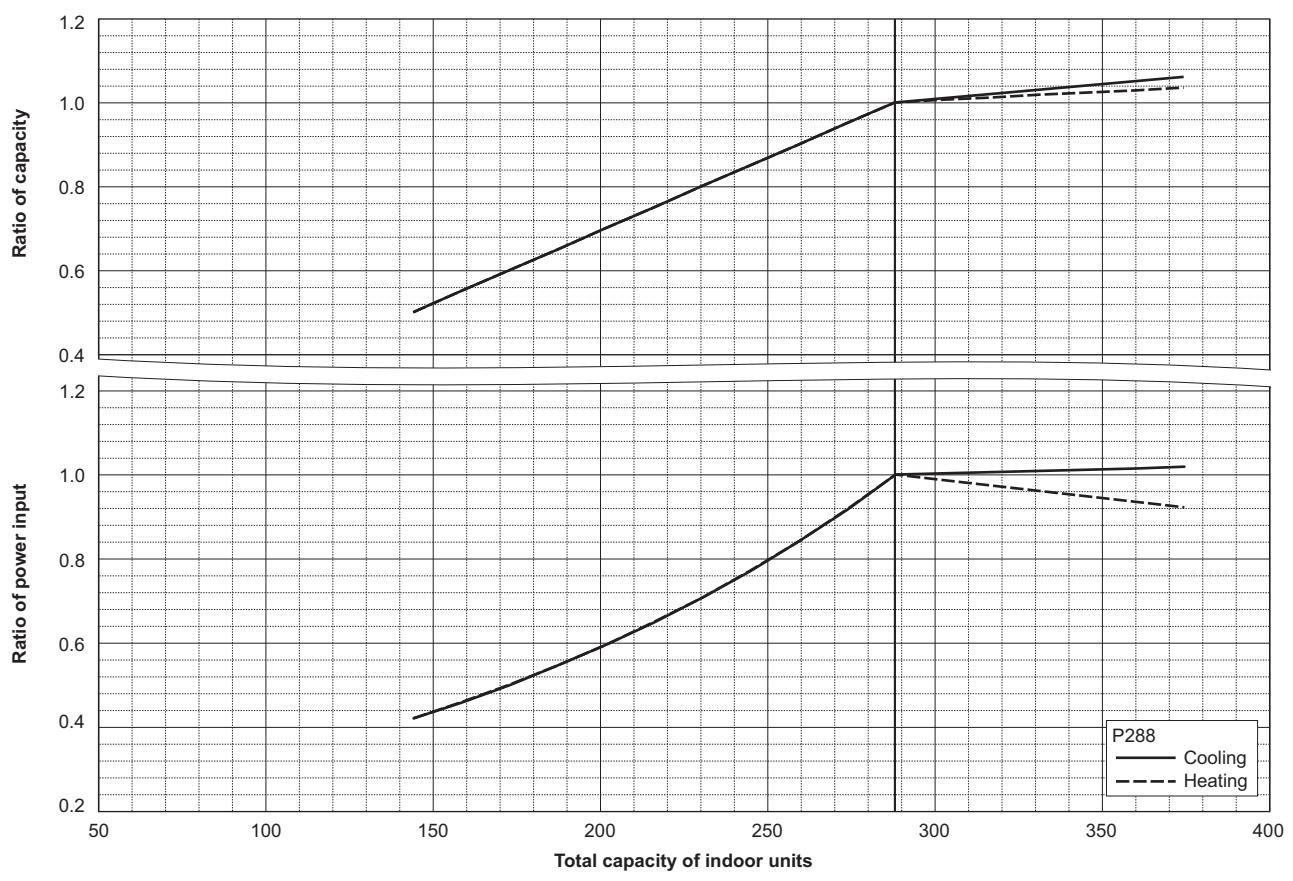

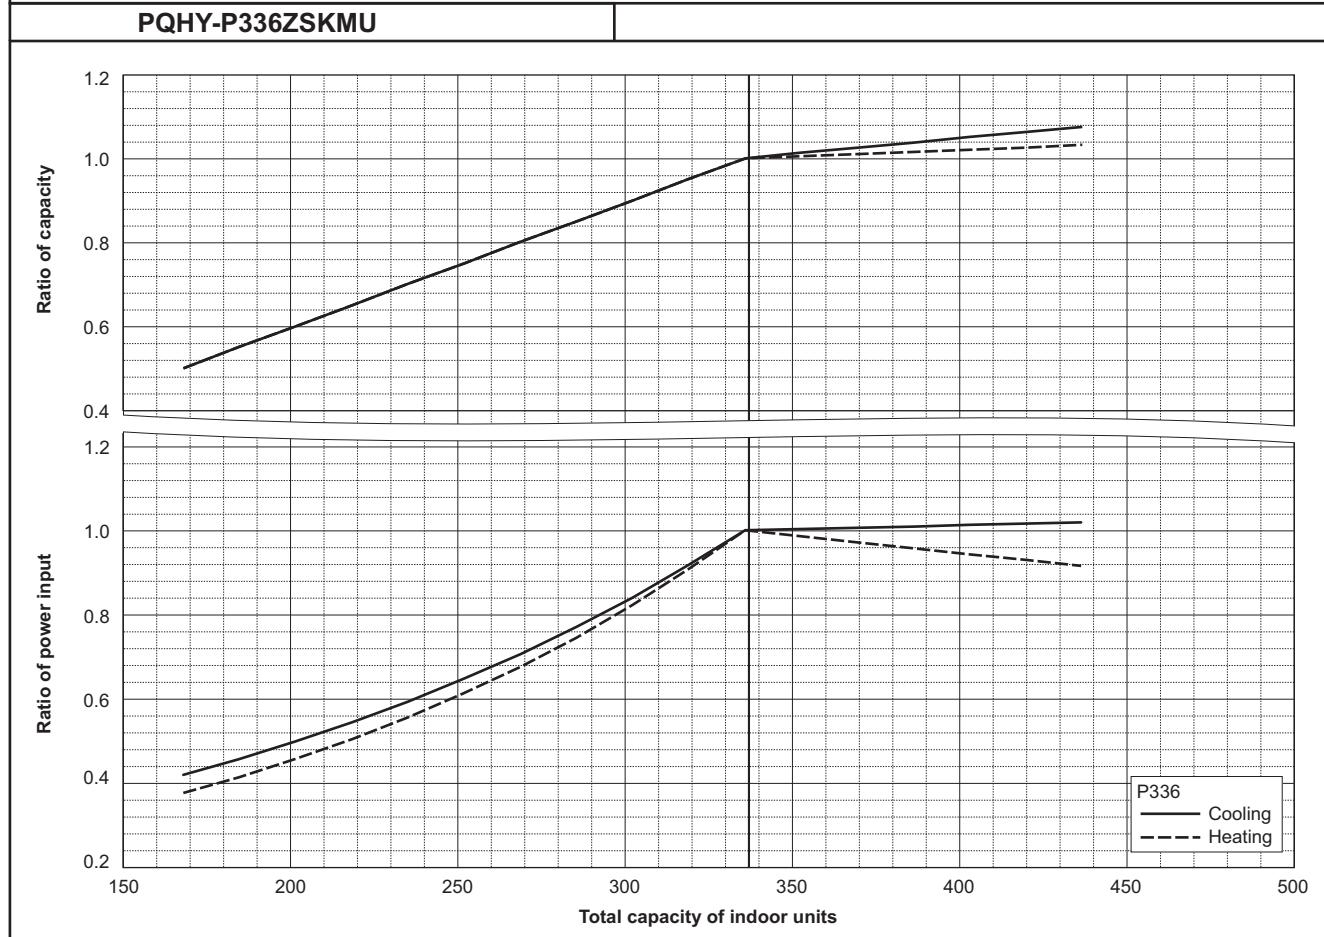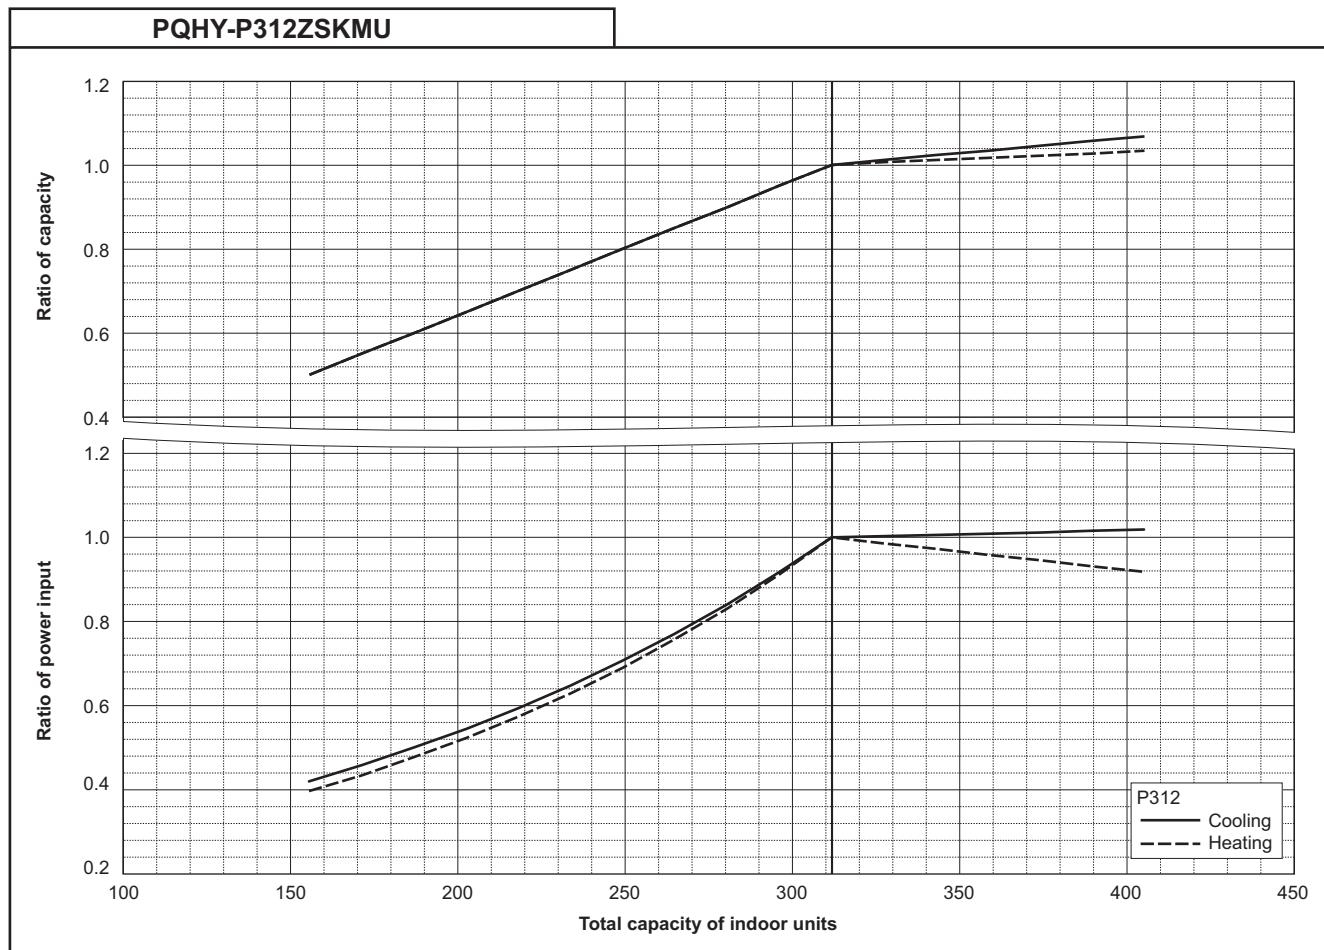

6. CAPACITY TABLES


U11 2nd

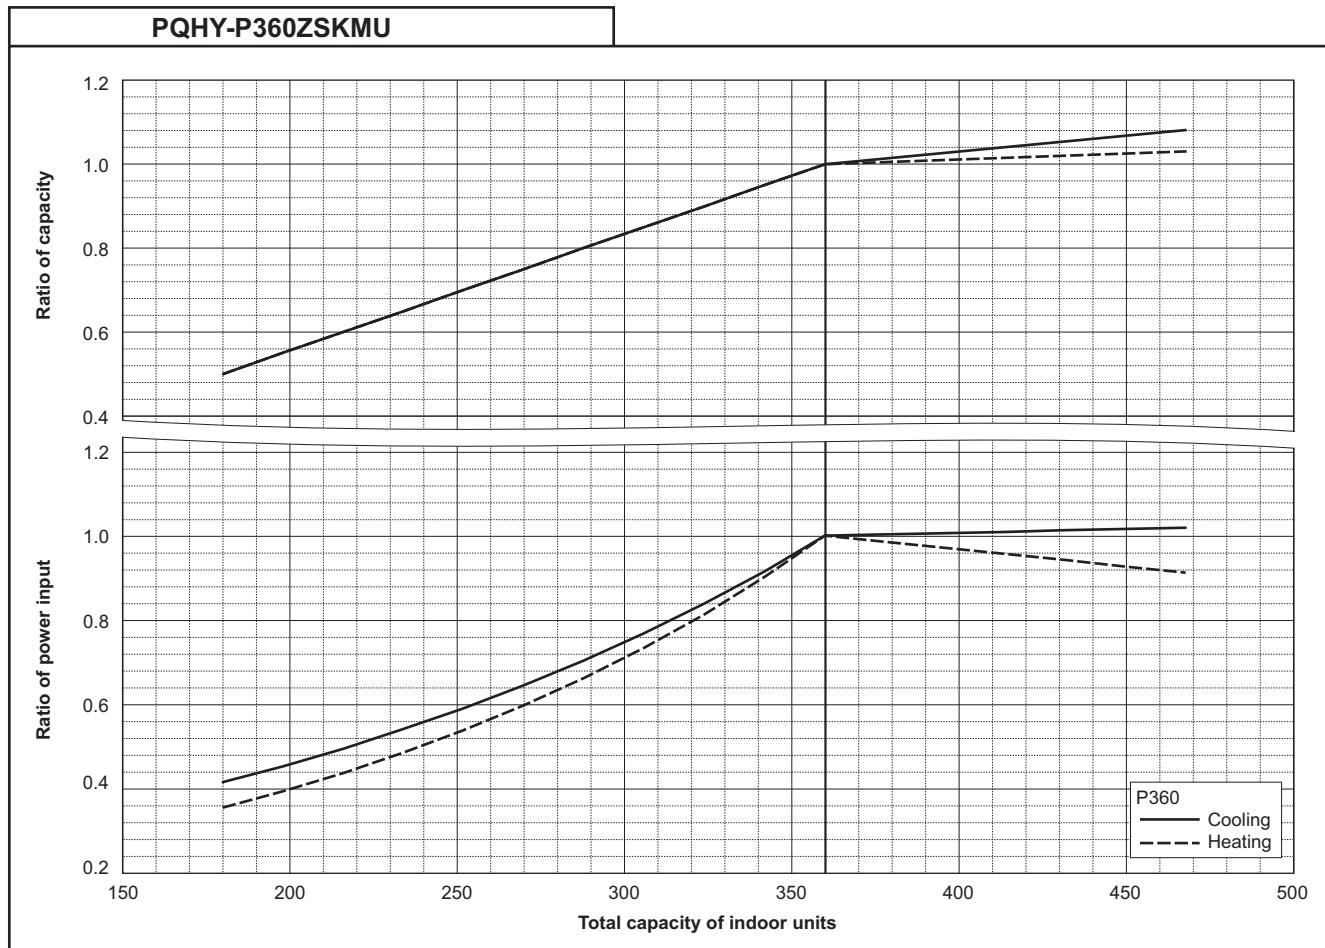

6-3. Correction by refrigerant piping length


CITY MULTI system can extend the piping flexibly within its limitation for the actual situation. However, a decrease of cooling/heating capacity could happen correspondently. Using following correction factor according to the equivalent length of the piping shown at 6-3-1 and 6-3-2, the capacity can be observed. 6-3-3 shows how to obtain the equivalent length of piping.

6-3-1. Cooling capacity correction

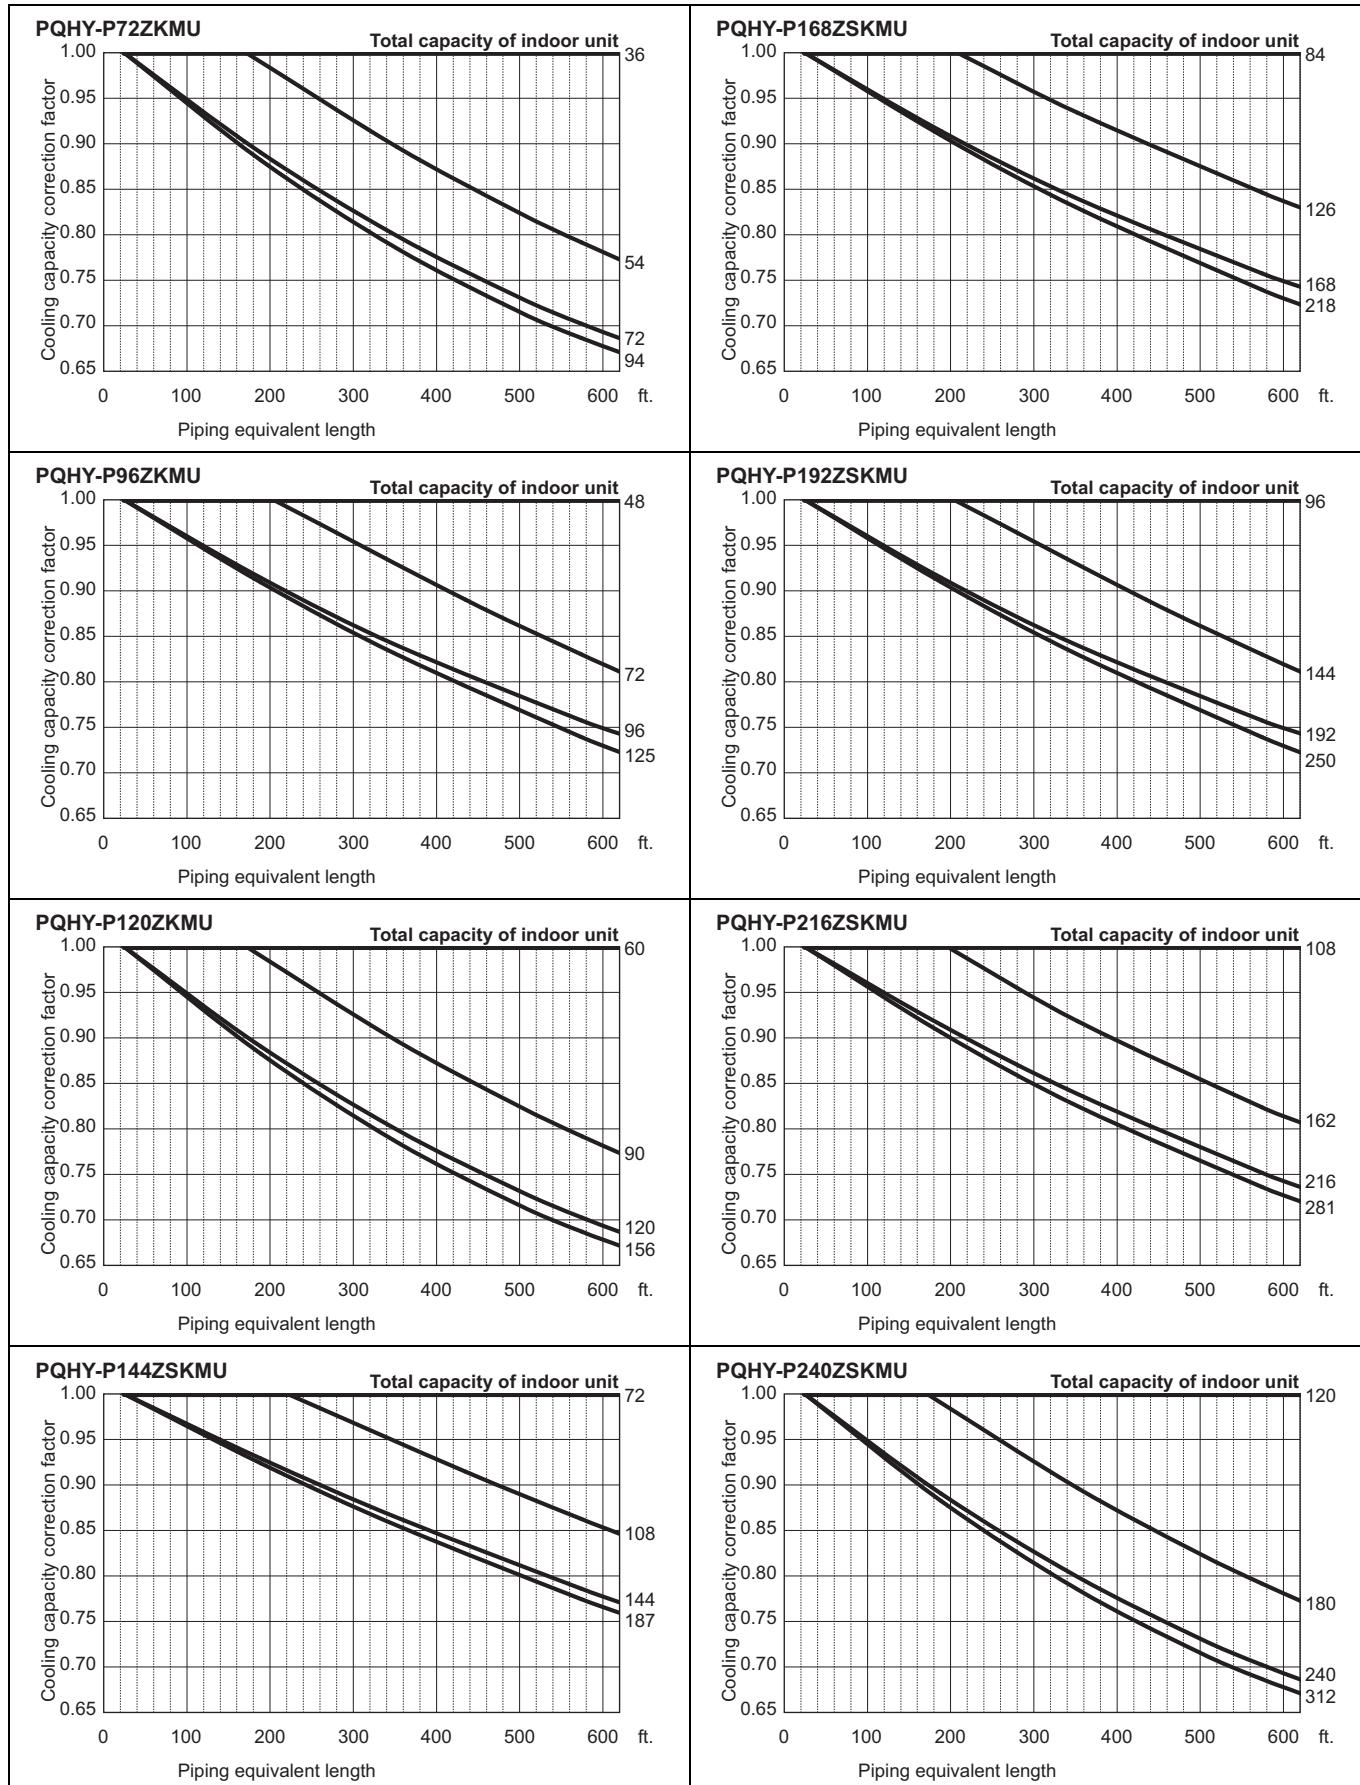


6. CAPACITY TABLES

U11 2nd

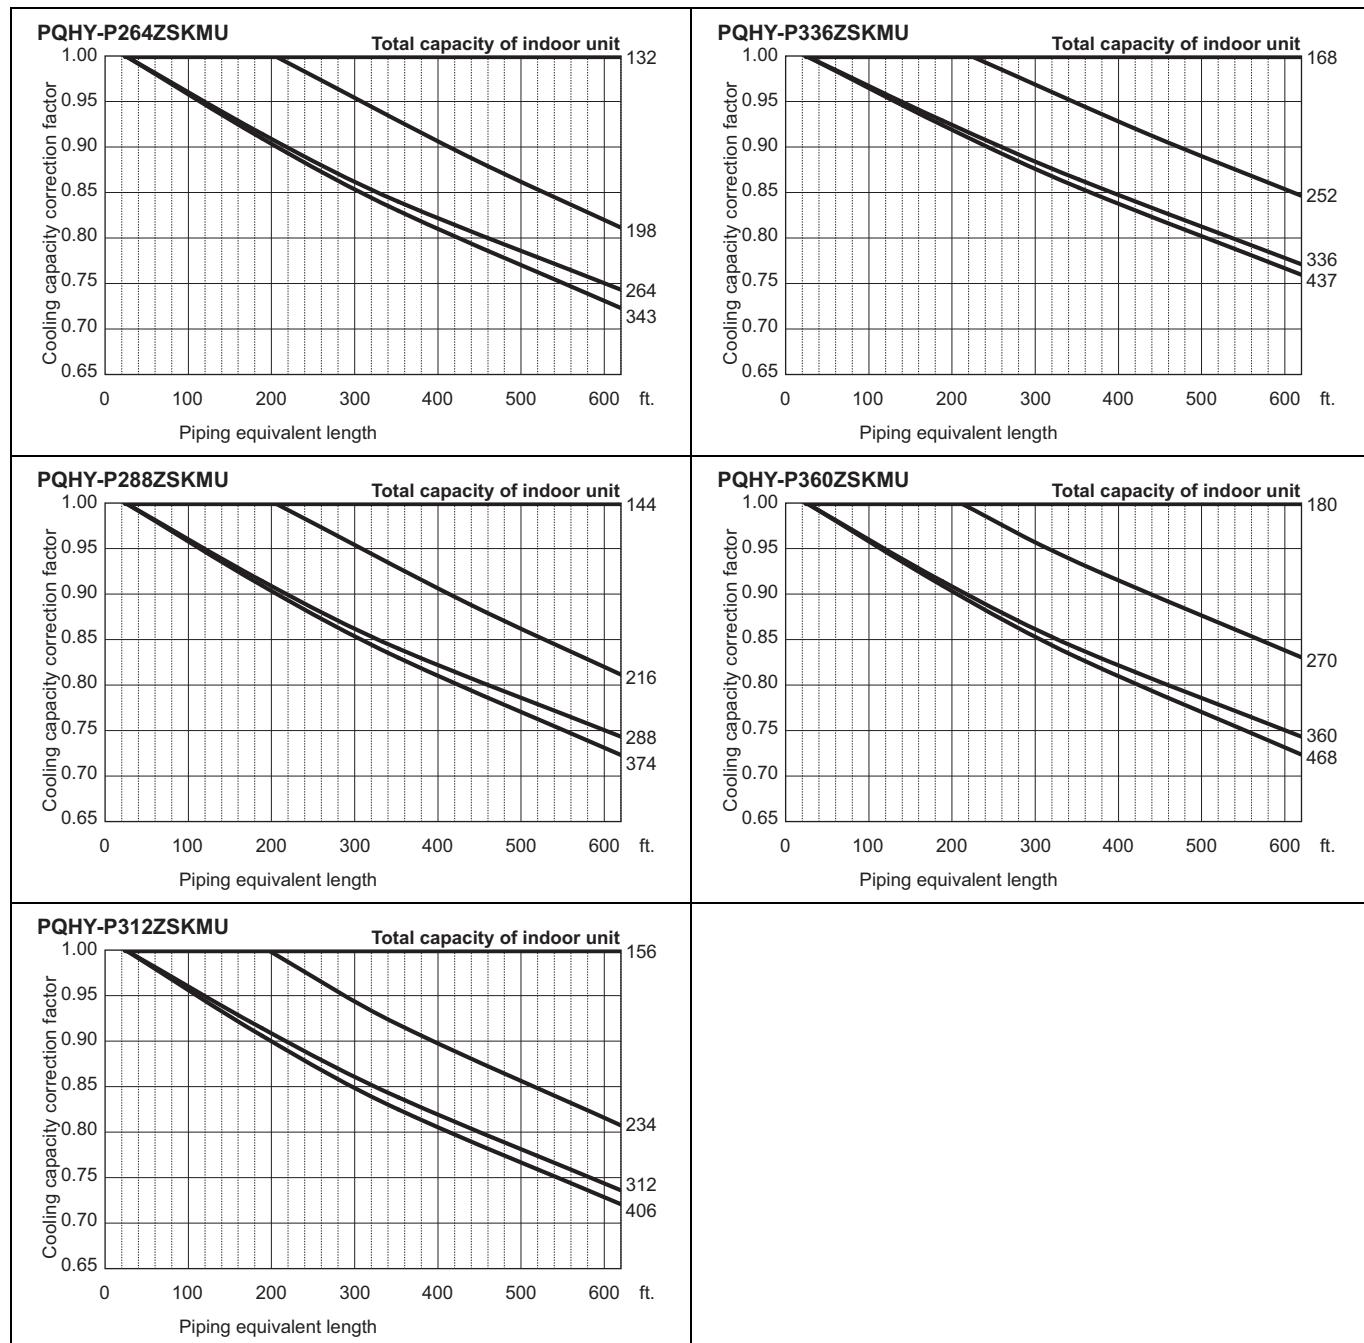

6-3-2. Heating capacity correction

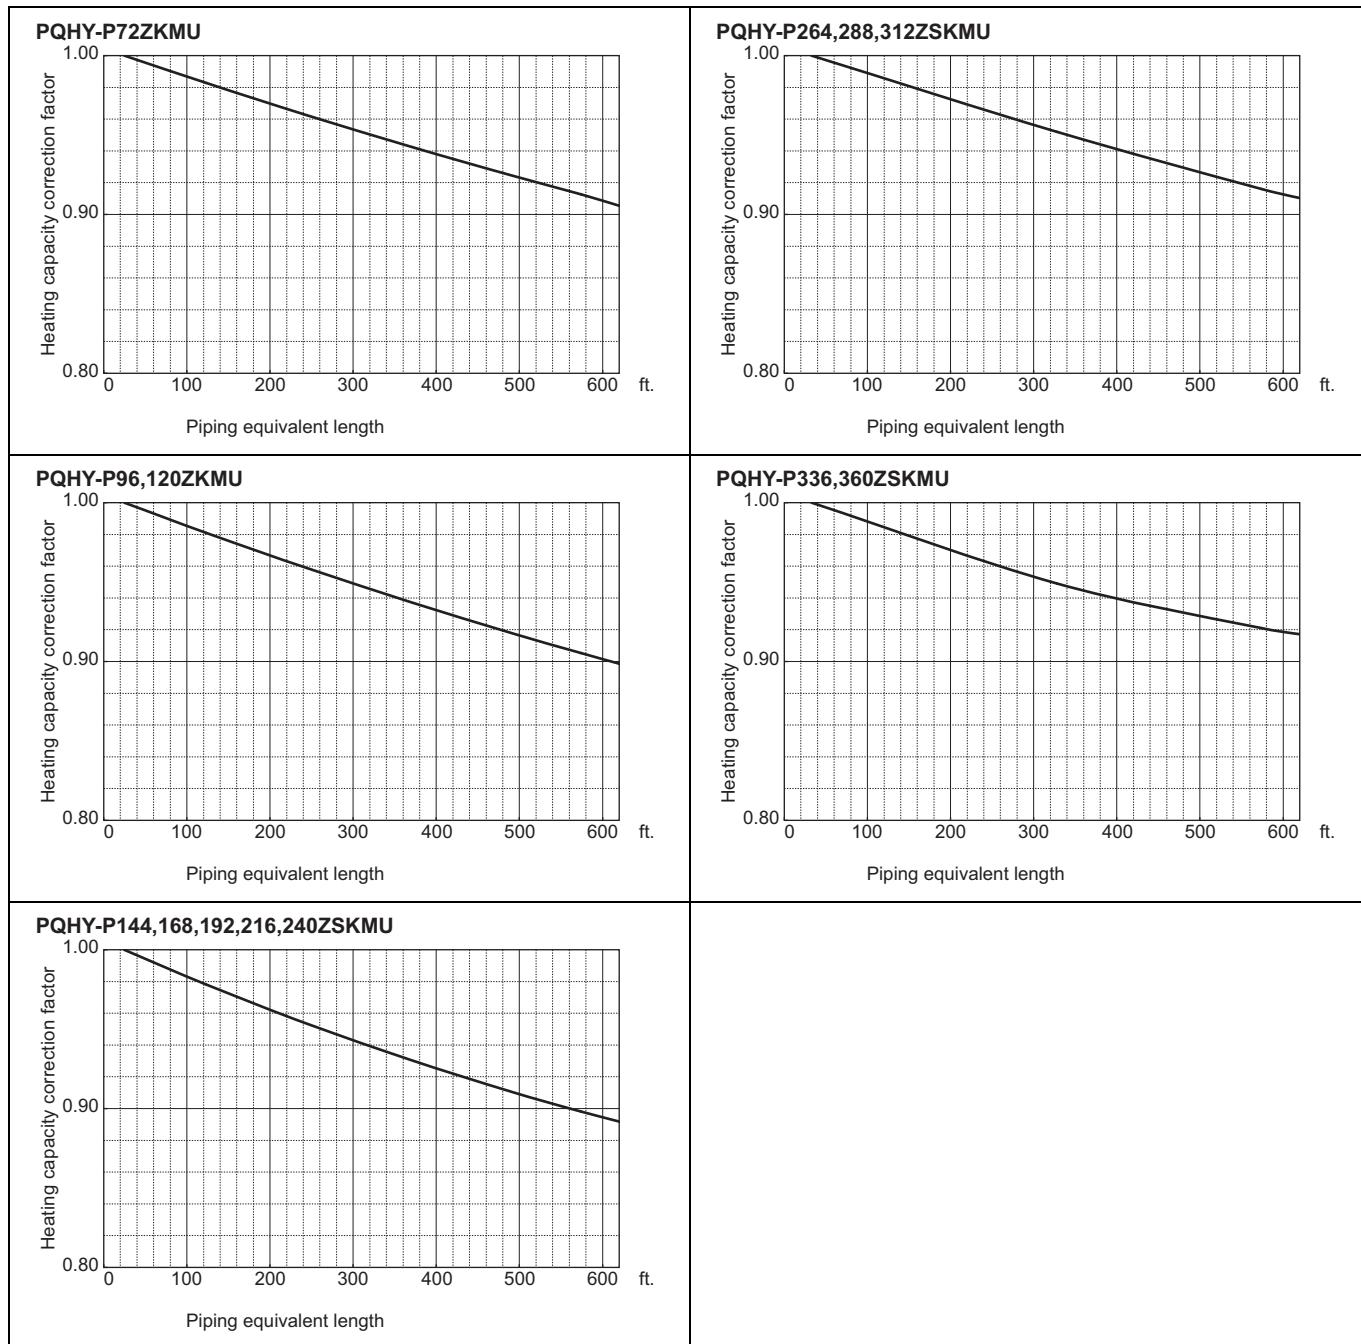

6-3-3. How to obtain the equivalent piping length

1. PQHY-P72ZKMU

Equivalent length = (Actual piping length to the farthest indoor unit) + (1.15 x number of bent on the piping) [ft.]

Equivalent length = (Actual piping length to the farthest indoor unit) + (0.35 x number of bent on the piping) [m]

2. PQHY-P96, 120ZKMU

Equivalent length = (Actual piping length to the farthest indoor unit) + (1.38 x number of bent on the piping) [ft.]

Equivalent length = (Actual piping length to the farthest indoor unit) + (0.42 x number of bent on the piping) [m]

3. PQHY-P144, 168, 192, 216, 240ZSKMU

Equivalent length = (Actual piping length to the farthest indoor unit) + (1.64 x number of bent on the piping) [ft.]

Equivalent length = (Actual piping length to the farthest indoor unit) + (0.50 x number of bent on the piping) [m]

4. PQHY-P264, 288, 312ZSKMU

Equivalent length = (Actual piping length to the farthest indoor unit) + (2.30 x number of bent on the piping) [ft.]

Equivalent length = (Actual piping length to the farthest indoor unit) + (0.70 x number of bent on the piping) [m]


5. PQHY-P336, 360ZSKMU

Equivalent length = (Actual piping length to the farthest indoor unit) + (2.63 x number of bent on the piping) [ft.]


Equivalent length = (Actual piping length to the farthest indoor unit) + (0.80 x number of bent on the piping) [m]

6-4. Operation temperature range

- Cooling

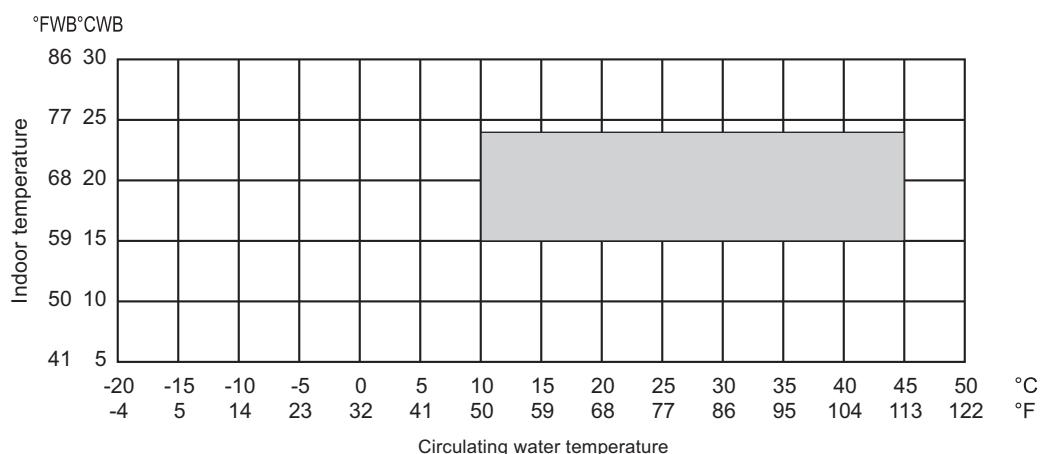

- Heating

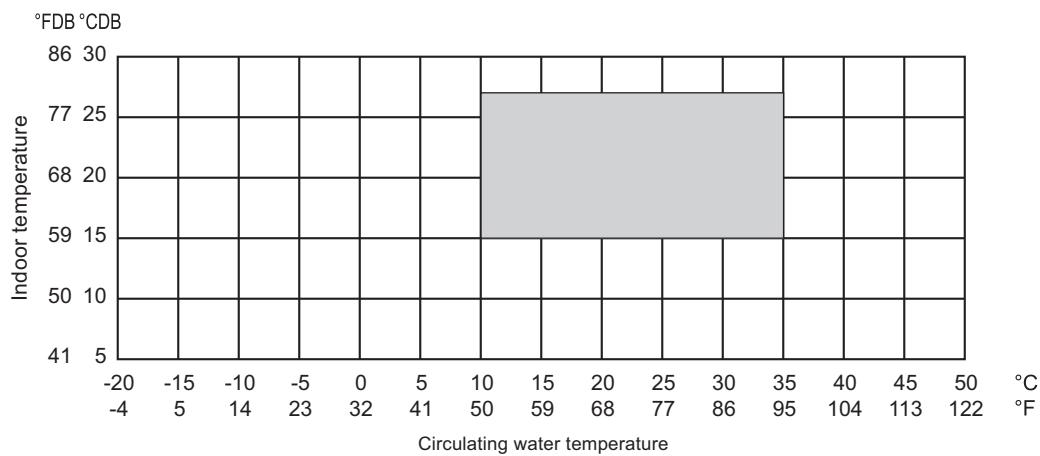

7-1. Designing of water circuit system

1) Example of basic water circuit

The water circuit of the water heat source CITY MULTI connects the heat source unit with the cooling tower/auxiliary heat source/heat storage tank/circulation pump with a single system water piping as shown in the figure below. The selector valve automatically controls to circulate water toward the cooling tower in the cooling season, while toward the heat storage tank in the heating season. If the circulation water temperature is kept in a range of 10~45°C [50~113°F]* regardless of the building load, the water heat source CITY MULTI can be operated for either cooling or heating. Therefore in the summer when only cooling load exists, the temperature rise of circulation water will be suppressed by operating the cooling tower. While in the winter when heating load increases, the temperature of circulation water may be dropped below 10°C [50°F]. Under such situation, the circulation water will be heated with the auxiliary heat source if it drops below a certain temperature.

When the thermal balance between cooling and heating operation is in a correct proportion, the operation of the auxiliary heat source and cooling tower is not required.


In order to control the above thermal balance properly and use thermal energy effectively, utilizing of heat storage tanks, and night-time discounted electric power as a auxiliary heat source will be economical.

Meantime as this system uses plural sets of heat source unit equipped with water heat exchangers, water quality control is important. Therefore it is recommended to use closed type cooling towers as much as possible to prevent the circulation water from being contaminated.

When open type cooling towers are used, it is essential to provide proper maintenance control such as that to install water treatment system to prevent troubles caused by contaminated circulation water.

*10~45°C [50~113°F] : 50%~130% of indoor units can be connected

Example of basic water circuit for water heat source CITY MULTI

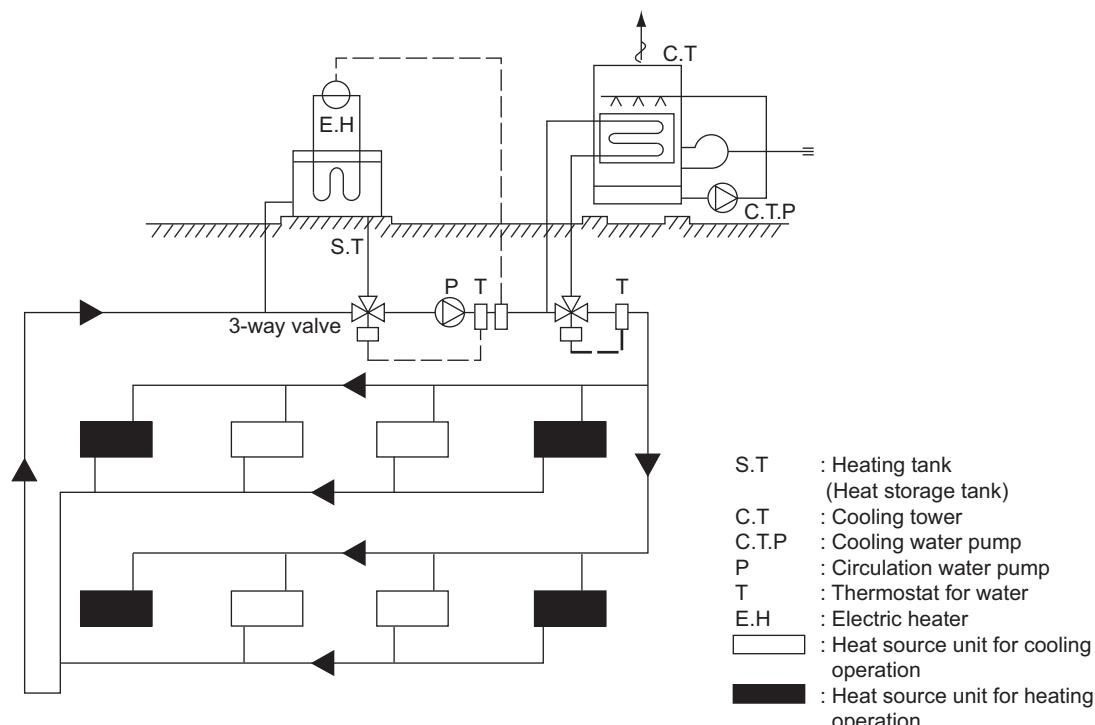

The indoor unit and refrigerant piping system are excluded in this figure.

2) Cooling tower

a) Types of cooling tower



The cooling towers presently used include the open type cooling tower, open type cooling tower + heat exchanger, closed type cooling tower, and air-cooled type cooling tower. However, as the quality control of circulation water is essential when units are installed in decentralized state inside a building, the closed type cooling tower is generally employed in such case.

Although the circulation water will not be contaminated by atmospheric air, it is recommended to periodically blow water inside the system and replenish fresh water instead.

In a district where the coil may be frozen in the winter, it is necessary to apply antifreeze solution to the circulation water, or take freeze protection measures such as to automatically discharge water inside the cooling coil at the stopping of the pump.

When the open type cooling tower is used, be sure to install a water quality control device in addition to the freeze protection measures, as the water may be deteriorated by atmospheric contaminants entered into the cooling tower and dissolved into the circulation water.

Types of cooling towers

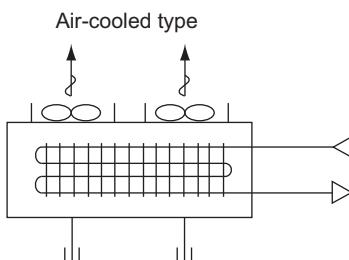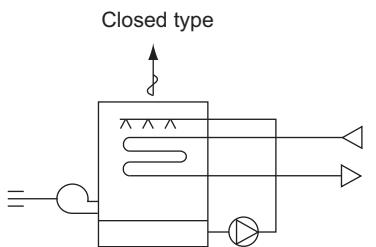

b) Calculation method of cooling tower capacity

All units of the water heat source CITY MULTI may possibly be in cooling operation temporarily (at pulling down) in the summer, however, it is not necessary to determine the capacity according to the total cooling capacity of all CITY MULTI units as this system has a wide operating water temperature range (10~45°C) [50~113°F].

It is determined in accordance with the value obtained by adding the maximum cooling load of an actual building, the input heat equivalent value of all CITY MULTI units, and the cooling load of the circulating pumps. Please check for the values of the cooling water volume and circulation water volume.

$$\text{Cooling tower capacity} = \frac{Qc + 860 \times (\Sigma Qw + Pw)}{3,900} \text{ (Refrigeration ton)}$$

Qc : Maximum cooling load under actual state (kcal/h)

Qw : Total input of water heat source CITY MULTI at simultaneous operation under maximum state (kW)

Pw : Shaft power of circulation pumps (kW)

$$\text{Cooling tower capacity} = \frac{Qc + 3,412 \times (\Sigma Qw + Pw)}{15,500} \text{ (Refrigeration ton)}$$

Qc : Maximum cooling load under actual state (BTU/h)

Qw : Total input of water heat source CITY MULTI at simultaneous operation under maximum state (kW)

Pw : Shaft power of circulation pumps (kW)

* 1 Refrigerant ton of cooling tower capacity \approx US refrigerant ton \times (1 + 0.3)
 $= 3,900 \text{ kcal/h} = 15,500 \text{ BTU/h}$

3) Auxiliary heat source and heat storage tank

When the heating load is larger than the cooling load, the circulation water temperature lowers in accordance with the heat balance of the system. It should be heated by the auxiliary heat source in order to keep the inlet water temperature within the operating range (10°C [50°F] or more) of the water heat source CITY MULTI.

Further in order to operate the water heat source CITY MULTI effectively, it is recommended to utilize the heat storage tank to cover the warming up load in the morning and the insufficient heat amount.

Effective heat utilization can be expected to cover insufficient heat at the warming up in the next morning or peak load time by storing heat by installing a heat storage tank or operating a low load auxiliary heat source at the stopping of the water heat source CITY MULTI. As it can also be possible to reduce the running cost through the heat storage by using the discounted night-time electric power, using both auxiliary heat source and heat storage tank together is recommended. The effective temperature difference of an ordinary heat storage tank shows about 5°C [41°F] even with the storing temperature at 45°C [113°F].

However with the water heat source CITY MULTI, it can be utilized as heating heat source up to 15°C [59°F] with an effective temperature of a high 30°C [54°F] approximately, thus the capacity of the heat storage tank can be minimized.

a) Auxiliary heat source

The following can be used as the auxiliary heat source.

- Boiler (Heavy oil, kerosine, gas, electricity)
- Electric heat (Insertion of electric heater into heat storage tank)
- Outdoor air (Air-heat source heat pump chiller)
- Warm discharge water (Exhaust water heat from machines inside building and hot water supply)
- Utilization of night-time lighting
- Solar heat

Please note that the auxiliary heat source should be selected after studying your operating environment and economical feasibility.

Determining the auxiliary heat source capacity

For the CITY MULTI water heat source system, a heat storage tank is recommended to use. When employment of the heat storage tank is difficult, the warming up operation should be arranged to cover the starting up heating load. Since the holding water inside the piping circuit owns heat capacity and the warming up operation can be assumed for about one hour except that in a cold region, the heat storage tank capacity is required to be that at the maximum daily heating load including the warming up load at the next morning of the holiday. However the auxiliary heat source capacity should be determined by the daily heating load including warming up load on the week day.

For the load at the next morning of the holiday, heat storage is required by operating the auxiliary heat source even outside of the ordinary working hour.

When heat storage tank is not used

$$QH = HCT \left(1 - \frac{1}{COP_h} \right) - 1000 \times Vw \times \Delta T - 860 \times Pw$$

QH	: Auxiliary heat source capacity	(kcal/h)
HCT	: Total heating capacity of each water heat source CITY MULTI	(kcal/h)
COP _h	: COP of water heat source CITY MULTI at heating	
Vw	: Holding water volume inside piping	(m ³)
ΔT	: Allowable water temperature drop = TWH - TWL	(°C)
TWH	: Heat source water temperature at high temperature side	(°C)
TWL	: Heat source water temperature at low temperature side	(°C)
Pw	: Heat source water pump shaft power	(kW)

$$QH = HCT \left(1 - \frac{1}{COP_h} \right) - 8.343 \times Vw \times \Delta T - 3412 \times Pw$$

QH	: Auxiliary heat source capacity	(BTU/h)
HCT	: Total heating capacity of each water heat source CITY MULTI	(BTU/h)
COP _h	: COP of water heat source CITY MULTI at heating	
Vw	: Holding water volume inside piping	(G)
ΔT	: Allowable water temperature drop = TWH - TWL	(°F)
TWH	: Heat source water temperature at high temperature side	(°F)
TWL	: Heat source water temperature at low temperature side	(°F)
Pw	: Heat source water pump shaft power	(kW)

When heat storage tank is not used

$$HQ_{1T} \cdot \left(1 - \frac{1}{COP_h} \right) - 860 \times P_w \times T_2$$

$$QH = \frac{HQ_{1T} \cdot \left(1 - \frac{1}{COP_h} \right) - 860 \times P_w \times T_2}{T_1} \times K \quad (\text{kcal})$$

QH_{1T}	: Total of heating load on weekday including warming up	(kcal/day)
T_1	: Operating hour of auxiliary heat source	(h)
T_2	: Operating hour of heat source water pump	(h)
K	: Allowance factor (Heat storage tank, piping loss, etc.)	1.05~1.10

HQ_{1T} is calculated from the result of steady state load calculation similarly by using the equation below.

$$HQ_{1T} = 1.15 \times (\Sigma Q'a + \Sigma Q'b + \Sigma Q'c + \Sigma Q'd + \Sigma Q'f) T_2 - \Psi (\Sigma Q'e_1 + \Sigma Q'e_2 + \Sigma Q'e_3) (T_2 - 1)$$

$Q'a$: Thermal load from external wall/roof in each zone	(kcal/h)
$Q'b$: Thermal load from glass window in each zone	(kcal/h)
$Q'c$: Thermal load from partition/ceiling/floor in each zone	(kcal/h)
$Q'd$: Thermal load by infiltration in each zone	(kcal/h)
$Q'f$: Fresh outdoor air load in each zone	(kcal/h)
$Q'e_1$: Thermal load from human body in each zone	(kcal/h)
$Q'e_2$: Thermal load from lighting fixture in each zone	(kcal/h)
$Q'e_3$: Thermal load from equipment in each zone	(kcal/h)
Ψ	: Radiation load rate	0.6~0.8
T_2	: Air conditioning hour	

$$HQ_{1T} \cdot \left(1 - \frac{1}{COP_h} \right) - 3,412 \times P_w \times T_2$$

$$QH = \frac{HQ_{1T} \cdot \left(1 - \frac{1}{COP_h} \right) - 3,412 \times P_w \times T_2}{T_1} \times K \quad (\text{BTU})$$

QH_{1T}	: Total of heating load on weekday including warming up	(BTU/day)
T_1	: Operating hour of auxiliary heat source	(h)
T_2	: Operating hour of heat source water pump	(h)
K	: Allowance factor (Heat storage tank, piping loss, etc.)	1.05~1.10

HQ_{1T} is calculated from the result of steady state load calculation similarly by using the equation below.

$$HQ_{1T} = 1.15 \times (\Sigma Q'a + \Sigma Q'b + \Sigma Q'c + \Sigma Q'd + \Sigma Q'f) T_2 - \Psi (\Sigma Q'e_1 + \Sigma Q'e_2 + \Sigma Q'e_3) (T_2 - 1)$$

$Q'a$: Thermal load from external wall/roof in each zone	(BTU/h)
$Q'b$: Thermal load from glass window in each zone	(BTU/h)
$Q'c$: Thermal load from partition/ceiling/floor in each zone	(BTU/h)
$Q'd$: Thermal load by infiltration in each zone	(BTU/h)
$Q'f$: Fresh outdoor air load in each zone	(BTU/h)
$Q'e_1$: Thermal load from human body in each zone	(BTU/h)
$Q'e_2$: Thermal load from lighting fixture in each zone	(BTU/h)
$Q'e_3$: Thermal load from equipment in each zone	(BTU/h)
Ψ	: Radiation load rate	0.6~0.8
T_2	: Air conditioning hour	

b) Heat storage tank

Heat storage tank can be classified by types into the open type heat storage tank exposed to atmosphere, and the closed type heat storage tank with structure separated from atmosphere. Although the size of the tank and its installation place should be taken into account, the closed type tank is being usually employed by considering corrosion problems.

The capacity of heat storage tanks is determined in accordance with the daily maximum heating load that includes warming up load to be applied for the day after the holiday.

When auxiliary heat source is operated during operation and even after stopping of water heat source CITY MULTI unit

$$V = \frac{HQ_{2T} \left(1 - \frac{1}{COP_h} \right) - 860 \times P_w \times T_2 - QH \times T_2}{\Delta T \times 1,000 \times \eta V} \quad (\text{ton})$$

HQ_{2T} : Maximum heating load including load required for the day after the holiday (kcal/day)

ΔT : Temperature difference utilized by heat storage tank ($^{\circ}\text{C}$)

ηV : Heat storage tank efficiency

$$HQ_{2T} : 1.3 \times (\Sigma Q'a + \Sigma Q'c + \Sigma Q'd + \Sigma Q'f) T_2 - \Psi (\Sigma Qe2 + \Sigma Qe3) (T_2 - 1)$$

$$V = \frac{HQ_{2T} \left(1 - \frac{1}{COP_h} \right) - 3,412 \times P_w \times T_2 - QH \times T_2}{\Delta T \times \eta V} \quad (\text{lbs})$$

HQ_{2T} : Maximum heating load including load required for the day after the holiday (BTU/day)

ΔT : Temperature difference utilized by heat storage tank ($^{\circ}\text{F}$)

ηV : Heat storage tank efficiency

$$HQ_{2T} : 1.3 \times (\Sigma Q'a + \Sigma Q'c + \Sigma Q'd + \Sigma Q'f) T_2 - \Psi (\Sigma Qe2 + \Sigma Qe3) (T_2 - 1)$$

When auxiliary heat source is operated after stopping of water heat source CITY MULTI unit

$$V = \frac{HQ_{2T} \left(1 - \frac{1}{COP_h} \right) - 860 \times P_w \times T_2}{\Delta T \times 1,000 \times \eta V} \quad (\text{ton})$$

HQ_{2T} : Maximum heating load including load required for the day after the holiday (kcal/day)

ΔT : Temperature difference utilized by heat storage tank ($^{\circ}\text{C}$)

ηV : Heat storage tank efficiency

$$HQ_{2T} : 1.3 \times (\Sigma Q'a + \Sigma Q'c + \Sigma Q'd + \Sigma Q'f) T_2 - \Psi (\Sigma Qe2 + \Sigma Qe3) (T_2 - 1)$$

$$V = \frac{HQ_{2T} \left(1 - \frac{1}{COP_h} \right) - 3,412 \times P_w \times T_2}{\Delta T \times \eta V} \quad (\text{lbs})$$

HQ_{2T} : Maximum heating load including load required for the day after the holiday (BTU/day)

ΔT : Temperature difference utilized by heat storage tank ($^{\circ}\text{F}$)

ηV : Heat storage tank efficiency

$$HQ_{2T} : 1.3 \times (\Sigma Q'a + \Sigma Q'c + \Sigma Q'd + \Sigma Q'f) T_2 - \Psi (\Sigma Qe2 + \Sigma Qe3) (T_2 - 1)$$

4) Piping system


The following items should be kept in your mind in planning / designing water circuits.

- All units should be constituted in a single circuit in principle.
- When plural numbers of the water heat source CITY MULTI unit are installed, the rated circulating water flow rate should be kept by making the piping resistance to each unit almost same value. As an example, the reverse return system as shown below may be employed.
- Depending on the structure of a building, the water circuit may be prefabricated by making the layout uniform.
- When a closed type piping circuit is constructed, install an expansion tank usable commonly for a make-up water tank to absorb the expansion/contraction of water caused by temperature fluctuation.
- If the operating temperature range of circulation water stays within the temperature near the normal temperature (summer :29.4°C [85°F], winter :21.1°C [70°F]), thermal insulation or anti-sweating work is not required for the piping inside buildings.

In case of the conditions below, however, thermal insulation is required.

- When well water is used for heat source water.
- When piped to outdoor or a place where freezing may be caused.
- When vapor condensation may be generated on piping due to an increase in dry bulb temperature caused by the entry of fresh outdoor air.

System example of water circuit

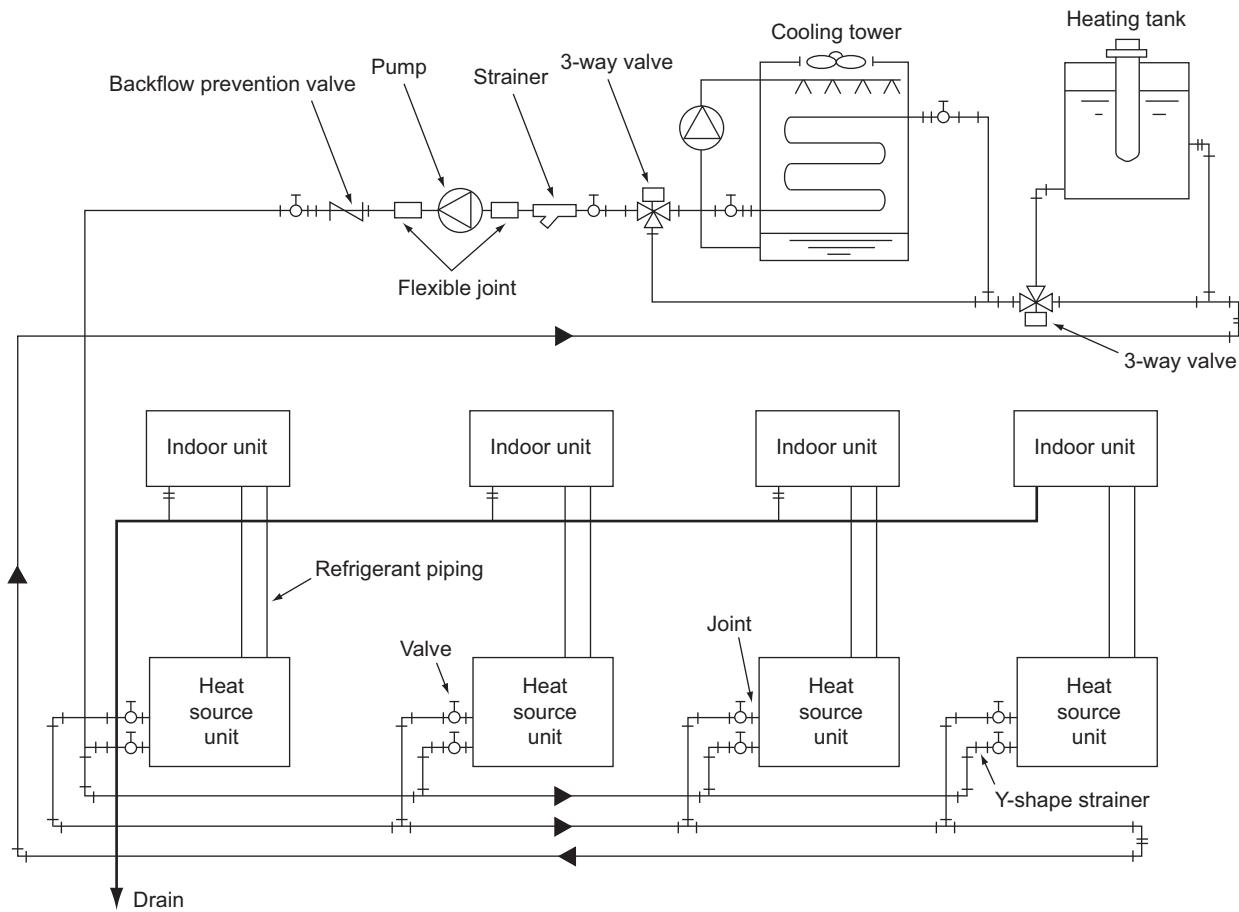


5) Practical System Examples and Circulation Water Control

Since the water heat source CITY MULTI is of water heat source system, versatile systems can be constituted by combining it with various heat sources.

The practical system examples are given below.

Either cooling or heating operation can be performed if the circulation water temperature of the water heat source CITY MULTI stays within a range of 10~45°C [50~113°F]. However, the circulation water temperature near 32°C [90°F] for cooling and 20°C [68°F] for heating is recommended by taking the life, power consumption and capacity of the air conditioning units into consideration. The detail of the control is also shown below.

Example-1 Combination of closed type cooling tower and hot water heat storage tank (using underground hollow slab)

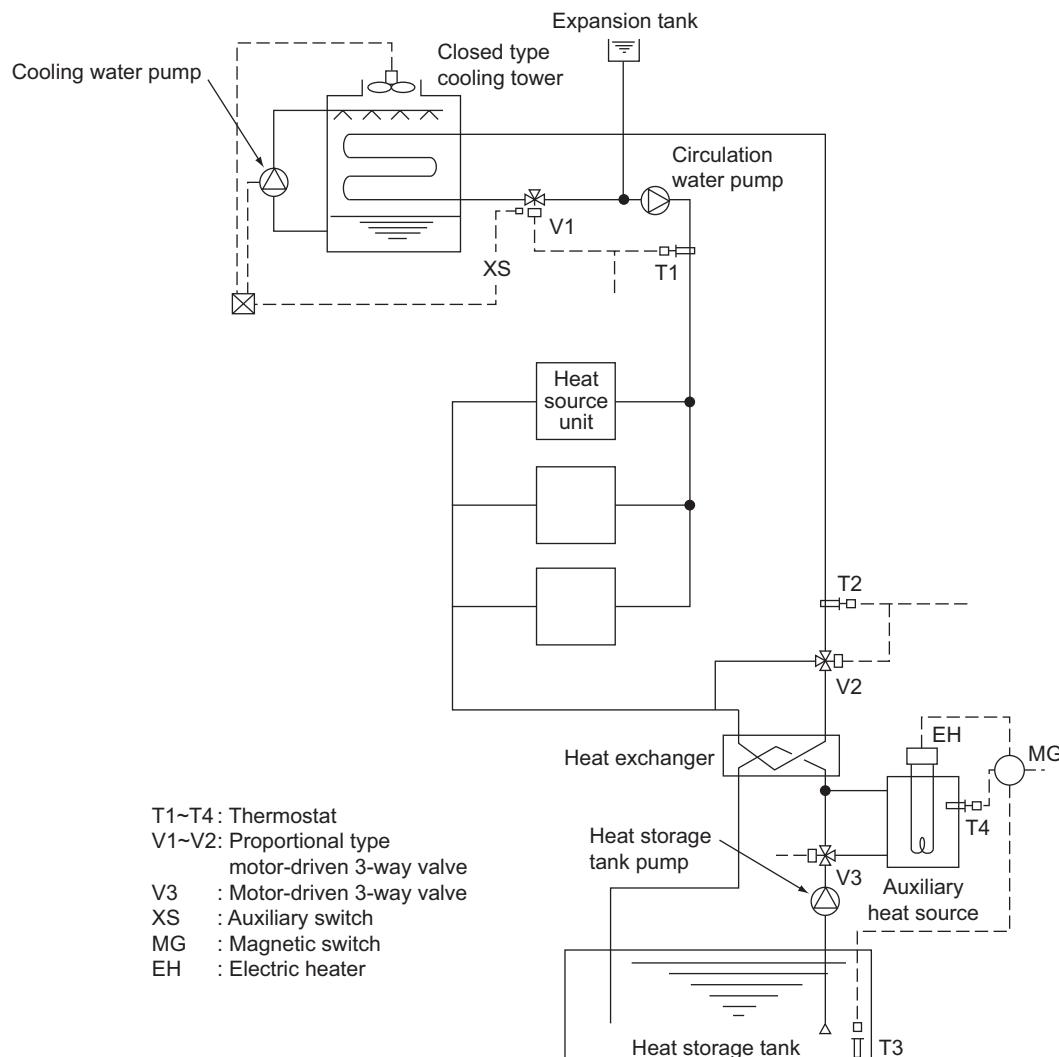

By detecting the circulation water temperature of the water heat source CITY MULTI system with T1 (around 32°C [90°F]) and T2 (around 20°C [68°F]), the temperature will be controlled by opening/closing V1 in the summer and V2 in the winter.


In the summer, as the circulation water temperature rises exceeding the set temperature of T1, the bypass port of V1 will open to lower the circulation water temperature. While in the winter, as the circulation water temperature drops, V2 will open following the command of T2 to rise the circulation water temperature.

The water inside the heat storage tank will be heated by the auxiliary heat source by V3 being opened with timer operation in the night-time. The electric heater of the auxiliary heat source will be controlled by T3 and the timer.

The start/stop control of the fan and pump of the closed type cooling tower is applied with the step control of the fan and pump following the command of the auxiliary switch XS of V1, that operates only the fan at the light load while the fan and pump at the maximum load thus controlling water temperature and saving motor power.

Example-2 Combination of closed type cooling tower and hot water heat storage tank

T1 : Proportional type, insertion system thermostat
 T2 : Proportional type, insertion system thermostat
 T3 : Proportional type, insertion system thermostat
 V1 : Proportional type, motor-driven 3-way valve
 V2 : Proportional type, motor-driven 3-way valve
 XS : Auxiliary switch (Duplex switch type)
 SC : Step controller
 R : Relay
 MG : Magnetic

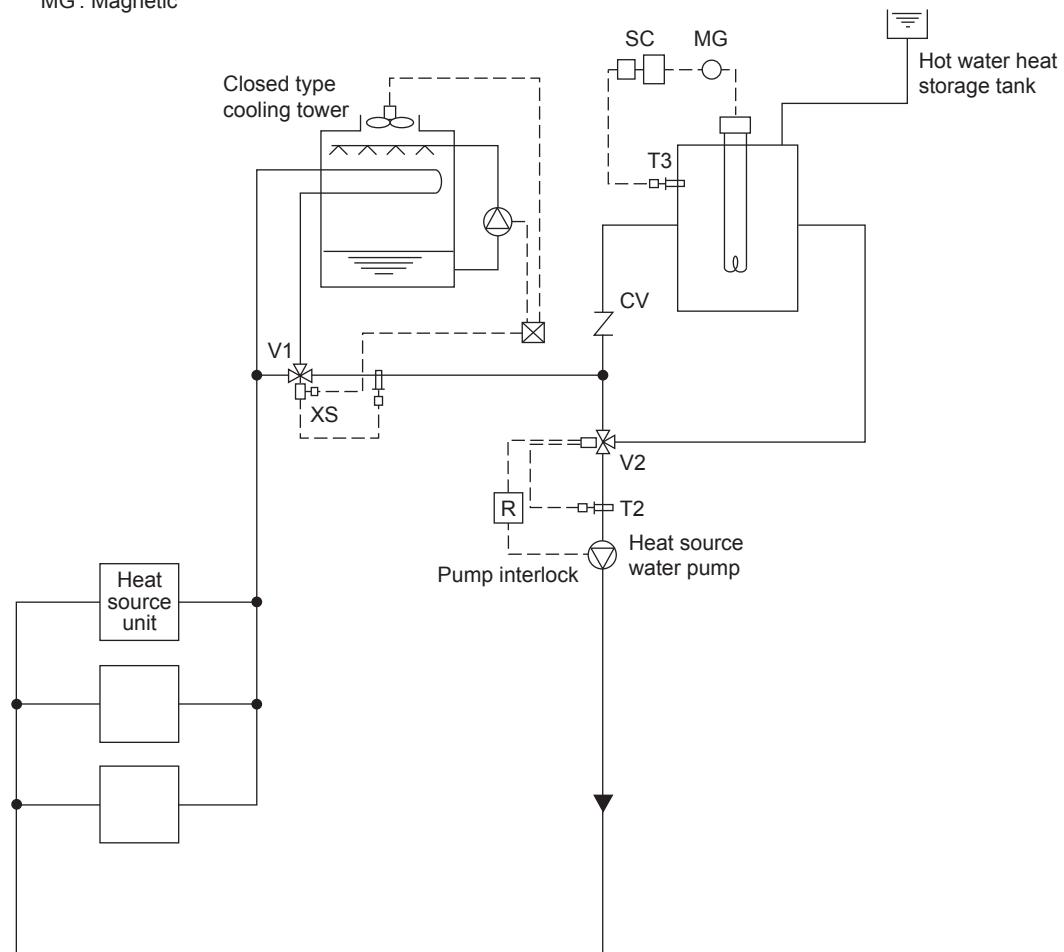

In the summer, as the circulation water temperature rises exceeding the set temperature of T1, the bypass port of V1 will open to lower the circulation water temperature. In the winter, if the circulation water temperature stays below 25°C [77°F], V2 will open/close by the command of T2 to keep the circulation water temperature constant.


The temperature of the hot water inside the heat storage tank will be controlled through the step control of the electric heater by step controller operation following the command of T3.

During the stopping of the heat source water pump, the bypass port of V2 will be closed fully by interlocking thus preventing the high temperature water from entering into the system at the starting of the pump.

The start/stop control of the fan and pump of the closed type cooling tower is applied with the step control of the fan and pump following the command of the auxiliary switch XS of V1, that operates only the fan at the light load while the fan and pump at the maximum load thus controlling water temperature and saving motor power.

Example-3 Combination of closed type cooling tower and boiler


T1 : Proportional type, insertion system thermostat
 T2 : Proportional type, insertion system thermostat
 T3 : Proportional type, insertion system thermostat
 V1 : Proportional type, motor-driven 3-way valve
 S : Selector switch
 R : Relay
 XS : Auxiliary switch (Duplex switch type)

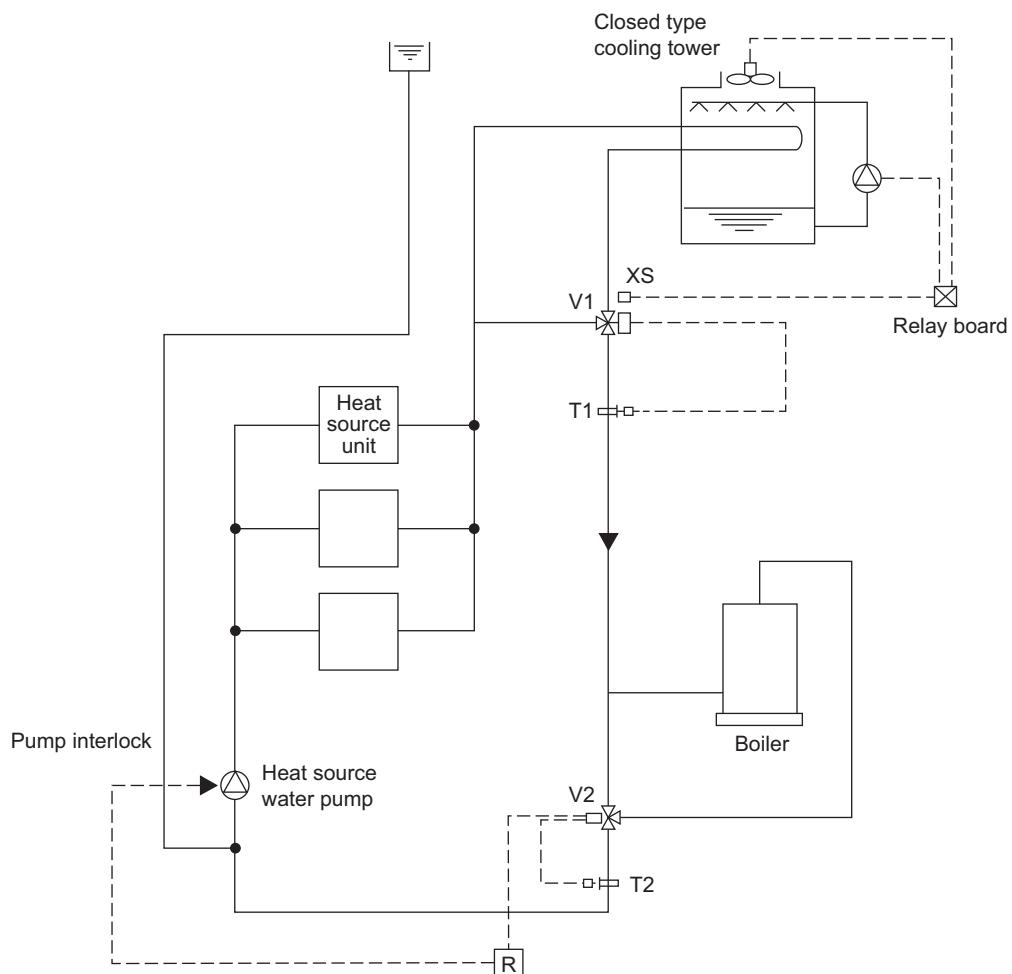

In the summer, as the circulation water temperature rises exceeding the set temperature of T1, the bypass port of V1 will close to lower the circulation water temperature. In the winter, if the circulation water temperature drops below 25°C [77°F], V2 will conduct water temperature control to keep the circulation water temperature constant. During the stopping of the heat source water pump, the bypass port of V2 will be closed fully by interlocking. The start/stop control of the fan and pump of the closed type cooling tower is applied with the step control following the command of the auxiliary switch XS of V1, thus controlling water temperature and saving motor power.


Example-4 Combination of closed type cooling tower and heat exchanger (of other heat source)

T1 : Proportional type, insertion system thermostat
 T2 : Proportional type, insertion system thermostat
 V1 : Proportional type, motor-driven 3-way valve
 V2 : Proportional type, motor-driven 3-way valve
 S : Selector switch
 R : Relay
 XS : Auxiliary switch (Duplex switch type)

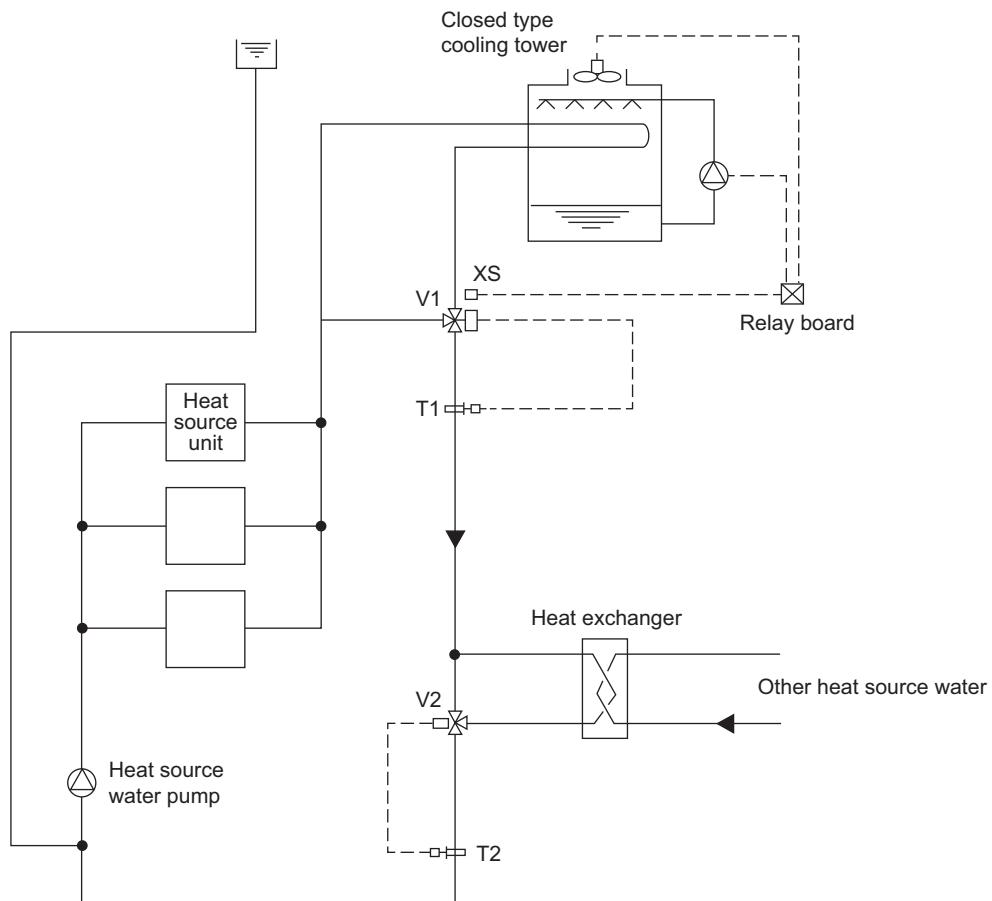


In the summer, as the circulation water temperature rises exceeding the set temperature of T1, the bypass port of V1 will close to lower the circulation water temperature. In the winter, if the circulation water temperature drops below 26°C [79°F], V2 will conduct water temperature control to keep the circulation water temperature constant. During the stopping of the heat source water pump, the bypass port of V2 will be closed fully by interlocking. The start/stop control of the fan and pump of the closed type cooling tower is applied with the step control following the command of the auxiliary switch XS of V1, thus controlling water temperature and saving motor power.

6) Pump interlock circuit

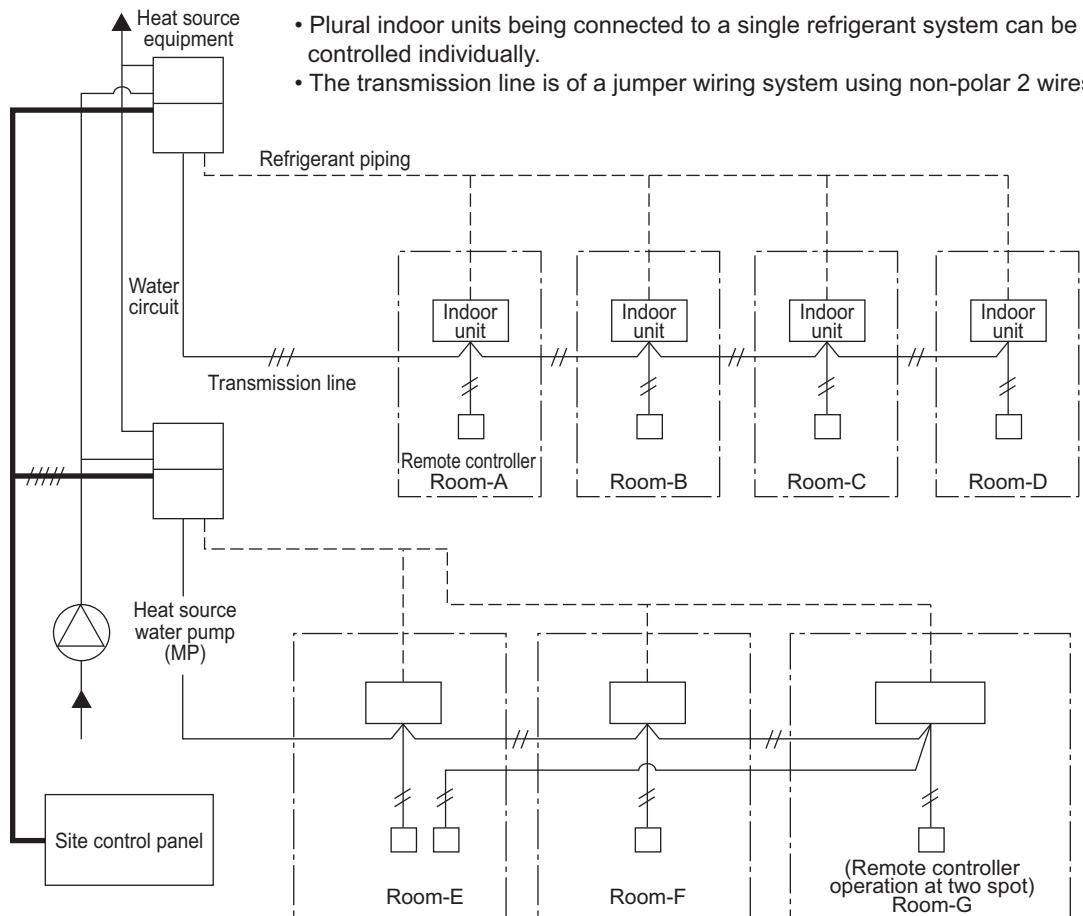

Wiring diagram

This circuit uses the "Terminal block for pump interlock (TB8)" inside the electrical parts box of the heat source equipment. This circuit is for interlocking of the heat source equipment operation and the heat source water pump.

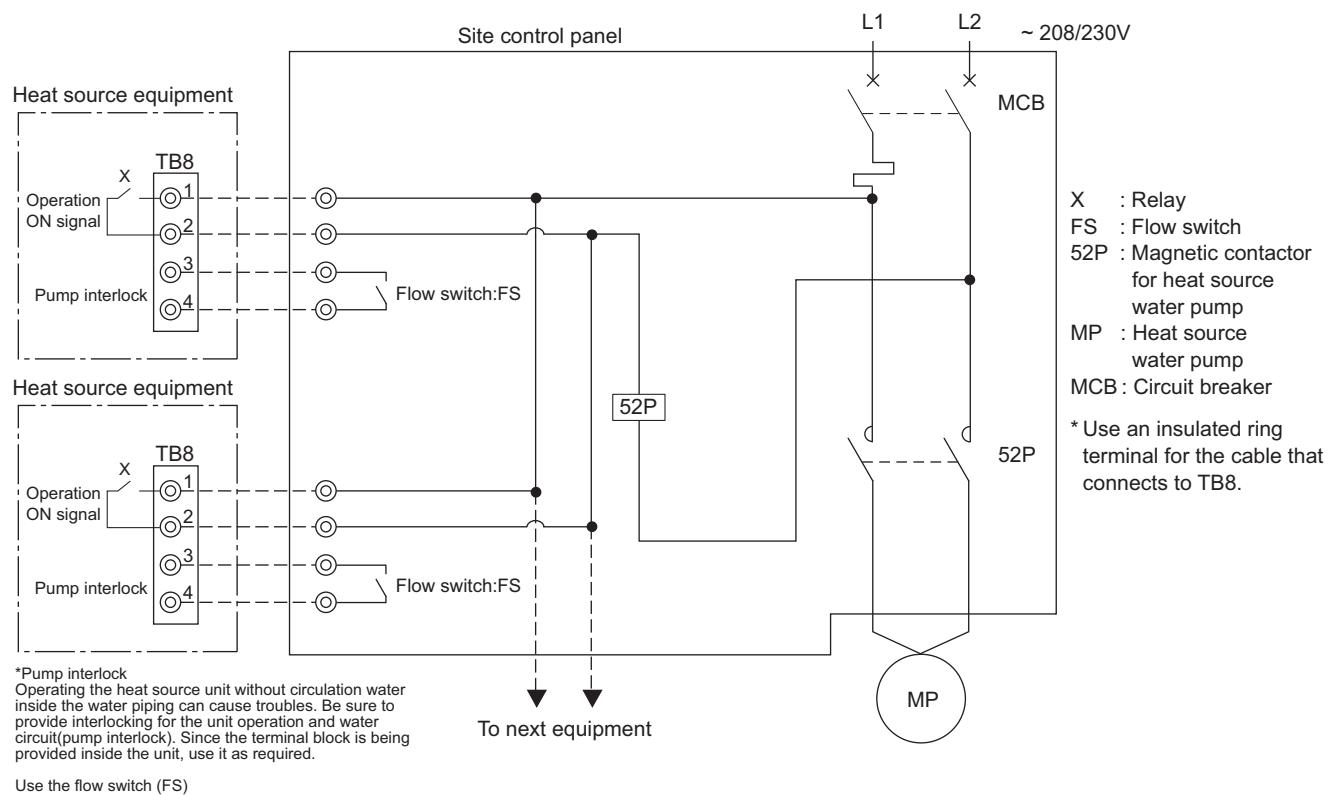

Operation ON signal


Terminal No.	TB8-1, 2				
Output	Relay contacts output	Rated voltage: 3~: 208/230V Rated load: 1 A			
Operation	<ul style="list-style-type: none"> When setting No.917 for Dip switch 4 (Dip switch 6-10 is ON) is OFF. The relay closes during compressor operation. <table border="1" style="margin-left: auto; margin-right: auto;"> <tr> <td style="text-align: center;">SW4 0: OFF, 1: ON</td> </tr> <tr> <td style="text-align: center;">1 2 3 4 5 6 7 8 9 10</td> </tr> <tr> <td style="text-align: center;">1 0 1 0 1 0 0 1 1 1</td> </tr> </table> <ul style="list-style-type: none"> When setting No.917 for Dip switch 4 (Dip switch 6-10 is ON) is ON. The relay closes during reception of cooling or the heating operation signal from the controller. (Note: It is output even if the thermostat is OFF (when the compressor is stopped).) 		SW4 0: OFF, 1: ON	1 2 3 4 5 6 7 8 9 10	1 0 1 0 1 0 0 1 1 1
SW4 0: OFF, 1: ON					
1 2 3 4 5 6 7 8 9 10					
1 0 1 0 1 0 0 1 1 1					

Pump Interlock

Terminal No.	TB8-3, 4	
Input	Level signal	
Operation	If the circuit between TB8-3 and TB8-4 is open, compressor operation is prohibited.	

*Remove the short circuit wire between 3 and 4 when wiring to TB8.

To prevent a false detection of error resulting from contact failure, use a flow switch with a minimum guaranteed current of 5 mA or below for FS.

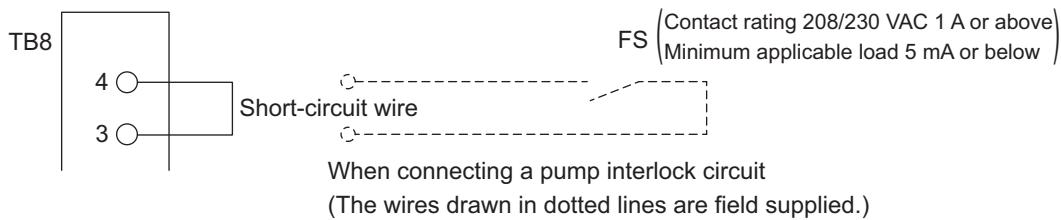

7-2. Water piping work

Although the water piping for the CITY MULTI WY system does not differ from that for ordinary air conditioning systems, pay special attention to the items below in conducting the piping work.

1) Items to be observed on installation work

- The water pressure resistance of the water pipes in the heat source unit is 2.0MPa [290psi].
- In order to equalize piping resistance for each unit, adapt the reverse return system.
- Mount a joint and a valve onto the water outlet/inlet of the unit to allow for maintenance, inspection and replacement work. Be sure to mount a strainer at the water inlet piping of the unit. (The strainer is required at the circulation water inlet to protect the heat source unit.)
- * The installation example of the heat source unit is shown right.
- Be sure to provide an air relief opening on the water piping properly, and purge air after feeding water to the piping system.
- Condensate will generate at the low temperature part inside the heat source equipment. Connect drain piping to the drain piping connection located at the bottom of the heat source equipment to discharge it outside the equipment.
- Mount a backflow prevention valve and a flexible joint for vibration control onto the pump.
- Provide a sleeve to the penetrating parts of the wall to prevent the piping.
- Fasten the piping with metal fitting, arrange the piping not to expose to cutting or bending force, and pay sufficient care for possible vibration.
- Be careful not to erroneously judge the position of the inlet and outlet of water.

(Lower position : Inlet, Upper position : Outlet)

- When connecting heat source unit water piping and water piping on site, apply liquid sealing material for water piping over the sealing tape before connection.
 - This unit doesn't include a heater to prevent freezing within tubes. If the water flow is stopped on low ambient, drain the water out.
 - The unused knockout holes should be closed and the refrigerant pipes, water pipes, power source and transmission wires access holes should be filled with putty.
 - The drain plug is installed on the back of the unit at factory for field-connection of the drain pipes on the front of the unit. Move the plug to the front to connect the drain pipes on the back. Verify that there are no leaks from pipe connections.
 - For installing two units, install water pipes in parallel to each other so that the water flow rate through both units will be equal.
 - Wrap the sealing tape as follows.
- Wrap the joint with sealing tape in the direction of the threads (clockwise), and do not let the tape run over the edge.
 - Overlap the sealing tape by two-thirds to three-fourths of its width on each turn. Press the tape with your fingers so that it is pressed firmly against each thread.
 - Leave the 1.5th through 2nd farthest threads away from the pipe end unwrapped.
 - Hold the pipe on the unit side in place with a spanner when installing the pipes or strainer. Tighten screws to a torque of 150N・m.


2) Thermal insulation work

Thermal insulation or anti sweating work is not required for the piping inside buildings in the case of the CITY MULTI WY system if the operating temperature range of circulation water stays within the temperature near the normal (summer :30°C [86°F], winter : 20°C [68°F]).

In case of the conditions below, however, thermal insulation is required.

- Use of well water for heat source water
- Outdoor piping portions
- Indoor piping portions where freezing may be caused in winter

Installation example of heat source unit

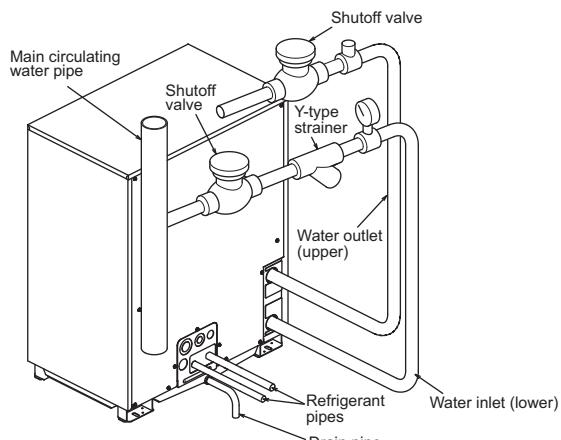

- A place where vapor condensation may be generated on piping due to an increase in dry bulb temperature inside the ceiling caused by the entry of fresh outdoor air
- Drain piping portions

3) Water treatment and water quality control

For the circulation water cooling tower of the CITY MULTI WY system, employment of the closed type is recommended to keep water quality. However, in the case that an open type cooling tower is employed or the circulating water quality is inferior, scale will adhere onto the water heat exchanger leading to the decreased heat exchange capacity or the corrosion of the heat exchanger. Be sufficiently careful for water quality control and water treatment at the installation of the circulation water system.

- Removal of impurities inside piping
Be careful not to allow impurities such as welding fragment, remaining sealing material and rust from mixing into the piping during installation work.
- Water treatment
The water quality standards have been established by the industry (Japan Refrigeration, Air Conditioning Industry Association, in case of Japan) for water treatment to be applied.

	Items	Lower mid-range temperature water system		Tendency	
		Recirculating water [20<T<60°C] [68<T<140°F]	Make-up water	Corrosive	Scale-forming
Standard items	pH (25°C/77°F)	7.0 ~ 8.0	7.0 ~ 8.0	○	○
	Electric conductivity (mS/m) (25°C/77°F) (µS/cm) (25°C/77°F)	30 or less (300 or less)	30 or less (300 or less)	○	○
	Chloride ion (mg Cl⁻/l)	50 or less	50 or less	○	
	Sulfate ion (mg SO₄²⁻/l)	50 or less	50 or less	○	
	Acid consumption (pH4.8) (mg CaCO₃/l)	50 or less	50 or less	○	
	Total hardness (mg CaCO₃/l)	70 or less	70 or less	○	
Reference items	Calcium hardness (mg CaCO₃/l)	50 or less	50 or less	○	
	Ionic silica (mg SiO₂/l)	30 or less	30 or less	○	
	Iron (mg Fe/l)	1.0 or less	0.3 or less	○	○
	Copper (mg Cu/l)	1.0 or less	0.1 or less	○	
	Sulfide ion (mg S²⁻/l)	not to be detected	not to be detected	○	
	Ammonium ion (mg NH₄⁺/l)	0.3 or less	0.1 or less	○	
Residual chlorine (mg Cl⁻/l)					
0.25 or less					
Free carbon dioxide (mg CO₂/l)					
0.4 or less					
Ryzner stability index					

Reference : Guideline of Water Quality for Refrigeration and Air Conditioning Equipment. (JRA GL02E-1994)

In order to keep the water quality within such standards, you are kindly requested to conduct bleeding-off by overflow and periodical water quality tests, and use inhibitors to suppress condensation or corrosion. Since piping may be corroded by some kinds of inhibitor, consult an appropriate water treatment expert for proper water treatment.


4) Pump interlock

Operating the heat source unit without circulation water inside the water piping can cause a trouble. Be sure to provide interlocking for the unit operation and water circuit. Since the terminal block is being provided inside the unit, use it as required.

5) Handling plate heat exchangers for heat-source units

<Designing the piping system>

- Install a strainer (50 mesh or finer recommended) near the heat-source unit on the inlet side of the hot/cold water pipe and cooling-water pipe (hereafter referred to as water pipes) to prevent an infiltration of foreign materials of solid nature, such as dirt and sand, into the plate heat exchanger.
- Depending on the water quality, scale may form inside plate heat exchangers. Plate heat exchangers must be chemically cleaned regularly to remove scale formation. Install sluice valves on the water pipes, and provide ports for connecting a pipe between the sluice valves and the heat-source unit for chemical cleaning.
- On both the inlet and outlet sides of water pipes, provide a plug to remove trapped air and water (also to be used for cleaning heat-source units and for purging water before a period of nonuse in winter or at the end of an air conditioning season). Also, provide automatic air-vent valves where air is likely to be trapped (such as a pipe that runs vertically).
- In addition to installing the above-mentioned strainers, install a cleanable strainer near the pump pipe inlet.
- Keep the pipes properly insulated and take an appropriate measure against humidity to minimize heat loss and prevent freeze damage in severe cold climate.
- If the system is stopped during winter or at night in subfreezing temperatures, take appropriate measures to protect pipes from freezing (i.e., pipe purging and use of water-circulation pump or heater) and prevent resultant damage to the plate heat exchanger.

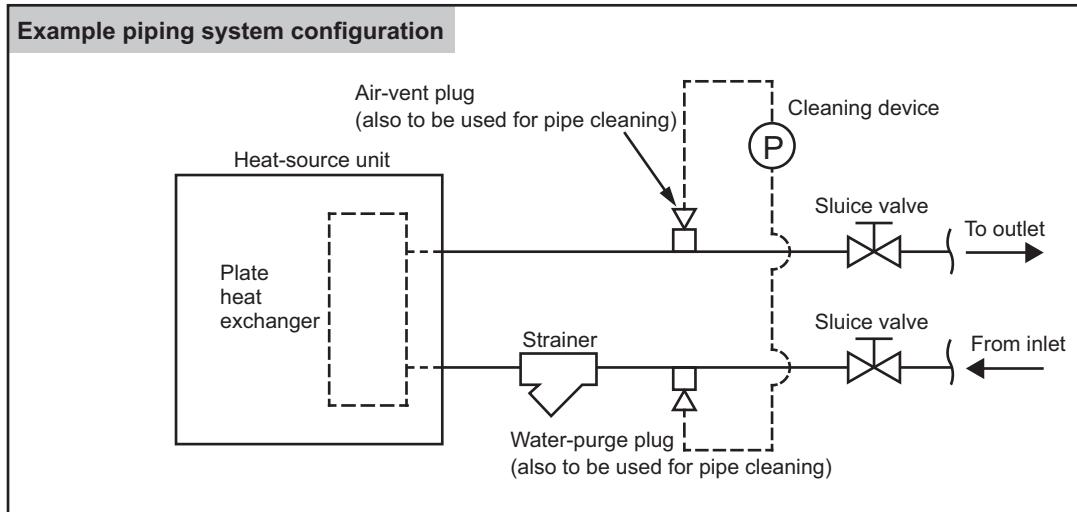

<Test run>

- Before performing a test run, check that the piping system is properly installed, especially the strainers, air-vents, automatic water-supply valves, expansion tanks, and systems.
- After the pipe system is filled with water, first, operate the pump alone to check the system for trapped air and adjust the water flow rate to prevent the plate heat exchanger from freezing. Take into consideration the water pressure loss before and after each heat-source unit, and make sure the water flow rate falls within the design water flow rate range. Stop the test run and correct any problems found, if any.
- At the completion of a test run, check the strainer at the inlet pipe of the heat-source unit and clean it as necessary.

<Daily maintenance>

- Controlling the water quality
Plate heat exchangers cannot be disassembled for cleaning and have no replaceable parts. Watch the water quality to prevent corrosion and scale formation. The quality of the water to be used for plate heat exchangers must meet the water quality guidelines JRA GL-02-1994 specified by Japan Refrigeration and Air conditioning Industry Association (JRAIA). (Refer to 3) Water treatment and water quality control.)
- Controlling the circulation water flow rate
Insufficient water rate will cause freeze damage to plate heat exchangers. Check for insufficient water flow caused by clogged strainer, trapped air in the system, or malfunction of the circulation water pump. Flow rate can also be checked by measuring the temperature or pressure difference between the inlet and outlet of plate heat exchangers. If the temperature or pressure difference goes outside of the specified range, stop the operation, remove the cause of the problem, and resume operation.
- What to do when the freeze protection trips
If the freeze protection trips during operation, be sure to remove its cause before resuming operation. Tripped freeze protection indicates that the system is partially frozen, and resuming operation without removing the cause of the problem will result in freeze damage to plate heat exchangers and/or pipes as well as resultant refrigerant leaks and infiltration of water into the refrigerant circuit.

<Maintaining plate heat exchangers>

Plate heat exchangers must be maintained in a planned and periodical manner to prevent scale formation, which may cause performance loss or decrease water flow rate that result in freeze damage to the plate heat exchanger.

- ♦ Check the following items before the operating season.
 1. Check that the water quality meets the specified water quality.
 2. Clean the strainers.
 3. Check that the water flow rate is adequate.
 4. Check for proper operation (e.g., pressure, flow rate, inlet/outlet temperatures).
- ♦ Plate heat exchangers cannot be disassembled for cleaning. Clean them in the following way.
 1. Make sure that there is a pipe connection port on the water inlet pipe.
Use formic acid, citric acid, oxalic acid, acetic acid, or phosphoric acid diluted to 5% to clean plate heat exchangers.
Do not use highly corrosive acids, such as hydrochloric acid, sulfuric acid, or nitric acid.
 2. Make sure that valves are installed before the inlet connection port and after the outlet connection port.
 3. Connect a pipe for circulating cleaning solution to the inlet/outlet pipes of the plate heat exchanger, fill the plate heat exchanger with cleaning solution at a temperature between 50 and 60°C, and circulate the cleaning solution with a pump for 2 to 5 hours. The cleaning time will depend on the temperature of the cleaning solution and the degree of scale formation. Use the color of the cleaning solution as a guide to determine how long the system needs to be cleaned.
 4. When done, discharge the cleaning solution out of the plate heat exchanger, fill it with sodium hydrate (NaOH) or sodium bicarbonate (NaHCO₃) diluted with water to 1 to 2%, and let the solution be circulated for 15 to 20 minutes until the cleaning solution is neutralized.
 5. After neutralizing the cleaning solution, thoroughly rinse the plate heat exchanger with clean water.
 6. When using a commercially available cleaning solution, make sure to use a solution not corrosive to stainless steel or copper.
 7. Consult the cleaning solution manufacture for details.
- ♦ At the completion of cleaning, check the system for proper operation.

8. OPTIONAL PARTS


U11 2nd

8-1. JOINT


CITY MULTI units can be easily connected by using Joint sets and Header sets provided by Mitsubishi Electric. Four kinds of Joint sets are available for use. Refer to section 3 in "System Design" or the Installation Manual that comes with the Joint set for how to install the Joint set.

CMY-Y102SS-G2



For Gas pipe:



<Reducer(Accessory)>

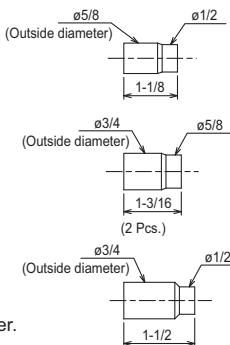


For Liquid pipe:

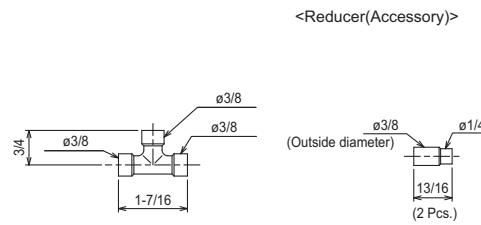


CMY-Y102LS-G2



For Gas pipe:



<Reducer(Accessory)>

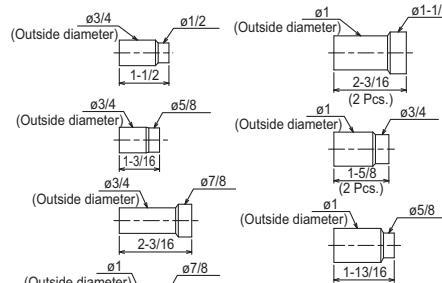


For Liquid pipe:

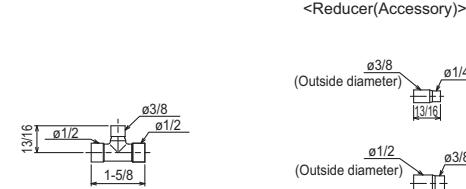


CMY-Y202S-G2



For Gas pipe:



<Reducer(Accessory)>

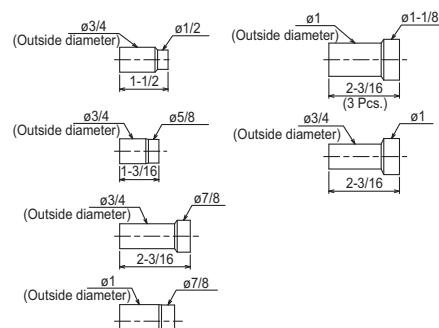


For Liquid pipe:

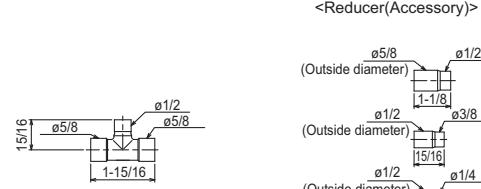


CMY-Y302S-G2



For Gas pipe:



<Reducer(Accessory)>

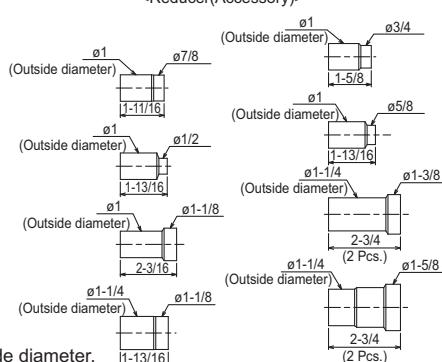

For Liquid pipe:

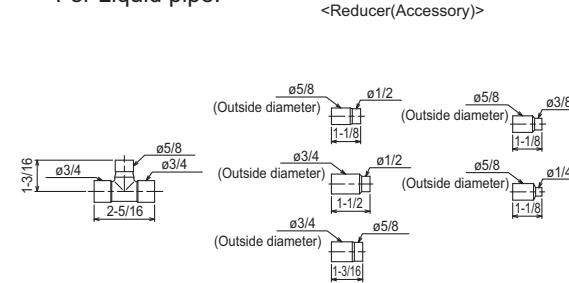


*Pipe diameter is indicated by inside diameter.

8-2. HEADER


CITY MULTI units can be easily connected by using Joint sets and Header sets provided by Mitsubishi Electric. Three kinds of Header sets are available for use. Refer to section 3 in "System Design" or the Installation Manual that comes with the Header set for how to install the Header set.

CMY-Y104C-G


For gas pipe:

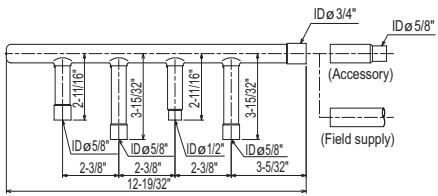


<Reducer(Accessory)>



For liquid pipe:

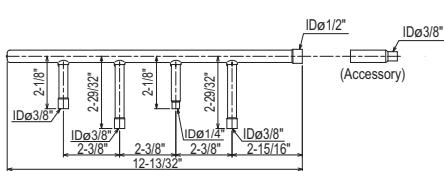

<Reducer(Accessory)>




ID: Inner Diameter OD: Outer Diameter


NOTE: Besides above mentioned accessories, caps for 1/4", 3/8", 1/2", 5/8" pipes (each diameter 1 piece) are included in the Header set.

CMY-Y108C-G


For gas pipe:

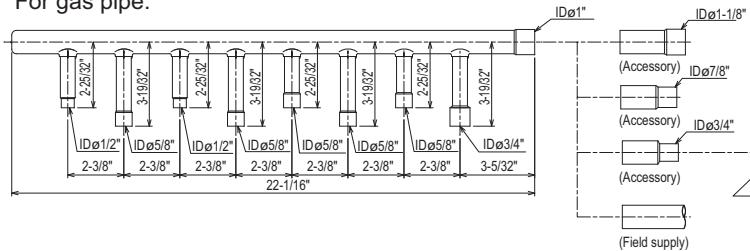


<Reducer(Accessory)>

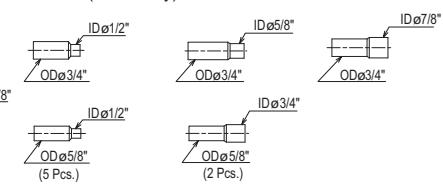

For liquid pipe:

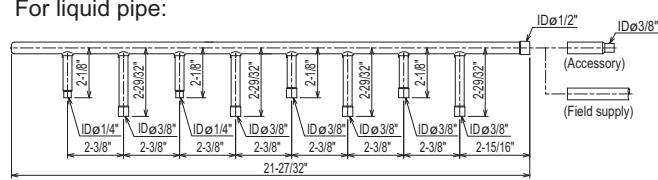

<Reducer(Accessory)>




ID: Inner Diameter OD: Outer Diameter


NOTE: Besides above mentioned accessories, caps for 1/4", 3/8", 1/2", 5/8" pipes (each diameter 2 pieces) and 1 cap for 3/4" pipe are included in the Header set.

CMY-Y1010C-G


For gas pipe:

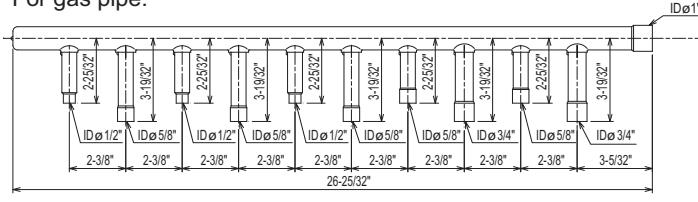


<Reducer(Accessory)>

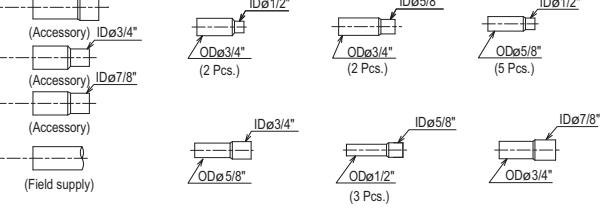

For liquid pipe:

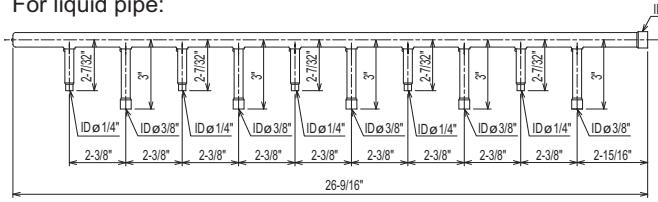

<Reducer(Accessory)>



ID: Inner Diameter OD: Outer Diameter


NOTE: Besides above mentioned accessories, caps for 1/4", 3/8", 1/2", 5/8" pipes (each diameter 2 pieces) and 1 cap for 3/4" pipe are included in the Header set.

8-3. OUTDOOR TWINNING KIT


The following optional Outdoor Twinning Kit is needed to use to combine multiple refrigerant pipes. Refer to the chapter entitled System Design Section for the details of selecting a proper twinning kit.

CMY-Y100CBK3


For Gas pipe:

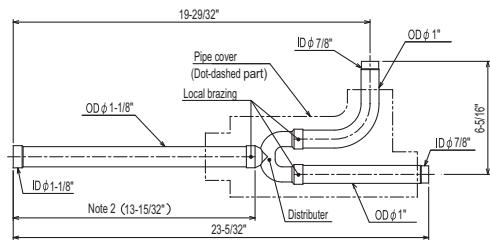

For Liquid pipe:

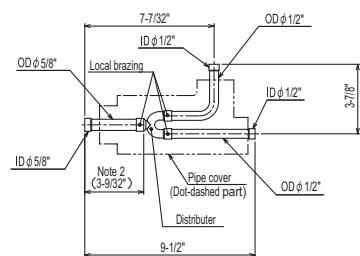


<Reducer(Accessory)>

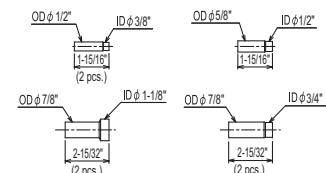


CMY-Y300CBK2


For Gas pipe:

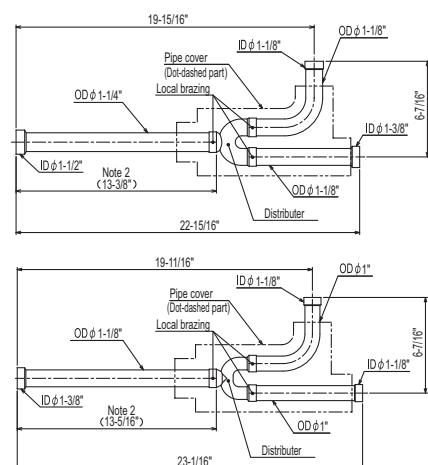

For Liquid pipe:

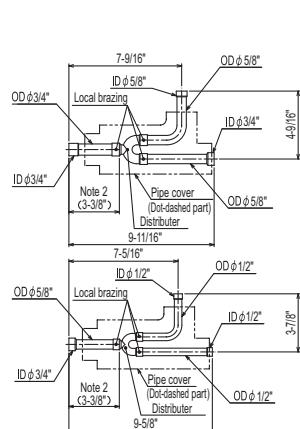


<Reducer(Accessory)>

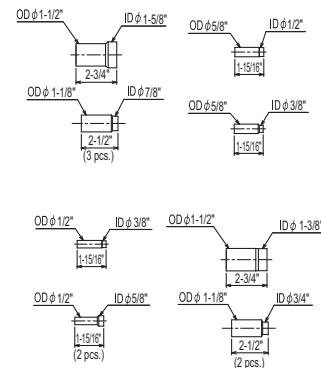

ID: Inner Diameter OD: Outer Diameter

Note 1. Reference the attitude angle of the branch pipe below the fig.



The angle of the branch pipe for high pressure is within ±15° against the horizontal plane.

2. Use the attached pipe to braze the port-opening of the distributor.
3. Pipe diameter is indicated by inside diameter.
4. Only use the Twinning pipe by Mitsubishi (optional parts) .