

SUBMITTAL DATA: PEAD-A30AA7 & PUZ-HA30NHA5

30,000 BTU/H HORIZONTAL-DUCTED HEAT-PUMP SYSTEM

Job Name:	Engineer:
Purchaser:	Application:
Submitted To:	For: ☐ Reference ☐ Approval ☐ Construction
Submitted By:	Location:
System Designation:	Schedule No.:



Indoor Unit: PEAD-A30AA7



Outdoor Unit: PUZ-HA30NHA5

UNIT OPTION:

Standard Model.....PUZ-HA30NHA5

ACCESSORIES:

Indoor Unit

Filter Box (PAC-KE93TB-E)
External Heating Adaptor (PAC-YU25HT)

Controls

Wireless Controller (MHK1)
Advanced Wired Controller (PAR-33MAA)
Simple Wired Controller (PAC-YT53CRAU)
Wireless Remote Controller (PAR-FL32MA) + Wireless Signal Receiver (PAR-FA32MA)
Thermostat Interface (PAC-US444CN)
M-NET Adapter (PAC-SF83MA-E)

Outdoor Unit

Rear Snow Guard (SG-1-RE)
Side Snow Guard (SG-1-SD)
Front Wind Deflector (x2 required) (PE-FR-24-36)

SPECIFICATIONS:

Rated Conditions (Capacity / Input)*		
Cooling	Btu/h / W	27,000 / 2,160
Heating at 47° F	Btu/h / W	32,000 / 2,750
Heating at 17° F	Btu/h / W	32,000 / 4,930

* Rating Conditions per AHRI Standard:

Cooling | Indoor: 80° F (27° C)DB / 67° F (19° C)WB; Outdoor: 95° F (35° C)DB / 75° F (24° C)WB
Heating at 47° F | Indoor: 70° F (21° C)DB / 60° F (16° C)WB; Outdoor: 47° F (8° C)DB / 43° F (6° C)WB
Heating at 17° F | Indoor: 70° F (21° C)DB / 60° F (16° C)WB; Outdoor: 17° F (-8° C)DB / 15° F (-9° C)WB

Capacity Range		
Cooling	Btu/h	18,000 - 30,000
Heating at 47° F	Btu/h	18,000 - 34,000

Operating Range	
Cooling	0° F** to 115° F (-18° C to 46° C) DB
Heating	-13° F to 70° F (-25° C to 21° C) DB

** Windscreens required for cooling operation below 23°F (-5°C)

AHRI Efficiency Rating	
EER	12.5
SEER	16.5
HSPF IV / V	9.5 / 7.3
COP at 47° F	3.41
COP at 17° F	1.90

Specifications are subject to change without notice.

Electrical Power Requirements	208 / 230V, 1-Phase, 60 Hz
-------------------------------	----------------------------

Minimum Circuit Ampacity (MCA) *		Breaker Size	MOCP (Outdoor)
Indoor 2.73 AMP	Outdoor 28 AMP	30 AMP	40 AMP

*All electrical work shall comply with National (CEC) and local codes and regulations.

Indoor Unit		
Blower Motor (ECM)	F.L.A.	2.18
Blower Motor Output	W	121
SHF / Moisture Removal		0.67 / 8.9 pt./h
External Static Pressure	In. WG	0.14-0.20-0.28-0.40-0.60
Drain Lift Mechanism (Included)	H: In.	27-9/16
		Drainpipe Size O.D [in. (mm)] - 1-1/4 (32)

Outdoor Unit		
Compressor		DC INVERTER-driven Scroll
Fan Motor (ECM)	F.L.A.	0.4 + 0.4
Fan Motor Power	W	86 + 86

Airflow Rate (Low-Mid-Hi)			
Indoor (Cooling)	DRY	CFM	618-742-883
	WET		578-702-843
Outdoor	DRY		3,530

Sound Pressure Level		
Indoor (Low-Mid-Hi)		30-34-38
Outdoor	Cooling	dB(A) 52
	Heating	53

External Dimensions		
Indoor (H x W x D)	In.(mm)	9-7/8 x 43-5/16 x 28-7/8 (250 x 1,100 x 732)
Outdoor (H x W x D)		53-1/8 x 37-3/8 x 13 + 1-3/16 (1,350 x 950 x 330 + 30)

Net Weight		
Indoor	Lbs.(kg)	73 (33)
Outdoor		265 (120)

External Finish	
Indoor	Galvanized-steel Sheet
Outdoor	Munsell No. 3Y 7.8 / 1.1

Refrigerant	R410A ; 12lbs., 2oz. (5.5kg)
-------------	------------------------------


Refrigerant Piping (Flared)		
Liquid (High Pressure)	In.(mm)	3/8 (9.52)
Gas (Low Pressure)		5/8 (15.88)
Maximum Total Refrigerant Pipe Length	Ft. (m)	245 (75)
Maximum Vertical Separation	Ft. (m)	100 (30)

Should this document be altered or changed without MESCA's permission, it becomes null and void. MESCA assumes no responsibility for any consequences in such cases.

FAN PERFORMANCE AND CORRECTED AIR FLOW - PEAD-A30AA7


PEAD-A30AA7

(External static pressure 35Pa) 208-230V 60Hz

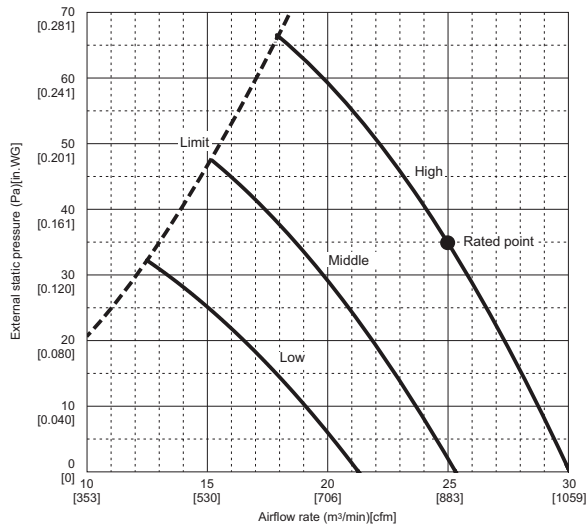


PEAD-A30AA7

(External static pressure 100Pa) 208-230V 60Hz

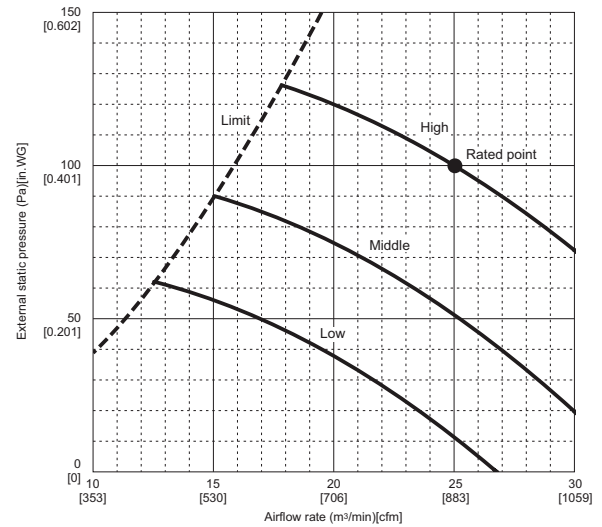


PEAD-A30AA7

(External static pressure 50Pa) 208-230V 60Hz

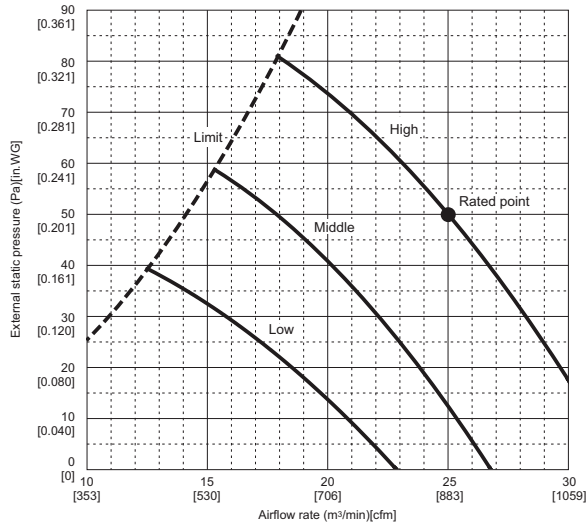


PEAD-A30AA7

(External static pressure 150Pa) 208-230V 60Hz

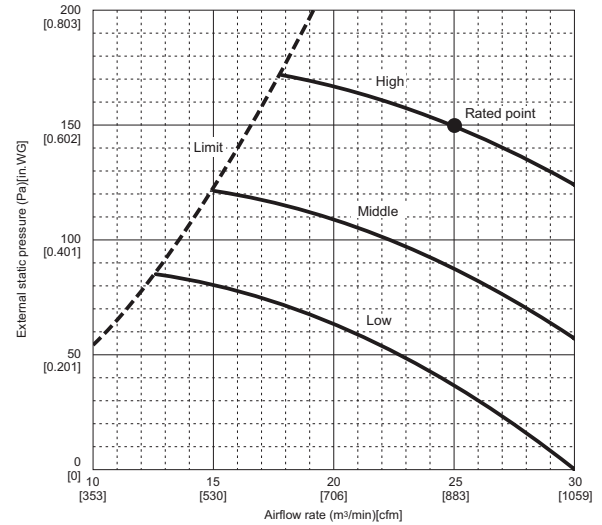


PEAD-A30AA7

(External static pressure 70Pa) 208-230V 60Hz

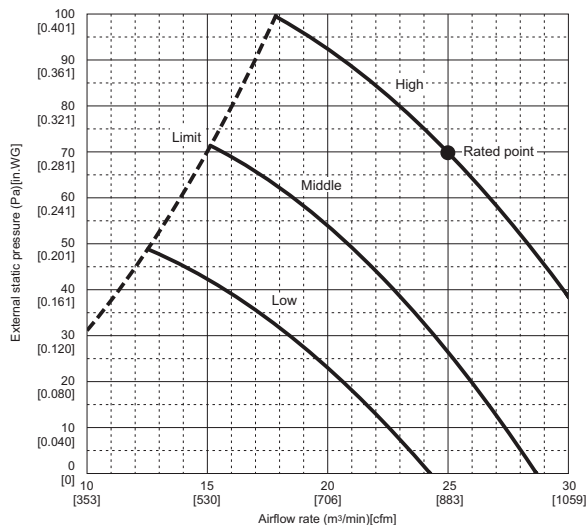

PEAD-A12,18,24,30,36,42AA7


Air filter 208-230V 60Hz

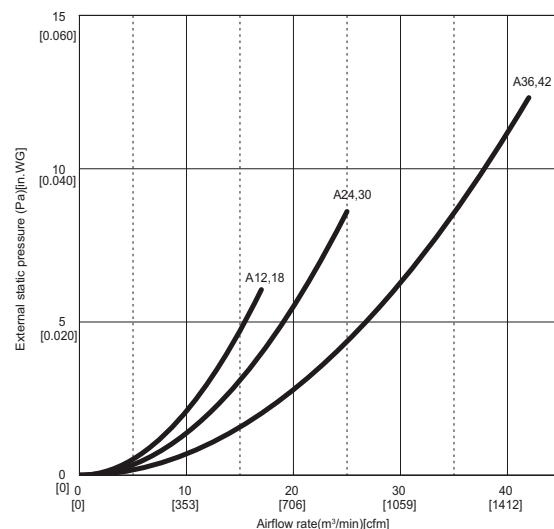

Specifications are subject to change without notice.

Unit: mm (in.)

- Note 1. Use an M10 screw for the suspension bolt (field supply).
2. Keep the service space for maintenance at the bottom.
3. This drawing is for PEAD-A24·30·36·42 AA7 models, which have 2 fans. PEAD-A12·18AA7 models have 1 fan.
4. If the inlet duct is used, remove the air filter (supplied with the unit), then install the filter (field supply) at the suction side.
5. Heat air to 0°C (32°F) or higher when taking fresh air with a fresh air intake.

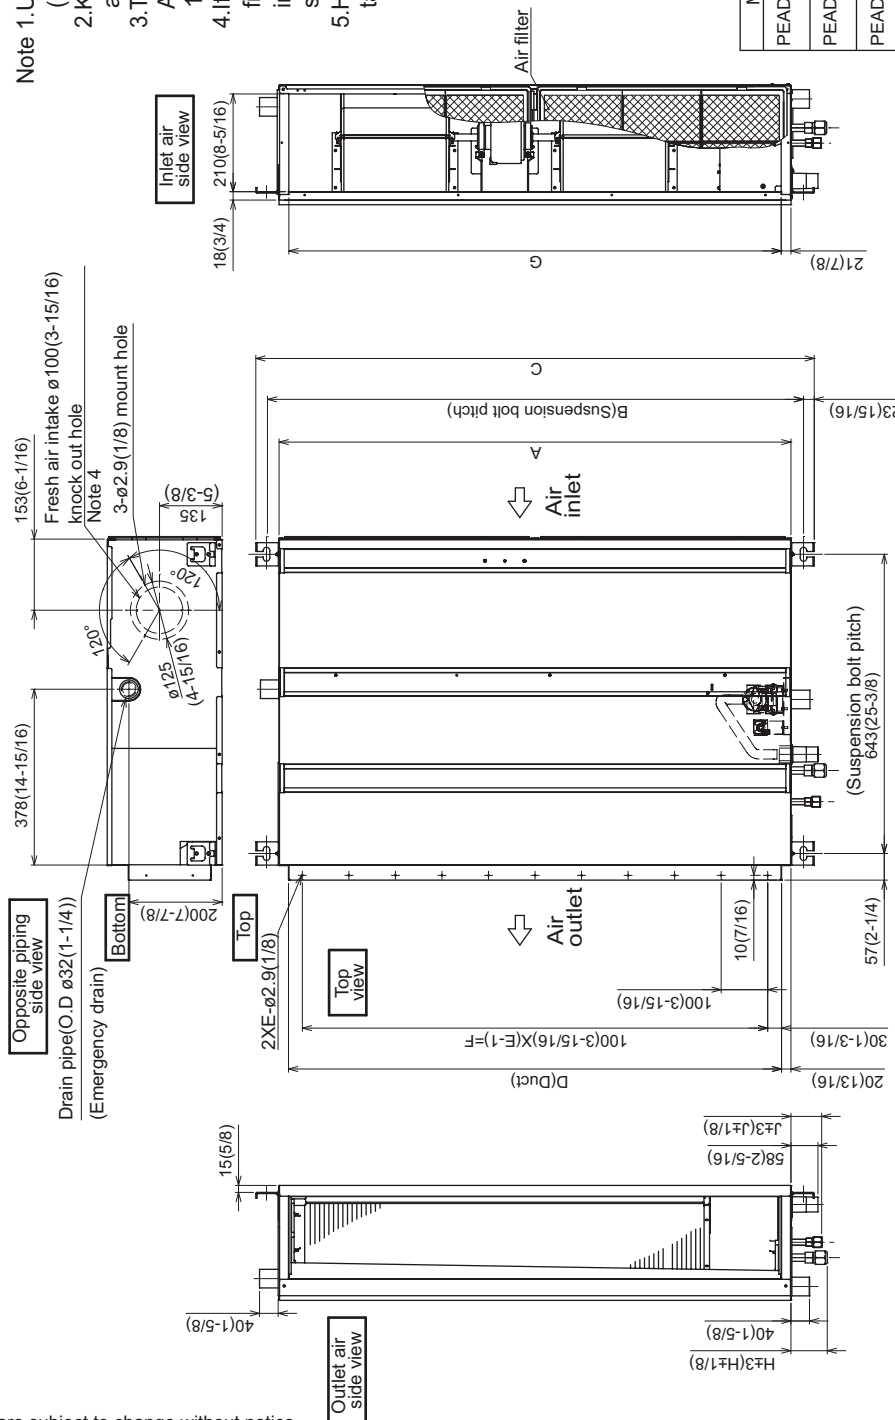

Model	J	① Gas pipe	② Liquid pipe
PEAD-A12,18AA7	62 (2-1/2)	ø12.7 (1/2)	ø6.35 (1/4)
PEAD-A24,30AA7	66 (2-5/8)	ø15.88 (5/8)	ø9.52 (3/8)
PEAD-A36,42AA7			

Model	A	B	C	D	E	F	G	H
PEAD-A12,18AA7	900 (35-7/16)	954 (37-9/16)	1000 (39-3/8)	860 (33-7/8)	9	800 (31-1/2)	858 (33-13/16)	72 (2-7/8)
PEAD-A24,30AA7	1100 (43-5/16)	1154 (45-7/16)	1200 (47-1/4)	1060 (41-3/4)	11	1000 (39-3/8)	1058 (41-11/16)	78 (3-1/8)
PEAD-A36,42AA7	1400 (55-1/8)	1454 (57-1/4)	1500 (59-1/16)	1360 (53-9/16)	14	1300 (51-3/16)	1358 (53-1/2)	

Form # SB PEAD-A30AA7 PUZ-HA30NHA5 201712

Should this document be altered or changed without MESCA's permission, it becomes null and void. MESCA assumes no responsibility for any consequences in such cases.*

DIMENSIONS: PEAD-A30AA7

Unit: mm (in.)

[Maintenance access space]

Secure enough access space to allow for the maintenance, inspection, and replacement of the motor, fan, drain pump, heat exchanger, and control box in one of the following ways.

Select an installation site for the indoor unit so that it's maintenance access space will not be obstructed by beams or other objects.

(1) When a space of 300mm or more is available below the unit between the unit and the ceiling. (Fig.1)

- Create access door 1 and 2 (450x450mm each) as shown in Fig.2.

(Access door 2 is not required if enough space is available below the unit for a maintenance worker to work in.)

(2) When a space of less than 300mm is available below the unit between the unit and the ceiling.

(At least 20mm of space should be left below the unit as shown in Fig.3.)

- Create access door 1 diagonally below the control box and access door 3 below the unit as shown in Fig.4.

List-Group">

- or
- Create access door 4 below the control box and the unit as shown in Fig.5.





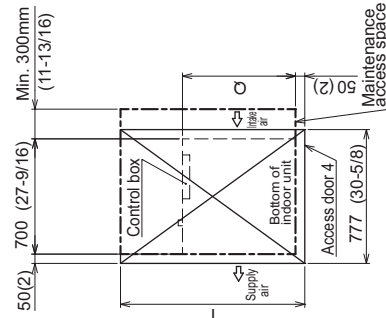


Fig.3 (Viewed from the direction of the arrow Y)

Fig.4 (Viewed from the direction of the arrow Y)

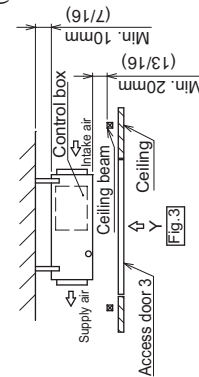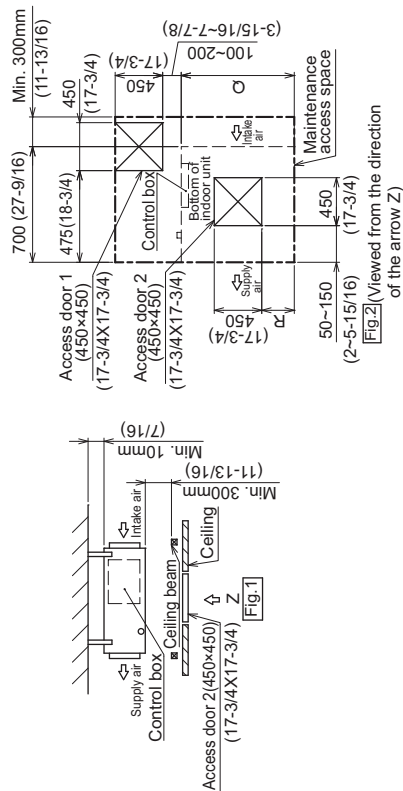
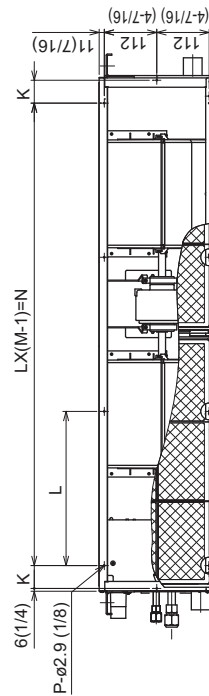
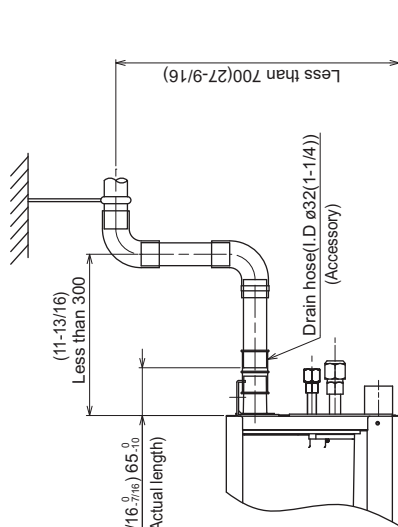


Model	K	L	M	N	P	Q	R	S	T
PEAD-A12,18AA7	54 (2-3/16)	260 (10-1/4)	4 (3/32)	780 (30-3/4)	10 (3/8)	900 (35-7/16)	150-250 (5-15/16-9-7/8)	1000 (39-3/8)	1500 (59-1/16)
PEAD-A24,30AA7	49 (1-15/16)	330 (13)	4 (3/16)	990 (39)	10 (3/8)	1100 (43-5/16)	250-350 (9-7/8-13-13/16)	1200 (47-1/4)	1700 (66-15/16)
PEAD-A36,48AA7	54 (2-3/16)	320 (12-5/8)	5 (3/16)	1280 (50-7/8)	12 (3/4)	1400 (55-1/8)	400-500 (15-3/4-19-11/16)	1500 (59-1/16)	2000 (78-3/4)

Unit:mm(in.)

DIMENSIONS: PUZ-HA30NHA5


Unit: mm (in.)

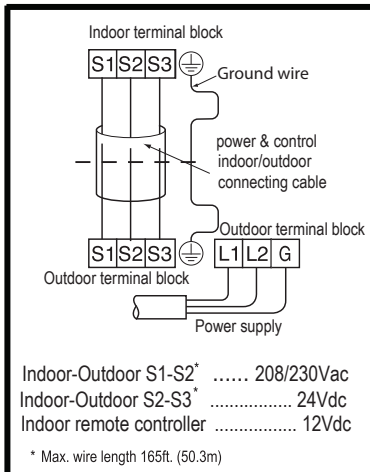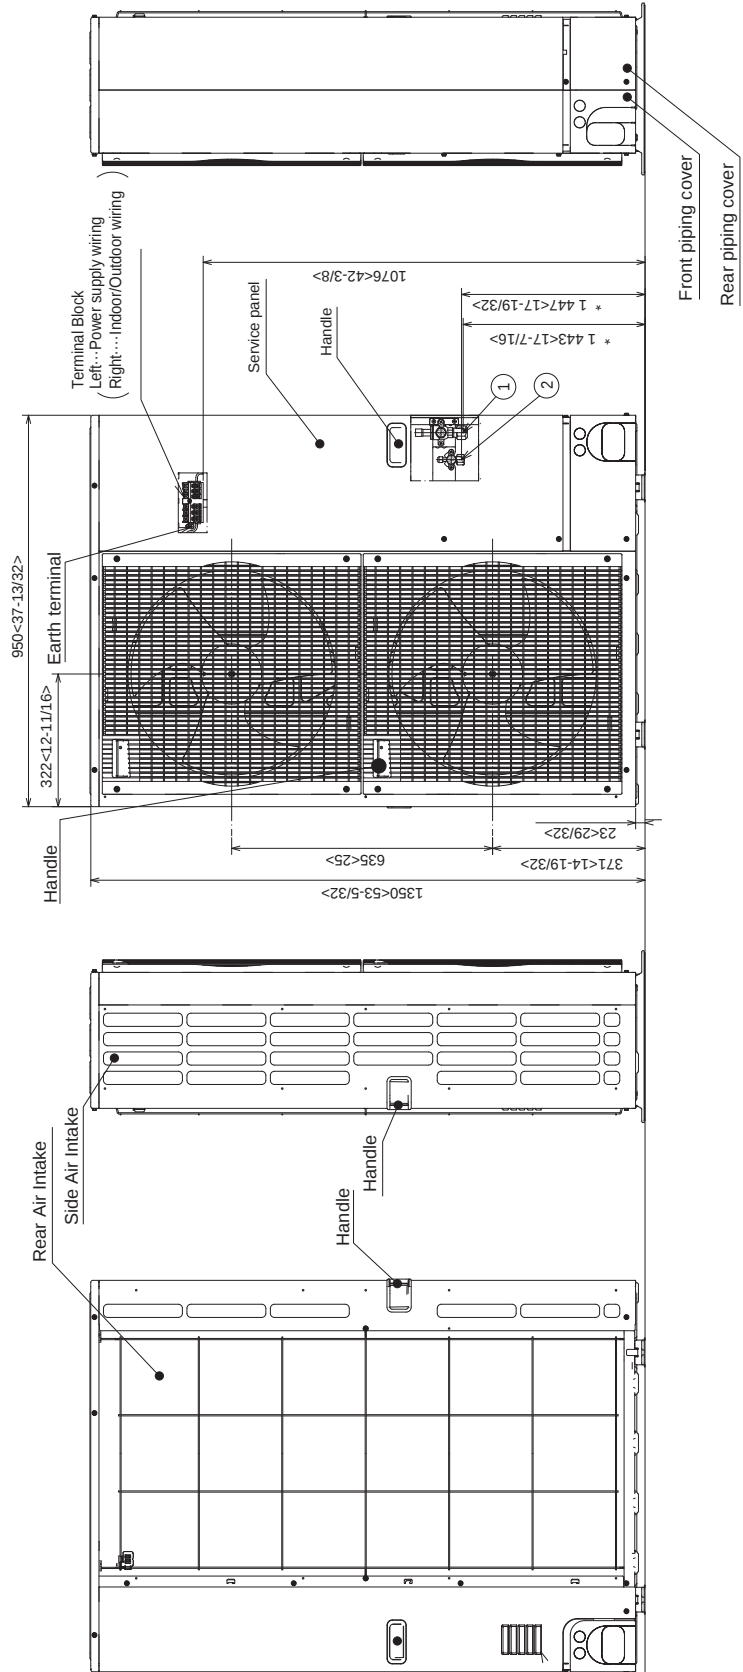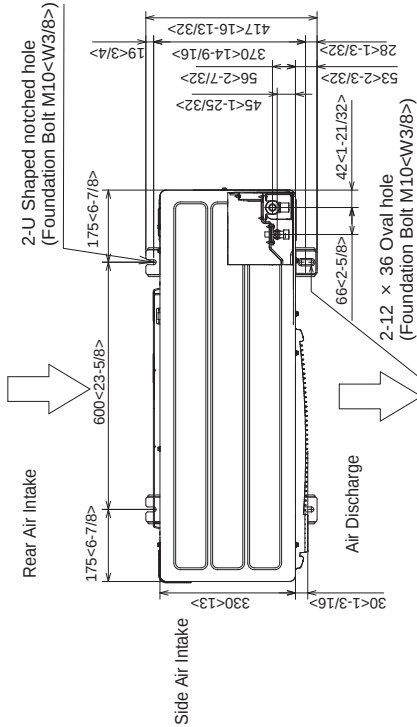

Example of Notes

- ①...Refrigerant GAS pipe connection (FLARE)/15.88<5/8>
- ②...Refrigerant LIQUID pipe connection (FLARE)/9.52<3/8>
- *1 ...Indication of STOP VALVE connection location.

Should this document be altered or changed without MESCA's permission, it becomes null and void. MESCA assumes no responsibility for any consequences in such cases.

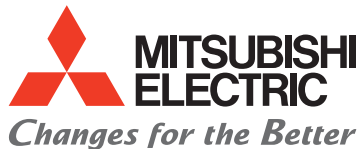

for a greener tomorrow

