


Job Name:		Location:	
Purchaser:		Submitted By:	
Submitted To:		Engineer:	
Date:		Application:	

Reference  Approval  Construction

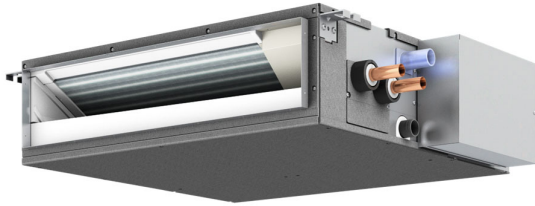

Reference Image

Model	PEFY-WL04NMSU-A
Power Source	1-phase 208/230 V, 60 Hz
Cooling Capacity Nominal (Btu/h)	4,000
Cooling Capacity Nominal (kW)	1.1
Cooling Power Input (kW)	0.024
Cooling Current Input (A, 208/230V)	0.31/0.28
Heating Capacity Nominal (Btu/h)	4,500
Heating Capacity Nominal (kW)	1.3
Heating Power Input (kW)	0.022
Heating Current Input (A)	0.26/0.23
Indoor Fan Motor FLA (A)	0.54
Minimum Circuit Ampacity (A)	0.68
External finish	Galvanized steel plate
External Dimensions (mm)	200 x 790 x 700
External Dimensions (in)	7-7/8 x 31-1/8 x 27-9/16
Net Weight (lb/kg)	41 (18.5)
Heat Exchanger	Cross fin (Aluminum fin and copper tube)
Water Volume (L)	0.5
Fan Type x Quantity	Sirocco fan x 2
Airflow, Low-Mid-High (cfm)	141 - 159 - 177
Airflow, Low-Mid-High (m <sup>3</sup> /min)	4.0 - 4.5 - 5.0
Airflow, Low-Mid-High (L/s)	67 - 75 - 83
Sound Pressure Level (dB<A>) Low-Mid-High measured in anechoic room	22-23-25
Fan Motor Type	DC motor
Fan Motor Output (kW)	0.096
External Static Pressure (in. WG)	<0.02> - 0.06 - <0.14> - <0.20>
External Static Pressure (Pa)	<5> - 15 - <35> - <50>
Insulation material	Polystyrene foam, Polyethylene foam, Urethane foam
Air Filter	PP honeycomb fabric.
Water piping diameter Connection Size Inlet (mm O.D.)	22
Water piping diameter Connection Size Outlet (mm O.D.)	22
Water piping diameter Filled Pipe Size Inlet (mm I.D.)	20
Water piping diameter Filled Pipe Size Outlet (mm I.D.)	20
Field drain pipe size (inch/mm)	O.D.1-1/4 (32)
Optional External Heater Adapter	PAC-YU25HT

**GENERAL FEATURE:**

- Compatible with CityMulti Heat Recovery Outdoor Unit and Hybrid Branch Box
- HVRF Indoor Unit with hydronic coil
- A built-in condensate lift mechanism (pump)
- Dual set point


**Notes:**

1. Nominal cooling conditions  
Indoor: 80°F D.B./67°F W.B. (26.7°C D.B./19.4°C W.B.),  
Outdoor: 95°F D.B. (35°C D.B.)  
Pipe length: 25 ft. (7.6 m), Level difference: 0 ft. (0 m)
2. The values are measured at the factory setting of external static pressure.
3. Nominal heating conditions  
Indoor: 70°F D.B. (21.1°C D.B.),  
Outdoor: 47°F D.B./43°F W.B. (8.3°C D.B./6.1°C W.B.)  
Pipe length: 25 ft. (7.6 m), Level difference: 0 ft. (0 m)
4. The factory setting of external static pressure is shown without <>.
5. Refer to 'Fan characteristics curves', according to the external static pressure, in DATA BOOK for the usable range of air flow rate.
6. Be sure to install a valve on the water inlet/outlet.
7. Install a strainer (40 mesh or more) on the pipe next to the valve to remove the foreign matters.
8. The water circuit must be a closed circuit (water is not exposed to the atmosphere).
9. All electrical work shall comply with Nation (CEC) and local codes and regulations
10. Should this document be altered or changed without MESCA's permission, it becomes null and void. MESCA assumes no responsibility for any consequences in such cases.
11. Mitsubishi Electric (MESCA) supports the use of only MESCA supplied and approved accessories. Use of non-MESCA supported accessories will affect warranty coverage.


PEFY-WL04, 06, 08, 12, 15, 18NMSU-A





Unit:mm (in.)

Model	A	B	C	D	E	F	G	H	J	K	L	M	① Water pipe from HBC	② Water pipe to HBC
PEFY-WL04NMSU-A	700	752	798	660	600	660	660	500	500	16	839	790		
PEFY-WL06NMSU-A	900	952	998	860	800	860	860	700	700	20	1039	990		
PEFY-WL08NMSU-A	1100	1152	1198	1060	1000	1060	1060	800	800	24	1239	1190		
PEFY-WL12NMSU-A	1300	1352	1398	1260	1200	1260	1260	1000	1000	28	1439	1390		
PEFY-WL15NMSU-A	1500	1552	1598	1460	1400	1460	1460	1200	1200	32	1639	1590		
PEFY-WL18NMSU-A	1700	1752	1798	1660	1600	1660	1660	1400	1400	36	1839	1790		

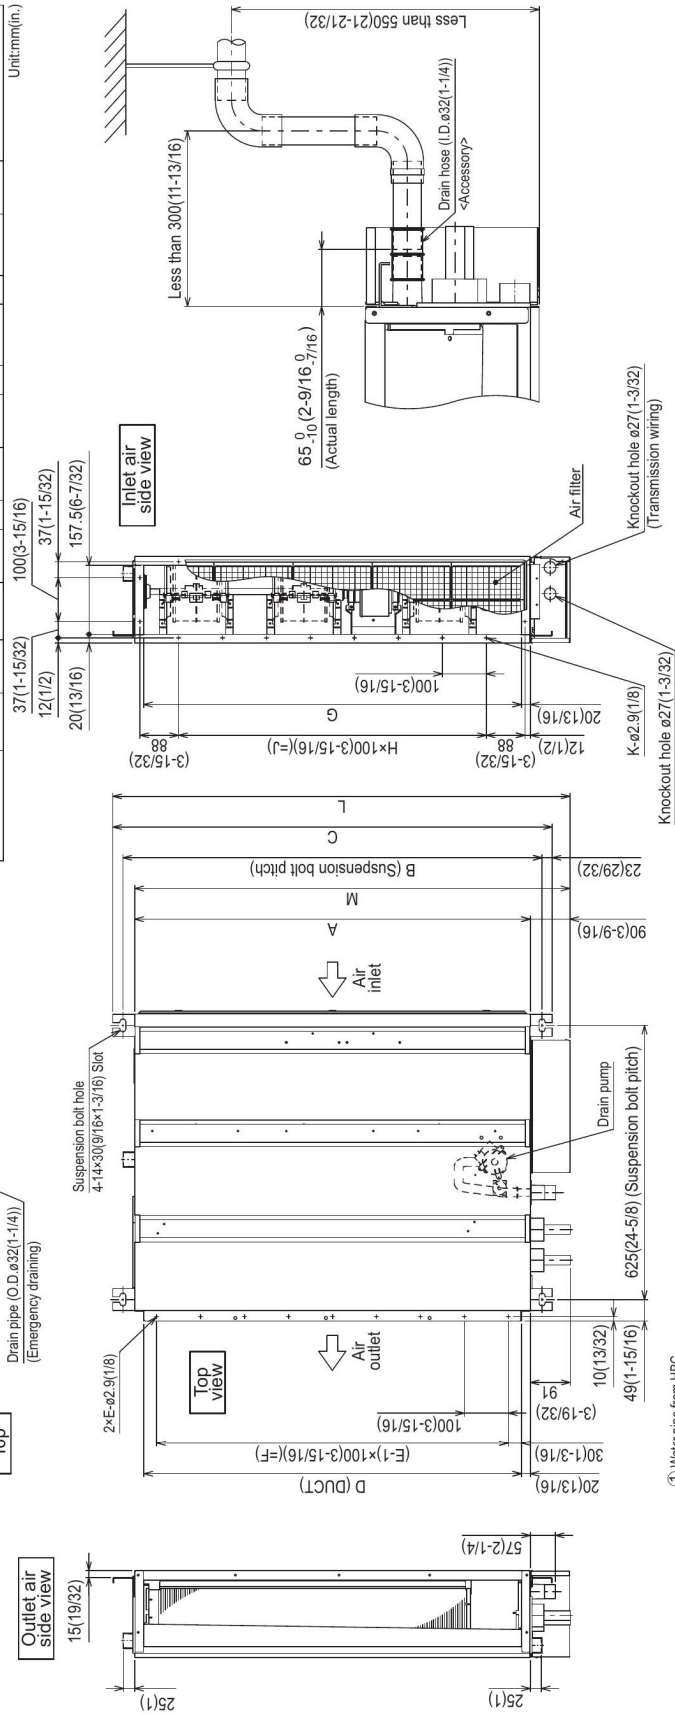

- Note 1. Use M10 screw for the suspension bolt (field supply).
- Note 2. This drawing is for PEFY-WL15 - 18NMSU-A models, which have 3 fans.
- Note 3. In case of the inlet duct is used, remove the air filter (supply with the unit), then install the filter (field supply) at suction side.

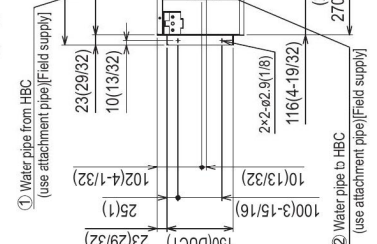

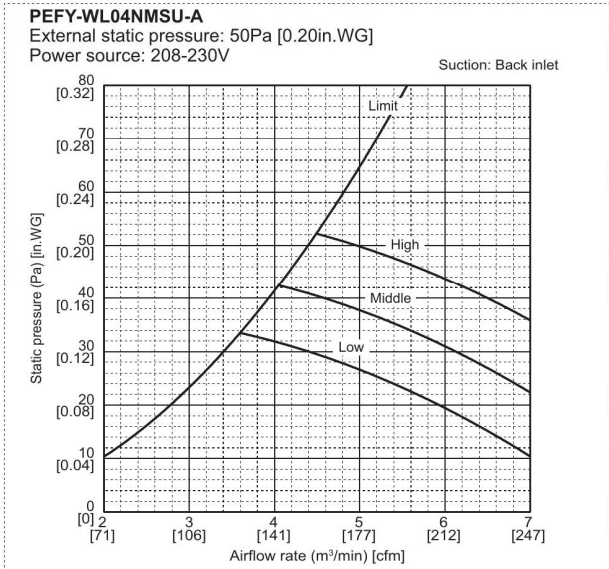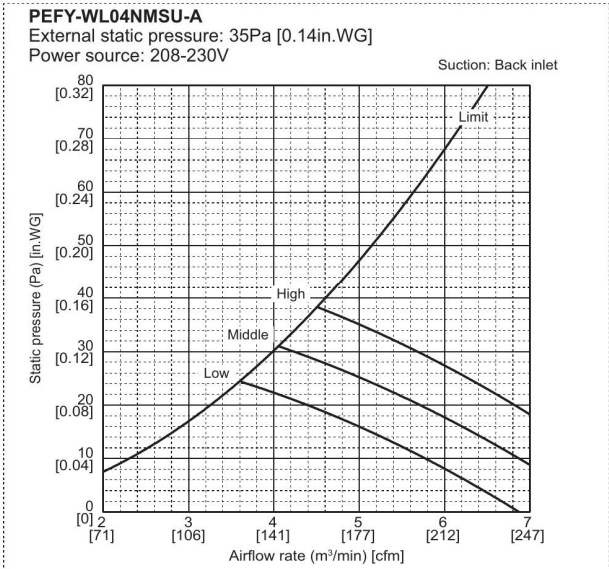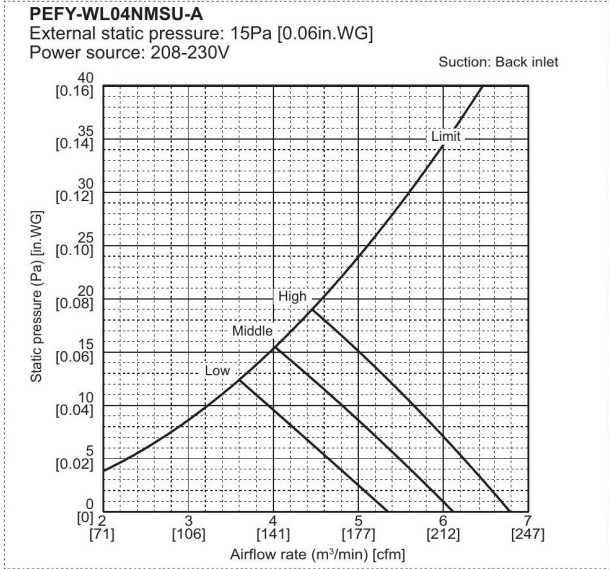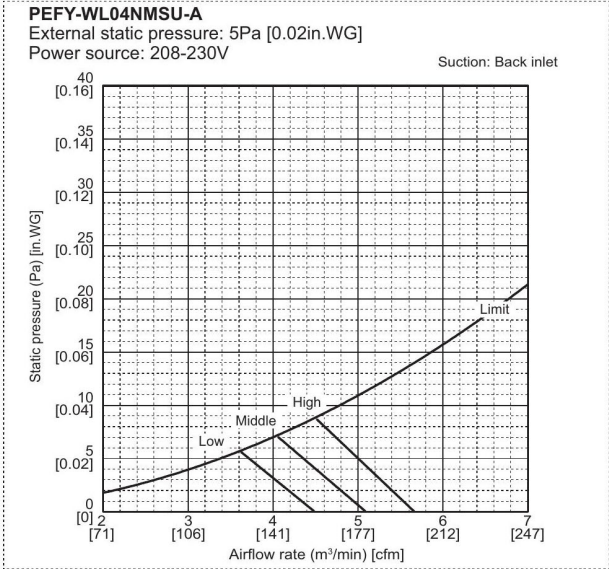

Note: Operate only within the operating range shown in the above fan characteristic curves