

Job Name:		Location:	
Purchaser:		Submitted By:	
Submitted To:		Engineer:	
Date:		Application:	

☐ Reference
 ☐ Approval
 ☐ Construction



*Reference image

GENERAL FEATURES:

- Heat pump operation
- System changeover mode available
- Water flow rate control via DC 0-10V from control board

Outdoor Model	PQHY-P336ZSLMU-B	
Power Source	3-phase 3-wire 575 V ±10% 60 Hz	
Cooling		
Cooling Capacity (Nominal)	336000	BTU/h
Cooling Capacity (Nominal)	98.5	kW
Power Input (Nominal)	26.84	kW
Current Input (Nominal)	29.9	A
Cooling Capacity (Rated)	320000	BTU/h
Cooling Capacity (Rated)	93.8	kW
Power Input (Rated) Non-Ducted/ Ducted	25.14/27.11	kW
Current Input (Rated) Non-Ducted/ Ducted	28.0/30.2	A
Guaranteed Operating Range (Indoor)	59.0°F~75.0°F W.B. (15.0°C~24.0°C)	
Guaranteed Operating Range (Outdoor)	50~113°F (10~45°C)	
Heating		
Heating Capacity (Nominal)	378000	BTU/h
Heating Capacity (Nominal)	110.8	kW
Power Input (Nominal)	20.77	kW
Current Input (Nominal)	23.1	A
Heating Capacity (Rated)	360000	BTU/h
Heating Capacity (Rated)	105.5	kW
Power Input (Rated) Non-Ducted/ Ducted	18.49/19.10	kW
Current Input (Rated) Non-Ducted/ Ducted	20.6/21.3	A
Operating Range (Indoor)	59.0°F~81.0°F D.B. (15.0°C~27.0°C)	
Operating Range (Outdoor)	50~113°F (10~45°C)	
Refrigerant Piping		
Liquid Pipe Diameter	3/4 (19.05) Brazed	
Gas Pipe Diameter	1-5/8 (41.28) Brazed	
Indoor Unit Connectable		
Total Capacity	50~130% of heat source unit capacity	
Model / Maximum Quantity	P04~P96/50	
Sound Power level (in anechoic room)	73	dB <A>


Accessories	Model Numbers
Twinning Kit	CMY-Y200CBK2
Joint	CMY-Y102SS-G2, CMY-Y102LS-G2, CMY-Y202S-G2, CMY-Y302S-G2
Header	CMY-Y104, 108, 1010C-G

Outdoor Model	PQHY-P168ZLMU-B	PQHY-P168ZLMU-B	
Electrical			
Minimum Circuit Ampacity (MCA)	21	21	A
Maximum Overcurrent Protection (MOP)	35	35	A
Circulating Water			
Circulating water flowrate	31.7 + 31.7 (120 + 120)		G/min (L/min)
Circulating water Pressure drop	6.38 (44)	6.38 (44)	psi (kPa)
Circulating water flowrate operating range	19.8 + 19.8 ~ 50.9 + 50.9 (4.5 + 4.5 ~ 11.6 + 11.6)		G/min (m3/h)
Refrigerant Piping between unit and distributor			
Liquid Pipe Diameter	5/8 (15.88) Brazed	5/8 (15.88) Brazed	in. (mm)
Gas Pipe Diameter	1-1/8 (28.58) Brazed	1-1/8 (28.58) Brazed	in. (mm)
Compressor			
Type × Quantity	Inverter scroll hermetic × 1		
Motor Output	11	11	kW
Starting Method	Inverter	Inverter	
Case Heater	0.045	0.045	kW
Lubricant	MEL32		
Physical & Finish			
External finish	Galvanized steel sheets		
External Dimensions (H × W × D)	57-1/8 x 34-11/16 x 21-11/16	57-1/8 x 34-11/16 x 21-11/16	in
External Dimensions (H × W × D)	1,450 x 880 x 550	1,450 x 880 x 550	mm
Net Weight	499 (226)	499 (226)	lb (kg)
Refrigerant			
Type × Original Charge	R410A x 13 lbs + 4 oz (6.0 kg)	R410A x 13 lbs + 4 oz (6.0 kg)	

Notes:

- Nominal cooling conditions (Test conditions are based on AHRI 1230)
Indoor: 81°F D.B./66°F W.B. (27°C D.B./19°C W.B.), Inlet water temperature: 86°F (30°C)
- Nominal heating conditions (Test conditions are based on AHRI 1230)
Indoor: 68°F D.B. (20°C D.B.), Inlet water temperature: 68°F (20°C)
- The sound values are sound power level (PWL) based on ISO 3744:2010 (r=3.5m).
Test conditions: Indoor: 81°F D.B./66°F W.B. (27°C D.B./19°C W.B.), Inlet water temperature: 86°F (30°C)
- 23°F EWT (Entering water temperature) is possible via DipSwitch Setting. Antifreeze (glycol) must be added to the water loop to prevent freezing down to 5°F
- The ambient temperature of the Heat Source Unit is to be below 104°F D.B. (40°C D.B.)
- The ambient relative humidity of the Heat Source Unit is to be below 80%.
- The Heat Source Unit should not be installed at outdoor.
- Use a strainer (more than 50 meshes) at the water inlet piping of the unit.
- Provide interlocking for the unit operation and water circuit.
- Install the supplied insulation material to the unused drain-socket.
- When installing insulation material around both water and refrigerant piping, follow the installation manual.
- The water circuit must be a closed circuit (water is not exposed to the atmosphere).
- All electrical work shall comply with Nation (CEC) and local codes and regulations
- Should this document be altered or changed without MESCA's permission, it becomes null and void. MESCA assumes no responsibility for any consequences in such cases.
- Mitsubishi Electric (MESCA) supports the use of only MESCA supplied and approved accessories. Use of non-MESCA supported accessories will affect warranty coverage.

Unit: mm(in)

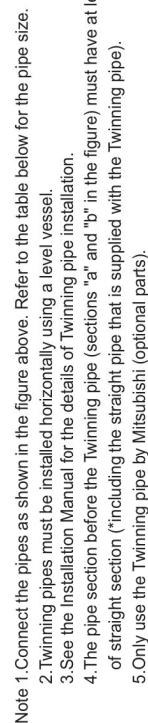


Package unit name	POHY-P288ZS1MU-B	POHY-P317ZS1MU-B	POHY-P336ZS1MU-B	POHY-P360ZS1MU-B
Heat Source unit 1	POHY-P14ZL1MU-B	POHY-P168Z1MU-B	POHY-P168Z1MU-B	POHY-P192Z1MU-B
Heat Source unit 2	POHY-P144Z1MU-B	POHY-P144Z1MU-B	POHY-P168Z1MU-B	POHY-P168Z1MU-B
Twinning Kit(optional parts)				
	CMY-Y200CBK2			
Indoor unit~Twinning pipe				
Liquid	a			
Gas	b	ø34.93(1-3/8)		ø41.28(1-5/8)
Twinning pipe~Heat Source unit 1				
Liquid	c	ø12.7(1/2)		ø15.88(5/8)
Gas	d		ø28.58(1-1/8)	
Twinning pipe~Heat Source unit 2				
Liquid	e	ø12.7(1/2)		ø15.88(5/8)
Gas	f		ø28.58(1-1/8)	


PQHY-P144, 168, 192ZLMU-B

Unit: mm(in)


- <Accessories (Packaged in the accessory kit)>
- Refrigerant (Liquid) conn. pipe 1pc.
 - Refrigerant (Gas) conn. elbow 1pc.
 - Water stopper (Liquid, Gas) 1pc. each
 - Sealing material for water stopper (Liquid, Gas) 1pc. each
 - Sealing material for field piping (Liquid, Gas) 1pc. each
 - Sealing material for drain socket 1pc.
 - Pipe cover for gas 1pc.
 - Sealing material for base leg (two types) 4 pcs. each
 - Sealing material for panel 1pc.



Top view

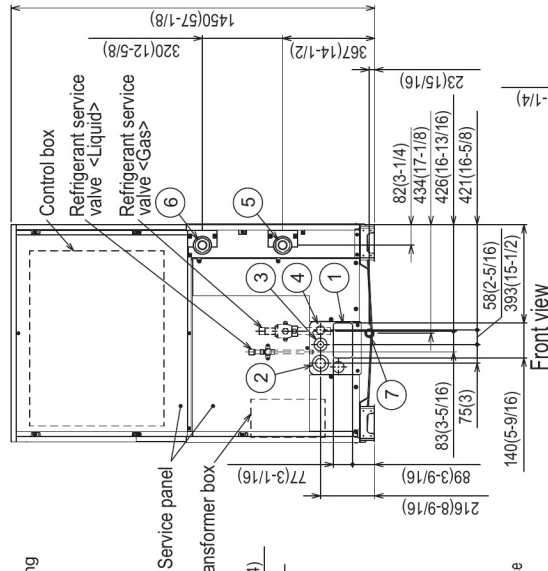


Front view

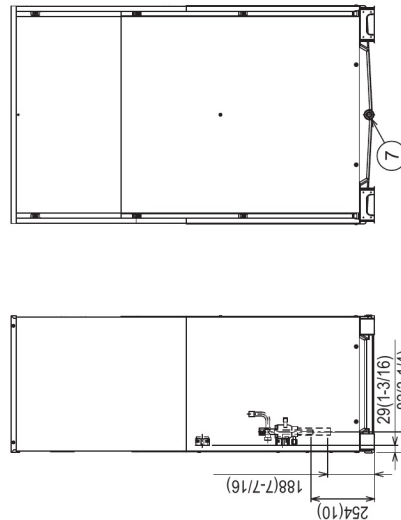

Right side view

Back view

NO.	Usage	Specifications
①	For pipes	140 x 77 Knockout hole (5-9/16) (3-1/16)
②	For wires	ø62.7 or ø34.5 Knockout hole (2-1/2) (1-3/8)
③	For transmission cables	ø43.7 or ø22.2 Knockout hole (1-3/4) (7/8)
④	For water pipe	ø34 Knockout hole (1-3/8)
⑤	Water pipe inlet	NPT1-1/2 Screw
⑥	Water pipe outlet	NPT1-1/2 Screw
⑦	Drain pipe	Rc3/4 Screw

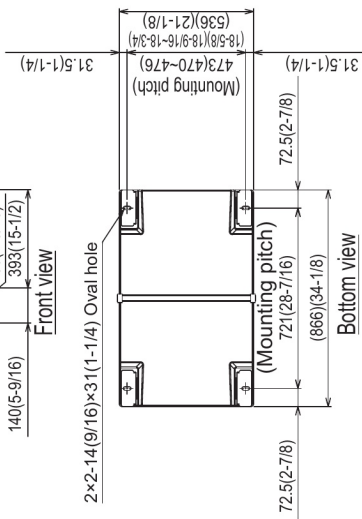

Bottom view

- Note1. Close a hole of the water piping, the refrigerant piping, the power supply, and the control wiring and unused knockout holes with the putty etc. so as not to infiltrate rain water etc. (field erection work)
- Note2. At the time of product shipment, the front side piping specification serves as the local drainage connection. When connecting on the rear side, please remove the rear side plug sealing corks, and attach a front side. Ensure there is no leak after the attachment has been fitted.
- Note3. Take notice of service space as Fig. A. (In case of single installation, 600mm(23-5/8) or more of back space as front space makes easier access when servicing the unit from rear side.)
- Note4. If water pipes or refrigerant pipes stretch upward, required space for service and maintenance due to replacement of control box is shown in Fig. B.
- Note5. Environmental condition for installation: -20~40°C (DB) (-4~104°F) as indoor installation.
- Note6. In case the temperature around the heat source unit has possibility to drop under 0°C (32°F), be careful for the following point to prevent the pipe burst by the water pipe freeze-up.
- Circulate the water all the time even if the heat source unit is not in operation.
 - Drain the water from inside of the heat source unit when the heat source unit will not operate for a long term.
- Note7. Ensure that the drain piping is downward with a pitch of more than 1/100.
- Note8. At brazing of pipes, wrap the refrigerant service valve with wet cloth and keep the temperature of refrigerant service valve under 120°C (248°F).

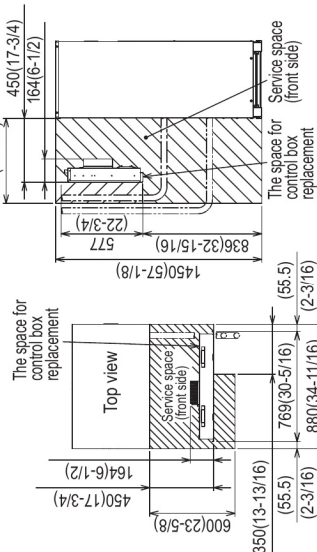


Fig. B

Fig. A

Connecting pipe specifications

Model	Diameter		
	Refrigerant pipe	Service valve	
	Liquid	Liquid	Gas
PQHY-P142ZLMU-B	ø12.7 Braze (1/2)*1*2	ø15.88 (5/8)	ø28.58 (1-1/8)
PQHY-P162ZLMU-B	ø28.58 Braze (1-1/8)*1		
PQHY-P192ZLMU-B	ø15.88 Braze (5/8)*1		

*1. Connect by using the connecting pipes and elbow that are supplied.

*2. Use the pipe joint (field supply) and connect to the refrigerant service valve piping.