

Job Name:

Schedule Reference:

Date:

**MODULAR WATER-SOURCE
VRF HEAT PUMP**

Standard Installation (*1) PQHY-P360ZSLMU-A1
 Geothermal Installation (*1)(*2) PQHY-P360ZSLMU-A1

ACCESSORIES

Twinning Kit * CMY-Y200CBK2
 Twinning Kit is necessary to combine the refrigerant flow of the modules and is sold separately.

T-Branch Joint ($\leq 72,000$ Btu/h) CMY-Y102SS-G2
 T-Branch Joint (73,000 - 144,000 Btu/h) CMY-Y102LS-G2
 T-Branch Joint (145,000 - 234,000 Btu/h) CMY-Y202S-G2
 T-Branch Joint ($\geq 235,000$ Btu/h) CMY-Y302S-G2
 Header - 4 Branch (Capacity: $\leq 72,000$ Btu/h) CMY-Y104C-G
 Header - 8 Branch (Capacity: $\leq 144,000$ Btu/h) CMY-Y108C-G
 Header - 10 Branch (Capacity: $\leq 234,000$ Btu/h) CMY-Y1010C-G

Specifications		System	Module 1	Module 2
Unit Type		PQHY-P360ZSLMU-A1	PQHY-P192ZLMU-A1	PQHY-P168ZLMU-A1
Nominal Cooling Capacity (575V) (*1)	Btu/h	360,000	192,000	168,000
Nominal Heating Capacity (575V) (*1)(*2)	Btu/h	405,000	215,000	188,000
Operating Temperature Range	Cooling (Indoor)	Refer to Module Data	59~75° F (15~24° C) WB	
	Heating (Indoor)		59~81° F (15~27° C) DB	
	Cooling (*3)		50~113° F (10~45° C)	
	Heating (*3)		50~113° F (10~45° C)	
External Dimensions (H x W x D)	In. (mm)	Refer to Module Data	57-1/8 x 34-11/16 x 21-11/16 (1450 x 880 x 550)	57-1/8 x 34-11/16 x 21-11/16 (1450 x 880 x 550)
Net Weight	Lbs. (kg)	1024 (464)	512 (232)	512 (232)
External Finish		Refer to Module Data	Galvanized steel sheet	
Electrical Power Requirements	Voltage, Phase, Hertz	Refer to Module Data (*4)	575V, 3-phase, 60Hz	
Minimum Circuit Ampacity (MCA) (*4) (*)	A	Refer to Module Data (*4)	20	16
Maximum Overcurrent Protection (MOP) (*4)	A	Refer to Module Data (*4)	30	25
Circulating Water (quality must meet regulations)				
Flow Rate	GPM	Refer to Module Data	31.7	31.7
Pressure Drop	psi		6.38	6.38
Operation Volume Range	GPM		19.8 - 50.9	19.8 - 50.9
Maximum Water Pressure	psi		290	290
Water-source Connection for Inlet and Outlet	In.		NPT1-1/2 Screw (Install strainer (more than 50 meshes) at water inlet piping of the unit)	
Piping Diameter (Brazed)				
From Twinning Kit to First Joint or Header (In. / mm)	Liquid (High Pressure)	3/4 / 19.05	Refer to System Data	Refer to System Data
	Gas (Low Pressure)	1-5/8 / 41.28	Refer to System Data	Refer to System Data
From Modules to Twinning Kit (In. / mm)	Liquid (High Pressure)	Refer to Module Data	5/8 / 15.88	5/8 / 15.88
	Gas (Low Pressure)	Refer to Module Data	1-1/8 / 28.58	1-1/8 / 28.58
Max. Total Refrigerant Line Length	Ft.	2,460	Refer to System Data	Refer to System Data
Max. Refrigerant Line Length (Bet.ODU & IDU)	Ft.	541		
Max. Control Wiring Length	Ft.	1,640		
Indoor Unit	Total Capacity	50~130%	Refer to System Data	Refer to System Data
	Model / Quantity	P06~P96 / 2~50	Refer to System Data	Refer to System Data
Sound Pressure Level	dB(A)	60	58	56
Compressor Operating Range		8% - 100%	Refer to System Data	Refer to System Data
Compressor Type x Quantity		Refer to Module Data (*4)	Inverter scroll hermetic compressor x 1	Inverter scroll hermetic compressor x 1
Refrigerant		Refer to Module Data	R410A x 13 lbs. + 4 oz. (6.0 kg)	R410A x 13 lbs. + 4 oz. (6.0 kg)
Protection Devices	High Pressure	Refer to Module Data	High pressure sensor, High pressure switch at 4.15 MPa (601 psi)	High pressure sensor, High pressure switch at 4.15 MPa (601 psi)
	Inverter Circuit		Over-heat protection, Over-current protection	Over-heat protection, Over-current protection
	Compressor		Over-heat protection	Over-heat protection
AHRI Ratings (Ducted/Non-Ducted)	EER	11.2 / 12.1	Refer to System Data	
	IEER	17.5 / 20.3	Refer to System Data	
	COP	4.64 / 5.14	Refer to System Data	

Should this document be altered or changed without MESCA's permission, it becomes null and void. MESCA assumes no responsibility for any consequences in such cases.

NOTES: (*1) <CITY MULTI indoor unit>
 Nominal cooling conditions (Test conditions are based on AHRI 1230)
 Indoor: 81°F D.B./66°F W.B. (27°C D.B./19°C W.B.),
 Water temperature: 86°F (30°C)
 Brine concentration 0%
 Nominal heating conditions (Test conditions are based on AHRI 1230)
 Indoor: 68°F D.B./20°C D.B.),
 Water temperature: 68°F (20°C)
 Brine concentration 0%

(*2) <PWFY-P36/72NMU-E-AU>
 Nominal cooling conditions
 Circulating water Temp.: 86°F (30°C)
 Pipe length: 25 ft. (7.6 m)
 Level difference: 0 ft. (0 m)
 Inlet water Temp.: 149°F (23°C)
 Water flow rate: 1.93 m³/h (8.3 gpm) <P36> / 3.86 m³/h (16.6 gpm) <P72>
 Brine concentration: 0%
 Nominal heating conditions
 Circulating water Temp.: 68°F (20°C)
 Pipe length: 25 ft. (7.6 m)
 Level difference: 0 ft. (0 m)
 Inlet water Temp.: 86°F (30°C)
 Water flow rate: 2.15 m³/h (9.2 gpm) <P36> / 4.30 m³/h (18.5 gpm) <P72>
 Brine concentration: 0%

(*3) If using circulating water temperatures between 23° and 50° F, Dip switch 3-9 must be turned on and glycol (antifreeze) must be added to the water loop to prevent freezing down to 5° F.


(*4) <Each individual module requires a separate electrical connection.

Note: Mitsubishi Electric (MESCA) supports the use of only MESCA supplied and approved accessories for proper functioning of the unit(s). Use of non-MESCA supported accessories will affect warranty coverage.

Specifications are subject to change without notice.

Module: PQHY-P360ZSLMU-A1 - DIMENSIONS

Unit: mm(in)

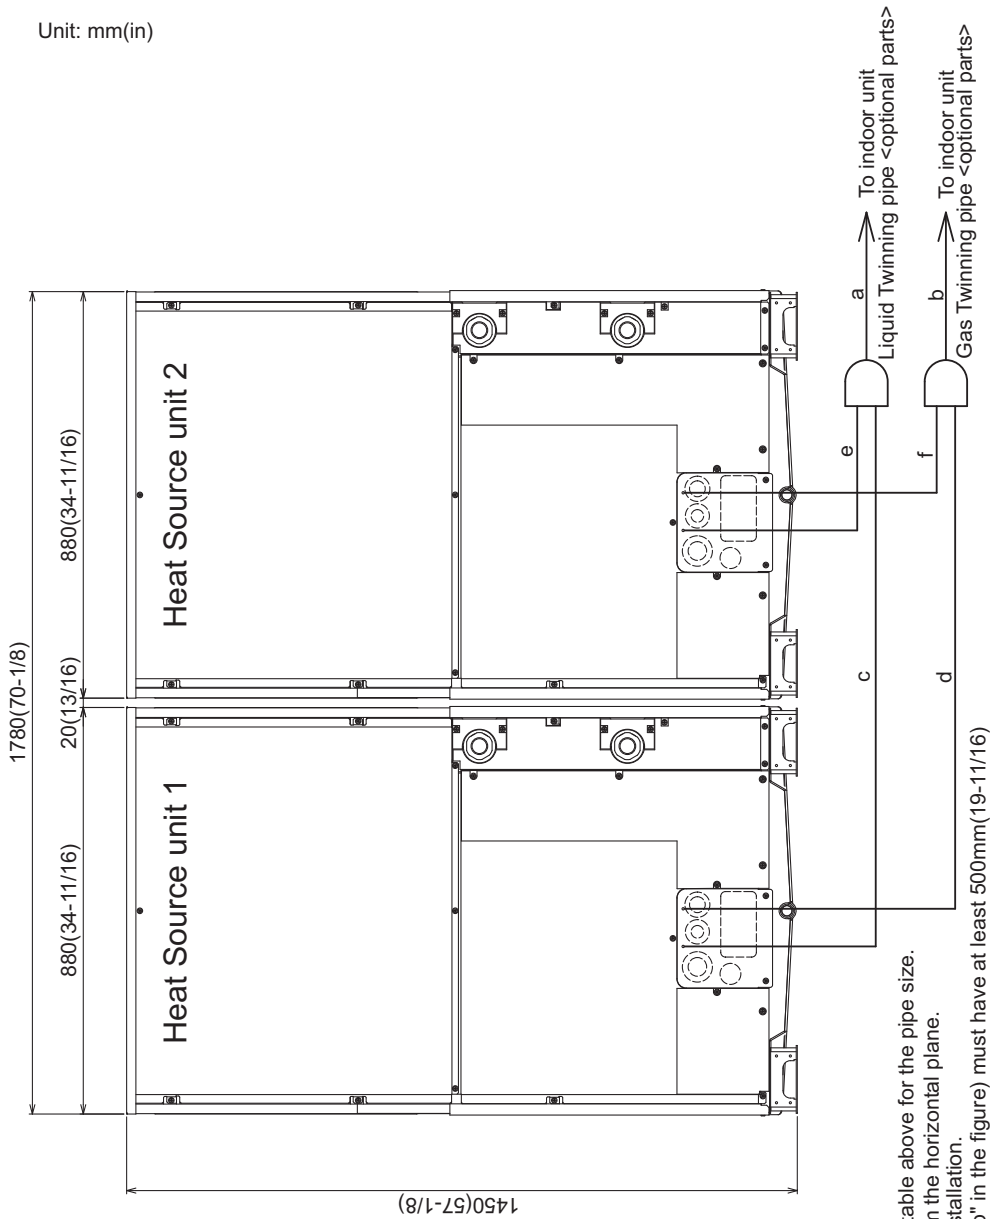

- Note 1. Connect the pipes as shown in the figure above. Refer to the table above for the pipe size.
 2. Twinning pipes should not be tilted more than 15 degrees from the horizontal plane.
 3. See the Installation Manual for the details of Twinning pipe installation.
 4. The pipe section before the Twinning pipe (sections "a" and "b" in the figure) must have at least 500mm(19-11/16) of straight section (*including the straight pipe that is supplied with the Twinning pipe).
 5. Only use the Twinning pipe by Mitsubishi (optional parts).

Twinning pipe connection size

Package unit name	PQHY-P288ZSLMU-A1	PQHY-P312ZSLMU-A1	PQHY-P360ZSLMU-A1	PQHY-P360ZSLMU-A1
Component unit name	Heat Source unit 1	PQHY-P144ZSLMU-A1	PQHY-P168ZSLMU-A1	PQHY-P192ZSLMU-A1
Heat Source unit 2	PQHY-P144ZSLMU-A1	PQHY-P168ZSLMU-A1	PQHY-P168ZSLMU-A1	PQHY-P168ZSLMU-A1
Twinning Kit(optional parts)	CMY-Y200CBK2			
Indoor unit~ Twinning pipe	Liquid a	Gas b	ø19.05(3/4)	
Twinning pipe~Heat Source unit 1	Liquid c	Gas d	ø34.93(1-3/8)	ø41.28(1-5/8)
	Liquid e	Gas f	ø12.7(1/2)	ø15.88(5/8)
Twinning pipe~Heat Source unit 2	Liquid e	Gas f	ø28.58(1-1/8)	ø15.88(5/8)
	Liquid e	Gas f	ø12.7(1/2)	ø28.58(1-1/8)


Specifications are subject to change without notice.

Modules: 1, 2 : PQHY-P168_192ZLMU-A1 - DIMENSIONS


Unit: mm(in)

<Accessories>

- Refrigerant (Liquid) conn. pipe..... 1pc.
(P144/P168/P192; Packaged in the accessory kit)
- Refrigerant (Gas) conn. elbow..... 1pc.
(P144/P168/P192; Packaged in the accessory kit)
- Water stopper(Liquid Gas)..... 1pc. each
(P144/P168/P192; Packaged in the accessory kit)
- Sealing material for water stopper (Liquid Gas)..... 1pc. each
(P144/P168/P192; Packaged in the accessory kit)
- Sealing material for field piping (Liquid Gas)..... 1pc. each
(P144/P168/P192; Packaged in the accessory kit)
- Sealing material for drain socket..... 1pc.
(P144/P168/P192; Packaged in the accessory kit)
- Pipe cover for gas..... 1pc.
(P144/P168/P192; Packaged in the accessory kit)
- Sealing material for base leg (two types)..... 4pcs. each
(P144/P168/P192; Packaged in the accessory kit)
- Sealing material for panel..... 1pc.
(P144/P168/P192; Packaged in the accessory kit)



Top view

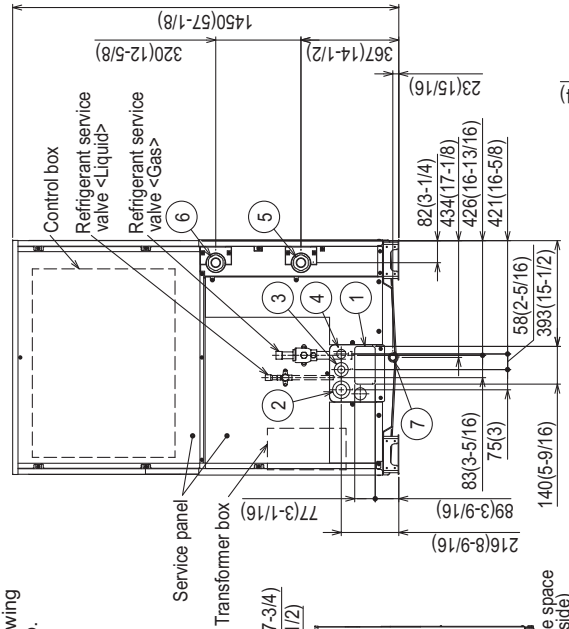


Front view

NO.	Usage	Specifications
①	For pipes	140 x 77 Knockout hole (5-9/16) (3-1/16)
②	For wires	ø2.7 or ø3.4.5 Knockout hole (2-1/2) (1-3/8)
③	For transmission cables	ø43.7 or ø22.2 Knockout hole (1-3/4) (7/8)
④	For transmission	ø34 Knockout hole (1-3/8)
⑤	Water pipe inlet	NPT1-1/2 Screw
⑥	Water pipe outlet	NPT1-1/2 Screw
⑦	Drain pipe	Rc3/4 Screw

Back view

Right side view

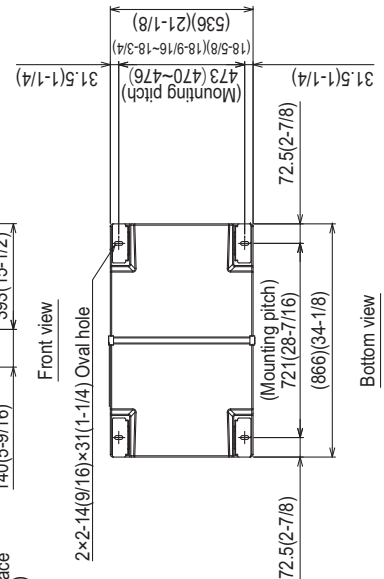

Bottom view

Note1. Close a hole of the water piping, the refrigerant piping, the power supply, and the control wiring and unused knockout holes with the putty etc. so as not to infiltrate rain water etc. (field erection work)

Note2. At the time of product shipment, the front side piping specification serves as the local drainage connection. When connecting on the rear side, please remove the rear side plug sealing corks, and attach a front side.

Note3. Ensure there is no leak after the attachment has been fitted. Take notice of service space as Fig.A. (In case of single installation, 600mm(23-5/8) or more of back space as front space makes easier access when servicing the unit from rear side.)

Note4. If water pipes or refrigerant pipes stretch upward, required space for service and maintenance due to replacement of control box is shown in Fig.B.

Note5. Environmental condition for installation: -20~40°C(DB)(-4~104°F) as indoor installation.

Note6. In case the temperature around the heat source unit has possibility to drop under 0°C(32°F), be careful for the following point to prevent the pipe burst by the water pipe freeze-up.

Note7. Circulate the water all the time even if the heat source unit is not in operation.

Note8. Drain the water from inside of the heat source unit when the heat source unit will not operate for a long term.

Note9. Ensure that the drain piping is downward with a pitch of more than 1/100.

Note10. At brazing of pipes, wrap the refrigerant service valve with wet cloth and keep the temperature of refrigerant service valve under 120°C(248°F).

Note11. The space for control box replacement

Note12. The space for service space replacement

Note13. The space for service space replacement

Note14. The space for service space replacement

Note15. The space for service space replacement

Note16. The space for service space replacement

Note17. The space for service space replacement

Note18. The space for service space replacement

Note19. The space for service space replacement

Note20. The space for service space replacement

Note21. The space for service space replacement

Note22. The space for service space replacement

Note23. The space for service space replacement

Note24. The space for service space replacement

Note25. The space for service space replacement

Note26. The space for service space replacement

Note27. The space for service space replacement

Note28. The space for service space replacement

Note29. The space for service space replacement

Note30. The space for service space replacement

Note31. The space for service space replacement

Note32. The space for service space replacement

Note33. The space for service space replacement

Note34. The space for service space replacement

Note35. The space for service space replacement

Note36. The space for service space replacement

Note37. The space for service space replacement

Note38. The space for service space replacement

Note39. The space for service space replacement

Note40. The space for service space replacement

Note41. The space for service space replacement

Note42. The space for service space replacement

Note43. The space for service space replacement

Note44. The space for service space replacement

Note45. The space for service space replacement

Note46. The space for service space replacement

Note47. The space for service space replacement

Note48. The space for service space replacement

Note49. The space for service space replacement

Note50. The space for service space replacement

Note51. The space for service space replacement

Note52. The space for service space replacement

Note53. The space for service space replacement

Note54. The space for service space replacement

Note55. The space for service space replacement

Note56. The space for service space replacement

Note57. The space for service space replacement

Note58. The space for service space replacement

Note59. The space for service space replacement

Note60. The space for service space replacement

Note61. The space for service space replacement

Note62. The space for service space replacement

Note63. The space for service space replacement

Note64. The space for service space replacement

Note65. The space for service space replacement

Note66. The space for service space replacement

Note67. The space for service space replacement

Note68. The space for service space replacement

Note69. The space for service space replacement

Note70. The space for service space replacement

Note71. The space for service space replacement

Note72. The space for service space replacement

Note73. The space for service space replacement

Note74. The space for service space replacement

Note75. The space for service space replacement

Note76. The space for service space replacement

Note77. The space for service space replacement

Note78. The space for service space replacement

Note79. The space for service space replacement

Note80. The space for service space replacement

Note81. The space for service space replacement

Note82. The space for service space replacement

Note83. The space for service space replacement

Note84. The space for service space replacement

Note85. The space for service space replacement

Note86. The space for service space replacement

Note87. The space for service space replacement

Note88. The space for service space replacement

Note89. The space for service space replacement

Note90. The space for service space replacement

Note91. The space for service space replacement

Note92. The space for service space replacement

Note93. The space for service space replacement

Note94. The space for service space replacement

Note95. The space for service space replacement

Note96. The space for service space replacement

Note97. The space for service space replacement

Note98. The space for service space replacement

Note99. The space for service space replacement

Note100. The space for service space replacement

Fig.A

Fig.B

Connecting pipe specifications


Model	Diameter		Service valve
	Refrigerant pipe	Gas	
PQHY-P46ZLMU-A1	ø12.7 Braze (1/2) *2	ø28.58 Braze (1-1/8) *1	ø28.58 (1-1/8)
PQHY-P68ZLMU-A1	ø15.88 Braze (5/8) *1	ø15.88 (5/8)	ø15.88 (5/8)
PQHY-P92ZLMU-A1	ø15.88 Braze (5/8) *1	ø15.88 (5/8)	ø15.88 (5/8)

*1. Connect by using the connecting pipes and elbow that are supplied.

*2. Use the pipe joint(field supply) and connect to the refrigerant service valve piping.


CMY-Y200CBK2

For Gas pipe:

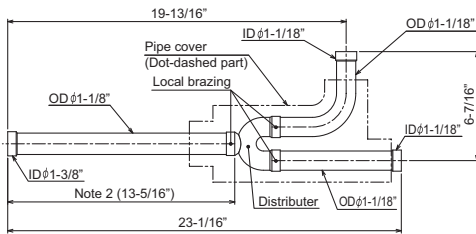


ID: Inner Diameter OD: Outer Diameter


For Liquid pipe:

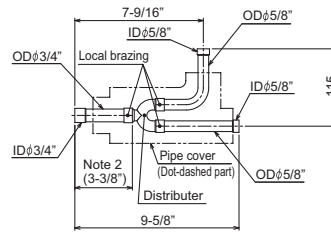

<Deformed pipe(Accessory)>



Note 1. Reference the attitude angle of the branch pipe below the fig.




The angle of the branch pipe for high pressure is within $\pm 15^\circ$ against the horizontal plane.

2. Use the attached pipe to braze the port-opening of the distribute
3. Pipe diameter is indicated by inside diameter
4. Only use the Twinning pipe by Mitsubishi (optional parts)

Should this document be altered or changed without MESCA's permission, it becomes null and void. MESCA assumes no responsibility for any consequences in such cases.

Notes:

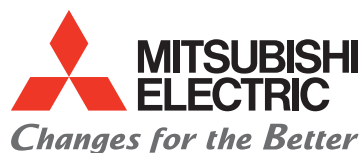

for a greener tomorrow

